
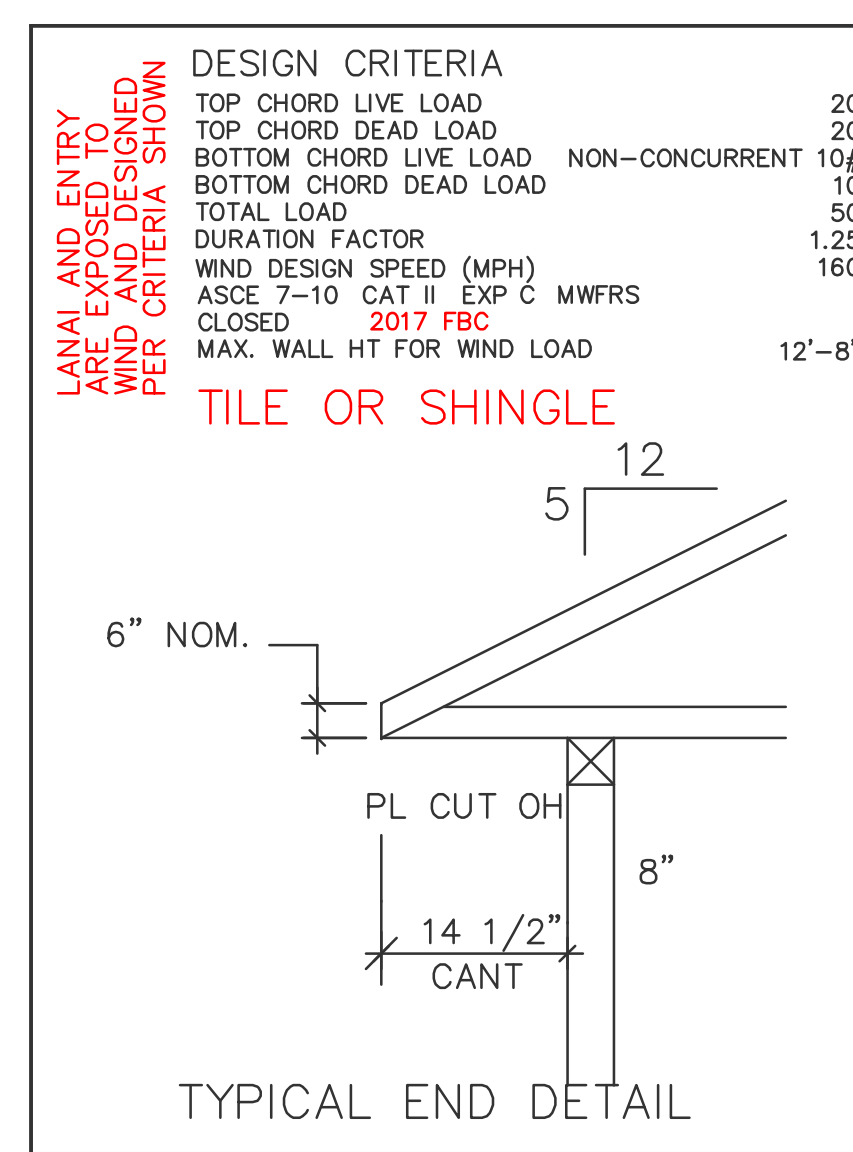


TYPICAL JACK CUTS

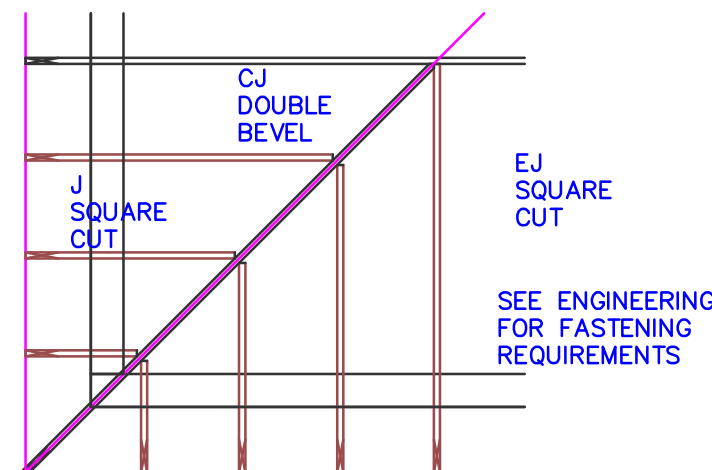

****UNLESS NOTED****

REACTION VALUES ARE UNDER 5000#

UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE

*****CAUTION*****








DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING
DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION,
ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY
SHEET FOR HANDLING METHODS & TEMPORARY
BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA
CORP. "+/-" BEARING DIFFERENCES SHOWN ARE CRITICAL
IF ANY HEIGHTS DEVIATE - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

9'-4" A.F.F.		0'-0"	ELEV.
12'-8" A.F.F.		+3'-4"	ELEV.
			ELEV.
			ELEV.
			ELEV.
			ELEV.
			ELEV.

HANGER SCHEDULE

(C) USP HUS 26 (M) USP THDH 28-3
(F) USP HUS 28 (N) USP THD 48
(H) USP THDH 28 (P) USP JUS 24
(I) USP THDH 28-2 (B) USP MSH 422
(W) USP HJC 26 (X)

HANGER VALUES HAVE BEEN BASED ON 16D
COMMON NAILS EXCEPT THE FOLLOWING
LUS24 - 10D COMMON THJA26 - 10D x 1-1/2

*****ATTENTION*****

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS, PITCHES, OVERHANGS, ELEVATIONS, CEILING & BEARING CONDITIONS. SCOSTA CORPORATION IS RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH PLANS AND/OR INFORMATION PROVIDED BY CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN. CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF INFORMATION AND PLANS PROVIDED TO SCOSTA CORPORATION, AND TO VERIFY CONFORMANCE TO FIELD CONDITIONS, AND/OR OWNER CHANGES. TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE APPROVED LAYOUT.

APPROVED BY: _____

DATE: _____ REQUESTED DELIVERY DATE: _____

JOBSITE CONTACT NAME: _____

PHONE #: _____

E-MAIL: _____

SCOSTA CORP.


WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES

3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242


SCALE: 1/4"=1'-0"	DATE: 08/13/18	REVISED BY: KD 10/28/18	DRAWN BY: KRISTY
JOB ADDRESS: 2197 ELEV A GARAGE RIGHT LEE/COLLIER/CHARLOTTE			1 OF 1
CUSTOMER: D.R. HORTON			JOB # 44134




Z:\MASTER\2018 BUILDERS\2018 DR HORTON\SUBDIVISIONS\BURN'T STORE\10782 LOT 16
BLK 364 2197 ARREV\10782 2197 AR.v4

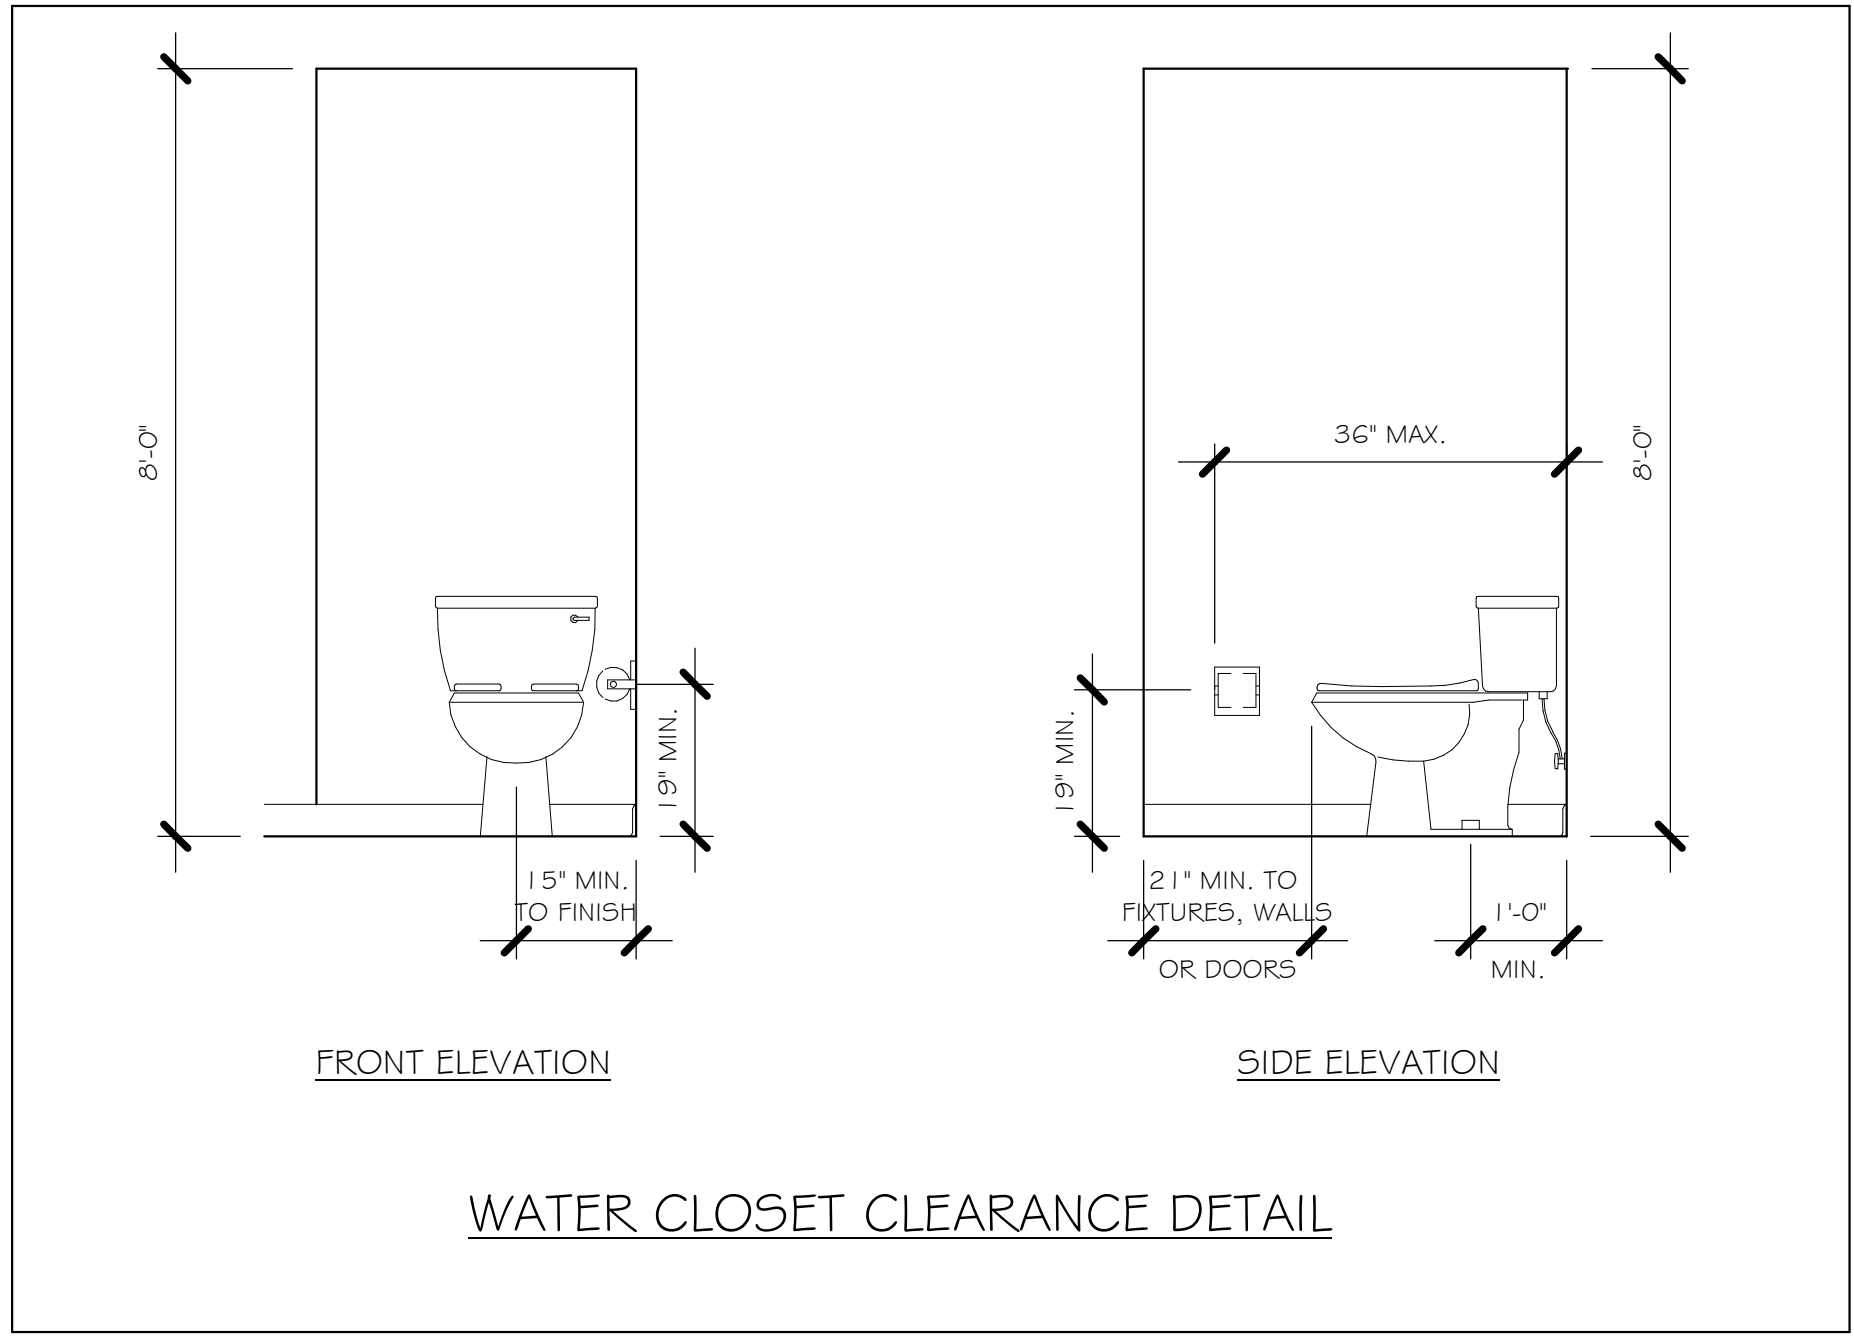

WATER CLOSET CLEARANCE DETAIL

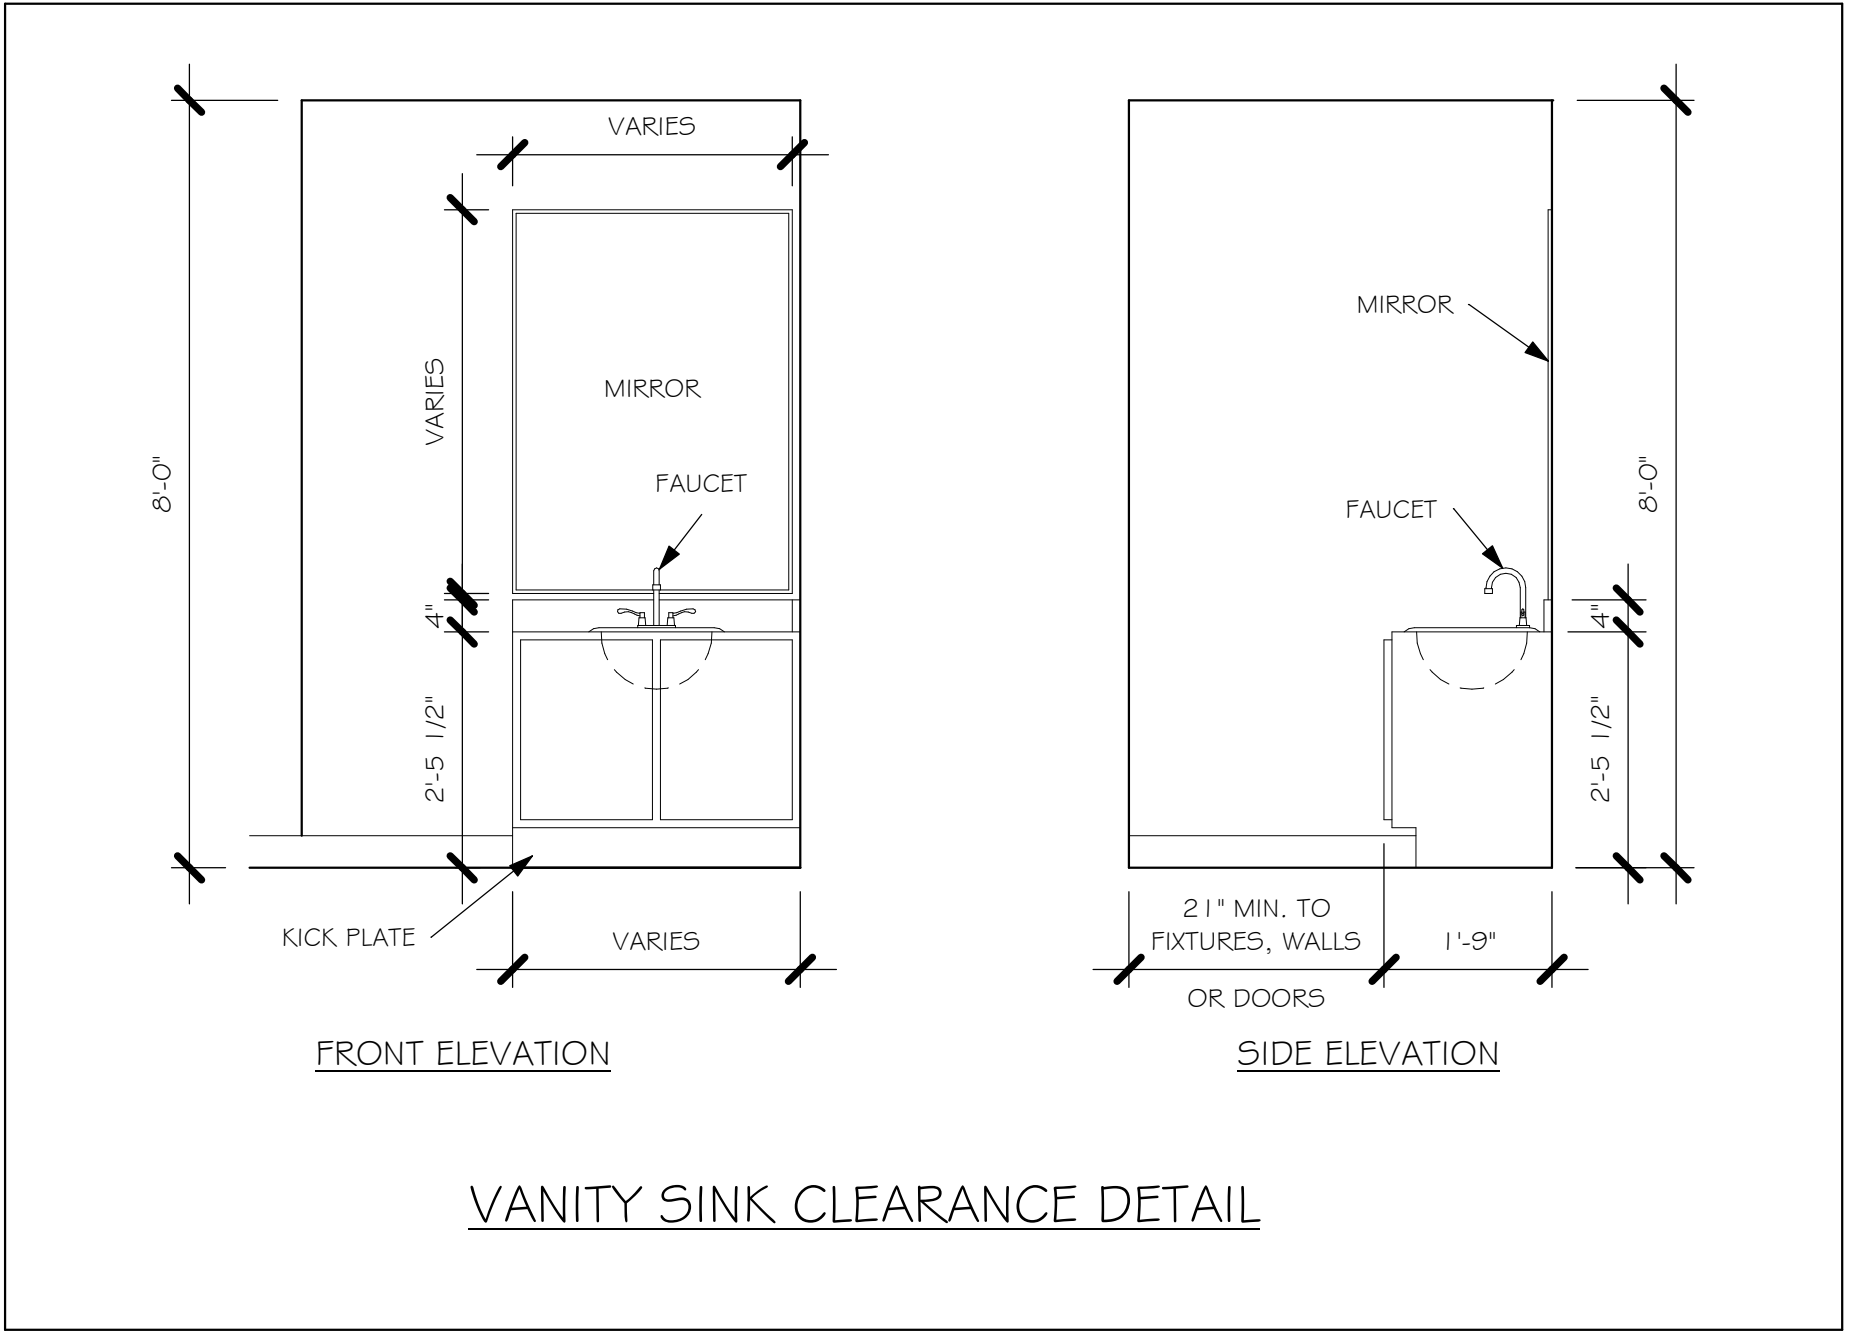

VANITY SINK CLEARANCE DETAIL

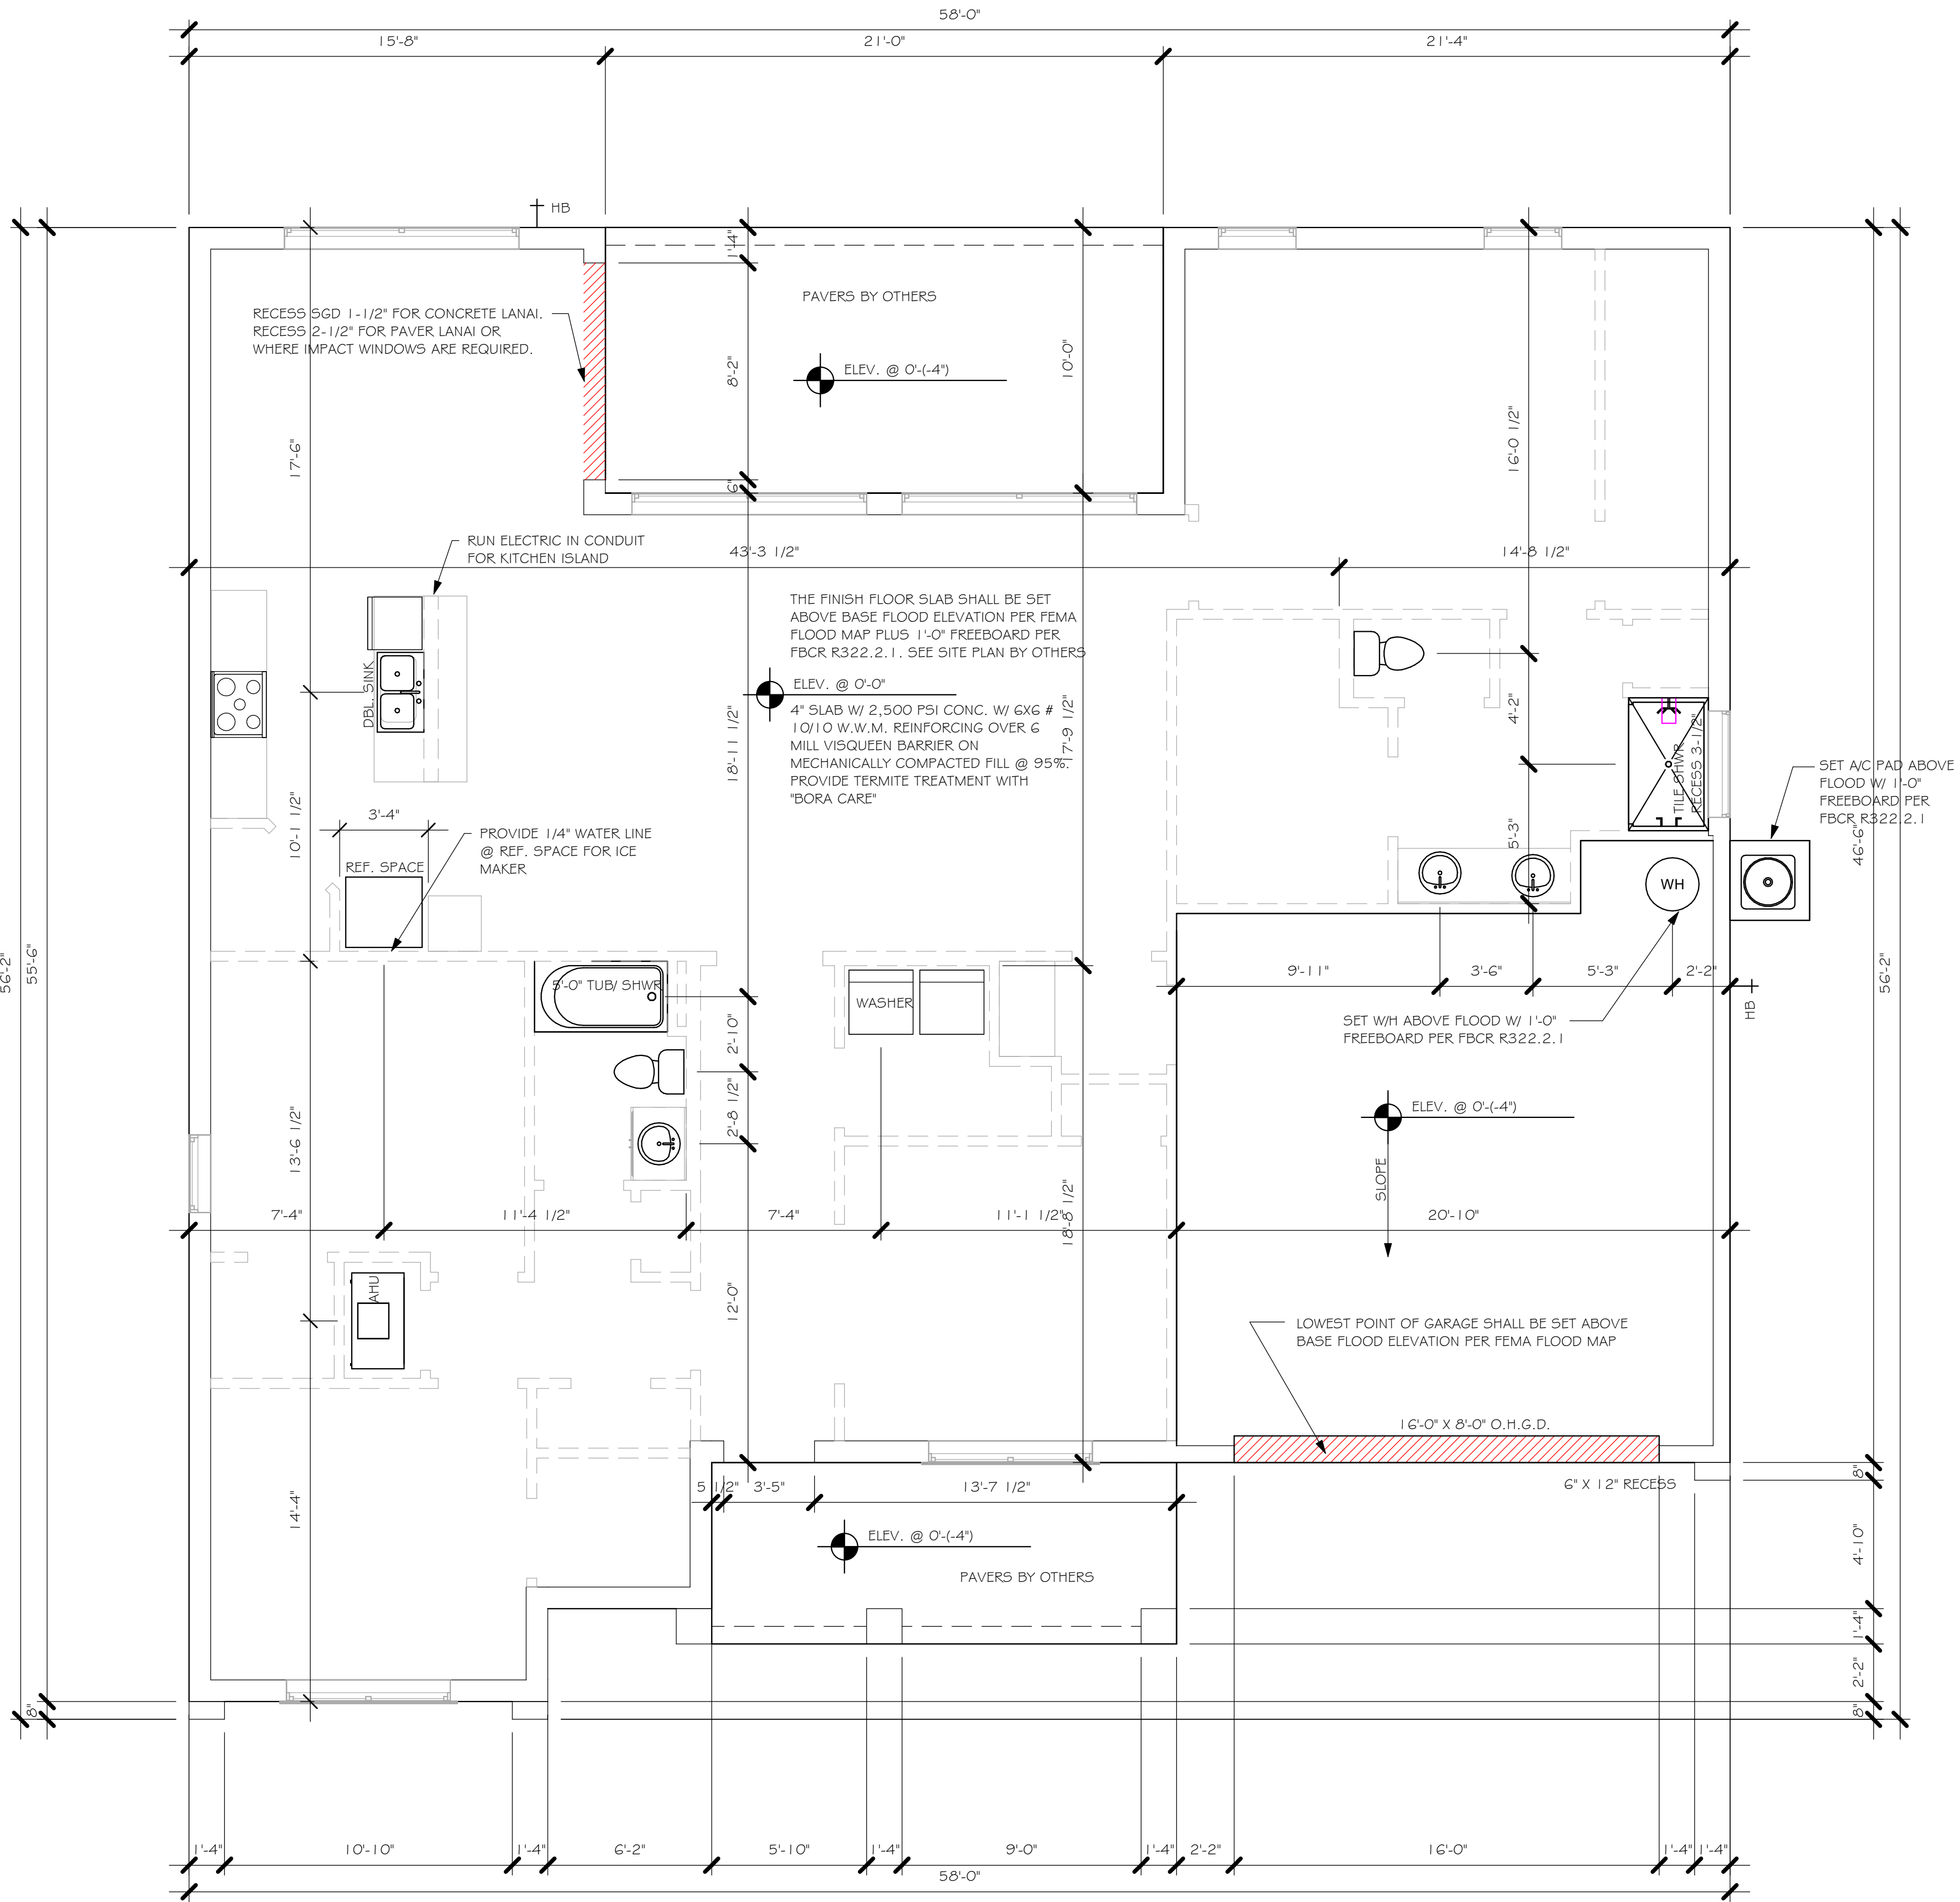

SLAB & PLUMBING PLAN "AR"
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

Z:\MASTER\2018 BUILDERS\2018 DR HORTON\SUBDIVISIONS\BURNST STORE\10782 LOT 1 G
BLK 364 2197 ARREV\10782 2197 AR.v4

DOOR SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	WIDTH	HEIGHT	COMMENTS	QTY
1	16080 OHGD		1'6"-0"	8'-0"		1
2	3080 ENTRY		3'-0"	8'-0"		1
3	2-4080 SL. GL. DR.		8'-0"	8'-0"		1


WINDOW SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	COMMENTS	QTY
A	2-25 SH		5'-1"	6'-2"		1
B	2-26 SH		6'-2"	6'-2"		1
C	48" X 16"	FIXED GLASS	1'-4"	4'-0"		1
D	25 SH		5'-1"	2'-1 1/2"		3
E	2-35 SH		5'-1"	8'-1 0"		3

OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-10"	B.F. = BI-FOLD DOOR
3	2'-8"	B.F. = BI-FOLD DOOR
4	2'-6"	B.P. = BI-PASS DOOR
5	2'-4"	B.P. = BI-PASS DOOR
6	2'-0"	L.V. = LOUVERED DOOR
7	1'-8"	
8	1'-6"	

SQUARE FOOTAGE		
ENTRY AREA		121 SF
LANAI AREA		210 SF
GARAGE AREA		446 SF
LIVING AREA		2196 SF
TOTAL AREA		2973 SF


BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F.
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

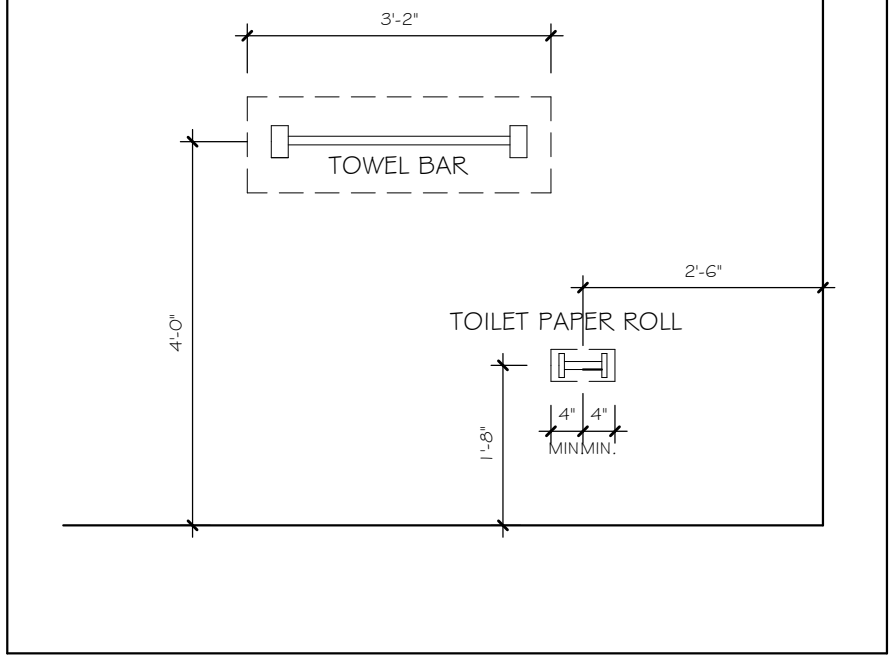



DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

- PLAN NOTES
- 1) VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
 - 2) PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R.308.4.2.
 - 3) PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R.308.4.5.
 - 4) NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
 - 5) PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
 - 6) KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
 - 7) INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
 - 8) WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
 - 9) THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE # ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSUM BOARD OR EQUIVALENT
 - 10) INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.
 - 11) ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
 - 12) ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

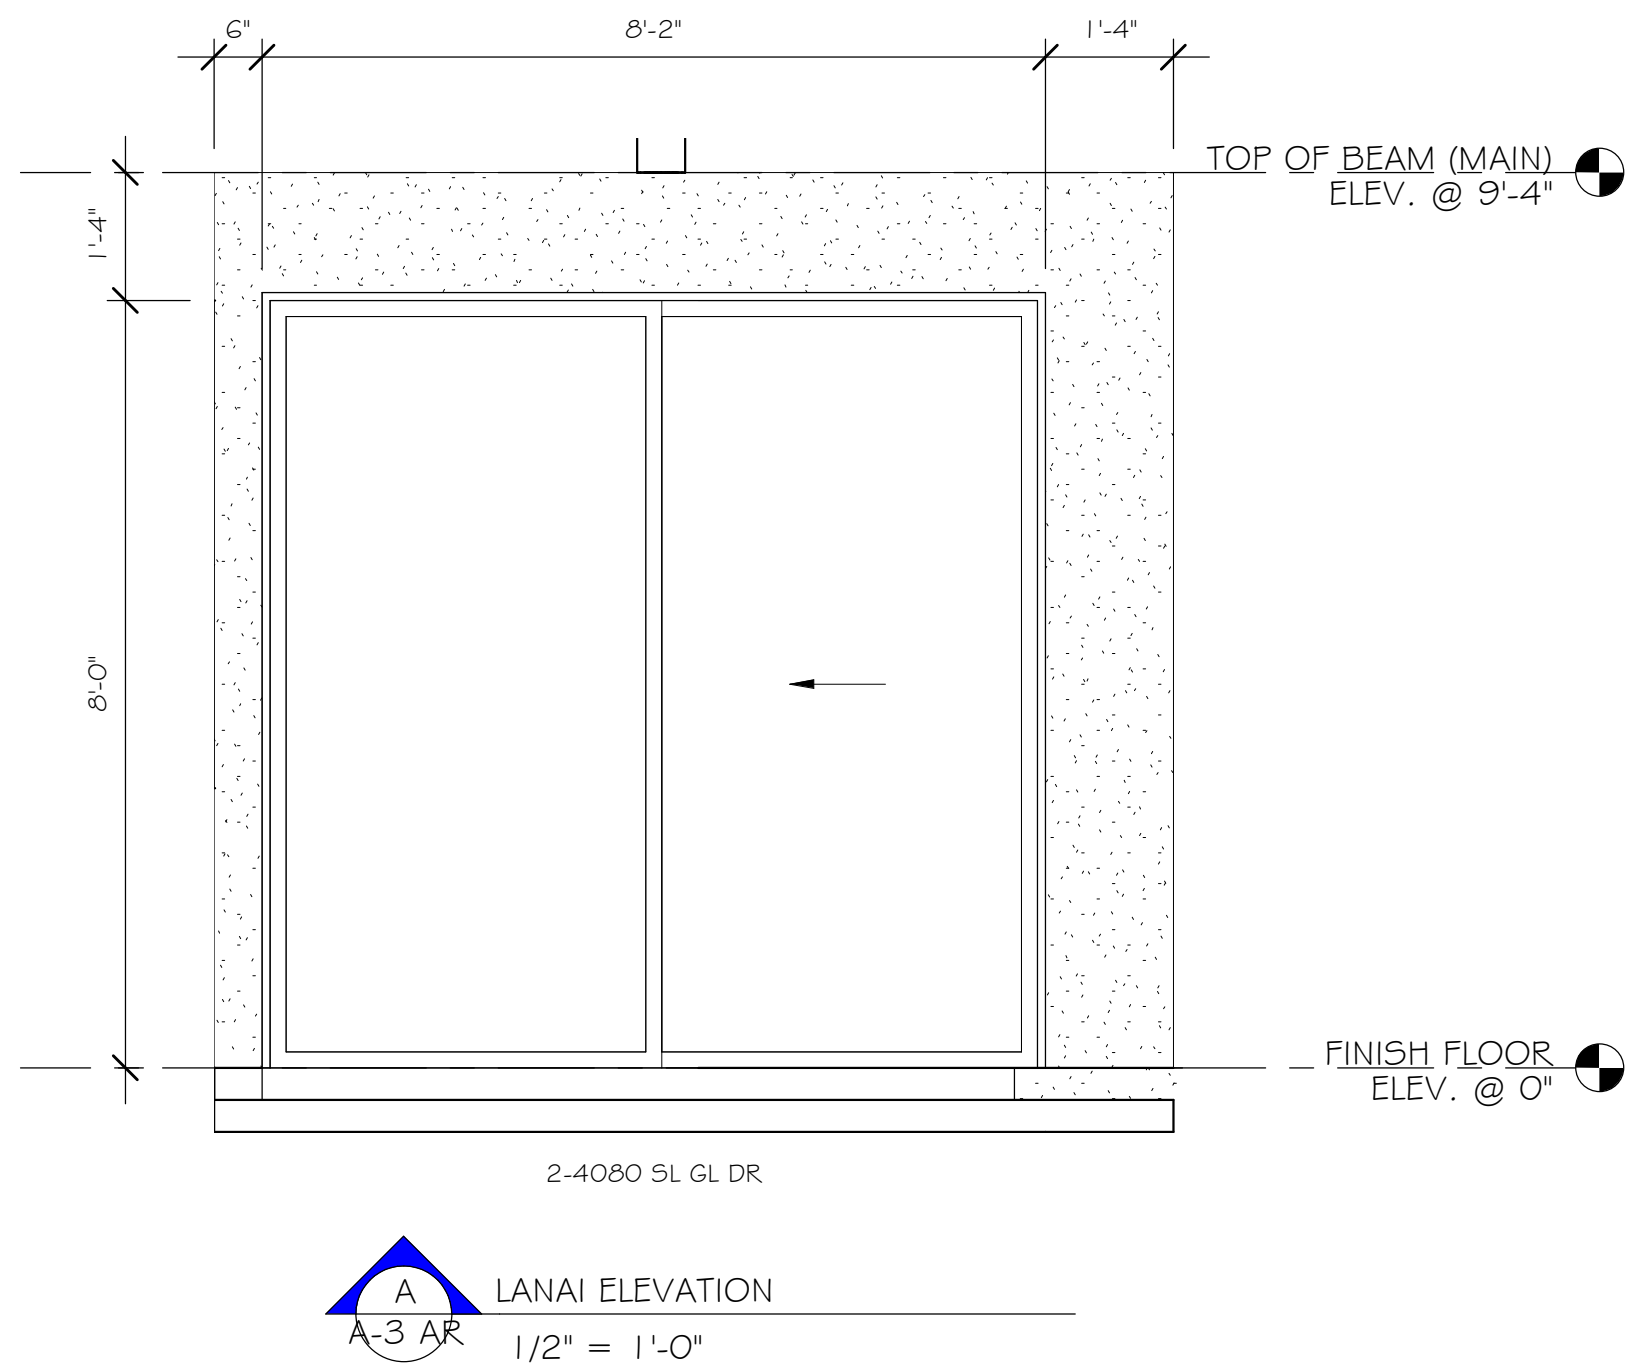

A-3 AR
LANAI ELEVATION
1/2" = 1'-0"

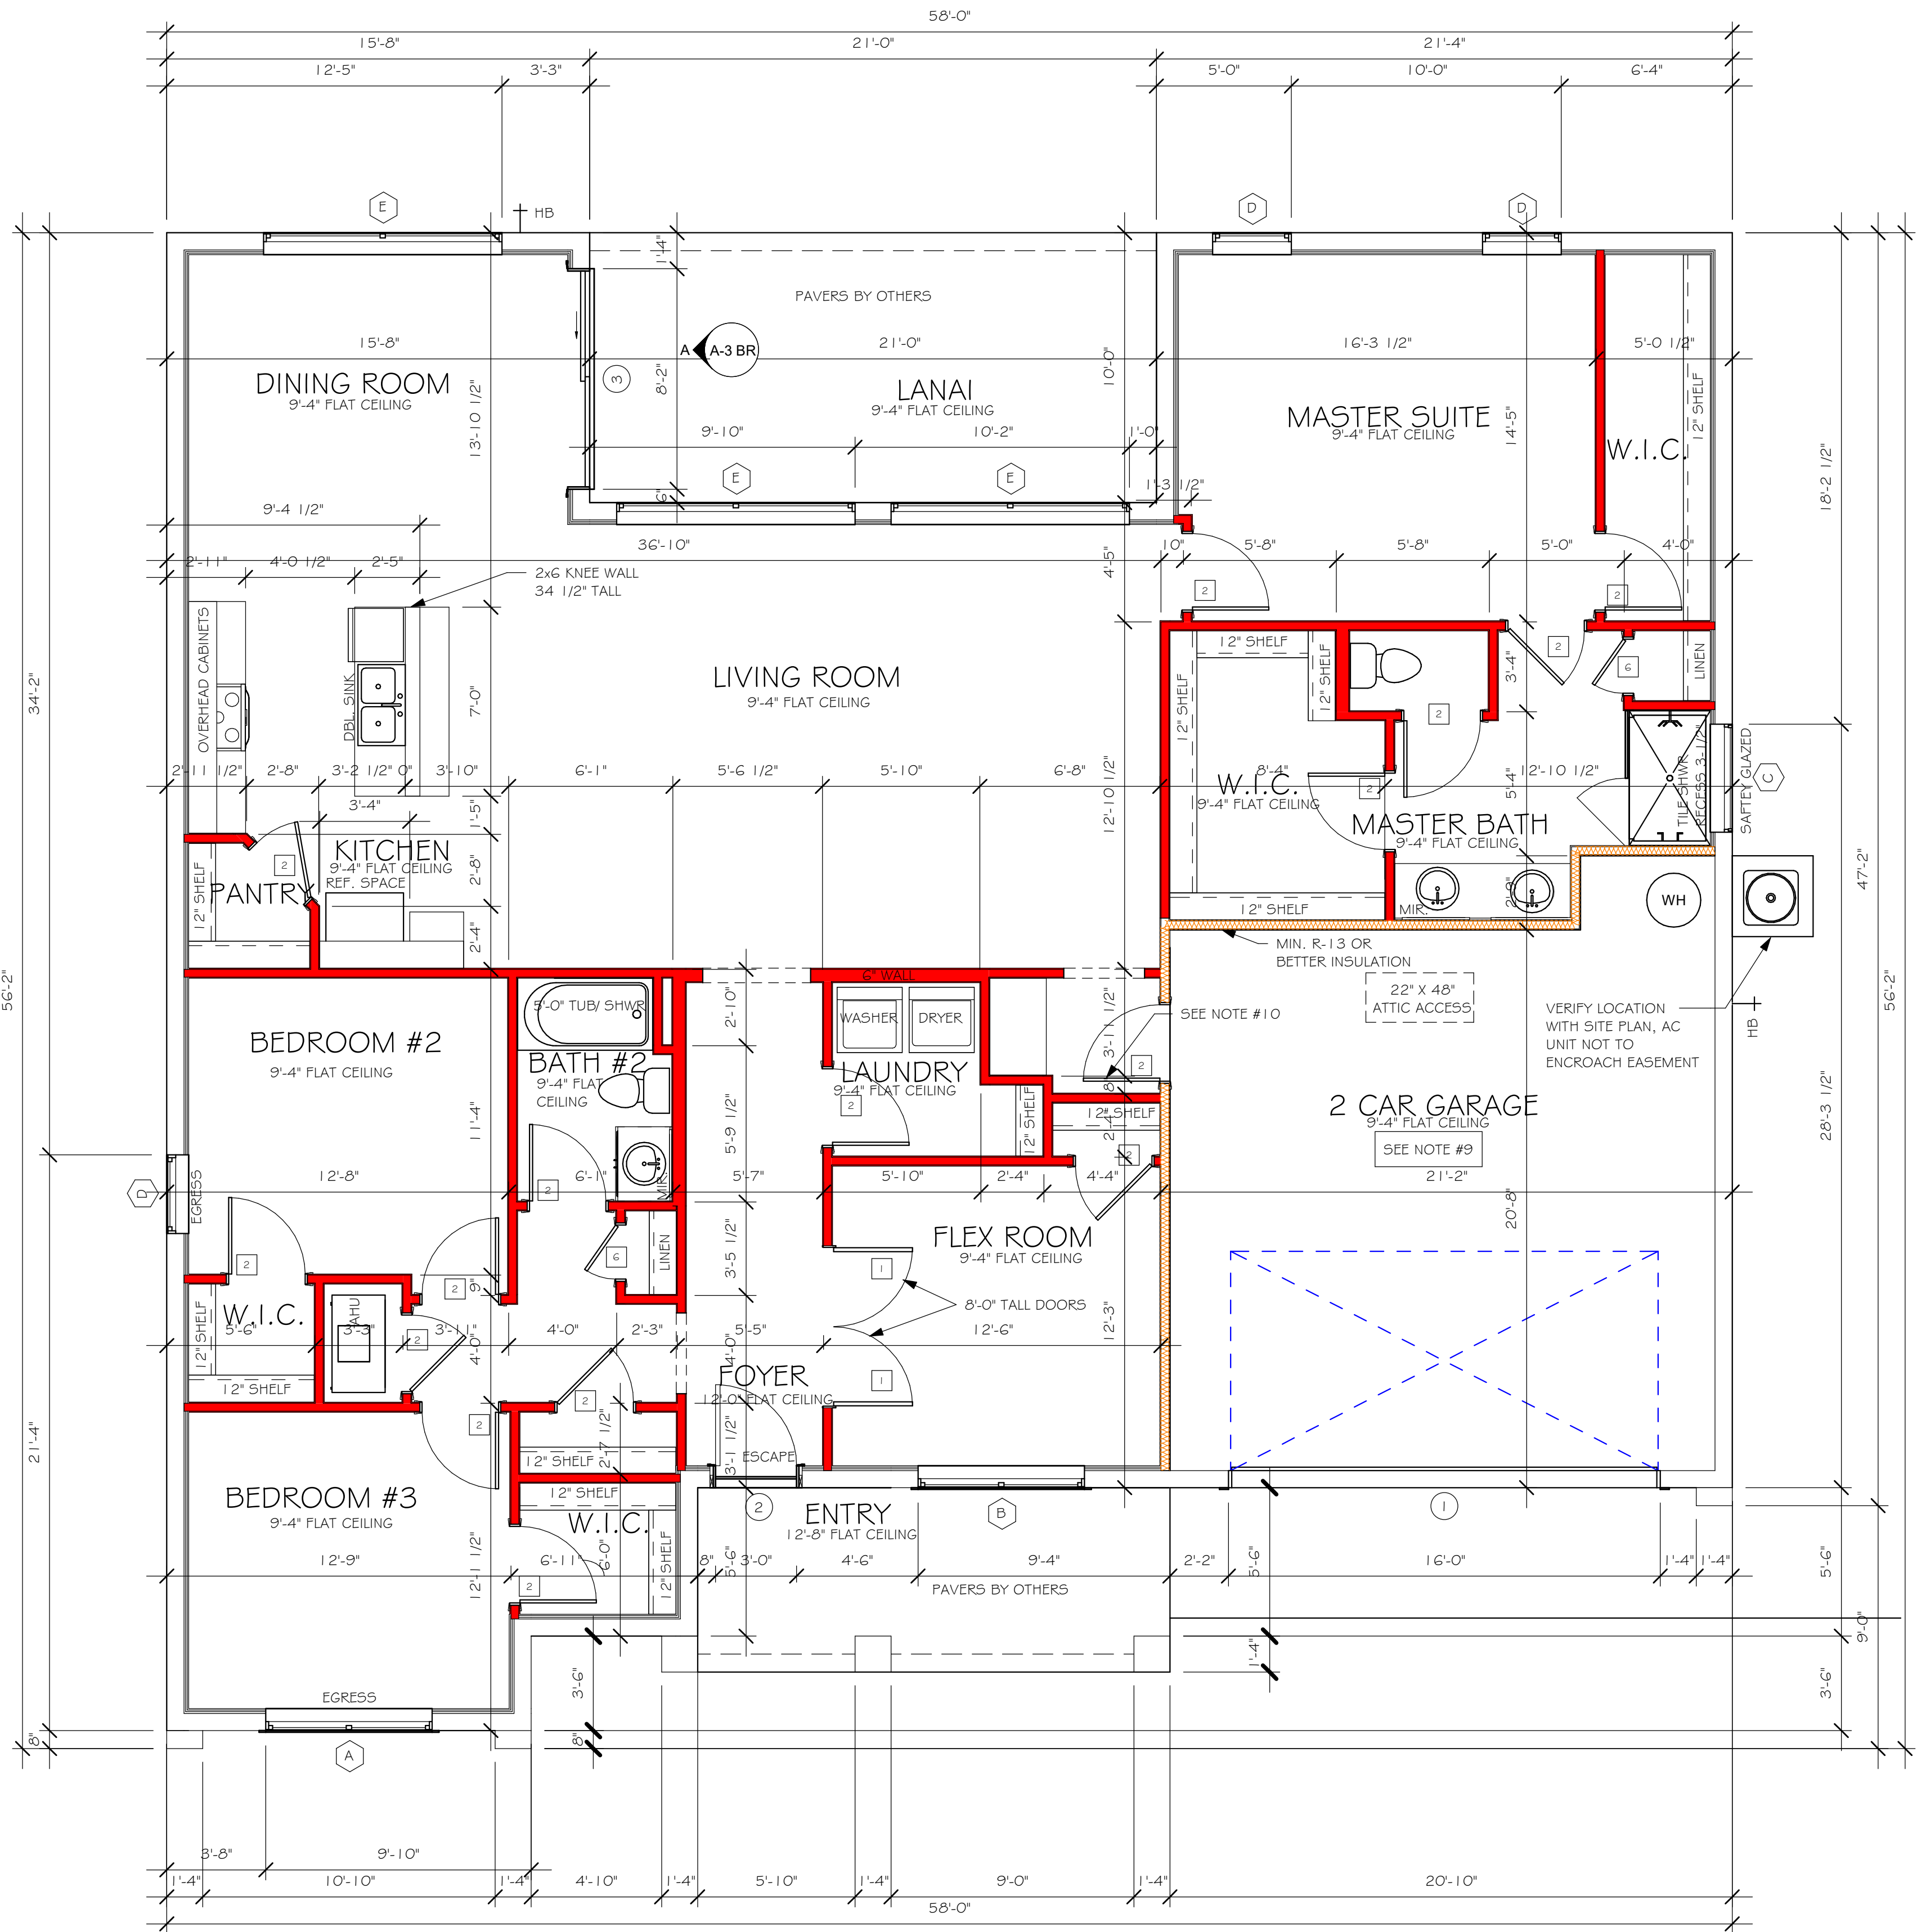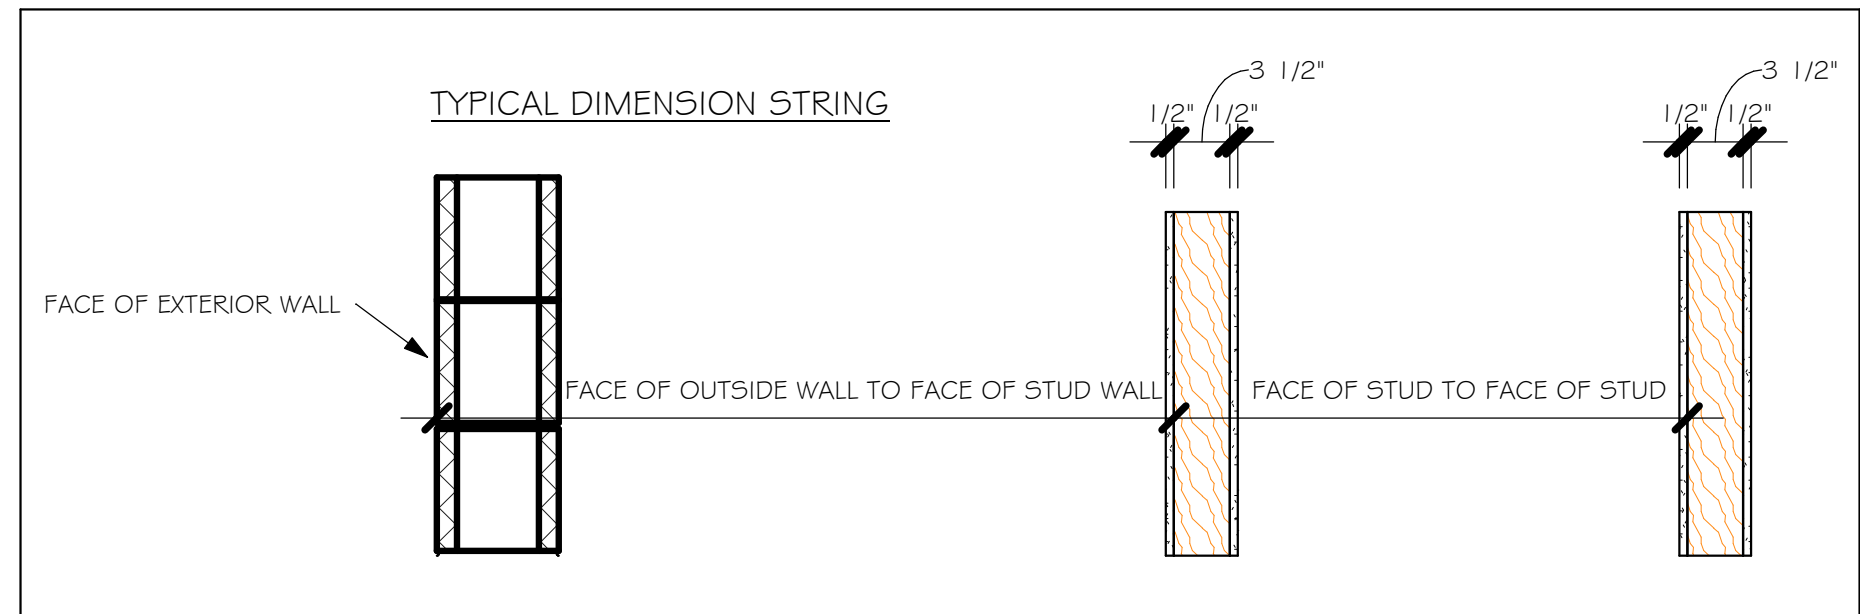


FLOOR PLAN "AR"
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



Z:\MASTER\2018 BUILDERS\2018 DR HORTON\SUBDIVISIONS\BURNT STORE\10782 LOT 16
BLK 364 2197 ARREV\10782 2197 AR.rvt


MODEL 2197 A: ATTIC VENTILATION FBCR R806

COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS

AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
MARK	ATTIC	SOFFIT	ATTIC AREA(150)	REQD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA(300)	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	3267.1 SQ. FT.	313.3 SQ. FT.	21.9 SQ. FT.	6.99%	8.15%
			"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED		
			SOFFIT MODEL ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW			ROOF VENT MODEL 32" BASE  LOMANCO 770-D 0.97 SQ. FT. FREE AIR		

BEARING HEIGHT



	= BEARING @ 9'-4"
	= BEARING @ 12'-8"

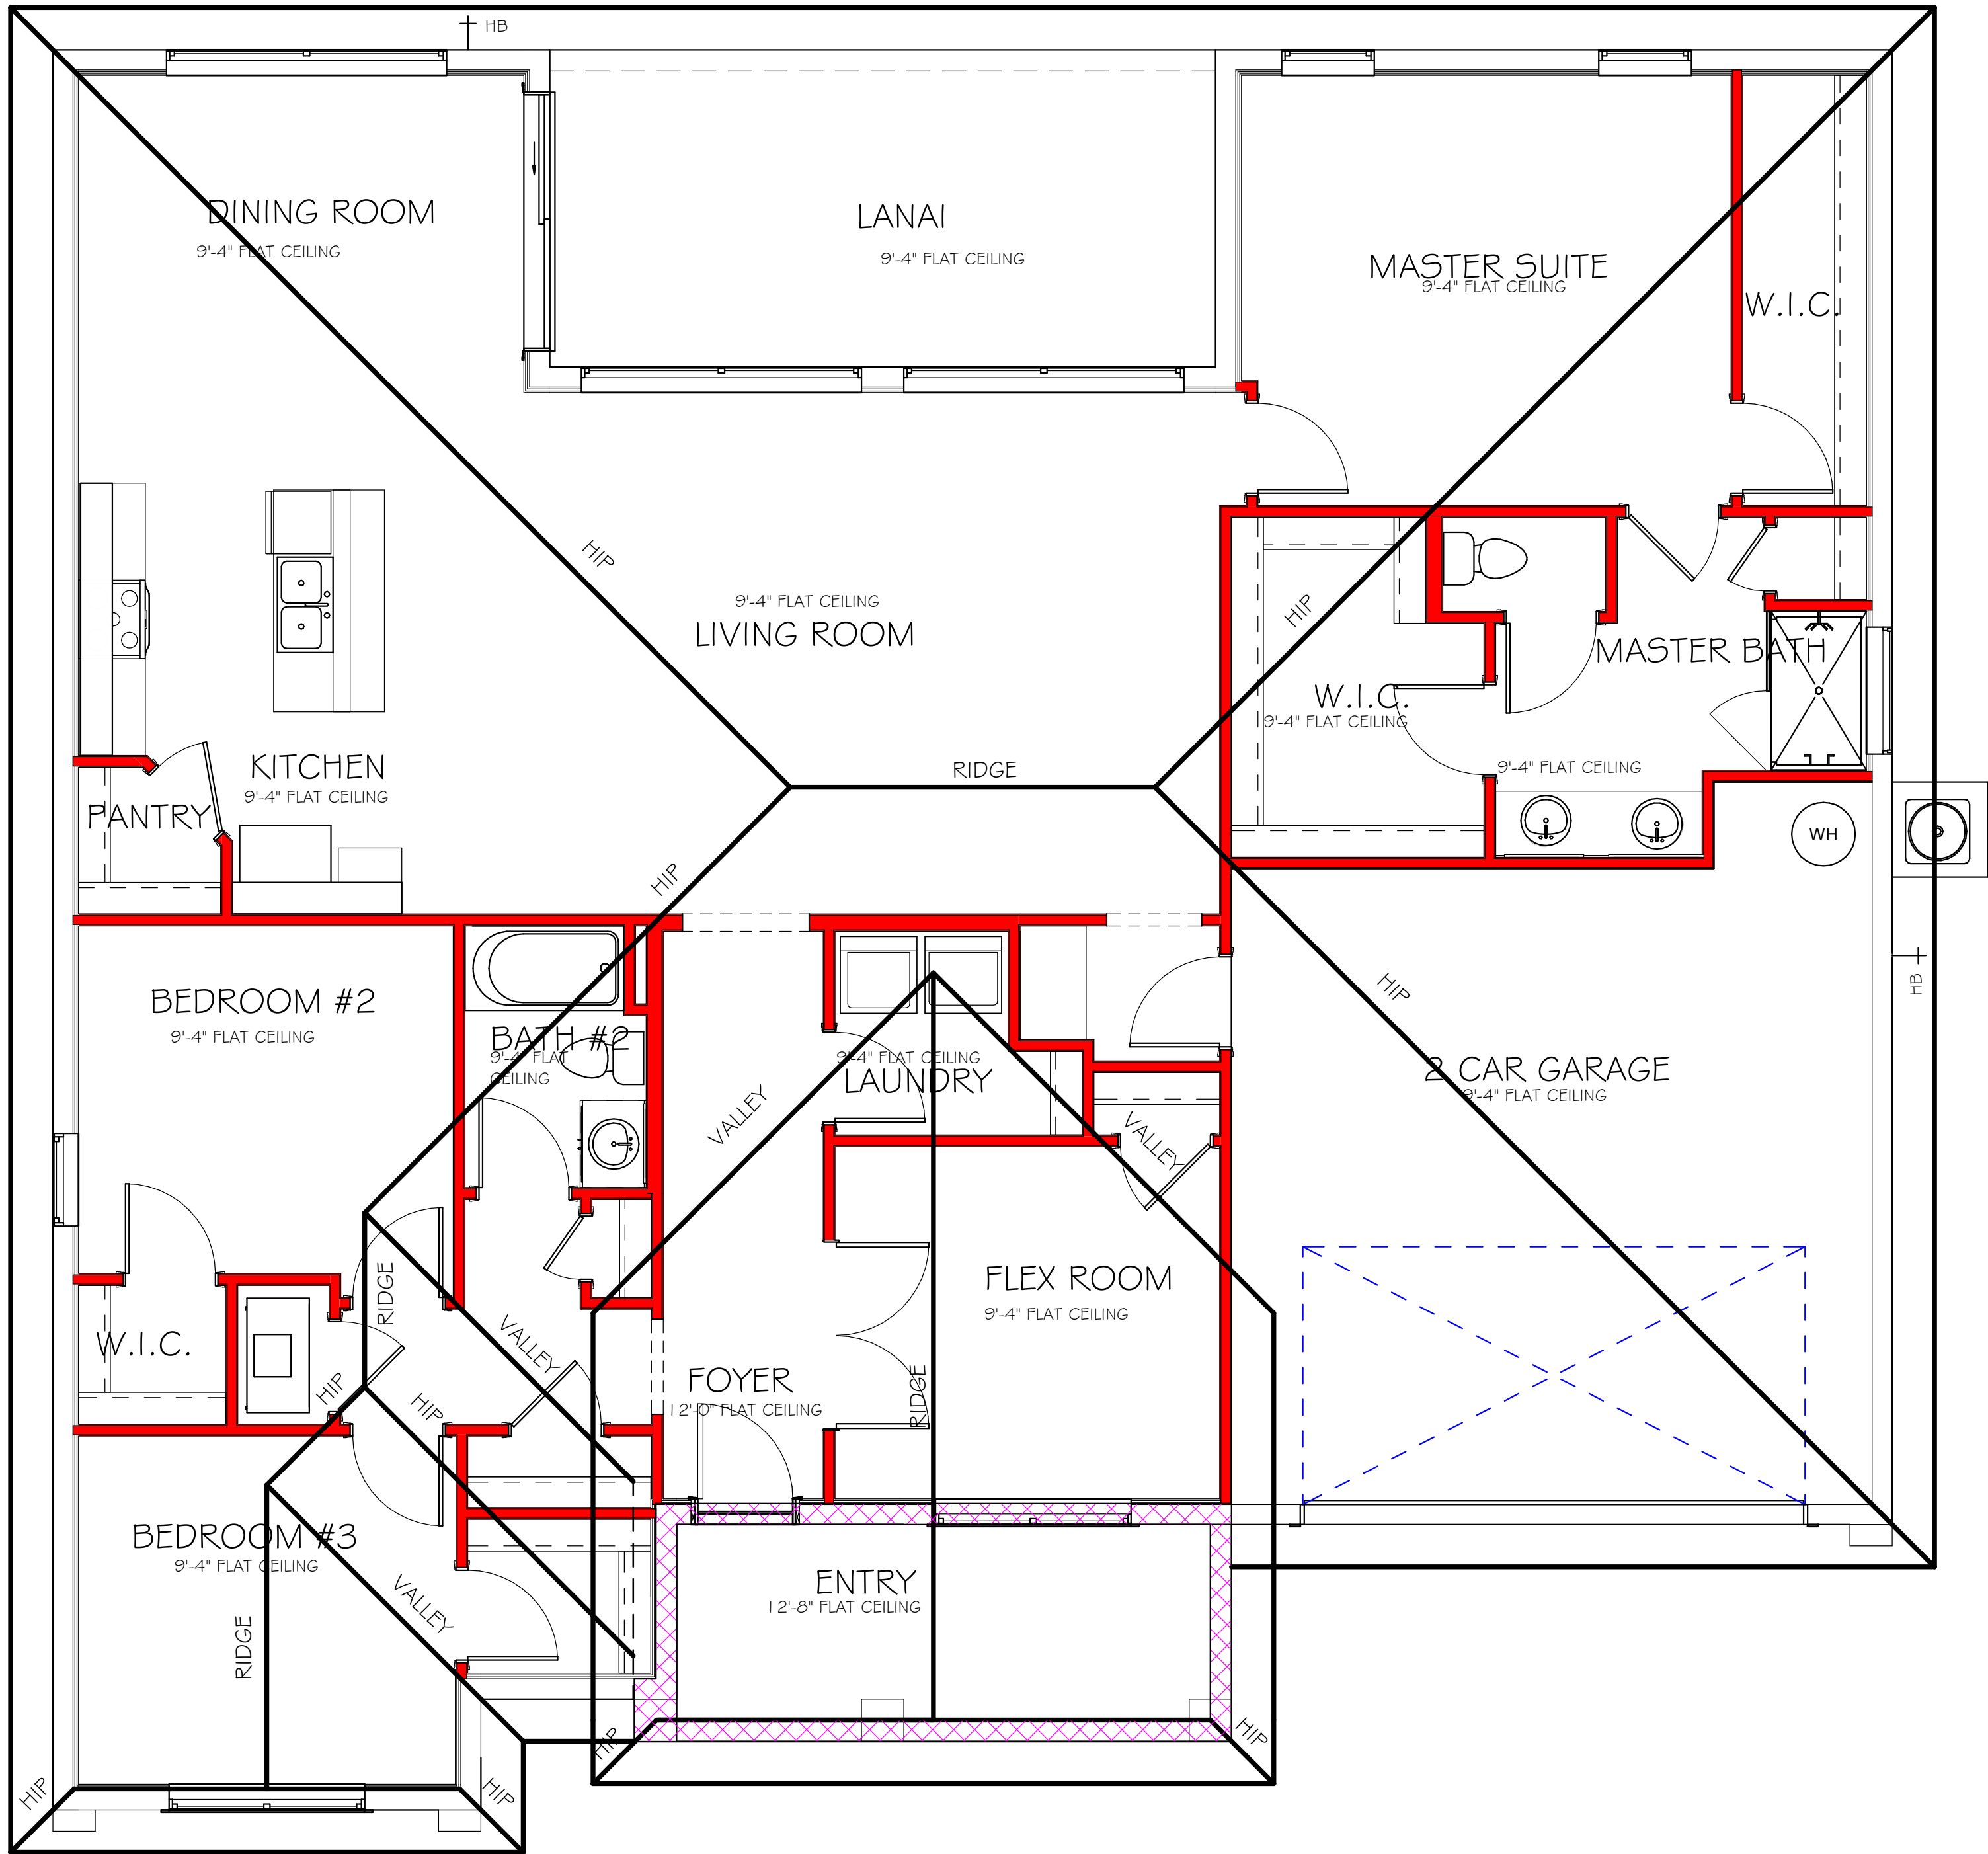


ROOF PLAN "AR"

1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

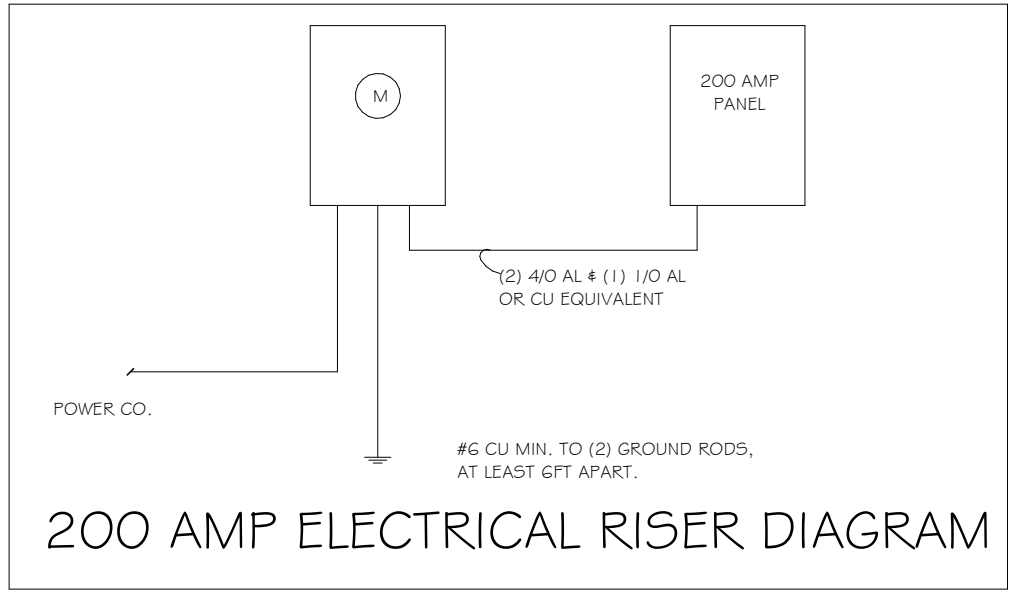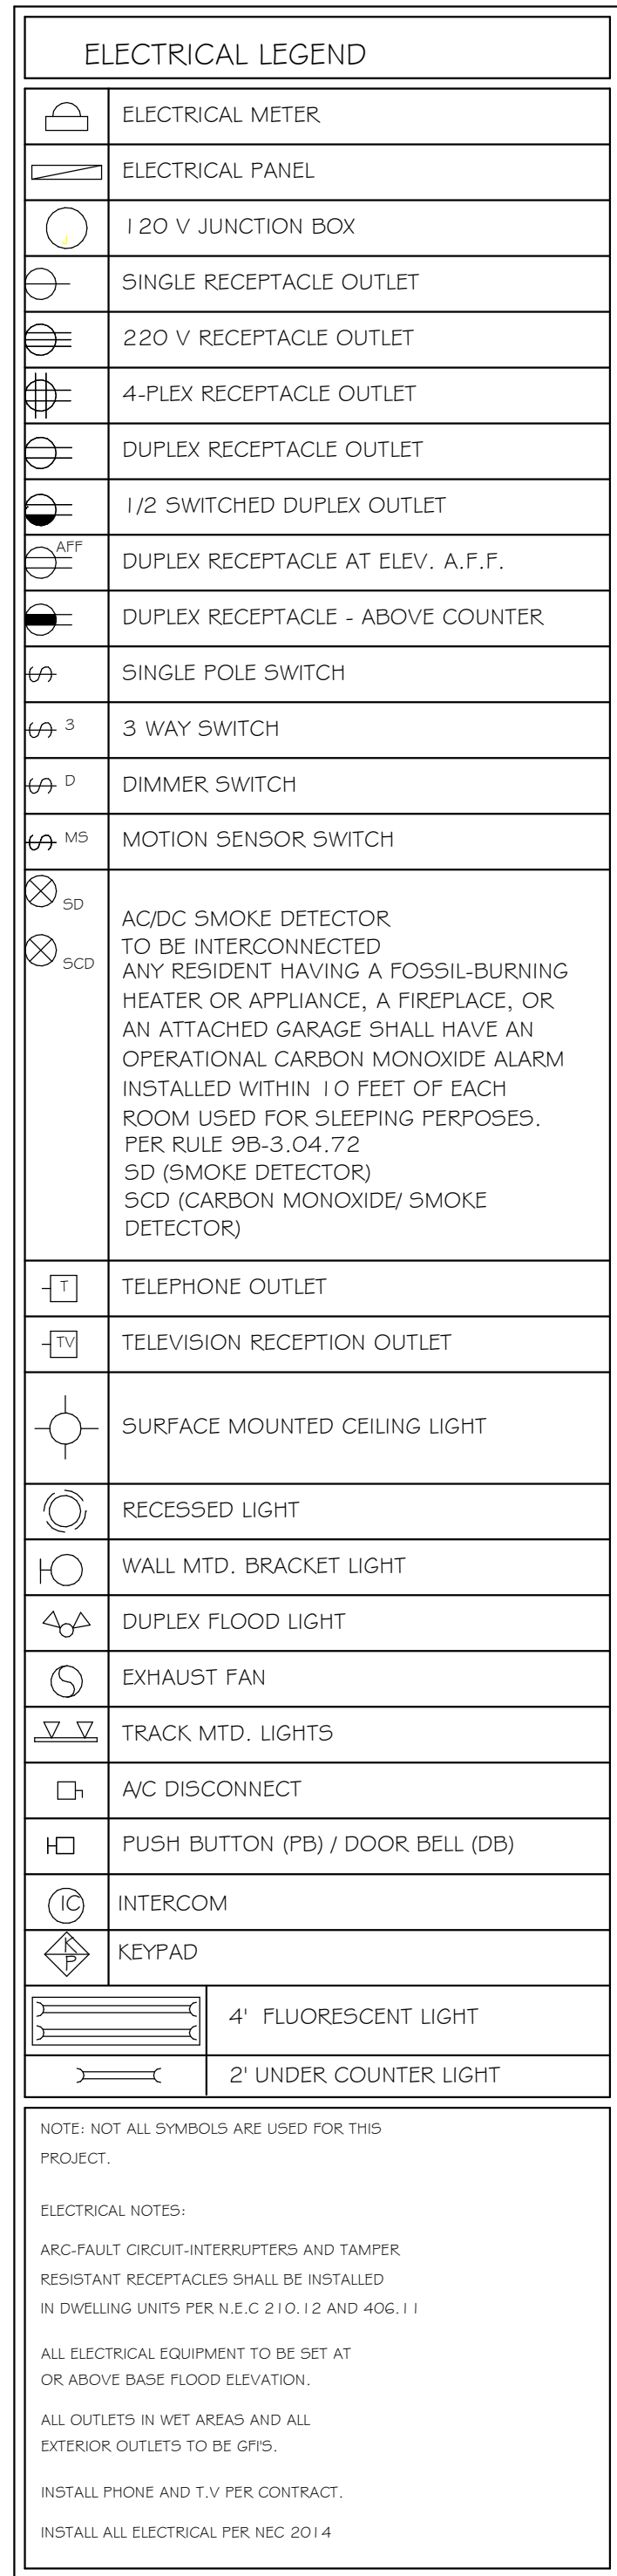


LIGHTING SCHEDULE		
200 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(17)	(RECESSED CAN5)
B	(11)	(VAPOR5)
C	(3)	(PENDANT LIGHT
D	(14)	(1" O' MUSHROOM5)
E	(3)	(24" 3 LT)
F	(X)	(36" 4 LT)
G	(X)	(NOT USED)
H	(2)	(COACH LIGHTS)
I	(X)	(COACH LIGHTS)
J	(1)	(3 BOX)
K	(X)	(4 FLORESCENT)
L	(X)	(2' FLORESCENT)
M	(X)	(5LT CHANDELIER)
N	(X)	(3 LT)
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

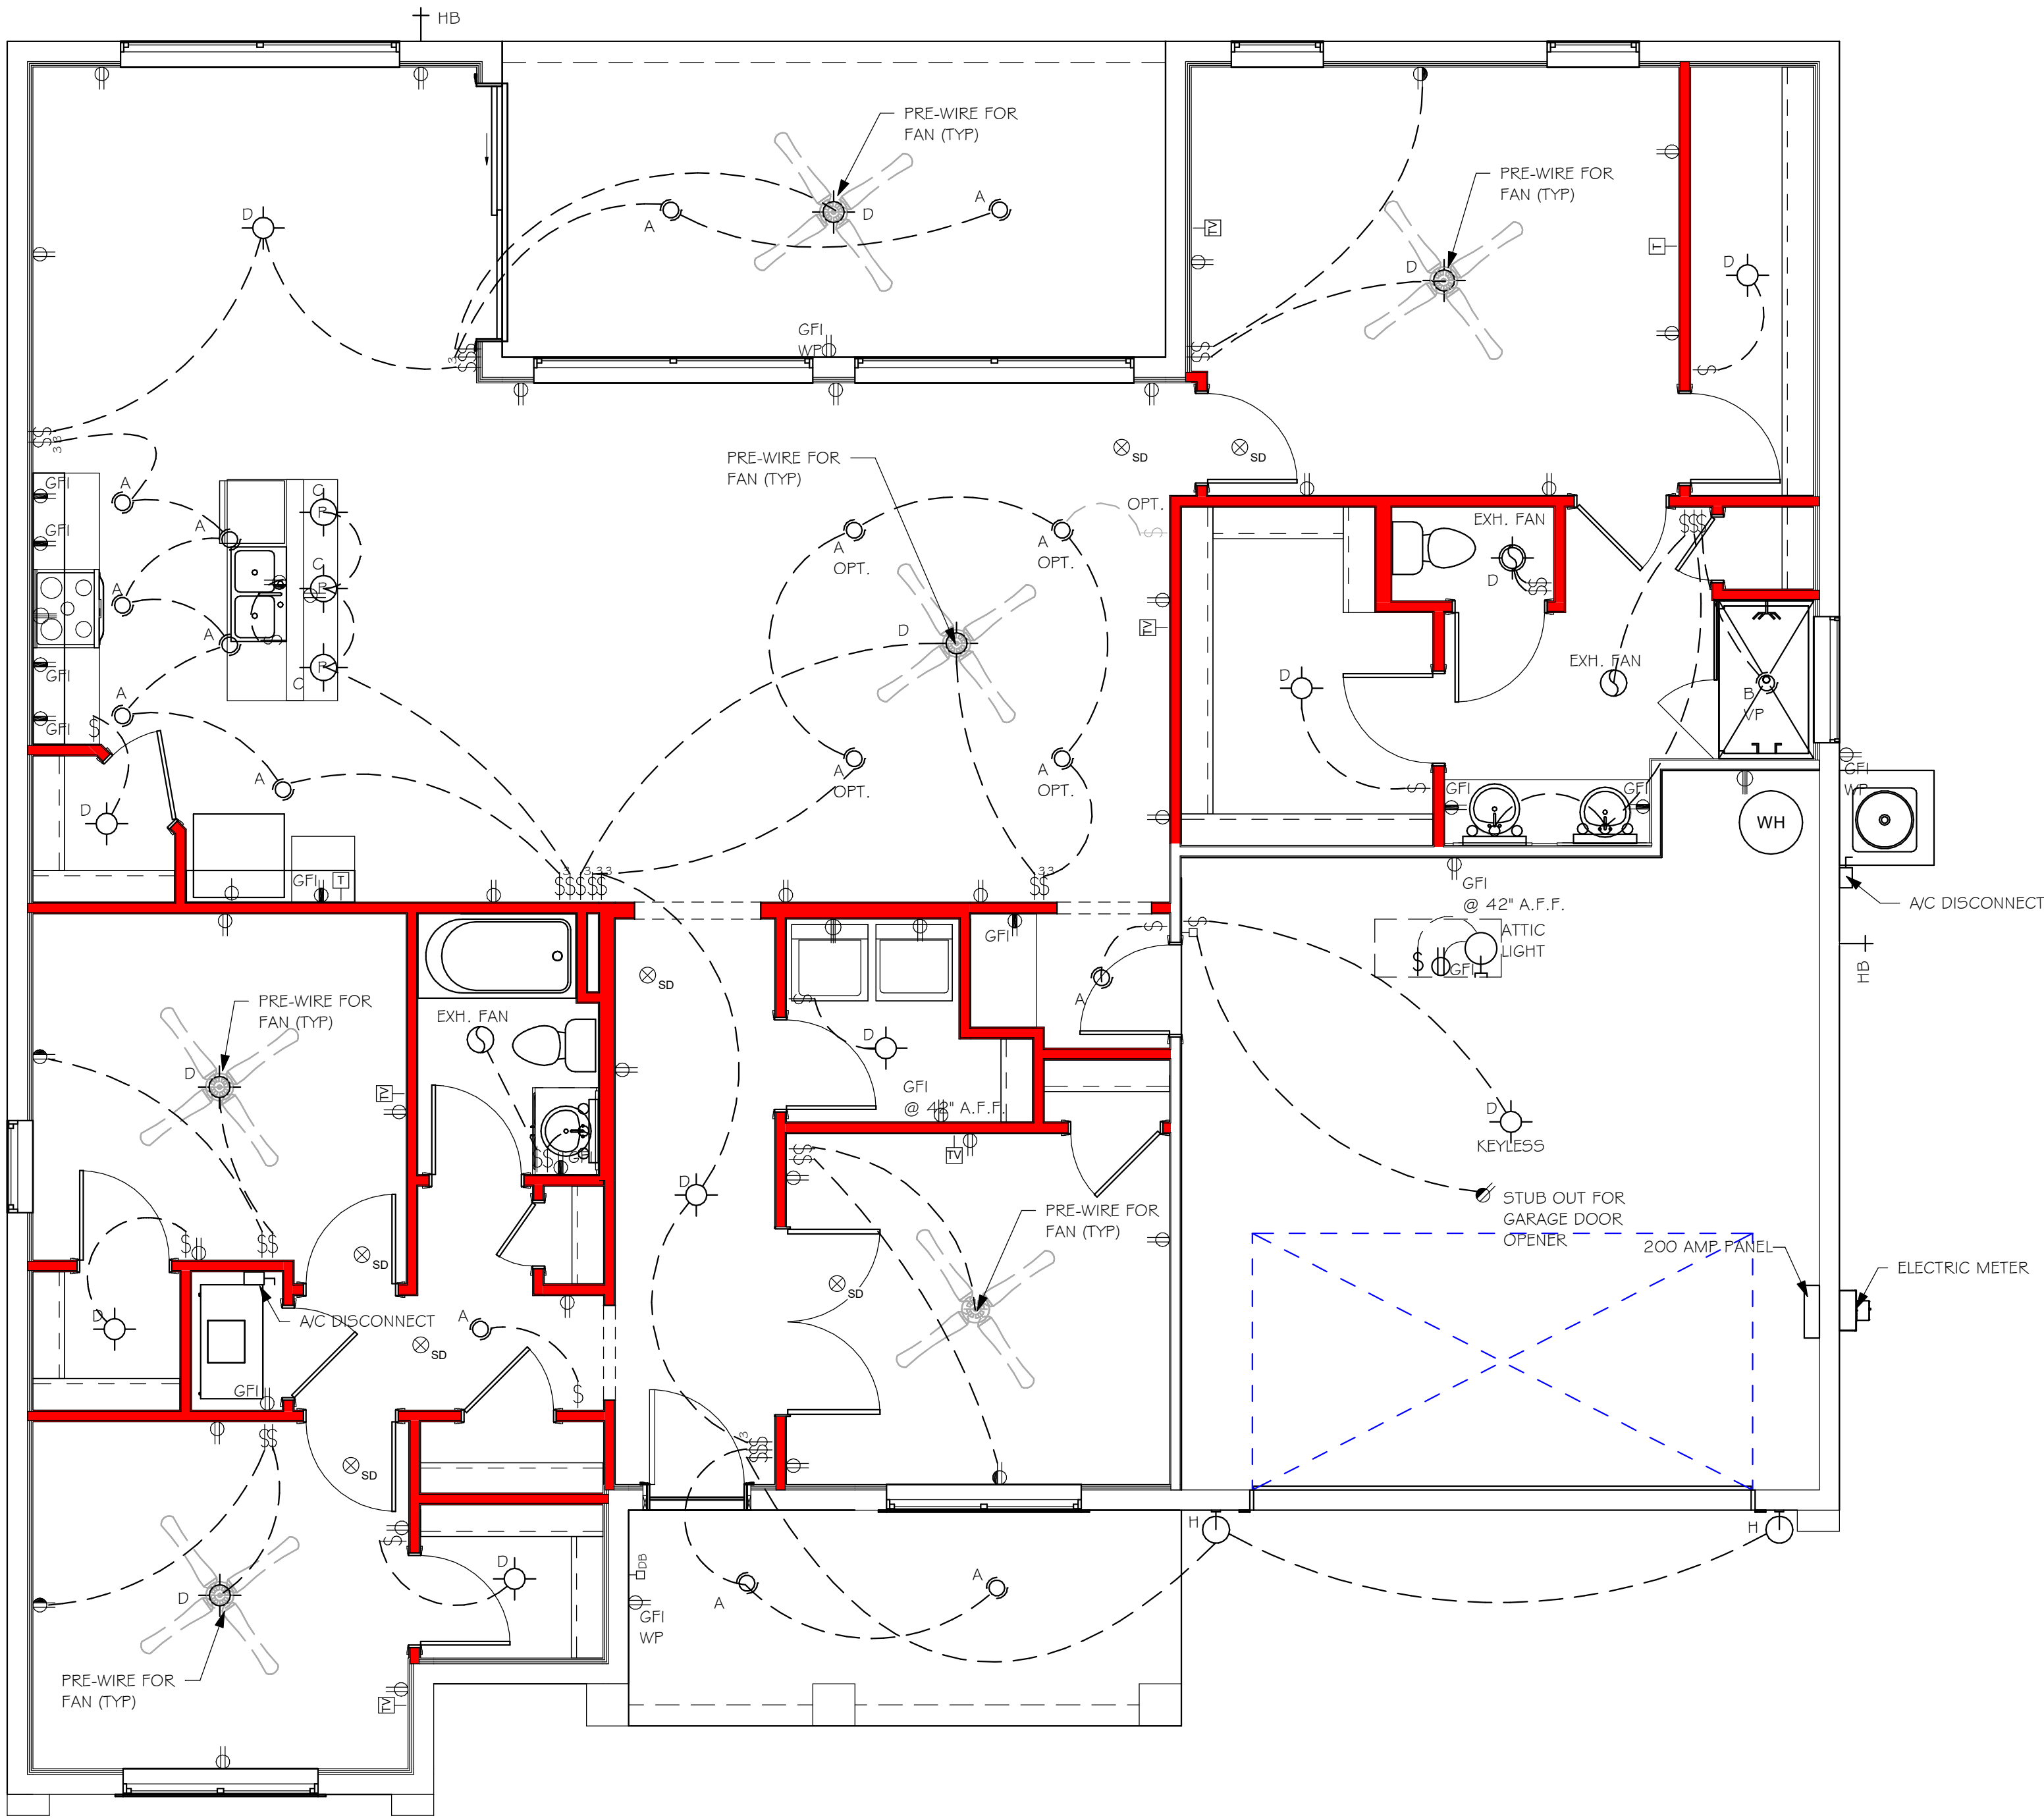


ELECTRICAL PLAN "AR"
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

Z:\MASTER\2018 BUILDERS\2018 DR HORTON\SUBDIVISIONS\BURNT STORE\10782 LOT 1 G
BLK 364 2197 ARREV\10782 2197 AR.rvt

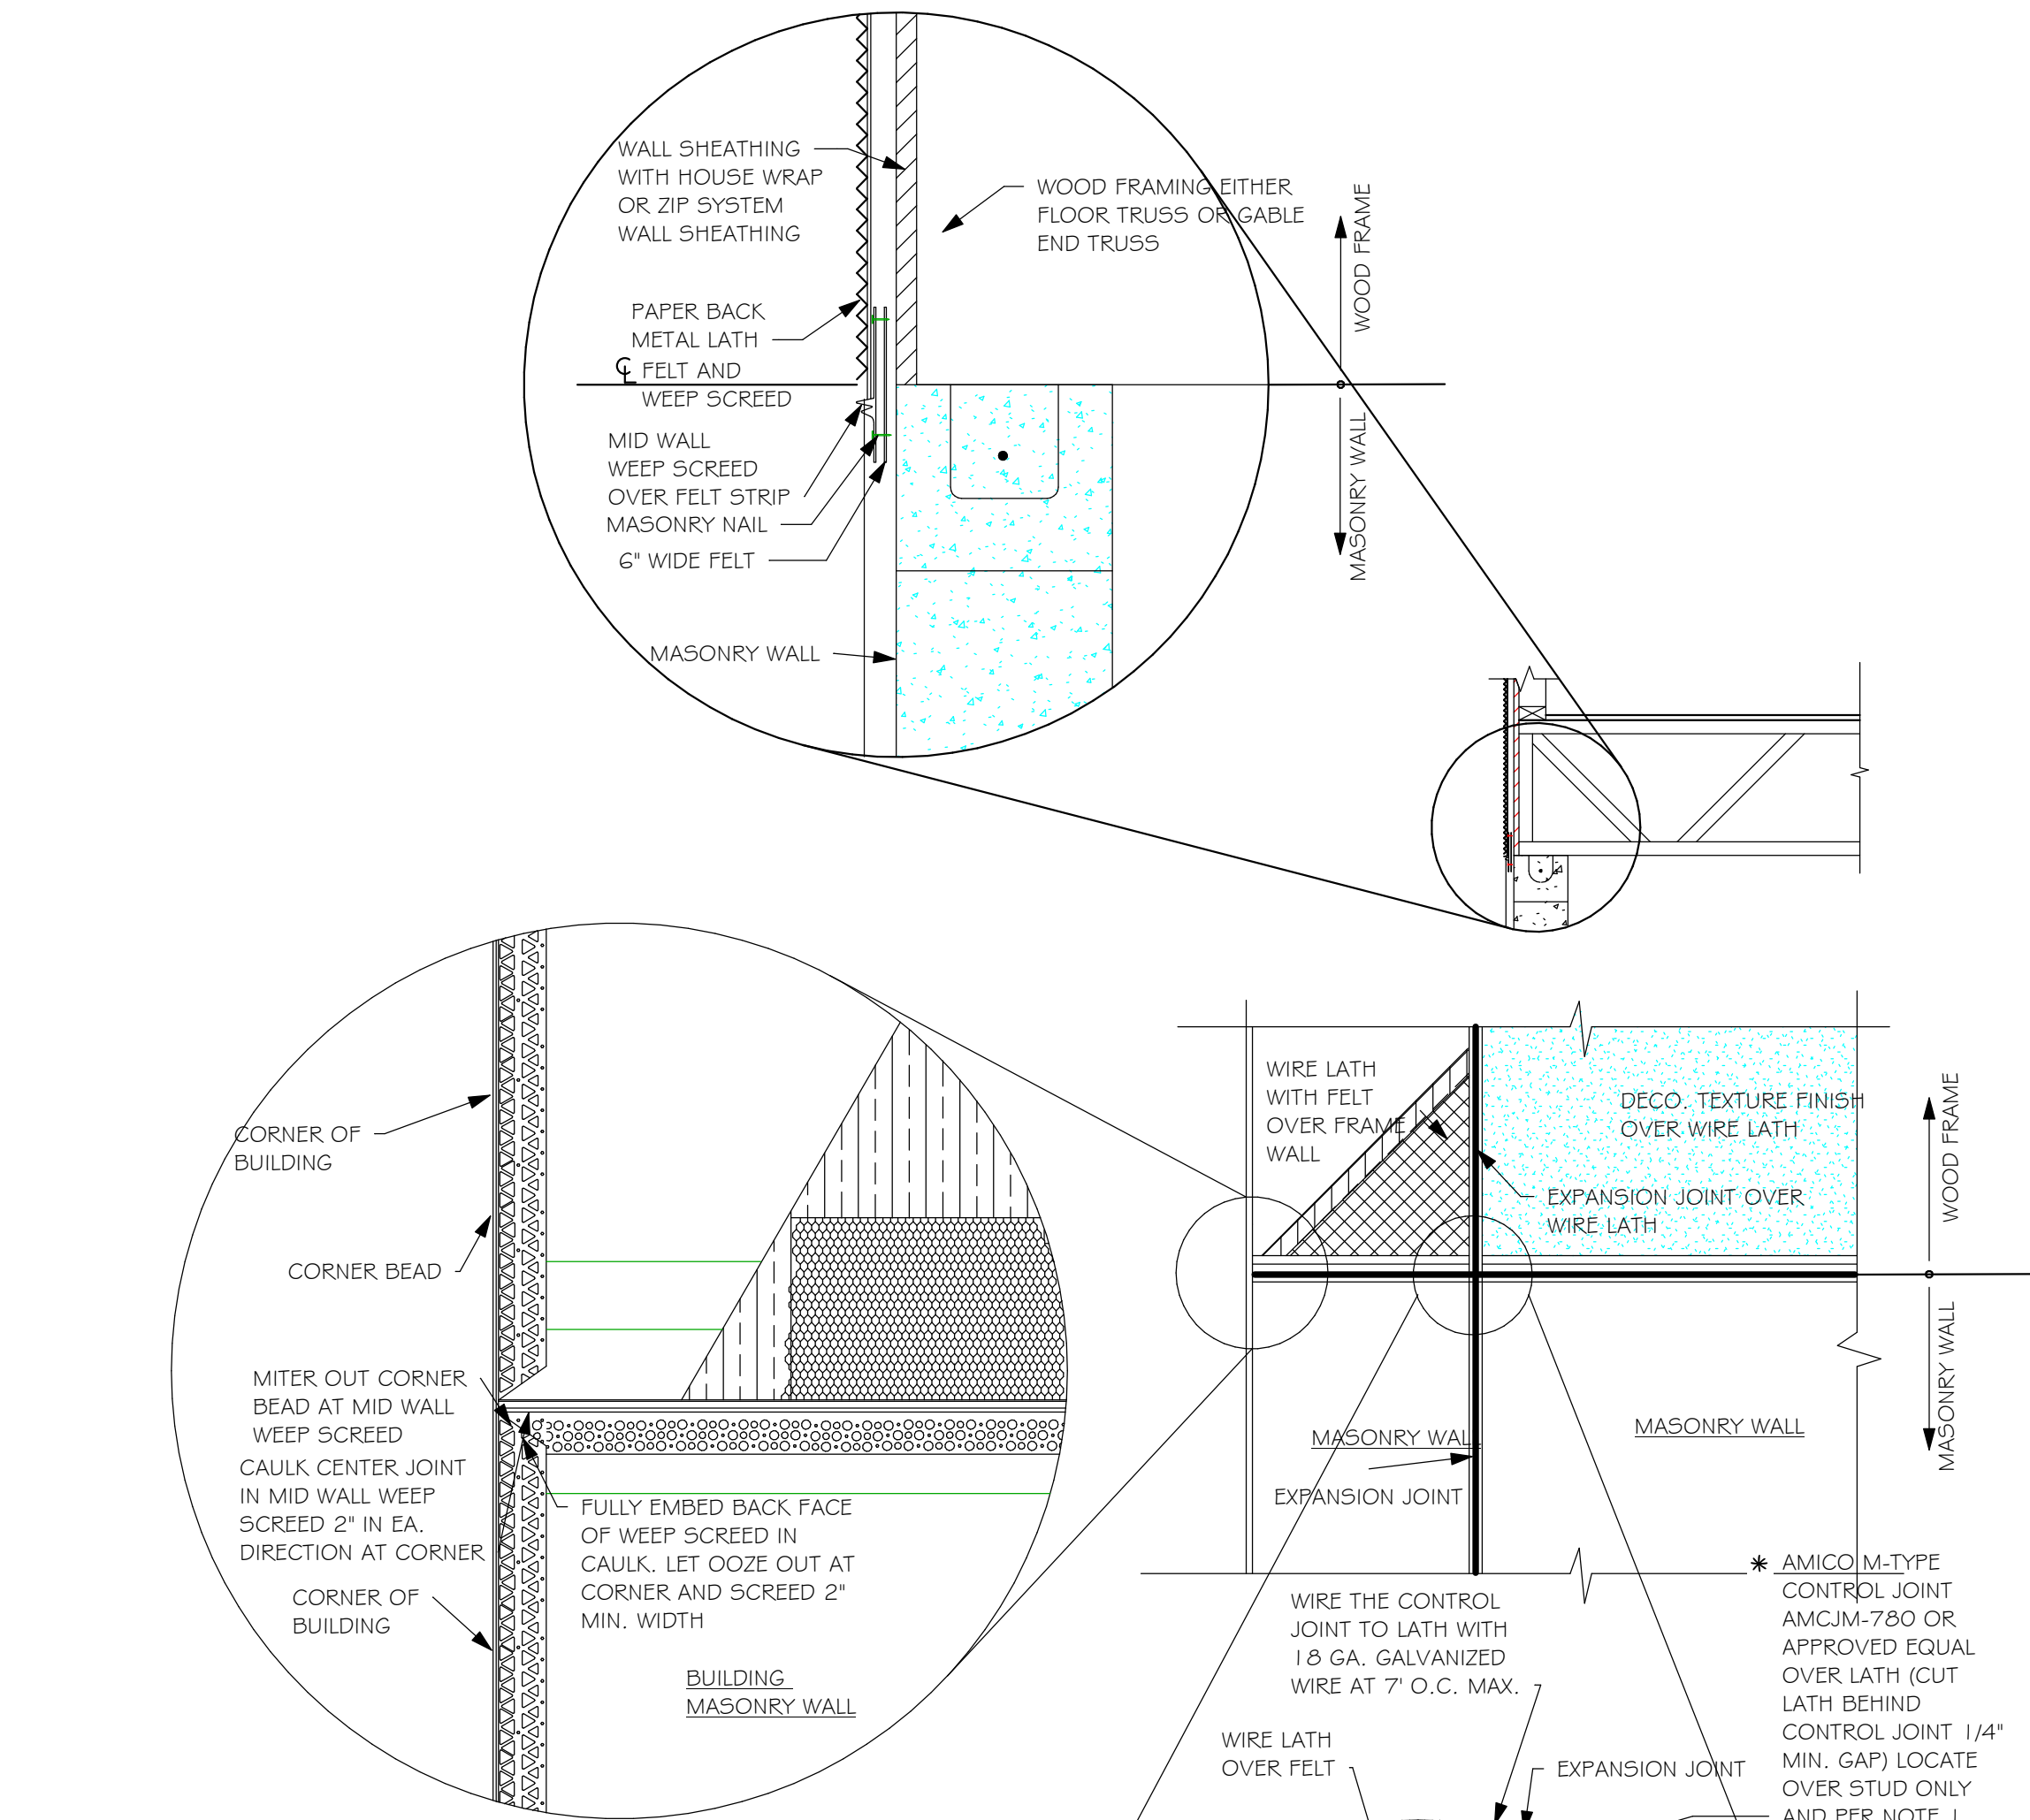


MID WALL WEEP SCREED DETAIL

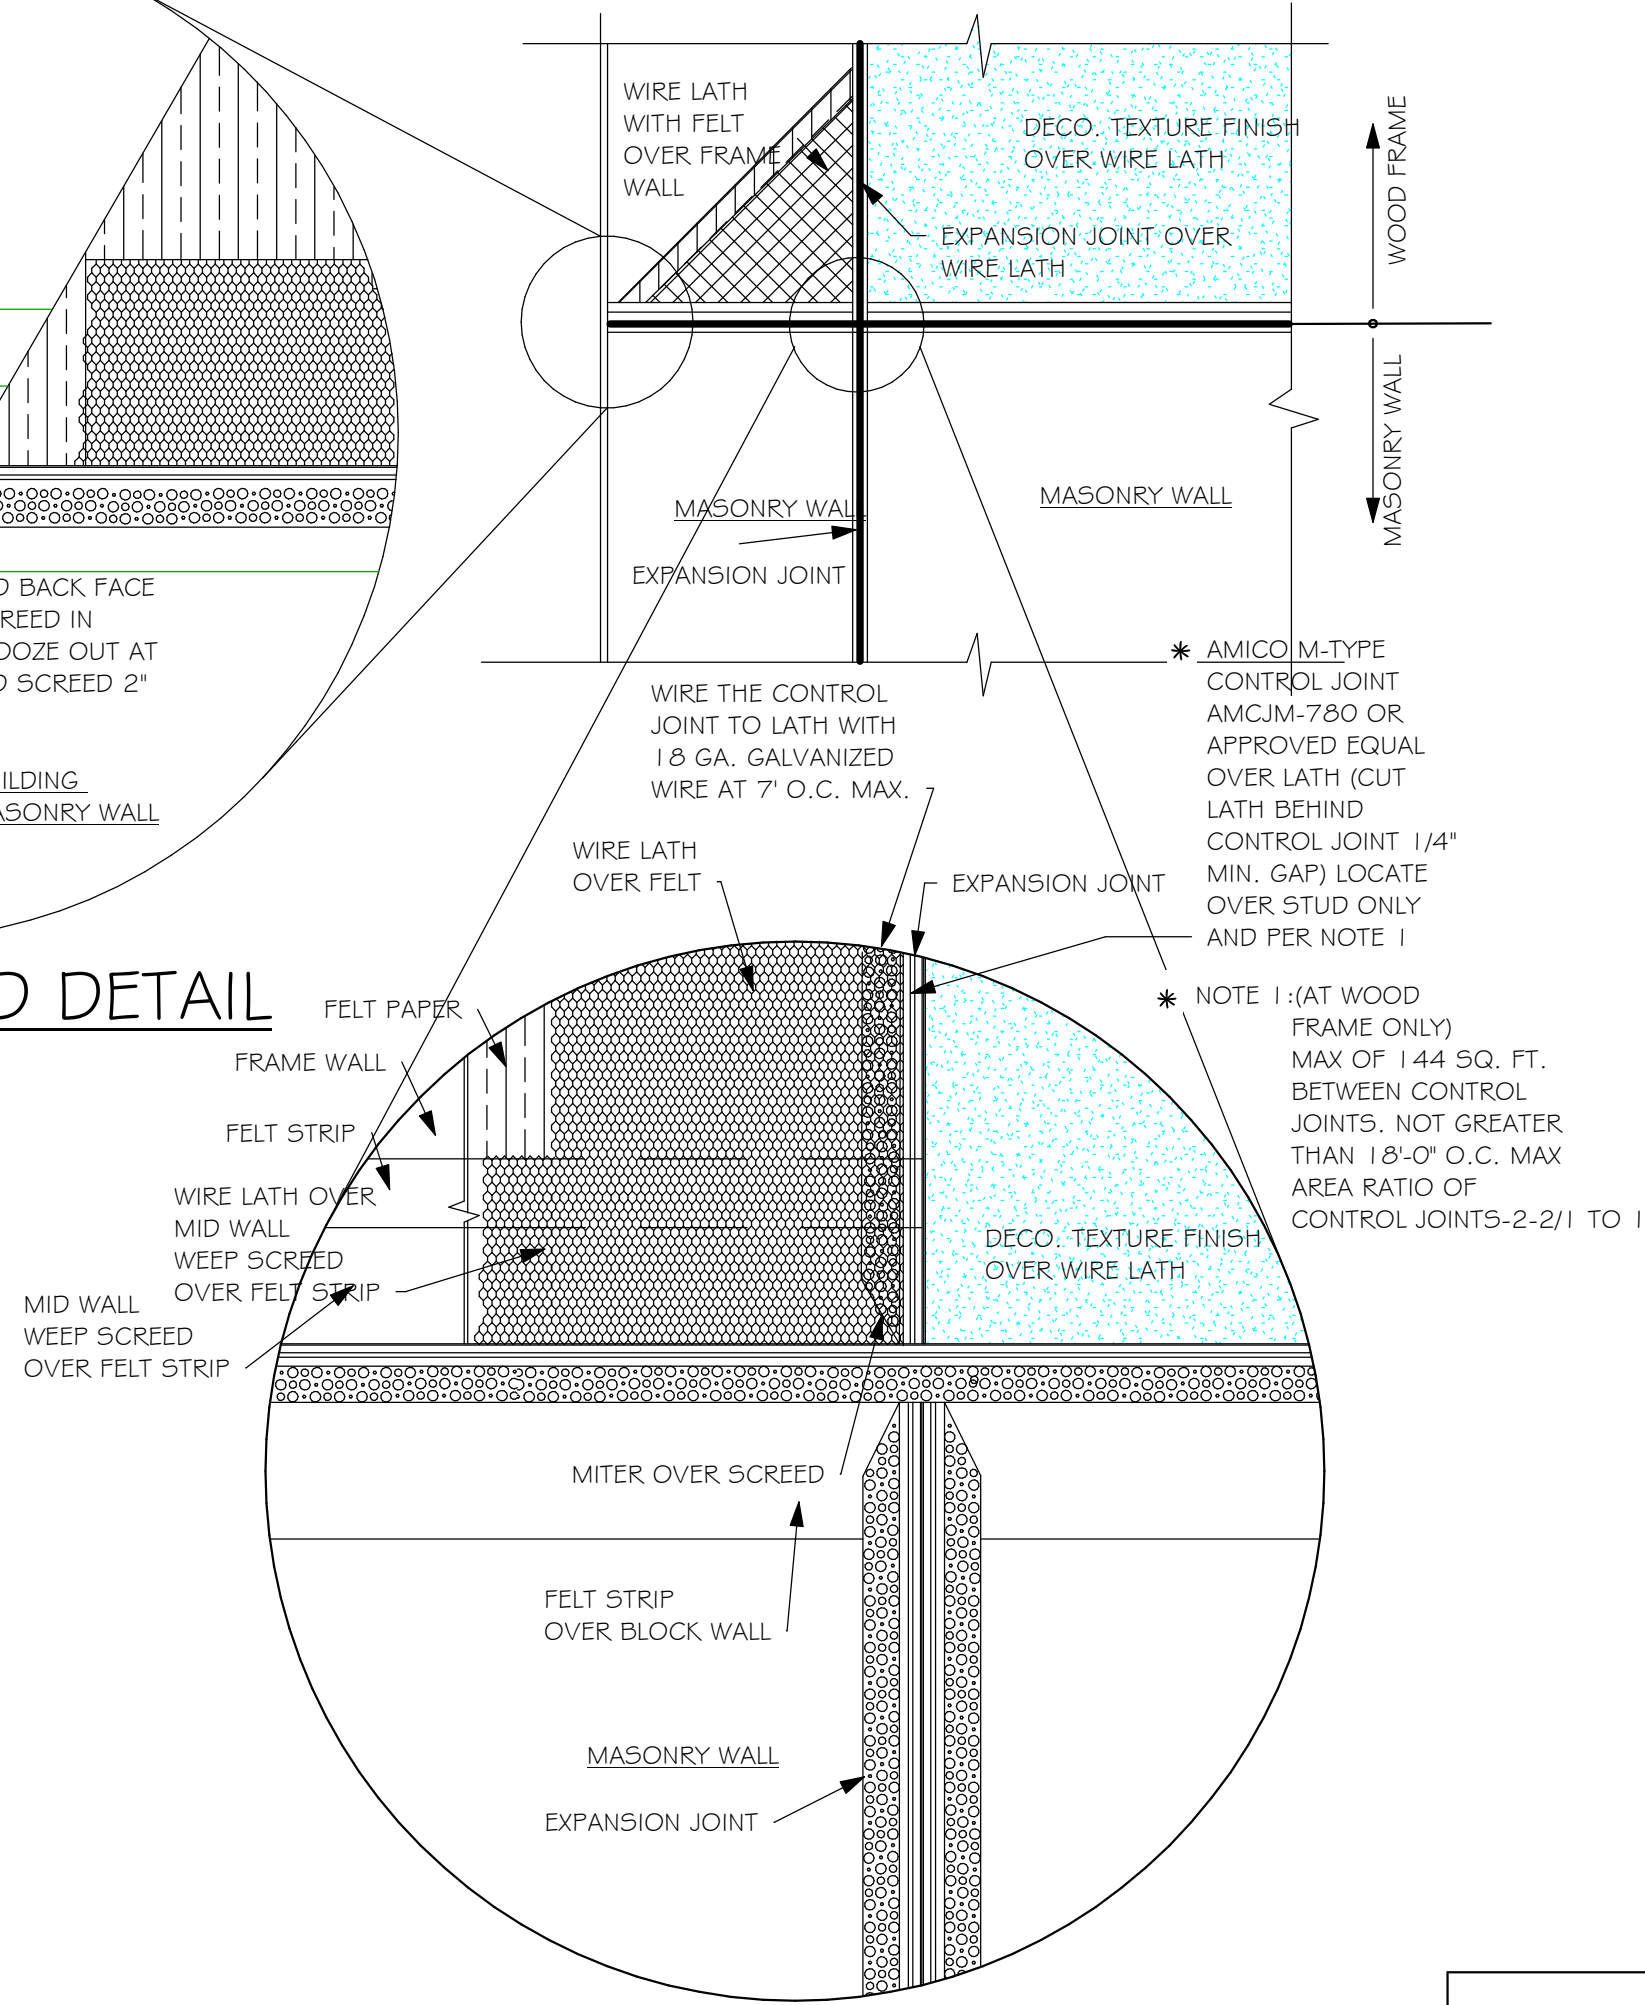

WEEP SCREED DETAIL

INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

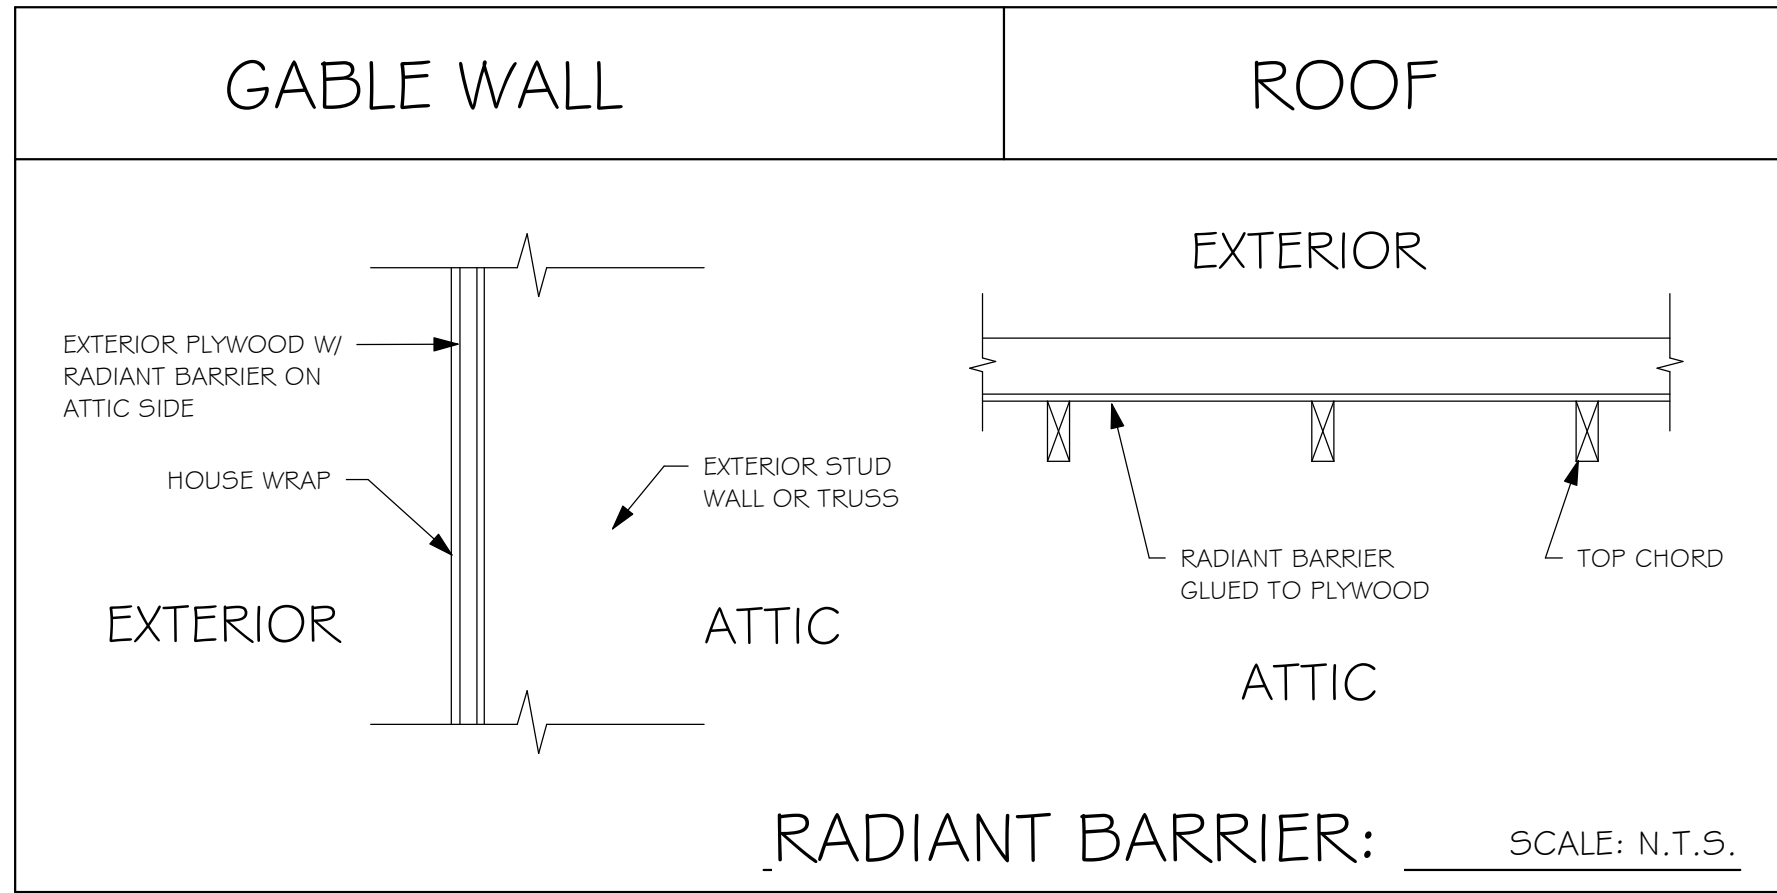

NOTE: EXTERIOR WALLS ADJACENT TO ATTIC SPACE, INCLUDING KNEEWALLS AND GABLE END WALLS, MUST HAVE RADIANT BARRIER AND HOUSE WRAP.

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT. ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT DIPPED GALVANIZED OR STAINLESS STEEL CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
7. TREATED WOOD REQUIREMENTS:- ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LANAI CEILINGS & COVERED ENTRY CEILINGS 1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.


2

GENERAL ROOF ASSEMBLY

ROOF SHEATHING
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "H" CLIPS AT UNSUPPORTED PANEL EDGES. THE ROOF SHEATHING SHALL BE NAILED WITH 8d RING SHANK NAILS @ 4" O.C. EDGE AND 6" O.C. FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSSES WITHOUT SPLITTING. RING SHANK NAILS PER R803.2.3.1 - 0.113" NOMINAL SHANK DIAMETER, RING DIAMETER OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURERS PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS. LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

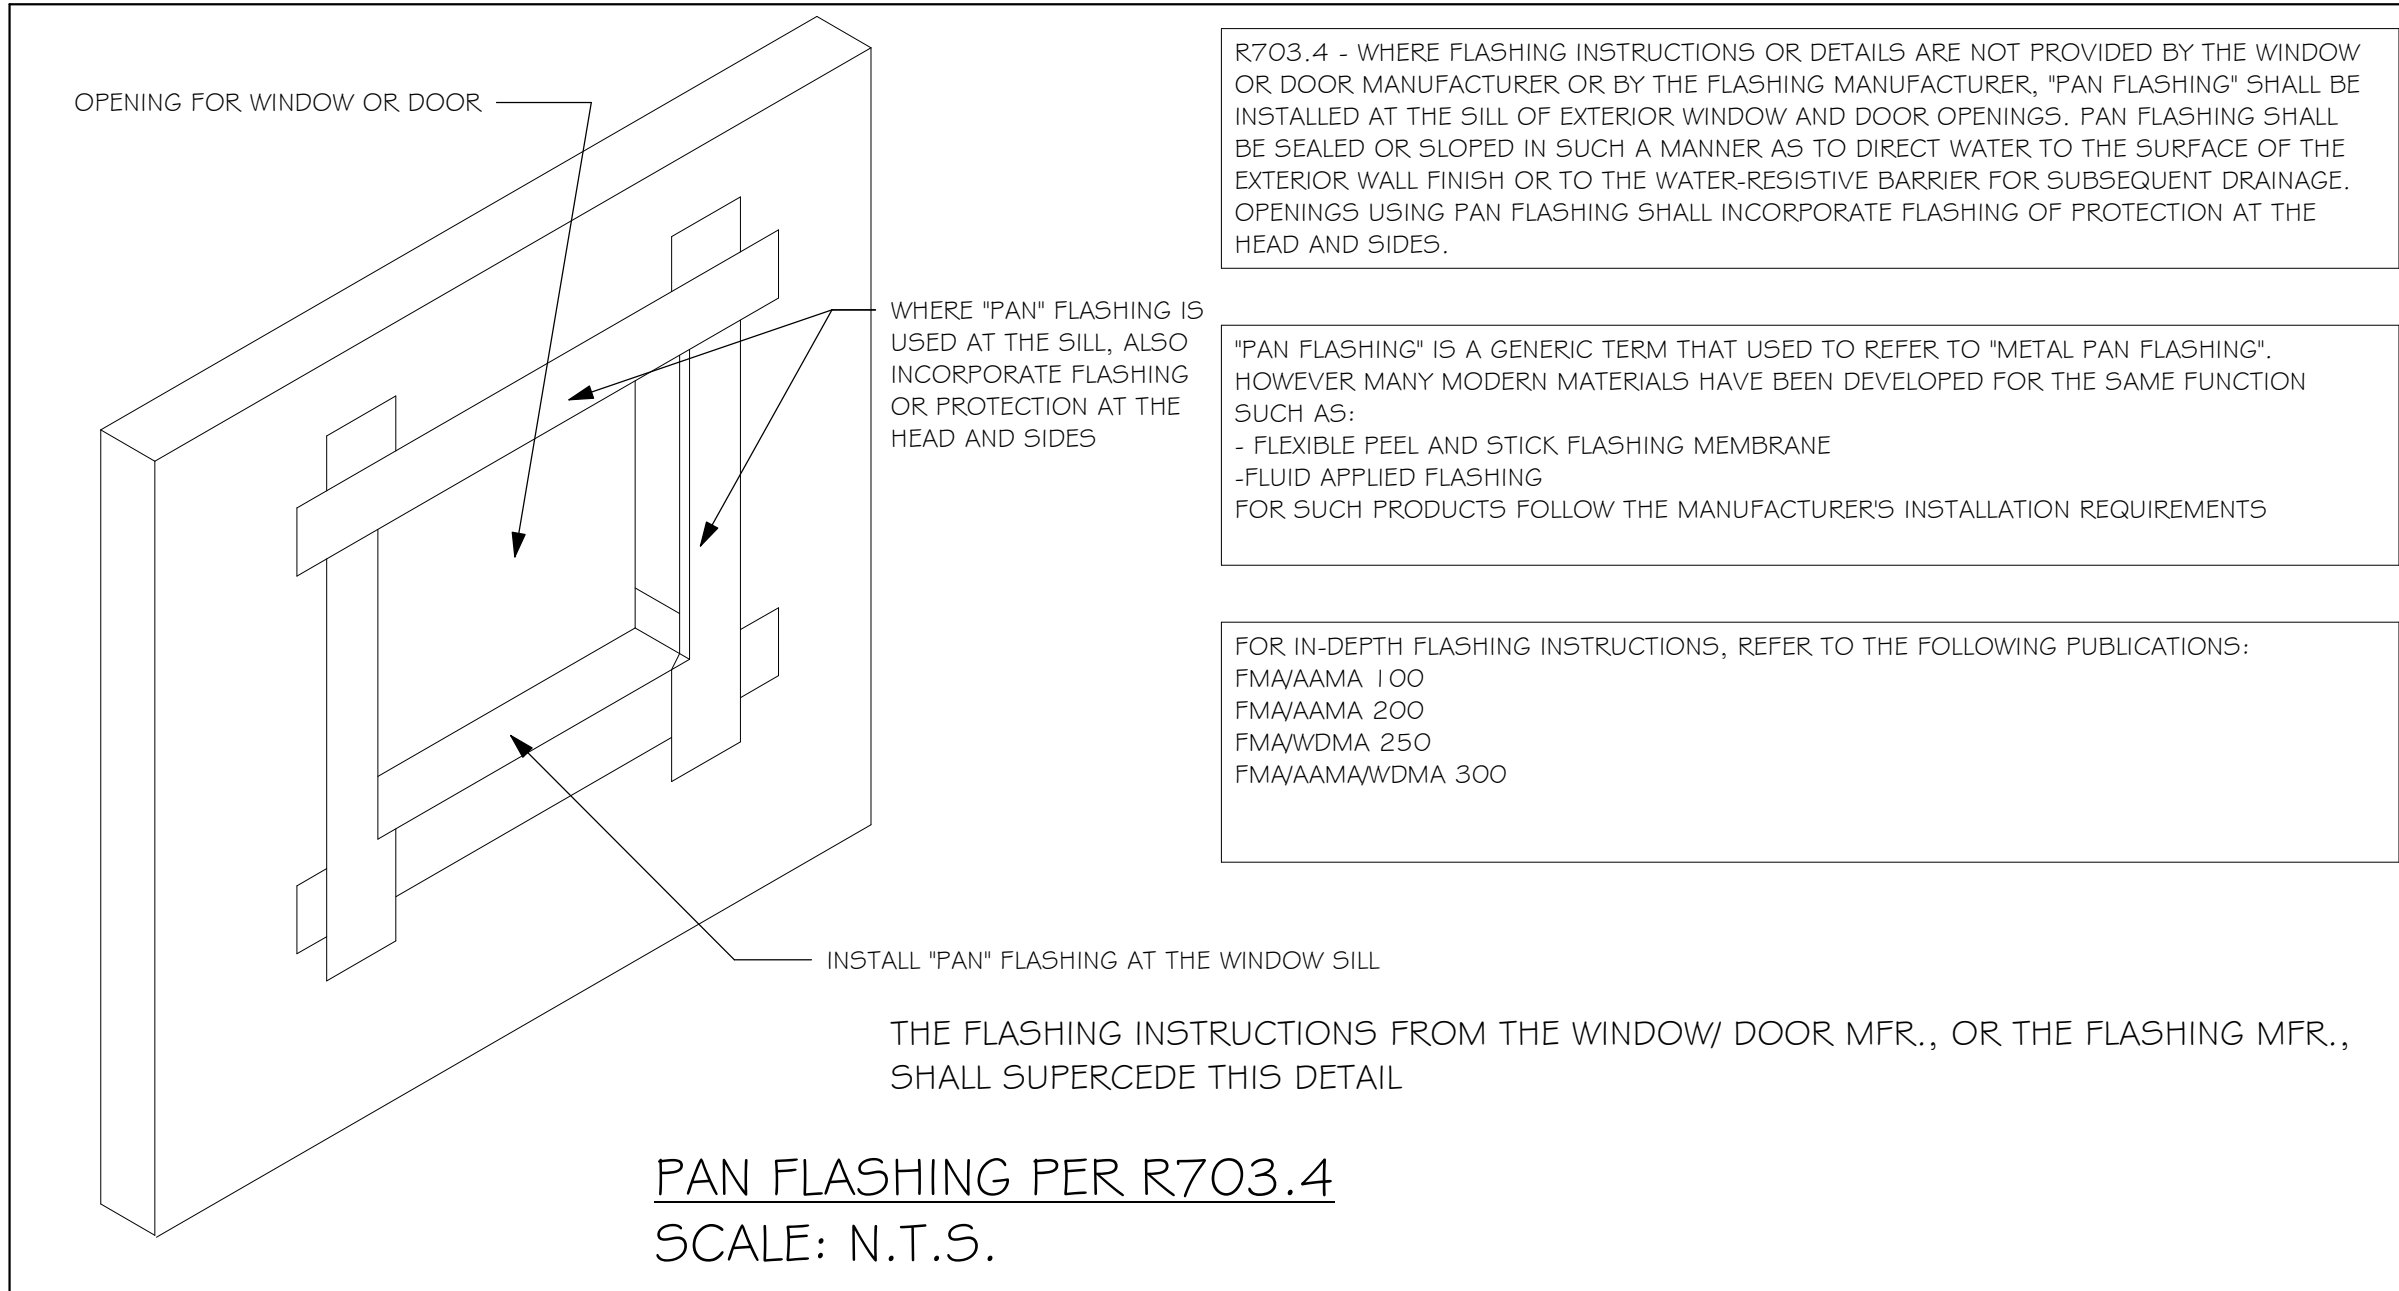

PAN FLASHING PER R703.4
SCALE: N.T.S.

3

ASPHALT SHINGLE ROOF SPEC'S

SHINGLES

15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3452, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURE. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

FASTENERS

FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 12 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESISTANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL

4



CLAY AND CONCRETE ROOF TILE SPECS

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C. MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING,
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE.
A. AMOUNT AND PLACEMENT OF MORTAR
B. AMOUNT AND PLACEMENT OF ADHESIVE
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT
4. SLOPE REQUIREMENT.

5

FLOOR SHEATHING AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES SPAN RATING 48/24 OR BETTER, GLUED AND NAILED

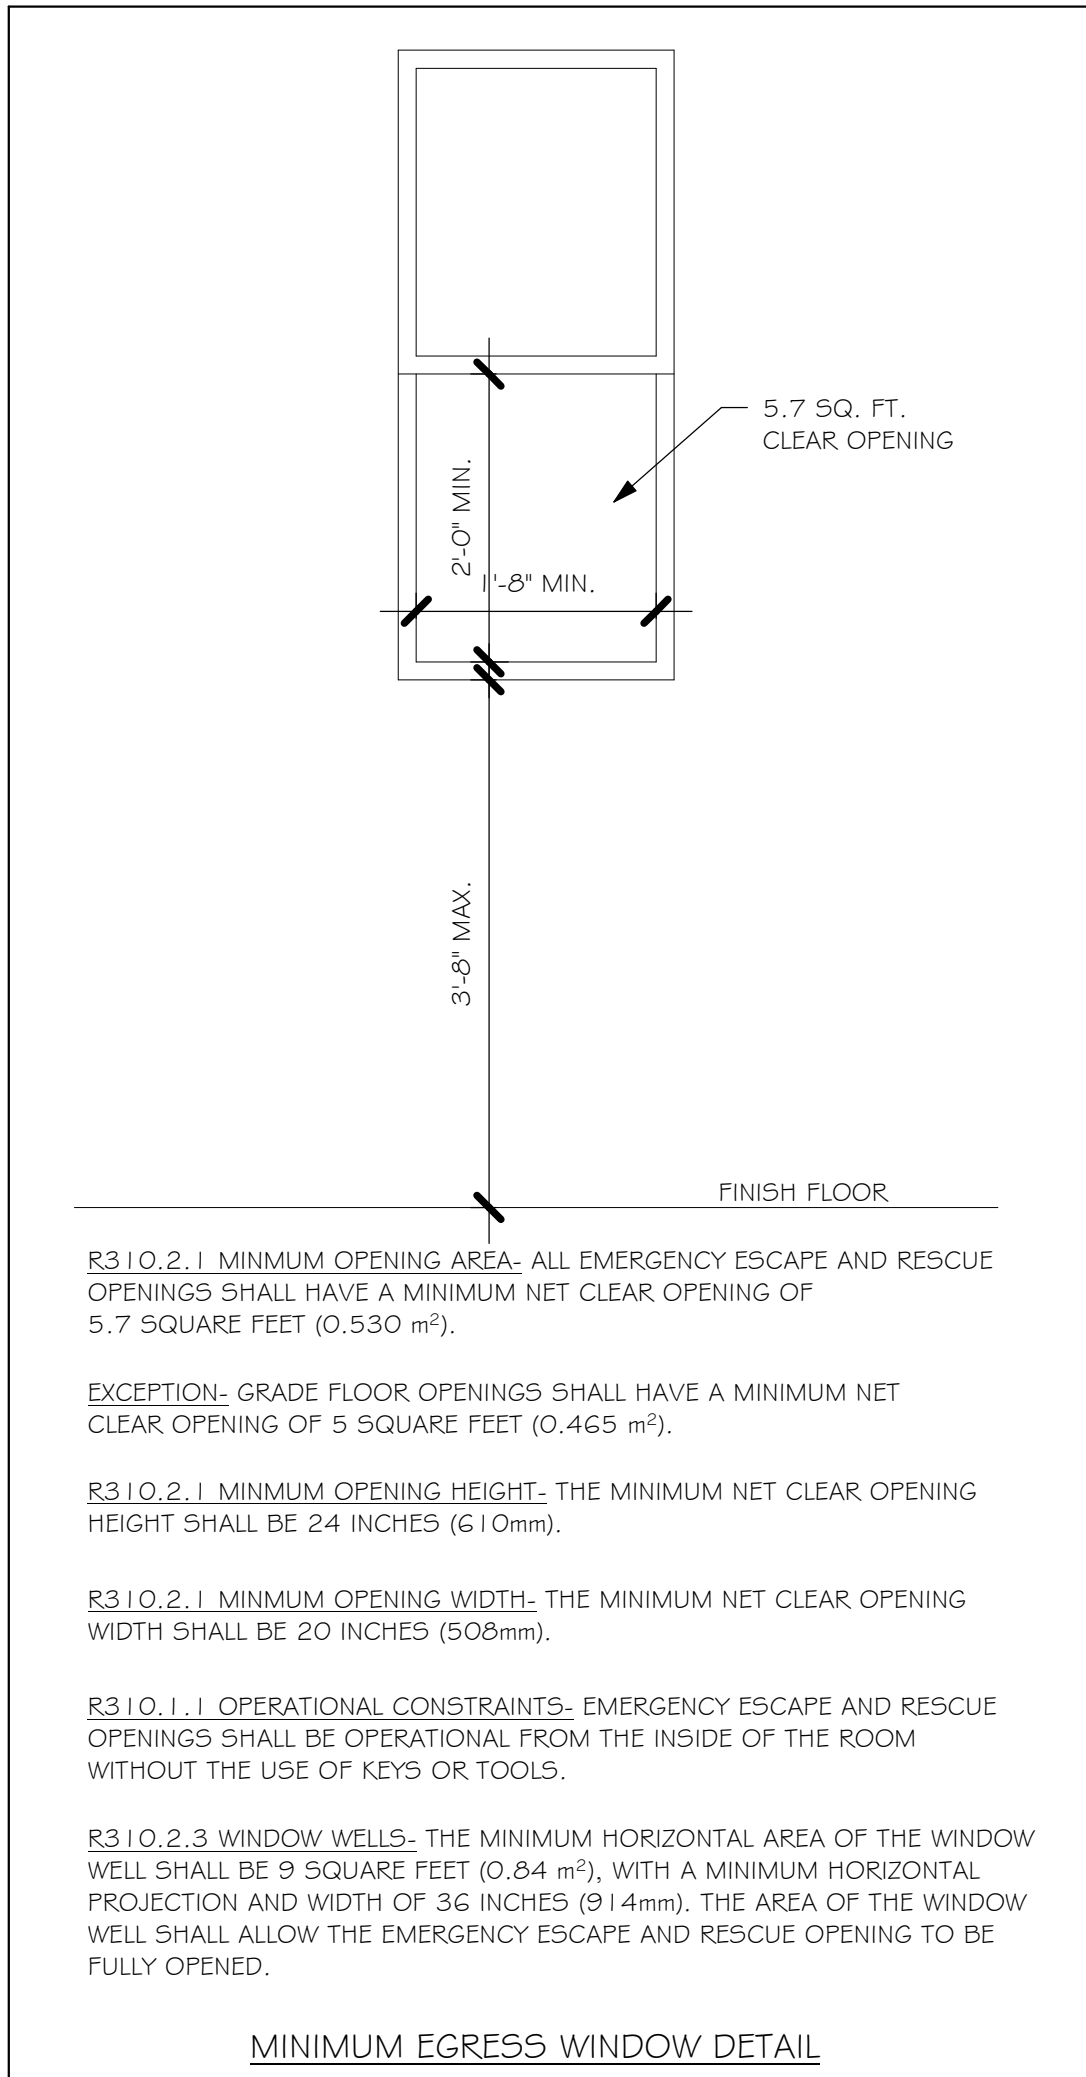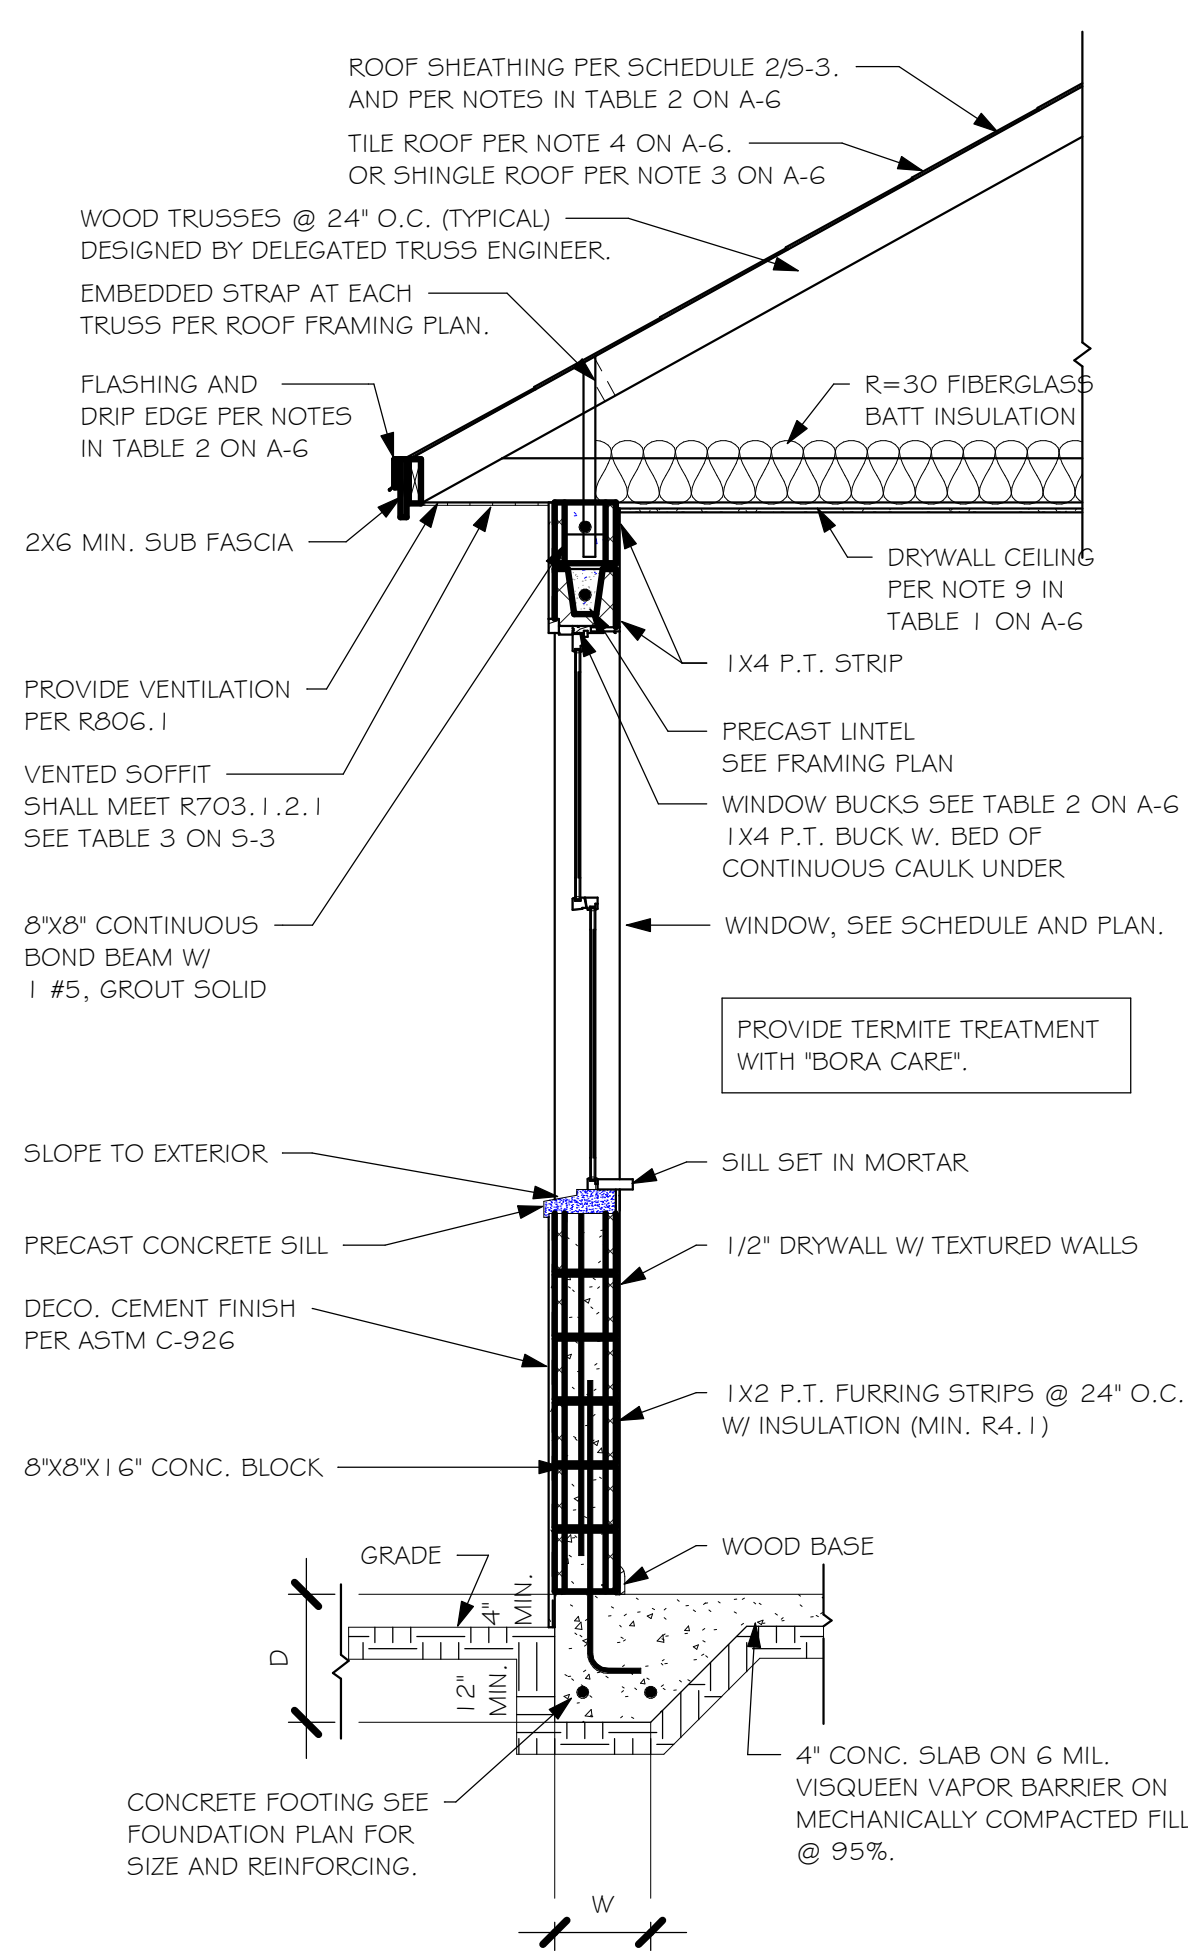

R310.2.1 MINIMUM OPENING AREA: ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.530 m²).

EXCEPTION: GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.5 SQUARE FEET (0.465 m²).

R310.2.1 MINIMUM OPENING HEIGHT: THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES (610mm).


R310.2.1 MINIMUM OPENING WIDTH: THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES (508mm).

R310.1.1 OPERATIONAL CONSTRAINTS: EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS.

R310.2.3 WINDOW WELLS: THE MINIMUM HORIZONTAL AREA OF THE WINDOW WELL SHALL BE 9 SQUARE FEET (0.84 m²), WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES (914mm). THE AREA OF THE WINDOW WELL SHALL ALLOW THE EMERGENCY ESCAPE AND RESCUE OPENING TO BE FULLY OPENED.

MINIMUM EGRESS WINDOW DETAIL

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

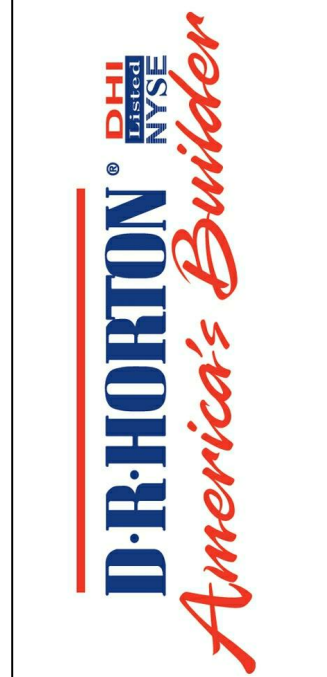


LOT: 16	BLOCK: 364
SUBDIVISION: BURNT STORE MEADOWS	
ADDRES: 739 TRUMPET TREE	
D.R.H. #: 578380024	

MODEL	2197
GCD JOB #	10782


DATE:	03/05/19
DRAWN BY:	JSL
CHECKED BY:	JWC
REVISED:	
PLAN:	SECTIONS
SCALE:	As indicated

A-6


Z:\MASTER\2018 BUILDERS\2018 DR HORTON\SUBDIVISIONS\BURNT STORE\10782 LOT 16
BLK 364 2197 ARREV\10782 2197 AR.rvt

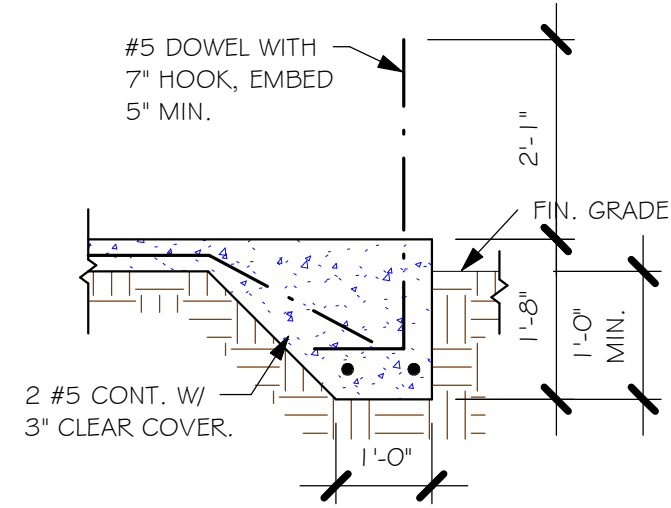


"F3" FOOTING
1/2" = 1'-0"

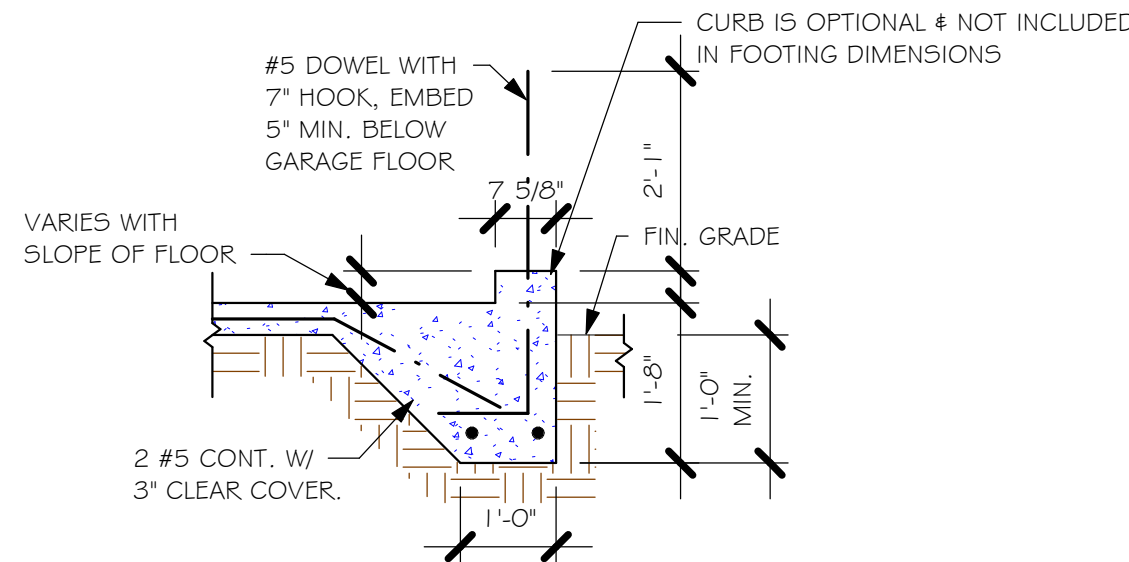


"F3" WITH CURB
1/2" = 1'-0"

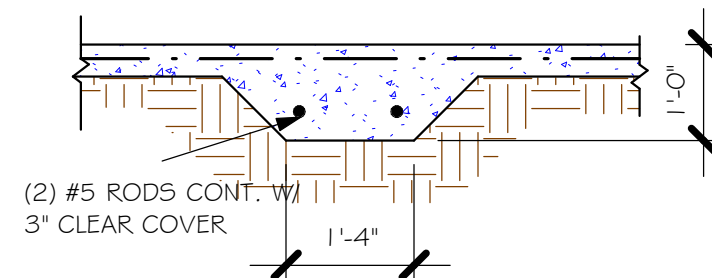


"F5" FOOTING
1/2" = 1'-0"

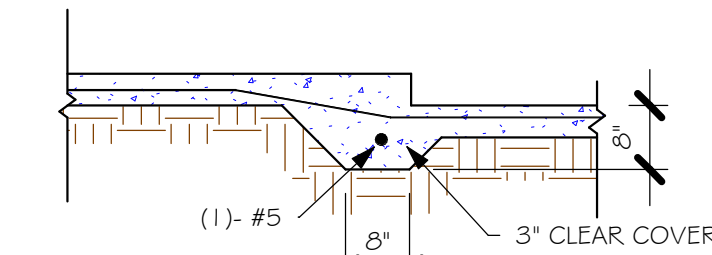

"F6A" STEP DOWN
1/2" = 1'-0"

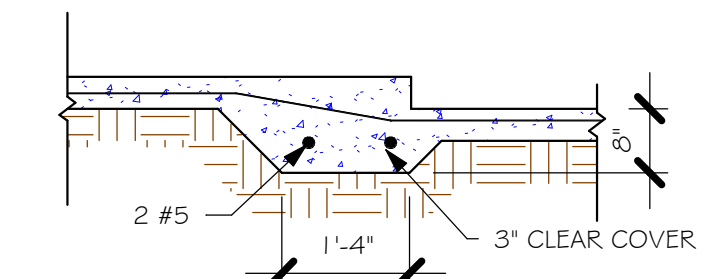

"F6" STEP DOWN
1/2" = 1'-0"

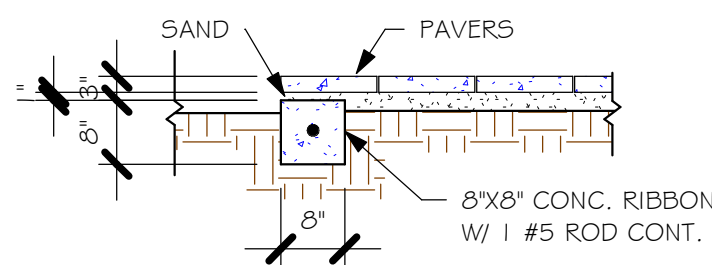

"P" PAVERS DETAIL
1/2" = 1'-0"

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

PLAN NOTES:

1. TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
2. "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
3. PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
4. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
5. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
6. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/S-3.


PAD FOOTING SCHEDULE

TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
				LONG WAY	SHORT WAY	
(A)	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
(B)	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
(C)	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
(D)	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
(E)	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

WALL FOOTING SCHEDULE

TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE	
F1	CONT.	1'-4"	0'-8"	2-#5		
F2	CONT.	1'-8"	0'-10"	2-#5		
F3	CONT.	1'-0"	1'-8"	2-#5		
F4	CONT.	1'-4"	1'-8"	2-#5		
F5	CONT.	1'-4"	1'-0"	2-#5		
F6	CONT.	1'-4"	1'-0"	2-#5		
F6A	CONT.	0'-8"	0'-8"	1-#5		
TE	CONT.	0'-8"	0'-8"	1-#5		

ADD CURB TO GARAGE, SEE DETAIL

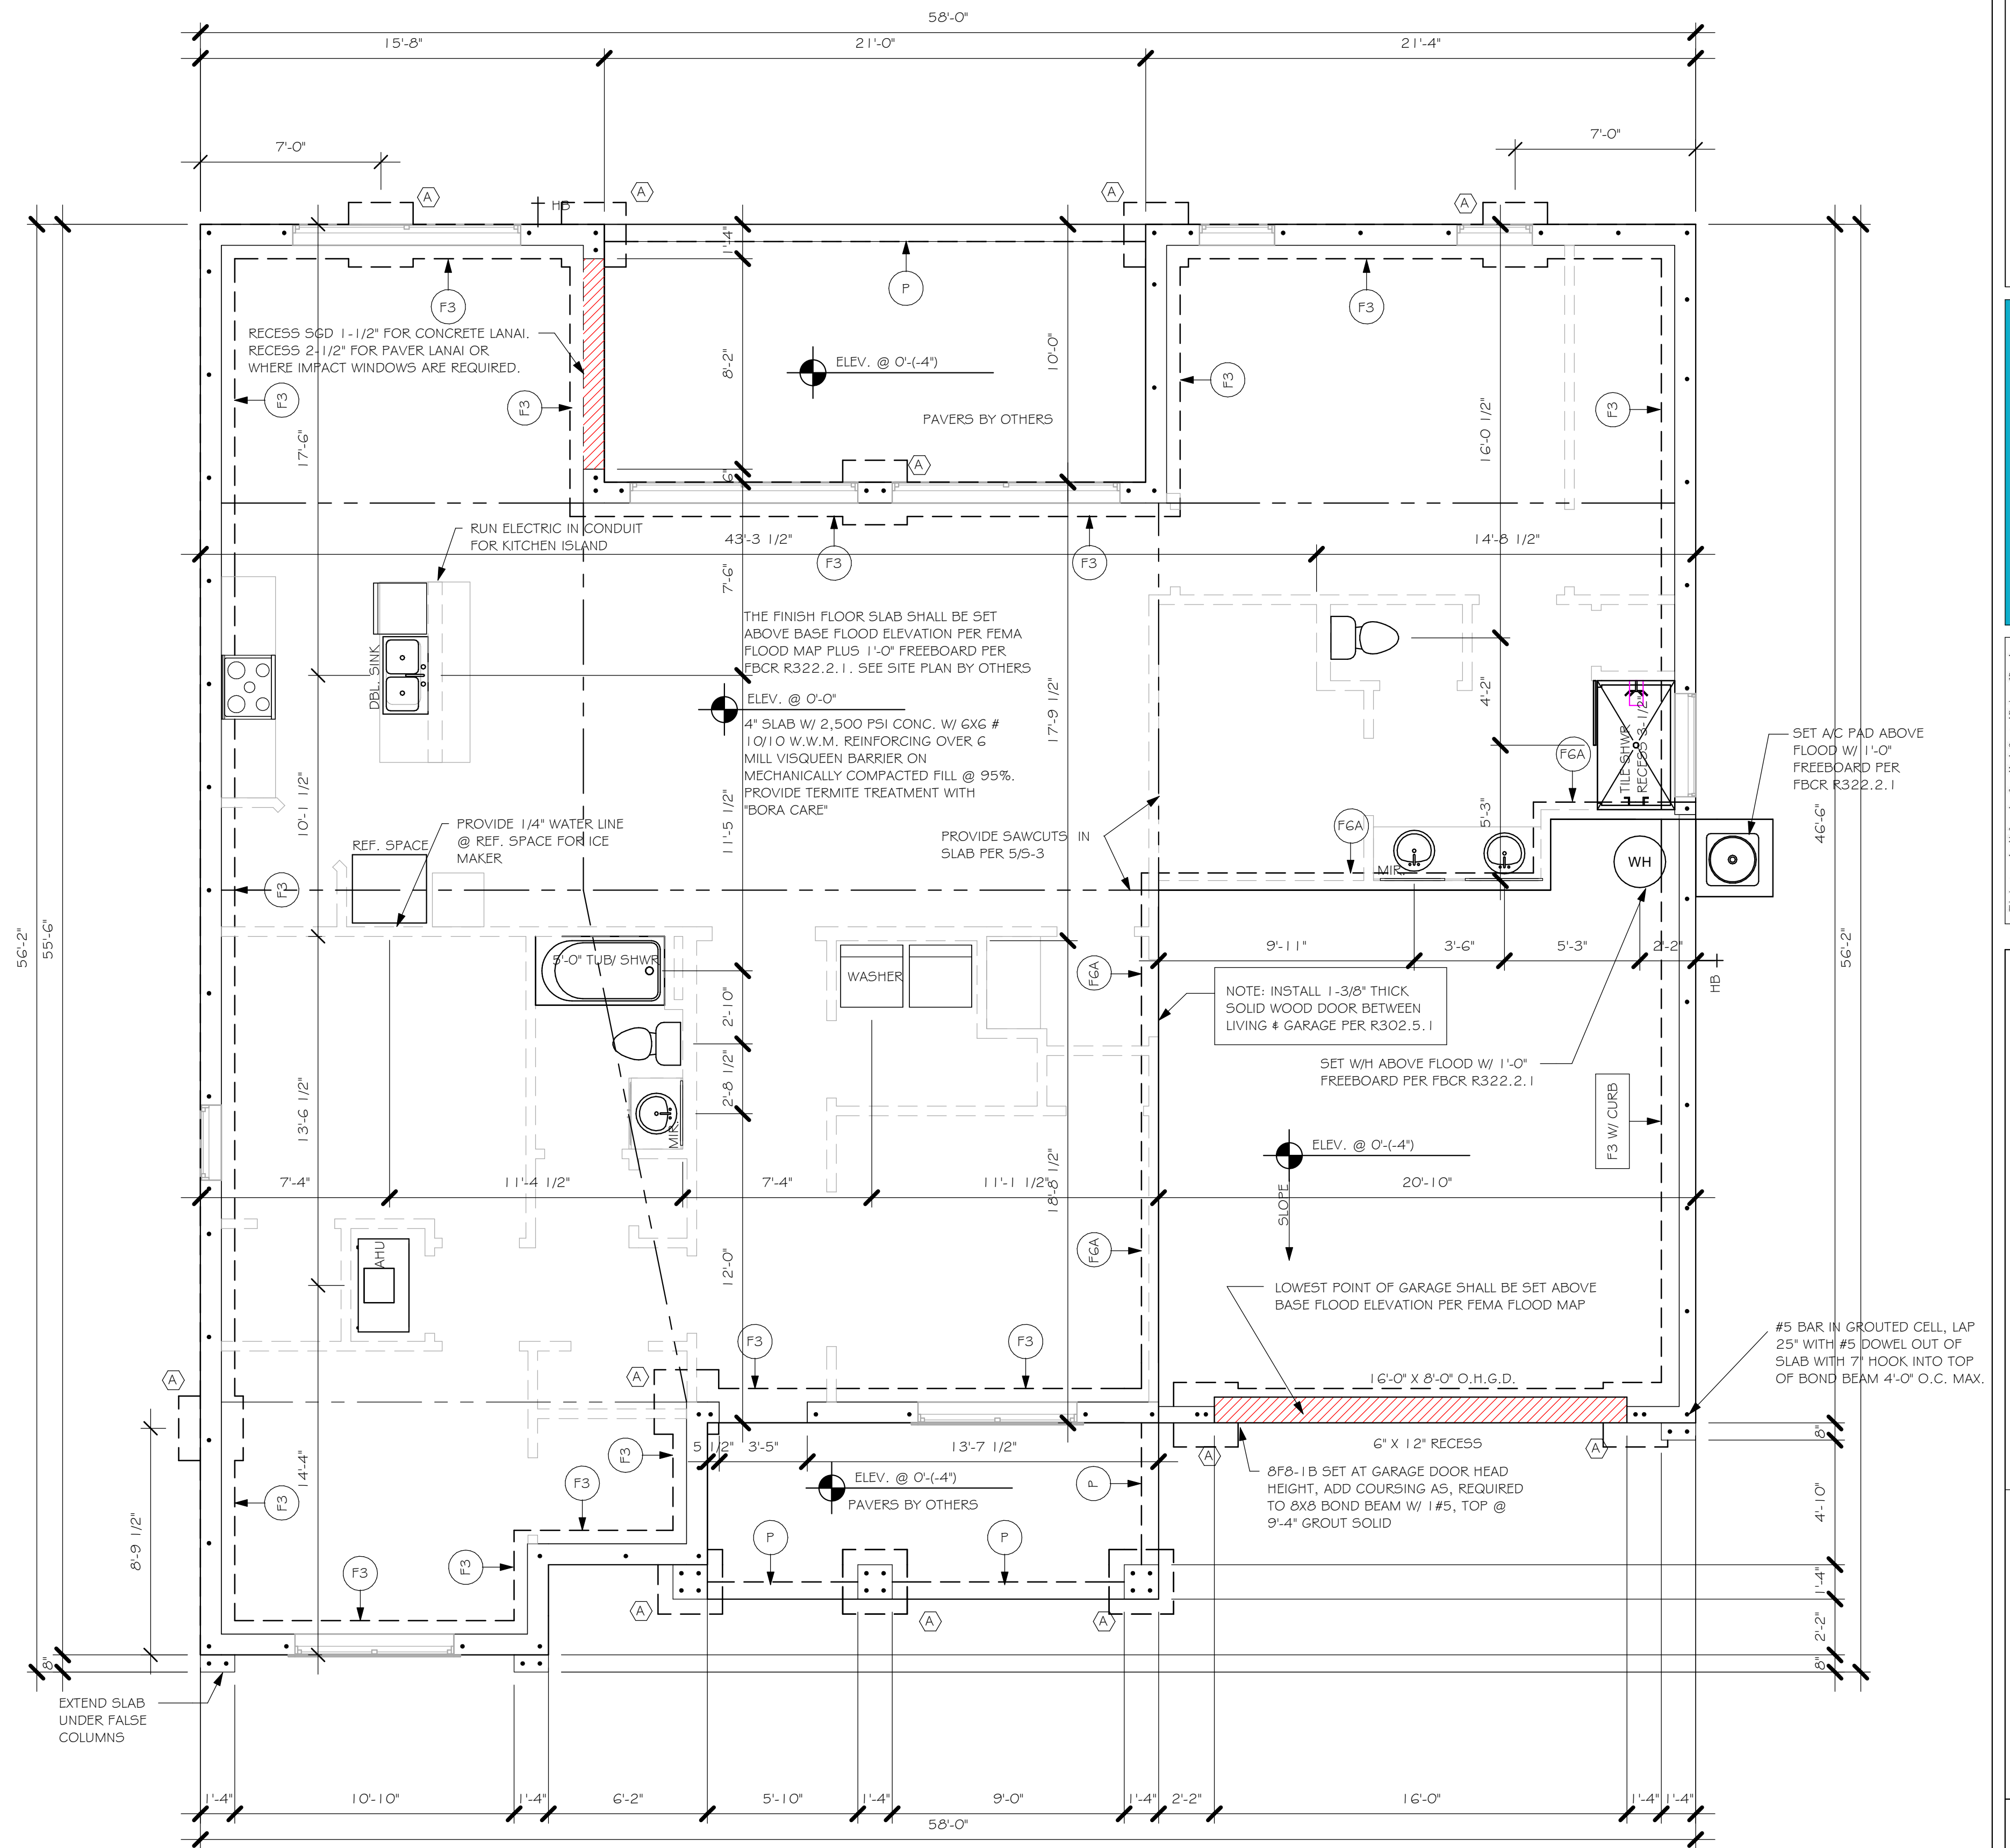

FOUNDATION PLAN "AR"
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

D-R HORTON
NYSE
America's Builder

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8222
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS
OF NORTH FLORIDA
INC.
1515 SE 47th ST.
CAPE CORAL, FL 33904
(239) 549-4254
CEN 8889

LOT: 16
SUBDIVISION: BURNT STORE MEADOWS
ADDRESS: 739 TRUMPET TREE
D.R.H. #: 578380024

MODEL
2197

GCD JOB # 10782

DATE: 03/05/19

DRAWN BY: JSL




CHECKED BY: JWC

REVISED:

PLAN: FOUNDATION PLAN

SCALE: As indicated

S-1 AR

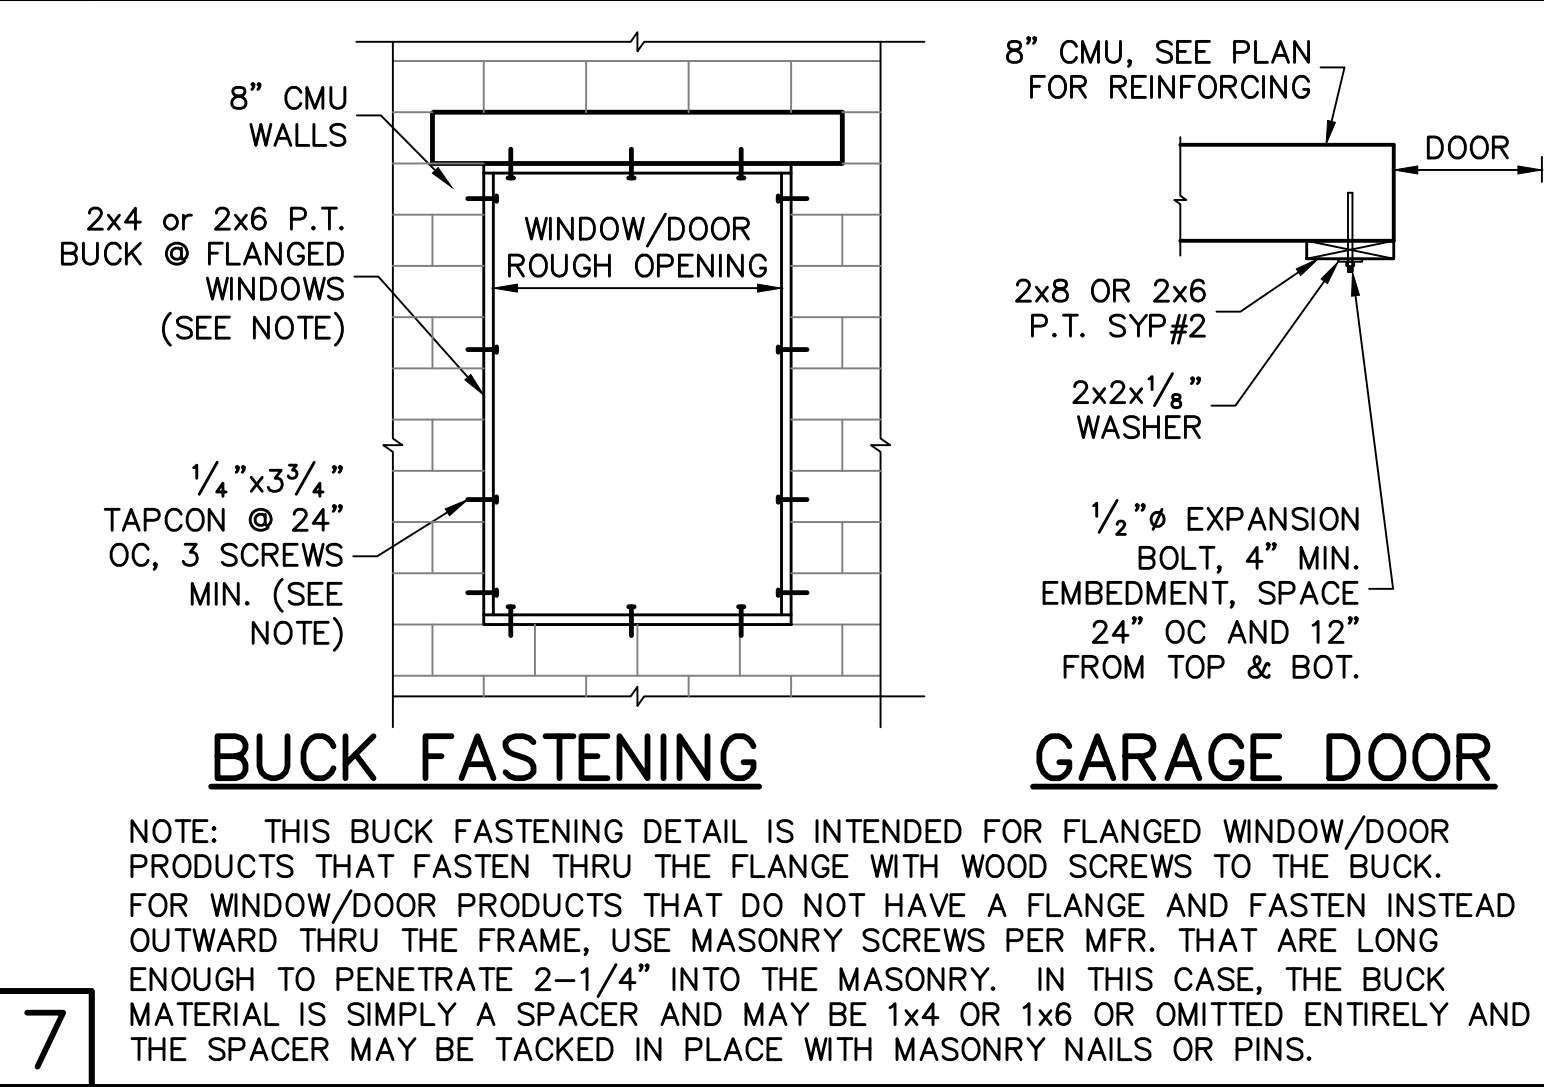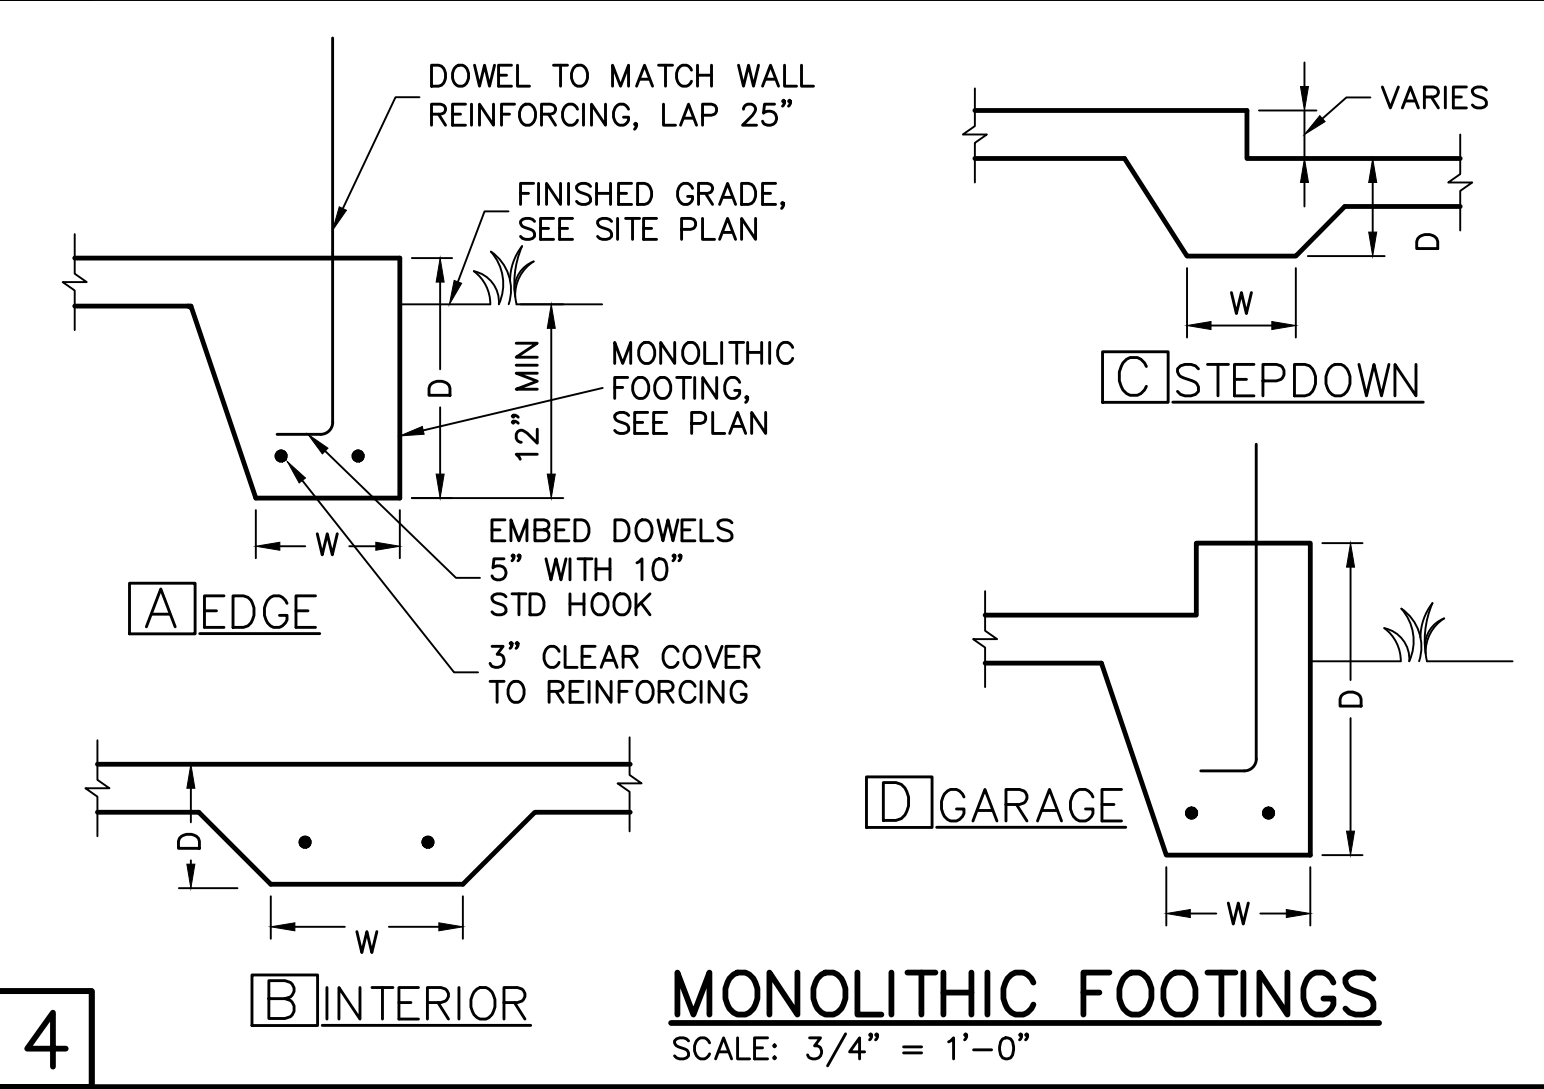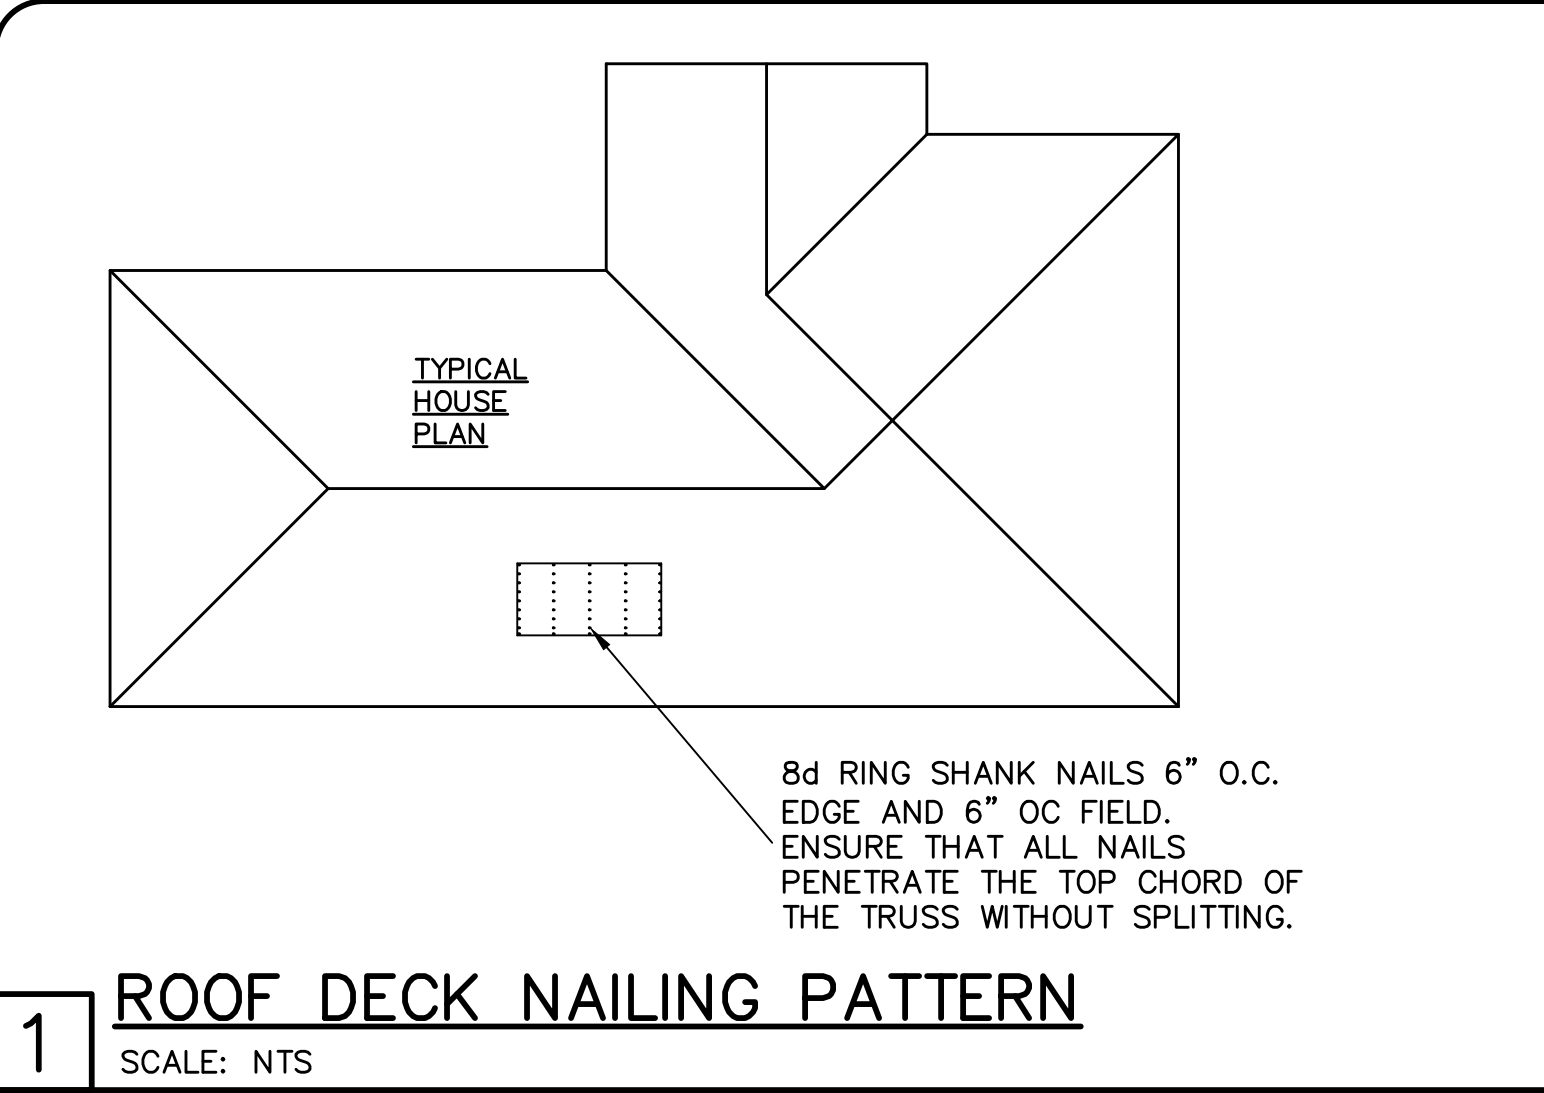

10

RETROFIT UPLIFT CONNECTOR SCHEDULE

TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR
TO 1145	1-HTWM16 or 20
TO 1145	1-HTWM16 or 20
TO 2290	2-HTWM16 or 20
TO 4520	2-LUGT2
TO 4520	HTT16
TO 9790	HGT-2/3







NOTES:
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2) CONNECTORS ARE USP. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH USP PRINTED INSTRUCTIONS.
3) CONCRETE SCREW SHALL BE WEDGE-BOLT+, TITEN, TAPCON OR EQUIVALENT.

2

SHEATHING SCHEDULE

EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED) (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.

NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

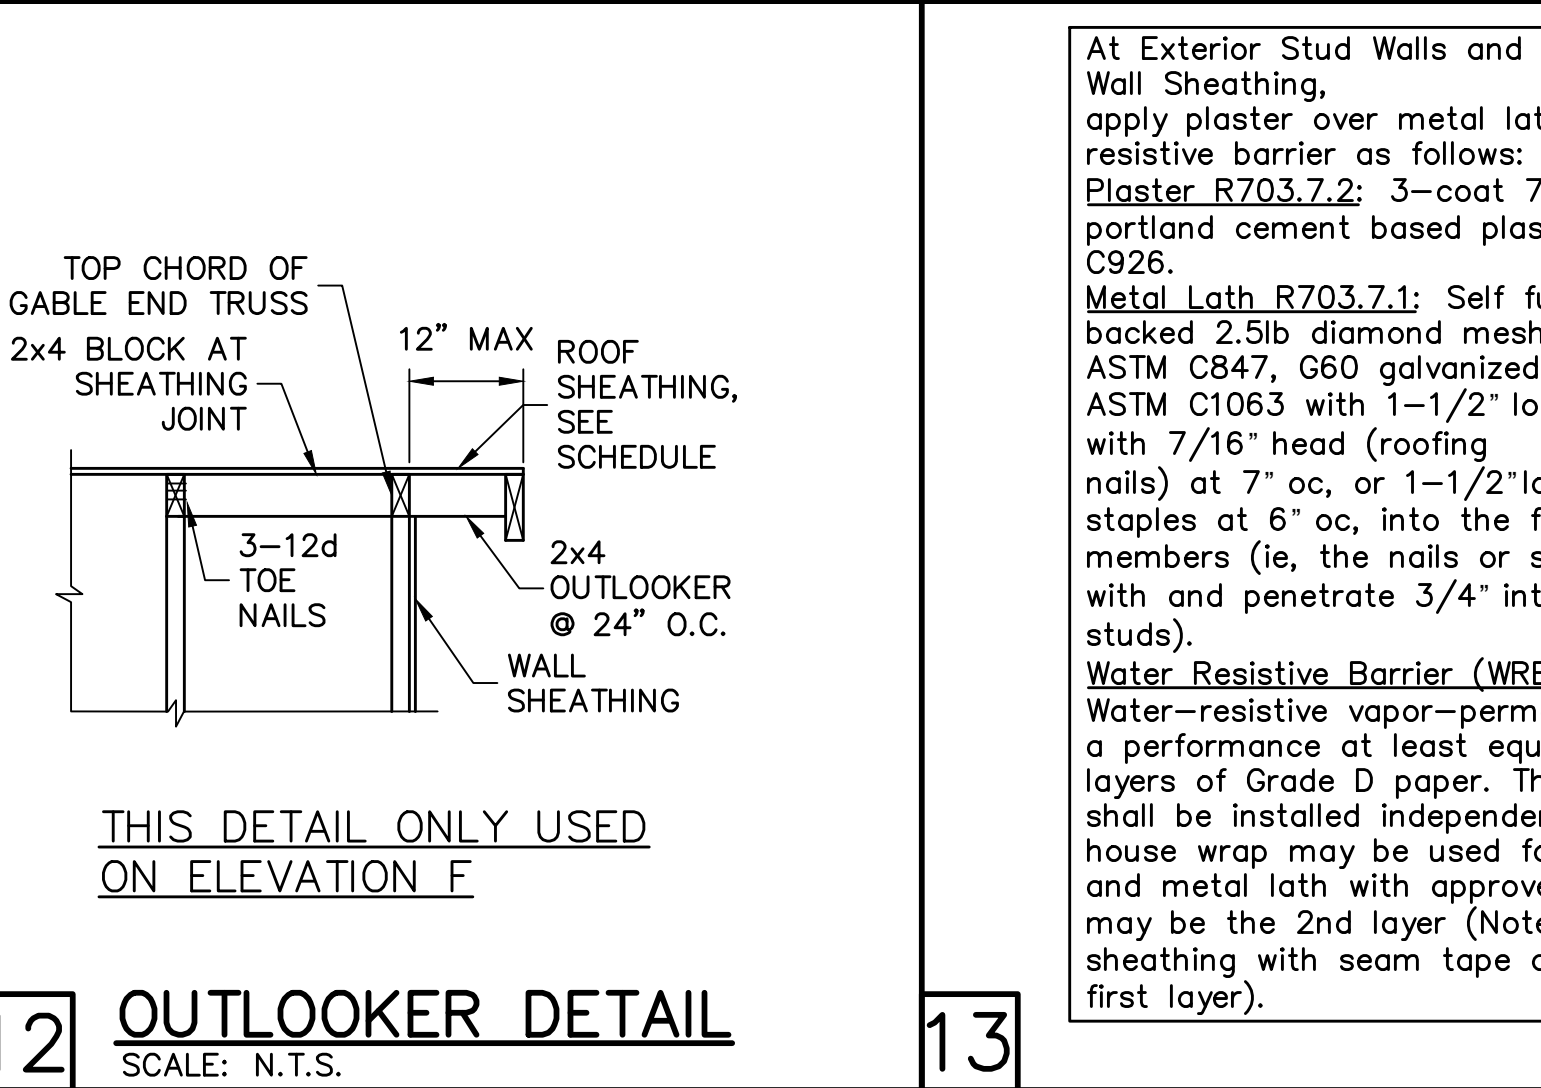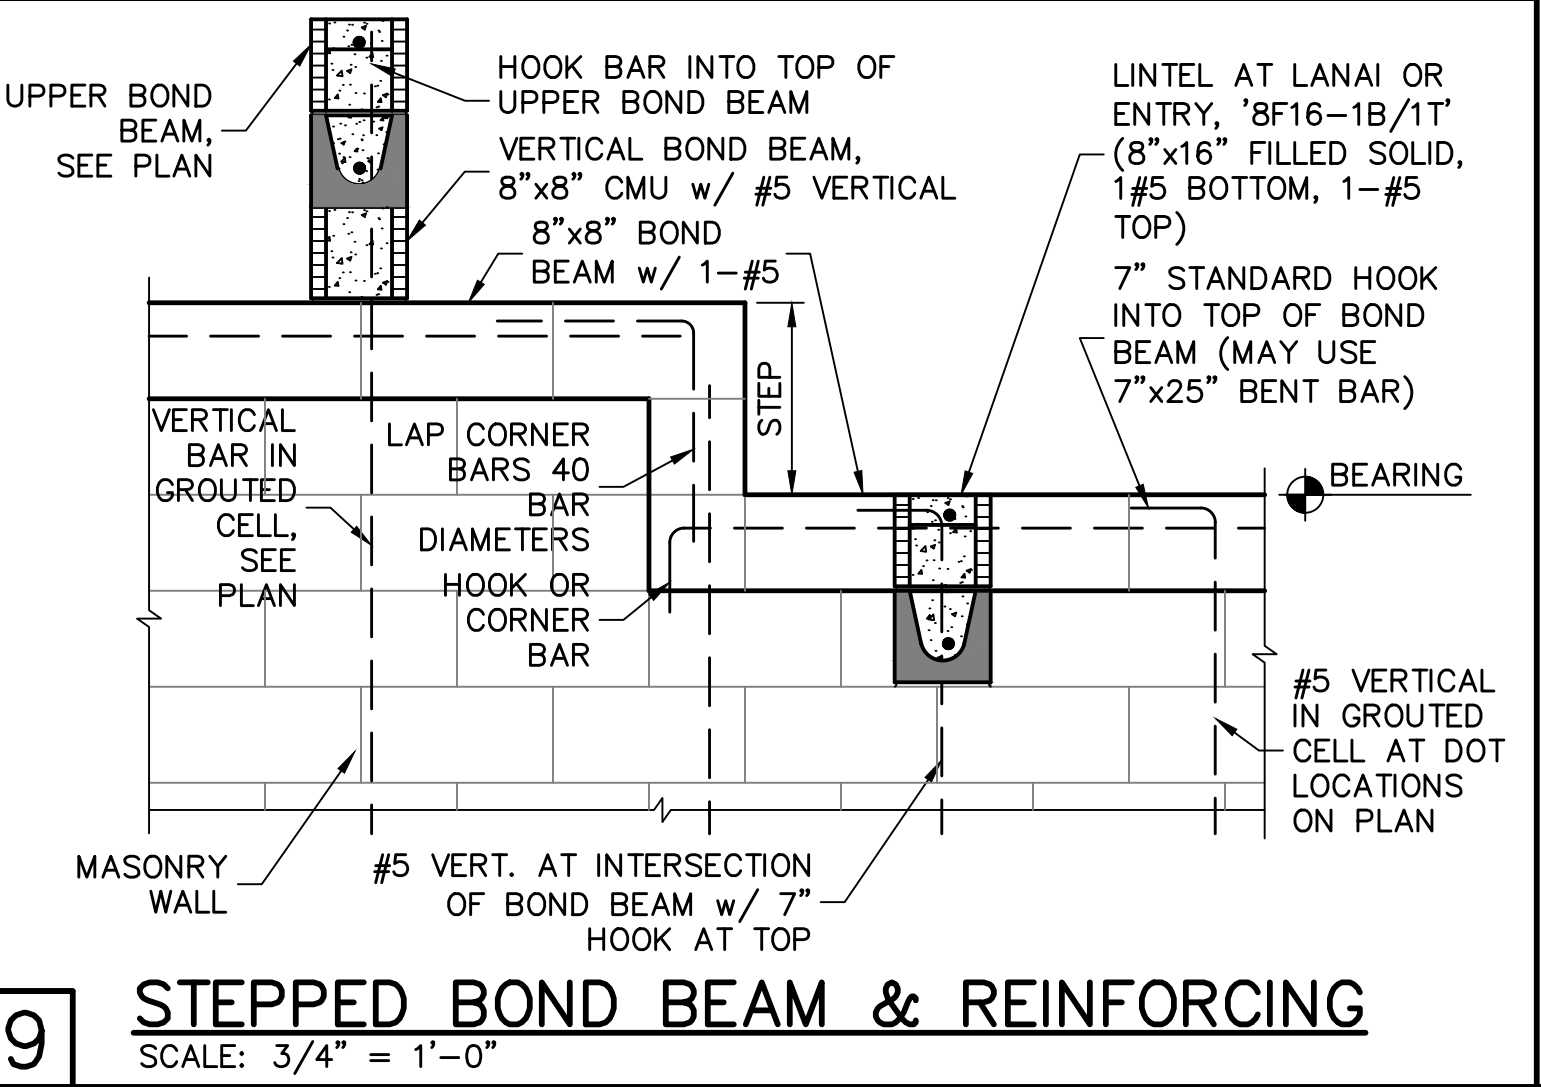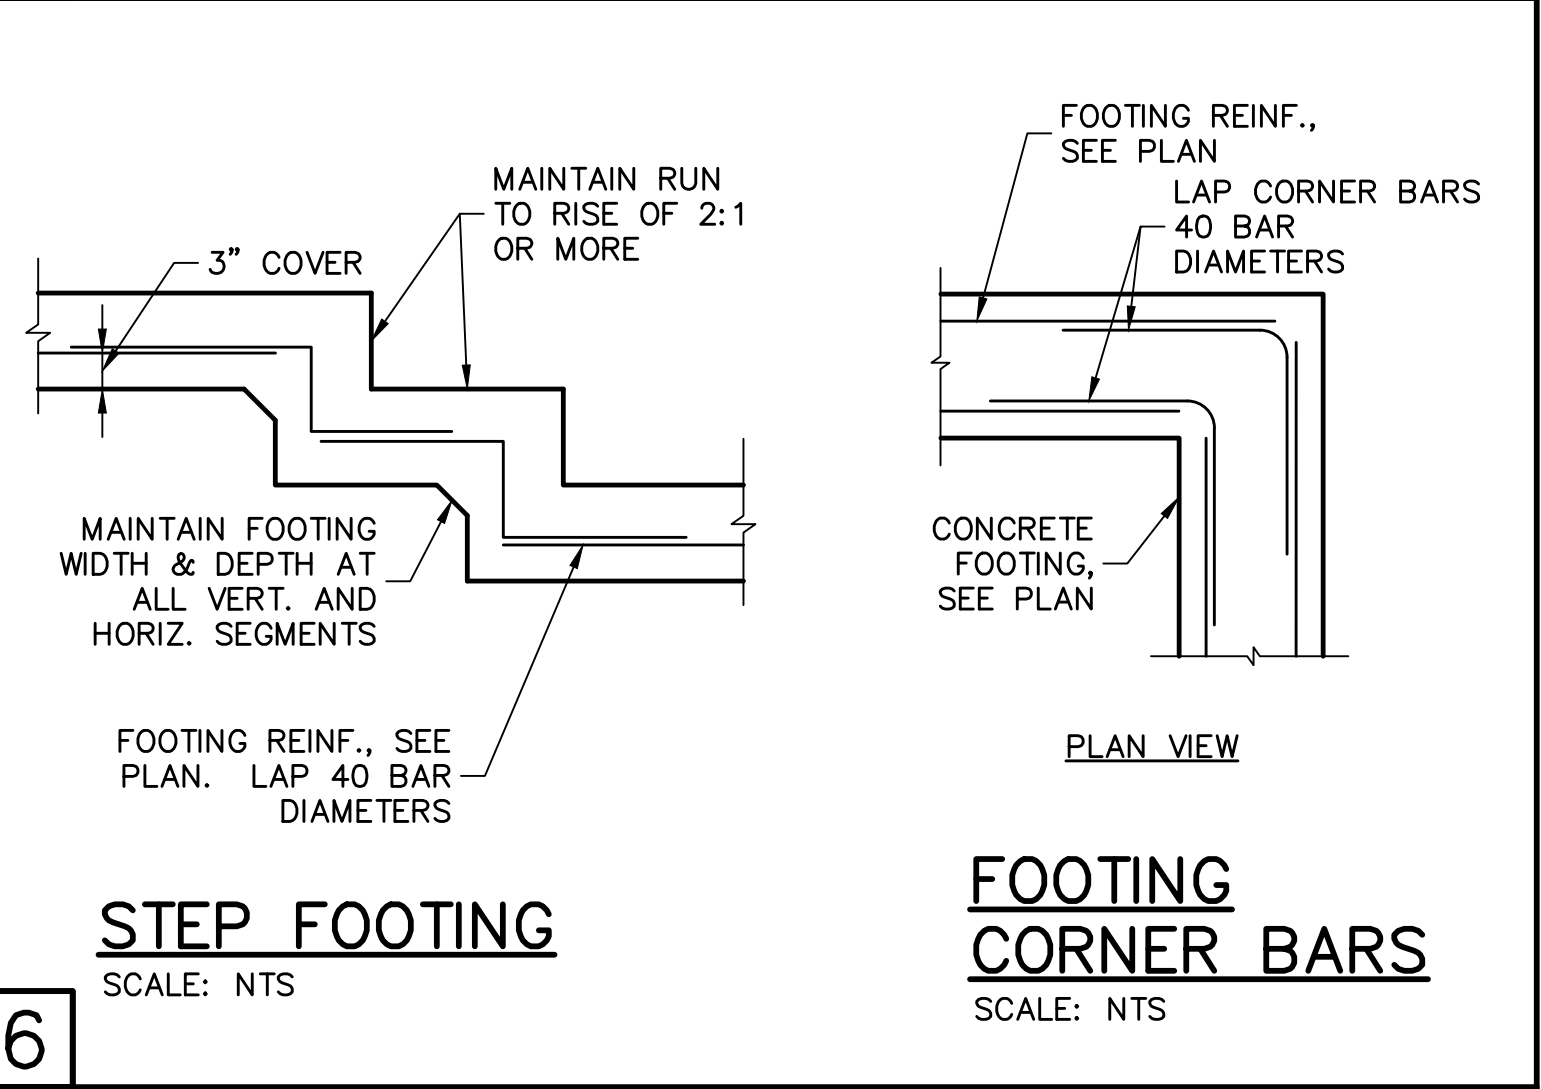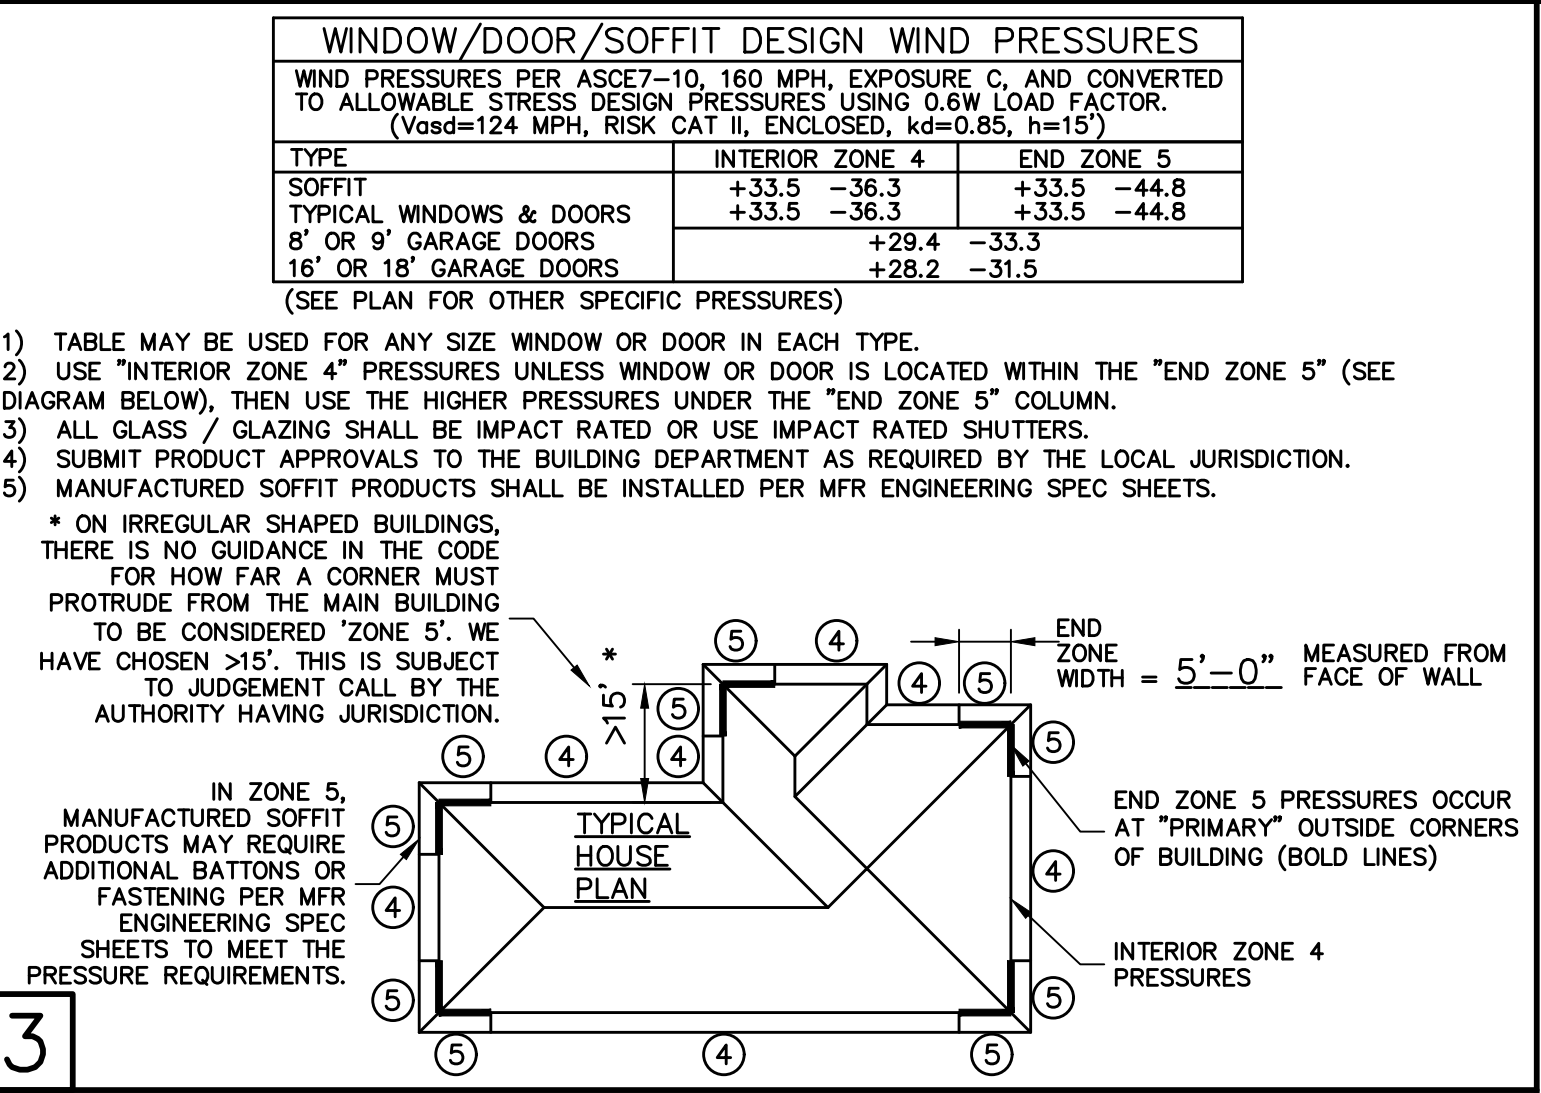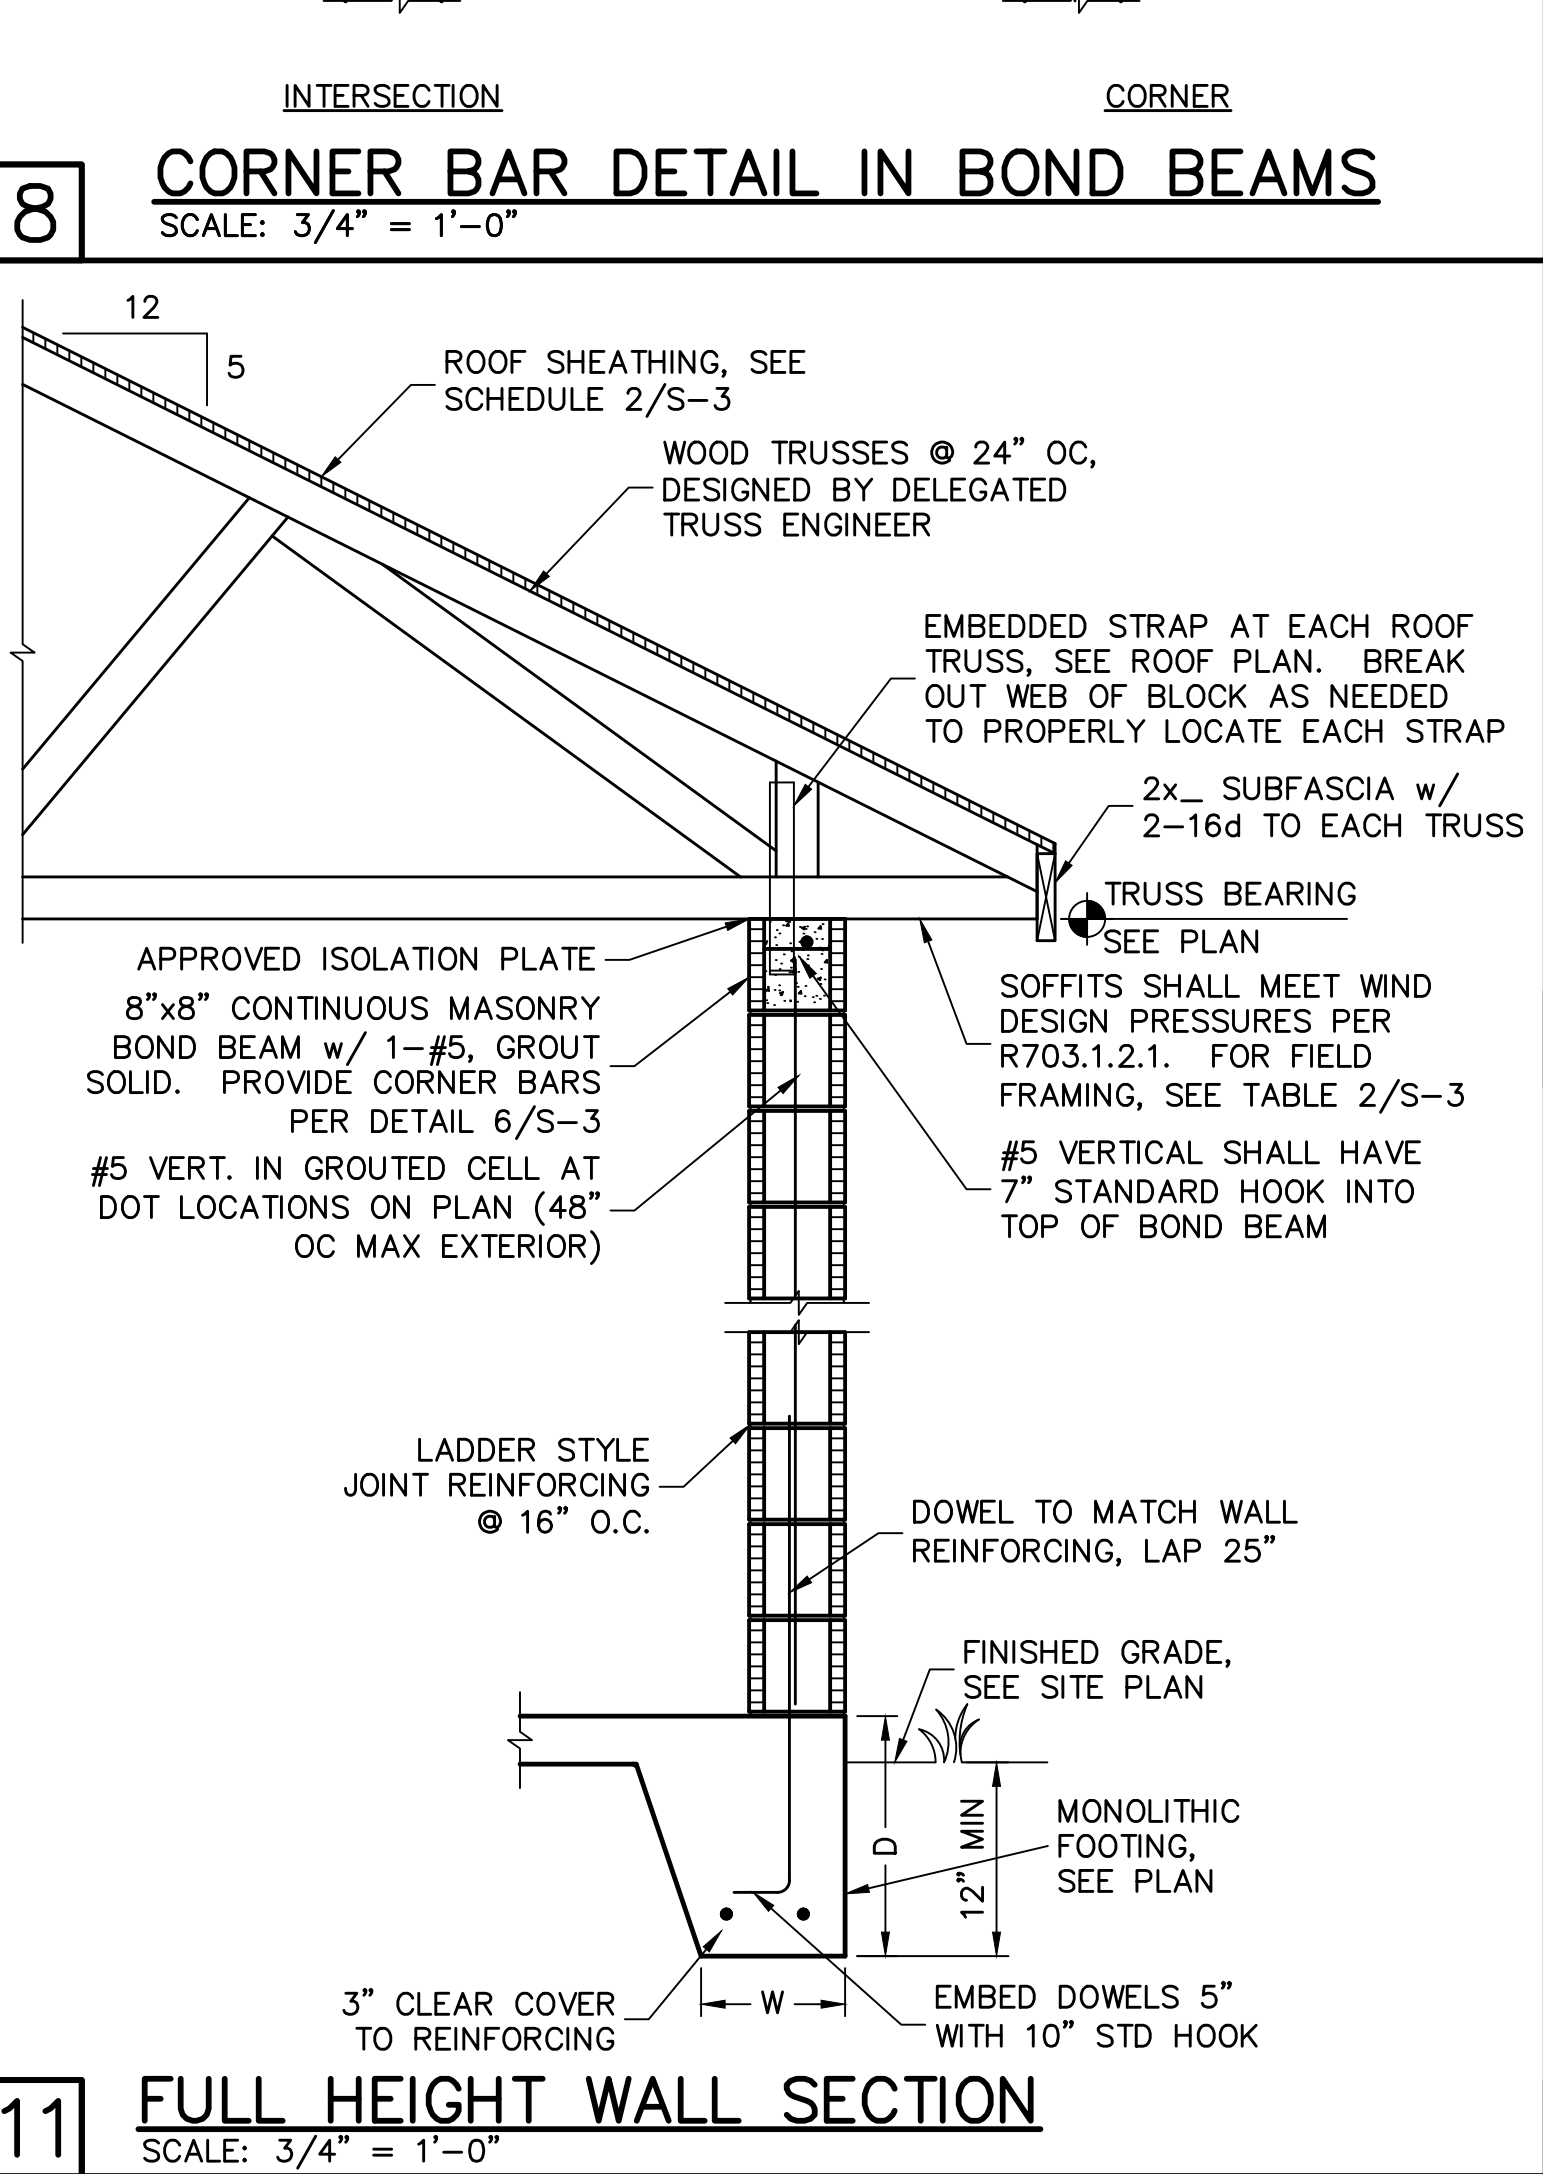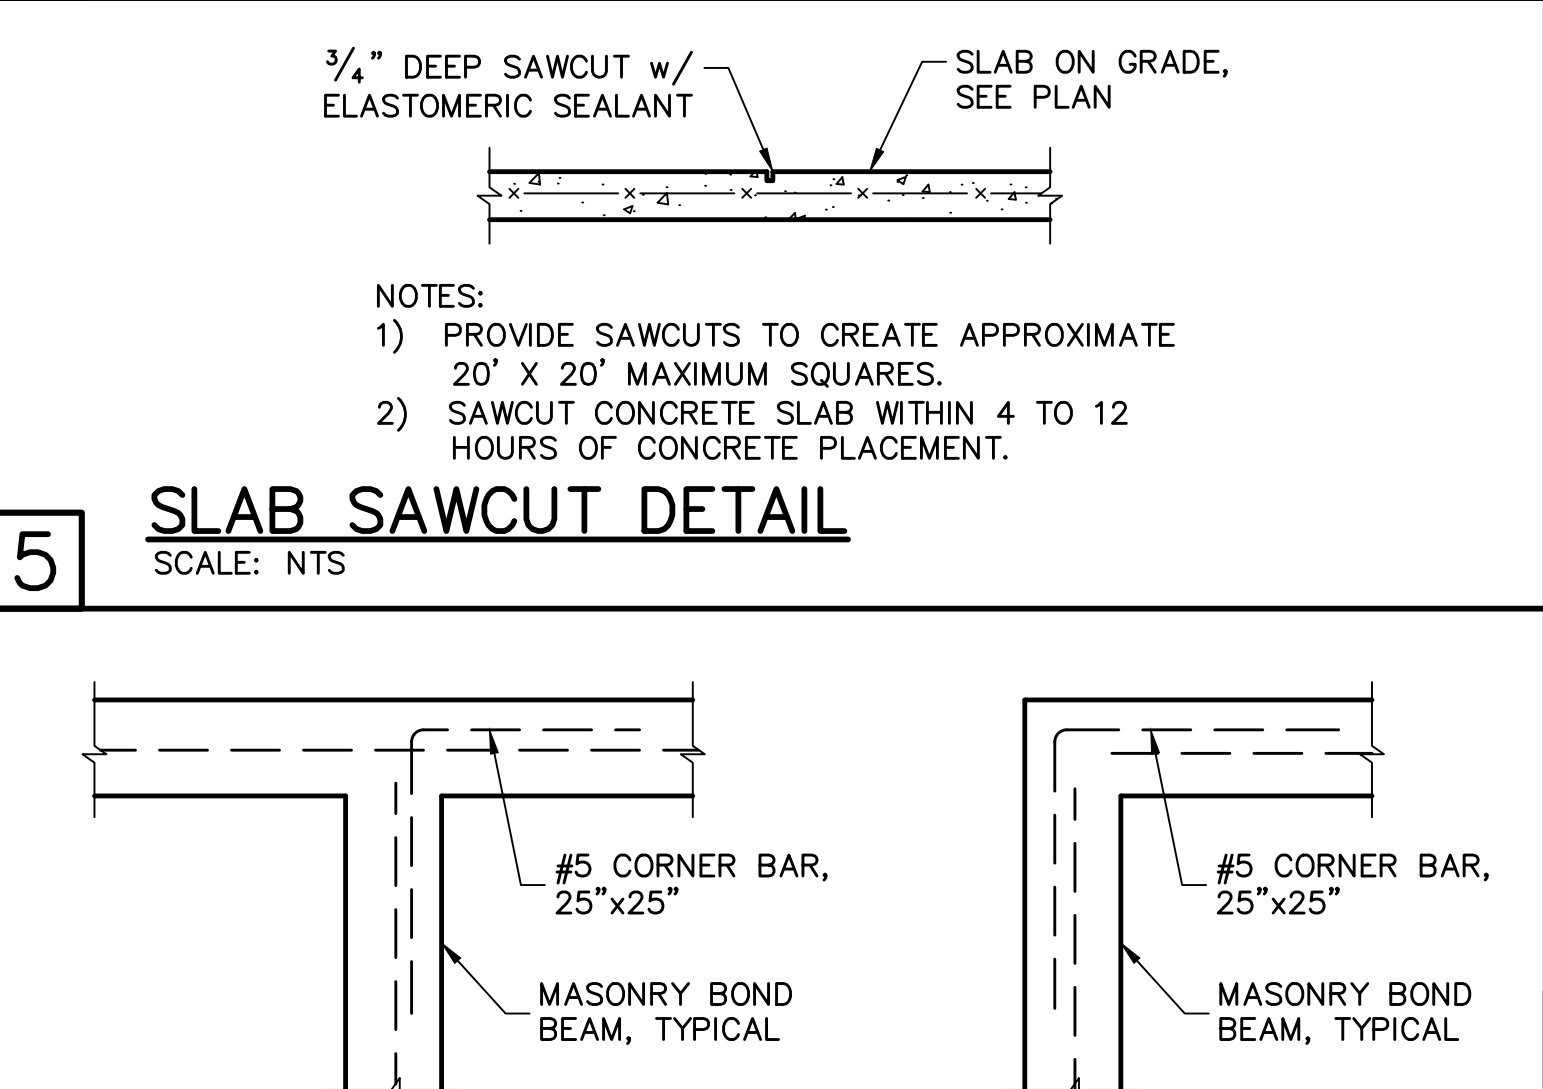

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF
DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7-10
BASIC WIND SPEED (ASCE7-10) 160 MPH
NOMINAL WIND SPEED (Vwsd TABLE R301.2.1.3) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3" CENTERED
SLAB ON GRADE 1 1/2" CENTERED
BEAMS 1 1/2" CENTERED
COLUMNS 1 1/2" CENTERED
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3
GRADE 60 FOR #4 TO #11
WELDED WIRE FABRIC - ASTM A185
SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPLICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.
FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER ACI 530-13
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI
REINFORCING STEEL - ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN. PROVIDE HORIZONTAL JOINT REINFORCEMENT IN WALLS AT 16" OC VERTICALLY, UNLESS NOTED OTHERWISE. IN ADDITION, INSTALL JOINT REINFORCING IN THE FIRST TWO MORTAR JOINTS ABOVE AND BELOW OPENINGS, EXTENDING AT LEAST 24" BEYOND THE OPENING. LAP JOINT REINFORCING 6" MINIMUM.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, H18-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES; TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

FOR SCOSTA TRUSSES: ELEVATION A, JOB # 44134, DATED: 08/13/18, REVISED: 10/28/18

REVISIONS

NO.	DESCRIPTION	DATE

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

BUILDER:
D.R. HOHON • PH
America's Builder

STRUCTURAL DETAILS
MODEL 2197 A
739 TRUMPET TREE
PUNTA GORDA, FLORIDA
LOT: 16 SUBDIVISION: BURNT STORE MEADOWS

DESIGN/DRAWN
DWB/GRH
CHECKED
DWB
DATE
03/13/19
SCALE
VARIES
JOB NO.
DR10782
SHEET

S-3

SHEET 3 OF 3