

DESIGN CRITERIA

TOP CHORD LIVE LOAD	20
TOP CHORD DEAD LOAD	7
BOTTOM CHORD LIVE LOAD	10#
BOTTOM CHORD DEAD LOAD	10
TOTAL LOAD	37
DURATION FACTOR	1.25
WIND DESIGN SPEED (MPH)	160
ASCE 7-10 CAT II EXP C	MFWS
CLOSED	FB 2017
MAX. WALL HT FOR WIND LOAD	8'-0"

SHINGLE

****UNLESS NOTED****

REACTION VALUES ARE UNDER 5000#

UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE

*****CAUTION*****

DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION, ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY SHEET FOR HANDLING METHODS & TEMPORARY BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA CORP. "+/-" BEARING DIFFERENCES SHOWN ARE CRITICAL. IF ANY HEIGHTS DEVIATE - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS	
	0'-0" ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.

TYPICAL HANGER SCHEDULE	
(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 16D COMMON NAILS EXCEPT THE FOLLOWING

LUS24 - 100 COMMON	THJA26 - 100 x 1-1/2
--------------------	----------------------

*****ATTENTION*****

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS, PITCHES, OVERHANGS, ELEVATIONS, CEILING & BEARING CONDITIONS. SCOSTA CORPORATION IS RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH PLANS AND/OR INFORMATION PROVIDED BY CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN. CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF INFORMATION AND PLANS PROVIDED TO SCOSTA CORPORATION, AND TO VERIFY CONFORMANCE TO FIELD CONDITIONS, AND/OR OWNER CHANGES. TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE APPROVED LAYOUT.

APPROVED BY: _____



DATE: _____ REQUESTED DELIVERY DATE: _____

JOB SITE CONTACT NAME: _____

PHONE #: _____

E-MAIL: _____

TYPICAL JACK CUTS

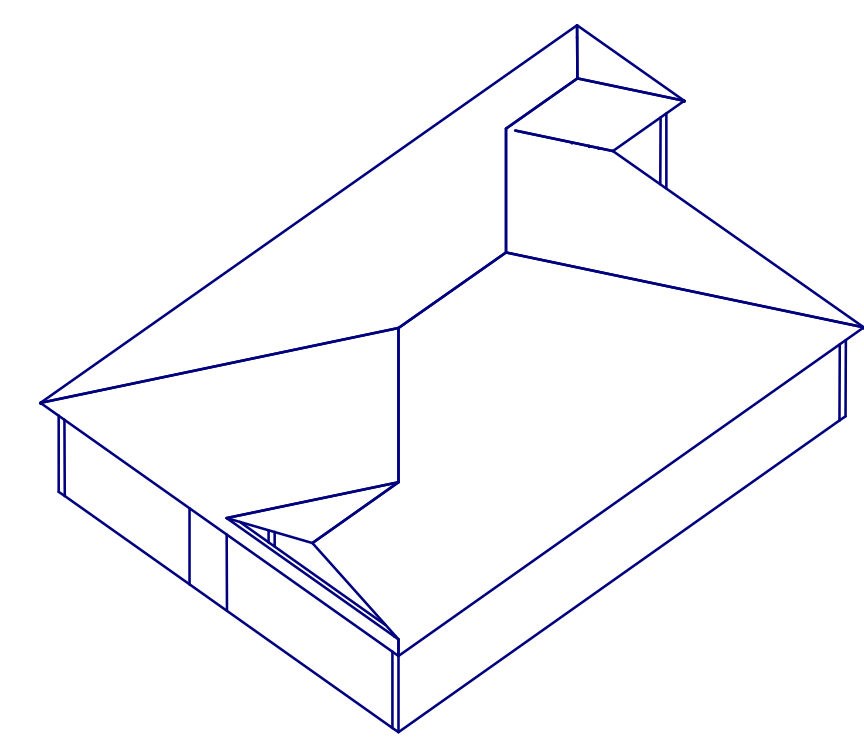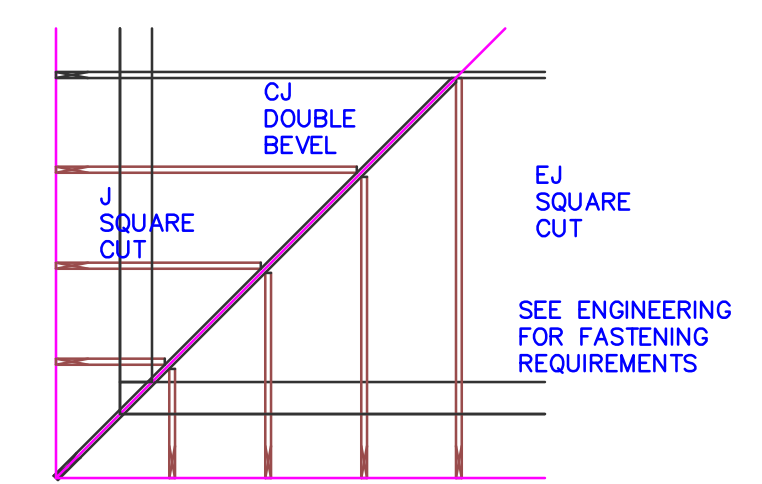


SCOSTA CORP.

WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES


3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242

SCALE: 1/4"=1'-0"	DATE: 12/12/19	REVISED BY:	DRAWN BY: J. CLEVELAND
JOB ADDRESS: 1499 A W/ LANAI GARAGE RIGHT LEE		1 of 1	
CUSTOMER: D.R. HORTON		JOB # 44116L	


Y:\O-New Data\1-Master 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 AR\REVIT\1087 1499 AR.rvt

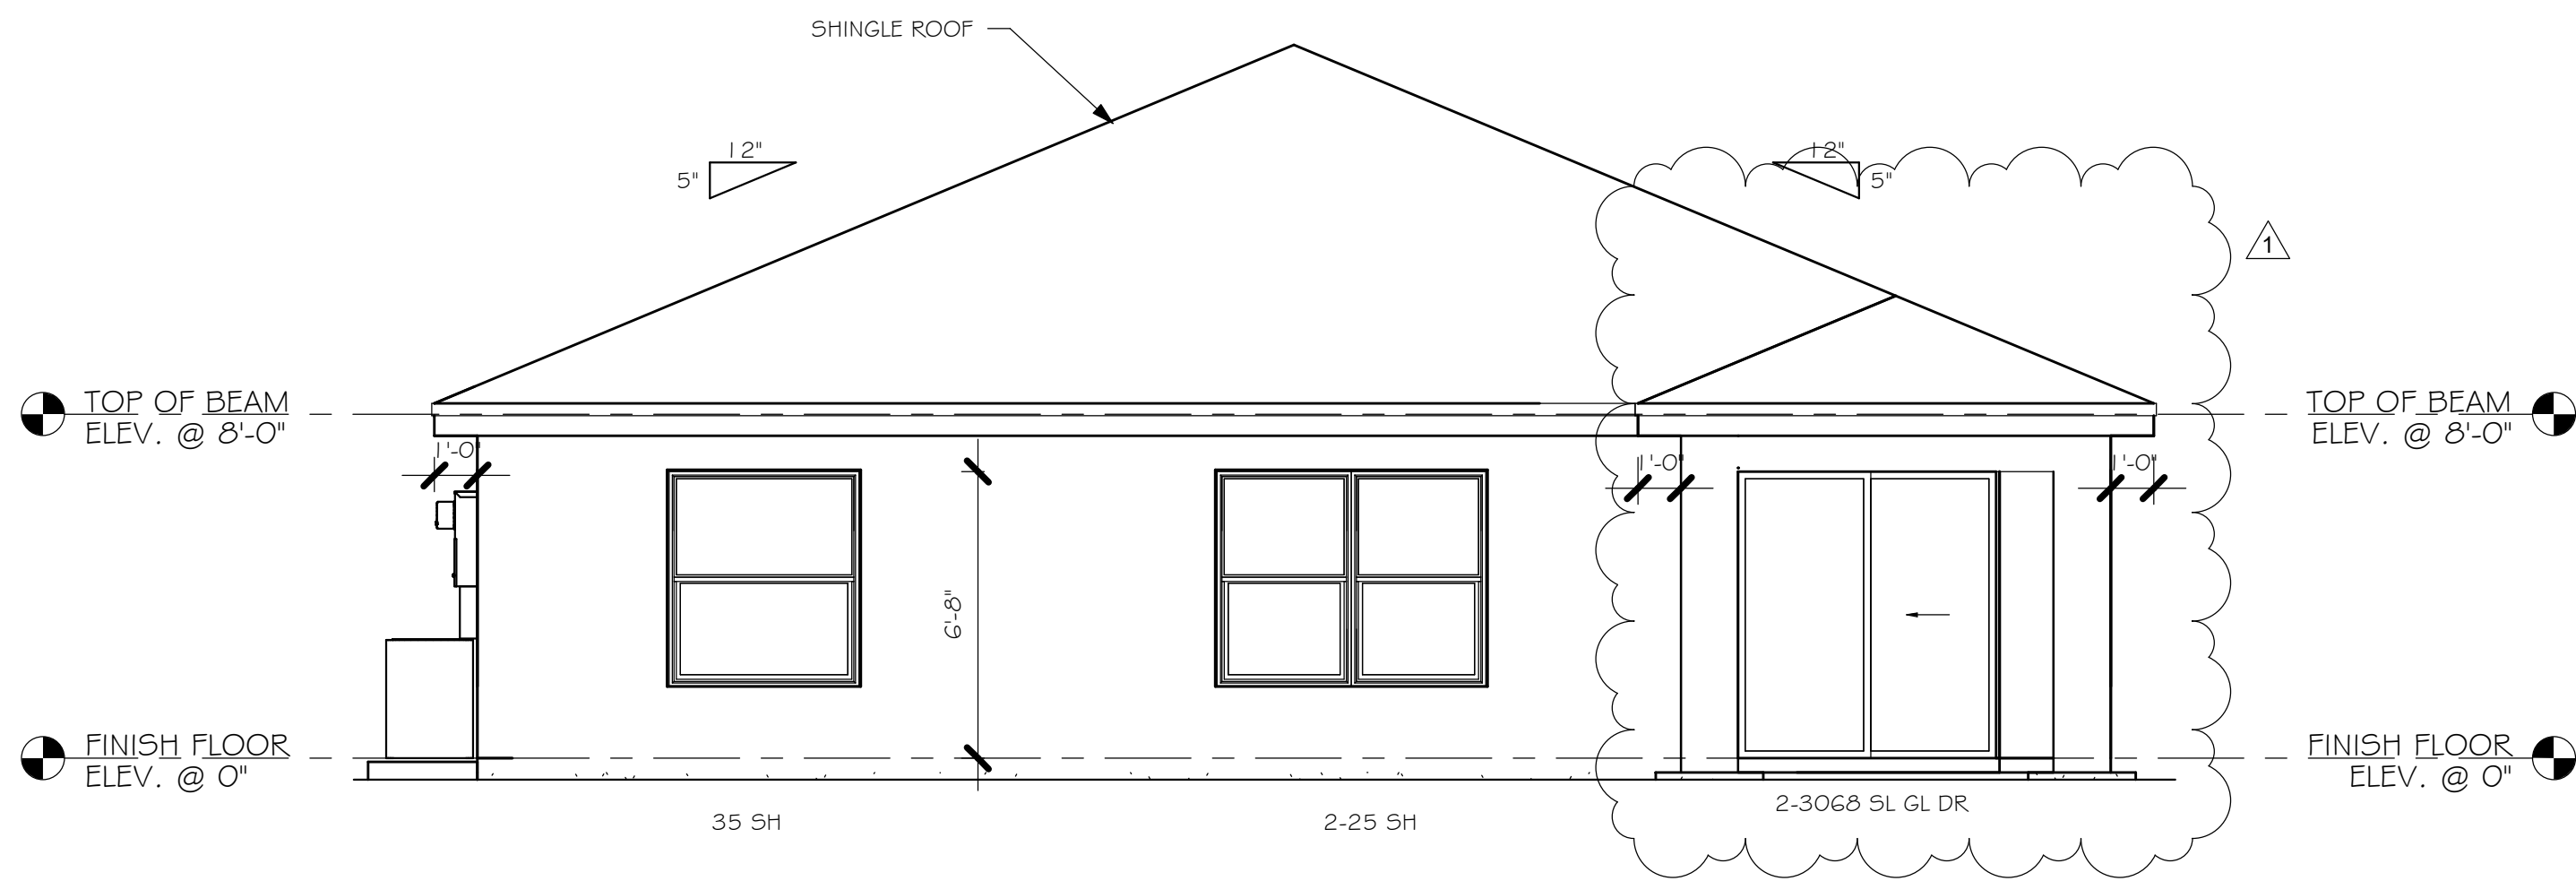


REAR ELEVATION
1/4" = 1'-0"

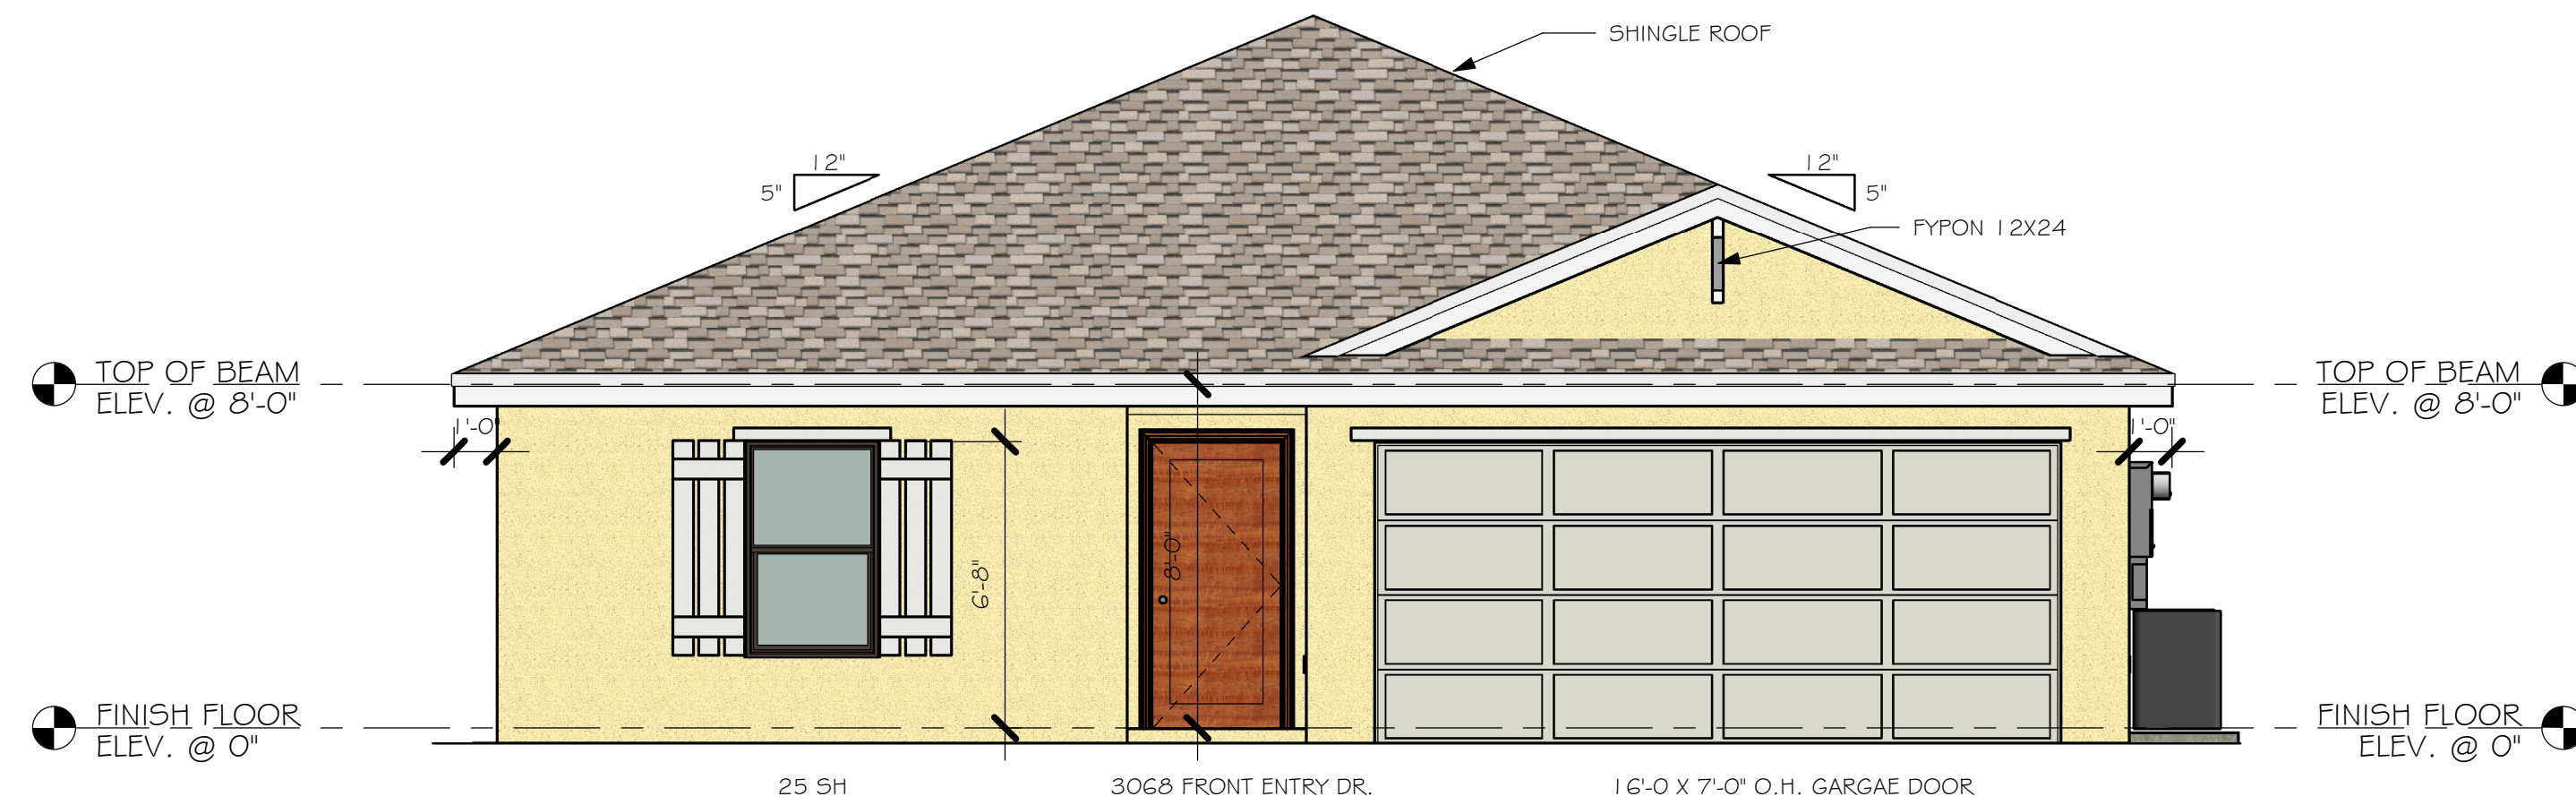

FRONT ELEVATION
1/4" = 1'-0"

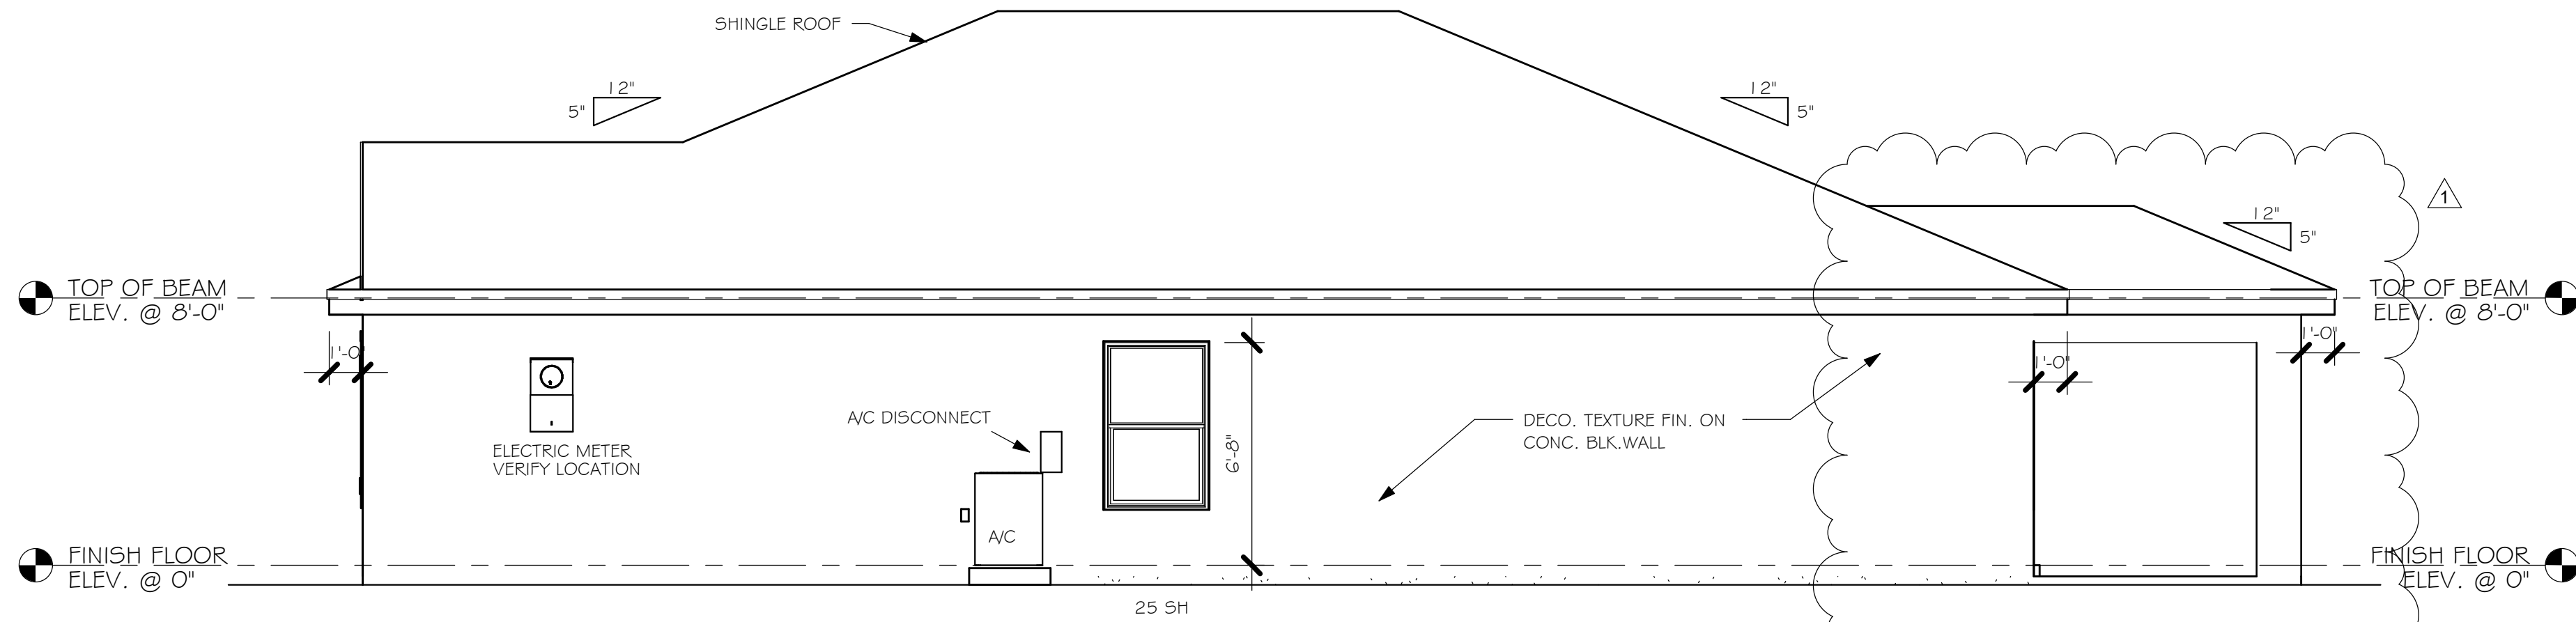

RIGHT ELEVATION
1/4" = 1'-0"

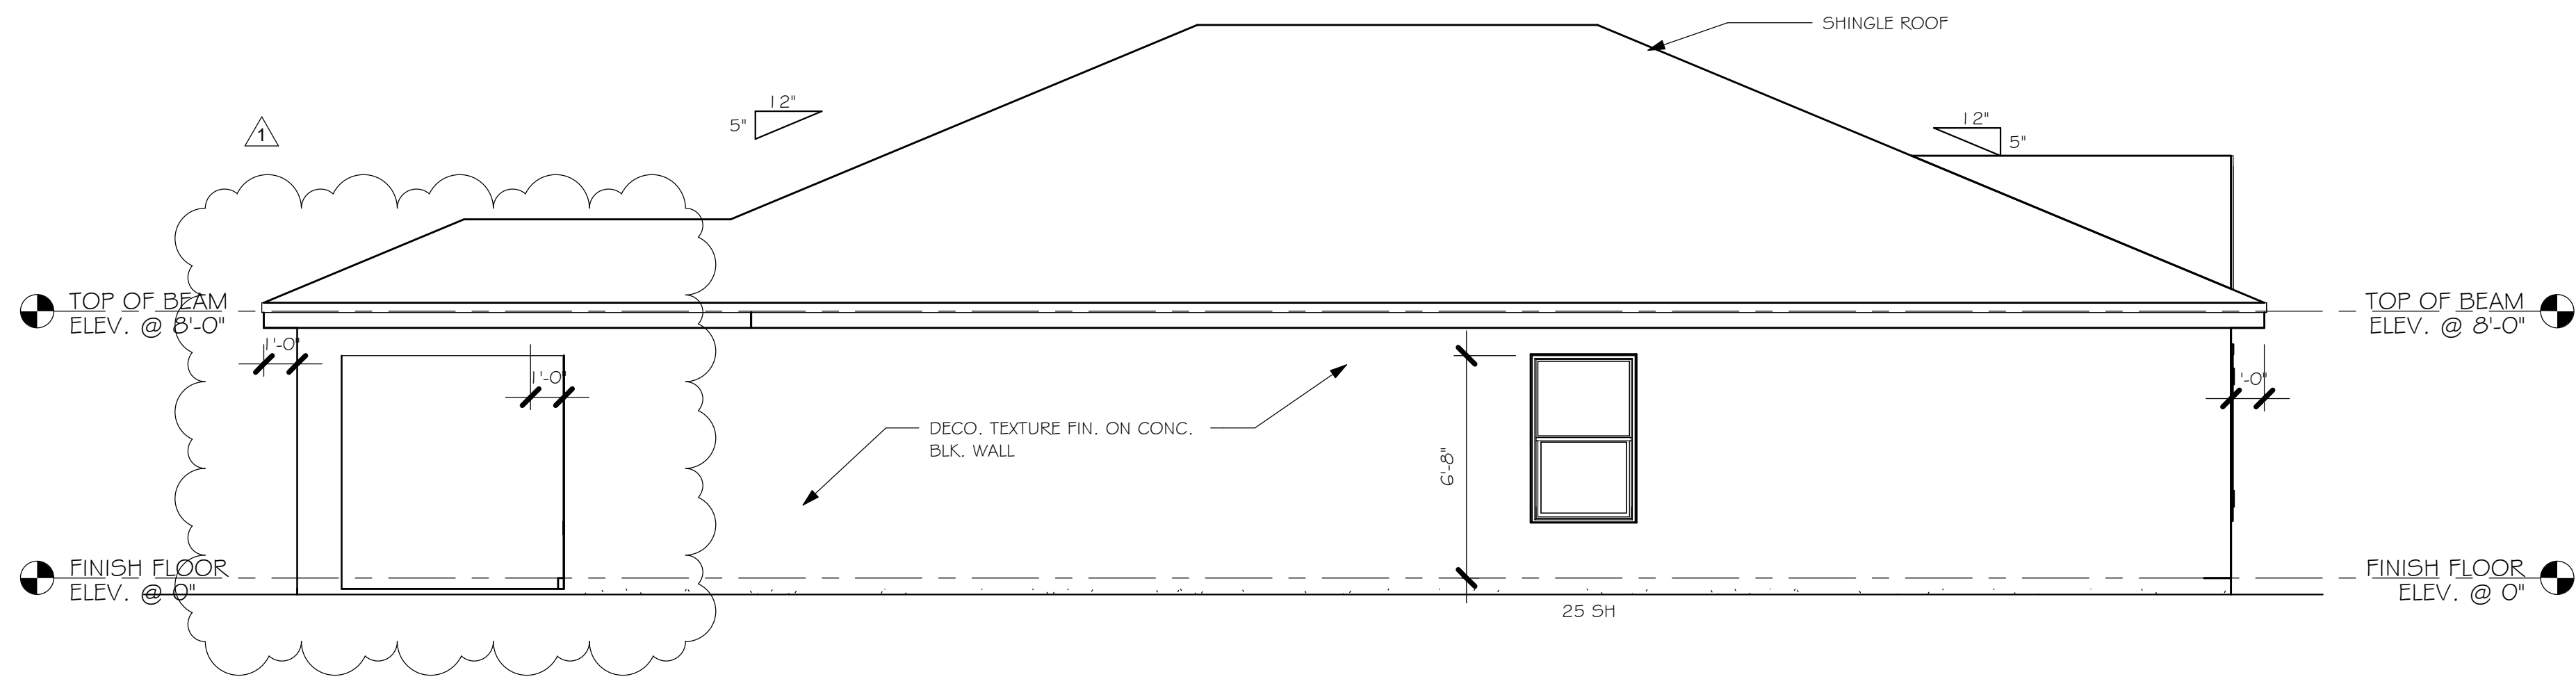

LEFT ELEVATION
1/4" = 1'-0"

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION





Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-822
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 20 BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS
ADDRESS: 1013 ALLMAN AVENUE
D.R.H. #: 579070015

MODEL
#1499 A
GCD JOB # 11087

DATE: 07/30/19
DRAWN BY: JBL
CHECKED BY: JWC
REVISED: 02/07/20
PLAN: ELEVATION
SCALE: 1/4" = 1'-0"

A-1

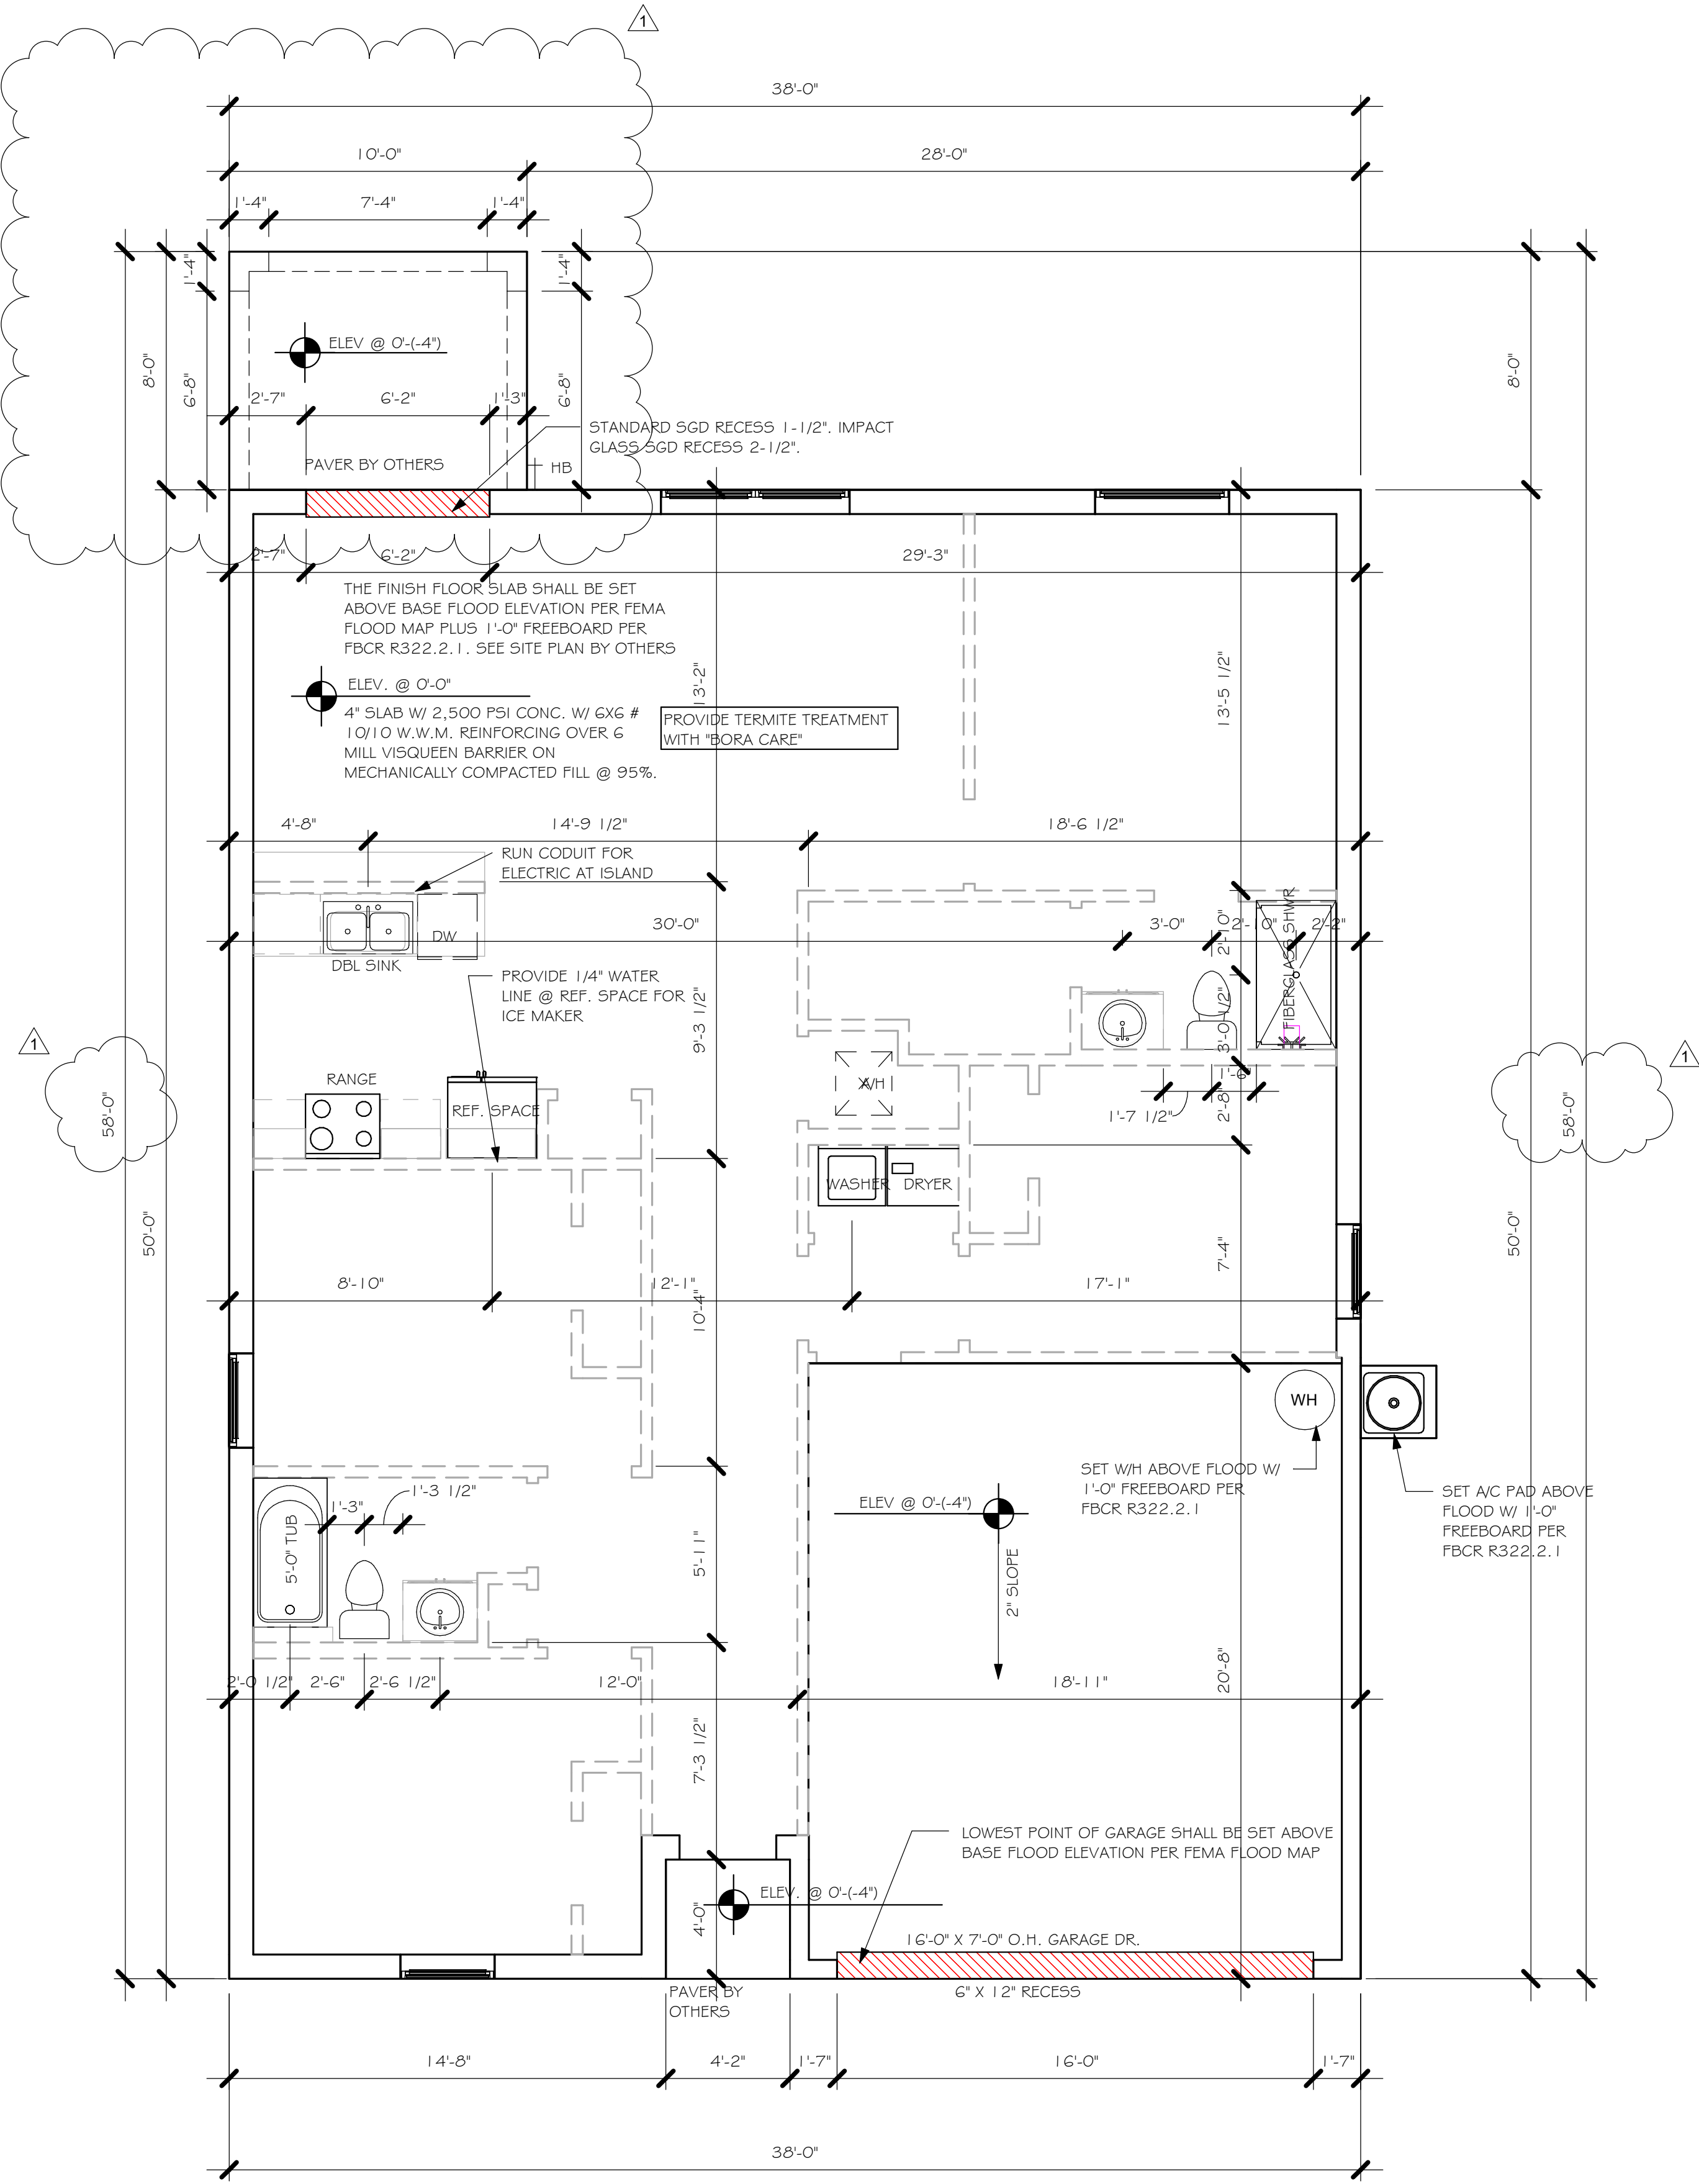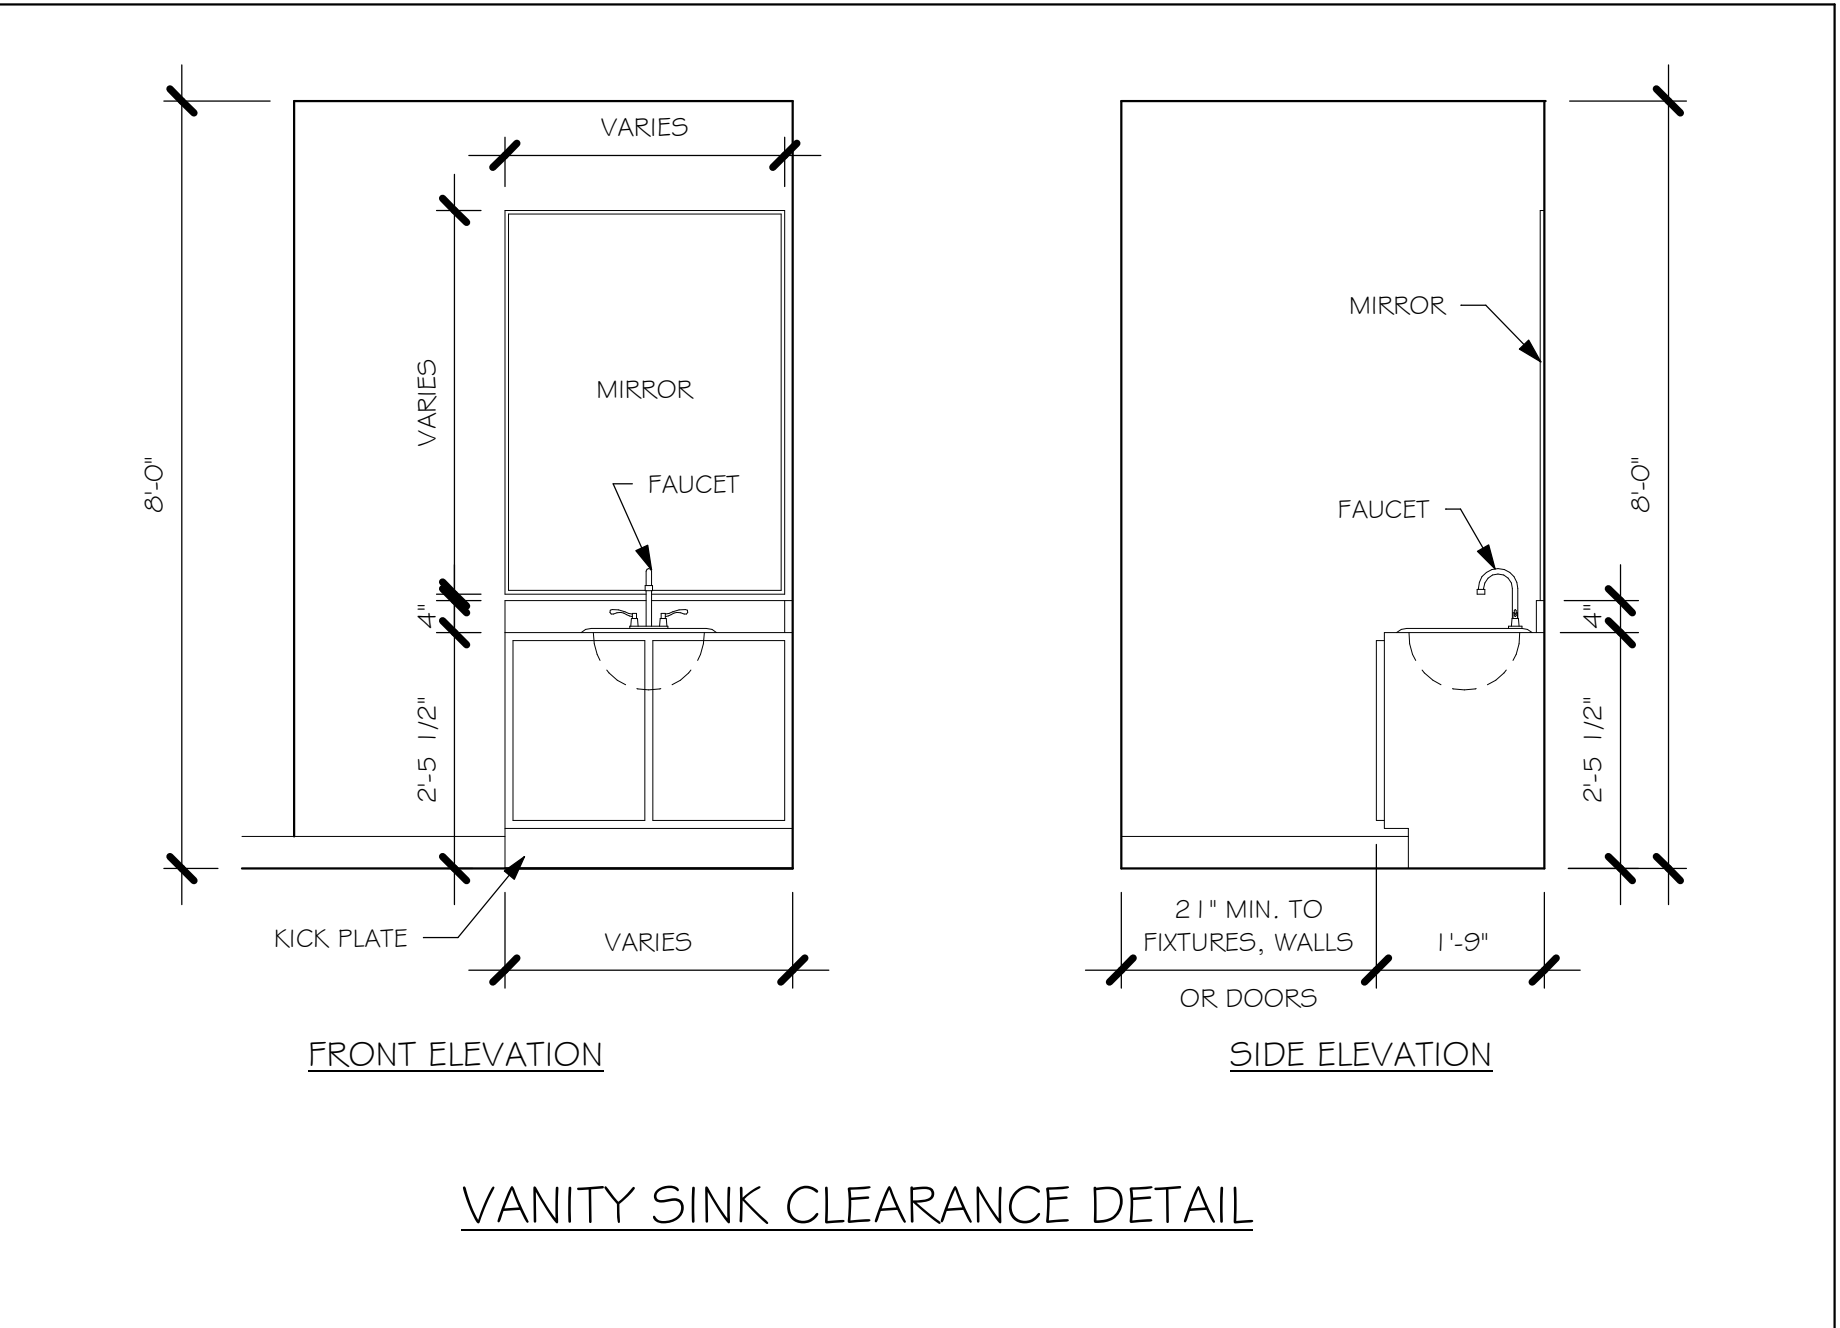

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

Y:\0-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 AR\REVIT\11087 1499 AR.rvt

DOOR SCHEDULE					
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	COUNT
1	3068 ENTRY	DISTINCTION	6'-8"	3'-0"	1
2	2-3068 SL. GL. DR.	DISTINCTION	6'-8"	6'-0"	1
3	16080 OHGD	GARAGE	7'-0"	16'-0"	1

WINDOW SCHEDULE				
MARK	DESCRIPTION	HEIGHT	WIDTH	COUNT
A	2-25 SH	5'-3"	6'-4"	1
B	25 SH	5'-3"	3'-2"	3
C	35 SH	5'-3"	4'-6"	1

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

- PLAN NOTES
- 1)

VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
- 2)

PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
- 3)

PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
- 4)

NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
- 5)

PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
- 6)

KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
- 7)

INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
- 8)

WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
- 9)

THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
- 10)

INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.
- 11)

ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH RG12.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PRVENTION DEVICE
- 12)

ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
- 13)

ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	
5	2'-0"	L.V. = LOUVERED DOOR
6	1'-8"	
7	1'-6"	
8	2'-11"	

SQUARE FOOTAGE	
LIVING AREA	1499
GARAGE AREA	385
LANAI AREA	80
FRONT PORCH/ ENTRY AREA	16
TOTAL SQUARE FOOTAGE	1,980

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS



3'-2"

TOWEL BAR

2'-6"

TOILET PAPER ROLL

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

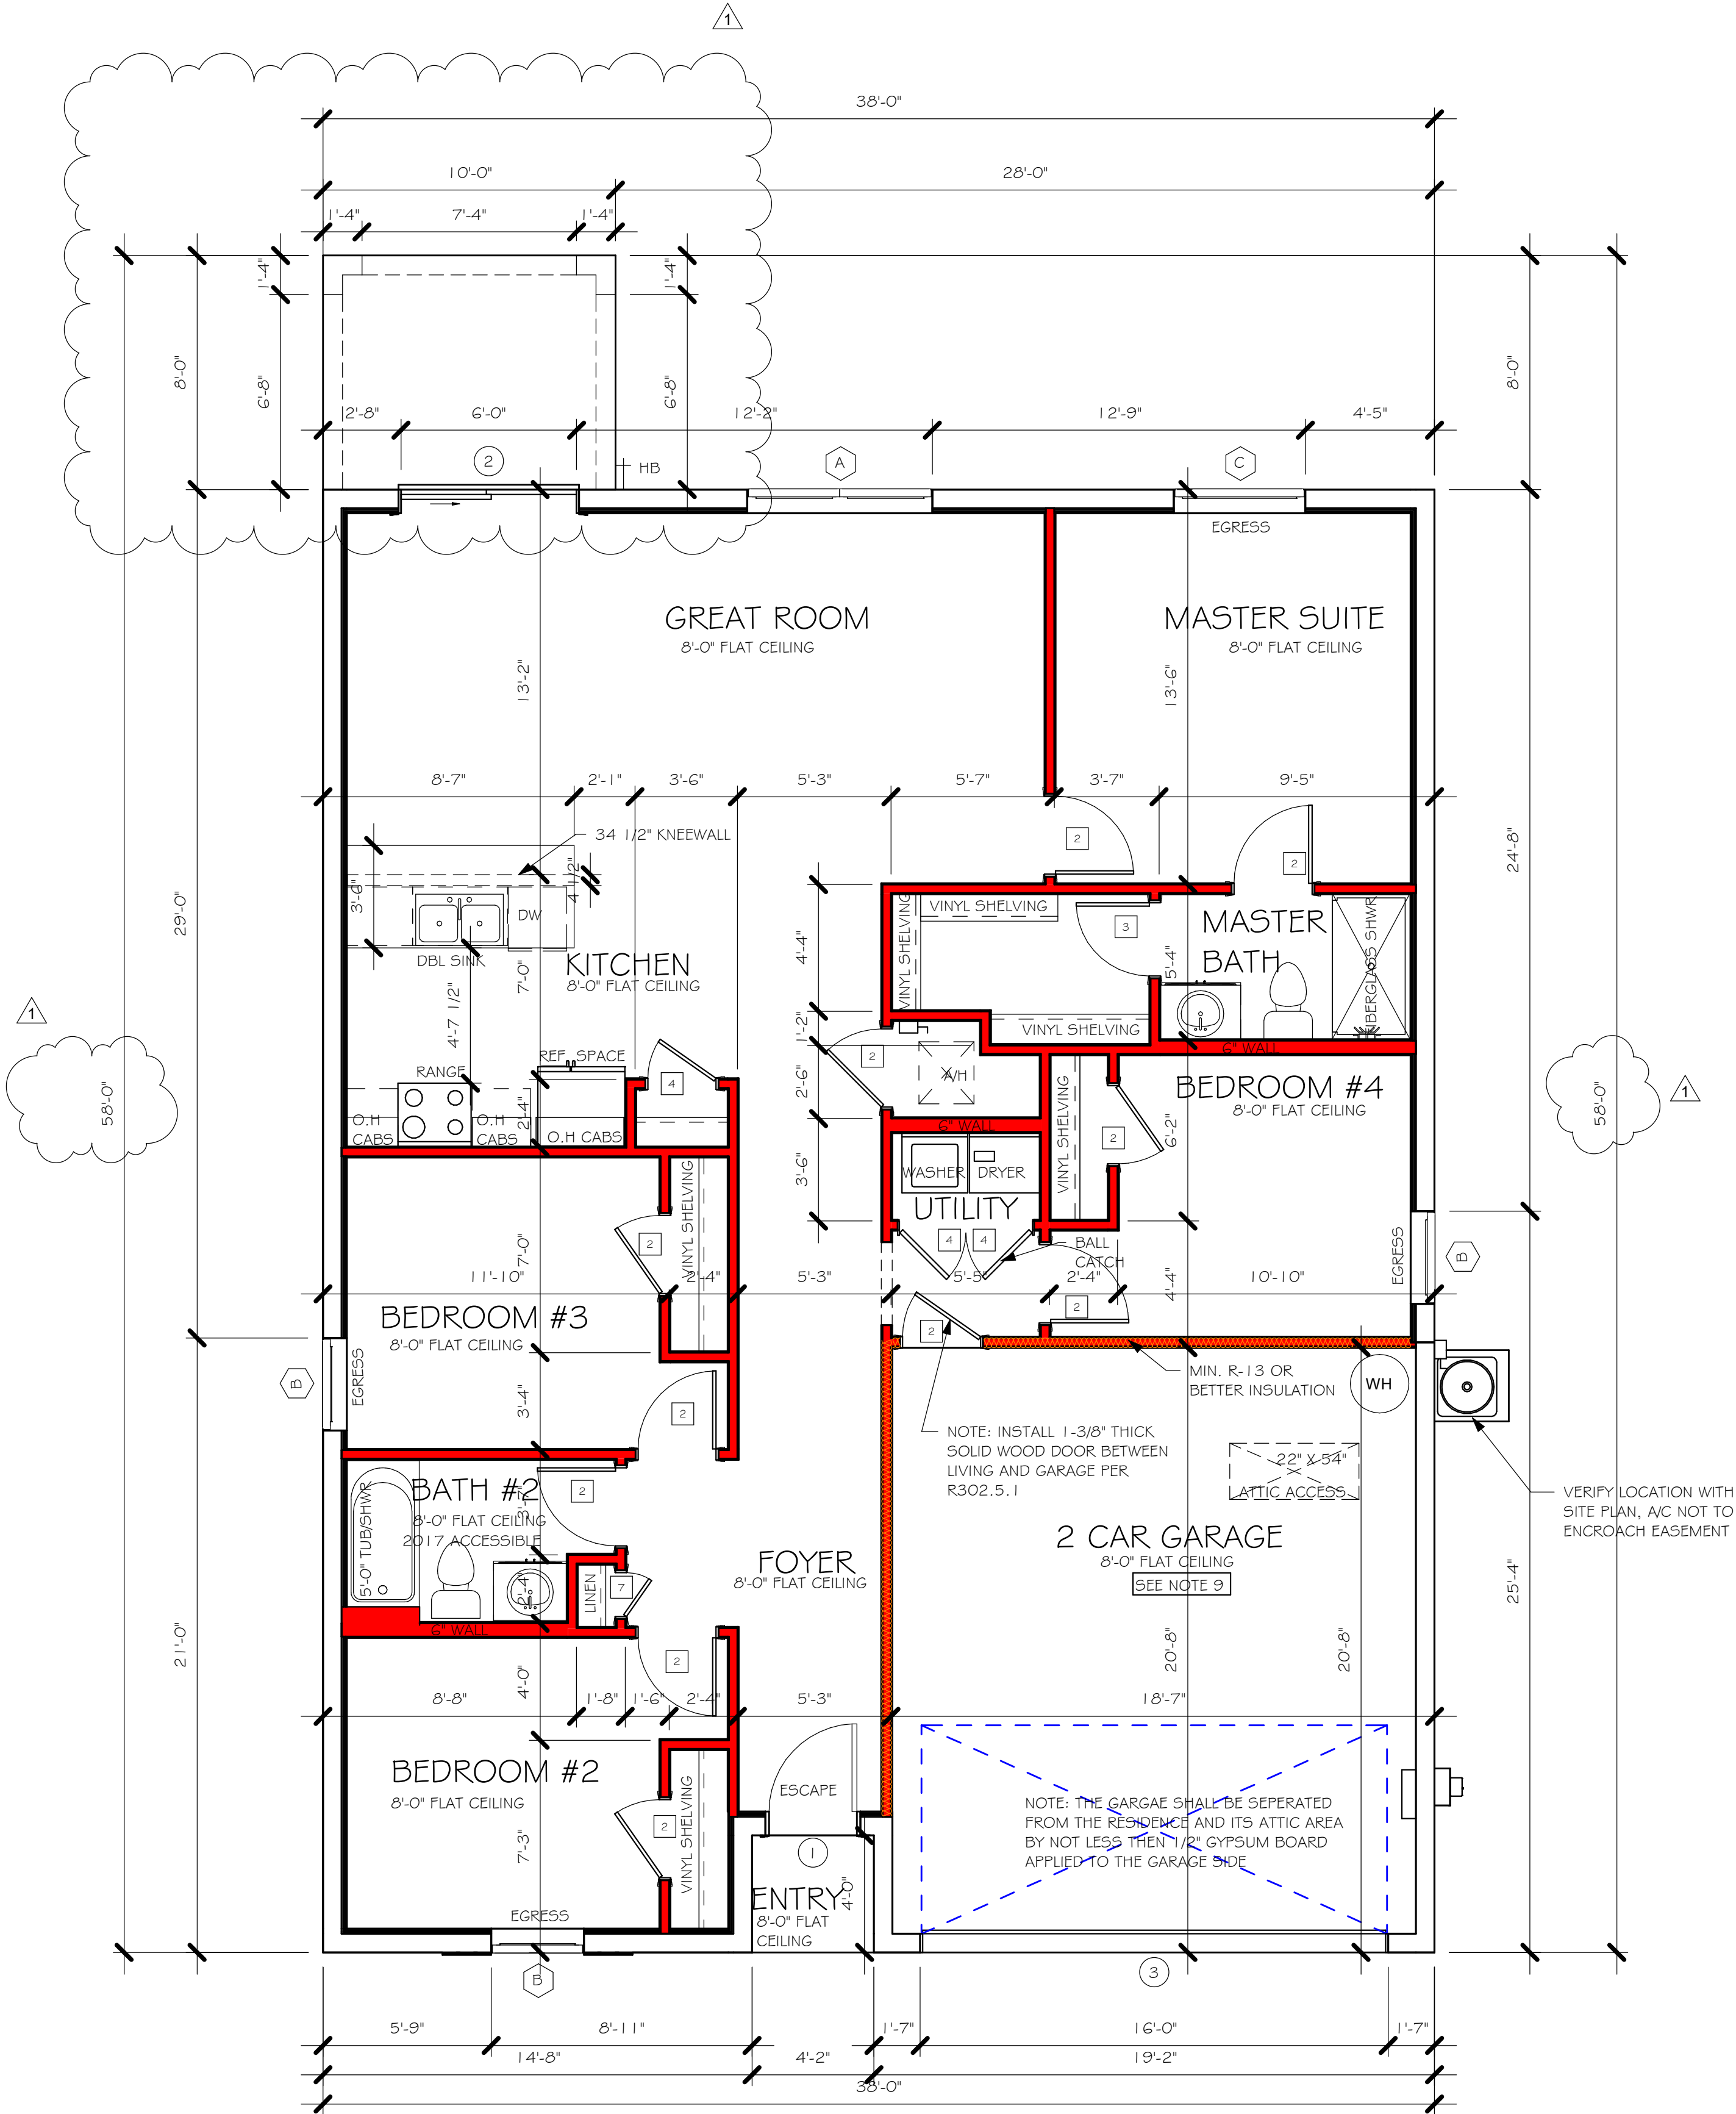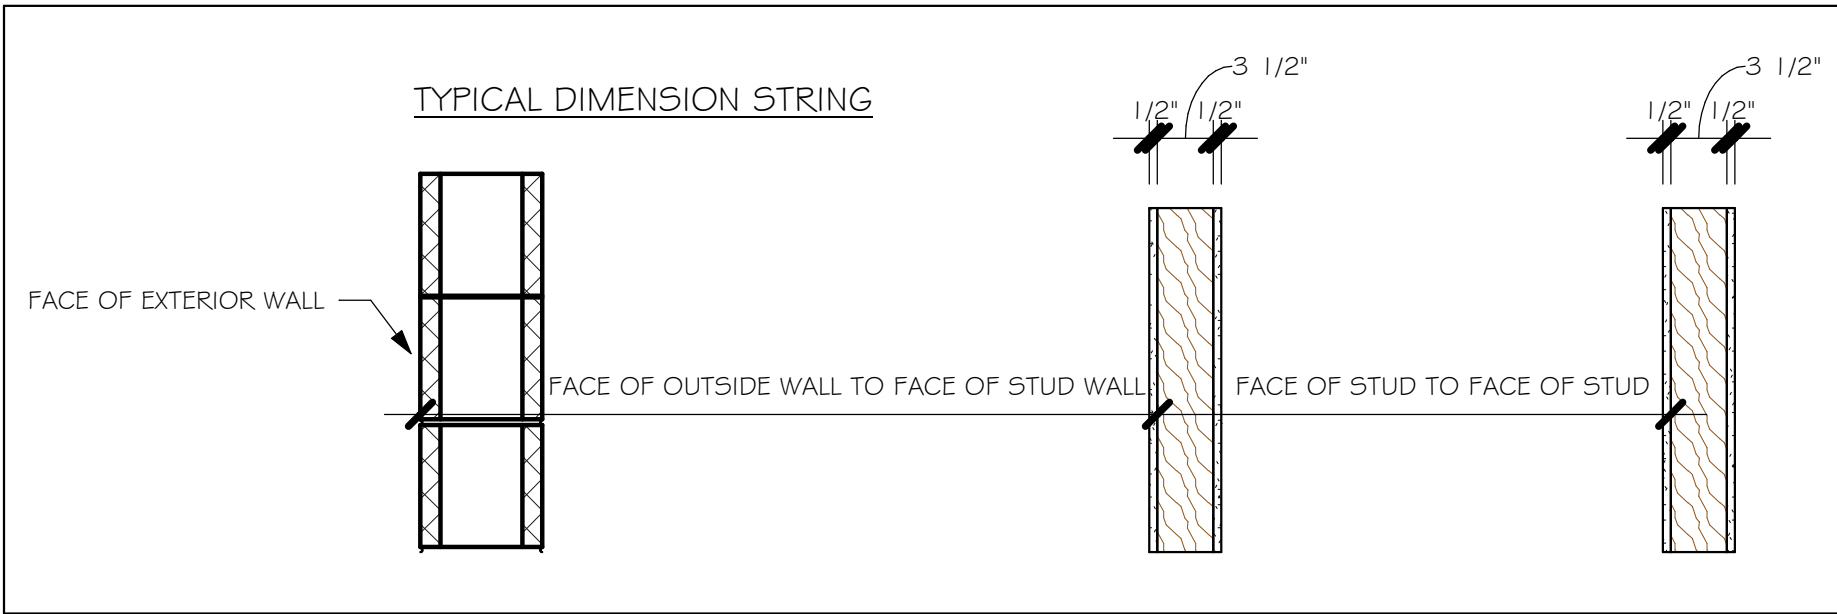

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8223
1515 SE 47th ST. CAPE CORAL, FL 33904


LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRESS: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	

MODEL # 1499 A	GCD JOB # 11087
-------------------	-----------------

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	FLOOR
SCALE:	As indicated

A-3

Y:\0-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 ARREVIT\11087 1499 AR.rvt

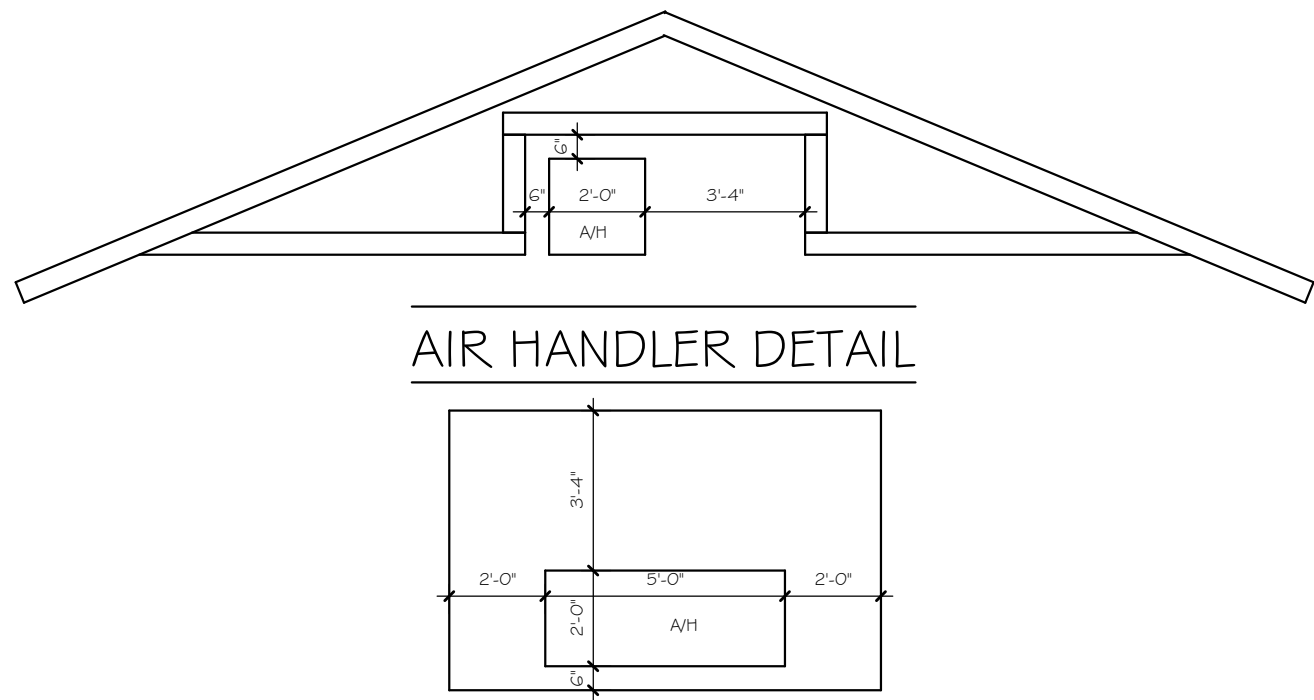


MODEL 1499 A: ATTIC VENTILATION FBCR R806

COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS

AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED		
MARK	ATTIC	SOFFIT	ATTIC AREA/150	REQ'D AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	2080.0 SQ. FT.	180.0 SQ. FT.	13.87 SQ. FT.	7.71%	8.15%	6.93 SQ. FT.	1	1.1%
"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED					
SOFFIT MODEL			ROOF VENT MODEL					
ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW			32" BASE 22-3/8" BASE LOMANCO 770-D 0.97 SQ. FT. FREE AIR					

BEARING HEIGHT

= BEARING @ 8'-0"

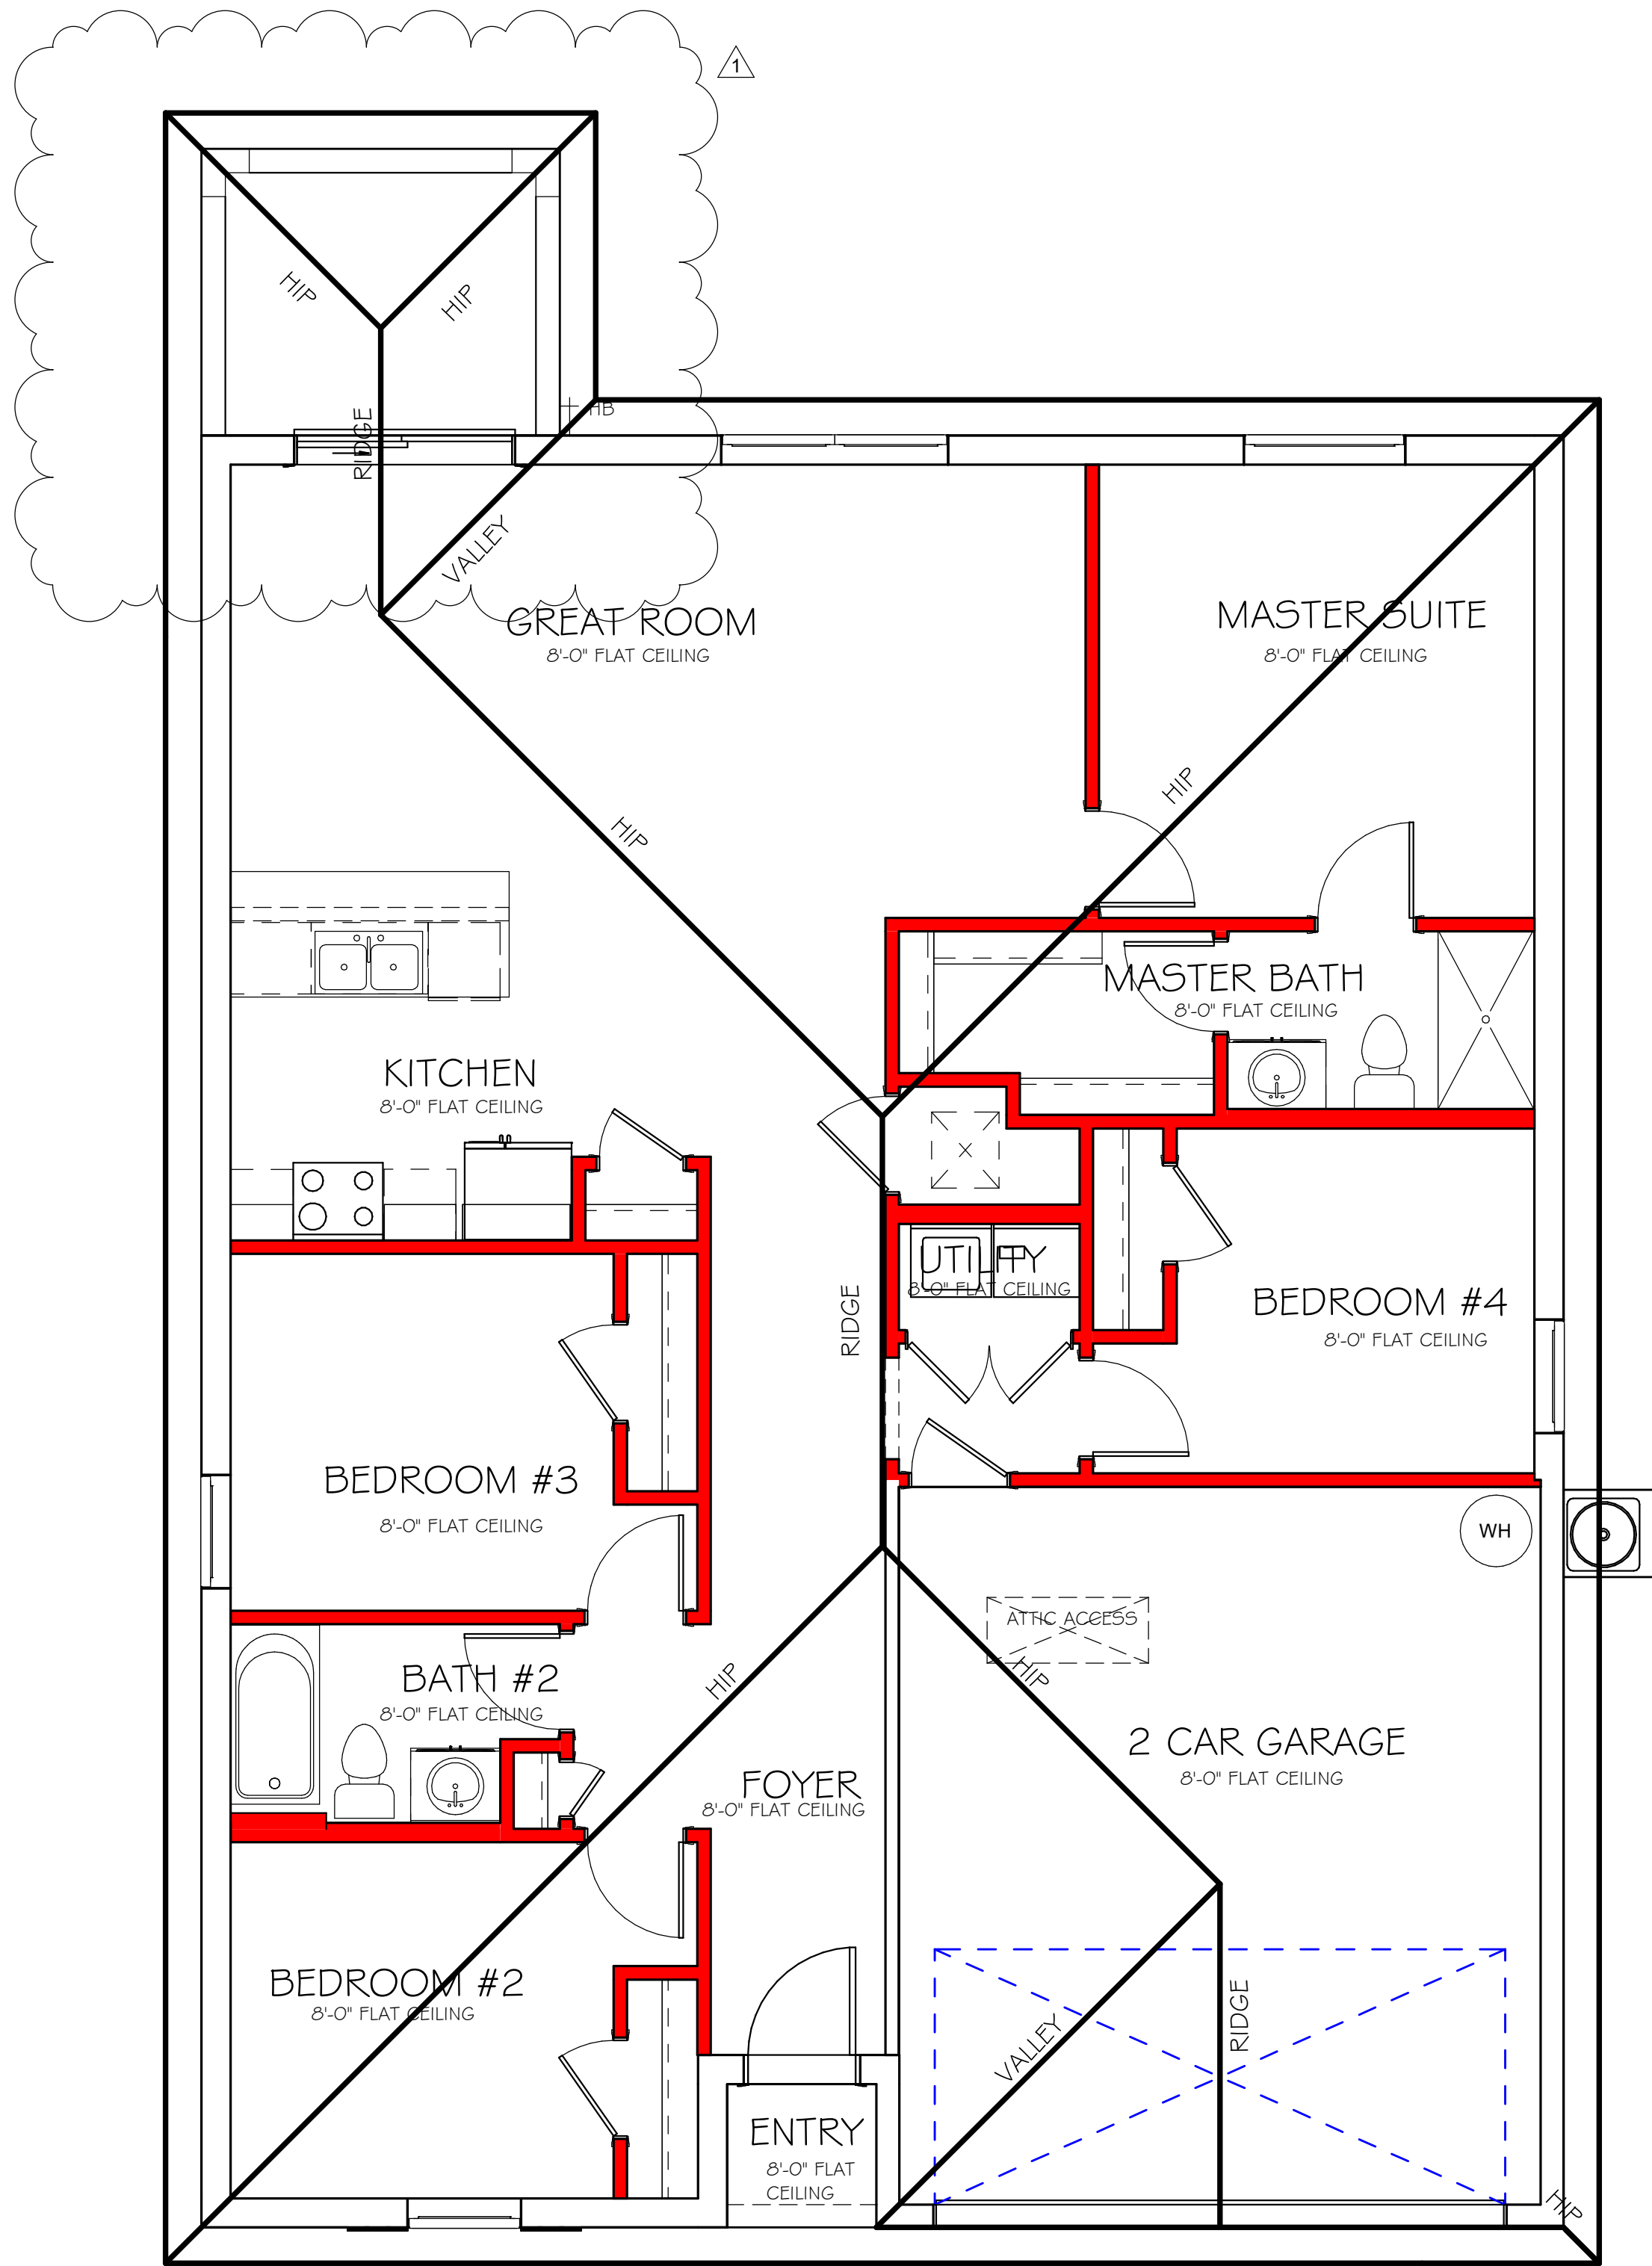

ROOF PLAN


1/4" = 1'-0"

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-822
1515 SE 47th ST. CAPE CORAL, FL 33904



LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRESS: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	


MODEL #1499 A	GCD JOB # 11087
------------------	-----------------

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	ROOF
SCALE:	As indicated


A-4

Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 AR\REVIT\11087 1499 AR.rvt

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES, PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON (FB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V. PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2014	

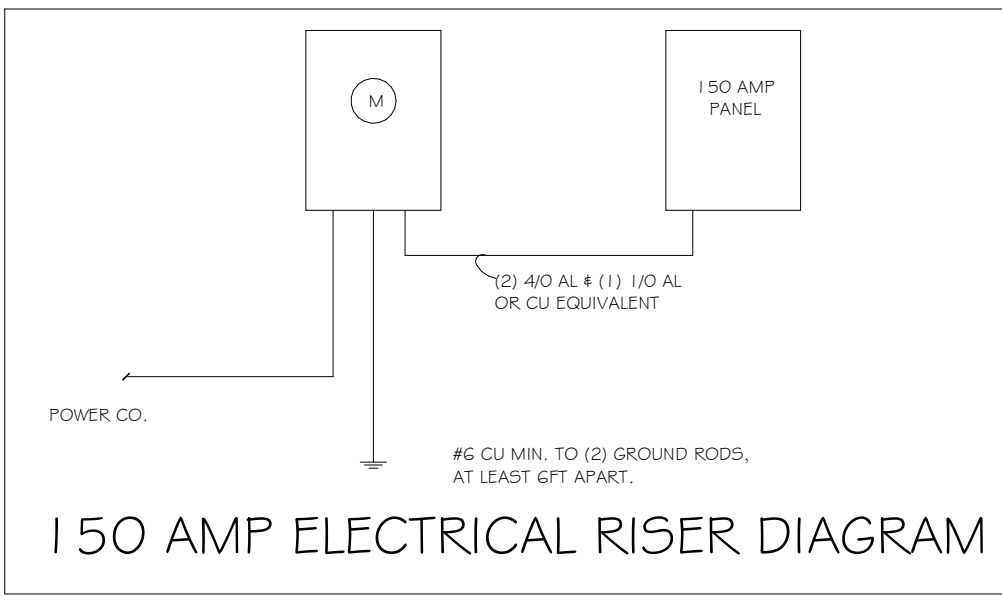

ELECTRICAL PLAN		
150 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(X)	(FLUSH MOUNTED LT)
B	(X)	(VAPORS)
C	(X)	(PENDANT LIGHT
D	(9)	(10" MUSHROOMS)
E	(2)	(24" 3 LT)
F	(X)	(36" LT)
G	(X)	(NOT USED)
H	(2)	(COACH LIGHTS)
I	(X)	
J	(X)	(J BOX)
K	(1)	(4' FLUORESCENT)
L	(X)	(2' FLUORESCENT)
M	(X)	(SLT CHANDELIER)
N	(X)	(3 LT.)
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

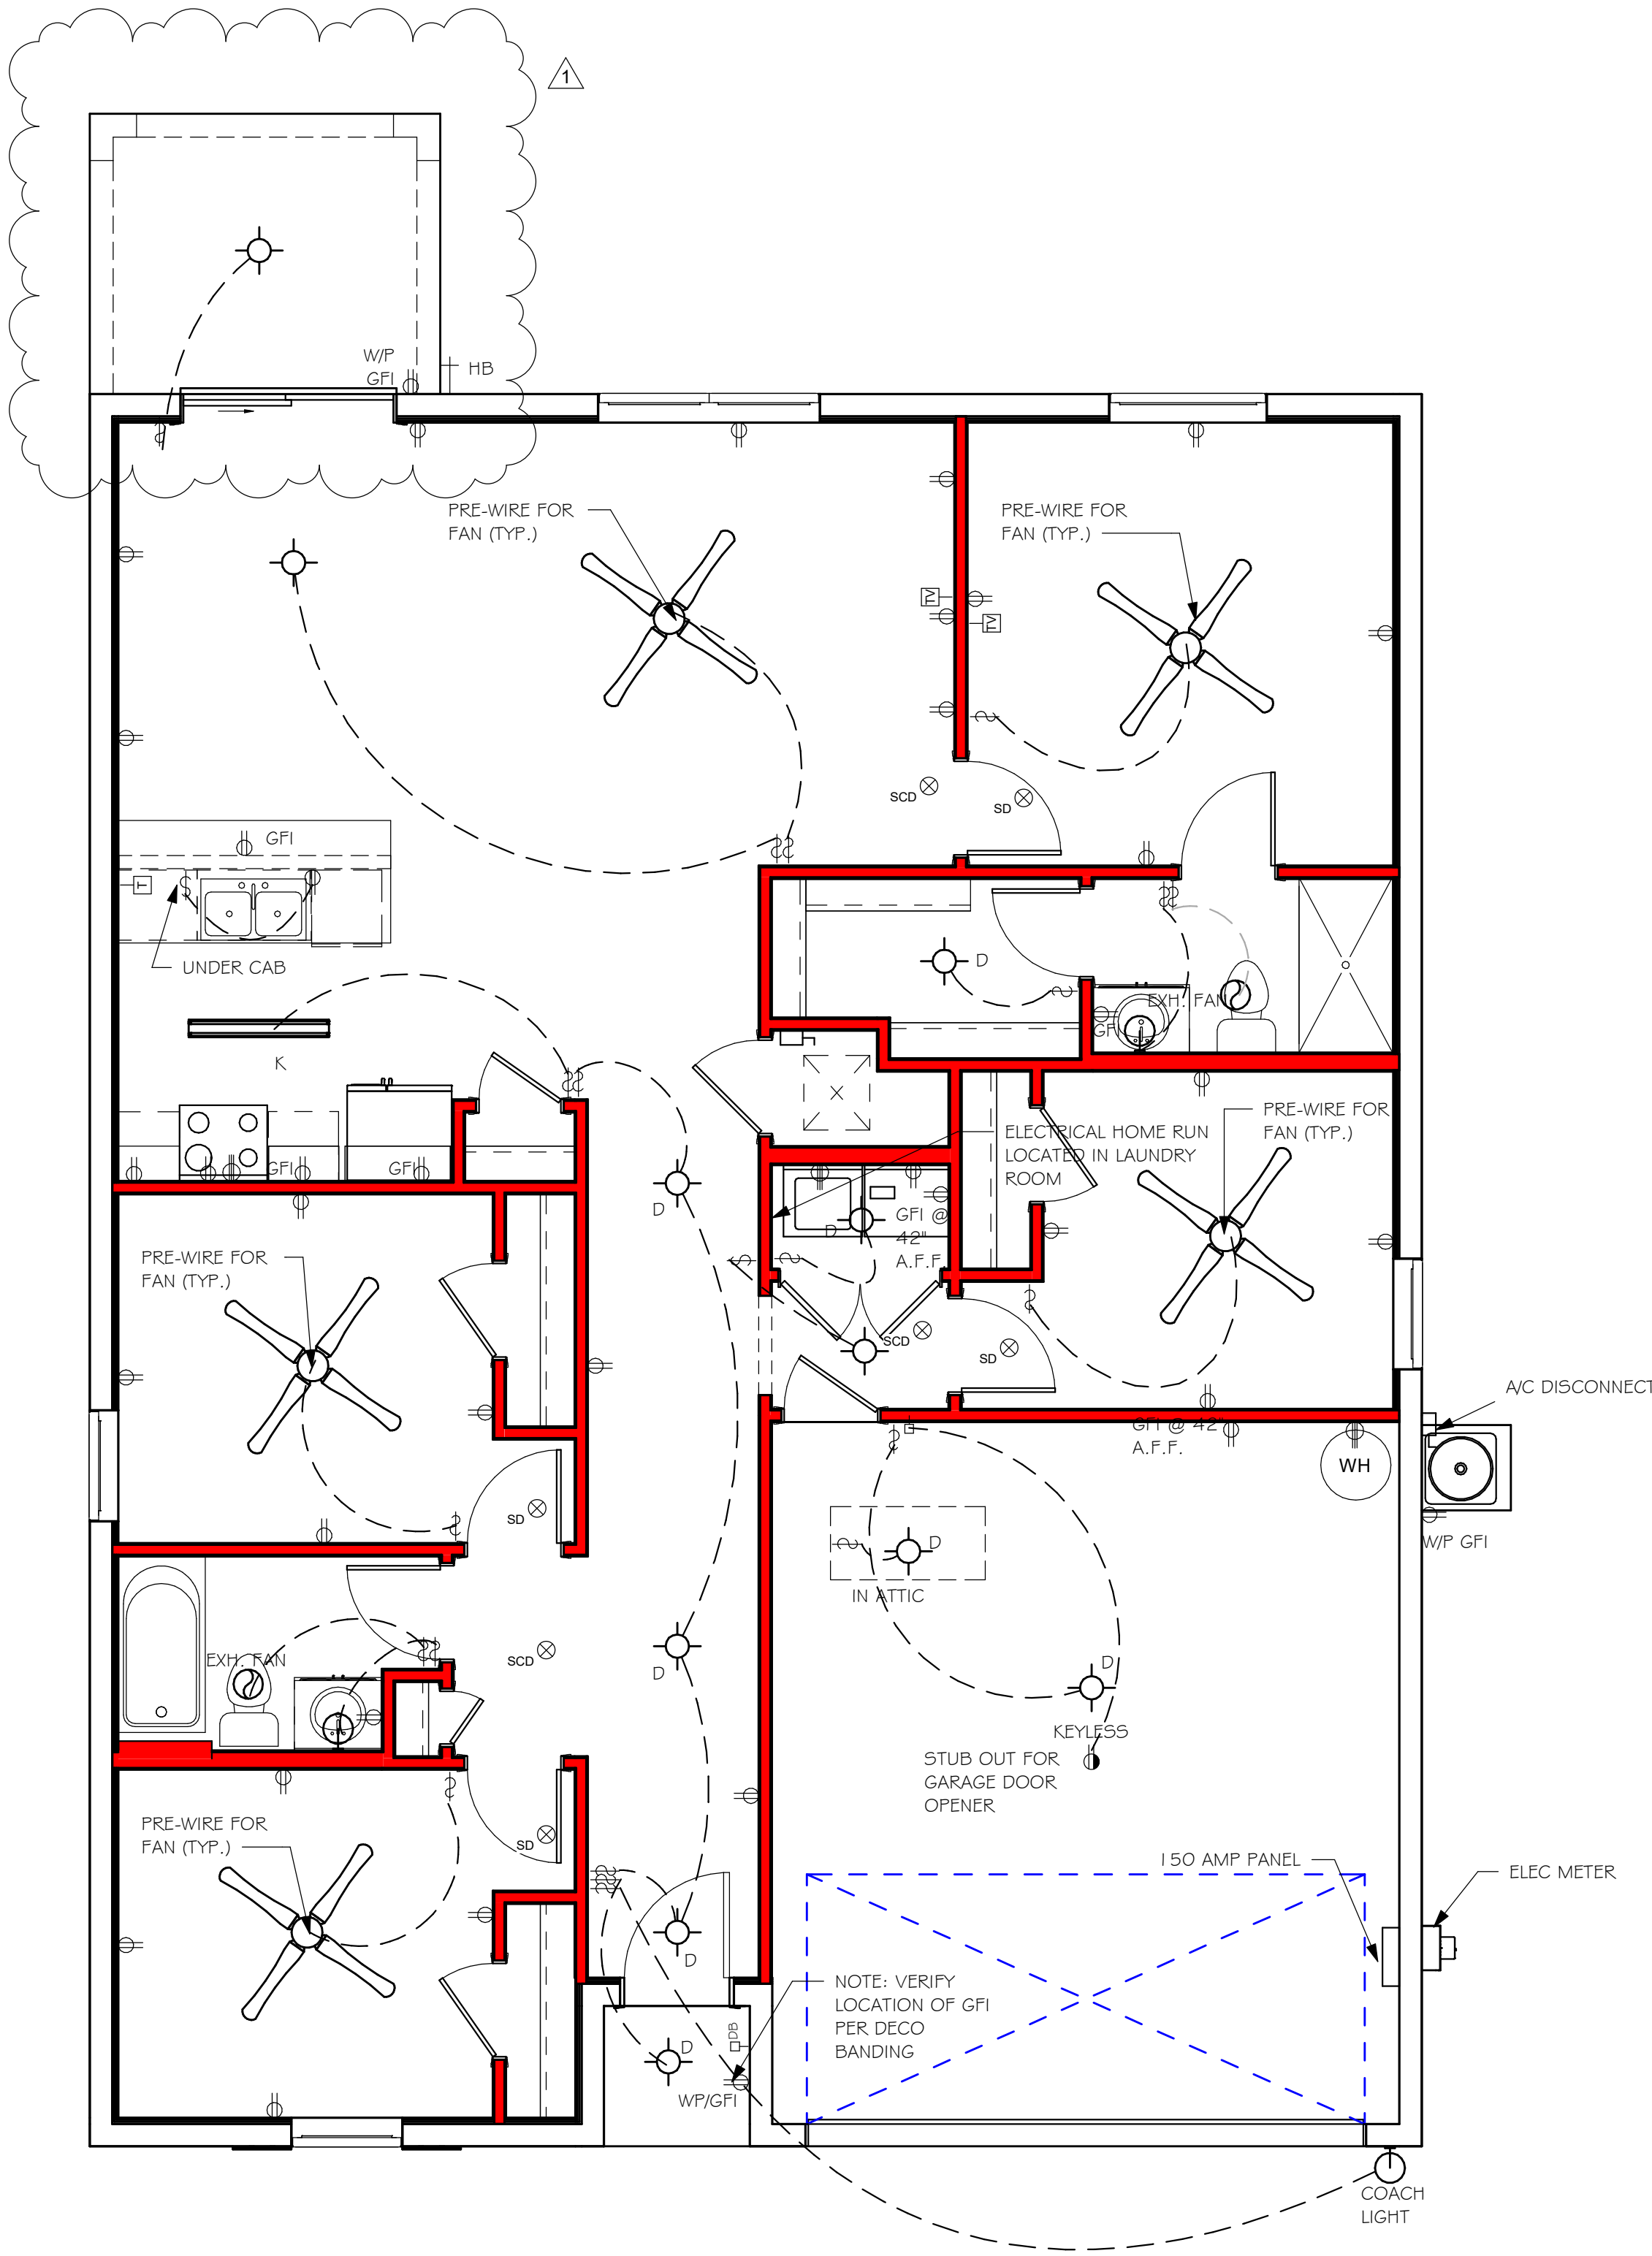

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION




Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47TH ST. CAPE CORAL, FL 33904

LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRESS: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	

MODEL # 1499 A	GCD JOB # 11087
-------------------	-----------------

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	ELECTRICAL
SCALE:	As indicated

Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 ARREV\11087 1499 AR.rvt

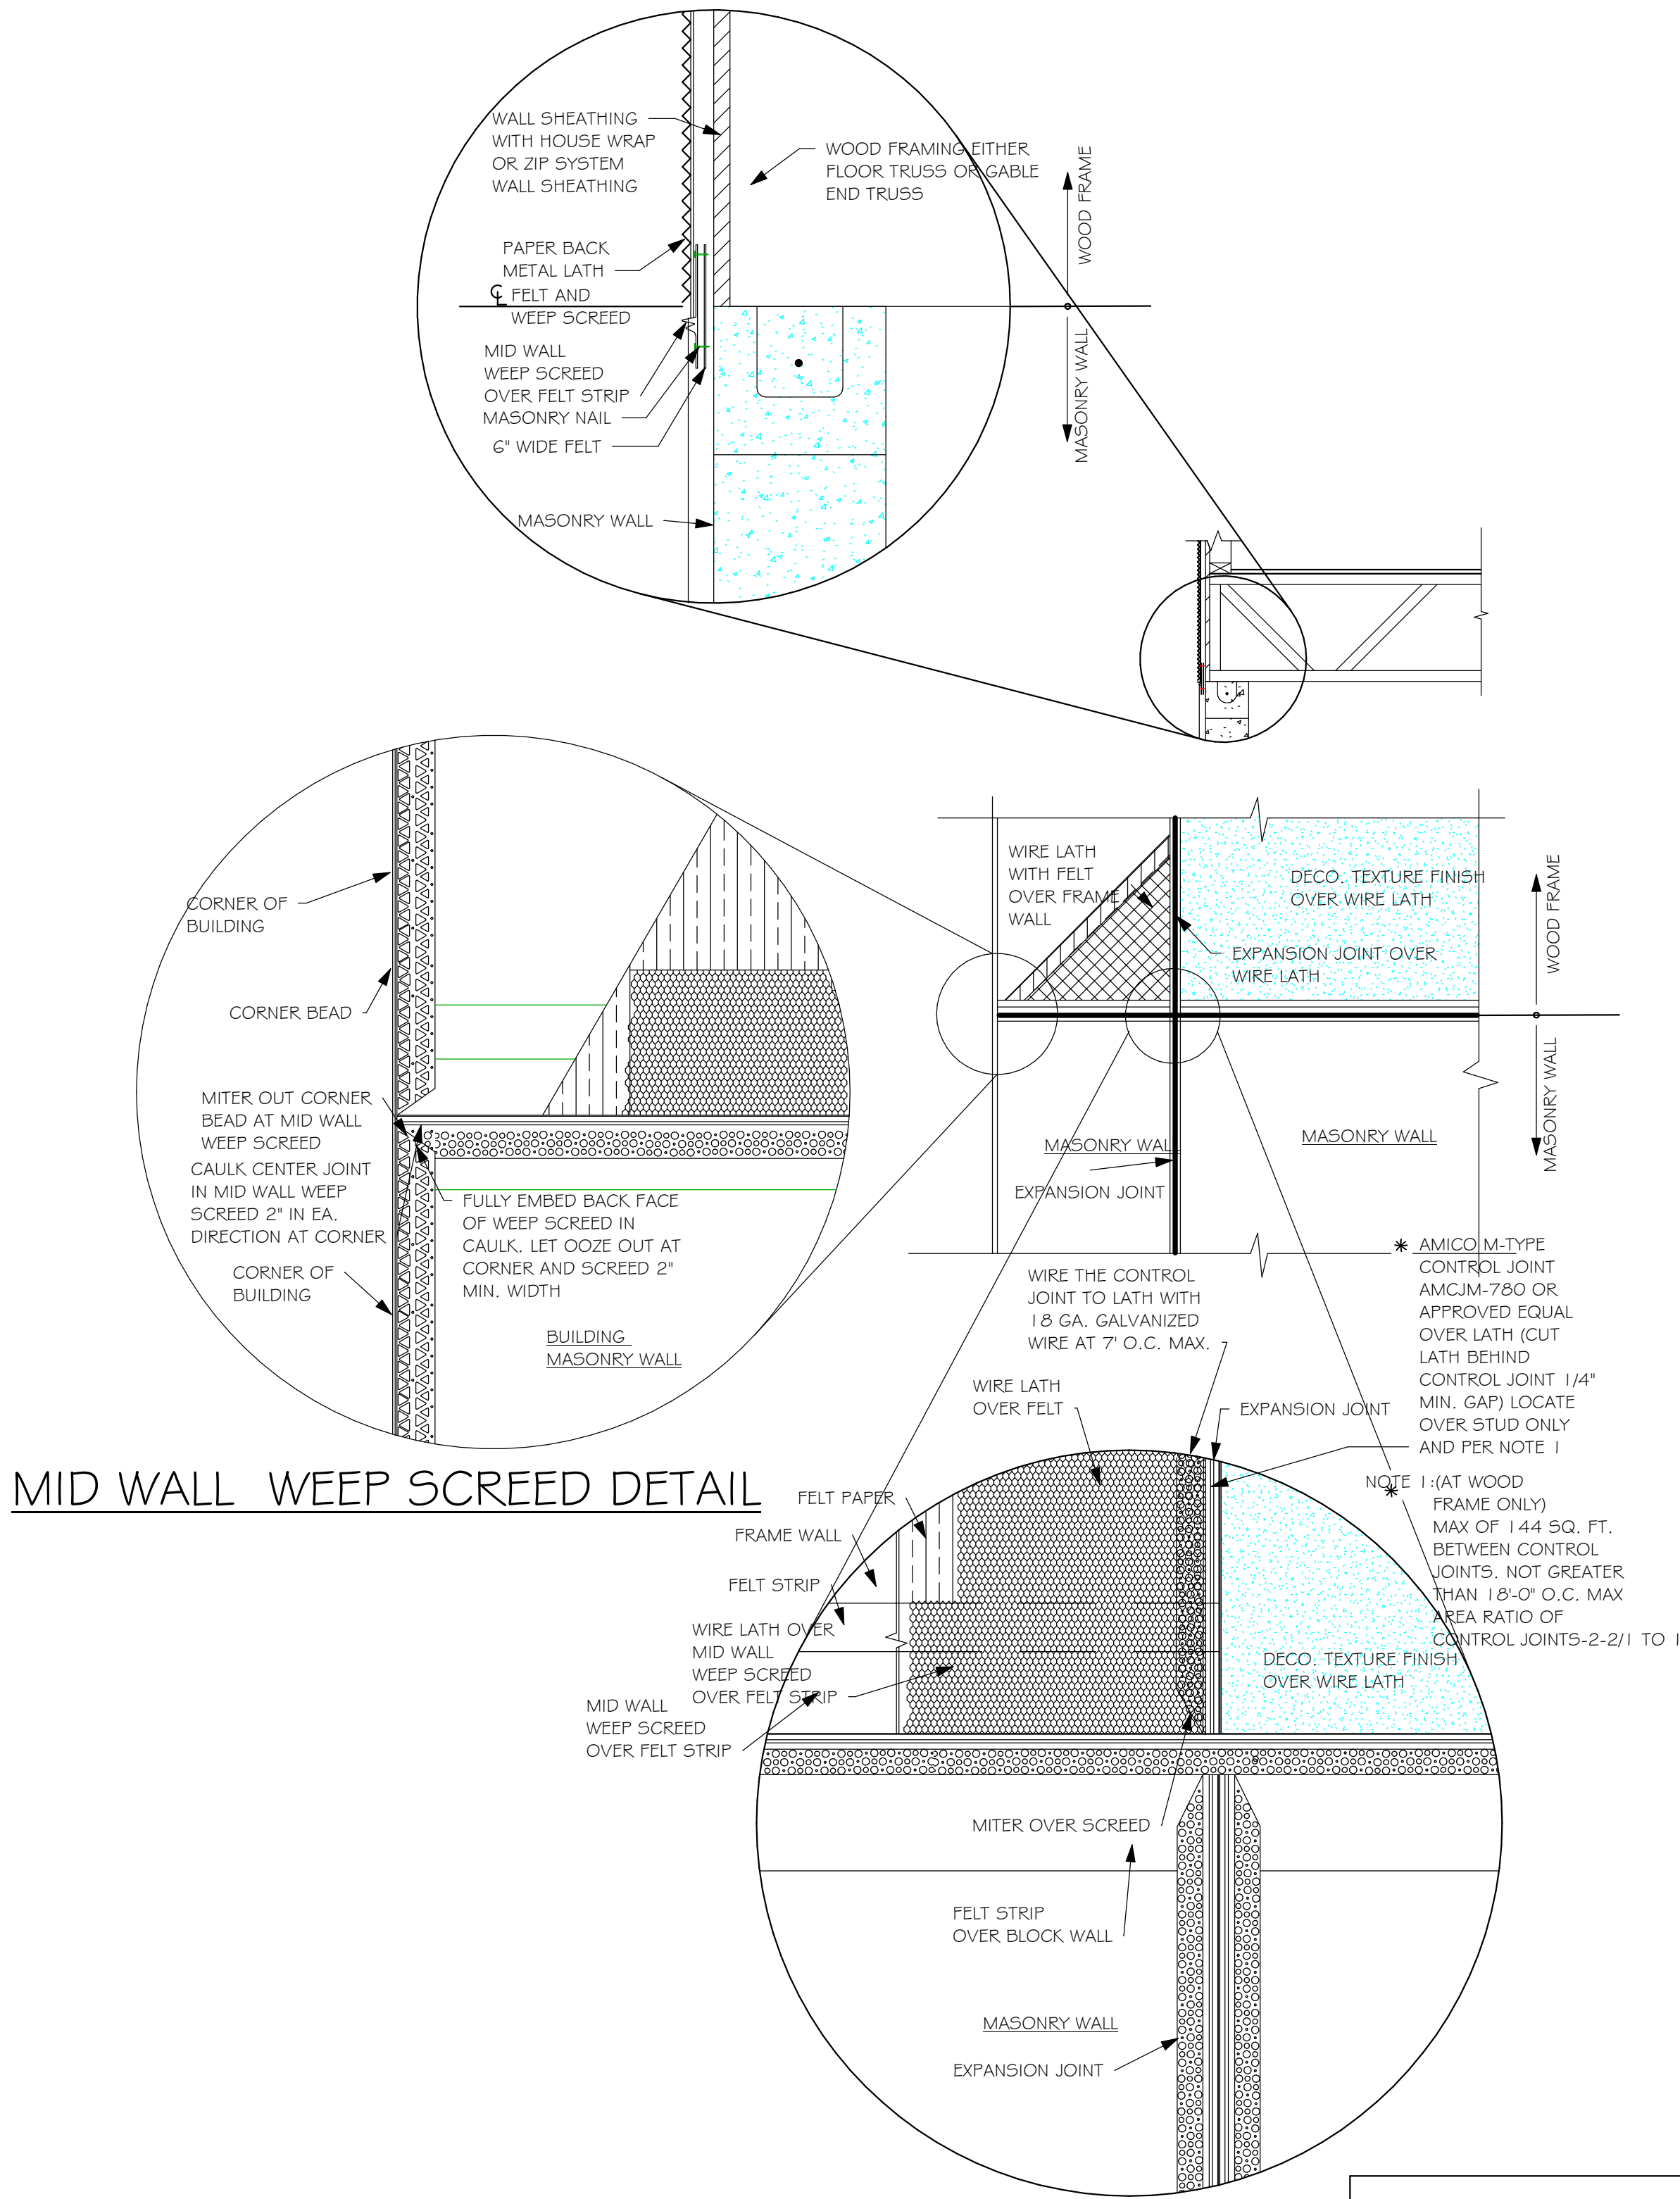

1

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
- ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
- SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
- ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT. ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT DIPPED GALVANIZED OR STAINLESS STEEL CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
- TREATED WOOD REQUIREMENTS:- ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE, IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
- CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
- LANAI CEILINGS & COVERED ENTRY CEILINGS 1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

2

DOOR AND WINDOW ANCHORAGE

ANCHORAGE REQUIREMENTS- ALL PASS AND SLIDING GLASS DOORS AND ALL WINDOW ASSEMBLIES SHALL BE ANCHORED TO THE MAIN WIND FORCE RESISTING SYSTEM IN A MANNER SPECIFIED BY THE PUBLISHED MANUFACTURERS LITERATURE. THERE SHALL BE NO SUBSTITUTION OF ALTERNATE FASTENINGS UNLESS PROVIDED BY THE MANUFACTURER AND APPROVED BY THE BUILDING DESIGN ENGINEER.

MASONRY OPENING

WHERE WINDOW FRAME IS DESIGN TO FASTEN WITH SCREWS THROUGH THE FRAME AND INTO THE MASONRY, THE BUCK MATERIAL IS SIMPLY A SPACER. THE BUCK MAY BE FASTENED WITH THE T NAILS OR ANY SUITABLE FASTENER TO TACK IT INTO POSITION PRIOR TO WINDOW INSTALLATION. FASTEN WINDOW FRAME PER MFR INSTRUCTIONS. A WINDOW FASTENER SHALL PENETRATE MASONRY BY 2 1/4" MIN.

WHERE WINDOW FRAME IS DESIGNED TO FASTEN ONLY TO THE WOOD BUCK (IE, FLANGED FRAME WITH WOOD SCREWS) THE BUCKS SHALL BE 2X WOOD WITH STRUCTURAL FASTENING TO THE MASONRY WITH 1/4 X 3 3/4 MASONRY SCREWS @ 24" OC AND 6" FROM EACH END.

WOOD FRAMED OPENING- ALL DOORS AND WINDOWS SHALL BE INSTALLED ACCORDING TO THE PUBLISHED MANUFACTURERS LITERATURE OF THE ASSEMBLY BEING INSTALLED TO THE ROUGH SUBSTRATE OPENING. SHIMS SHALL BE MADE OF MATERIALS CAPABLE OF RESISTING THE APPLIED LOADS AND SHALL BE LOCATED NEAR EACH FRAME FASTENER TO MINIMIZE DISTORTION OF THE FRAME AS THE FASTENERS ARE TIGHTENED .

3

GENERAL ROOF ASSEMBLY

ROOF SHEATHING

SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED . INSTALL "Y" CUPS AT UNSUPPORTED PANEL EDGES. THE ROOF SHEATHING SHALL BE NAILED WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSSES WITHOUT SPLITTING. RING SHANK NAILS PER R803.2.3.1 - 0.113" NOMINAL SHANK DIAMETER, RING DIAMETER OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING

FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURES PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

D RIP EDGE

D RIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". D RIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE D RIP EDGE FLANGE.

4

ASPHALT SHINGLE ROOF SPEC'S



SHINGLES

15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELD-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURE. INSTALLATION SHALL COMPLY WITH MANUFACTURES REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 31 G 1 .

FASTENERS

FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 12 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESITANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL

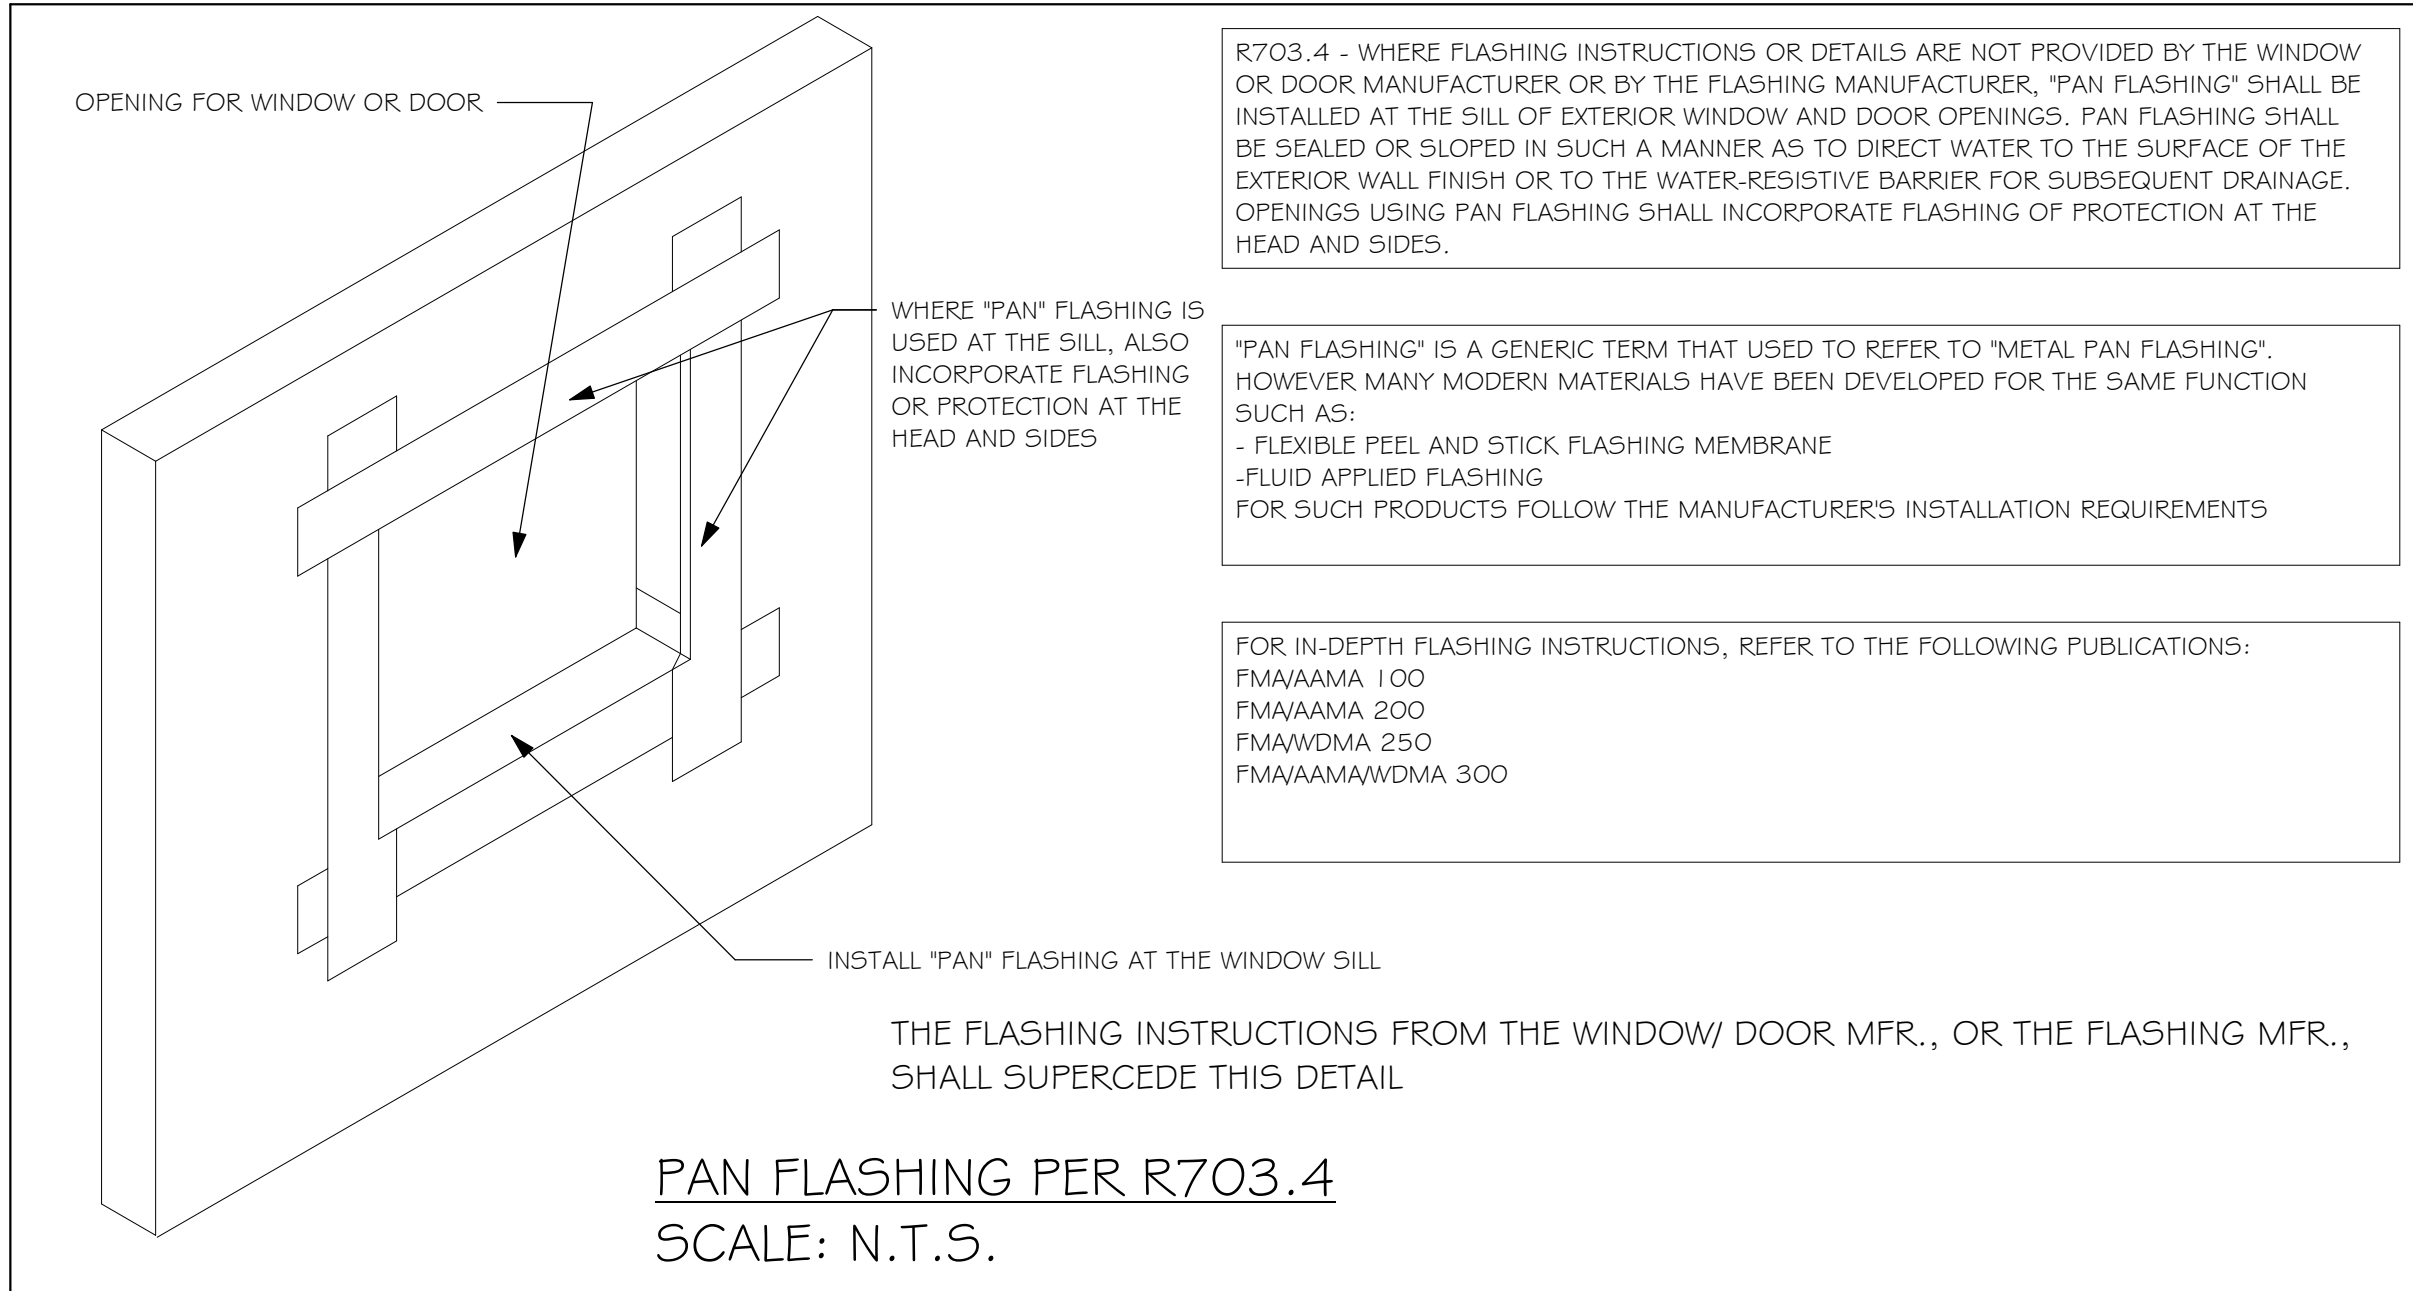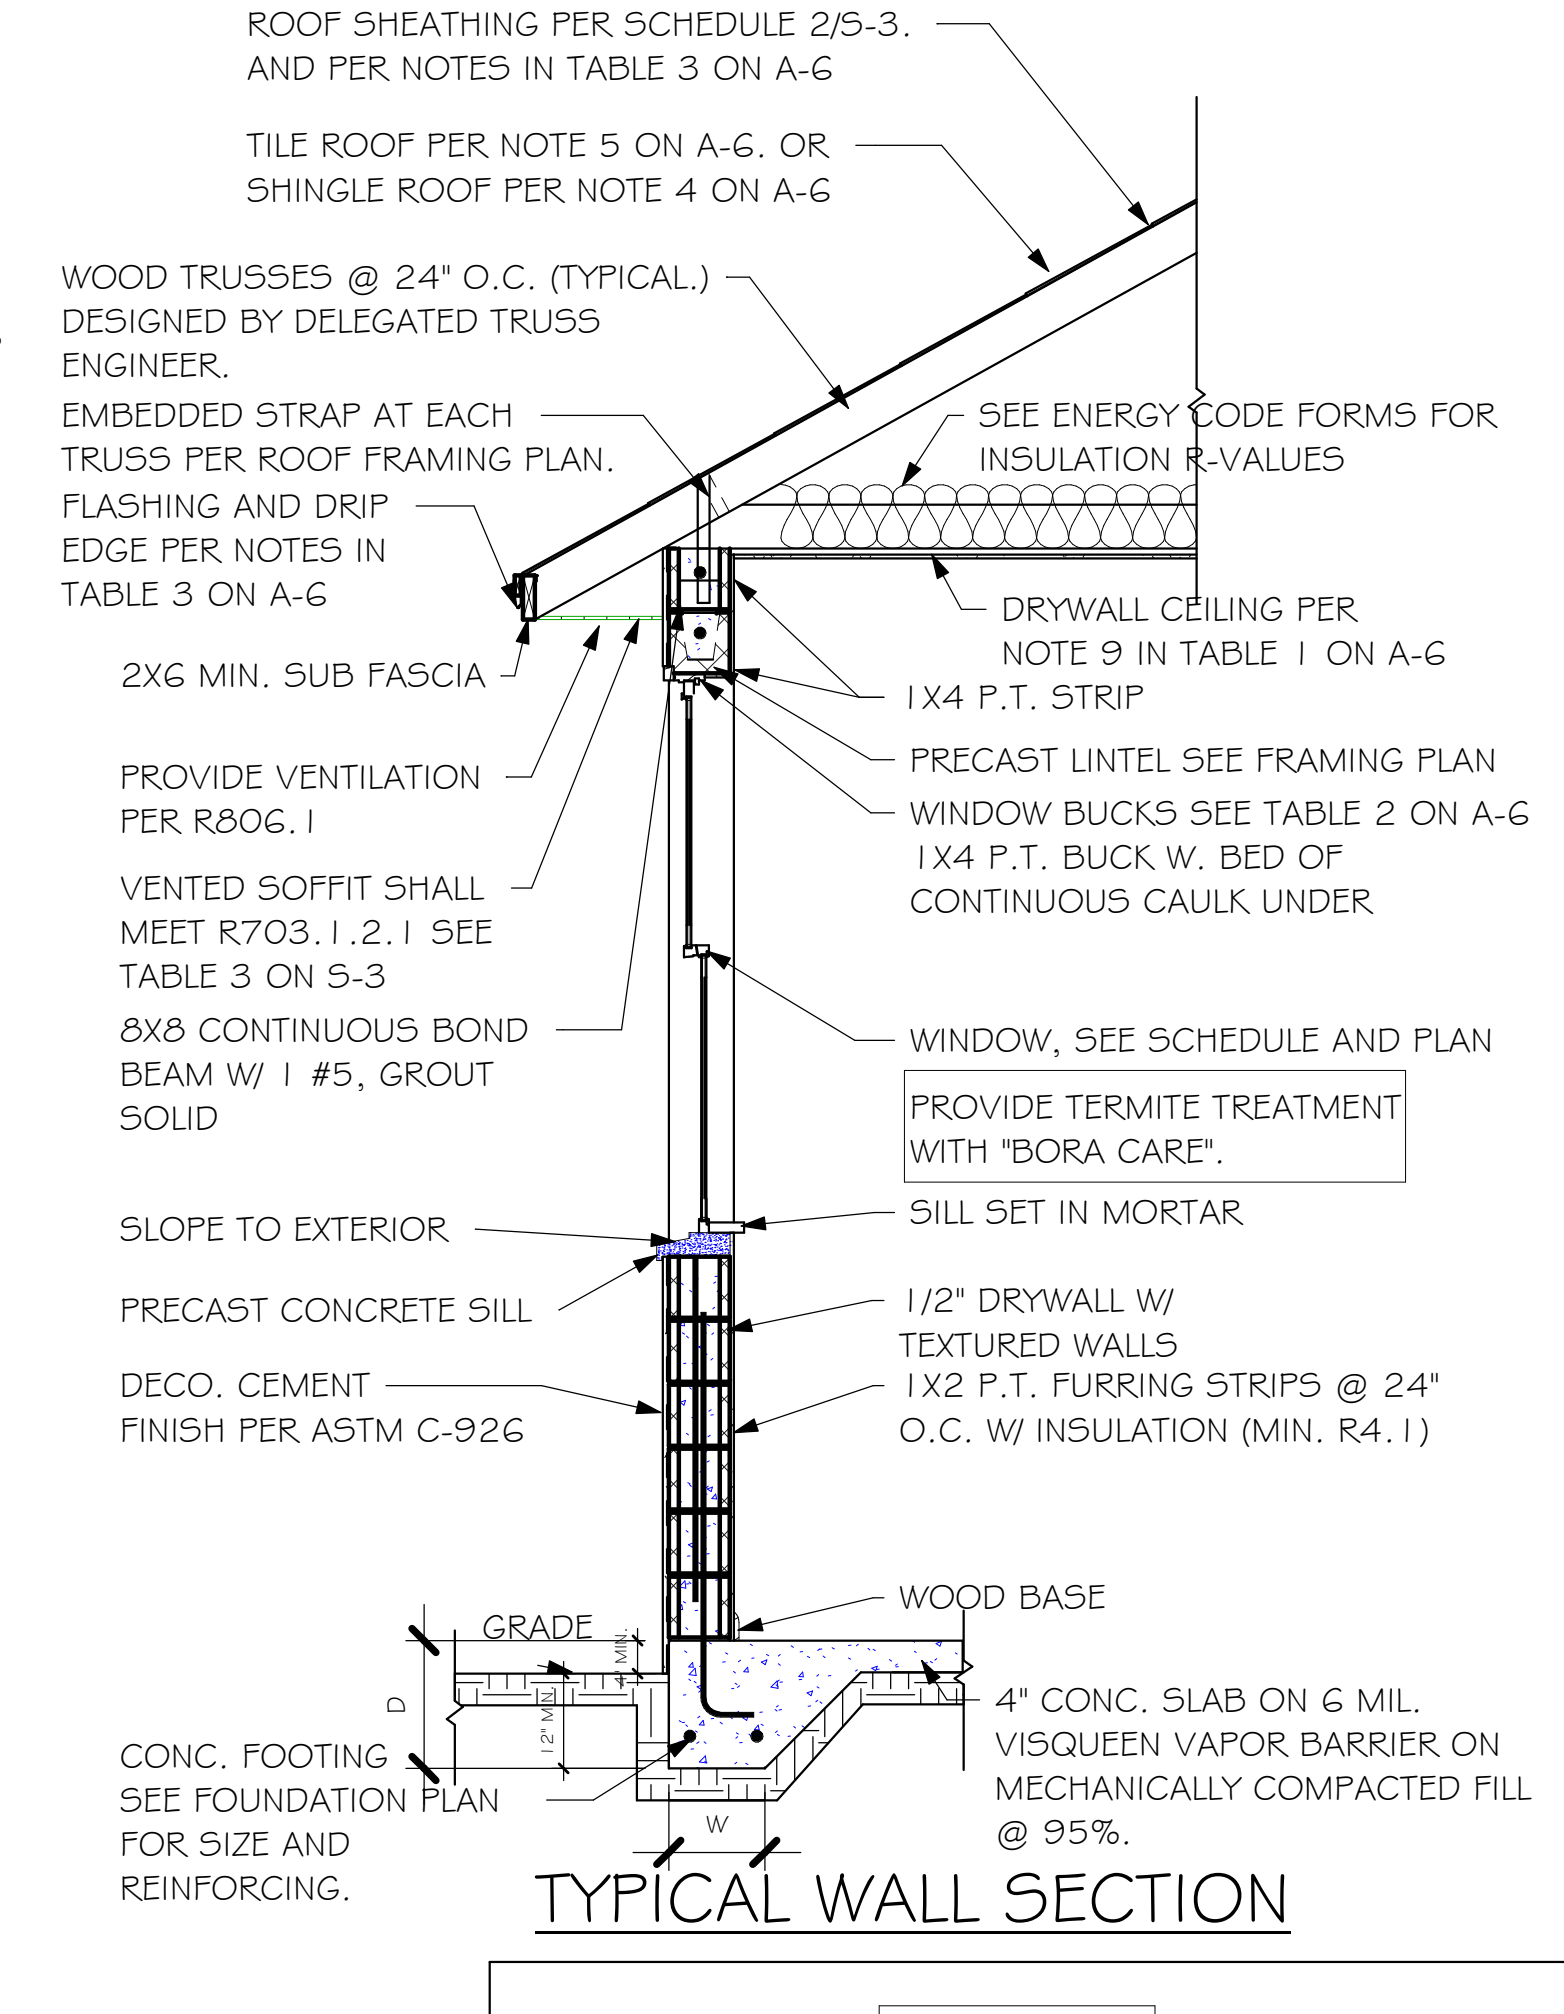

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION




Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRES: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	


MODEL	# 1499 A
GCD JOB #	11087

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	SECTIONS
SCALE:	As indicated
A-6	


Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 ARREVIT\1087 1499 AR.rvt

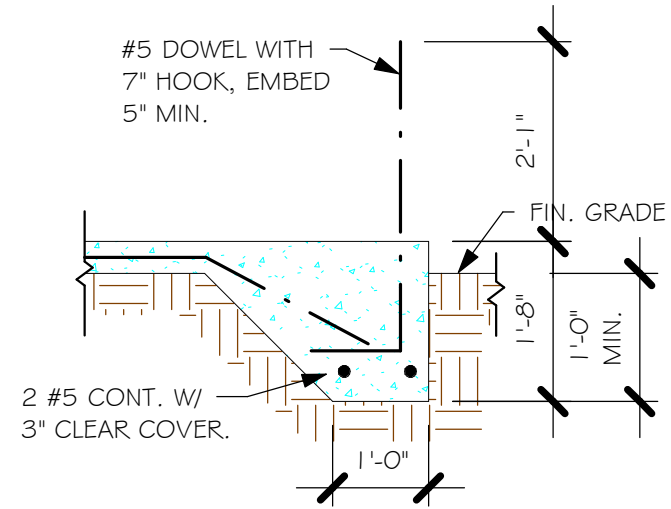


"F3" FOOTING
1/2" = 1'-0"

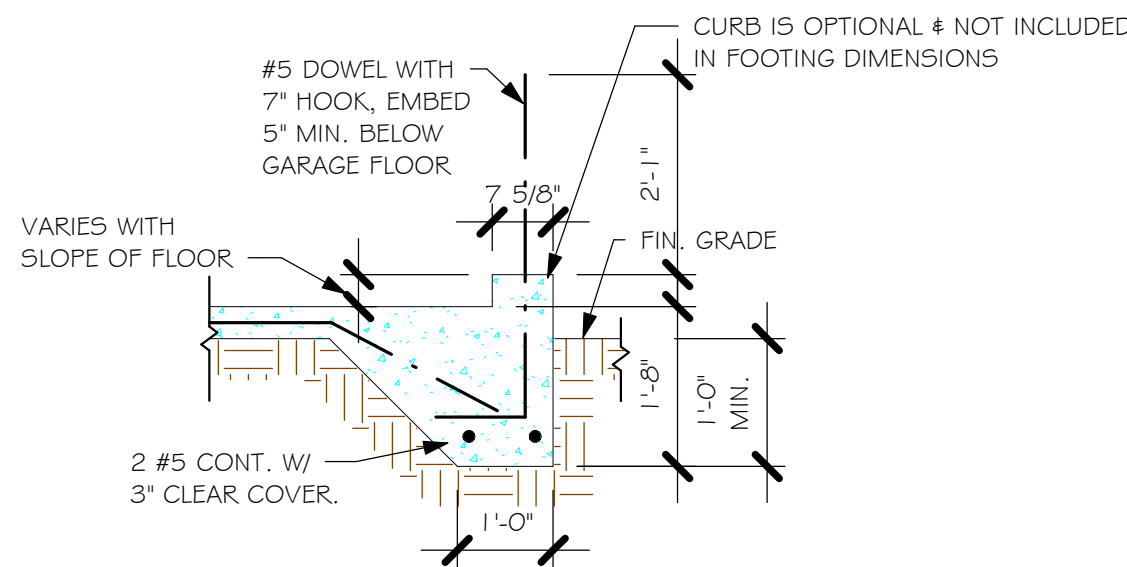


"F3" WITH CURB AT GARAGE
1/2" = 1'-0"

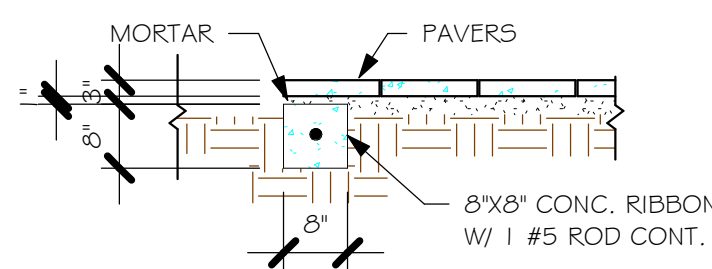

"P" PAVERS DETAIL ENTRY/ LANAI
1/2" = 1'-0"

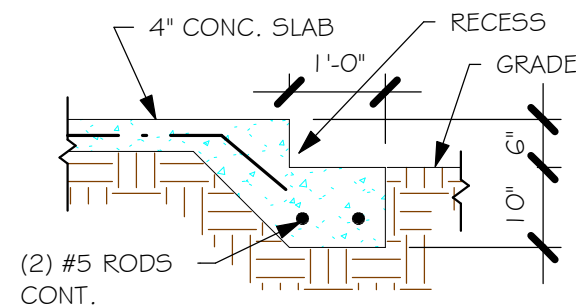

GARAGE DOOR RECESS
1/2" = 1'-0"

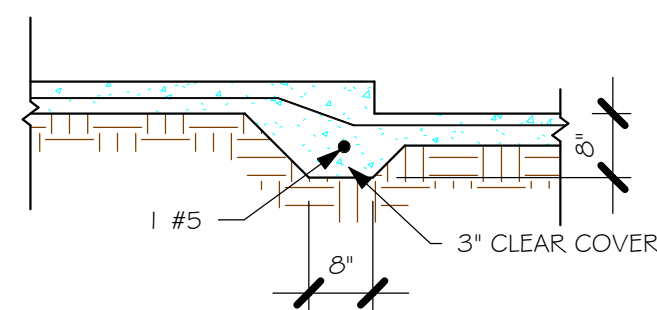

"F6A" STEP DOWN
1/2" = 1'-0"

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM		REMARKS
					LONG	SHORT	
<input checked="" type="checkbox"/>	(A)	2'-	2'-	1'-	3-	3-	-
	(B)	3'-	3'-	1'-	4-	4-	-
	(C)	3'-	3'-	1'-	4-	4-	-
	(D)	4'-	4'-	1'-	5-	5-	-
	(E)	5'-	5'-	1'-	6-	6-	-

WALL FOOTING SCHEDULE						
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCIN	SHAP
	F1	CONT	1'-	0'-	2'-	
	F2	CONT	1'-	0'-1	2'-	
	F3	CONT	1'-	1'-	2'-	
	F4	CONT	1'-	1'-	2'-	
	F5	CONT	1'-	1'-	2'-	
	F6	CONT	1'-	1'-	2'-	
	F6A	CONT	0'-	0'-	1'-	
	TE	CONT	0'-	0'-	1'-#5	

PROVIDE CORNER BARS PER G/S-3


ADD CURB TO GARAGE.

FOUNDATION

SCALE: 3/16" =

PLAN NOTES:

- TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
- "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- "# DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH

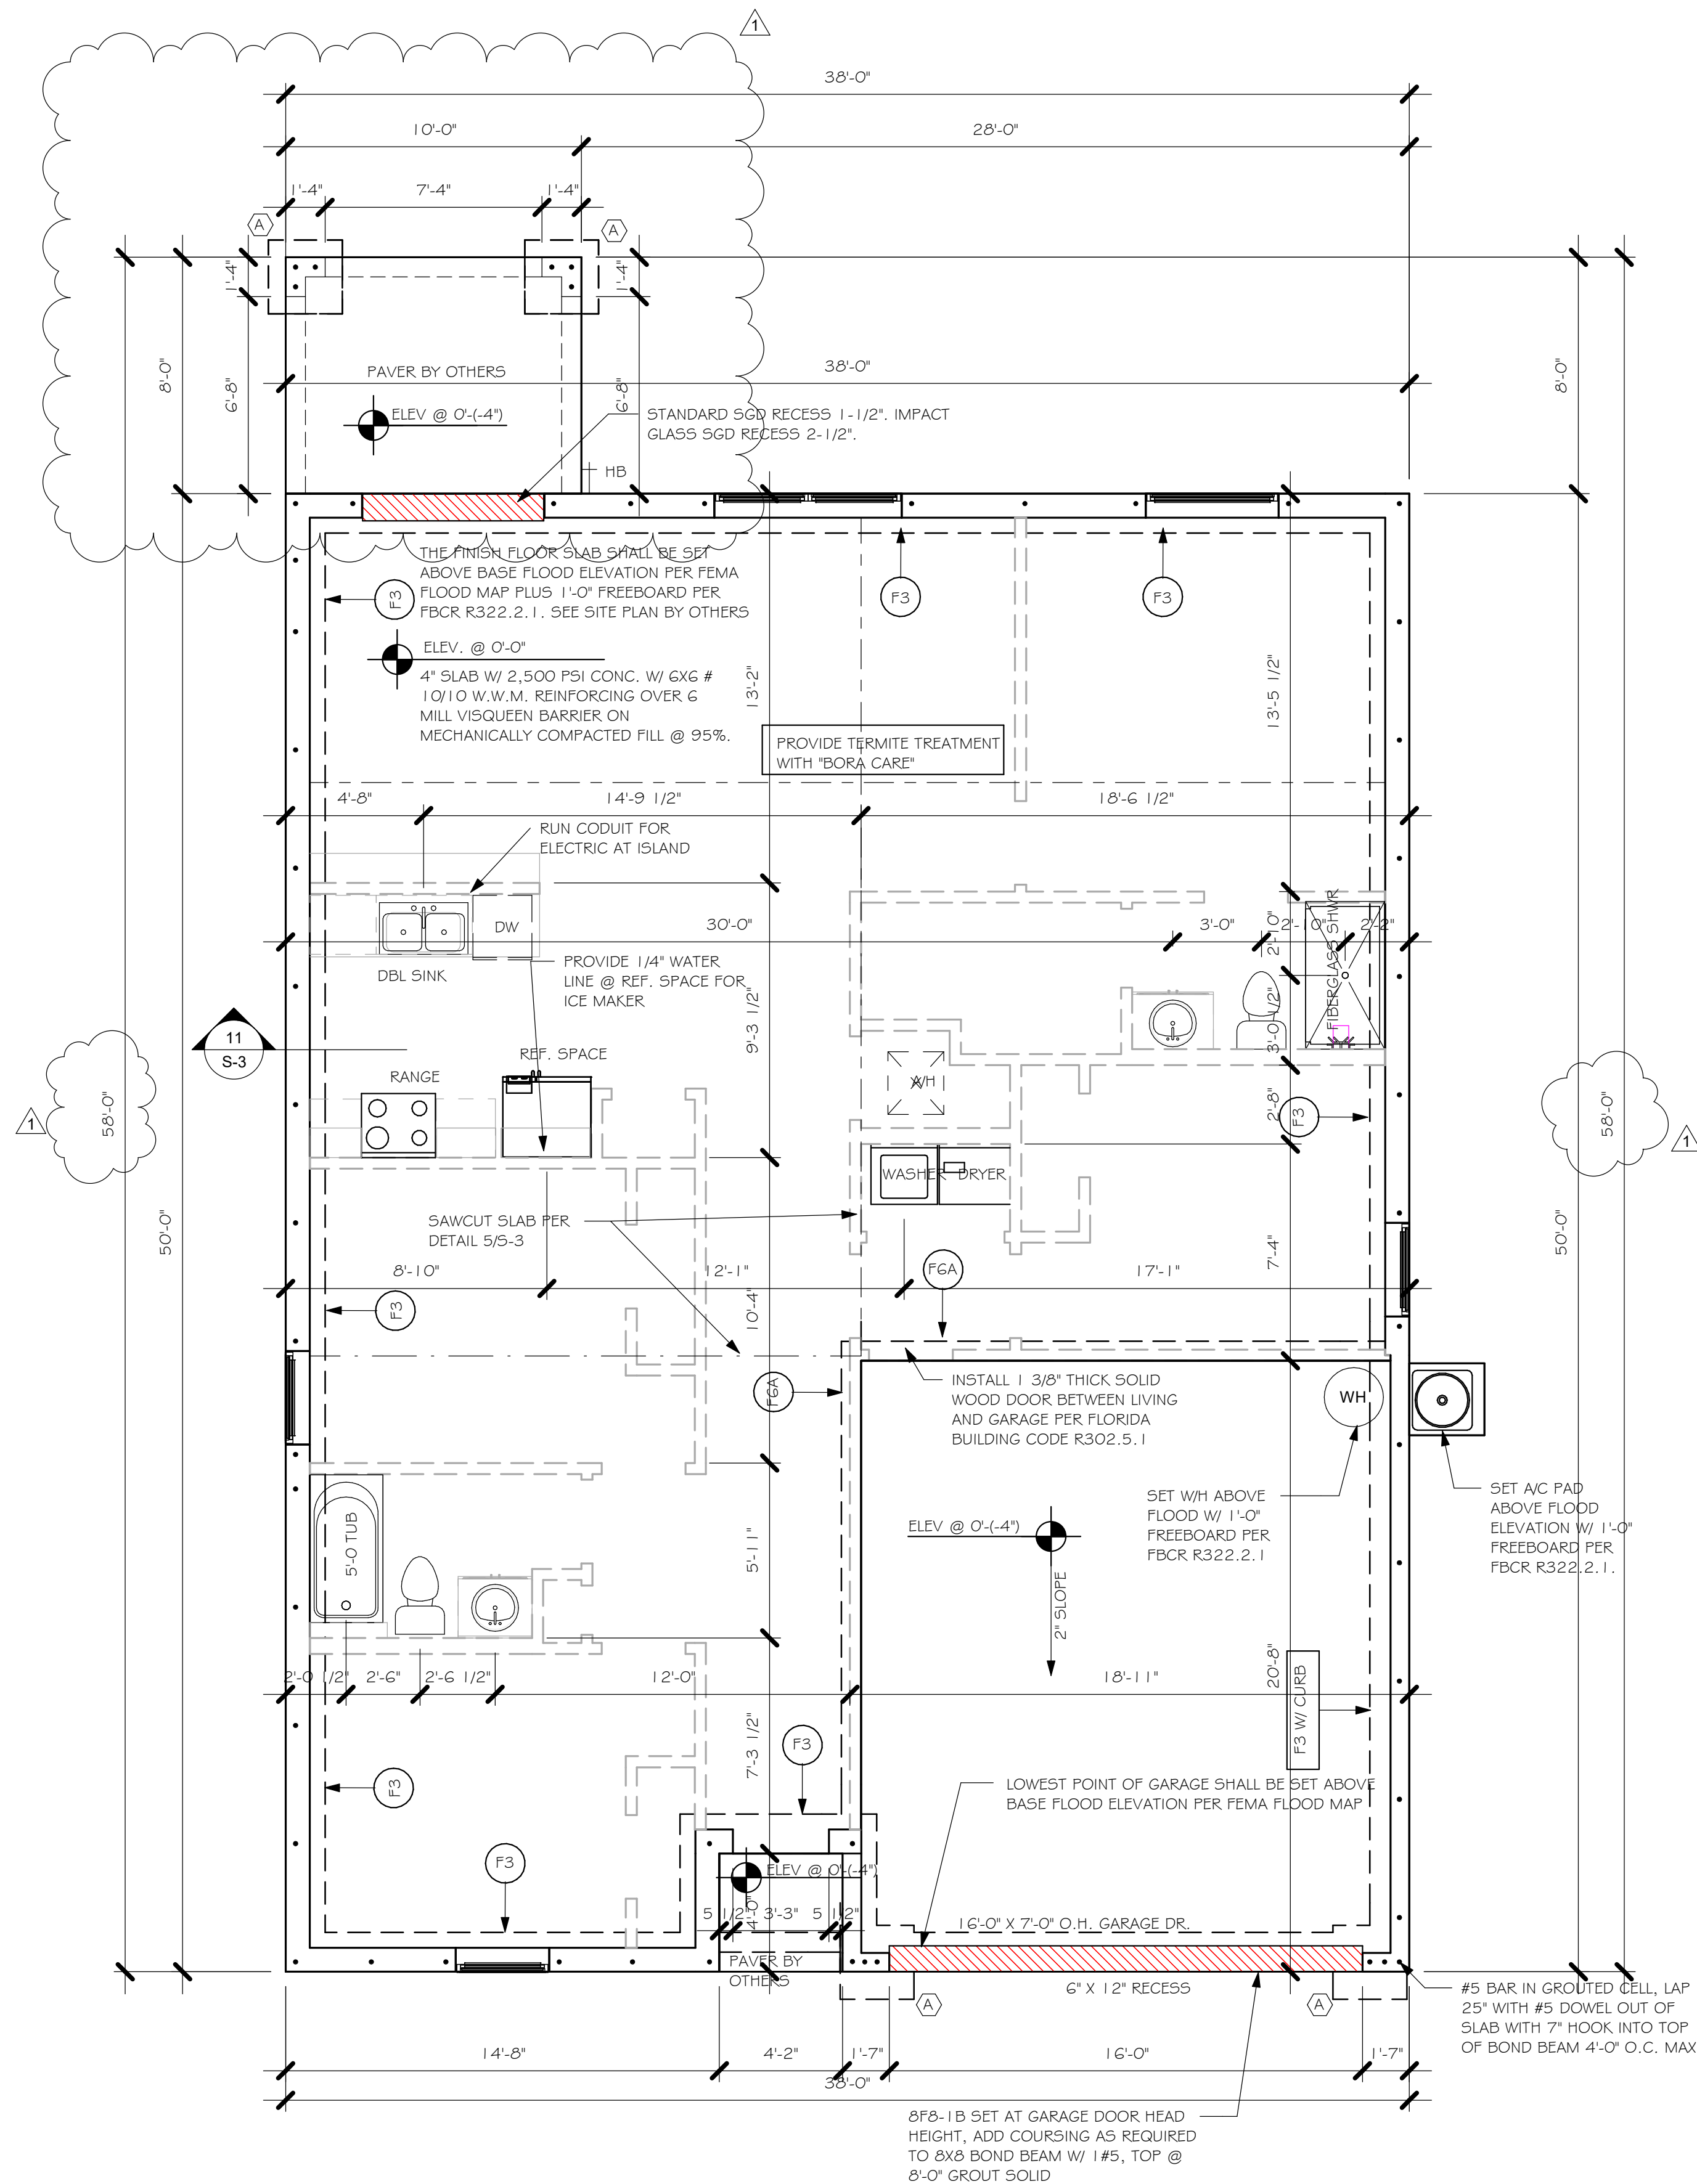

FOUNDATION

1/4" = 1'-0"

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL SYSTEMS OF NORTH FLORIDA
2500 S. GULF BLVD., SUITE 100
CAPE CORAL, FL 33904
(239) 549-4554
CFL 8889

LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRES: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	
MODEL # 1499 A	
GCD JOB # 11087	

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	FOUNDATION PLAN
SCALE:	As indicated
S-1	


Y:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\LEHIGH SPOT LOTS\11087 LOT 20 BLK 14 1499 AR\REV\11087 LOT 20 BLK 14 1499 AR.rvt

TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
1450	(1) META I 6 TO 40	8-0.148x1 1/2", EMBED 4"
1810	(1) META I 6 TO 40	9-0.148x1 1/2", EMBED 4"
2120	(1) HHETA I 6 TO 40	10-0.148x1 1/2", EMBED 4"
1875 (1 PLY)	(2) META I 6 TO 40	10-0.148x1 1/2", EMBED 4"
1795 (2 PLY)	(2) META I 6 TO 40	14-0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) META I 6 TO 40	12-0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) HHETA I 2 TO 40	12-0.162x3 1/2", EMBED 4"
3965/SYP 3330/SPP	MGT (2 PLY)	22-0.148x3" ATR, EPOXY 12"
4235/SYP 3640/SPP	HTT4	18-0.162x2 1/2", 3/8" ATR, EPOXY 12"
4670/SYP 4015/SPP	HTT5	26-0.148x3", 3/8" ATR, EPOXY 12"
5445/SYP 5360/SPP	HTT5KT	26-SD#10x2 1/2", 3/8" ATR, EPOXY 18"
10690/SYP 10690/SPP	(1)HGT - 2	16-0.148x2" TO GIRDER, (2)3/4" ATR, EPOXY 12"
10790/SYP 10790/SPP	(1)HGT - 3	16-0.148x3" TO GIRGER, (2)3/4" ATR, EPOXY 12"


NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON -C OF WALL. CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD. WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 105-3.

R4-02 1020

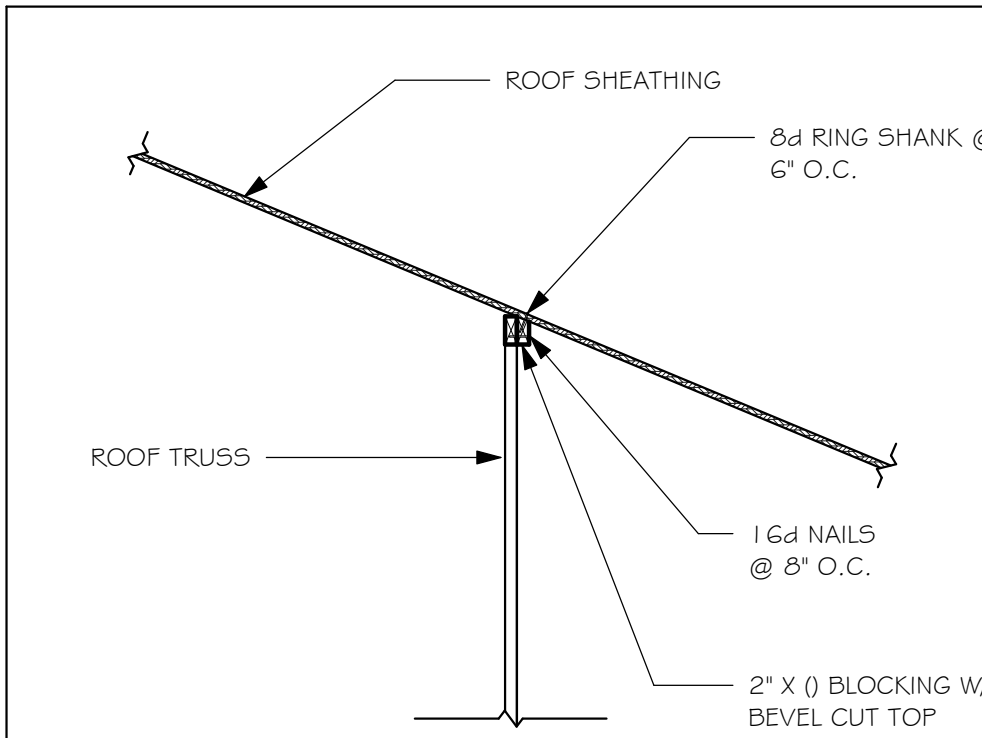

BEVELLED BLOCKING DETAIL

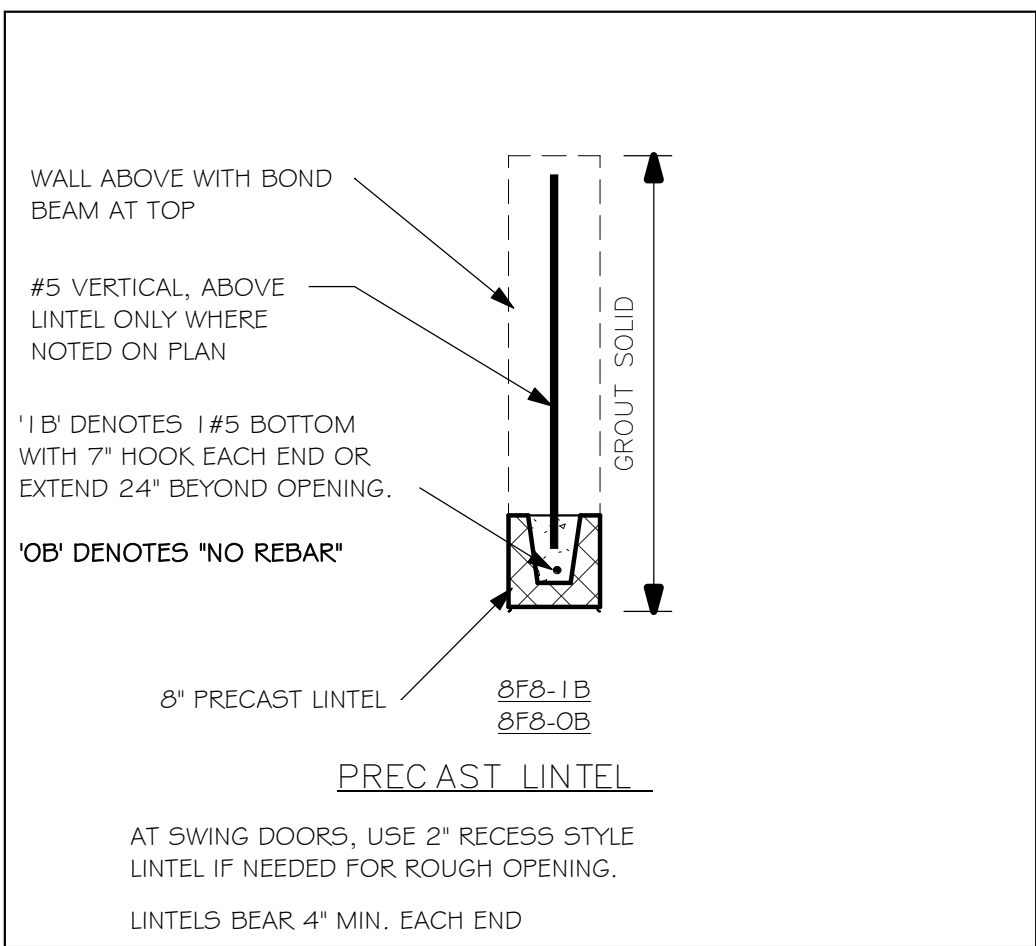

PLAN NOTES:

- ROOF TRUSS BEARING 8'-0", SEE LEGEND.
- ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-3.
- PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
- FOR NAILING OF ROOF AND FLOOR DECK, SEE 1 AND 2 ON S-3.
- 8F8-1B etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
- AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 11/5-3.


BEARING HEIGHT

= BEARING @ 8'-0"

TRUSS BEARING CONDITIONS AND STRAPPING IS BASED ON TRUSS LAYOUT PREPARED BY SCOSTA JOB# 4411 GL DATED: 12/12/19 REVISED: NONE

WHERE ROOF SHEATHING CONTACTS ONLY THE EDGE OF ROOF TRUSSES, INSTALL BEVELLED BLOCKING PER DETAILS THIS SHEET (DR HORTON COMPANY REQUIREMENT)

(+33.5 -36.3) WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE C AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vmax=124 MPH, RISK CAT II, ENCLOSED, kd=0.85, H=15)

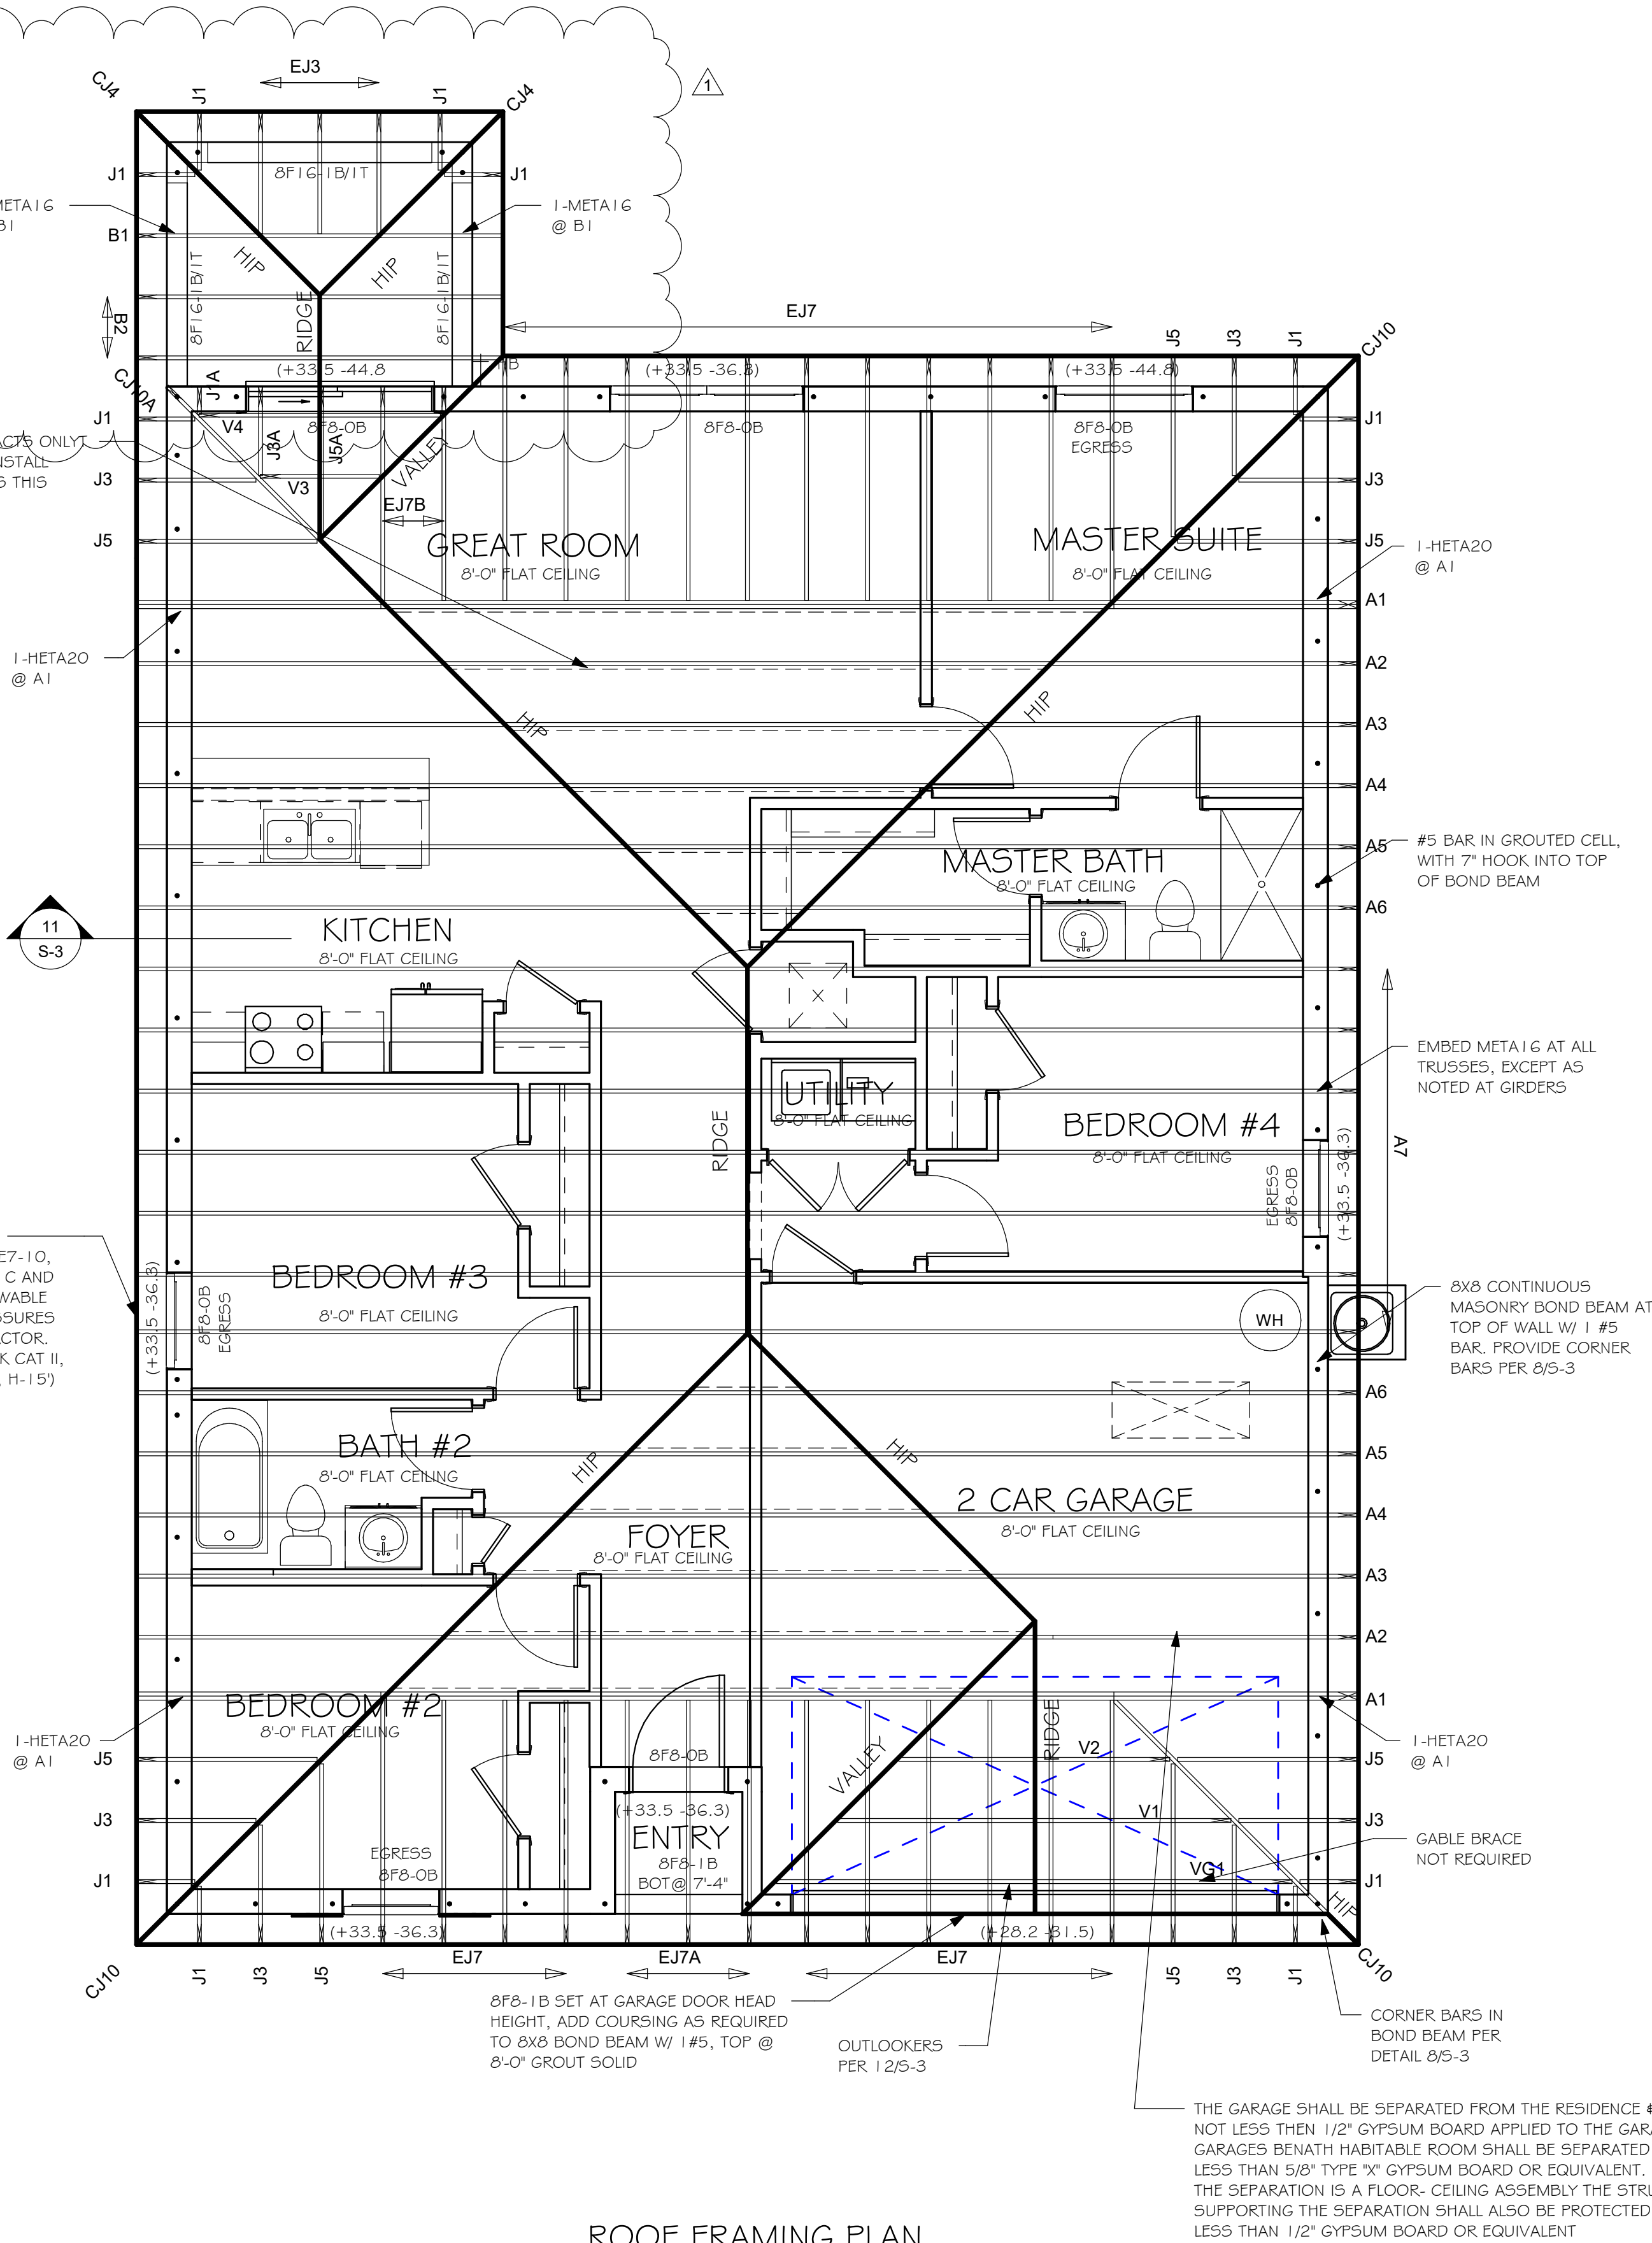

ROOF FRAMING PLAN

1/4" = 1'-0"

No.	Description	Date
1	COMPLETE MODEL CHANGE FROM 1499 AR TO A 1499 AR EXT LANAI / CHANGED STRAPPING FROM USP TO SIMPSON STRONG TIE	02/07/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION






Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8223
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1000 E. 10th Ave., Suite 100
Cape Coral, FL 33904
(239) 549-4254
CA 889

LOT: 20	BLOCK: 14
SUBDIVISION: LEHIGH SPOT LOTS	
ADDRESS: 1013 ALLMAN AVENUE	
D.R.H. #: 579070015	

MODEL
#1499 A
GCD JOB # 11087

DATE:	07/30/19
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	02/07/20
PLAN:	ROOF FRAMING PLAN
SCALE:	As indicated
S-2	

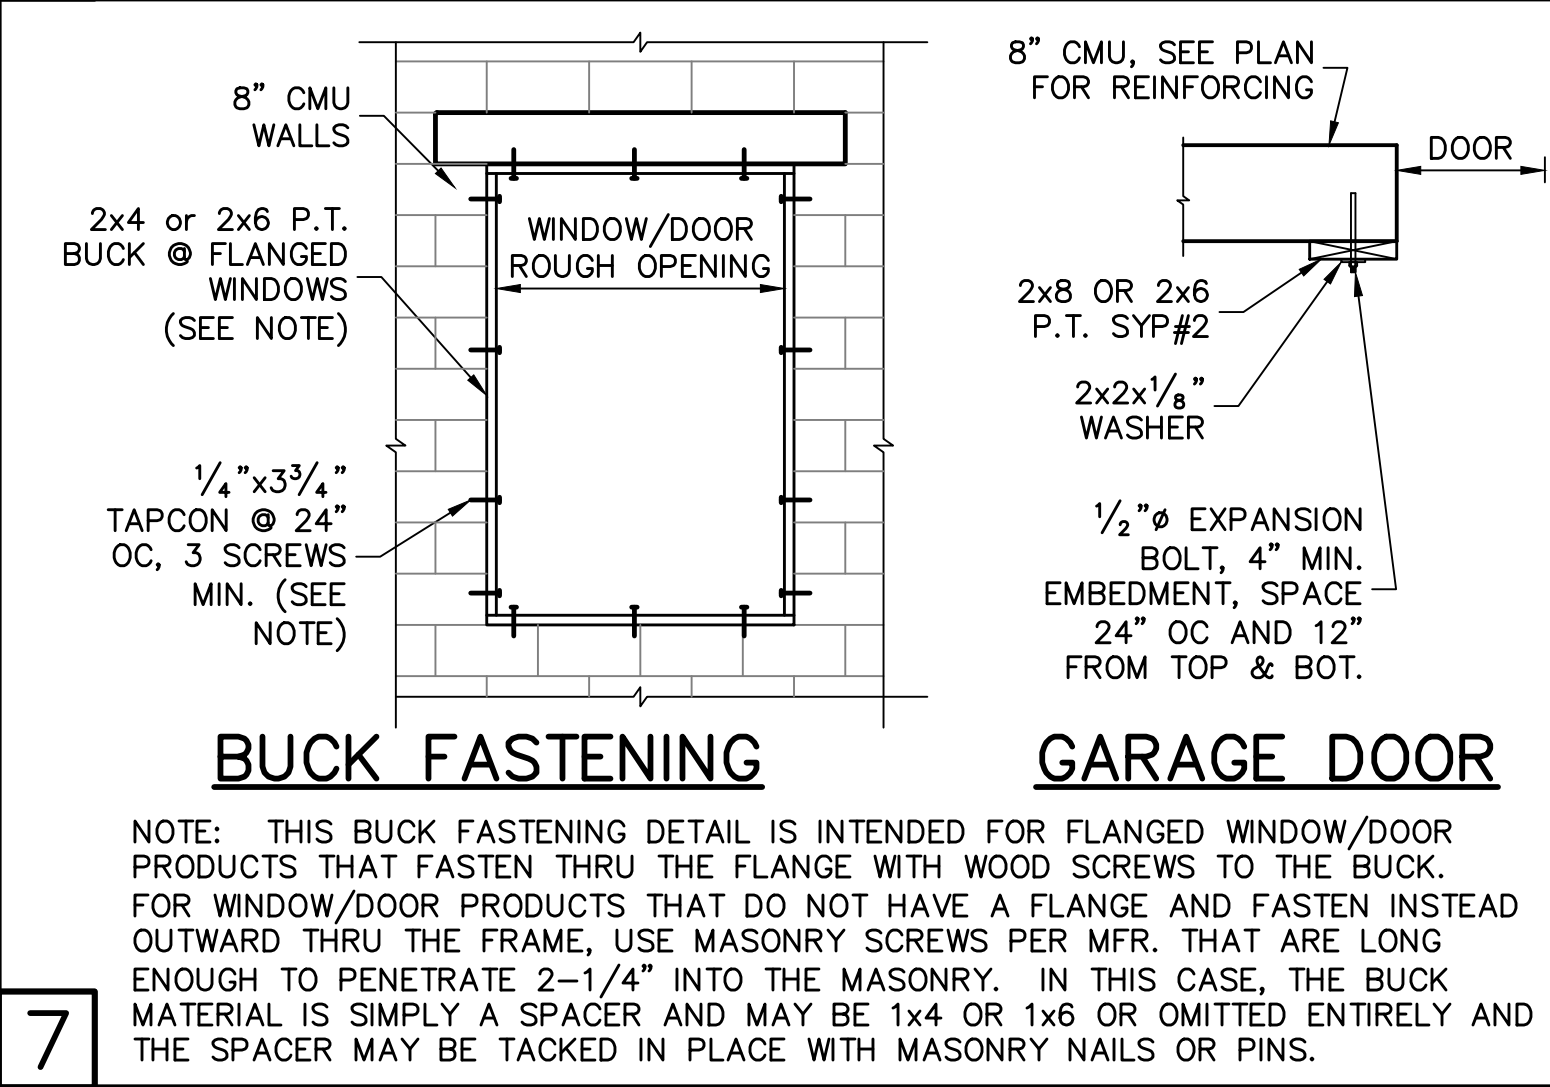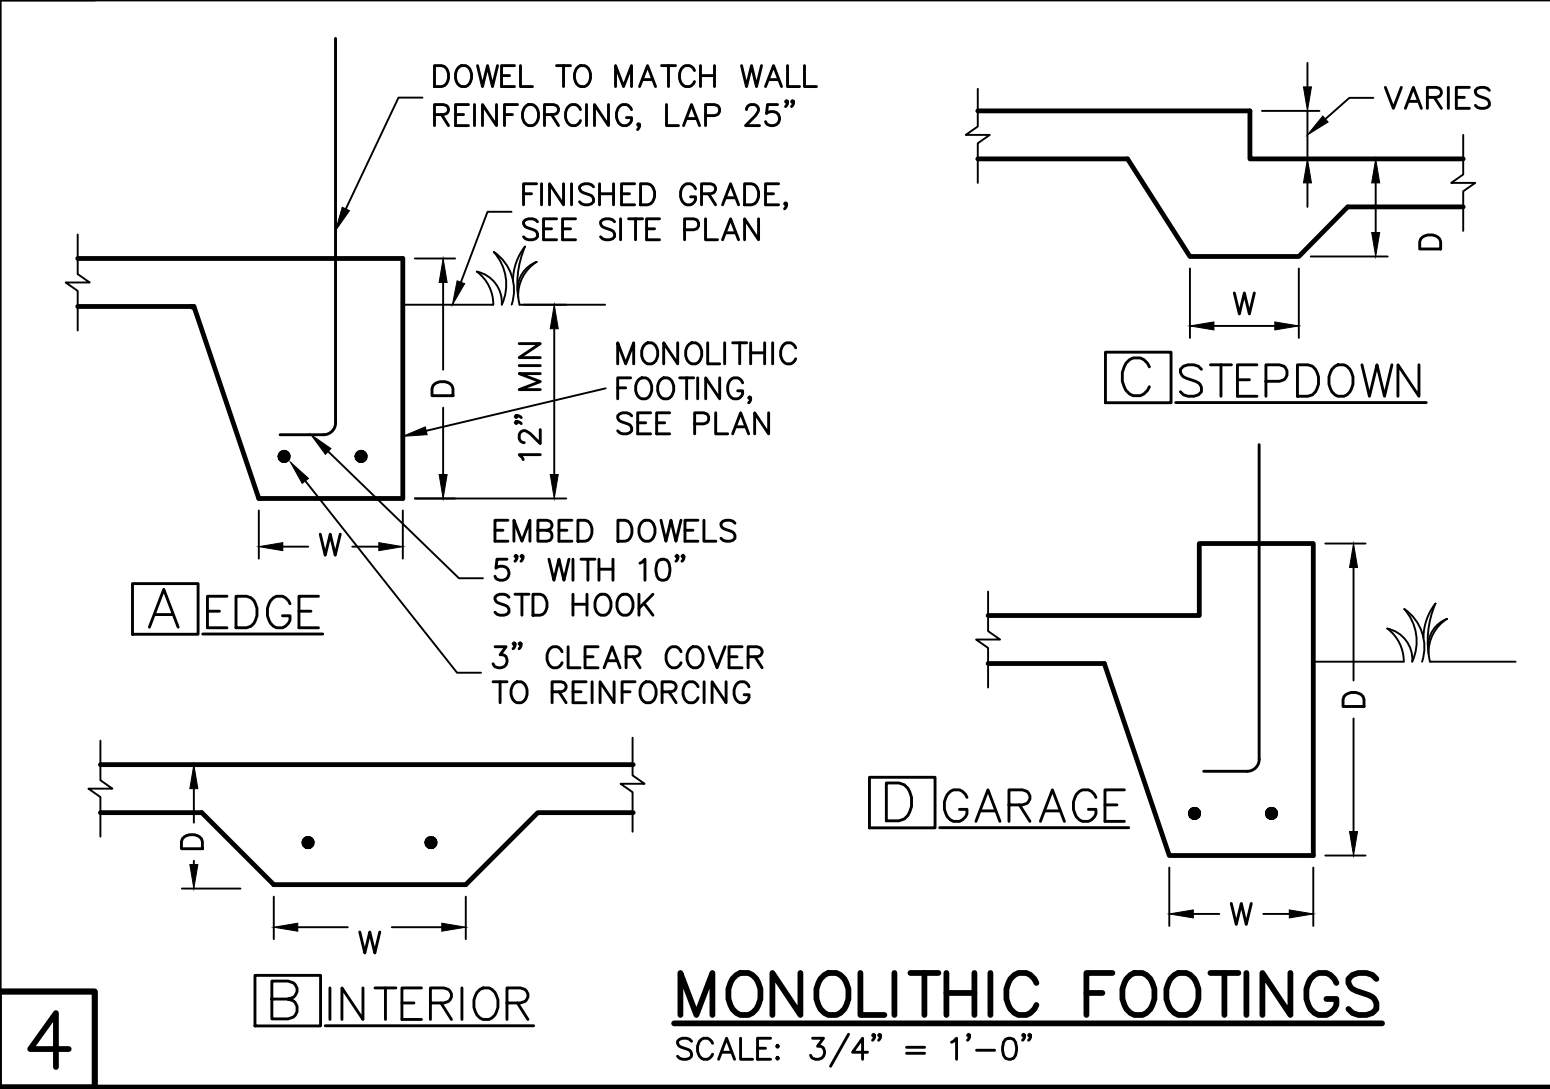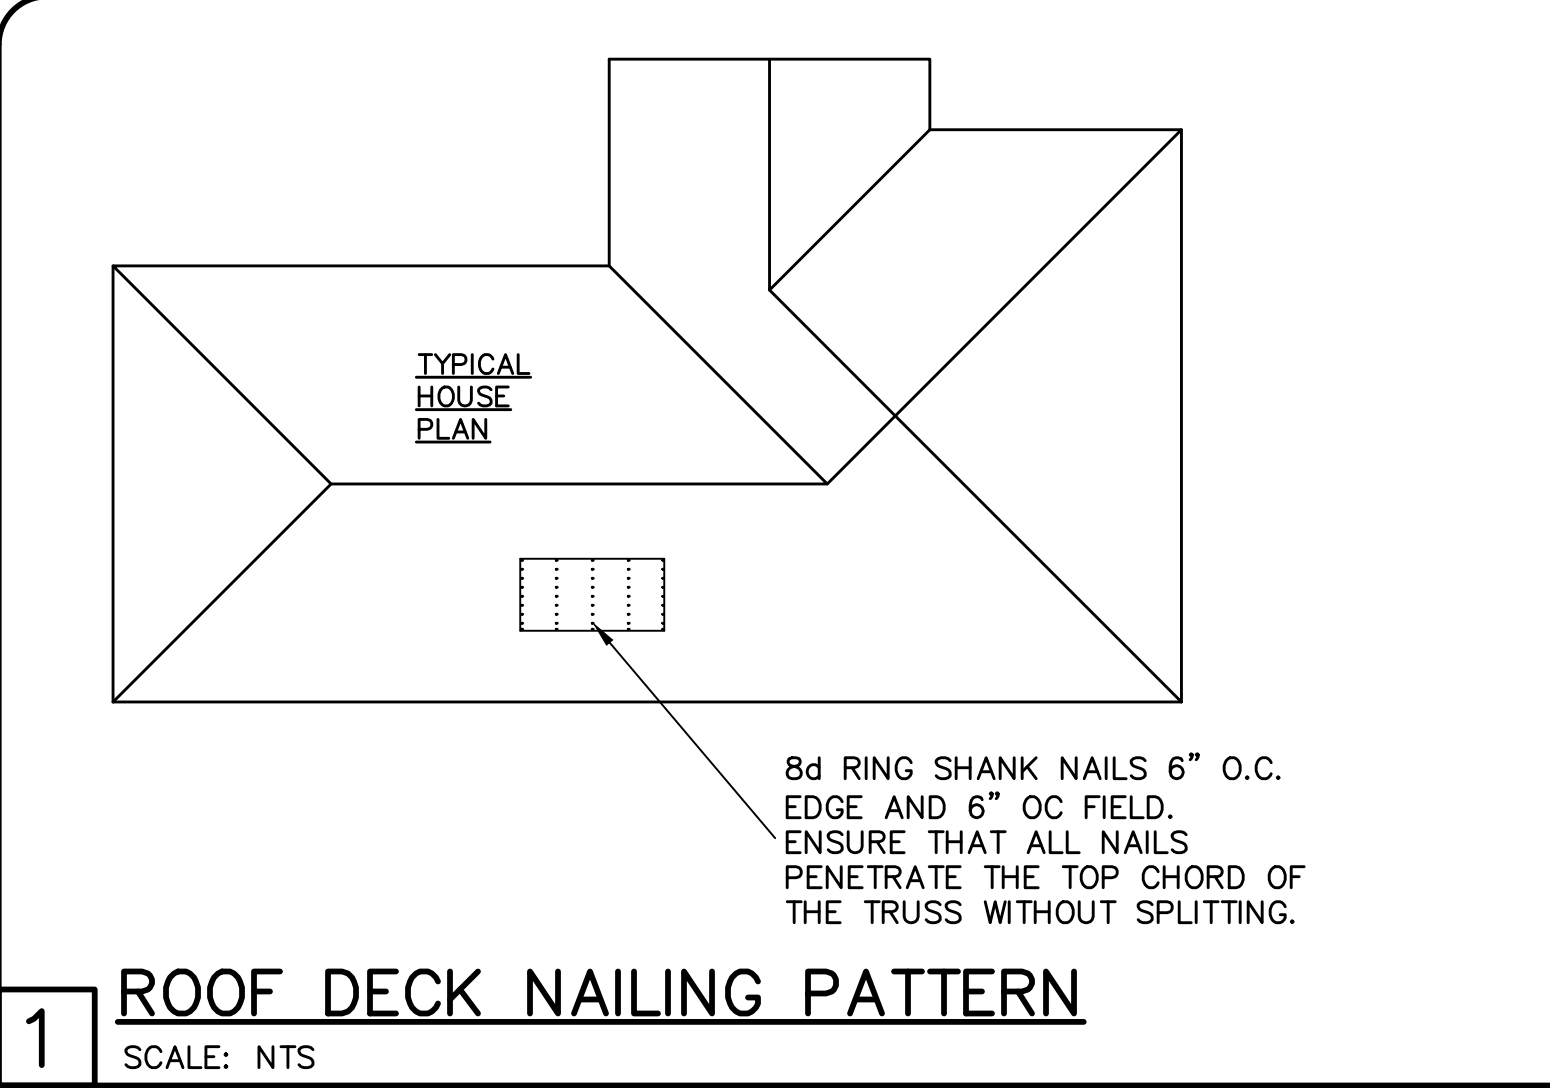

RETROFIT STRAPS TO CONCRETE/MASONRY







TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR
TO 840	1-MTSM16 or 20
TO 1045	1-HTSM16 or 20
TO 2090	2-HTSM16 or 20
TO 4300	2-LGT2
TO 3480	HTT16
TO 10530	HGT-2/3

NOTES:
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

SHEATHING SCHEDULE

EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED) (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.

NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

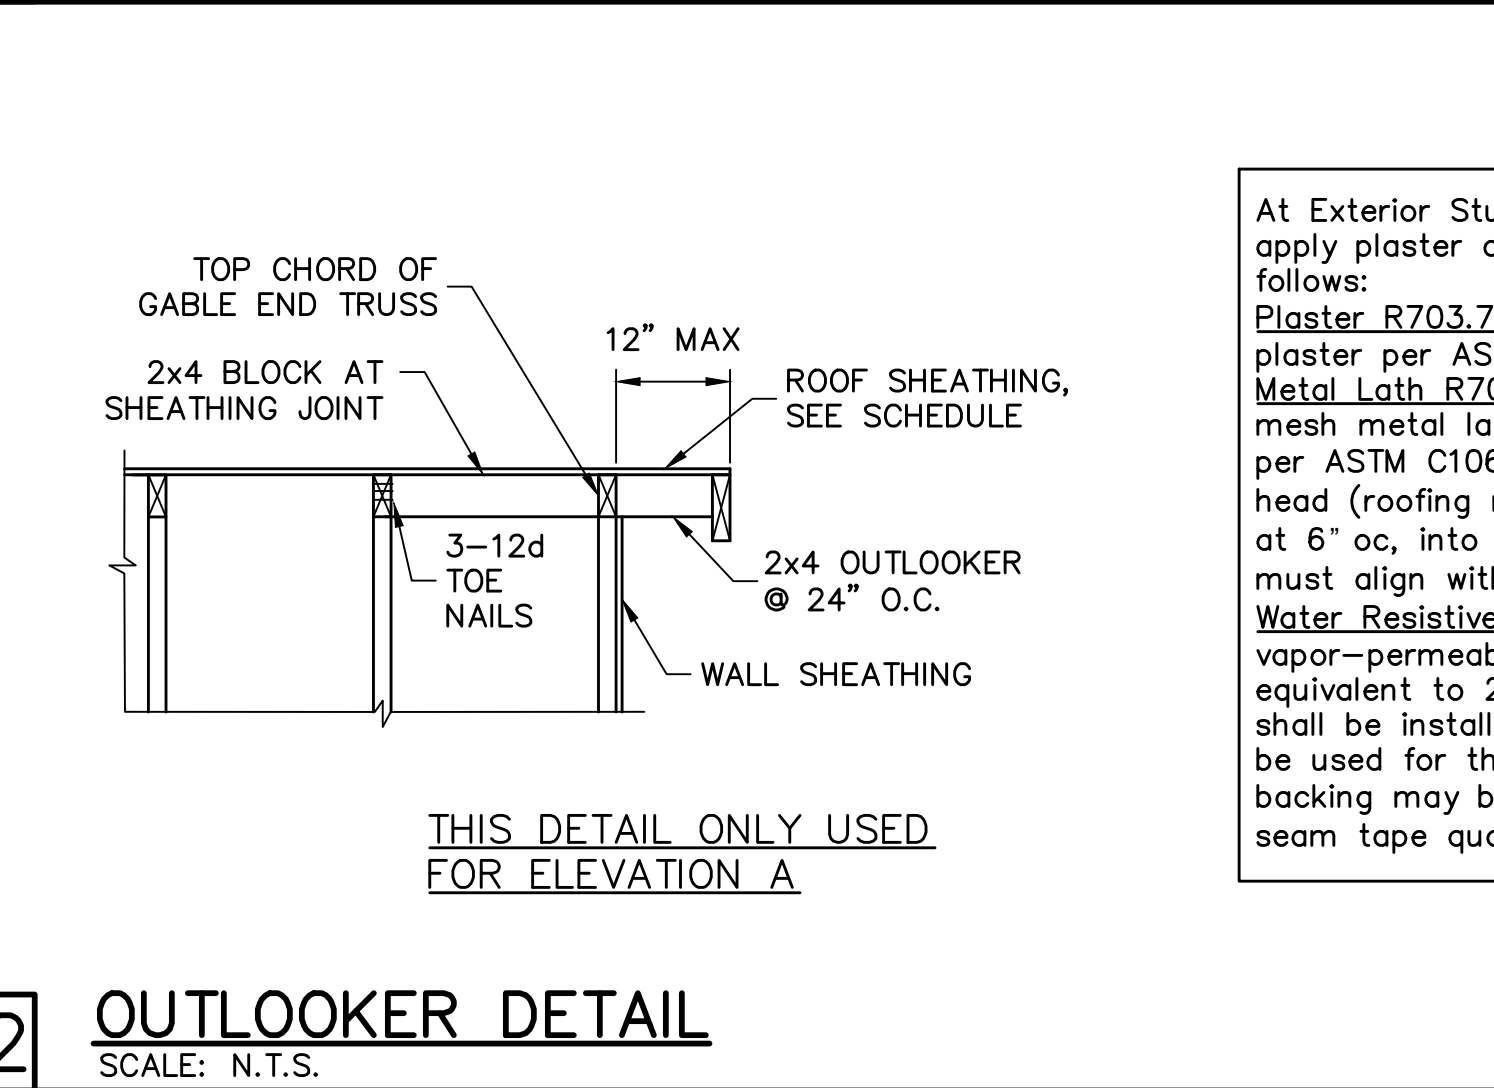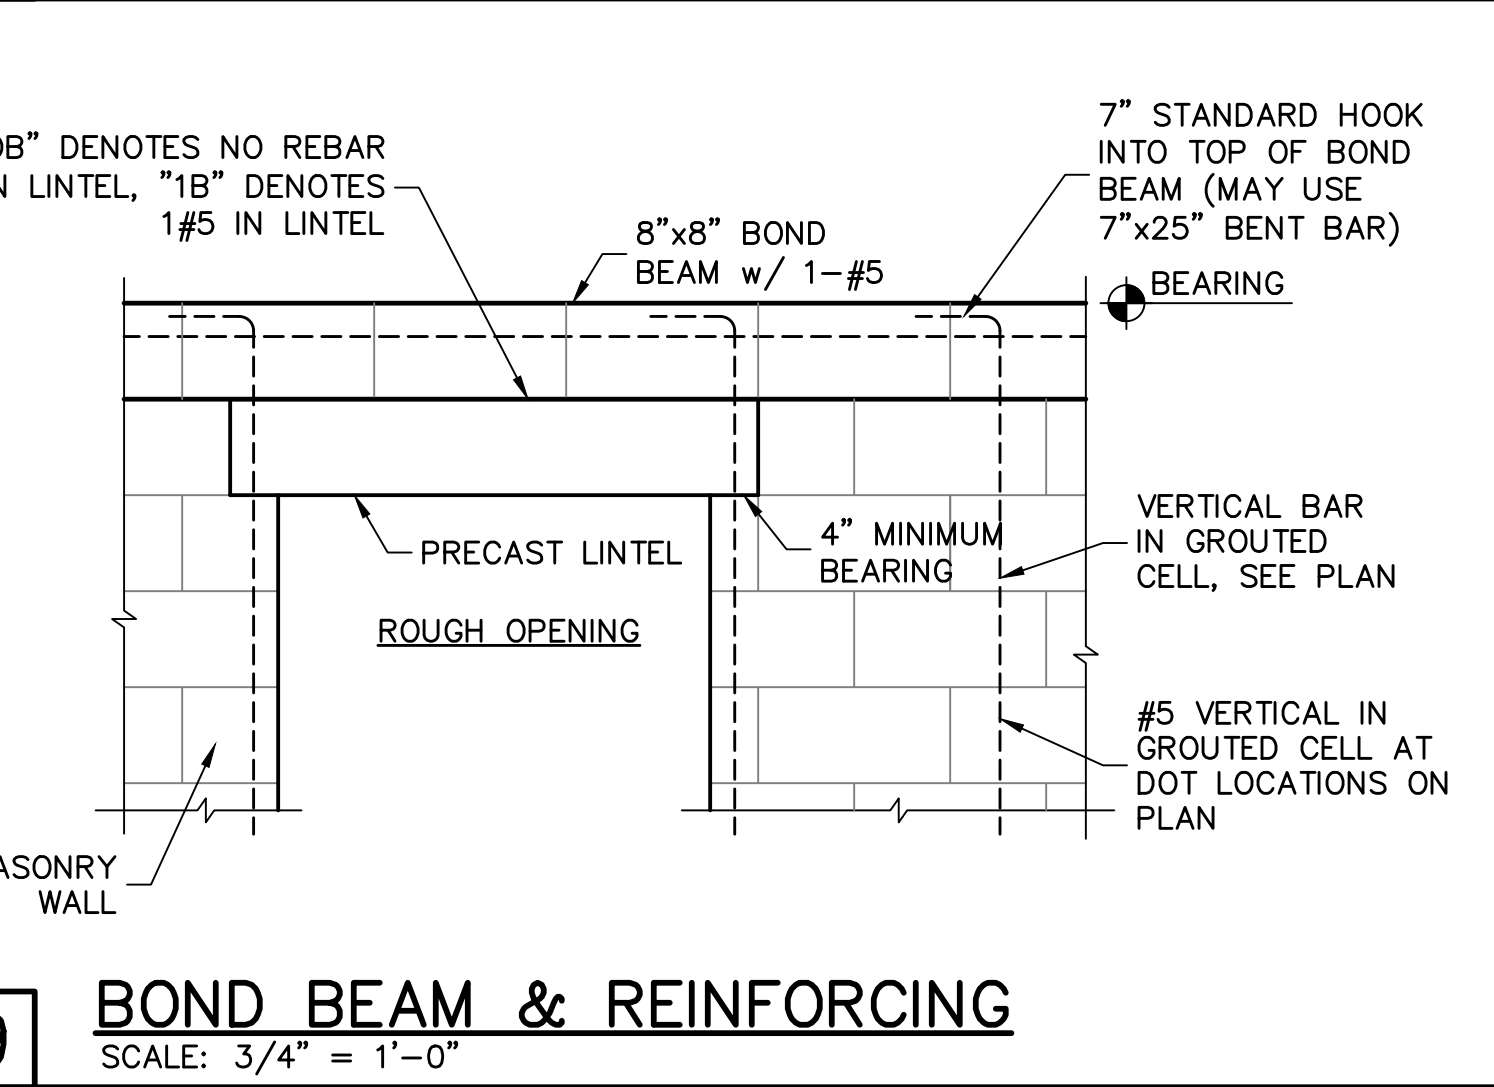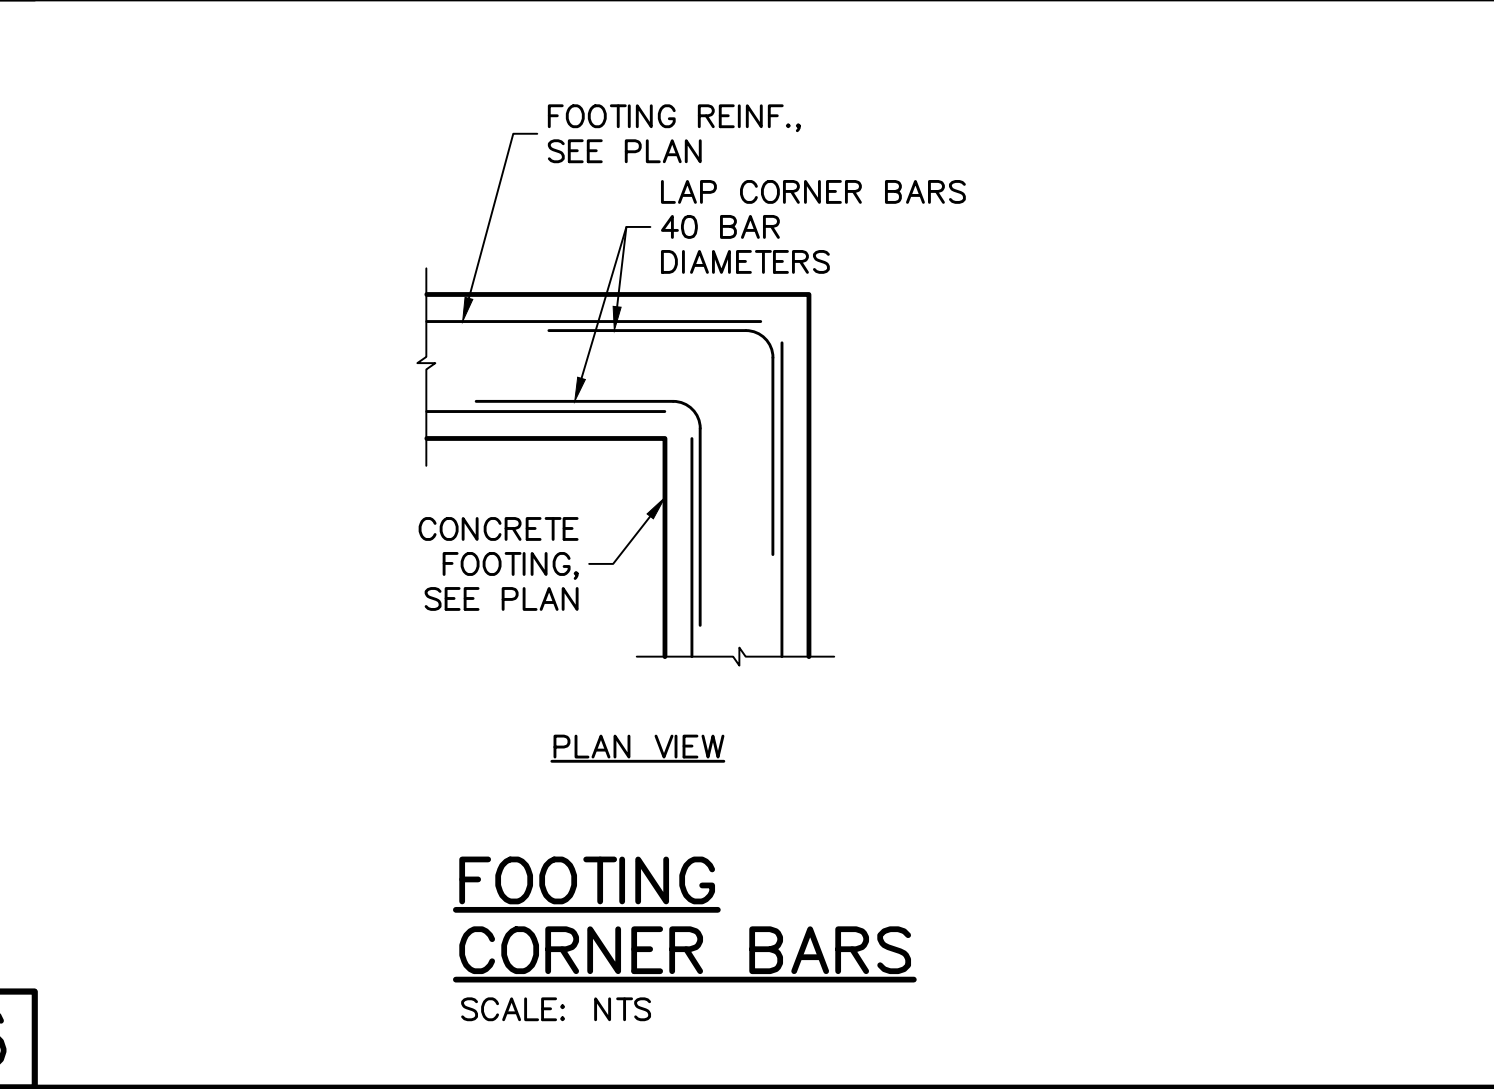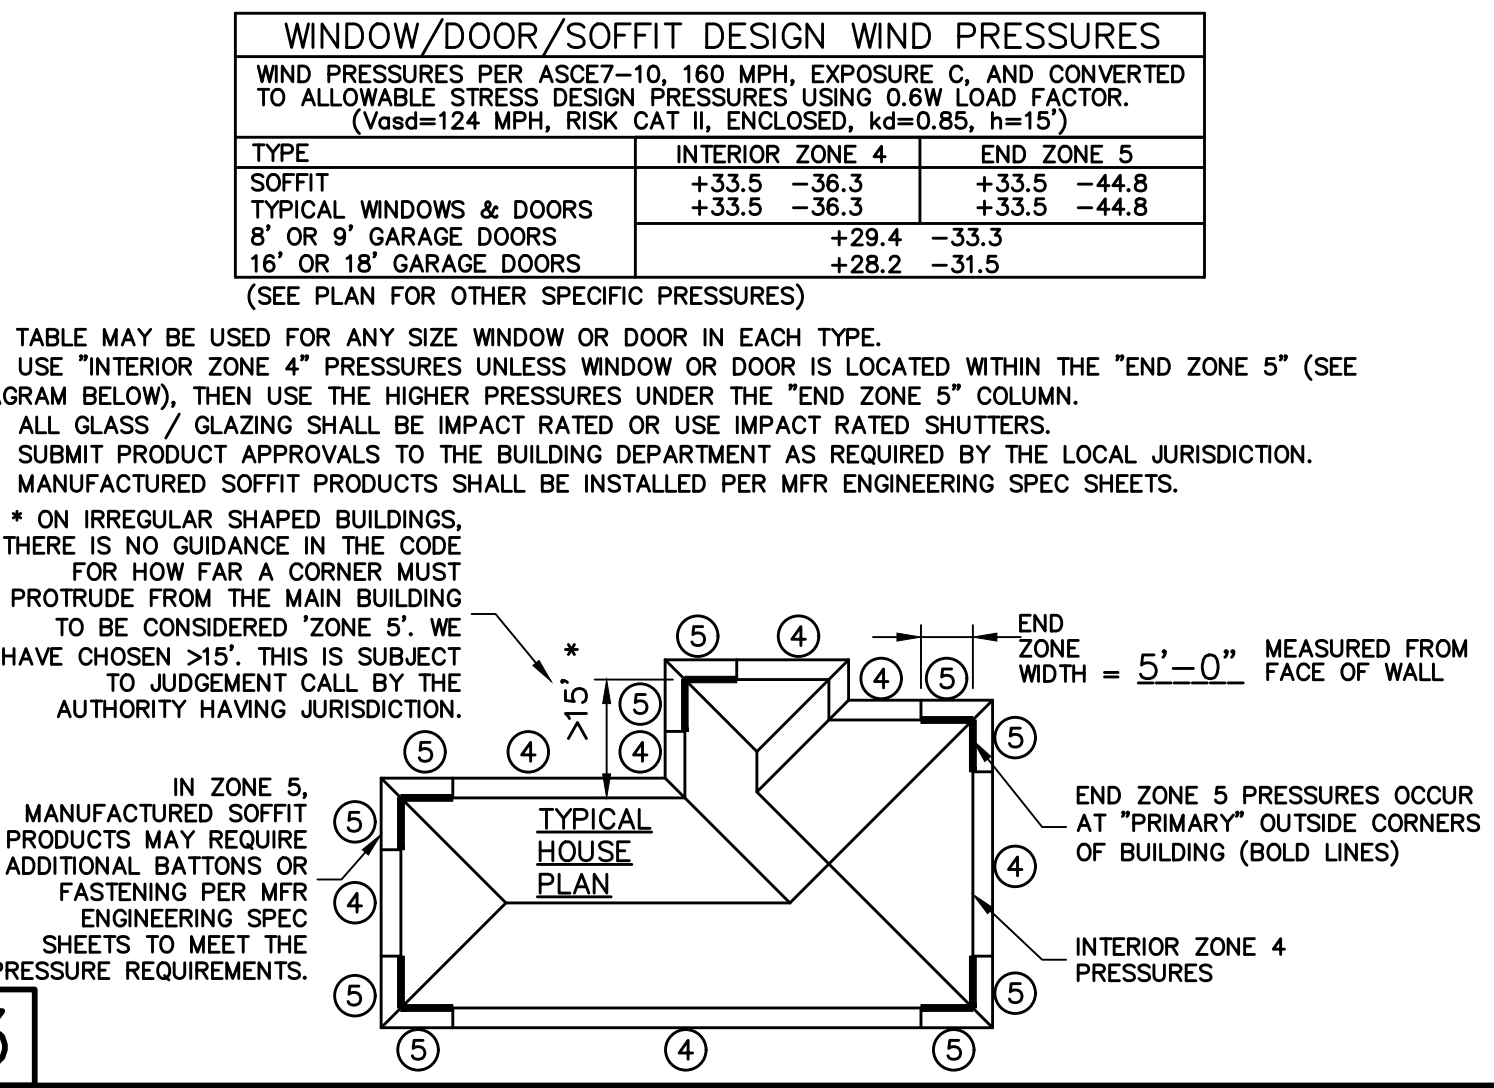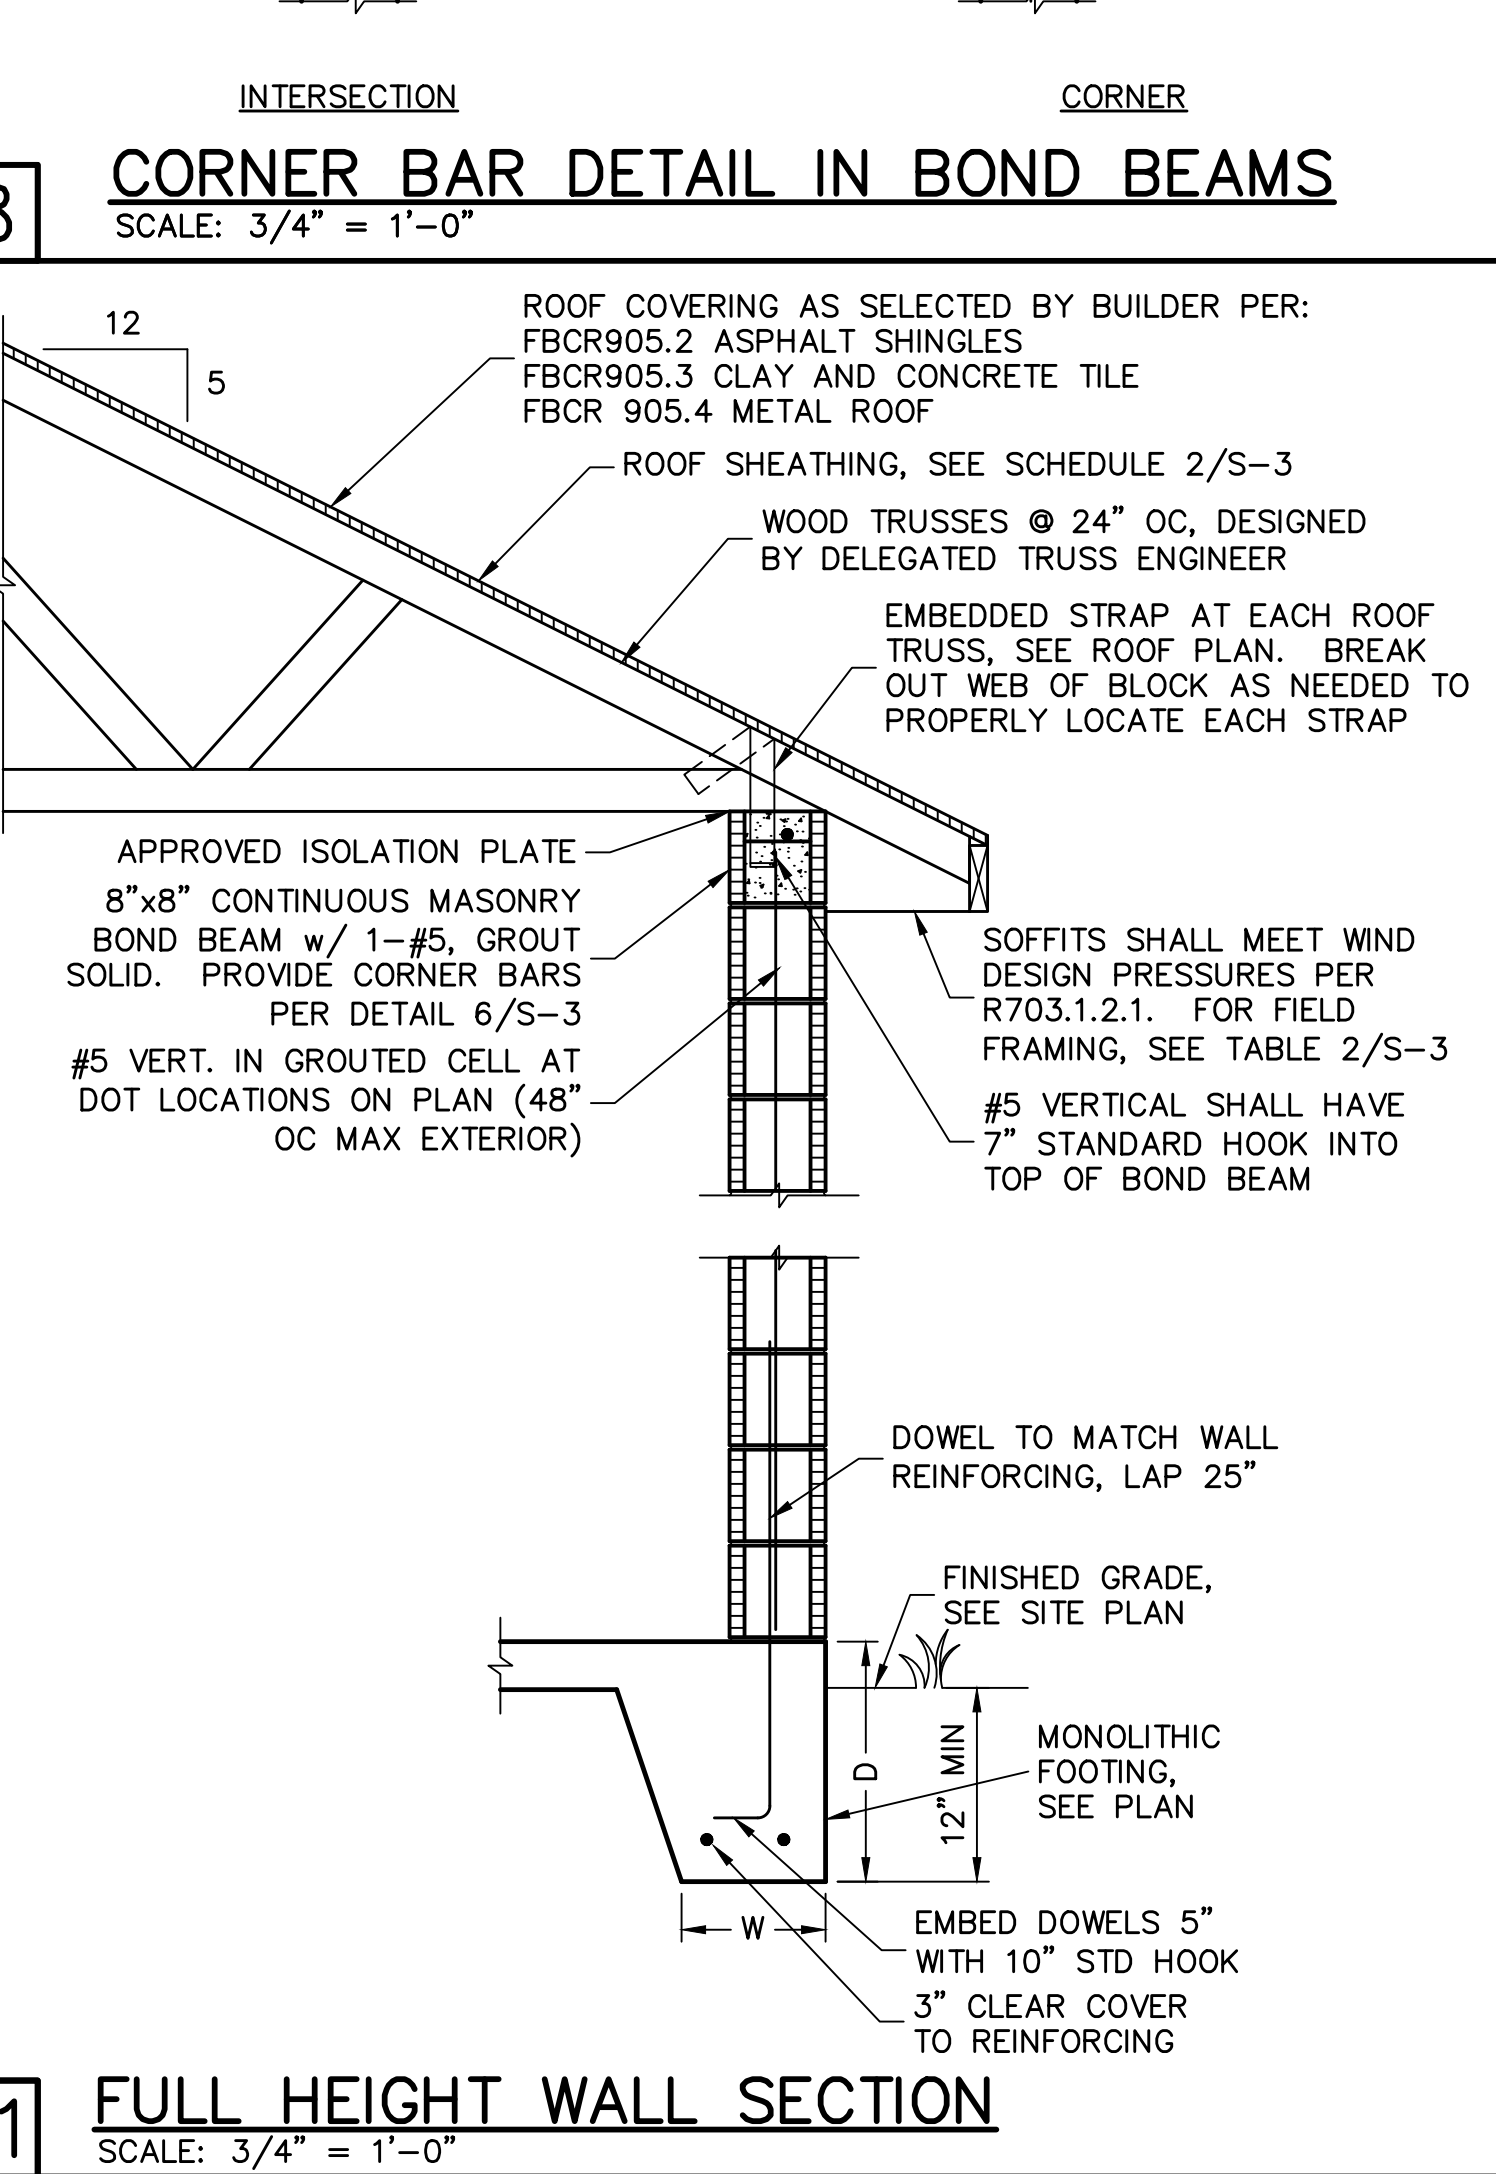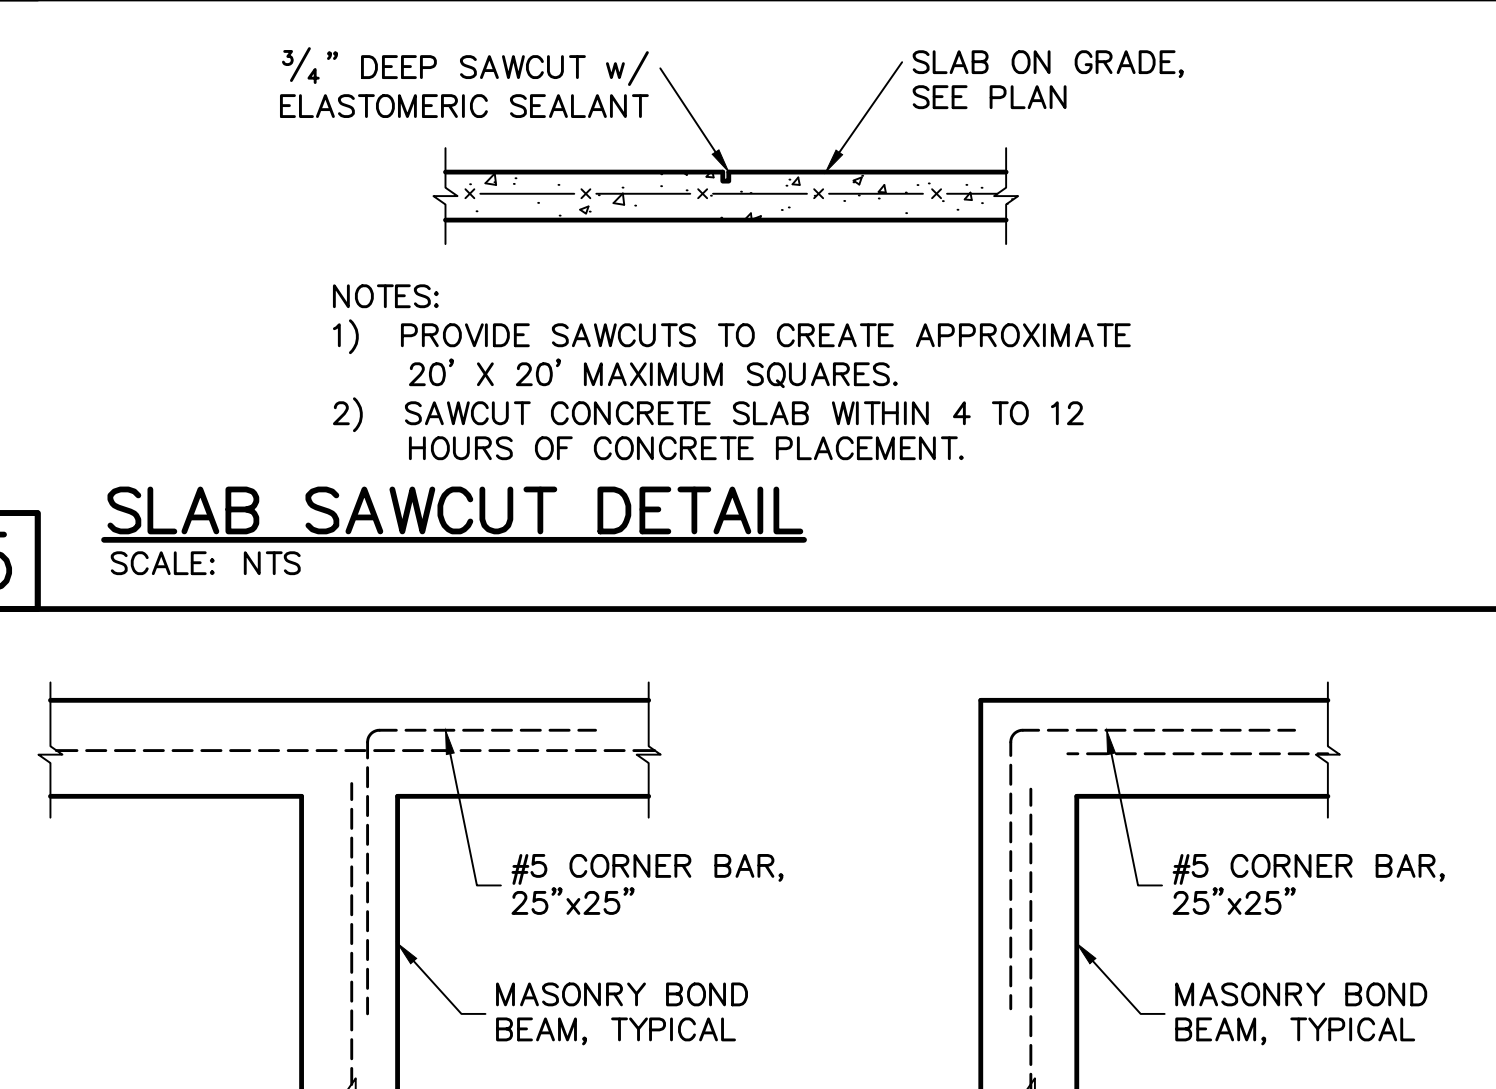

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6TH EDITION (2017) RESIDENTIAL

REV 1 - REVISED MODEL TO ADD LANAI AND CHANGED FROM USP STRAPPING TO SIMPSON STRONG TIE STRAPPING

1. FLOOR & ROOF UNIFORM LOADS:
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TOLL)
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF
DEFLECTION CRITERIA:
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER: ASCE7-10
BASIC WIND SPEED (ASCE7-10) 160 MPH
NOMINAL WIND SPEED (Vasd TABLE R301.2.1.3) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS, ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH.
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3"
SLAB ON GRADE CENTERED
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3
GRADE 60 FOR #4 TO #11
WELDED WIRE FABRIC - ASTM A185
SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS, NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.
FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER ACI 530-13
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI
REINFORCING STEEL - ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS
SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION, FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

At Exterior Stud Walls and Gable Ends with Wall Sheathing, apply plaster over metal lath over water resistive barrier as follows:
Plaster R703.7.2: 3-coat 7/8" thick portland cement based plaster per ASTM C926.
Metal Lath R703.7.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C847, G60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gage nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gage staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).
Water Resistive Barrier (WRB) R703.7.3: Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the first layer).

REVISIONS BY

02/11/20 DWB

STRUCTURAL ENGINEERING:

STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6TH EDITION (2017) RESIDENTIAL

DELEGATED TRUSS ENGINEER

D.R. HOHON, P.E.
America's Builder

STRUCTURAL DETAILS
MODEL 1499 A
1013 ALLMAN AVENUE
LEHIGH ACRES, FLORIDA
LOT: 20 SUBDIVISION: LEHIGH SPOT LOTS

DESIGN/DRAWN DWB/DWB
CHECKED DWB
DATE 02/11/20
SCALE VARIES
JOB NO. DR11087
SHEET

S-3
SHEET 3 OF 3