



JOB No.	MASTER
DATE DRAWN	1/4/2019
DATE PRINTED	2/22/2019






GENERAL TRUSS ENGINEERING CRITERIA & DESIGN LOADS	
DESIGN CODE	FBC2017/TP12014
WIND CODE	MWFRS (Directional)/C-C HYBRID WIND ASCE 7-10
WIND LOAD	160 MPH
EXPOSURE CATEGORY	C
OCCUPANCY CATEGORY	II
IMPORTANCE FACTOR	1.0
WIND DURATION FACTOR	1.60
OPENING CONDITIONS	ENCLOSED
TRUSSES HAVE BEEN DESIGNED FOR A 10.0 PSF BOTTOM CHORD LIVE LOAD NONCONCURRENT WITH ANY OTHER LIVE LOADS	
TRUSS LOADING	ROOF
TCLL	20 PSF
TCDL	20 PSF
BCLL	0 PSF
BCDL	10 PSF
TOTAL	50 PSF
DURATION	1.25
TCDL / TO RESIST UPLIFT	5 PSF
BCDL / TO RESIST UPLIFT	5 PSF

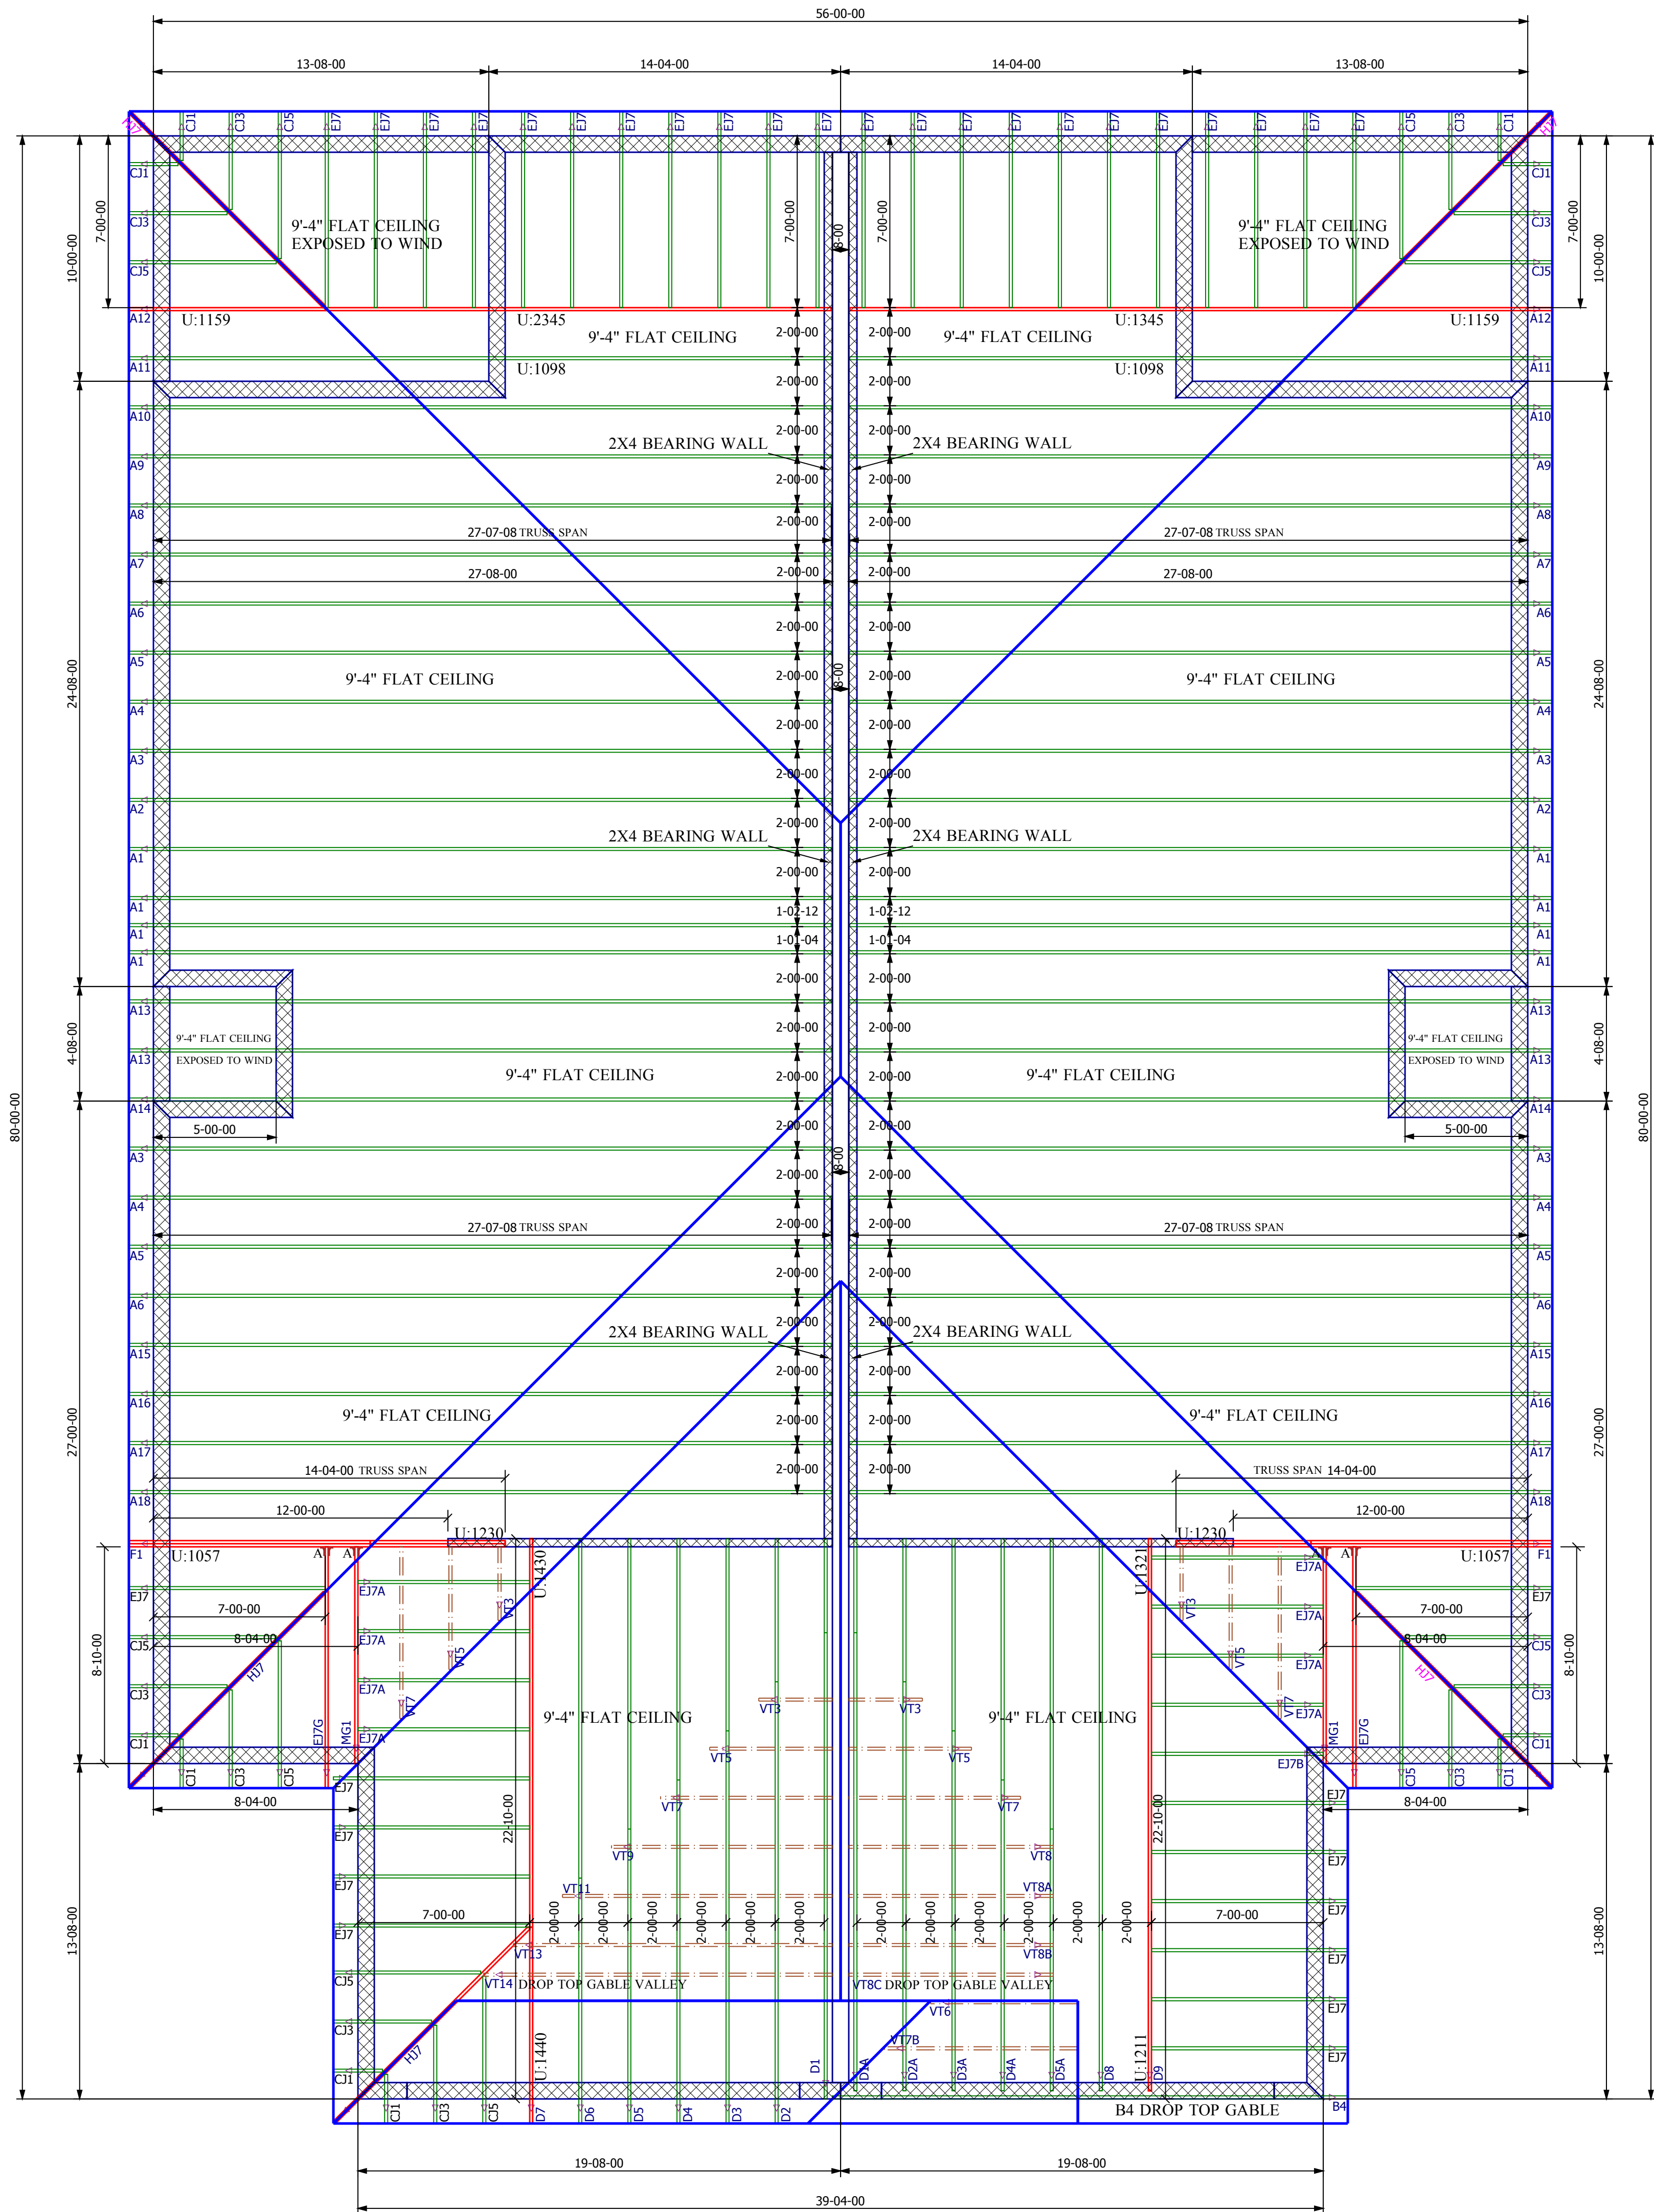

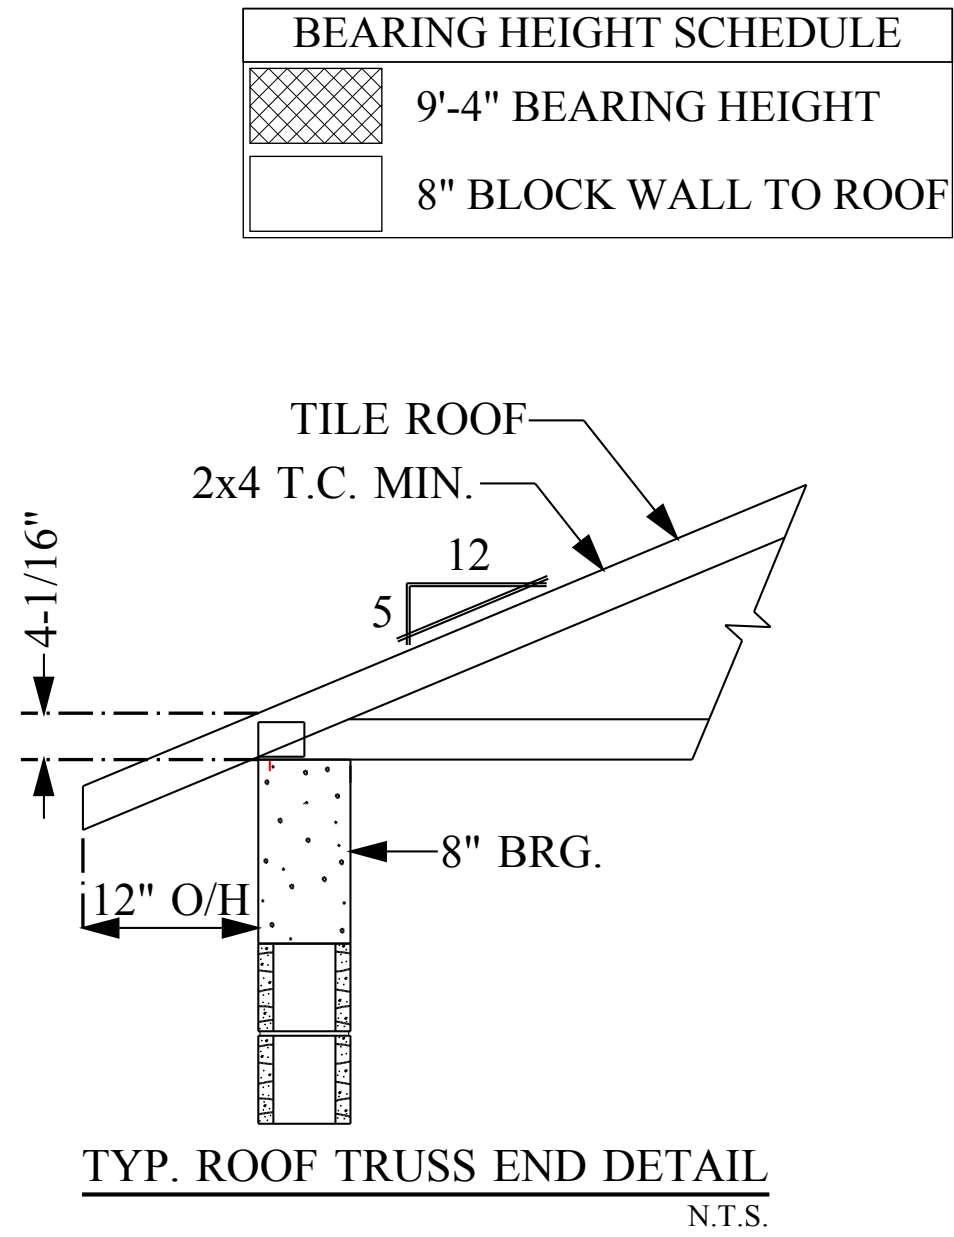
<p>CAUTION!!!</p> <p>DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DRAWINGS AND BSCI-B1 SUMMARY SHEETS.</p> <p>ALL PERMANENT BRACING MUST BE IN PLACE PRIOR TO LOADING TRUSSES. (ie. SHEATHING, SHINGLES, ETC.)</p> <p>ALL INTERIOR BEARING WALLS MUST BE IN PLACE PRIOR TO INSTALLING TRUSSES.</p> <p>REFER TO FINAL ENGINEERING SHEETS FOR THE FOLLOWING.</p> <ol style="list-style-type: none"> 1) NUMBER OF GIRDER PLIES AND NAILING SCHEDULE. 2) BEARING BLOCK REQUIREMENTS. 3) SCAB DETAILS (IF REQUIRED) 4) UPLIFT AND GRAVITY REACTIONS.
<p>WARNING</p> <p>BACK CHARGES WILL NOT BE ACCEPTED REGARDLESS OF FAULT WITHOUT PRIOR NOTIFICATION BY CUSTOMER WITHIN 48 HOURS AND INVESTIGATION BY Builders First Source. NO EXCEPTIONS.</p>
<p>THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL CONNECTIONS OTHER THAN TRUSS TO TRUSS, GABLE SHEAR WALL, AND CONNECTIONS. TEMPORARY AND PERMANENT BRACING, AND CEILING AND ROOF DIAPHRAM CONNECTIONS.</p>

ROOF PITCH	5/12
CEILING PITCH	FLAT
TOP CHORD SIZE	2 x 4 MIN.
BOTTOM CHORD SIZE	2 x 4 MIN.
OVERHANG LENGTH	12"
CANTILEVER	N/A
END CUT	PLUMB
FLOOR TRUSS SPACING	N/A
ROOF TRUSS SPACING	24"






USP ROOF AND FLOOR TRUSS HANGER SCHEDULE							
ID	QTY/RF	QTY/FL	MODEL	FLOOR	ROOF	UPLIFT	SYMBOL
A*	0	0	JUS24	725	895	490	 A*
A	4	0	THD26	2940	3200 / 3600	1250 / 1555	 A
B	0	0	THD28	3820	3895 / 4680	1235 / 2140	 B
C	0	0	THD26-2	2940	3600	1515 / 2175	C
D	0	0	THD28-2	3820	4310 / 4680	1530 / 3485	D
E	0	0	THDH26-2	4355	5320	2155	E
F	0	0	THDH28-2	7460	7460	3235	F
G	0	0	THDH26-3	4355	5230	2155	G
H	0	0	THDH28-3	7460	7460	3235	H
I	0	0	THDH16710	9100	9100	4095	I
J	0	0		865	1055	765	J
K	0	0		865	1055	765	K
L	0	0		1440	1760	1250	L
M	0	0		1440	1760	1250	M
N	0	0		2680	3265	960	N
O	0	0	HJC26	2385	2980	1840	O
P	N/A	0	THD46	2790	3410	1550	P
Q	N/A	0	MSH422	2245	2245	1855	Q
R	N/A	0	MSH422IF	2245	2245	1855	R
S	N/A	0	MSH426	2435	2435	1855	S








NOTE: UPLIFT VALUE FOR THA422, THA422, THA426 HANGERS APPLY ONLY TO FACE MOUNT INSTALTION

(1) PLY	(1) PLY	(2) PLY	(3) PLY	CORNER HIP	CORNER HIP	(1) PLY FLR. TRUSS	(1) PLY FLR. TRUSS
 JUS24	 THD26, THD28	 THD26-2, THD28-2 THD26-3, THD28-3	 THD26-3, THD28-3 SIMILAR	 THD26	 THD26	 THD46	 MSH422, MSH426 MSH422IF SIMILAR

- NOTES:**
- 1) ALL DIMENSIONS ARE FEET-INCHES-SIXTEENTHS.
 - 2) DO NOT CUT OR ALTER TRUSSES IN ANY WAY.
 - 3) ALL REACTIONS ARE UNDER 5000 LBS. UNLESS NOTE OTHERWISE.
 - 4) ALL UPLIFTS ARE UNDER 1000 LBS. UNLESS NOTED OTHERWISE.
 - 5) FRAMING REQUIRED BELOW TRUSSES TO GET DESIRED CEILING CONDITIONS.
 - 6) ONLY TRUSS TO TRUSS CONNECTIONS SUPPLIED W/ TRUSS PACKAGE.

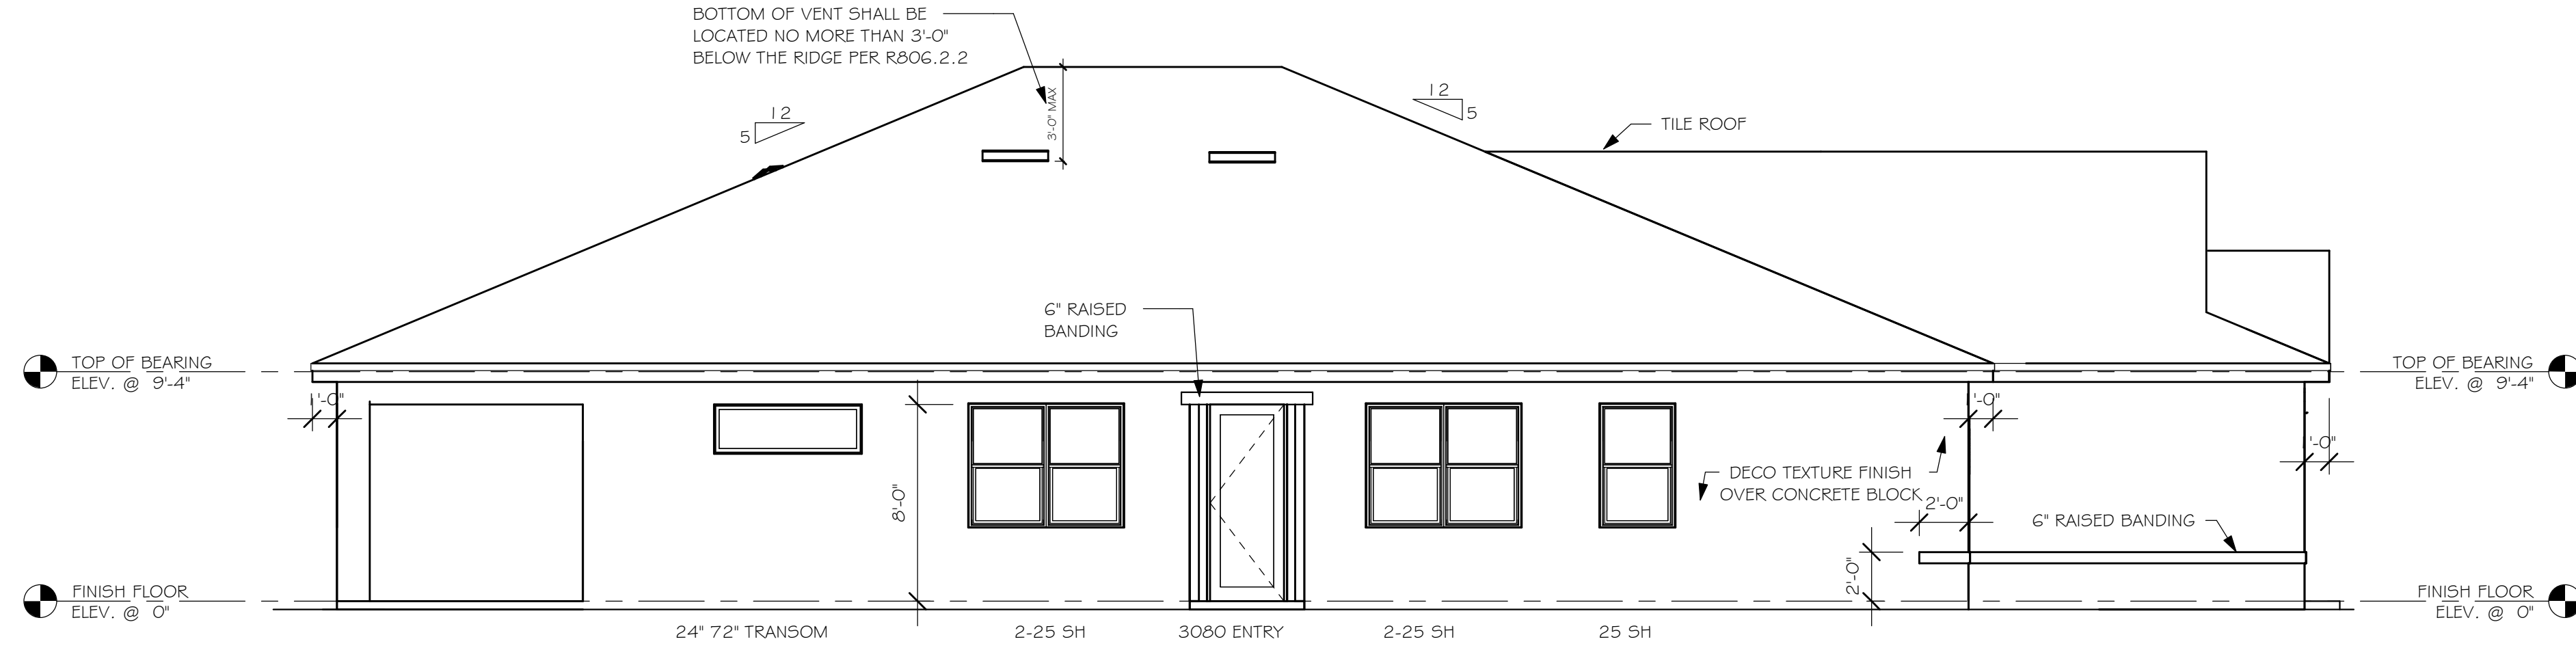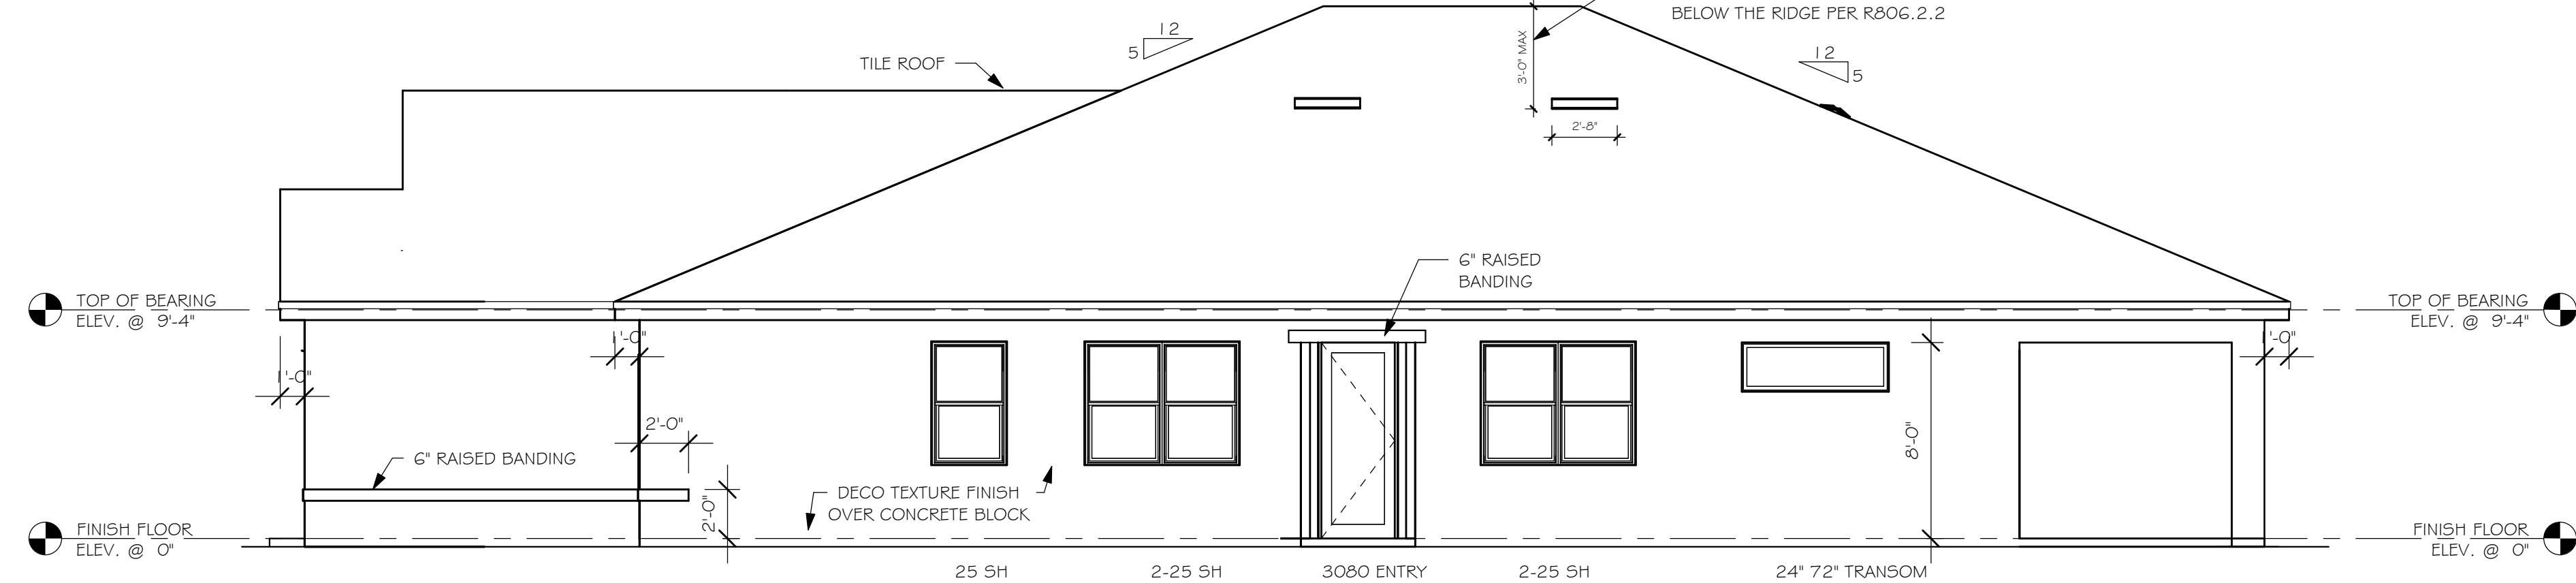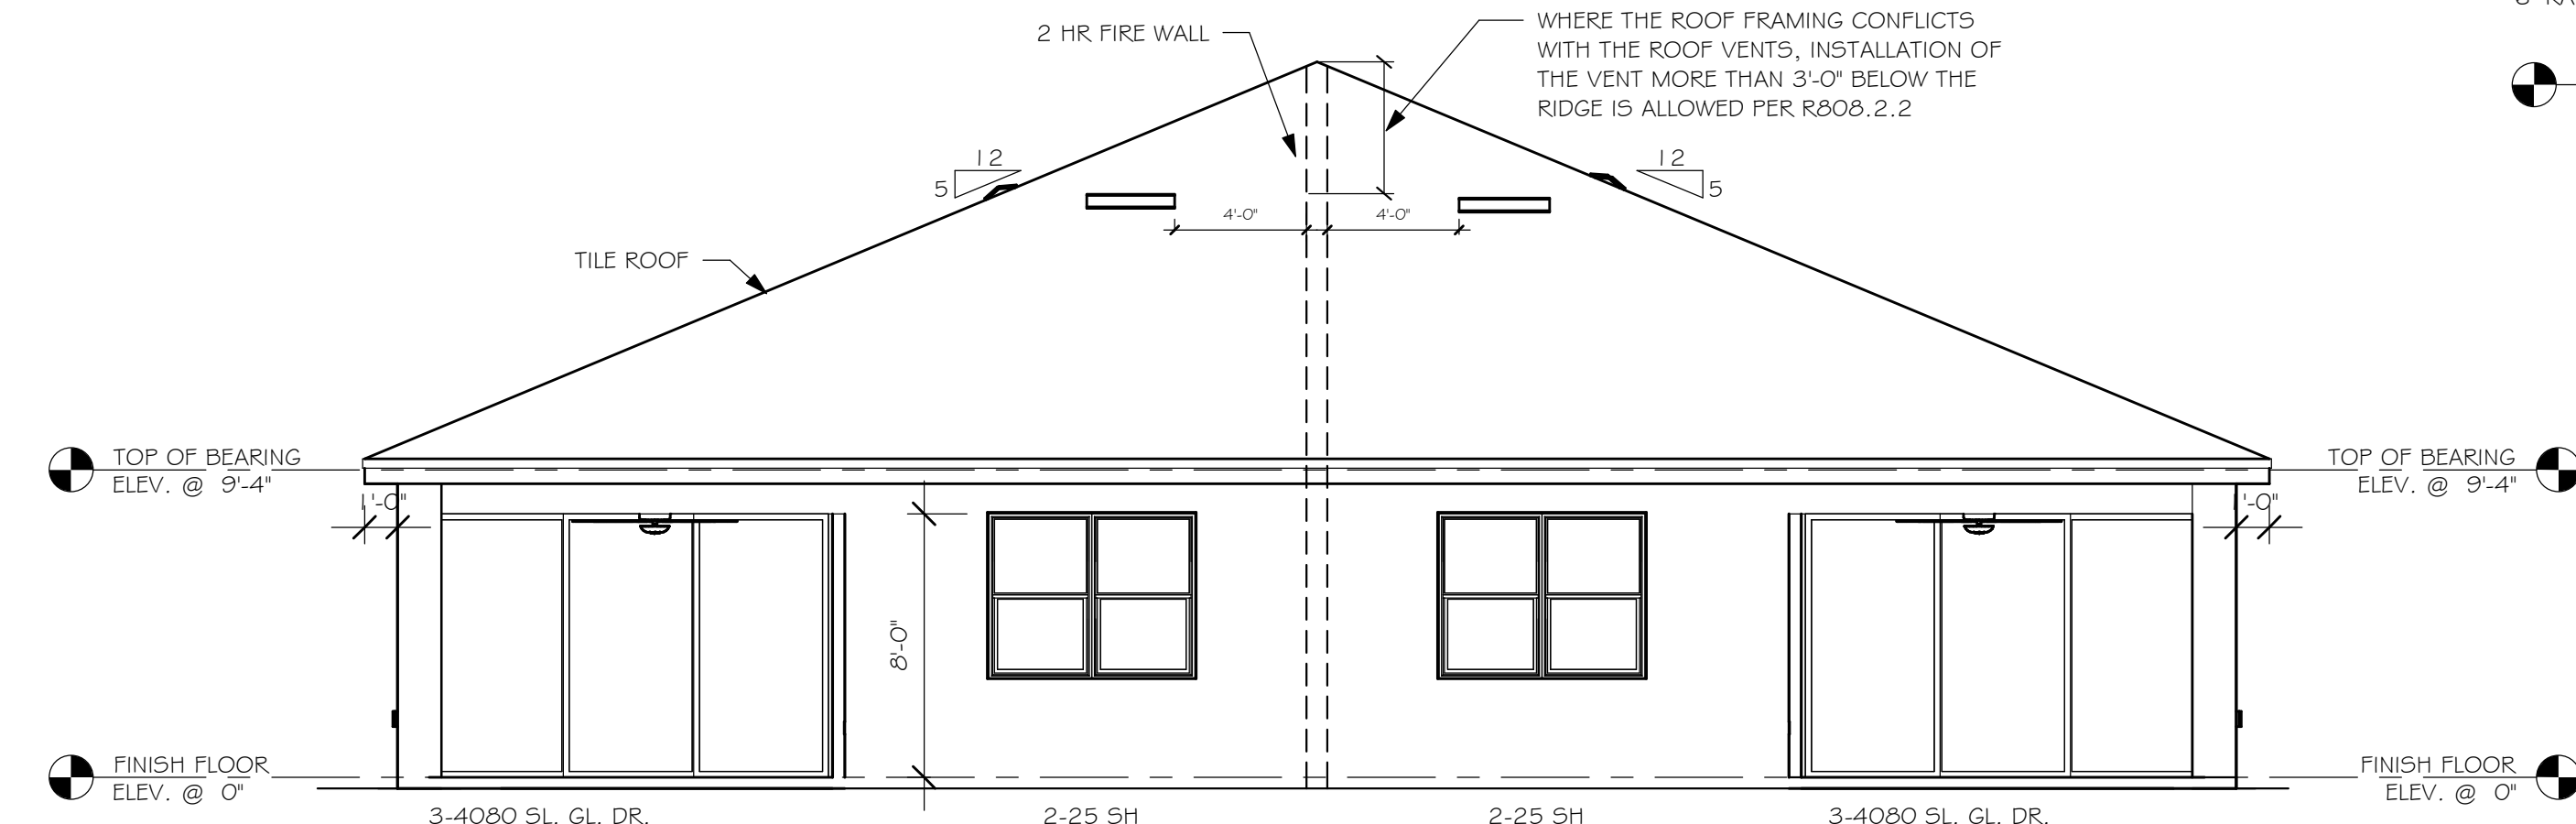

LEFT ELEVATION
3/16" = 1'-0"

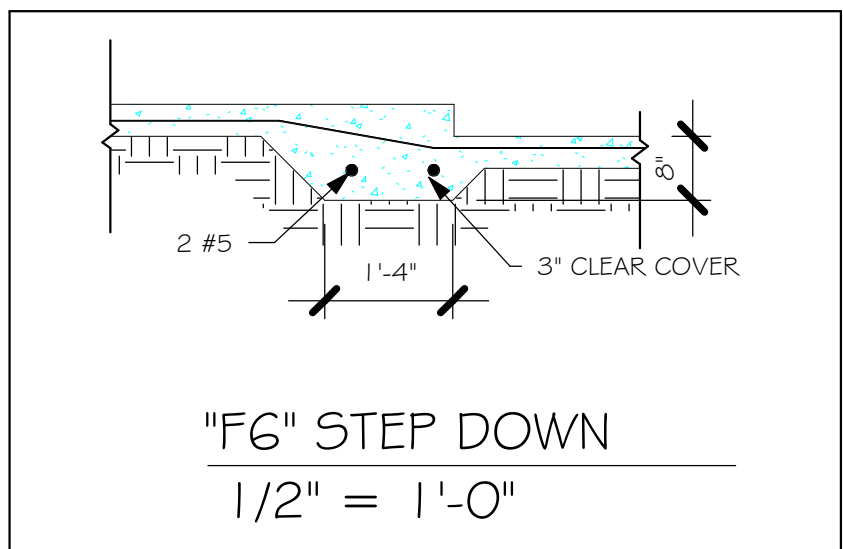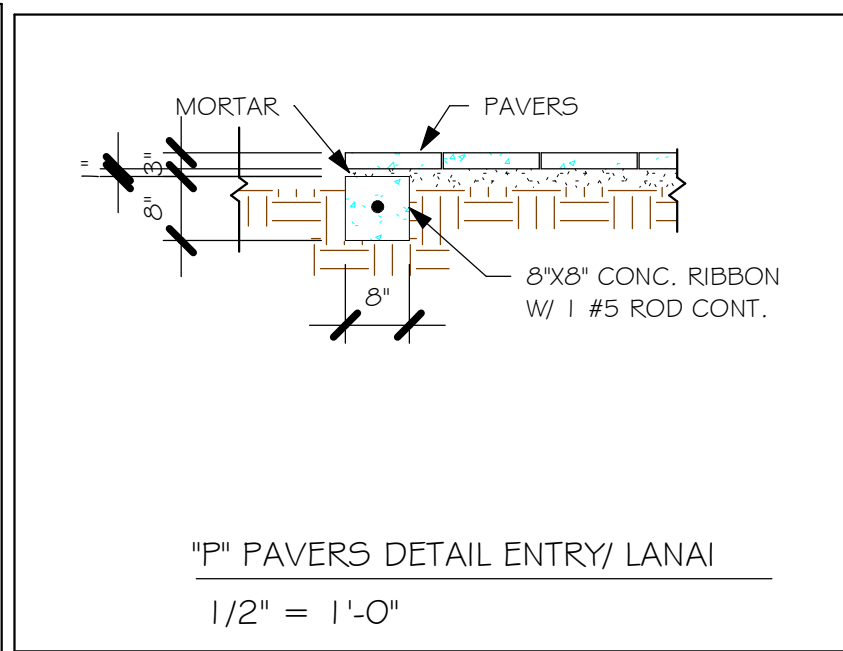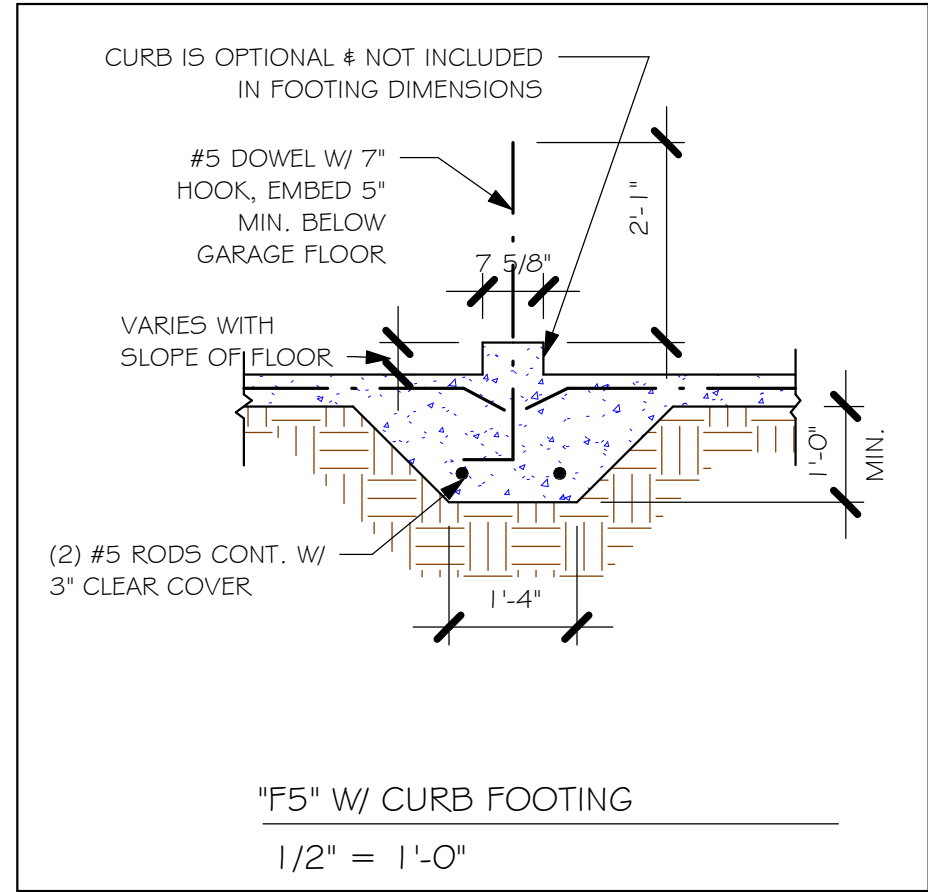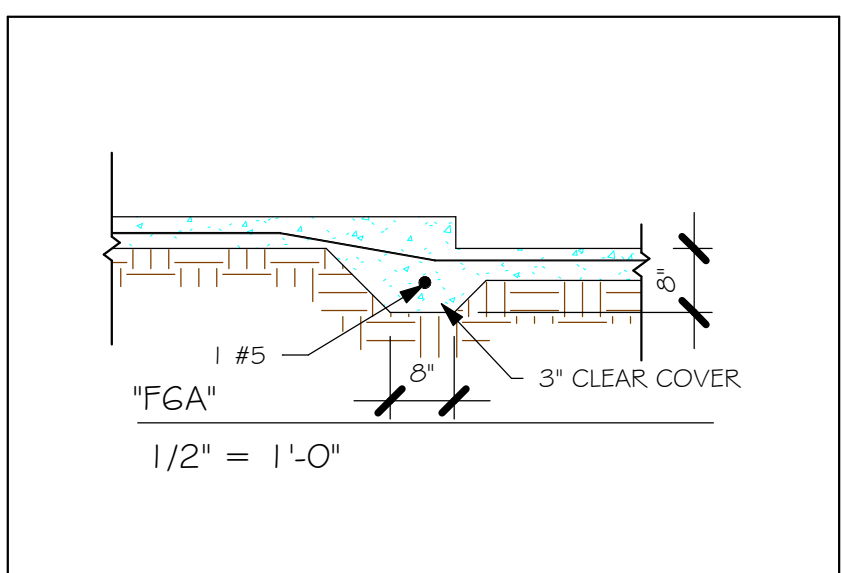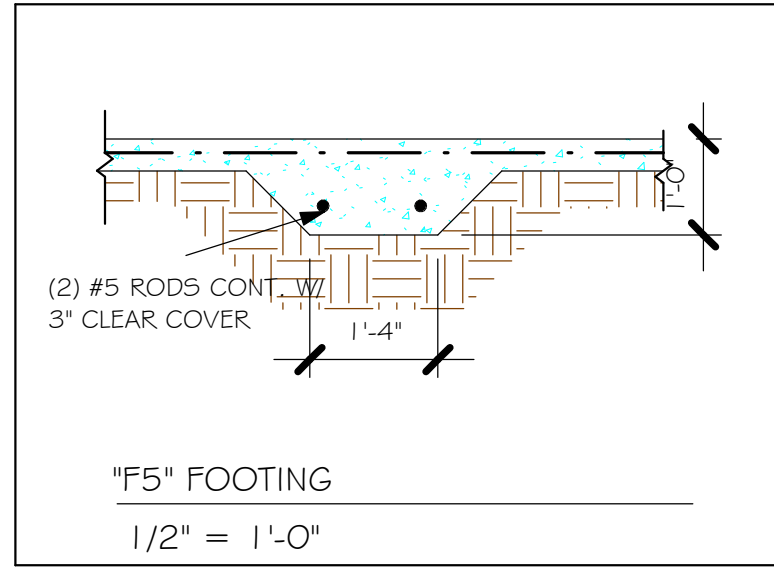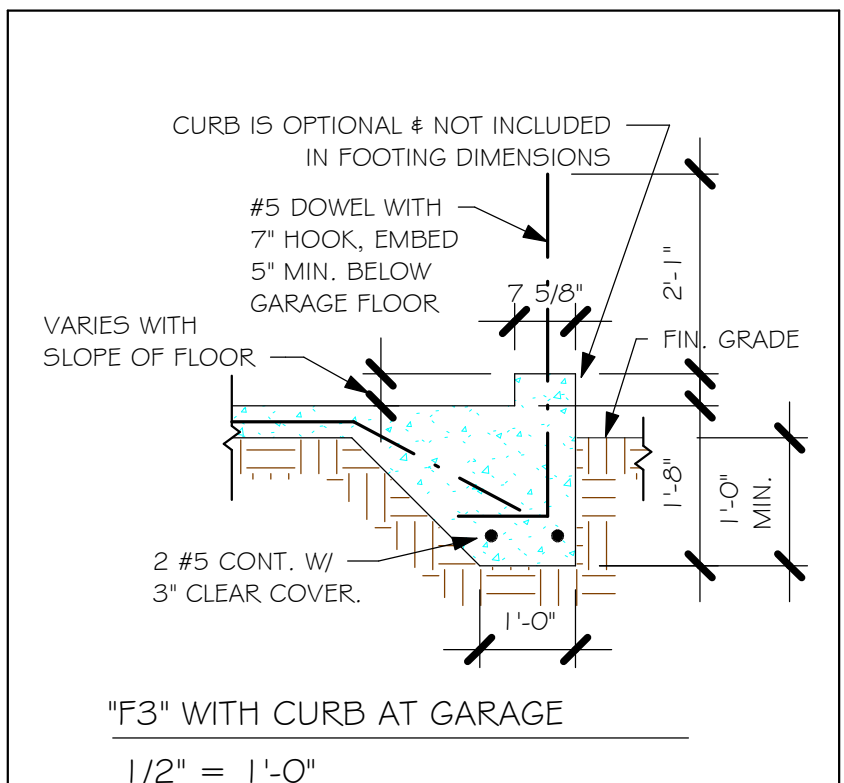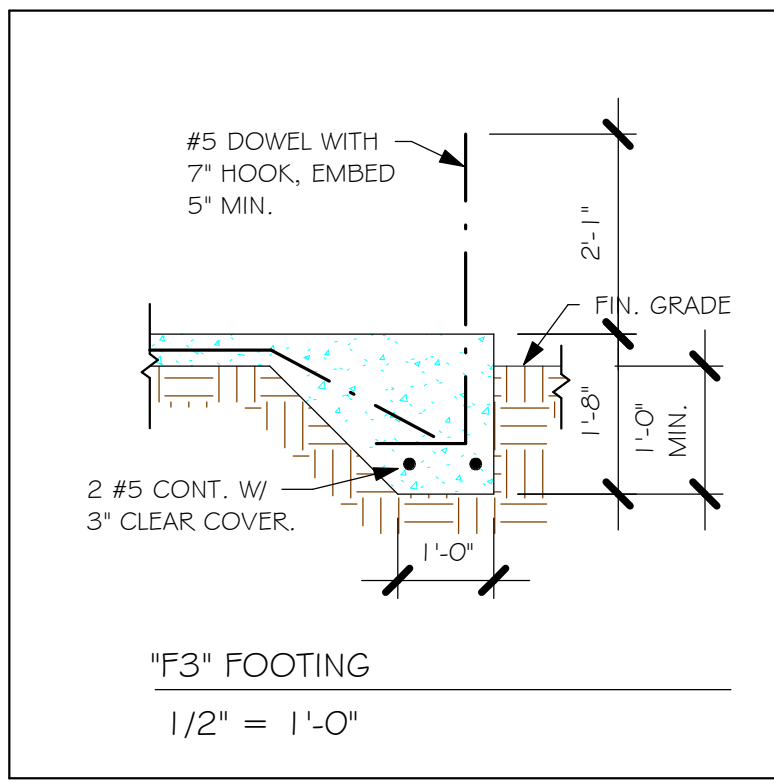

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
X	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
X	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
X	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
X	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
X	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

USED	WALL FOOTING SCHEDULE					
	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
X	F1	CONT.	1'-4"	0'-8"	2-#5	
X	F2	CONT.	1'-8"	0'-10"	2-#5	
X	F3	CONT.	1'-0"	1'-8"	2-#5	
X	F4	CONT.	1'-4"	1'-8"	2-#5	
X	F5	CONT.	1'-4"	1'-0"	2-#5	
X	F6	CONT.	1'-4"	1'-0"	2-#5	
X	F6A	CONT.	0'-8"	0'-8"	1-#5	
X	TE	CONT.	0'-8"	0'-8"	1-#5	


PROVIDE CORNER BARS PER 6/S-1

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"

PLAN NOTES:

- TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
- "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- "#5" DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/DOORS PER DETAIL 7/S-1.

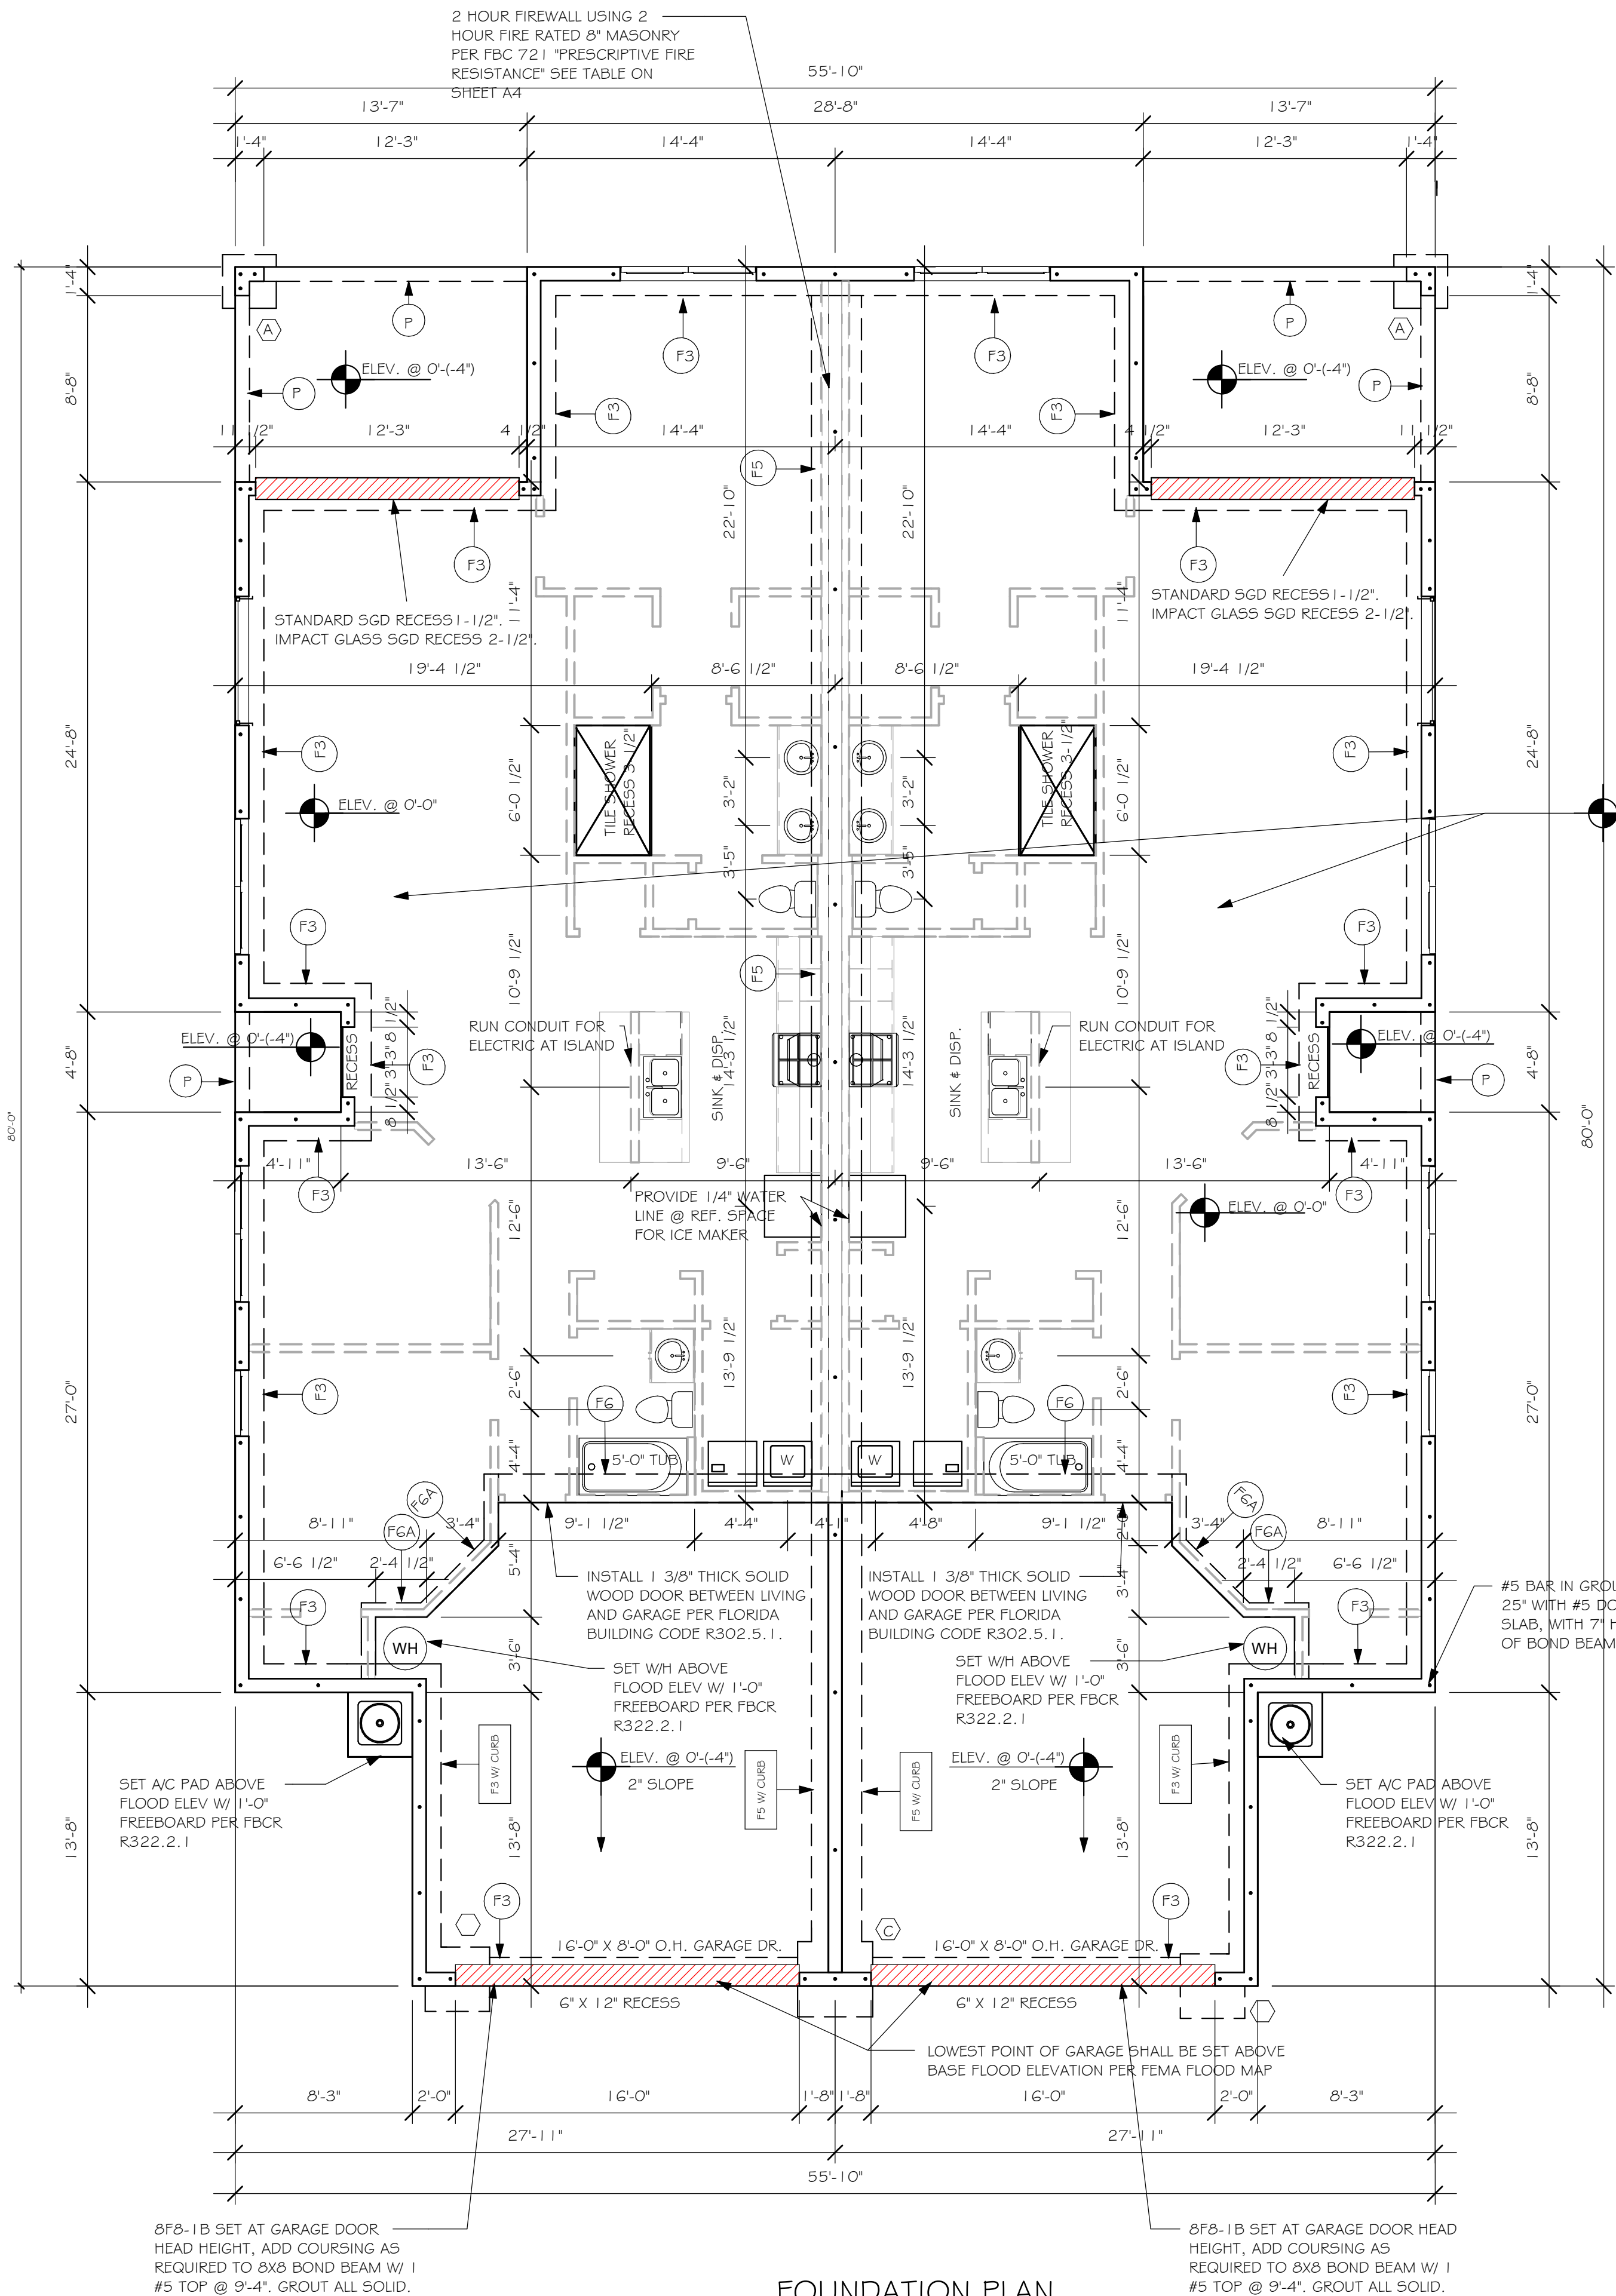

FOUNDATION PLAN
3/16" = 1'-0"

THE FINISH FLOOR SLAB SHALL BE SET ABOVE BASE FLOOD ELEVATION PER FEMA FLOOD MAP PLUS 1'-0" FREEBOARD PER FBCR R322.2.1. SEE SITE PLAN BY OTHERS

PROVIDE TERMITE TREATMENT WITH "BORA CARE"

K:\1-MASTER 2019\2019-BUILDERS\DR Horton\2019SUBDIVISIONS\WEST VILLAGES
TV\5\11301\1301\133-134 1526 AREVITY\1301 1526 AR.vcf

DOOR SCHEDULE							
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
1	16080 OHGD	GARAGE DOOR	8'-0"	16'-0"	+28.2/-31.5	+28.2/-31.5	2
2	3080 ENTRY	DISTINCTION	8'-0"	3'-0"	+33.5/-36.3	+33.5/-44.8	2
3	(3)-4080 SL. GL. DR.	DISTINCTION	8'-0"	12'-0"	+29.4/-33.3	+29.4/-33.3	2

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE C, AND
CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING
0.6W LOAD FACTOR. V_{asd} = 124 MPH

GARAGE DOOR ASSUMES 2' IN ZONE 5.


WINDOW SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
A	25 SH		5'-3"	3'-2"	+33.5/-36.3	+33.5/-44.8	2
B	2-25 SH		5'-3"	6'-4"	+33.5/-36.3	+33.5/-44.8	6
C	24'X72" FIXED GLASS		2'-0"	6'-0"	+33.5/-36.3	+33.5/-44.8	2

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE C, AND
CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING
0.6W LOAD FACTOR. V_{asd} = 124 MPH

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

PLAN NOTES	
1)	VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
2)	PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
3)	PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
4)	NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
5)	PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
6)	KITCHEN KNIEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
7)	INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
8)	WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
9)	THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARTION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
10)	INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.5.1.
11)	ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PRVENTION DEVICE
12)	ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
13)	ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE


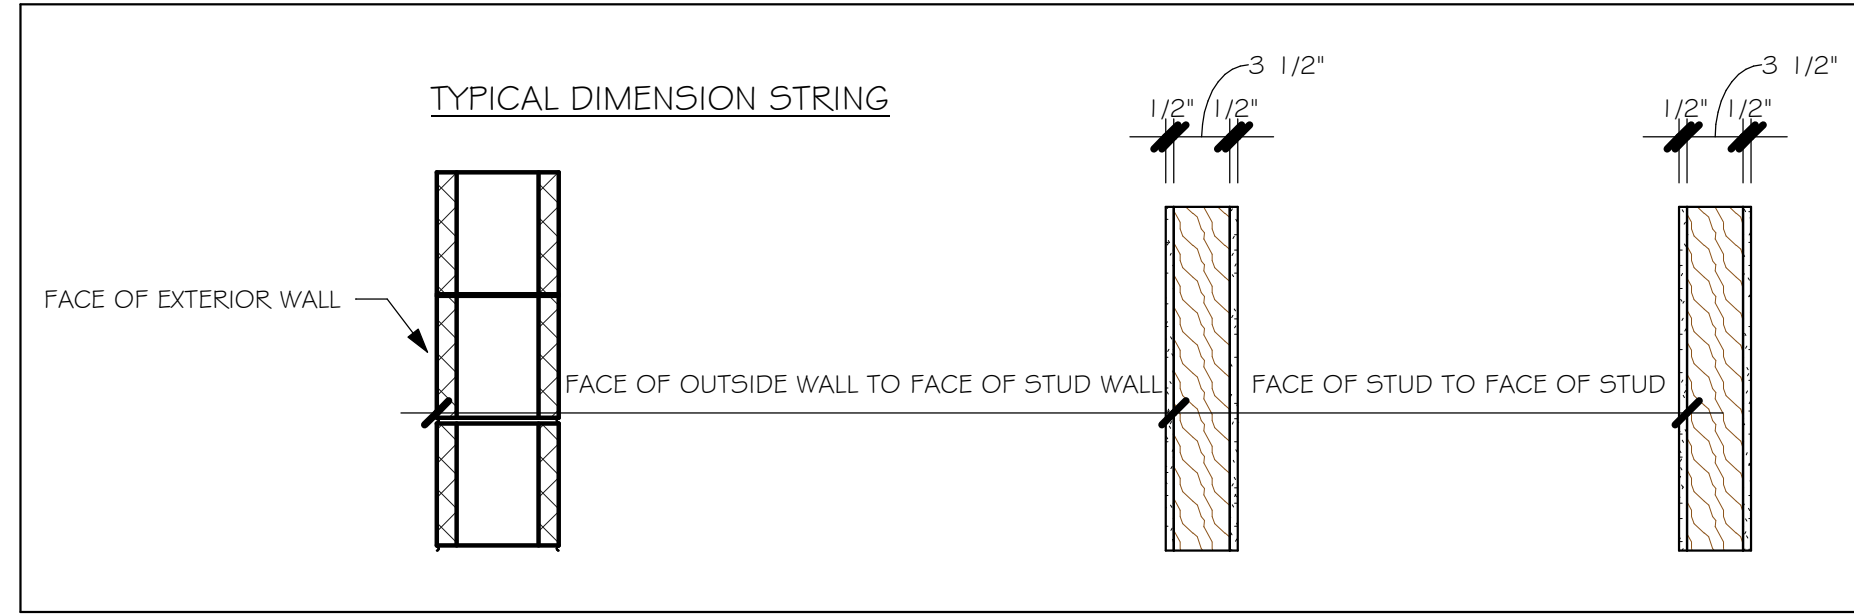


INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	
4	2'-4"	B.P. = BI-PASS DOOR
5	2'-0"	
6	1'-8"	L.V. = LOUVERED DOOR
7	1'-6"	
8	2'-1 1/4"	

SQUARE FOOTAGE UNIT 1	
LIVING AREA	1,513
GARAGE AREA	433
LANAI AREA	146
FRONT PORCH/ ENTRY AREA	29
TOTAL SQUARE FOOTAGE	2,121

SQUARE FOOTAGE UNIT 2	
LIVING AREA	1,513
GARAGE AREA	433
LANAI AREA	146
FRONT PORCH/ ENTRY AREA	29
TOTAL SQUARE FOOTAGE	2,121

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

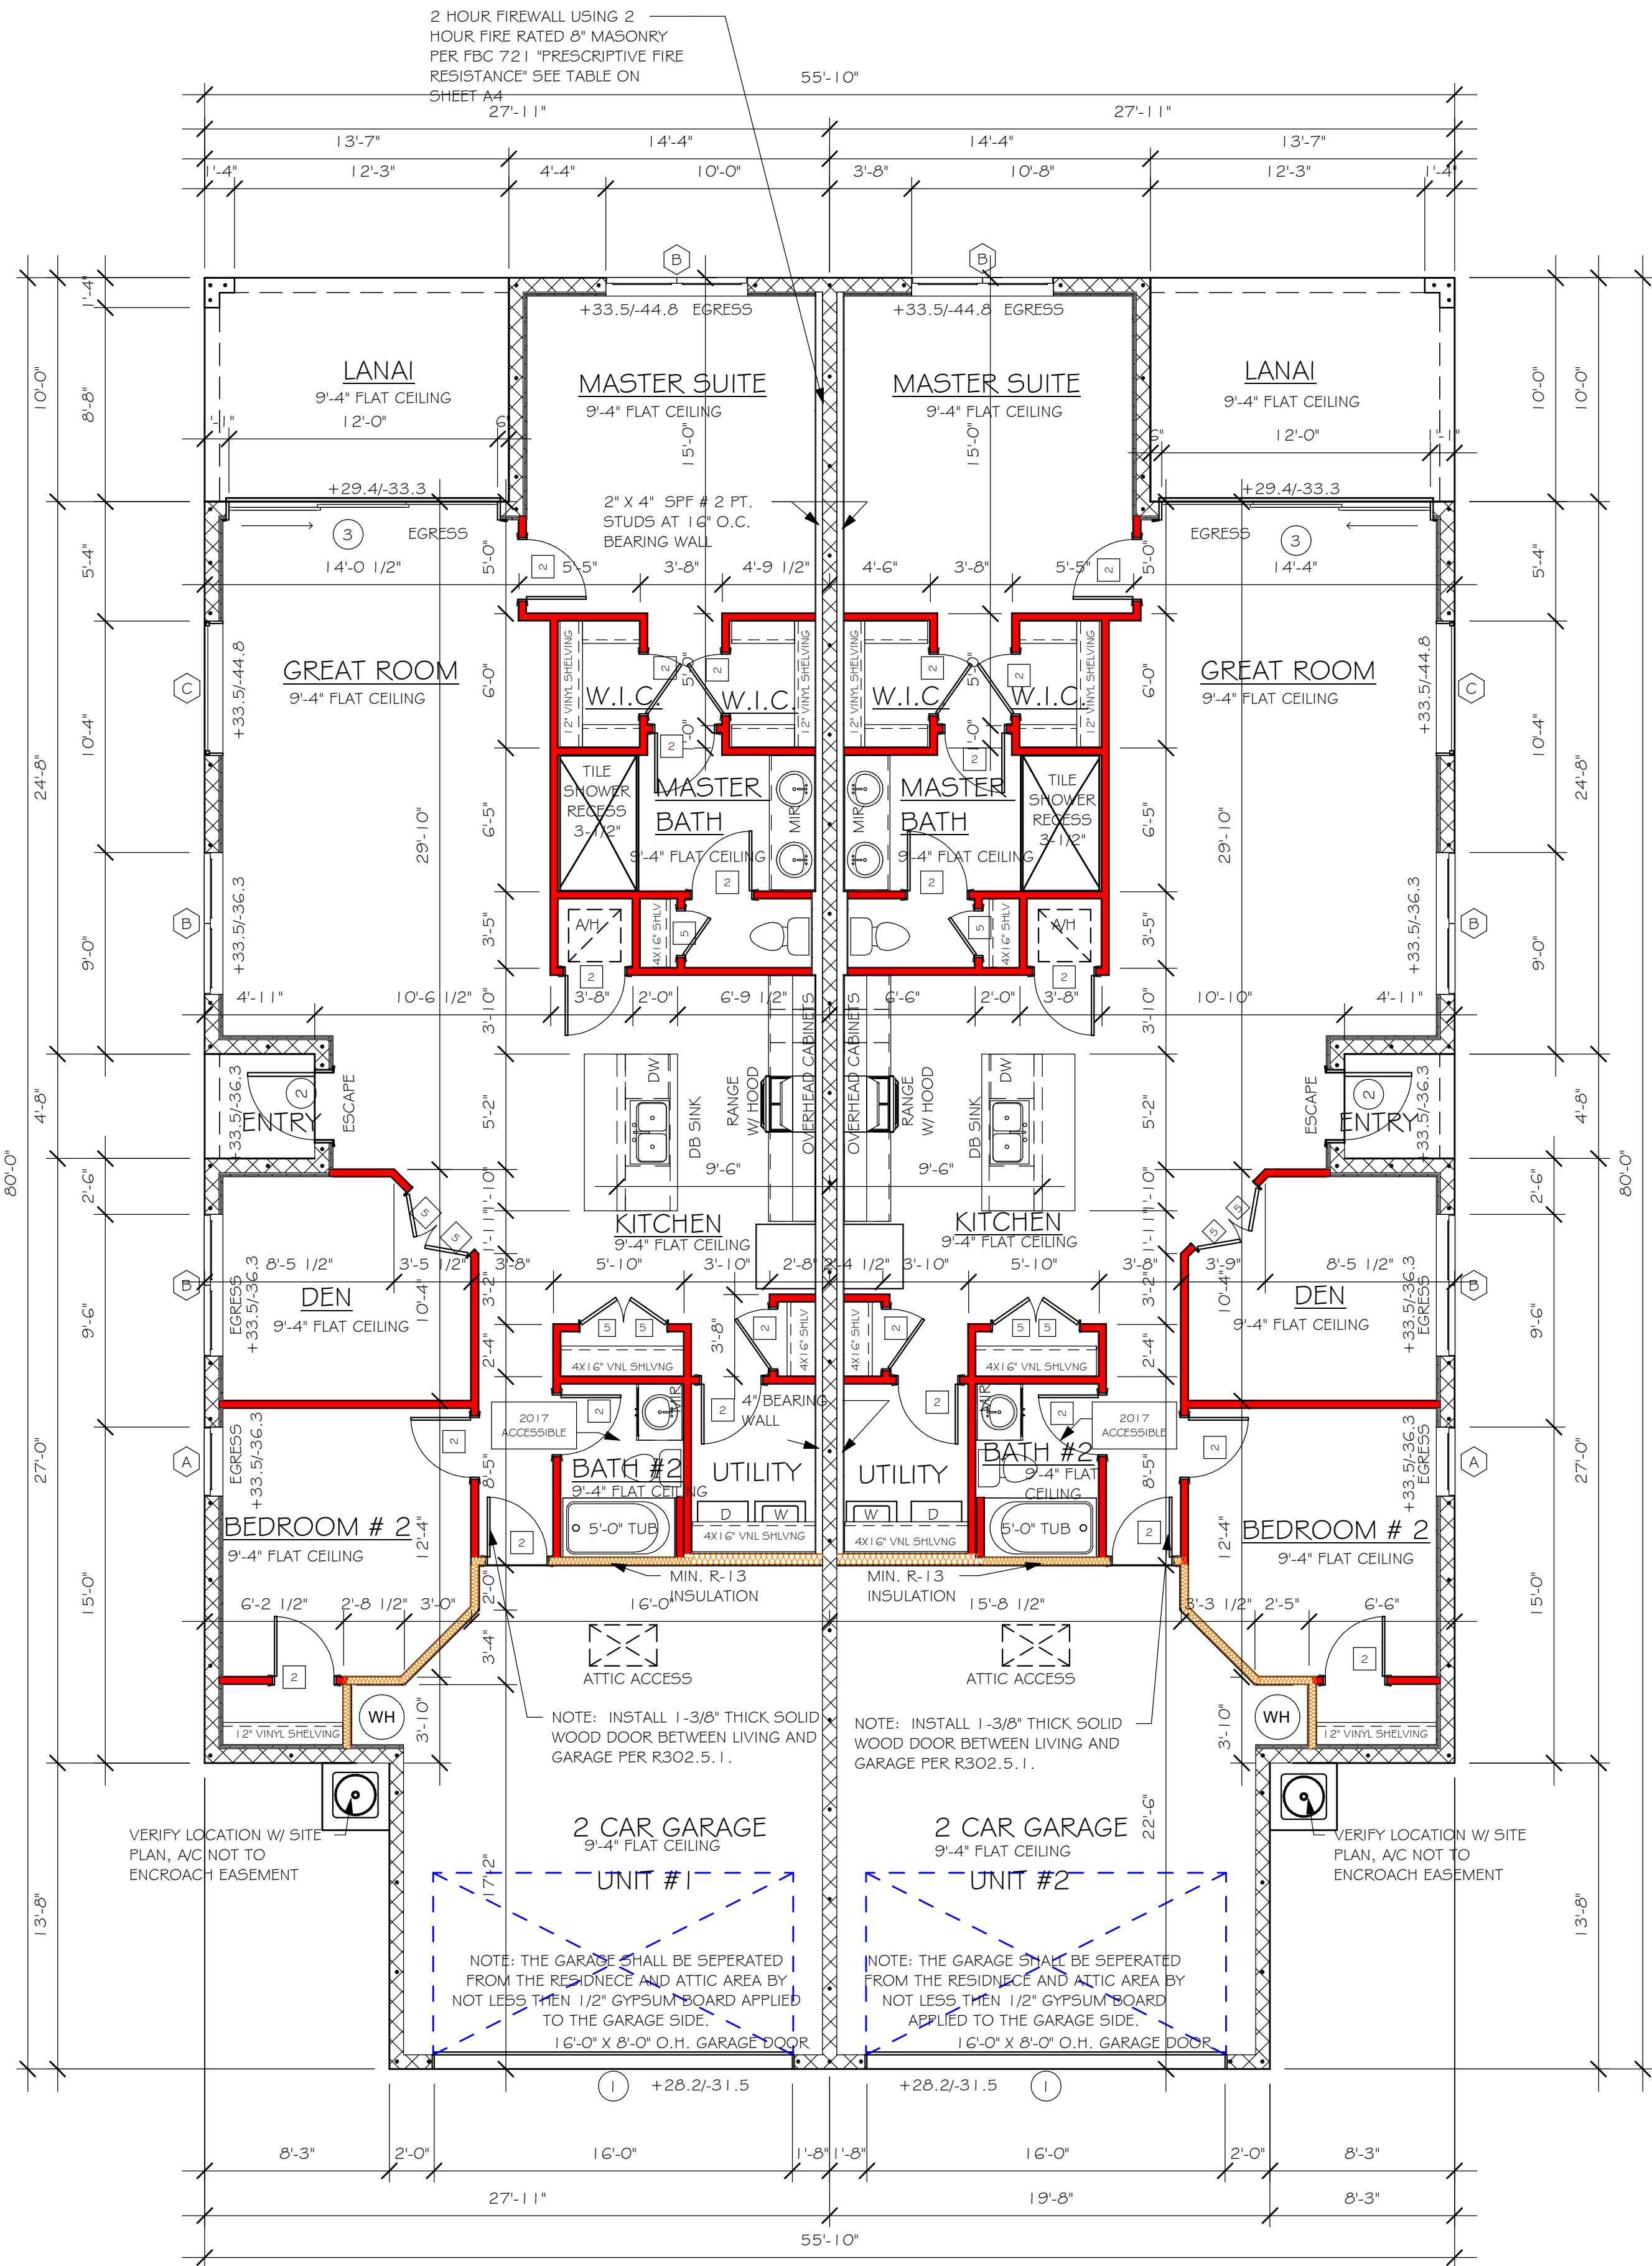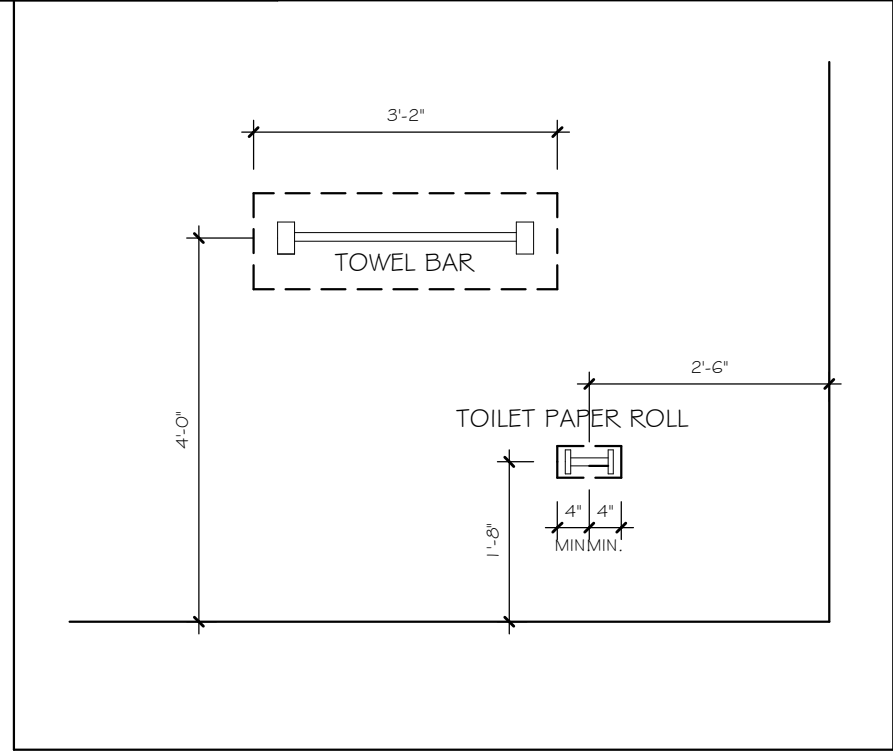

FLOOR PLAN

3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
1615	(1) HTA1 G-1B	10-10dX1 1/2", EMBED 4"
1870	(1) HTA20	10-10dX1 1/2", EMBED 4"
2430 (1 PLY)	(2) HTA1 G-1B	10-10dX1 1/2", EMBED 4"
2800 (2 PLY)	(2) HTA1 G-1B	10-10dX1 1/2", EMBED 4"
3170 (2 PLY)	(2) HTA20	10-10dX1 1/2", EMBED 4"
5005	HTTA45	5/8" ATR, EPOXY 12"

NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON CL OF WALL.
- CONNECTORS ARE USP STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH USP PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
- WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/S-1.
- *ATR = ALLTHREAD, DRILL AND EPOXY WITH USP EPOXY PER MFR. INSTRUCTIONS.

REV2

TRUSS STRAPPING TO STUDWALL/ WOOD BEAM		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
1005	(1) MTW1 G	12-10dX1 ~ 1/2"
2010	(2) MTW1 G	12-10dX1 ~ 1/2"
3015	(3) MTW1 G	12-10dX1 ~ 1/2"
1285	(1) HTW20	24-10dX1 ~ 1/2"
2570	(2) HTW20	24-10dX1 ~ 1/2"
3855	(3) HTW20	24-10dX1 ~ 1/2"
5140	(4) HTW20	24-10dX1 ~ 1/2"

NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE. CONNECTORS ARE USP STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH USP PRINTED INSTRUCTIONS.


REV2

2 HOUR FIREWALL USING 8" MASONRY PER FBC 721 "PRESCRIPTIVE FIRE RESISTANCE"		
F.B.C. TABLE 722.3.2		
MINIMUM EQUIVALENT THICKNESS (IN) BEARING OR NON-BEARING CONCRETE MASONRY WALLS		
TYPE OF AGGREGATE	FIRE - RESISTANCE RATING (HOURS)	
1. PUMICE OR EXPANDED SLAG		2 HR
2. EXPANDED SHALE, CLAY OR SLATE		3.6"
3. LIMESTONE, CINDERS, OR UNEXPANDED SLAG		4.0"
4. CALCREOUS OR SILICEOUS GRAVEL		4.2"

FOR THE 2 HOUR FIREWALL, PURCHASE ONLY BLOCK WITH 2 HOUR FIRE RATED MARKING, LABEL OR DOCUMENTATION.


MODEL 1526 VILLA (EACH UNIT): ATTIC VENTILATION FBCR R806

COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS


			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
AREAS (SQ. FT.)			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED		
MARK	ATTIC	SOFFIT	ATTIC AREA/50	REGD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	2100.0 SQ. FT.	137.3 SQ. FT.	14.0 SQ. FT.	10.20%	8.15%	7.0 SQ. FT.	3	2.99%
"SOFFIT ONLY" DOES NOT QUALIFY						ROOF VENTS ARE REQUIRED		
			SOFFIT MODEL ACM QUAD 4, FULL VENT, NARROW PATTERN, Ø, 15% FREE AIR FLOW			ROOF VENT MODEL  LOMANCO 770-D 0.97 SQ. FT. FREE AIR		

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)



Design No. U301	Bearing Wall Rating 2 HR.	Finish Rating 66 Min.
<p>1. Nailheads - Exposed or covered with joint finisher.</p> <p>2. Joints - Exposed or covered with fiber tape and joint finisher. As an alternate, nominal 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard. Joints reinforced.</p> <p>3. Nails - 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 8d cement coated nails 2-3/8 in. long, 0.113 in. shank diam, 9/32 in. diam heads.</p> <p>4. Gypsum Board - 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 8" o.c. Outer layer attached to studs over inner layer with the 2-3/8 in. long nails spaced 8" o.c. Vertical joints located over studs. All joints in face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side.</p> <p>When used in widths other than 48 in., gypsum board to be installed horizontally. When Steel Framing Members (Item 5) are used, base layer attached to furring channels with 1 in. long Type S bugle-head steel screws spaced max. 24 in. o.c., face layer attached with 1-5/8 in. long Type S bugle-head steel screws spaced max. 12 in. o.c.</p> <p>AMERICAN GYPSUM CO. - Types AG-C, AGX-1, AGX-C.</p> <p>BEIJING NEW BUILDING MATERIALS CO LTD - Type DBX-1.</p> <p>CERTAINTED GYPSUM, INC. - Types 1, FRPC, EGRG, ProRoc Type C or ProRoc Type X.</p> <p>CERTAINTED GYPSUM CANADA, INC. - ProRoc Type C, ProRoc Type X, ProRoc Type Abuse-Resistant.</p> <p>CANADIAN GYPSUM COMPANY - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX.</p> <p>G-P GYPSUM CORP. - SUB OF</p> <p>GEORGIA-PACIFIC CORP. - Types 5, 9, C, DAP, DO, DA, DGS, DG, GPFS6.</p> <p>LA FARGE NORTH AMERICA INC. - Types LGFC-C, LGFC2, LGFC2A, LGFC3, LGFC3A, LGFC3A.</p> <p>NATIONAL GYPSUM CO. - Types FSK, FSK-C, FSK-G, FSW, FSW-3, FSW-C, FSW-G.</p> <p>PASCO GYPSUM, DIV OF</p> <p>PACIFIC COAST BUILDING PRODUCTS INC. - Types C, PG-2, PG-3, PG-3W, PG-4, PG-5, PG-5W, PG-SWS, PG-9 or PG-C.</p> <p>TEMPLE-INLAND FOREST PRODUCTS CORP. - Type TG-C.</p> <p>SIAM GYPSUM INDUSTRY (SARABURI) CO LTD - Type EX-1.</p> <p>STANDARD GYPSUM L L C - Types SGC, SG-C or SG-C.</p> <p>UNITED STATES GYPSUM CO. - Types AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX.</p> <p>USG MEXICO S A DE CV - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX.</p> <p>4A. Gypsum Board - (As an alternate to Item 4) - Nom. 3/4 in. thick, installed as described in Item 4.</p> <p>CANADIAN GYPSUM COMPANY - Types AR, IP-AR.</p> <p>UNITED STATES GYPSUM CO. - Types AR, IP-AR.</p> <p>USG MEXICO S A DE CV - Types AR, IP-AR.</p> <p>4B. Gypsum Board - (As an alternate to Items 4 and 4A) - 5/8 in. thick, 2 ft. wide, tongue and groove edge, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 4. Joint covering (Item 2) not required.</p> <p>CANADIAN GYPSUM COMPANY - Types SHX.</p> <p>UNITED STATES GYPSUM CO. - Types SHX.</p> <p>USG MEXICO S A DE CV - Types SHX.</p> <p>5. Modeled Plaster - Not shown, Optional - Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details.</p> <p>ASSOCIATED MATERIALS INC</p> <p>ALSIDE, DIV OF</p> <p>GENTER BUILDING PRODUCTS LTD</p> <p>HEARTLAND BUILDING PRODUCTS INC</p> <p>VYTEC CORP</p> <p>NEBRASKA PLASTICS INC</p> <p>6. Steel Framing Members - (Optional, Not shown) - Furring channels and resilient sound isolation clip as described below:</p> <p>A. Furring Channels - Formed of No. 25 MSG galv. steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. o.c. perpendicular to studs. Channels secured to studs as described in Item B. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 16 SWG galv. steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel.</p> <p>Wallboard attached to furring channels as described in Item 4.</p> <p>B. Steel Framing Members - Resilient sound isolation clip used to attach furring channels (Item 6A) to studs. Clips spaced 48 in. o.c. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips.</p> <p>PAC INTERNATIONAL INC - Type RSIC-1.</p> <p>*Bearing the UL Classification Mark</p>		

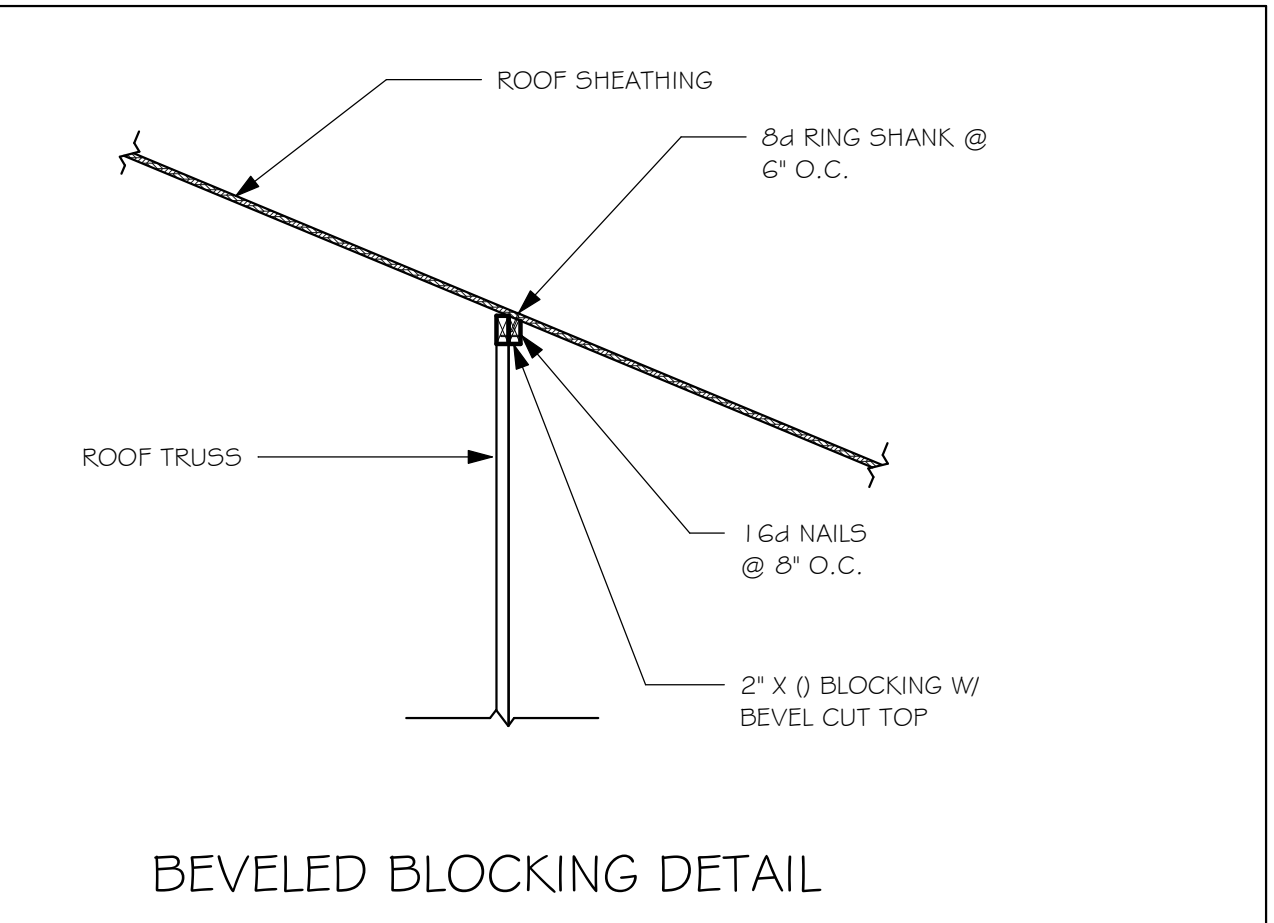

TRUSS BEARING CONDITIONS AND STRAPPING BASED ON TRUSS LAYOUT PREPARED BY BUILDERS FIRST SOURCE JOB# DATED: 01/4/19 REVISED: 02/22/19

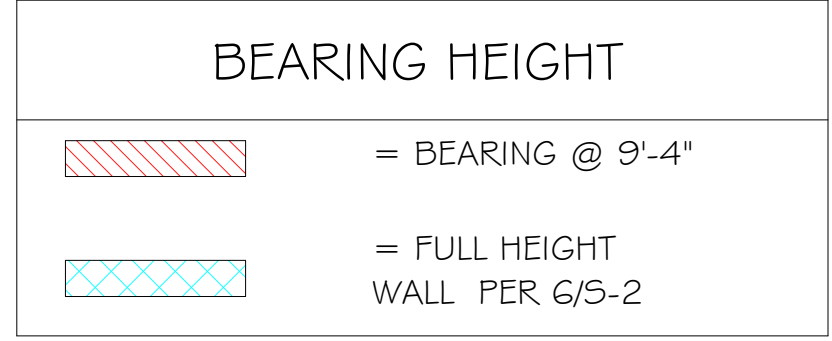

- PLAN NOTES:
- ROOF AND FLOOR TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - ROOF AND FLOOR FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-1.
 - PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - FOR NAILING OF ROOF AND FLOOR DECK, SEE 1 AND 2 ON S-1.
 - [8F8-1B] etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 11/S-1.

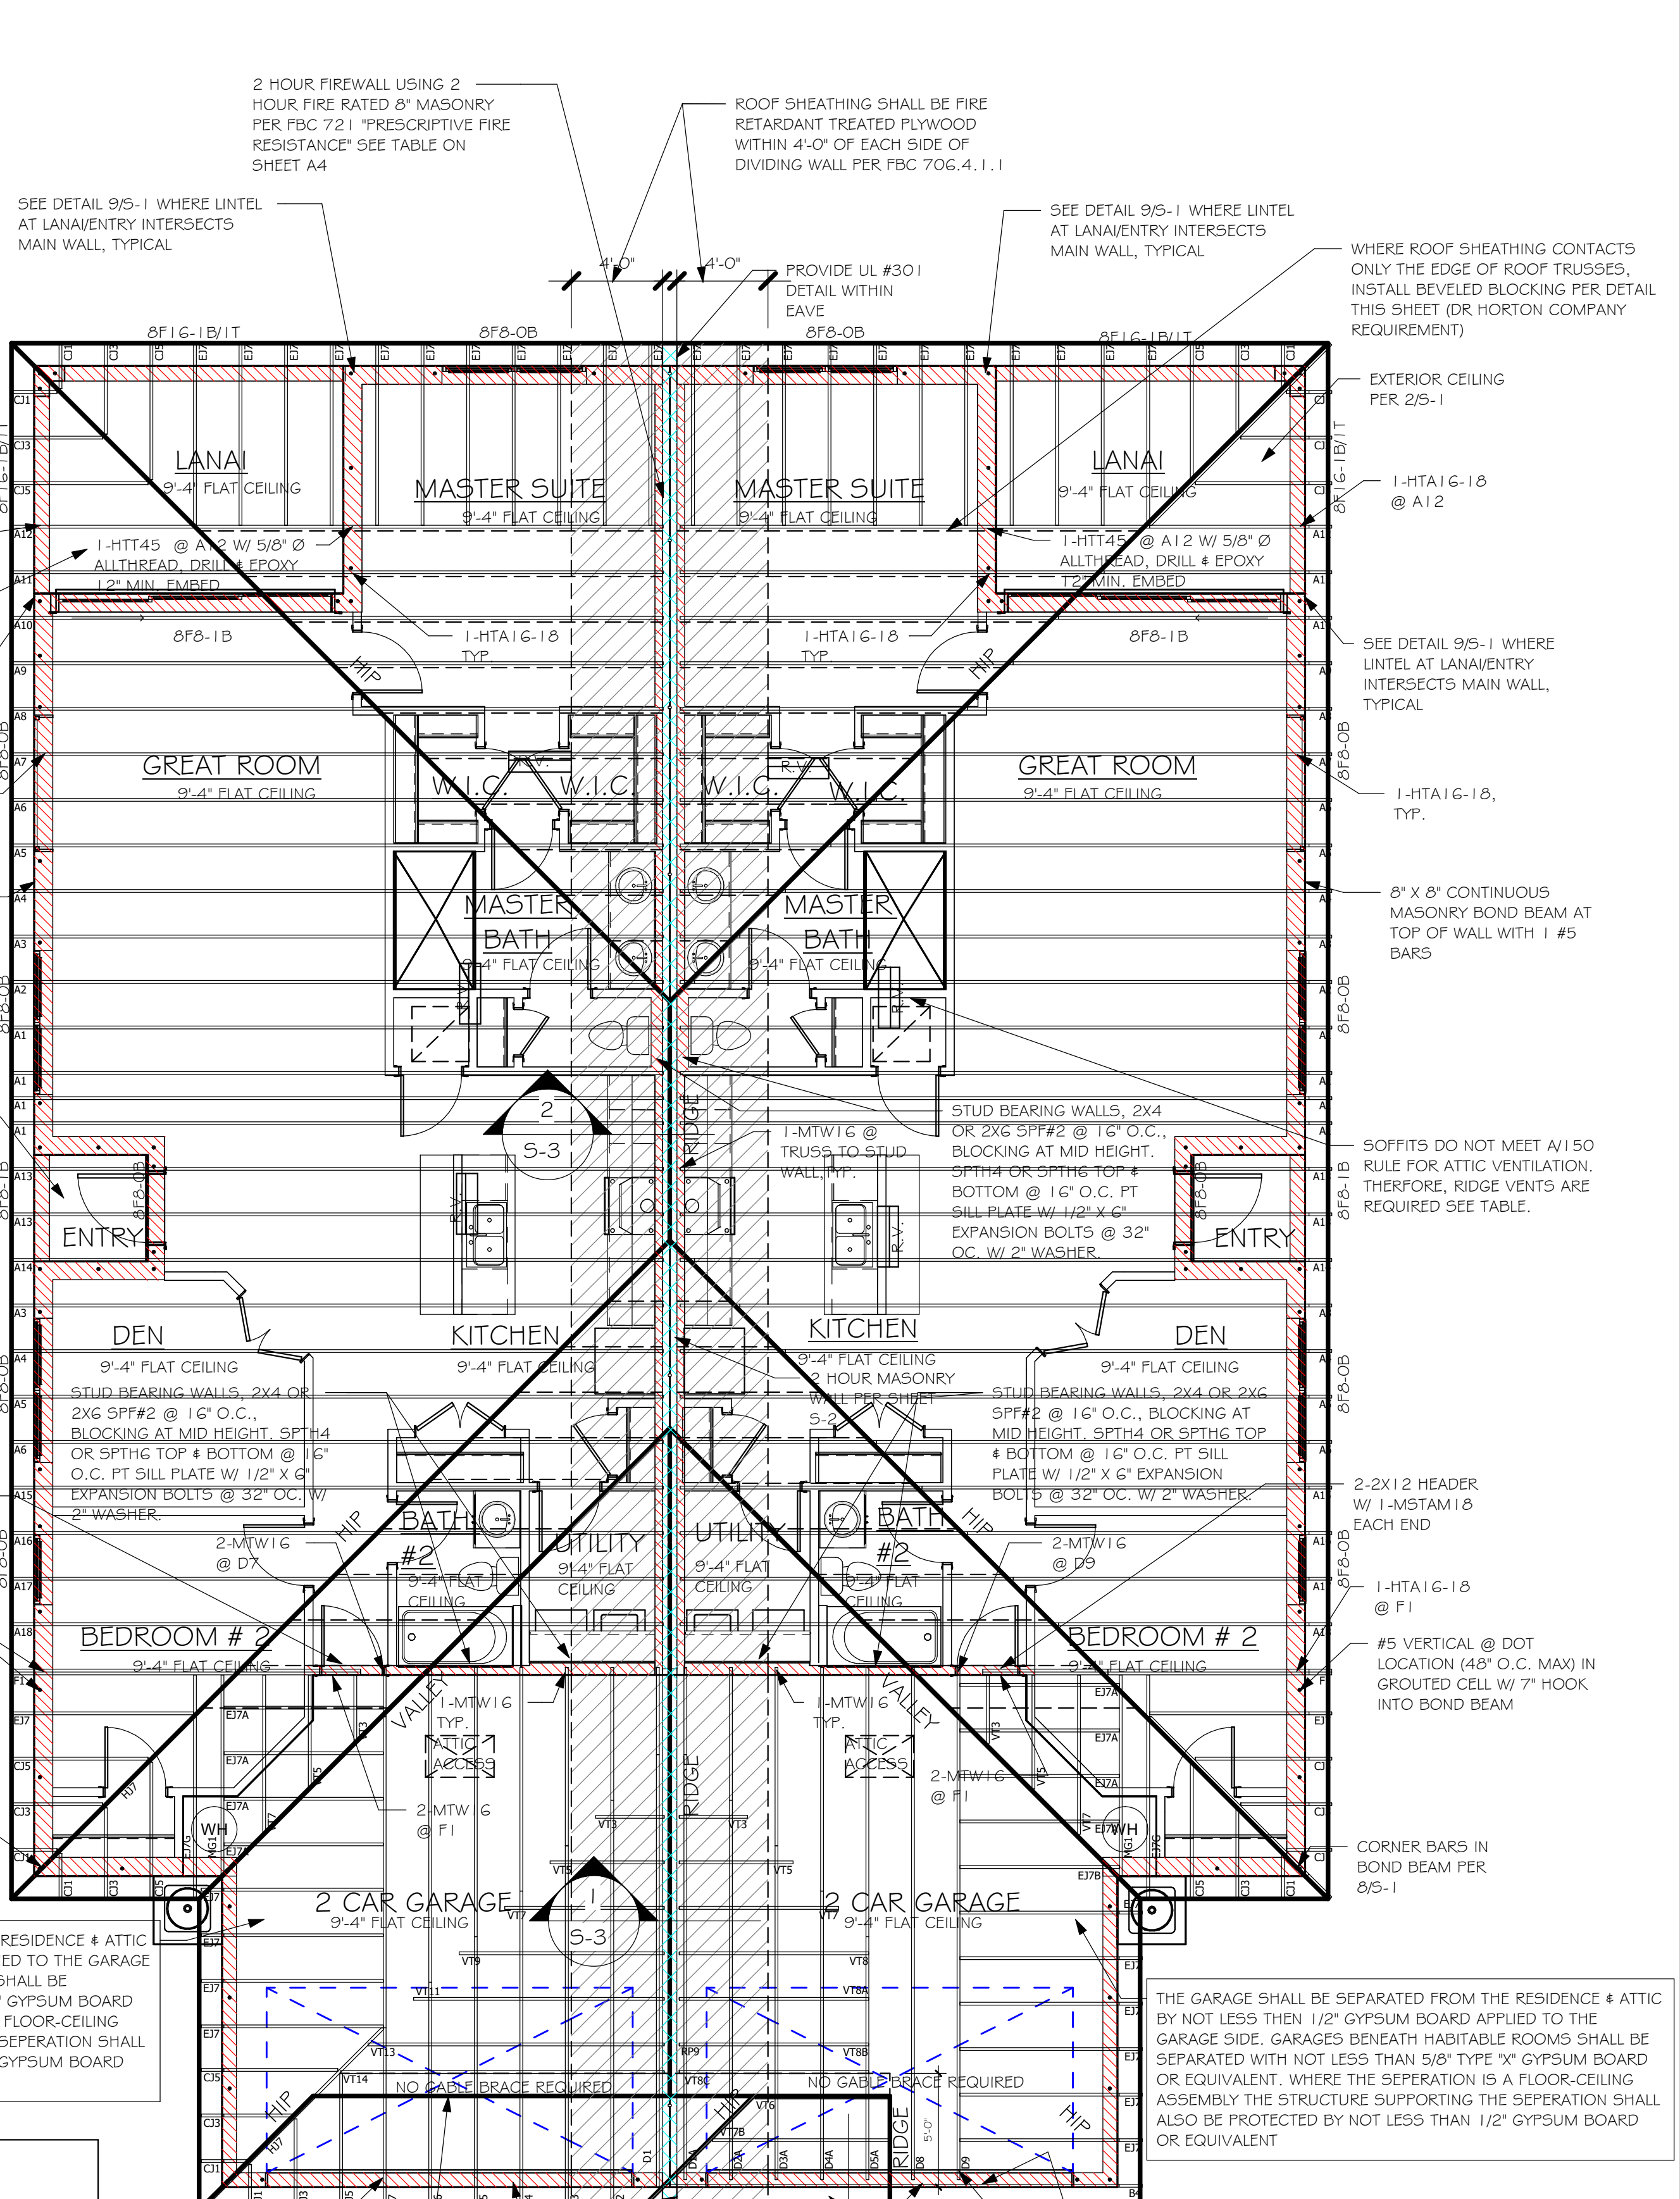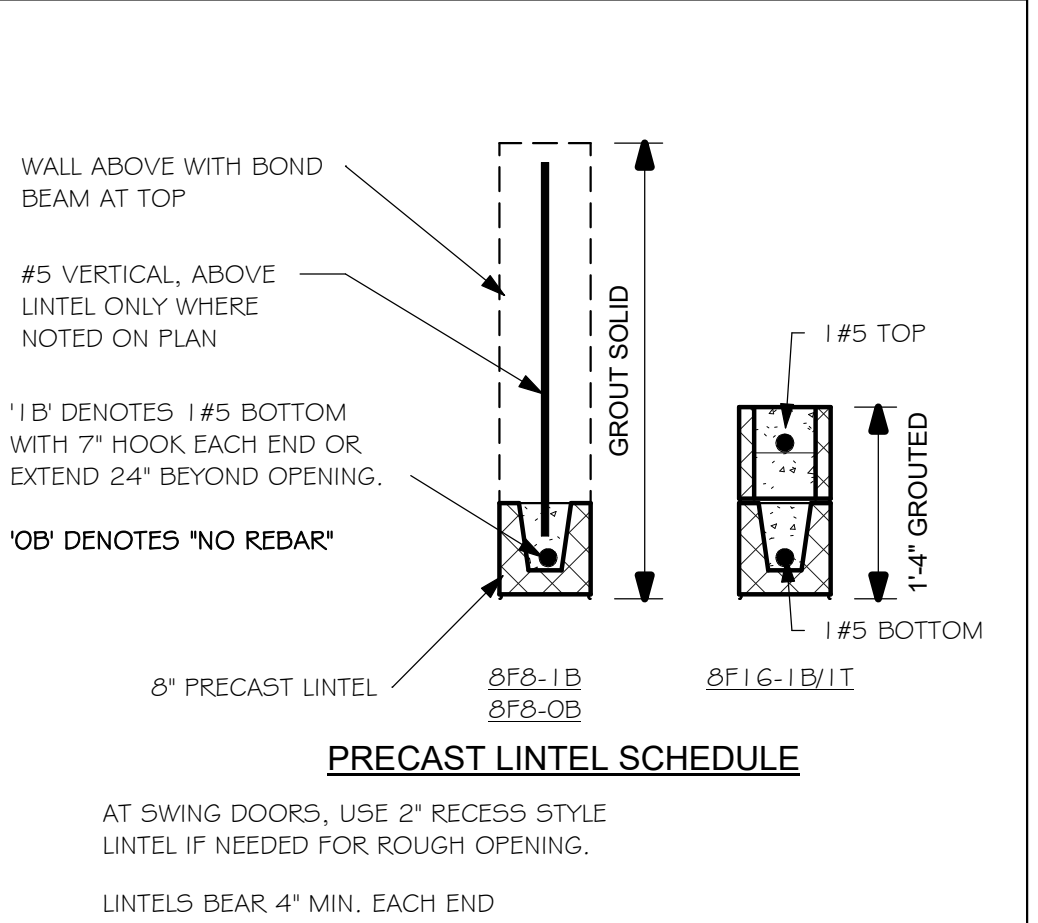

ROOF FRAMING PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8222
1515 SE 47th ST. CAPE CORAL, FL 33904


STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1515 SE 47th ST. CAPE CORAL, FL 33904
(239) 549-4254
CEN 8887

LOT: 133-134	SUBDIVISION: WEST VILLAGES TV-5	DATE: 10/17/19
ADDRESS: 21014-21008 PETERBUSH PLACE	D.R.H. #: 579780017-018	DRAWN BY: JSL
MODEL 1526 VILLA	GCD JOB # 11301	CHECKED BY: JWC
		REVISED:
		PLAN: ROOF
		SCALE: As indicated
		A-4

K:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\5UBDIVISIONS\WEST VILLAGES
TV\5\11301 LOT 133-134 1526 AREVTV\1301 1526 AR.vcf


ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V. RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES. PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2014	

ELECTRICAL NOTES FOR FIRE RATED WALLS	
ELECTRICAL OUTLETS PLACED IN FIRE RATED WALLS SHALL BE IN CONFORMANCE WITH THE UNDERWRITERS LABORATORIES, INC., FIRE RESISTANCE DIRECTORY, CURRENT EDITION. THESE REQUIREMENTS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING SPECIFIC ITEMS: A) INDIVIDUAL OUTLET/SWITCH BOXES SHALL NOT EXCEED (16) SQUARE INCHES IN AREA. B) AGGREGATE AREA OF OUTLET/SWITCH BOXES SHALL NOT EXCEED (100) SQUARE INCHES WITHIN (100) SUARE FEET OF WALL AREA. C) OUTLET/SWITCH BOXES LOCATED ON OPPOSITE SIDE OF THE SAME WALL SHALL BE SEPERATED BY A MINIMUM OF (24) INCHES. D) ALL OUTLET/SWITCH BOXES SHALL BE SECURELY ATTACHED TO THE STUDS AND THE OPENING IN THE WALL BOARD FACING SHALL BE CUT SO THAT THE CLEARANCE BETWEEN THE BOX AND THE WALLBOARD DOES NOT EXCEED 1/8 INCH.	

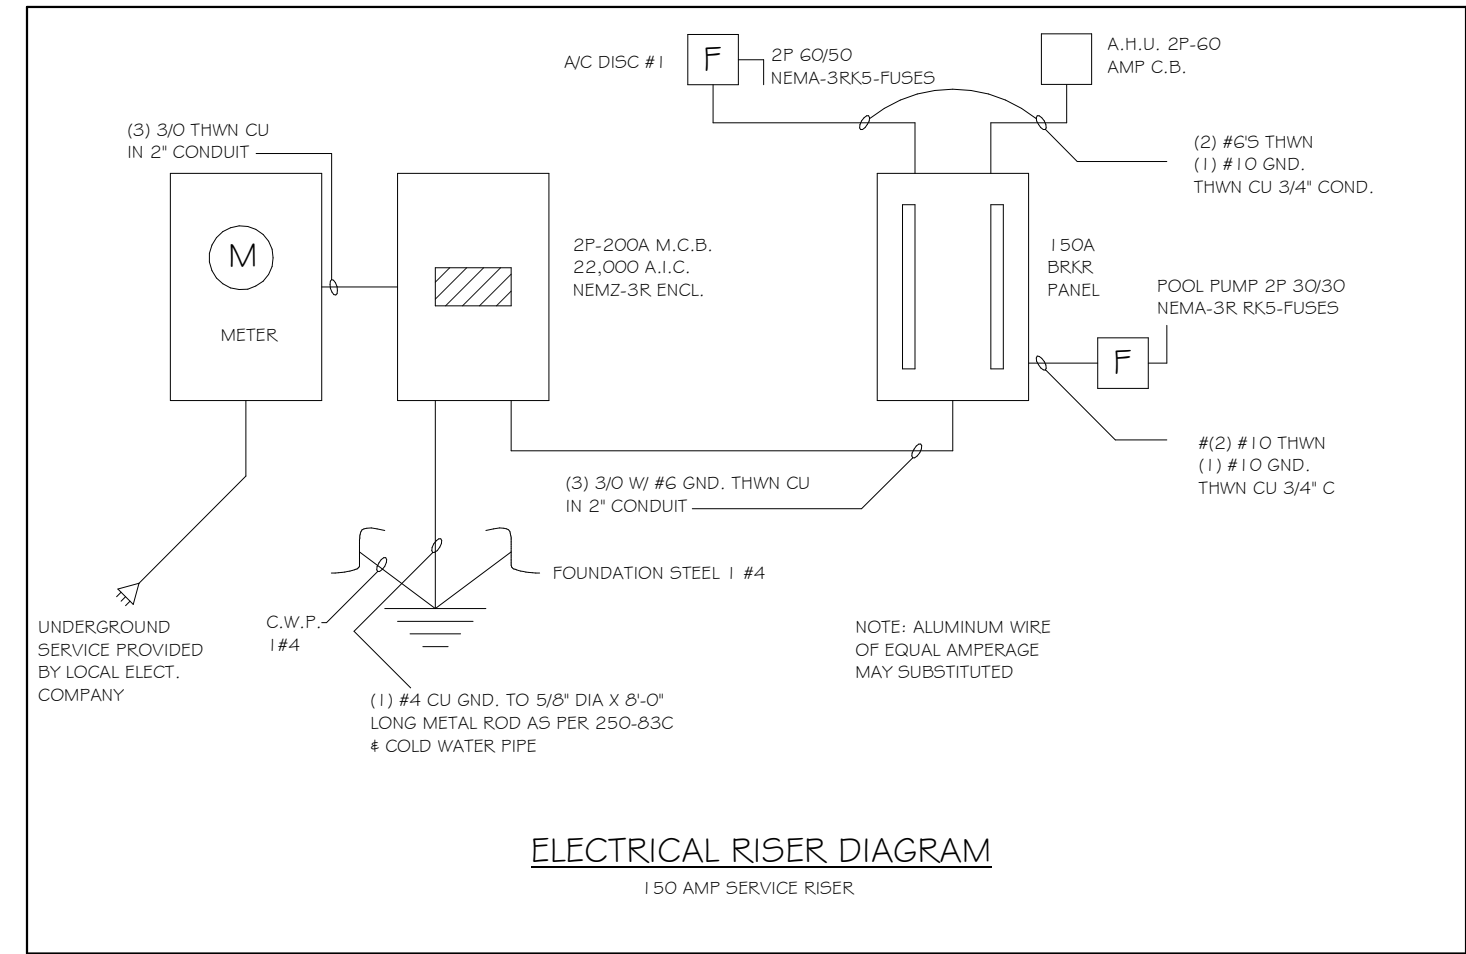

AIR CONDITIONING COORDINATION REQUIRED.
PRIOR TO ORDERING ROOF TRUSSES, THE CONTRACTOR SHALL WORK WITH THE AIR CONDITIONING SUB CONTRACTOR TO DESIGN/PLAN AND LAYOUT THE LOCATION OF AIR HANDLING EQUIPMENT, AIR DUCT SIZE AND LOCATION AND COORDINATE THAT DESIGN WITH THE TRUSSES FOR SPACE, CONNECTIVITY, AND POSITION REQUIREMENTS. THE CONTRACTOR MUST ADVISE THE TRUSS COMPANY PRIOR TO ANY CONSTRUCTION OF TRUSSES OF THE AIR CONDITIONING/HANDLING EQUIPMENTS SIZES AND WEIGHT AND DUCT LAYOUT CONCERNS OR REQUIREMENTS THAT MAY HAVE THE POTENTIAL TO CHANGE OR MODIFY THE TRUSSES TO ACCOMMODATE THE SAME. THE CONTRACTOR SHALL COORDINATE CONDENSATION DISCHARGE LINE LOCATION, AND ELECTRICAL SERVICE TO AIR EQUIPMENT, AND PROVIDE ANY LOCAL DISCONNECTS, LIGHTS AND SERVICE PLATFORMS THAT MAY BE REQUIRED.

ELECTRICAL PLAN		
200 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(26)	(FLUSH MOUNTED LT)
B	(4)	(VAPORS)
C	(4)	(PENDANT LIGHT
D	(8)	(10" MUSHROOMS)
E	(2)	(24" 3 LT)
F	(4)	(36" 4 LT)
G	(X)	(NOT USED)
H	(2)	(COACH LIGHTS)
I	(X)	(COACH LIGHTS)
J	(1)	(J BOX)
K	(2)	(4' FLUORESCENT)
L	(X)	(2' FLUORESCENT)
M	(X)	(5LT CHANDELIER)
N	(X)	(3 LT)
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

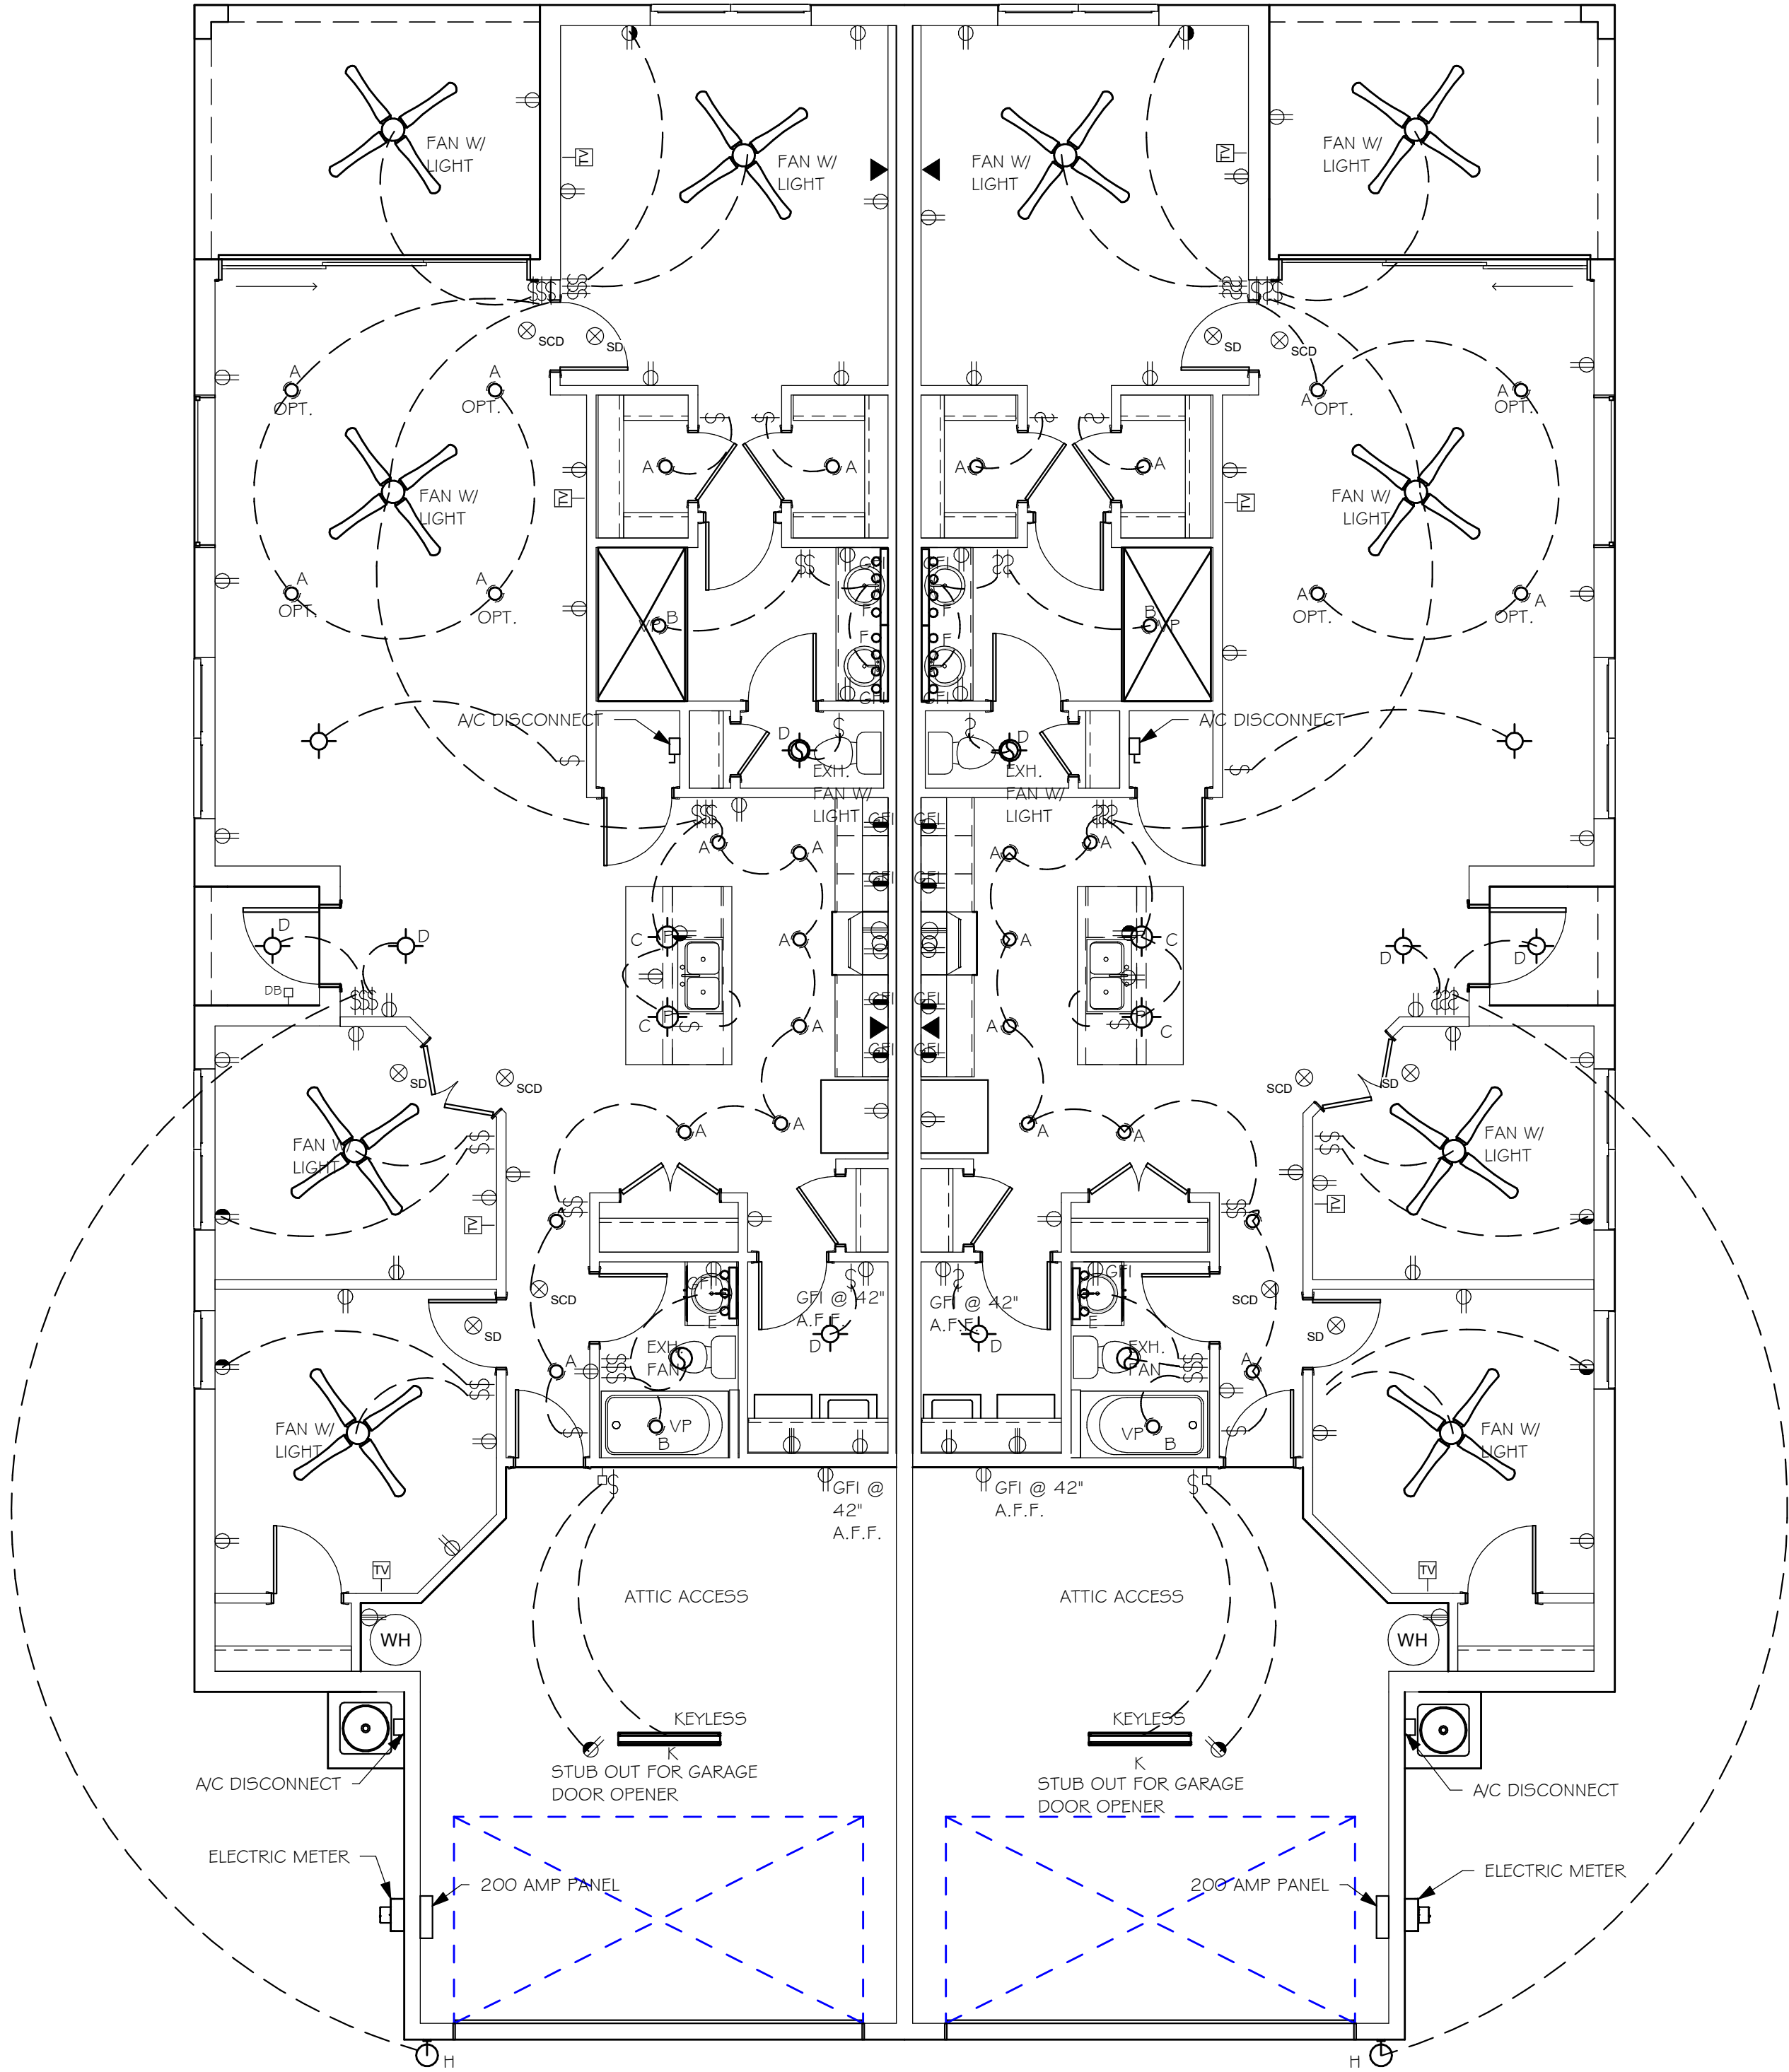

ELECTRICAL PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

D-R HORTON

NYSE

America's Builder

Gulf Coast

Drafting & Design, Inc.

EMAIL: PLANS@GULFCOASTDRAFTING.COM

PHONE: 239-540-8823

1515 SE 47th ST. CAPE CORAL, FL 33904

MODEL 1526 VILLA GCD JOB # 11301	LOT: 133-134	DATE: 10/17/19
	SUBDIVISION: WEST VILLAGES TV's	DRAWN BY: JSL
	ADDRESS: 21014-21008 FETTERBUSH PLACE	CHECKED BY: JWC
	D.R.H. #: 579780017-018	REVISED:
		PLAN: ELECTRICAL
		SCALE: As indicated
A-5		

1

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
- ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
- SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE. FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
- ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL. CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
- TREATED WOOD REQUIREMENTS:-
ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY.
ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
- CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
- LANAI CEILINGS & COVERED ENTRY CEILINGS
1X4 STRIPPING @ 1'6" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

3

GENERAL ROOF ASSEMBLY

ROOF SHEATHING
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL 1" CLIPS AT UNSUPPORTED PANEL EDGES. THE ROOF SHEATHING SHALL BE NAILED WITH 8d RING SHANK NAILS @ 4" O.C. EDGE AND 6" O.C. FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSSES WITHOUT SPLITTING. RING SHANK NAILS PER R303.2.3.1 - 0.113" NOMINAL SHANK DIAMETER, RING DIAMETER OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G30. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURER'S PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R305.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

6

ASPHALT SHINGLE ROOF SPECS

SHINGLES

15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURE. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

FASTENERS

FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 1/2 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESISTANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL

4



CLAY AND CONCRETE ROOF TILE SPECS

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING,
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,
A. AMOUNT AND PLACEMENT OF MORTAR
B. AMOUNT AND PLACEMENT OF ADHESIVE
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT
4. SLOPE REQUIREMENT.

5

FLOOR SHEATHNG AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES SPAN RATING 48/24 OR BETTER, GLUED AND NAILED

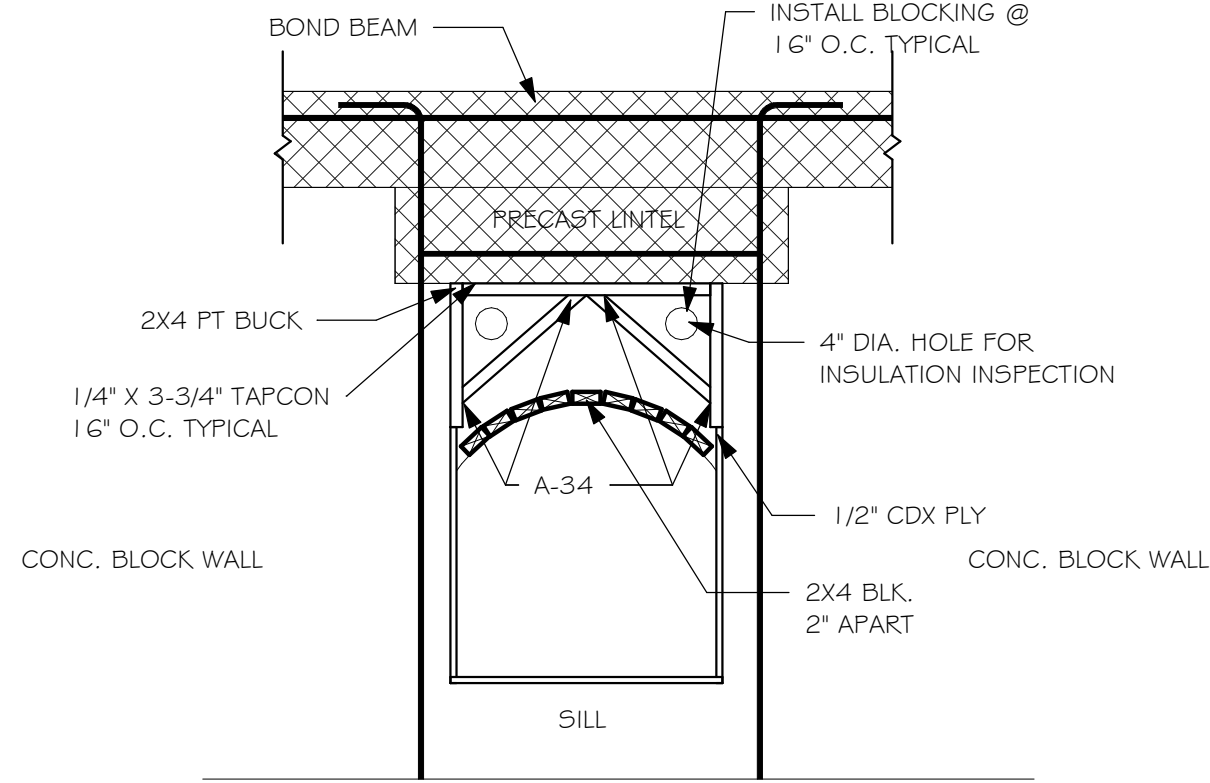
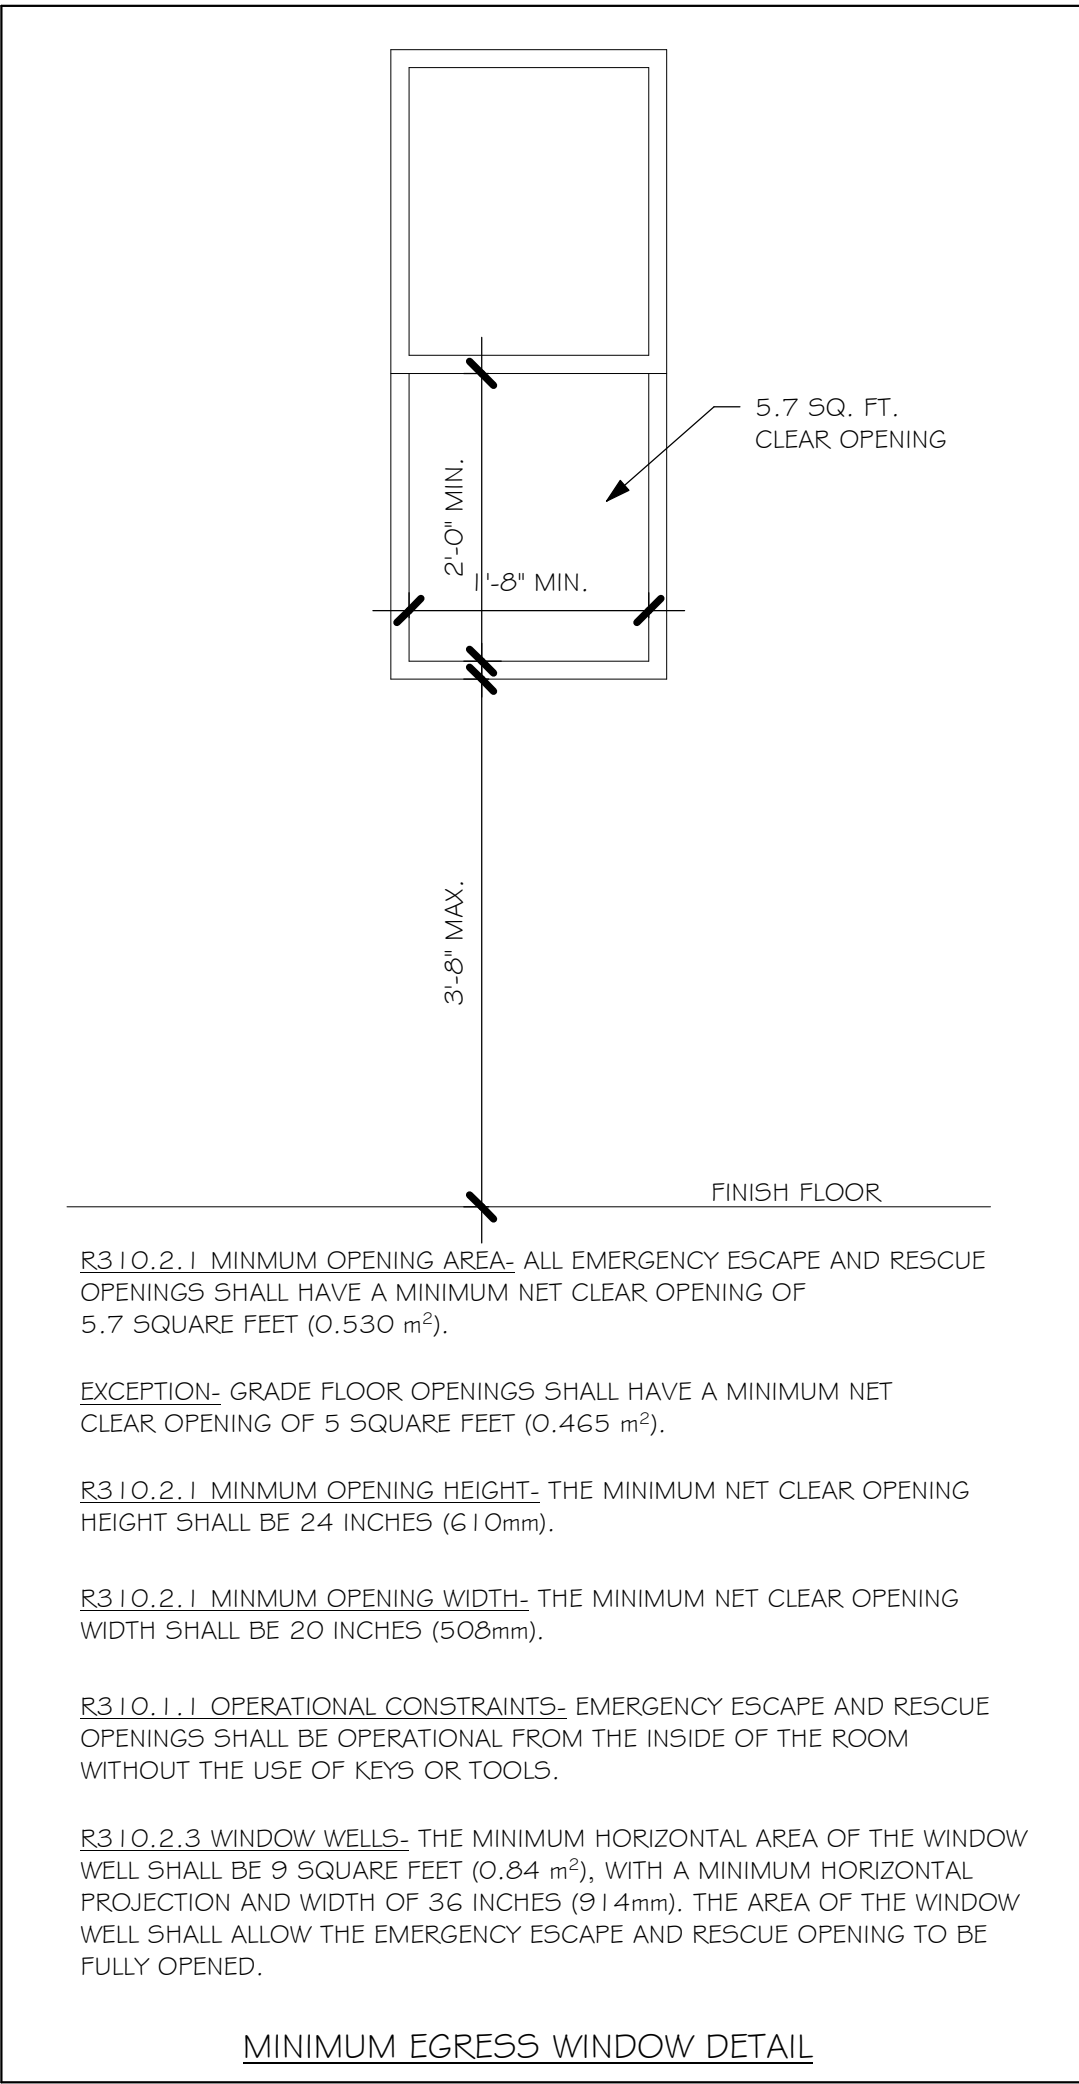


SPECIAL NOTE:

FRAMING OF DECORATIVE ARCHES AT WINDOW AND DOOR OPENINGS SHALL COMPLY WITH THE FOLLOWING:


- ATTACH 1X4 OR 1X8 PT W/ (2) 8d NAILS STAGGERED 8" O.C. FOR FRAME APPLICATIONS OR 1-1/2" O. 113" CASE HARDENED PNEUMATIC DRIVEN NAILS STAGGERED @ 8" O.C.
- 1/532" C-D PLYWOOD, BOTH SIDES. ATTACH W/ 8d NAILS 6" O.C. EDGE.
- 1 X 4 MIN. BLOCKING ATTACH W/ (2) 8d NAILS TYPICAL EACH END

FILL IN FRAMING

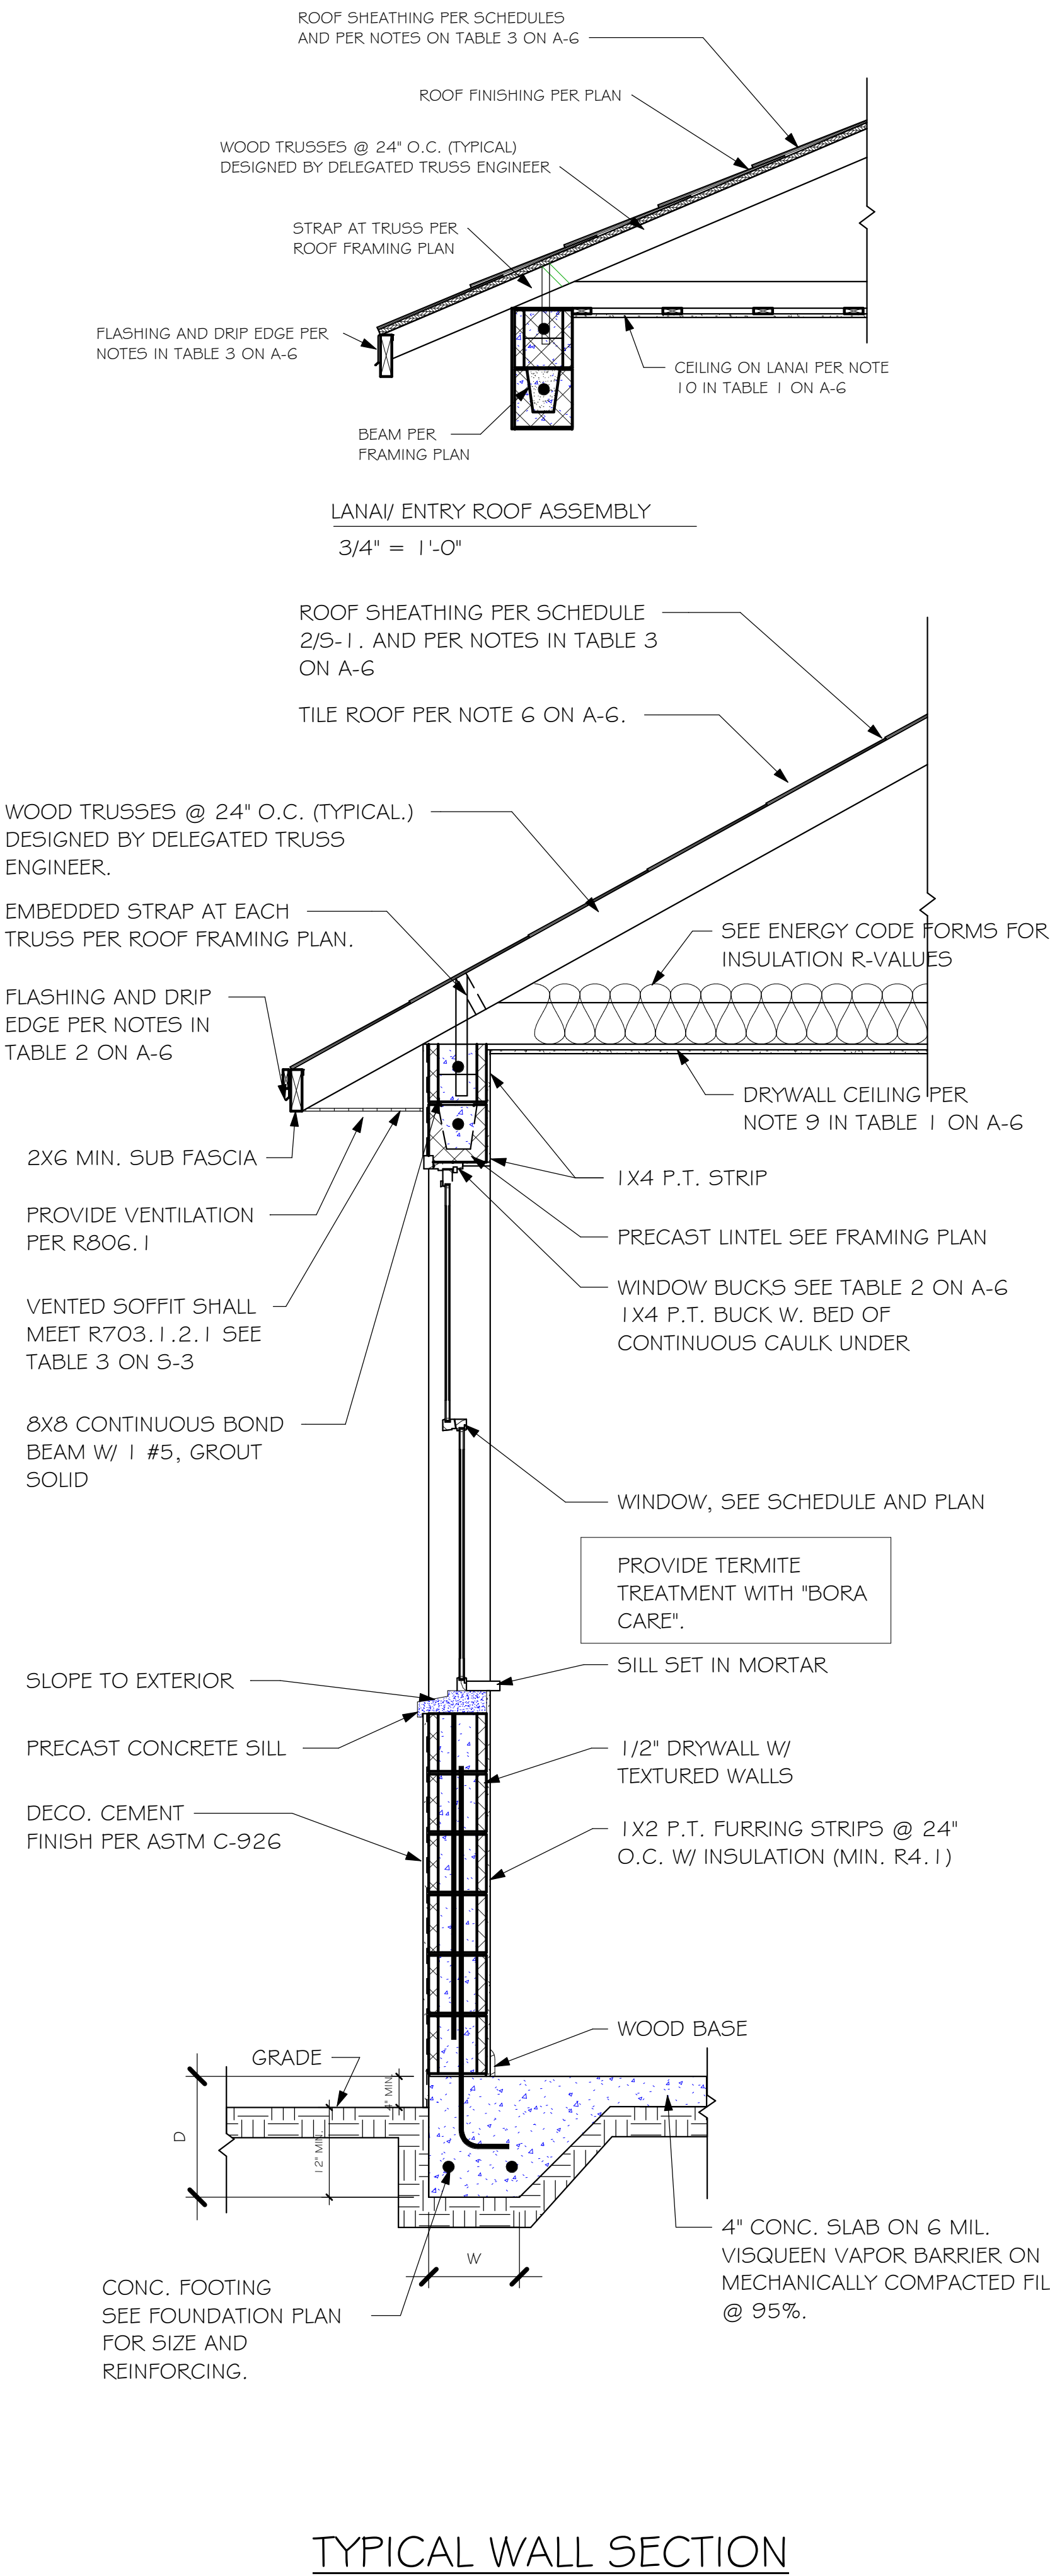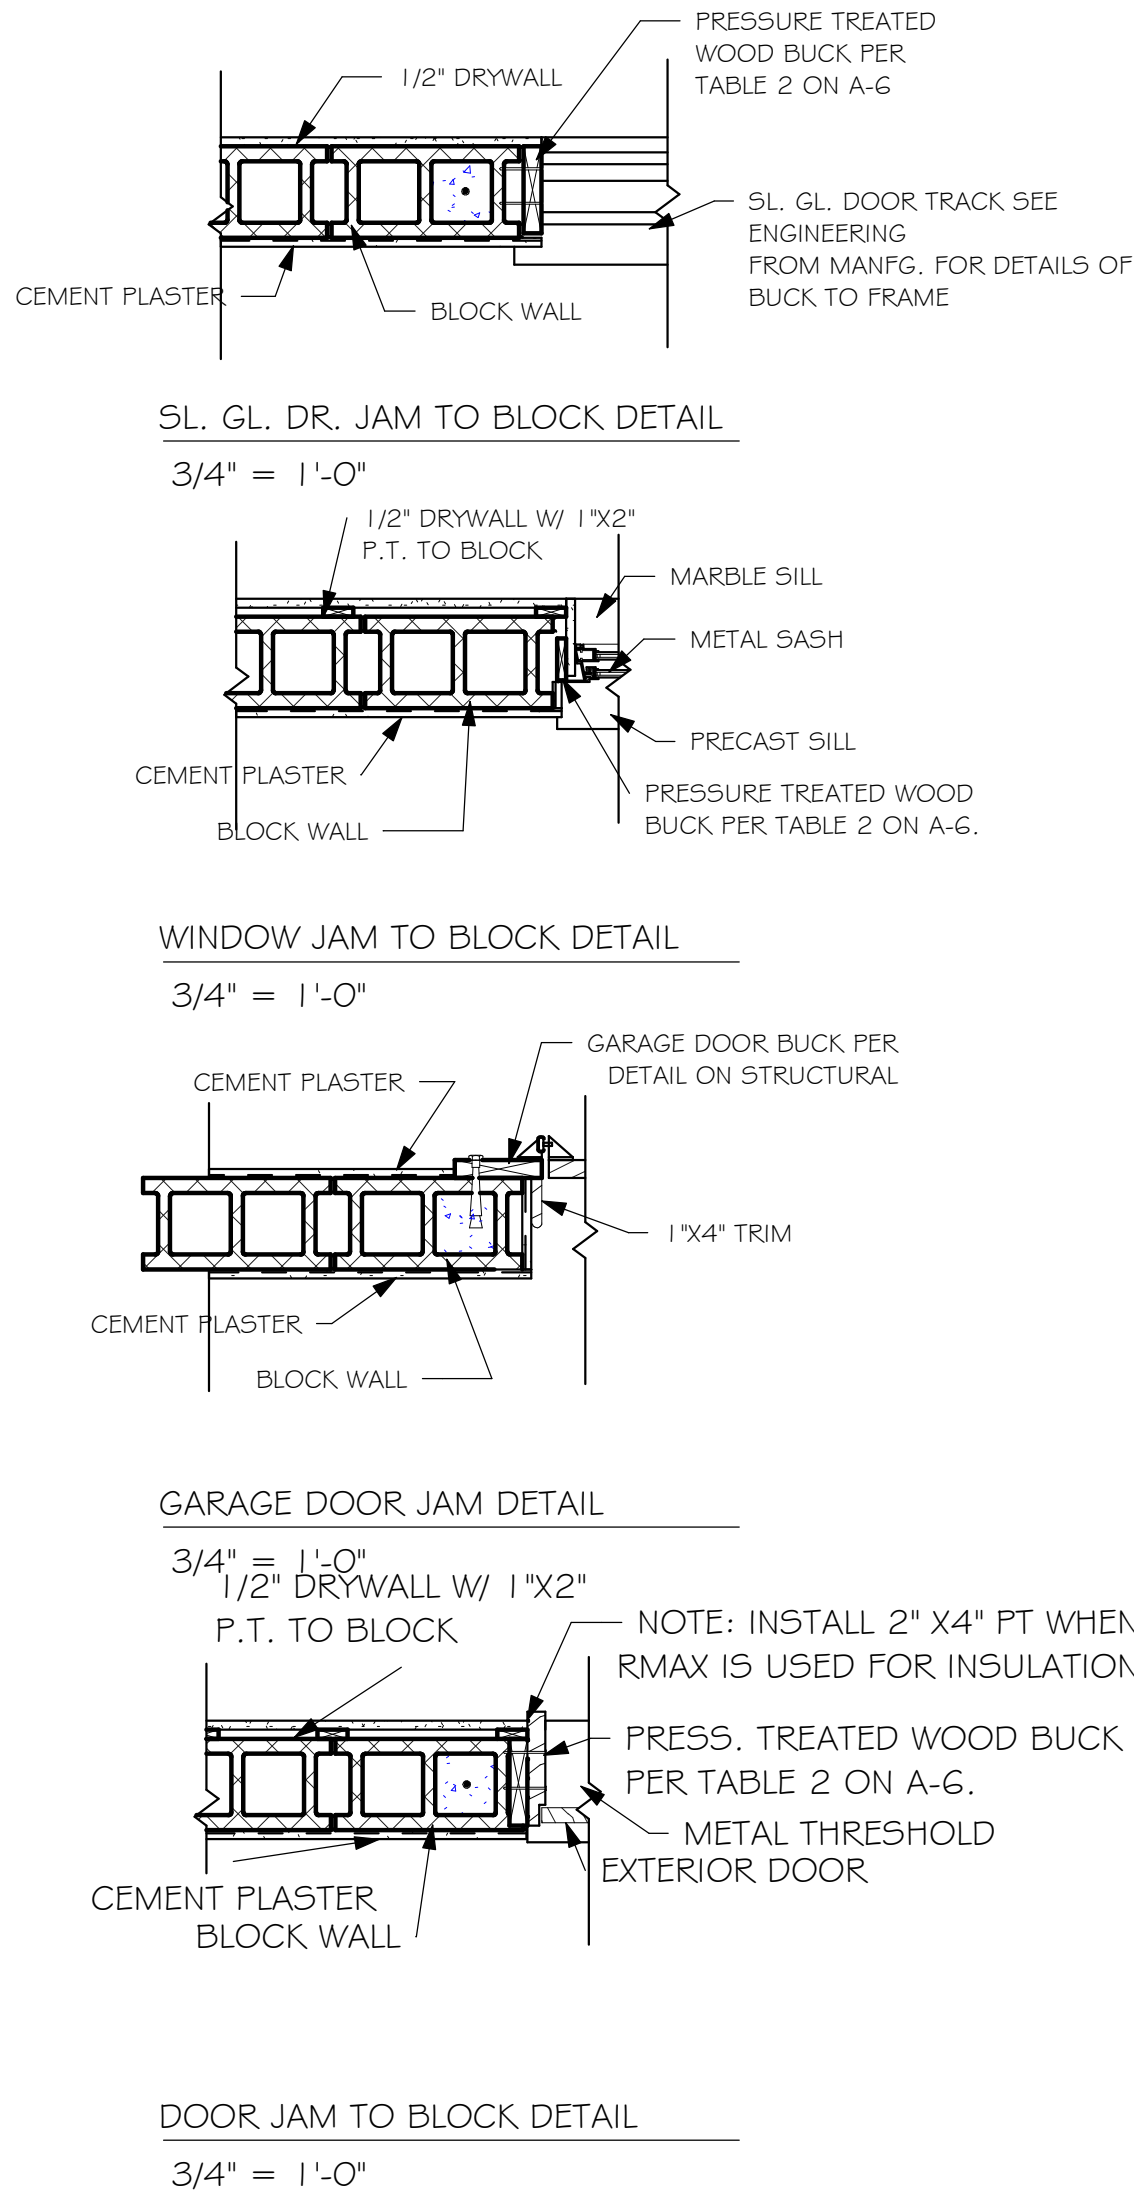

D-R HORTON NYSE <i>America's Builder</i>	
Gulf Coast Drafting & Design, Inc. EMAIL: PLANS@GULFCOASTDRAFTING.COM PHONE: 239-540-1622 1515 SE 47th ST. CAPE CORAL, FL 33904	
This document and its contents are the property of Gulf Coast Drafting & Design, Inc. (GCD) and are not to be reproduced, stored in a retrieval system, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of GCD. No part of this document may be reproduced, stored, or transmitted in any form or by any means, electronic, mechanical, photocopying, recording, or by any information storage and retrieval system, without the prior written permission of GCD.	
STRUCTURAL DIVISION SYSTEMS of North Florida 1515 SE 47th St. Cape Coral, FL 33904 (239) 549-4254 CDD 889	
LOT: 133-134	SUBDIVISION: WEST VILLAGES TV's
ADDRESS: 21014-21008 FETTERBUSH PLACE	
D.R.H. #: 579780017-018	
MODEL 1526 VILLA GCD JOB # 11301	
DATE: 10/17/19	
DRAWN BY: JSL	
CHECKED BY: JWC	
REVISED:	
PLAN: SECTIONS	
SCALE: As indicated	
A-6	




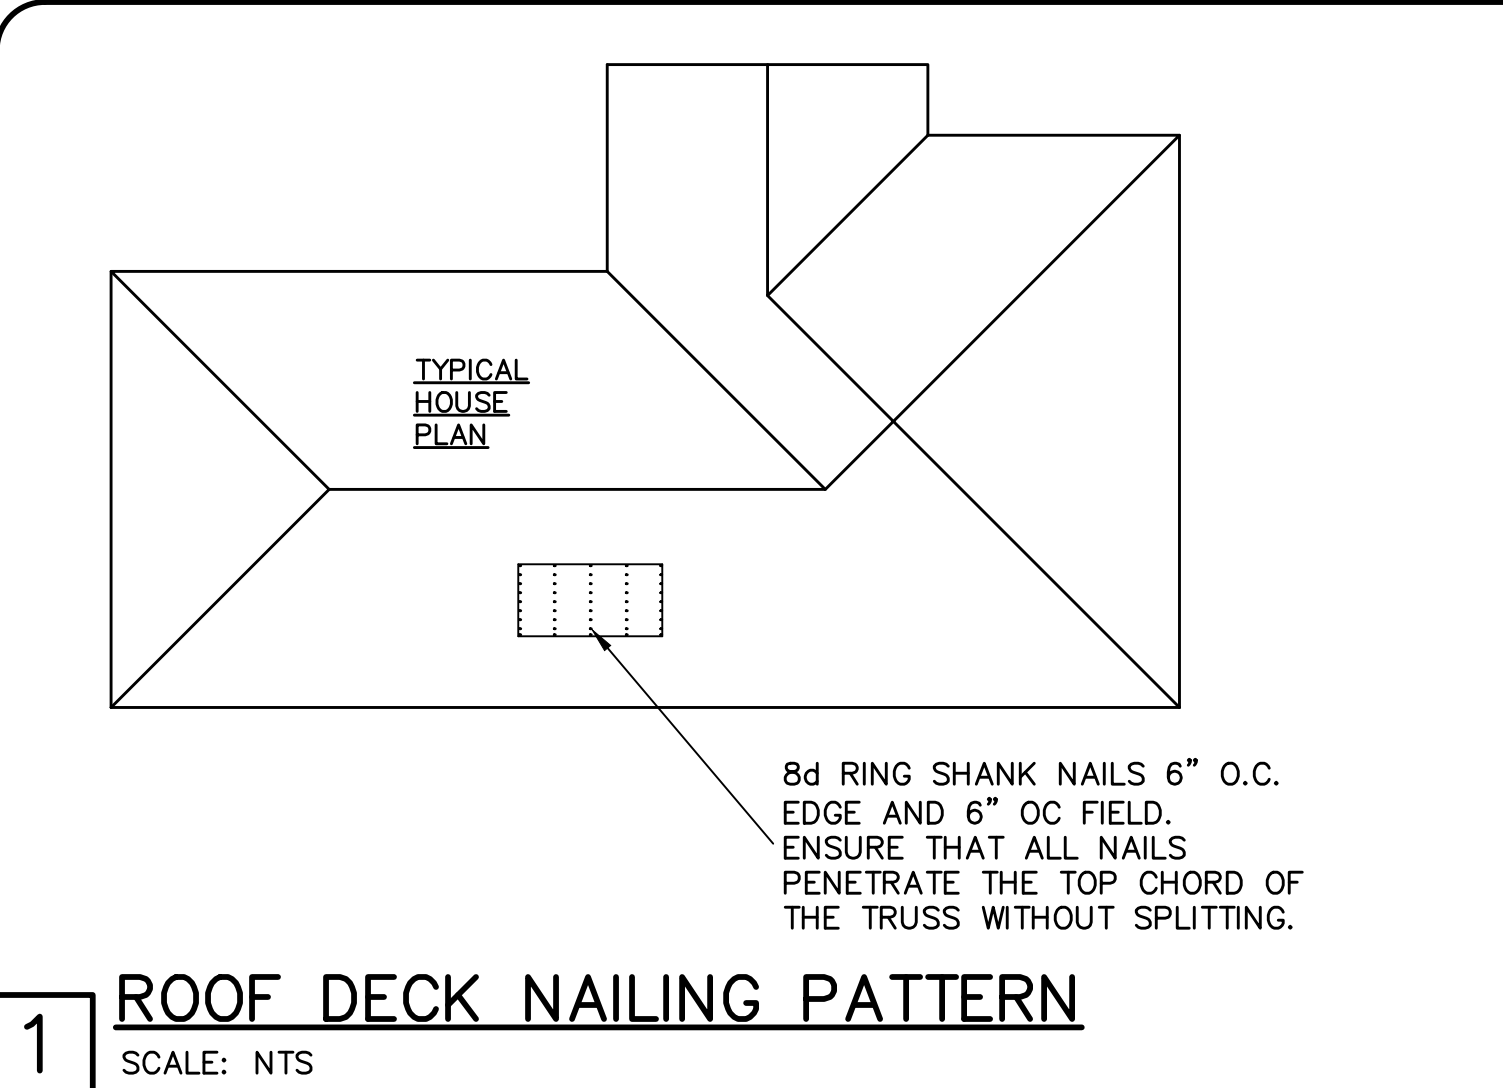


1 **ROOF DECK NAILING PATTERN**
SCALE: NTS

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED) (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 3/8" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.


2 **SHEATHING SCHEDULE**
NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

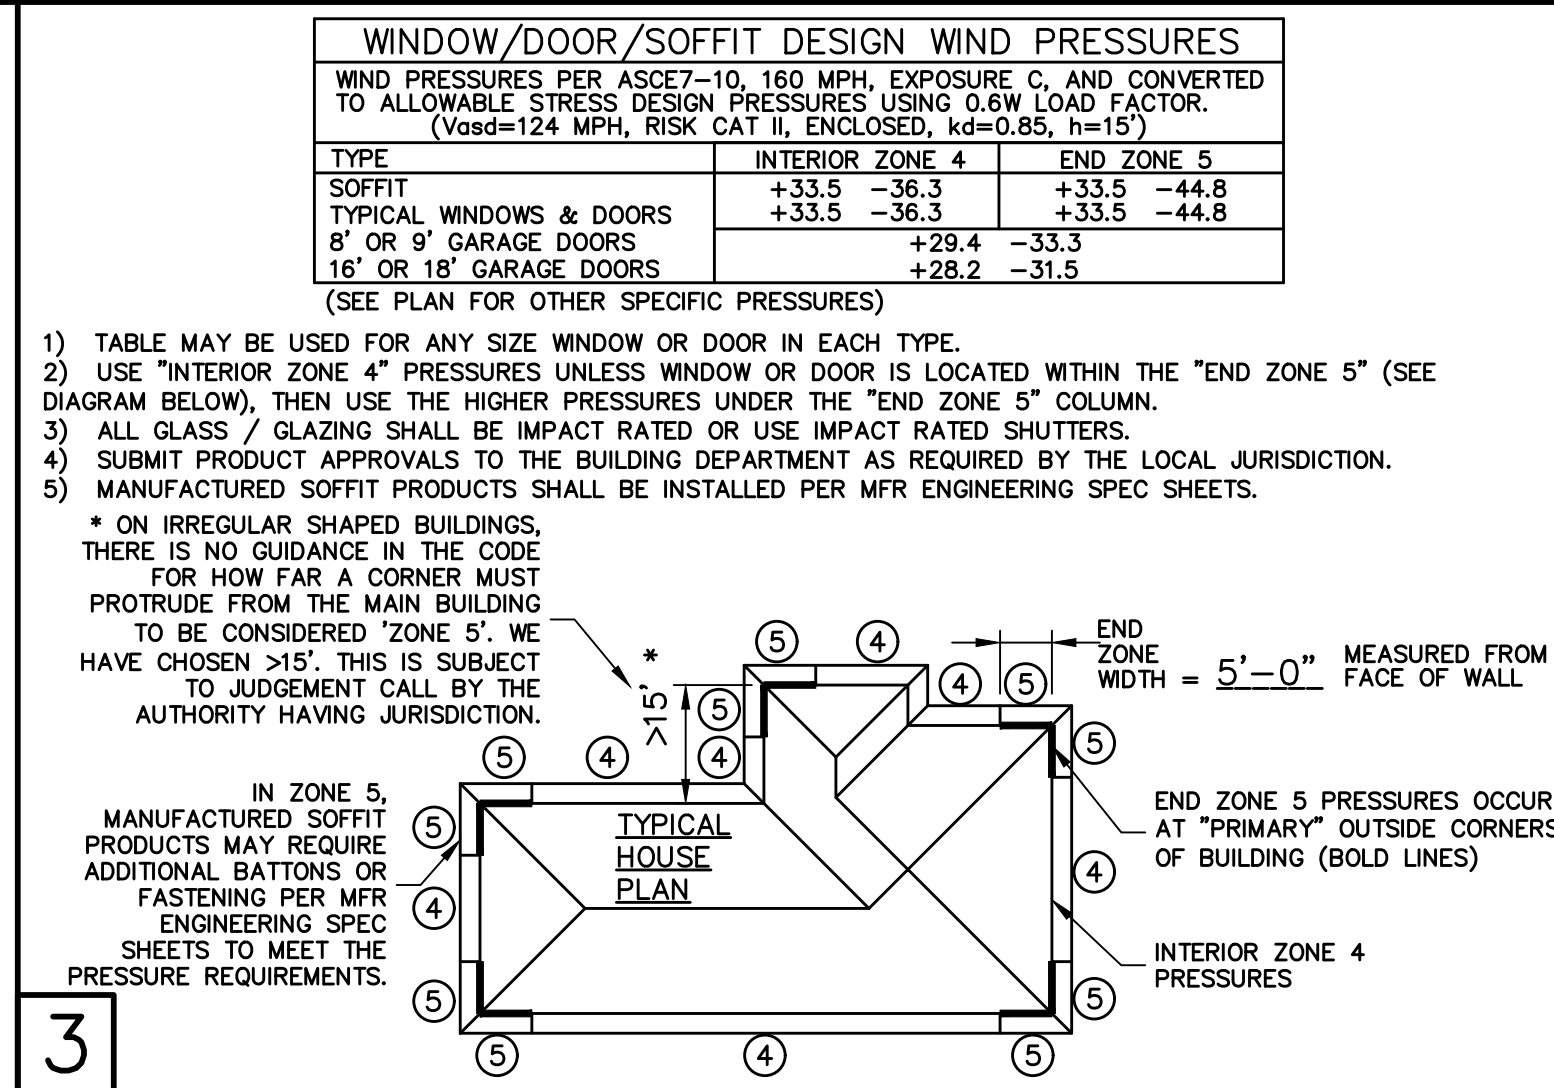


3 **WINDOW/DOOR/SOFFIT DESIGN WIND PRESSURES**
NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

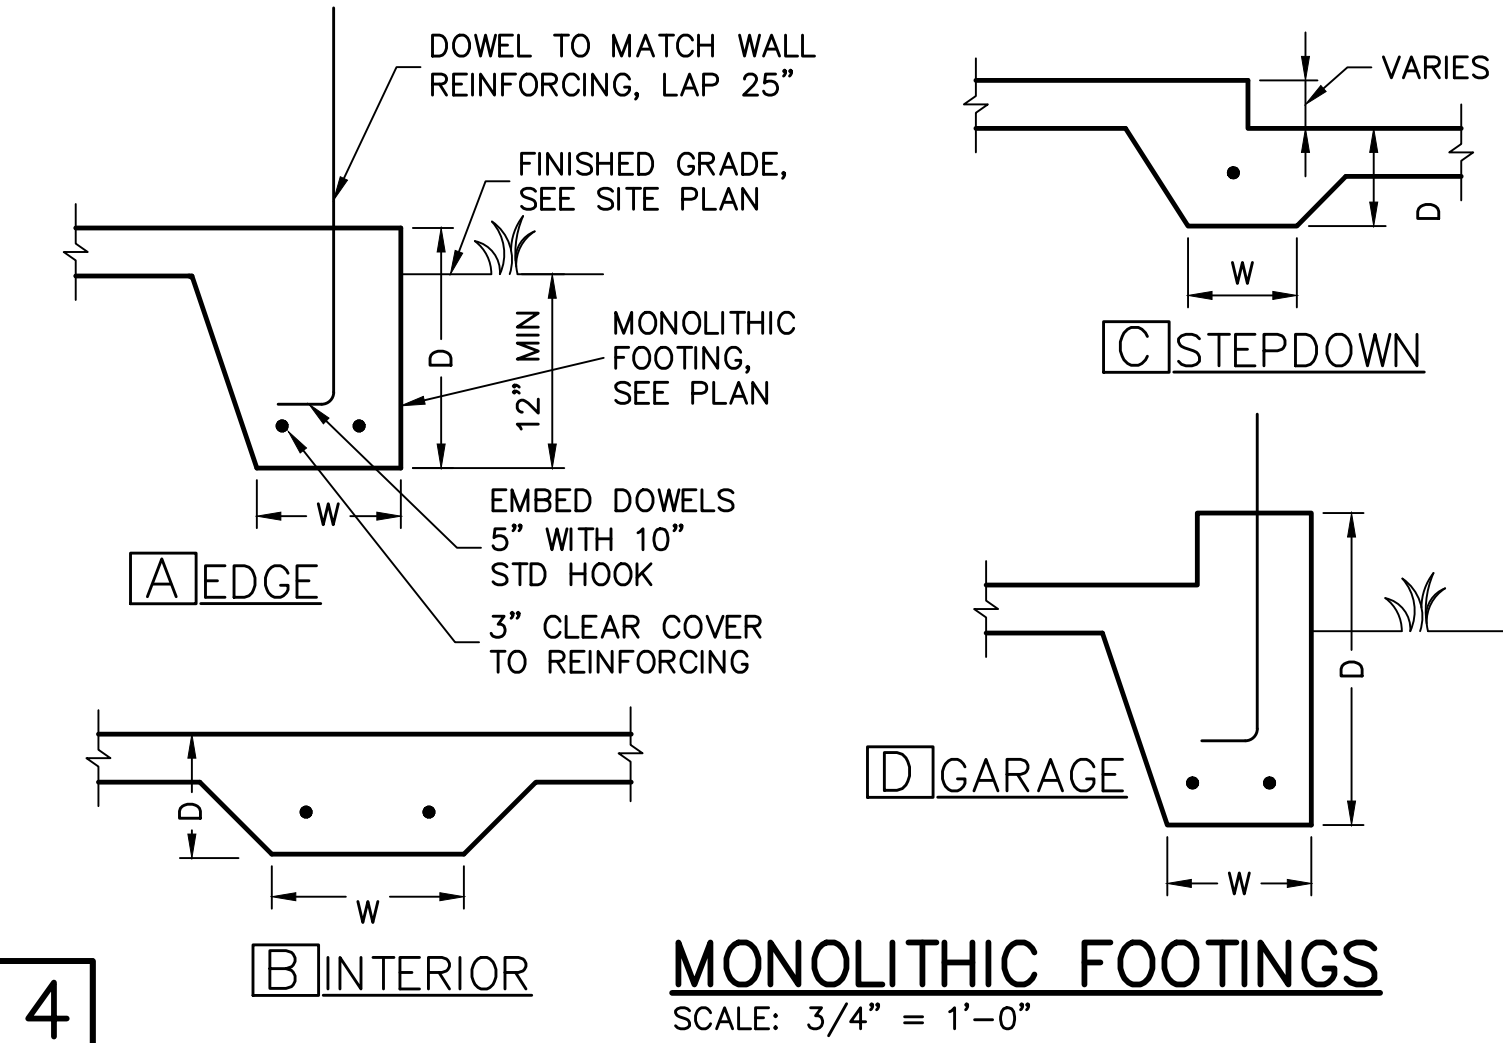


4 **MONOLITHIC FOOTINGS**
SCALE: 3/4" = 1'-0"

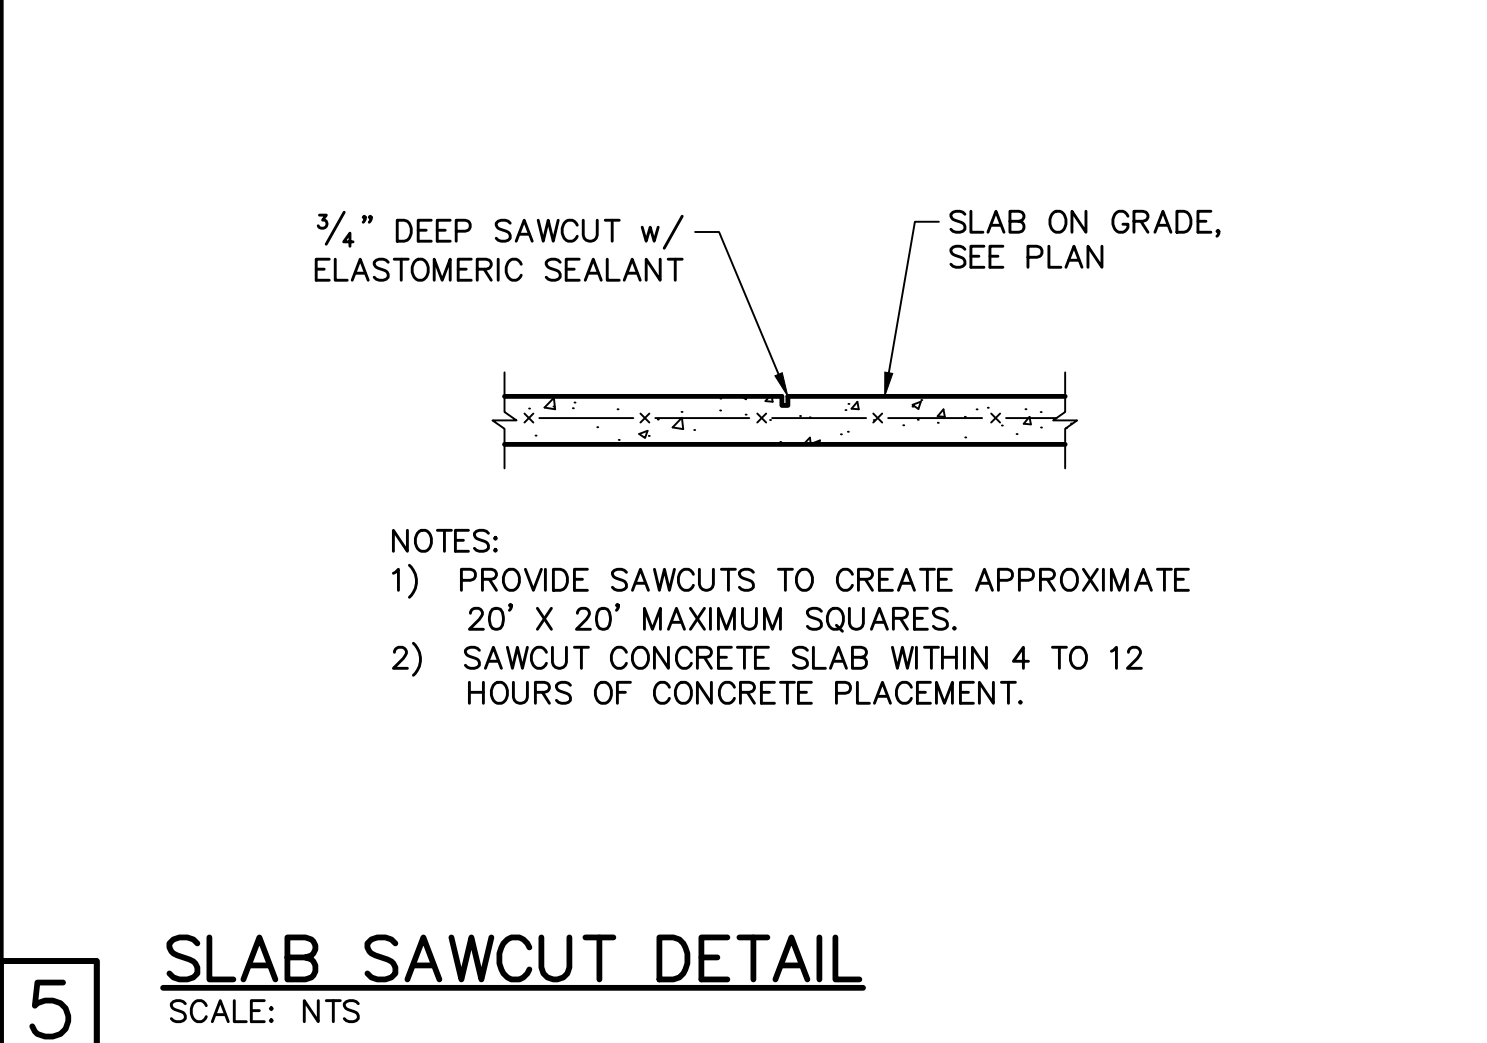


5 **SLAB SAWCUT DETAIL**
SCALE: NTS

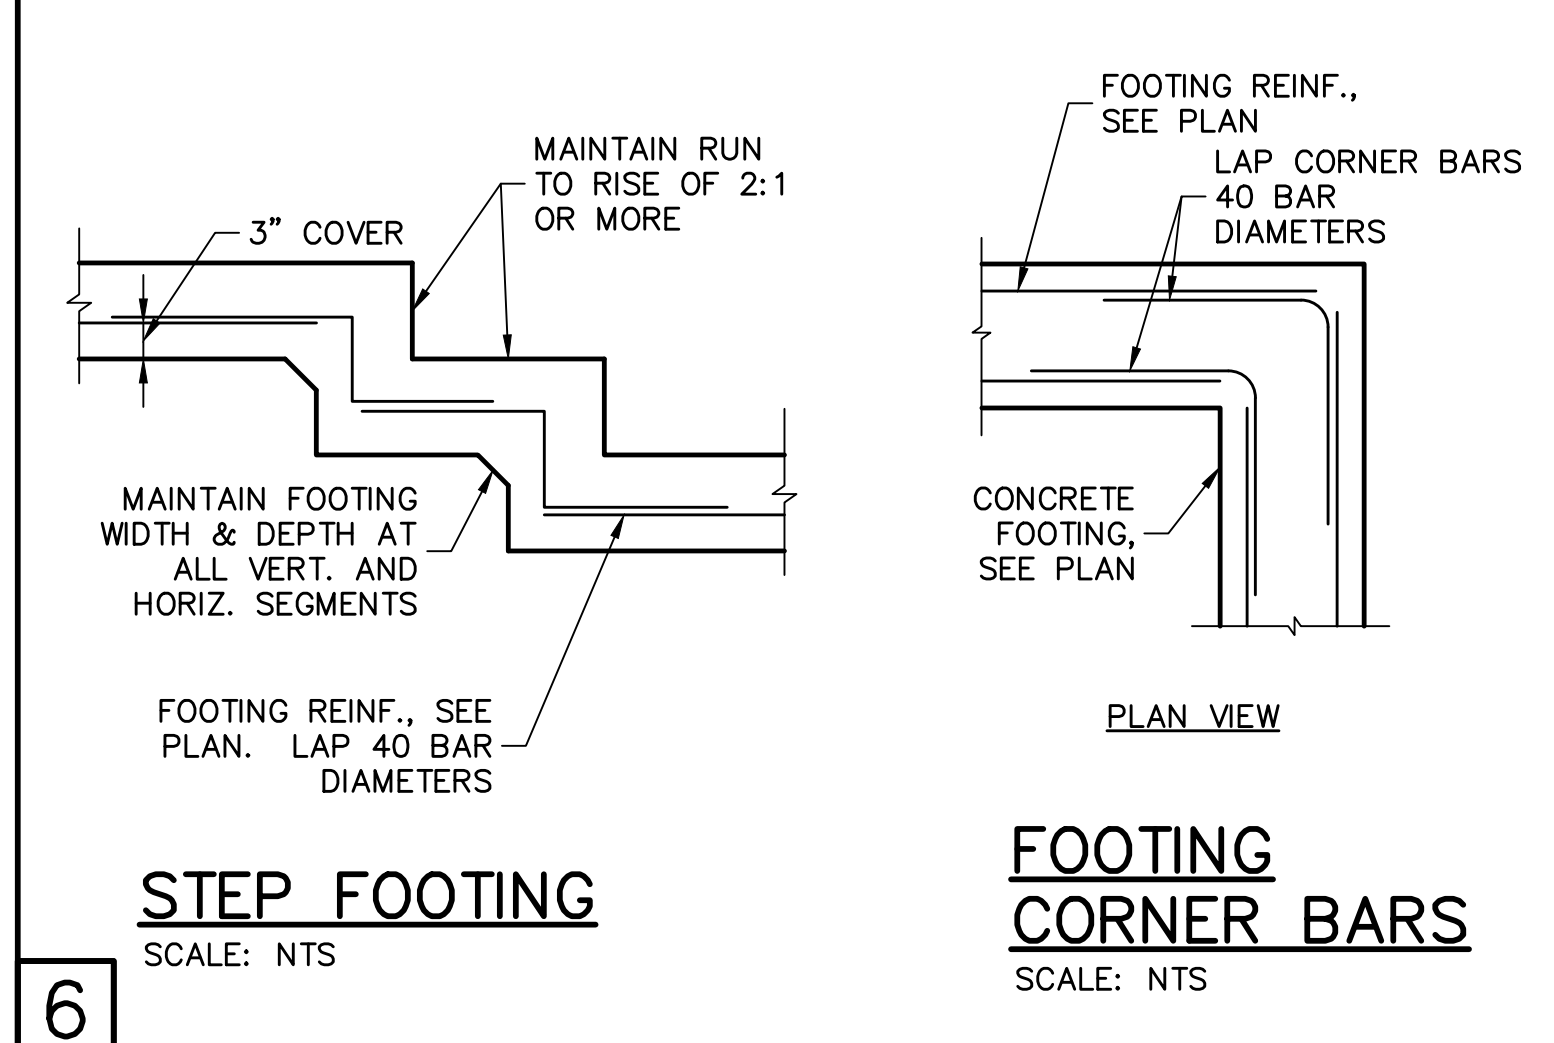


6 **FOOTING CORNER BARS**
SCALE: NTS

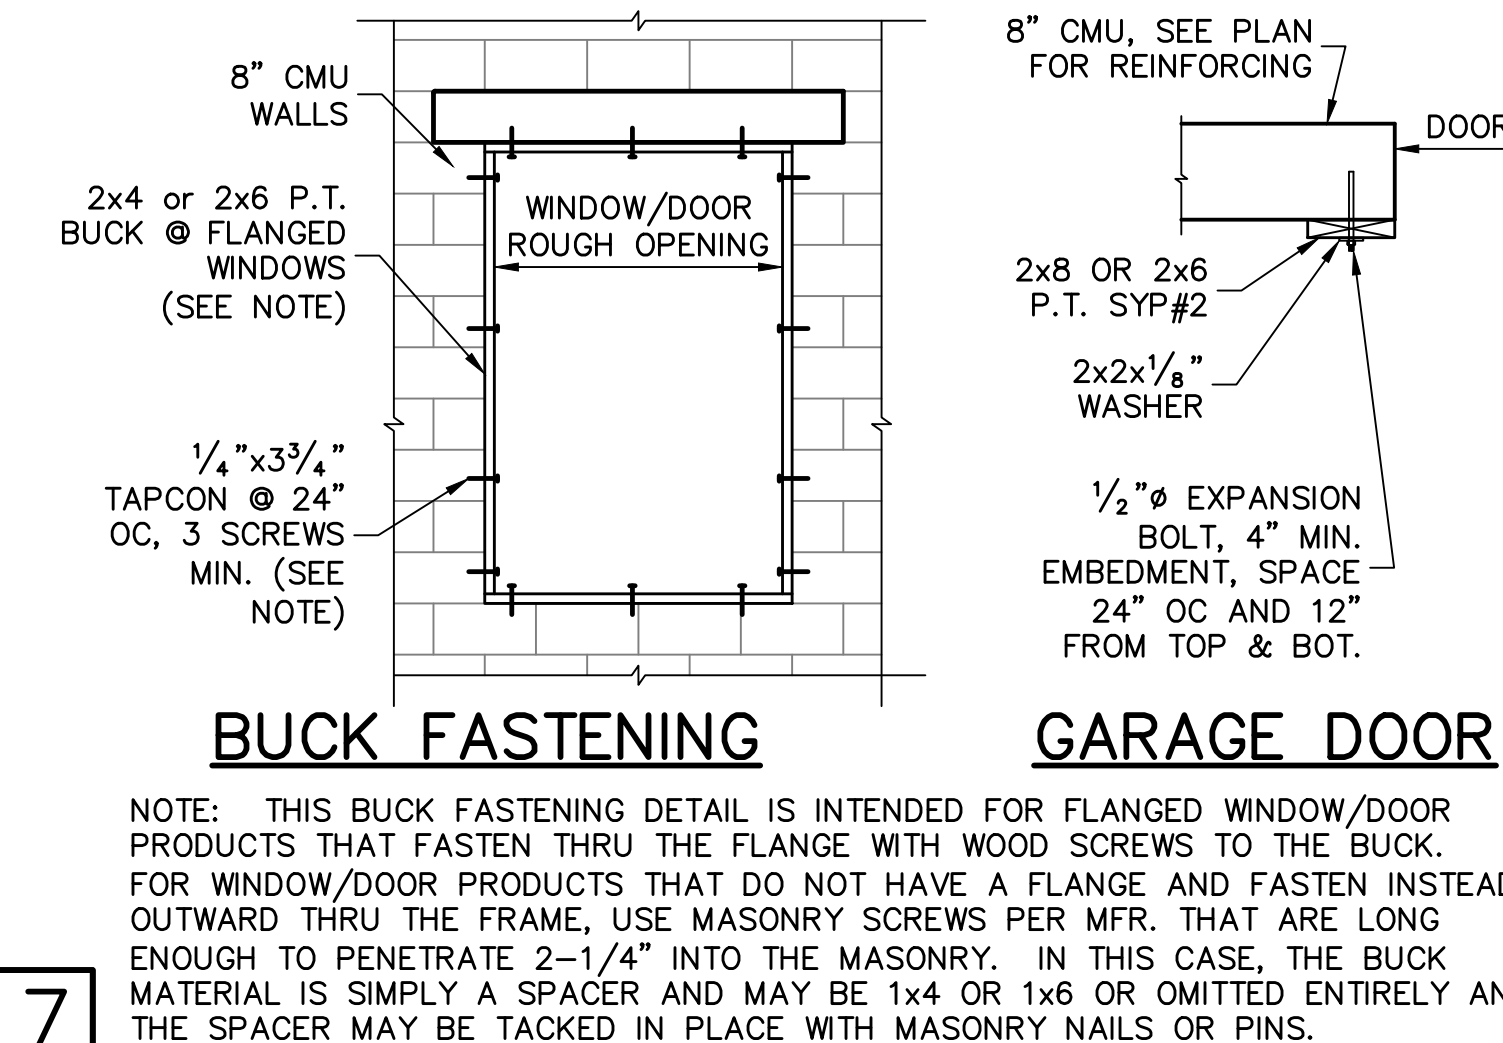

7 **BUCK FASTENING**
NOTE: THIS BUCK FASTENING DETAIL IS INTENDED FOR FLANGED WINDOW/DOOR PRODUCTS THAT FASTEN THRU THE FLANGE WITH WOOD SCREWS TO THE BUCK. FOR WINDOW/DOOR PRODUCTS THAT DO NOT HAVE A FLANGE AND FASTEN INSTEAD OUTWARD THRU THE FRAME, USE MASONRY SCREWS PER MFR. THAT ARE LONG ENOUGH TO PENETRATE 2-1/4" INTO THE MASONRY. IN THIS CASE, THE BUCK MATERIAL IS SIMPLY A SPACER AND MAY BE 1x4 OR 1x6 OR OMITTED ENTIRELY AND THE SPACER MAY BE TACKED IN PLACE WITH MASONRY NAILS OR PINS.

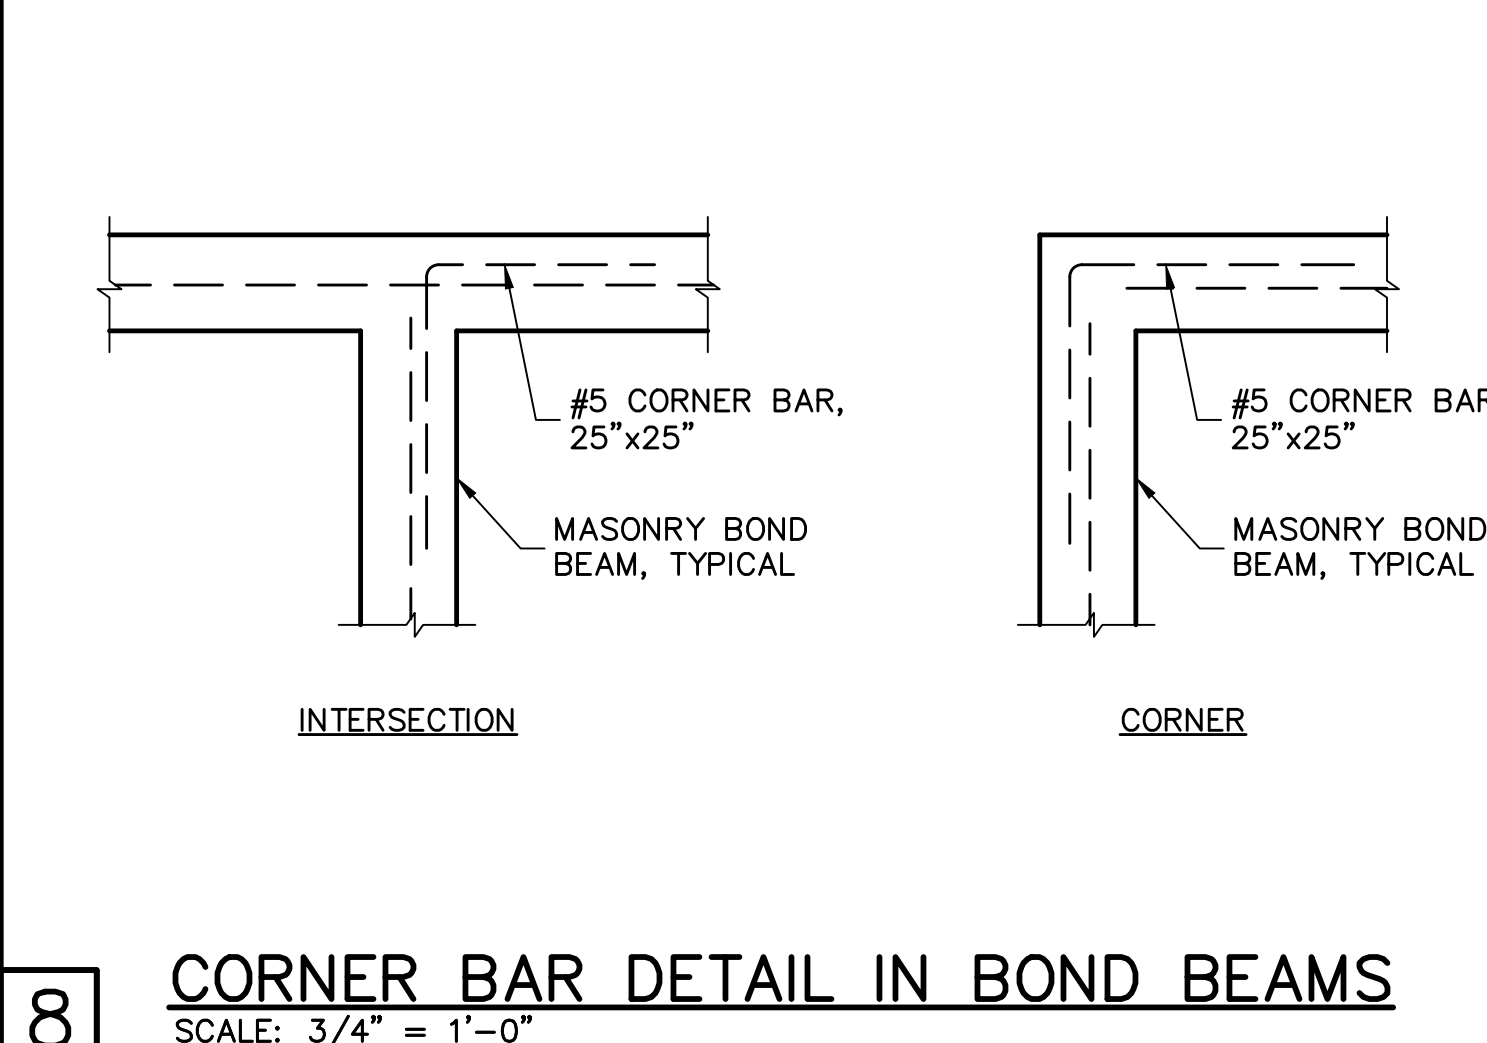


8 **CORNER BAR DETAIL IN BOND BEAMS**
SCALE: 3/4" = 1'-0"

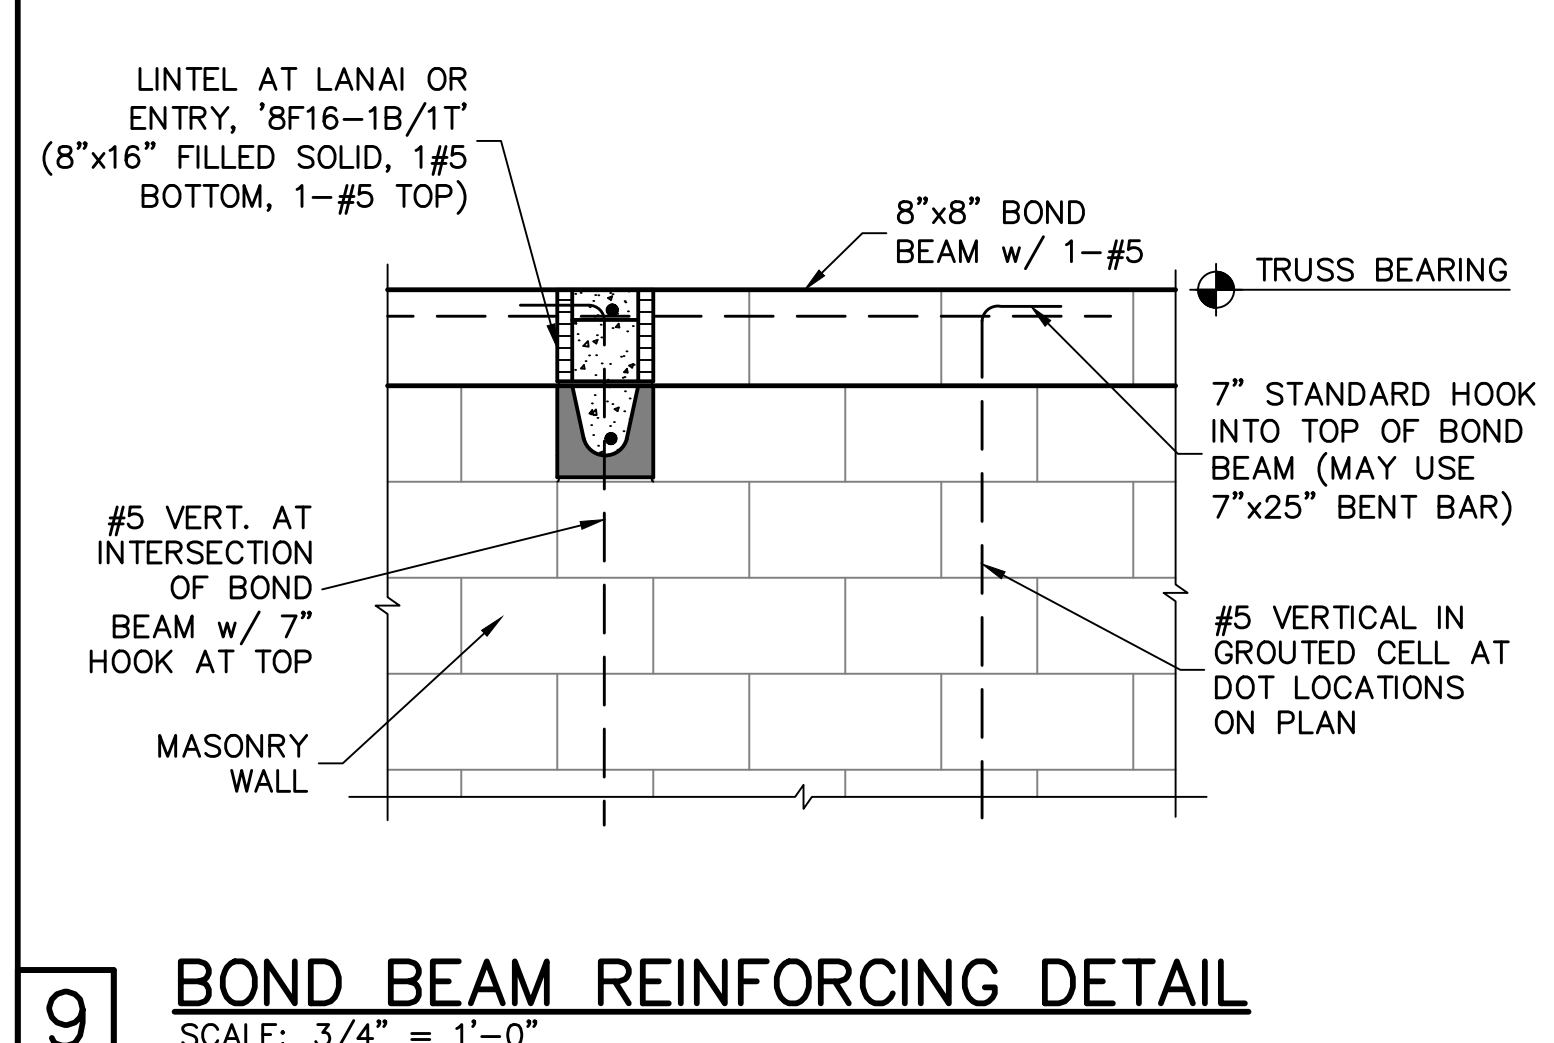


9 **BOND BEAM REINFORCING DETAIL**
SCALE: 3/4" = 1'-0"

RETROFIT STRAPS TO CONCRETE/MASONRY	
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR
TO 1145	1-HTWM16 or 20
TO 1145	1-HTWM16 or 20
TO 2290	2-HTWM16 or 20
TO 4520	2-LUGT2
TO 3610	HTT16
TO 9790	HGT-2/3


10 **RETROFIT UPLIFT CONNECTOR SCHEDULE**

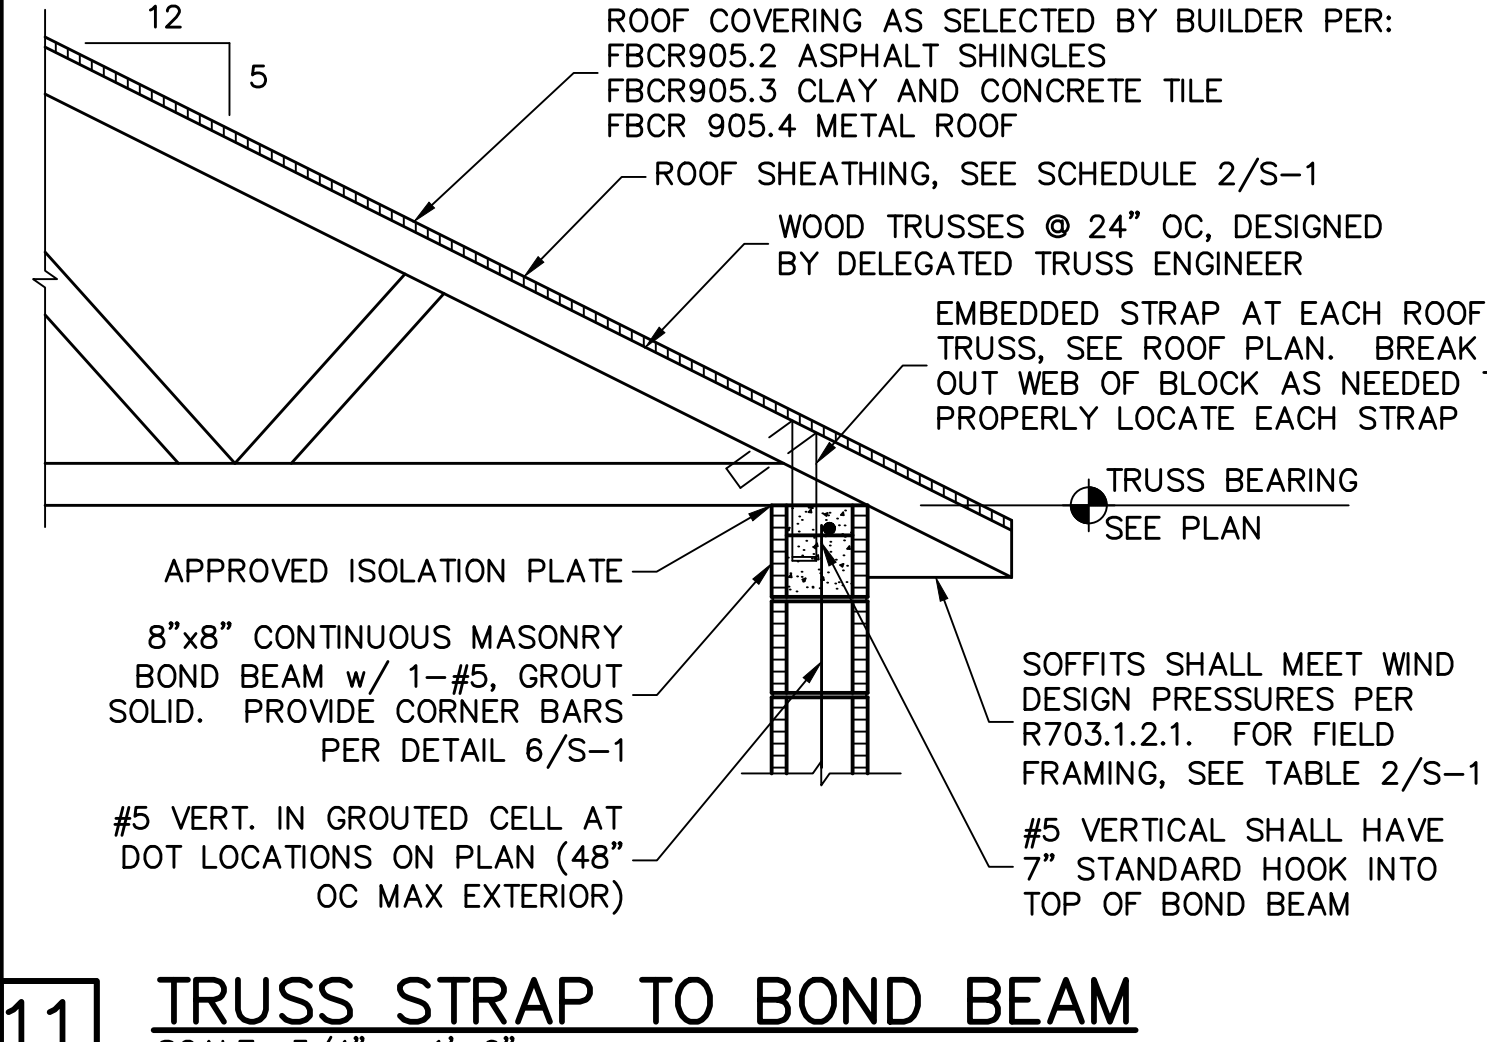

11 **TRUSS STRAP TO BOND BEAM**
SCALE: 3/4" = 1'-0"

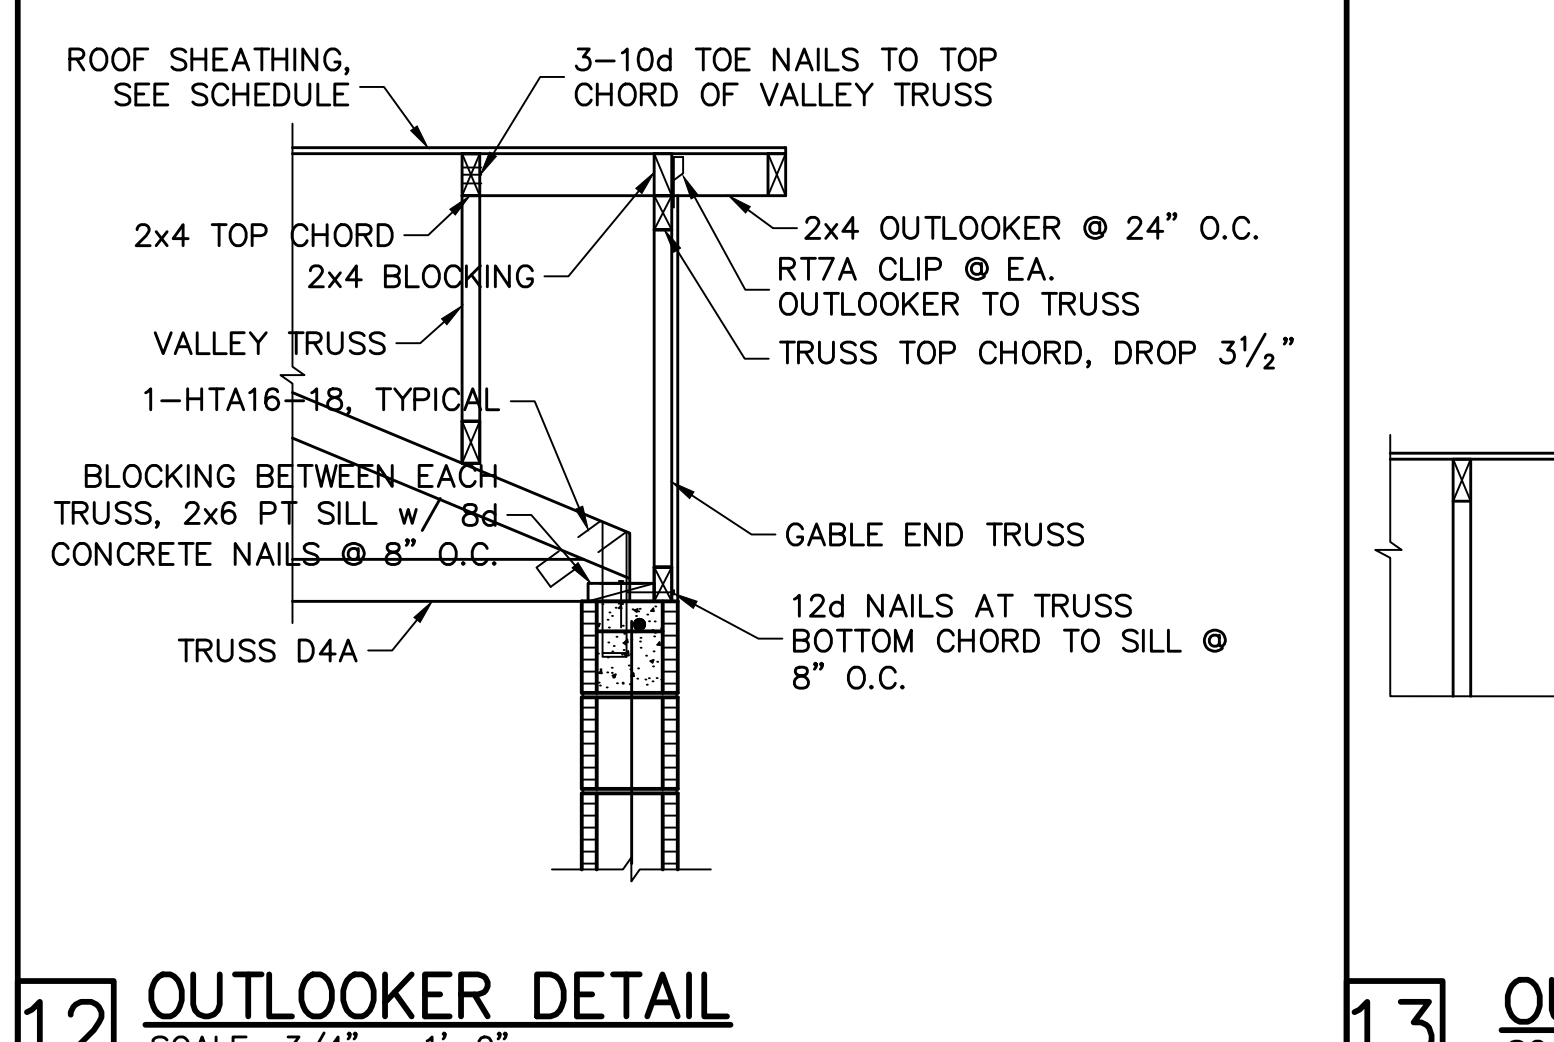

12 **OUTLOOKER DETAIL**
SCALE: 3/4" = 1'-0"

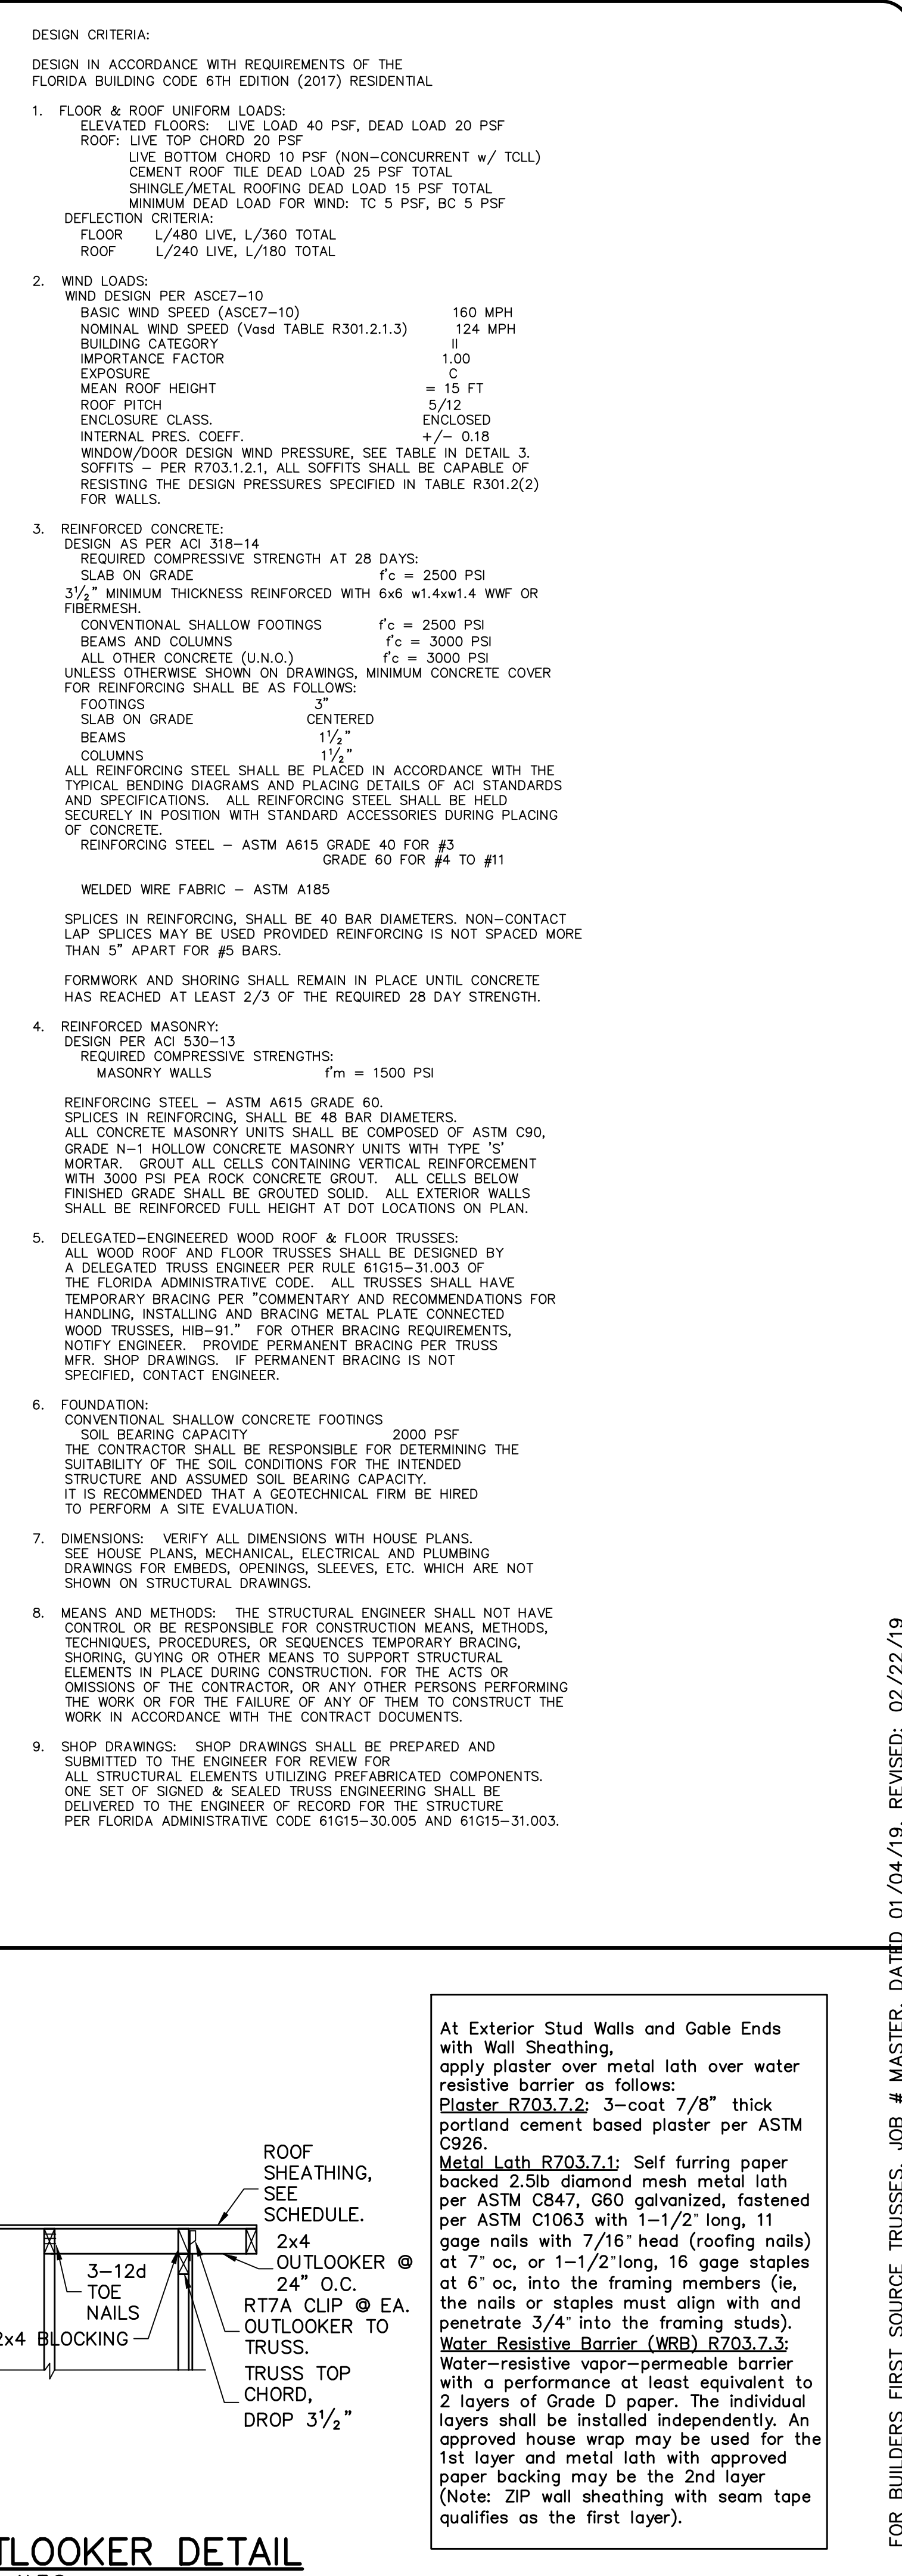

13 **OUTLOOKER DETAIL**
SCALE: N.T.S.

REVISIONS

BY

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6TH EDITION (2017) RESIDENTIAL

DESIGN/DRAWN
DWB/DWB
CHECKED
DWB
DATE
10/17/19
SCALE
AS NOTED
JOB NO.
DR11301
SHEET

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #2
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6TH EDITION (2017) RESIDENTIAL

BUILDER:



STRUCTURAL DETAILS FOR
1526 SIGNATURE VILLA
21008, 21014 FETTERBUSH PLACE
VENICE, FLORIDA
LOTS: 133-134 SUBDIVISION: WEST VILLAGES

FOR BUILDERS FIRST SOURCE TRUSSES, JOB # MASTER, DATED 01/04/19, REVISED: 02/22/19

At Exterior Stud Walls and Gable Ends with Wall Sheathing, apply plaster over metal lath over water resistive barrier as follows:
Plaster R703.7.2: 3-coat 7/8" thick portland cement based plaster per ASTM C926.
Metal Lath R703.7.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C847, G60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gage nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gage staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).
Water Resistive Barrier (WRB) R703.7.3: Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the first layer).

S-1

SHEET 1 OF 3

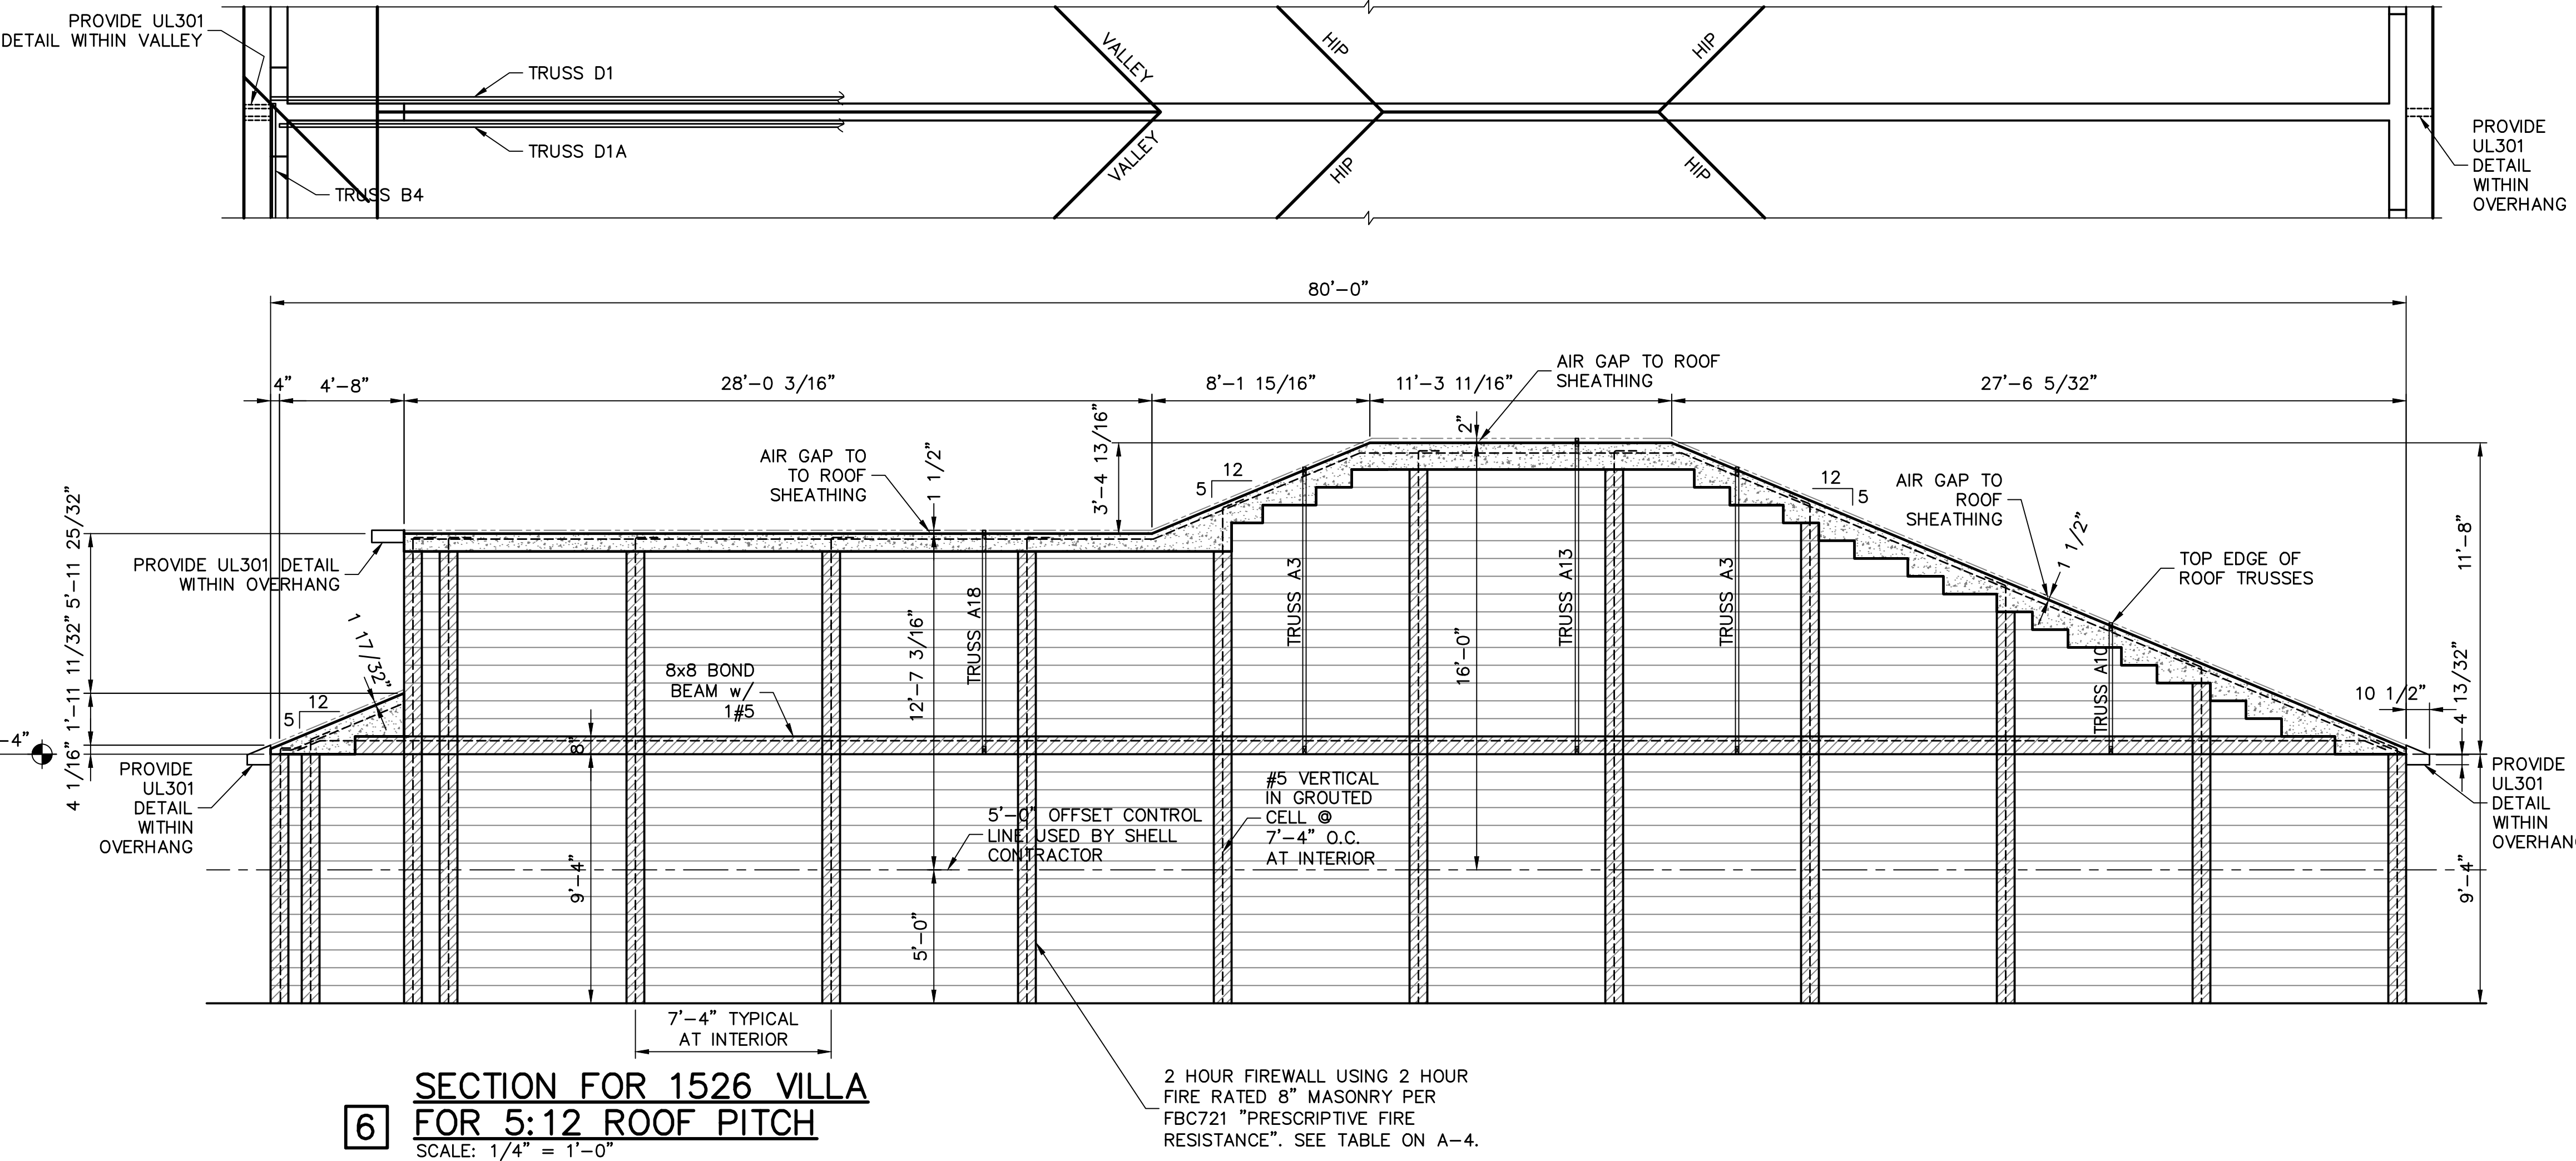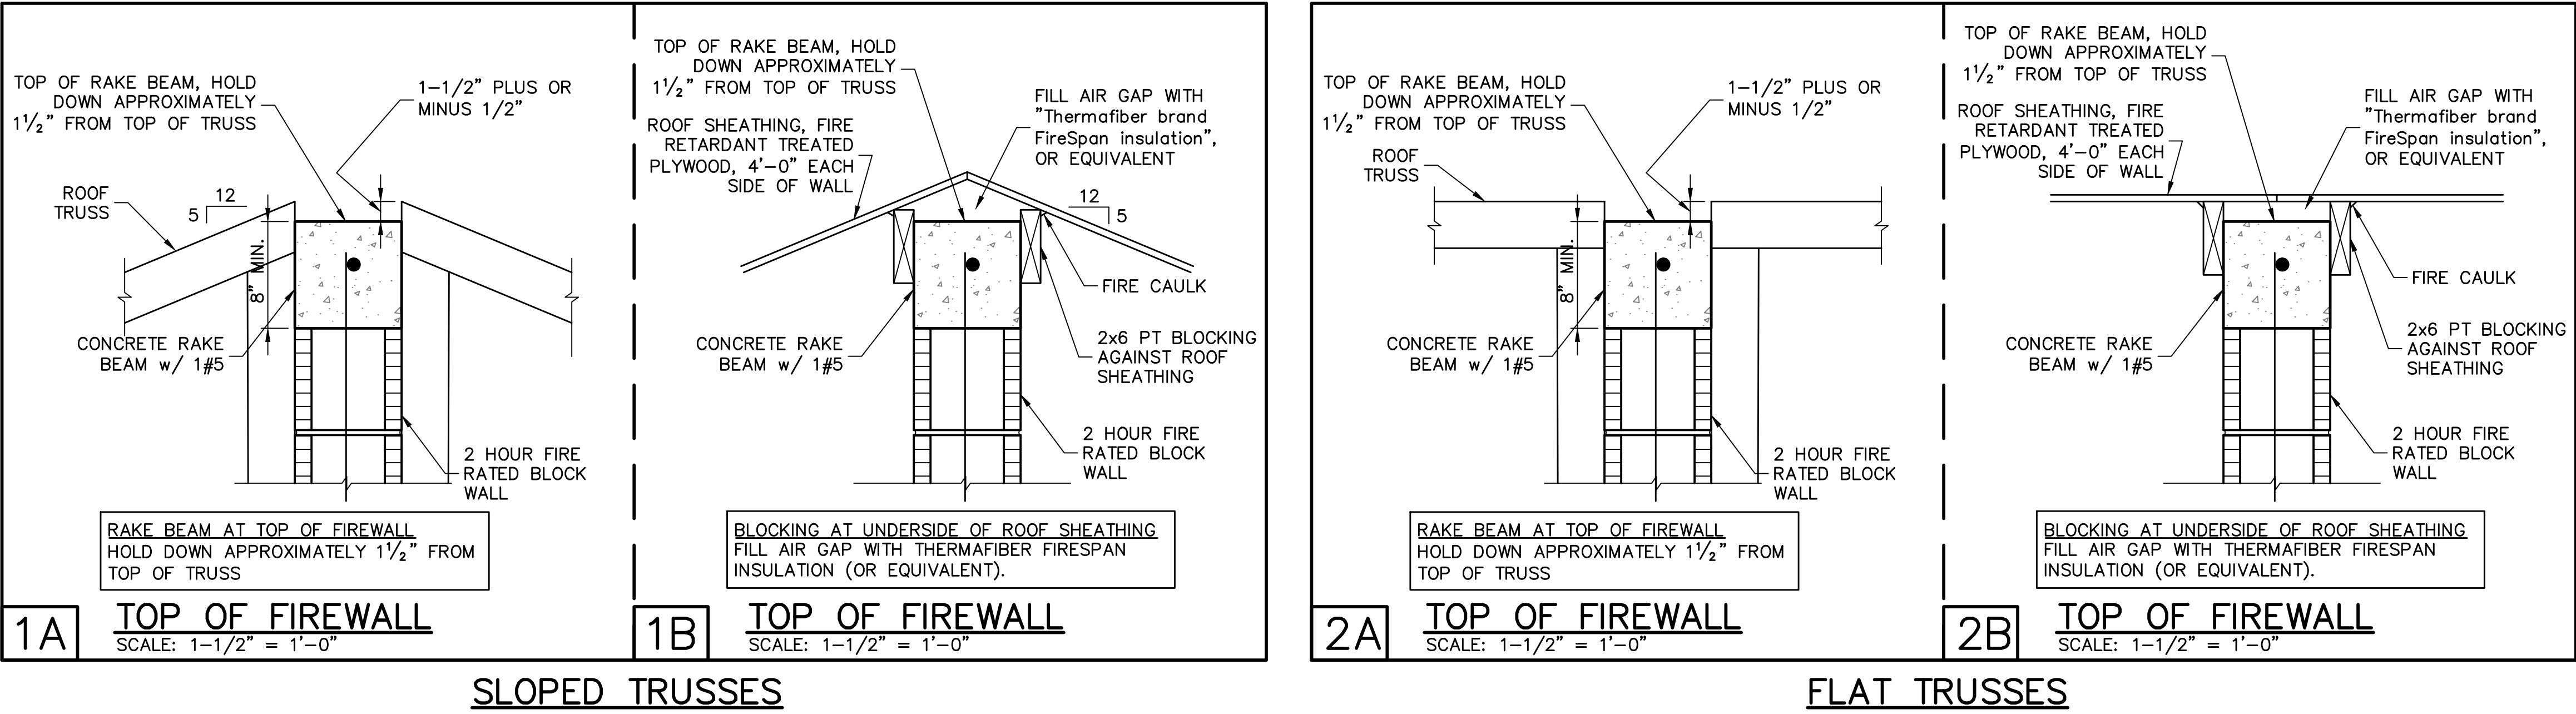

REVISIONS	BY

STRUCTURAL ENGINEERING:

STRUCTURAL
SYSTEMS
OF NORTH FLORIDA

1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

BUILDER:

STRUCTURAL DETAILS FOR

1526 SIGNATURE VILLA

21008, 21014 FETTERBUSH PLACE
VENICE, FLORIDA

LOTS: 133-134 SUBDIVISION: WEST VILLAGES

DESIGN/DRAWN	DWB/DWB
CHECKED	DWB
DATE	10/17/19
SCALE	AS NOTED
JOB NO.	DR11301
SHEET	

FOR BUILDERS FIRST SOURCE TRUSSES, JOB # MASTER, DATED 01/04/19, REVISED: 02/22/19

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 SE 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

BUILDER:

**STRUCTURAL DETAILS FOR
1526 SIGNATURE VILLA**
21008, 21014 FETTERBUSH PLACE
VENICE, FLORIDA
LOTS: 133-134 SUBDIVISION: WEST VILLAGES

DESIGN/DRAWN DWB/DWB
CHECKED DWB
DATE 10/17/19
SCALE AS NOTED
JOB NO. DR11301
SHEET

S-3
SHEET 3 OF 3

