

No.	Description	Date

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

MODEL	LOT: 37-38	BLOCK: 4758
2414	SUBDIVISION: CAPE CORAL SPOT LOTS	
	ADDRESS: 4352 SW 20TH PLACE	
GCD JOB # 11565	D.R.H. #: 578630130	

DATE:	04/01/20
DRAWN BY:	JBL
CHECKED BY:	JWC
REVISED:	
PLAN:	ELEVATION
SCALE:	$1/4" = 1'-0"$
A-1 AR	

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\SCAPE
-SPOT LOTS\1 1565 LOT 37-38 BLK 4758 2414 AR\REVIT\1 565 2414 AR.rvt

L:\O-New Data\1 - MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\CAPE SPOT LOTS\11565 LOT 37-38 BLK 4758 2414 AR\REVIT\11565 2414 AR.rvt

DOOR SCHEDULE						
TYPE MARK	DESCRIPTION	MANUFACTURER	COMMENTS	Width	Height	QTY
1	3080 ENTRY	DISTINCTION		3'-0"	8'-0"	1
2	16080 OHGD	GARAGE DOOR		16'-0"	8'-0"	1
3	8080 OHGD	GARAGE DOOR		8'-0"	8'-0"	1
4	(3)-4080 SL. GL. DR.			12'-0"	8'-0"	1
5	2880 ENTRY	DISTINCTION		2'-8"	8'-0"	1


WINDOW SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	WIDTH	HEIGHT	COMMENTS	QTY
A	2-35 SH		9'-0"	5'-3"		2
B	48" X 16"	FIXED GLASS	4'-2"	3'-4"		1
C	1/2 33 SH		2'-2"	3'-2"		2
D	25 SH		3'-2"	5'-3"		3
E	2-25 SH		6'-4"	5'-3"		1
F	2-26 SH		6'-4"	6'-4"		1

OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT


DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

PLAN NOTES	
1)	VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
2)	PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
3)	PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
4)	NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
5)	PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
6)	KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
7)	INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
8)	WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
9)	THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THAN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
10)	INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.
11)	ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
12)	ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 16" O.F.F. W/ 15" INCREMENT.
13)	ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

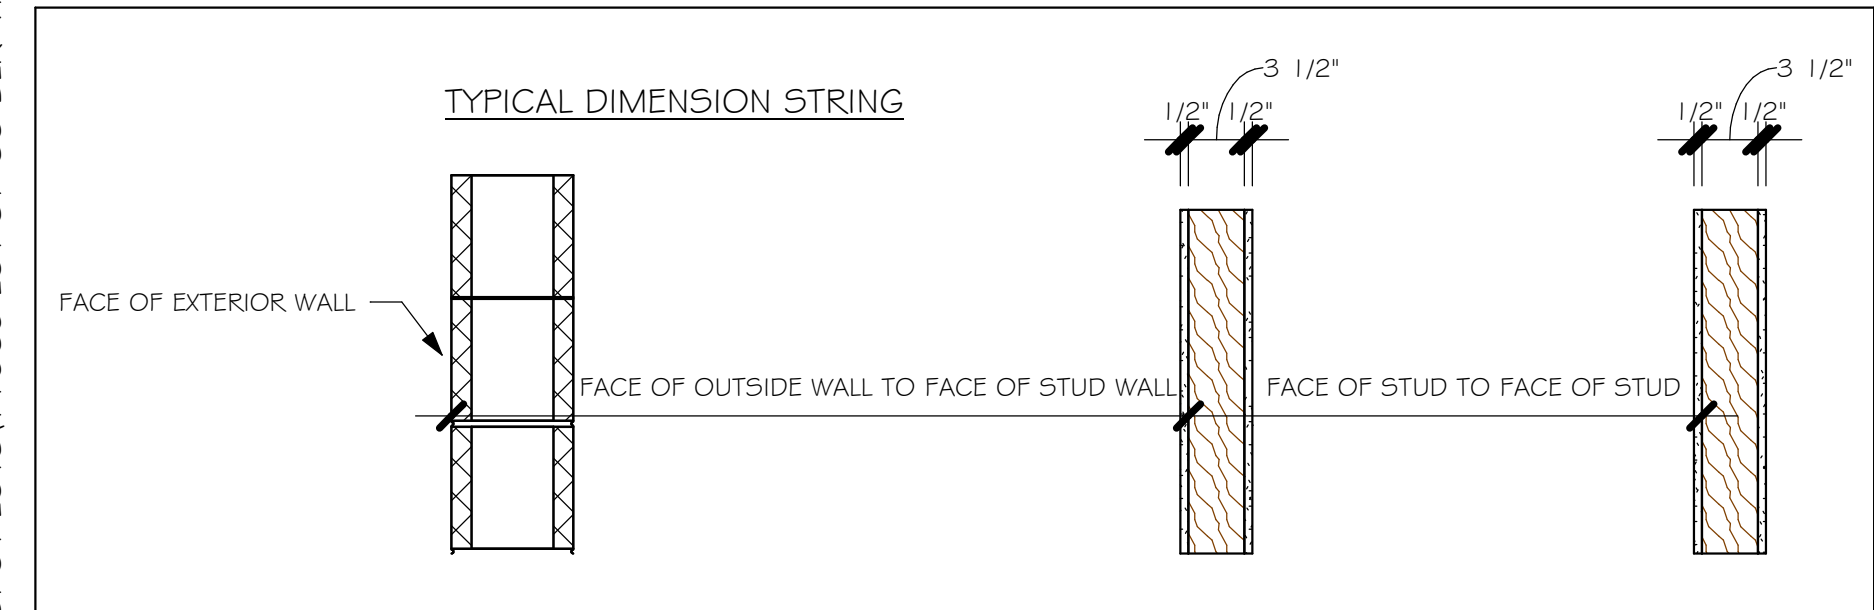


BATHROOM NOTES	
TB	TOWEL BAR
TP	TOILET PAPER

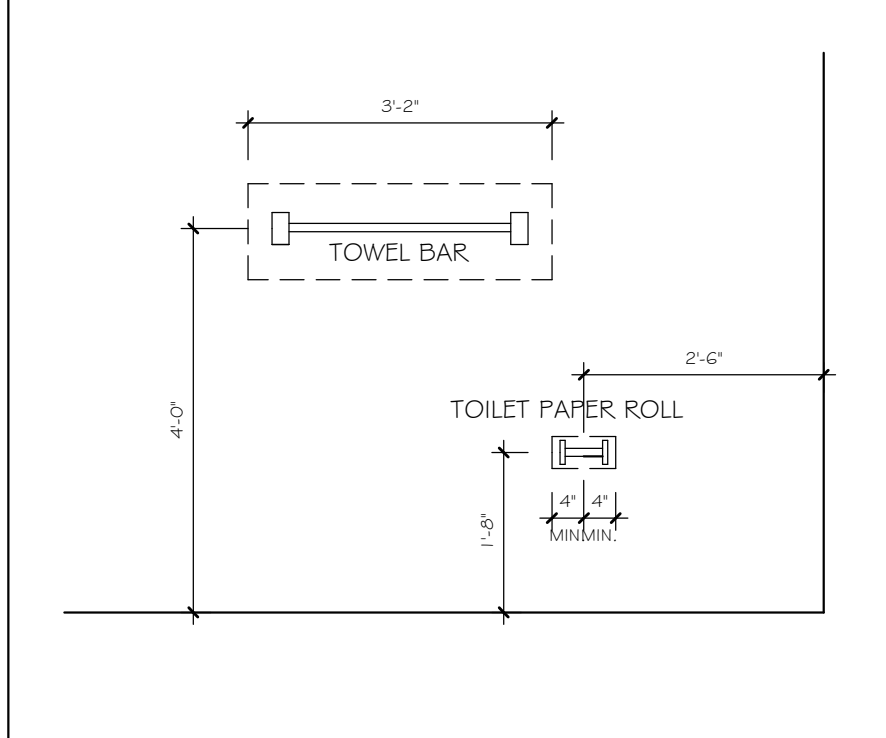

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-10"	
3	2'-8"	B.F. = BI-FOLD DOOR
4	2'-6"	B.P. = BI-PASS DOOR
5	2'-4"	
6	2'-0"	L.V. = LOUVERED DOOR
7	1'-8"	
8	1'-6"	

SQUARE FOOTAGE		
LIVING AREA		2416 SF
LANAI AREA		211 SF
GARAGE AREA		604 SF
ENTRY AREA		96 SF
TOTAL AREA		3329 SF

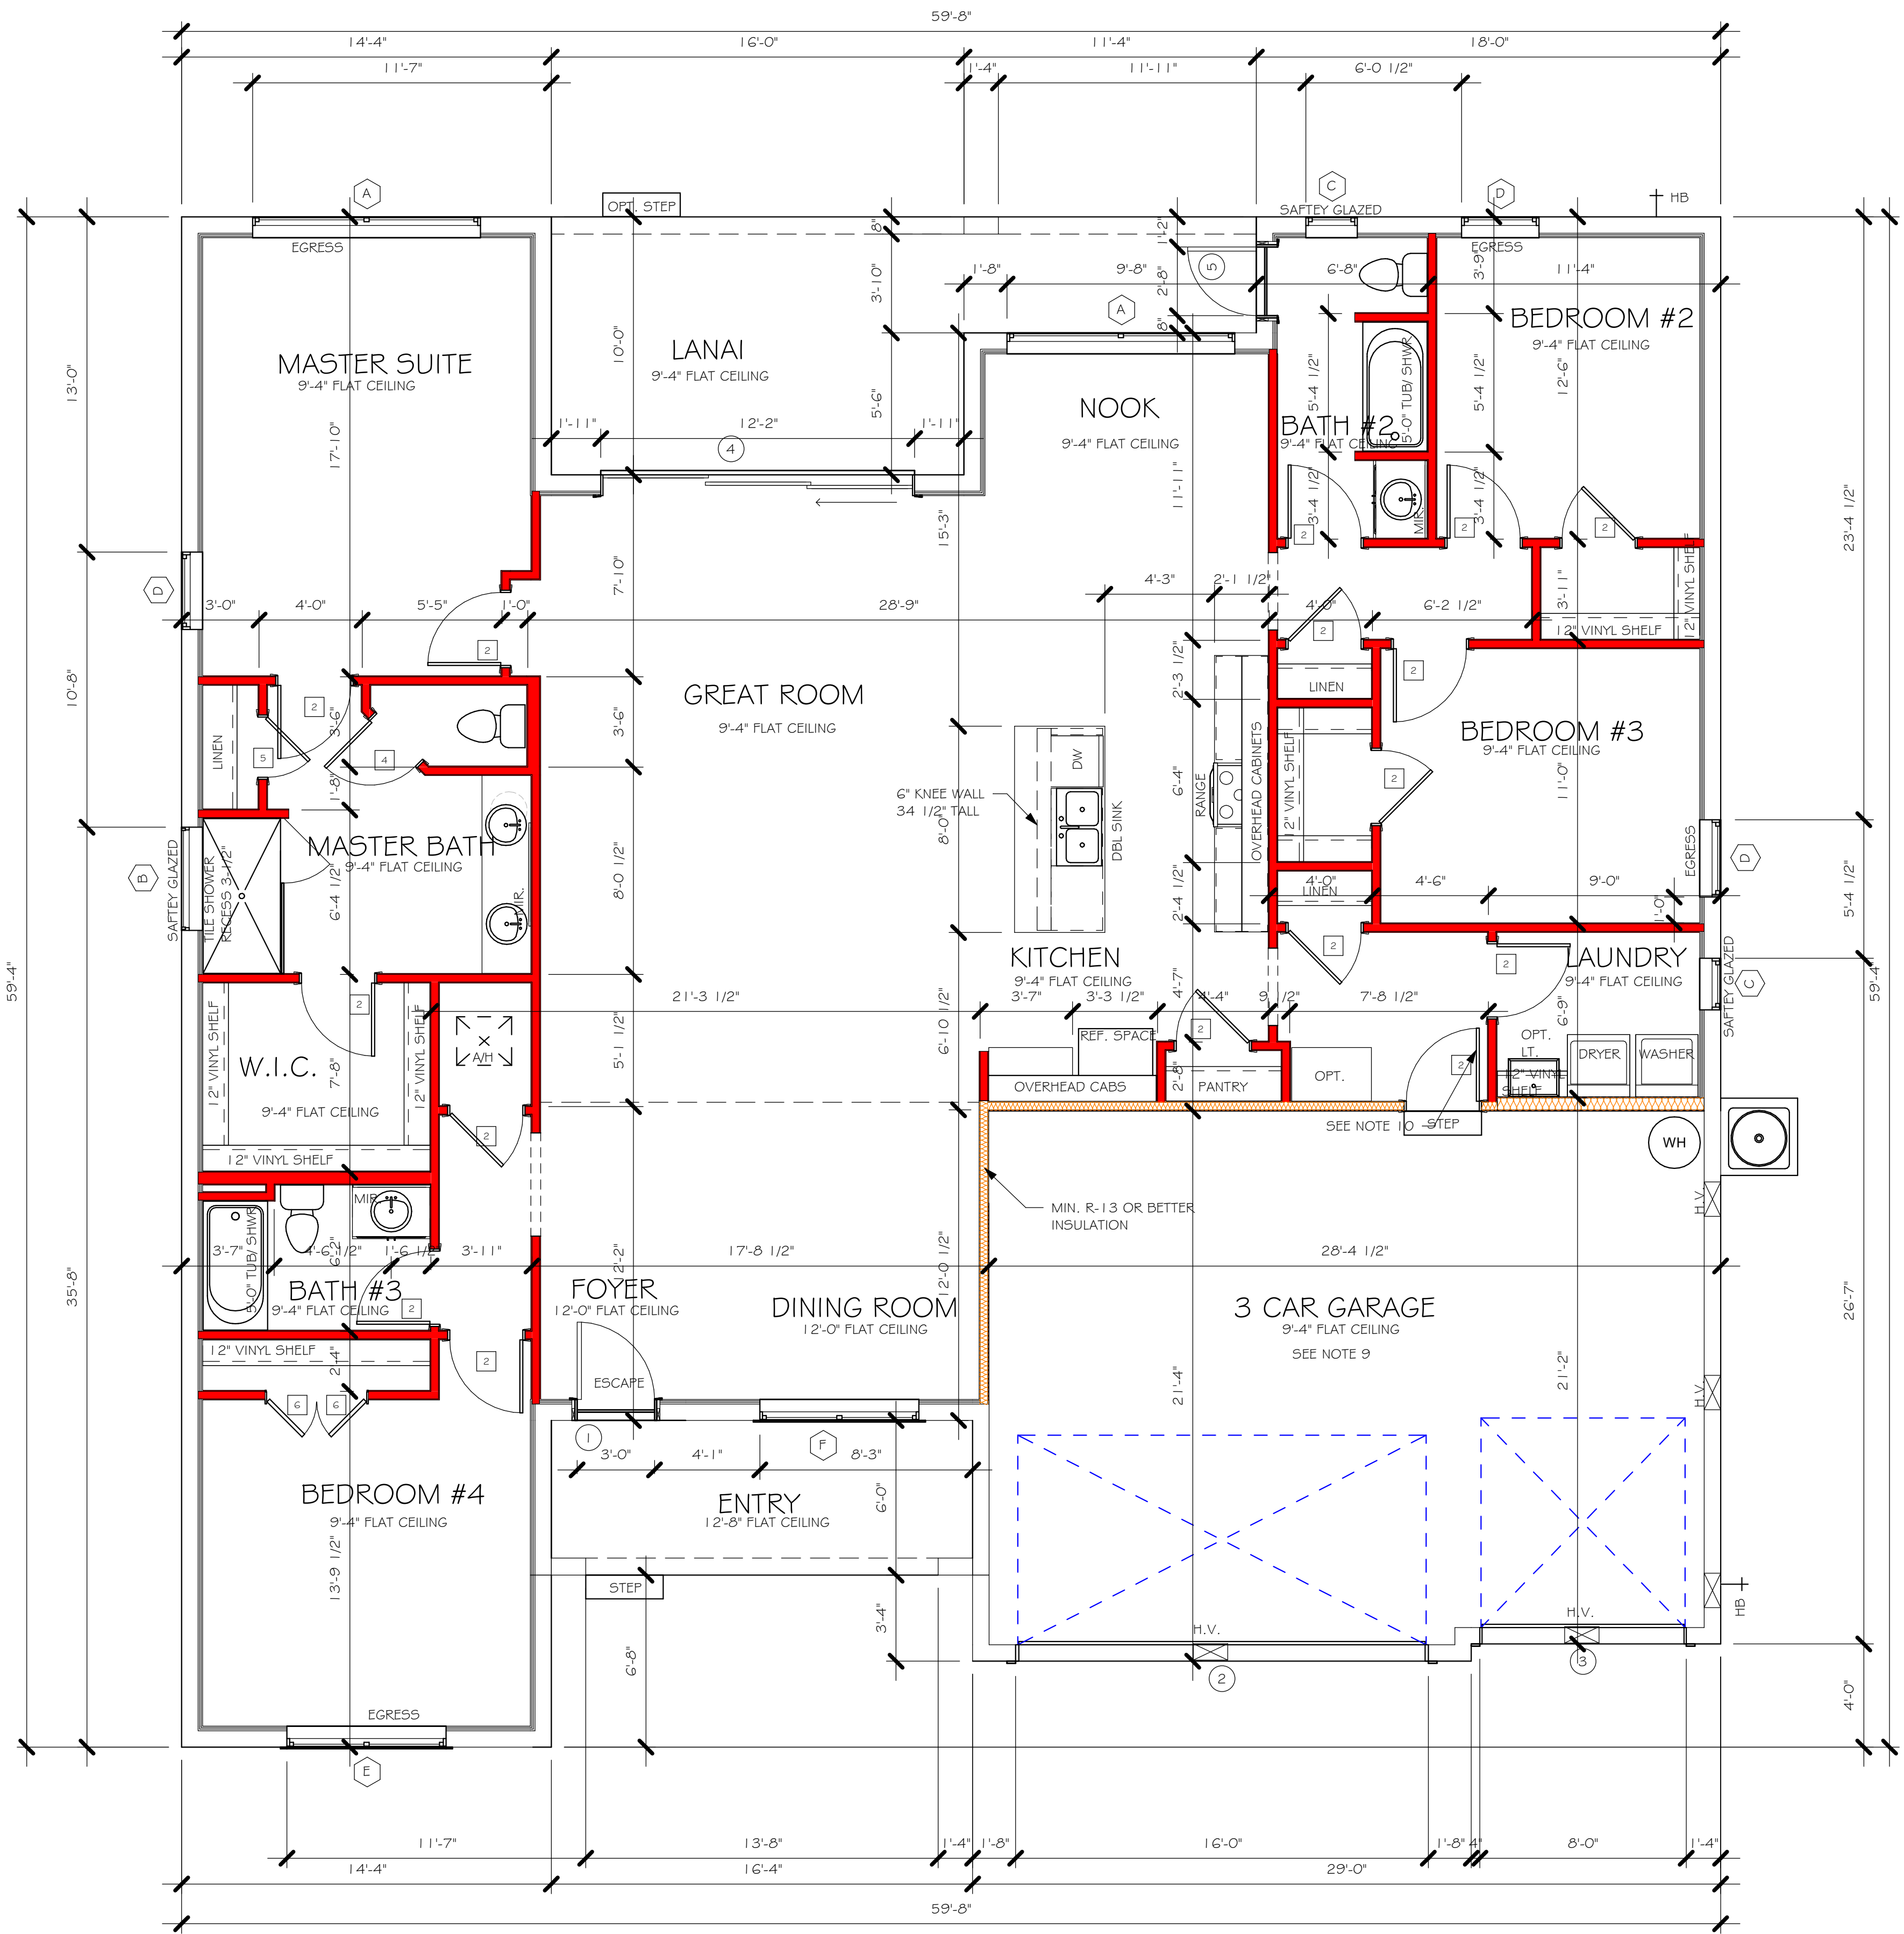

FLOOR PLAN "AR"
1/4" = 1'-0"


No.	Description	Date

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\CAPE SPOT LOTS\11565 LOT 37-38 BLK 4758 2414 AR\REVIT\11565 2414 AR.rvt

MODEL 2414 A: ATTIC VENTILATION FBCR R806									
COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS									
AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)			
			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			
MARK.	ATTIC	SOFFIT	ATTIC AREA/150	REQD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT	
1st STORY	3328.2 SQ. FT.	333.3 SQ. FT.	22.19 SQ. FT.	6.66%	0.15%	11.09 SQ. FT.	2	0.075%	
			"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED			
			SOFFIT MODEL ACM QUAD 4, FULL VENT, NARROW PATTERN, 0.15% FREE AIR FLOW			ROOF VENT MODEL 32" BASE LOMANCO 770-D 0.97 SQ. FT. FREE AIR			


BEARING HEIGHT	
	= BEARING @ 9'-4"
	= INTERIOR BEARING @ 9'-4"
	= BEARING @ 12'-8"
	= INTERIOR BEARING @ 12'-8"

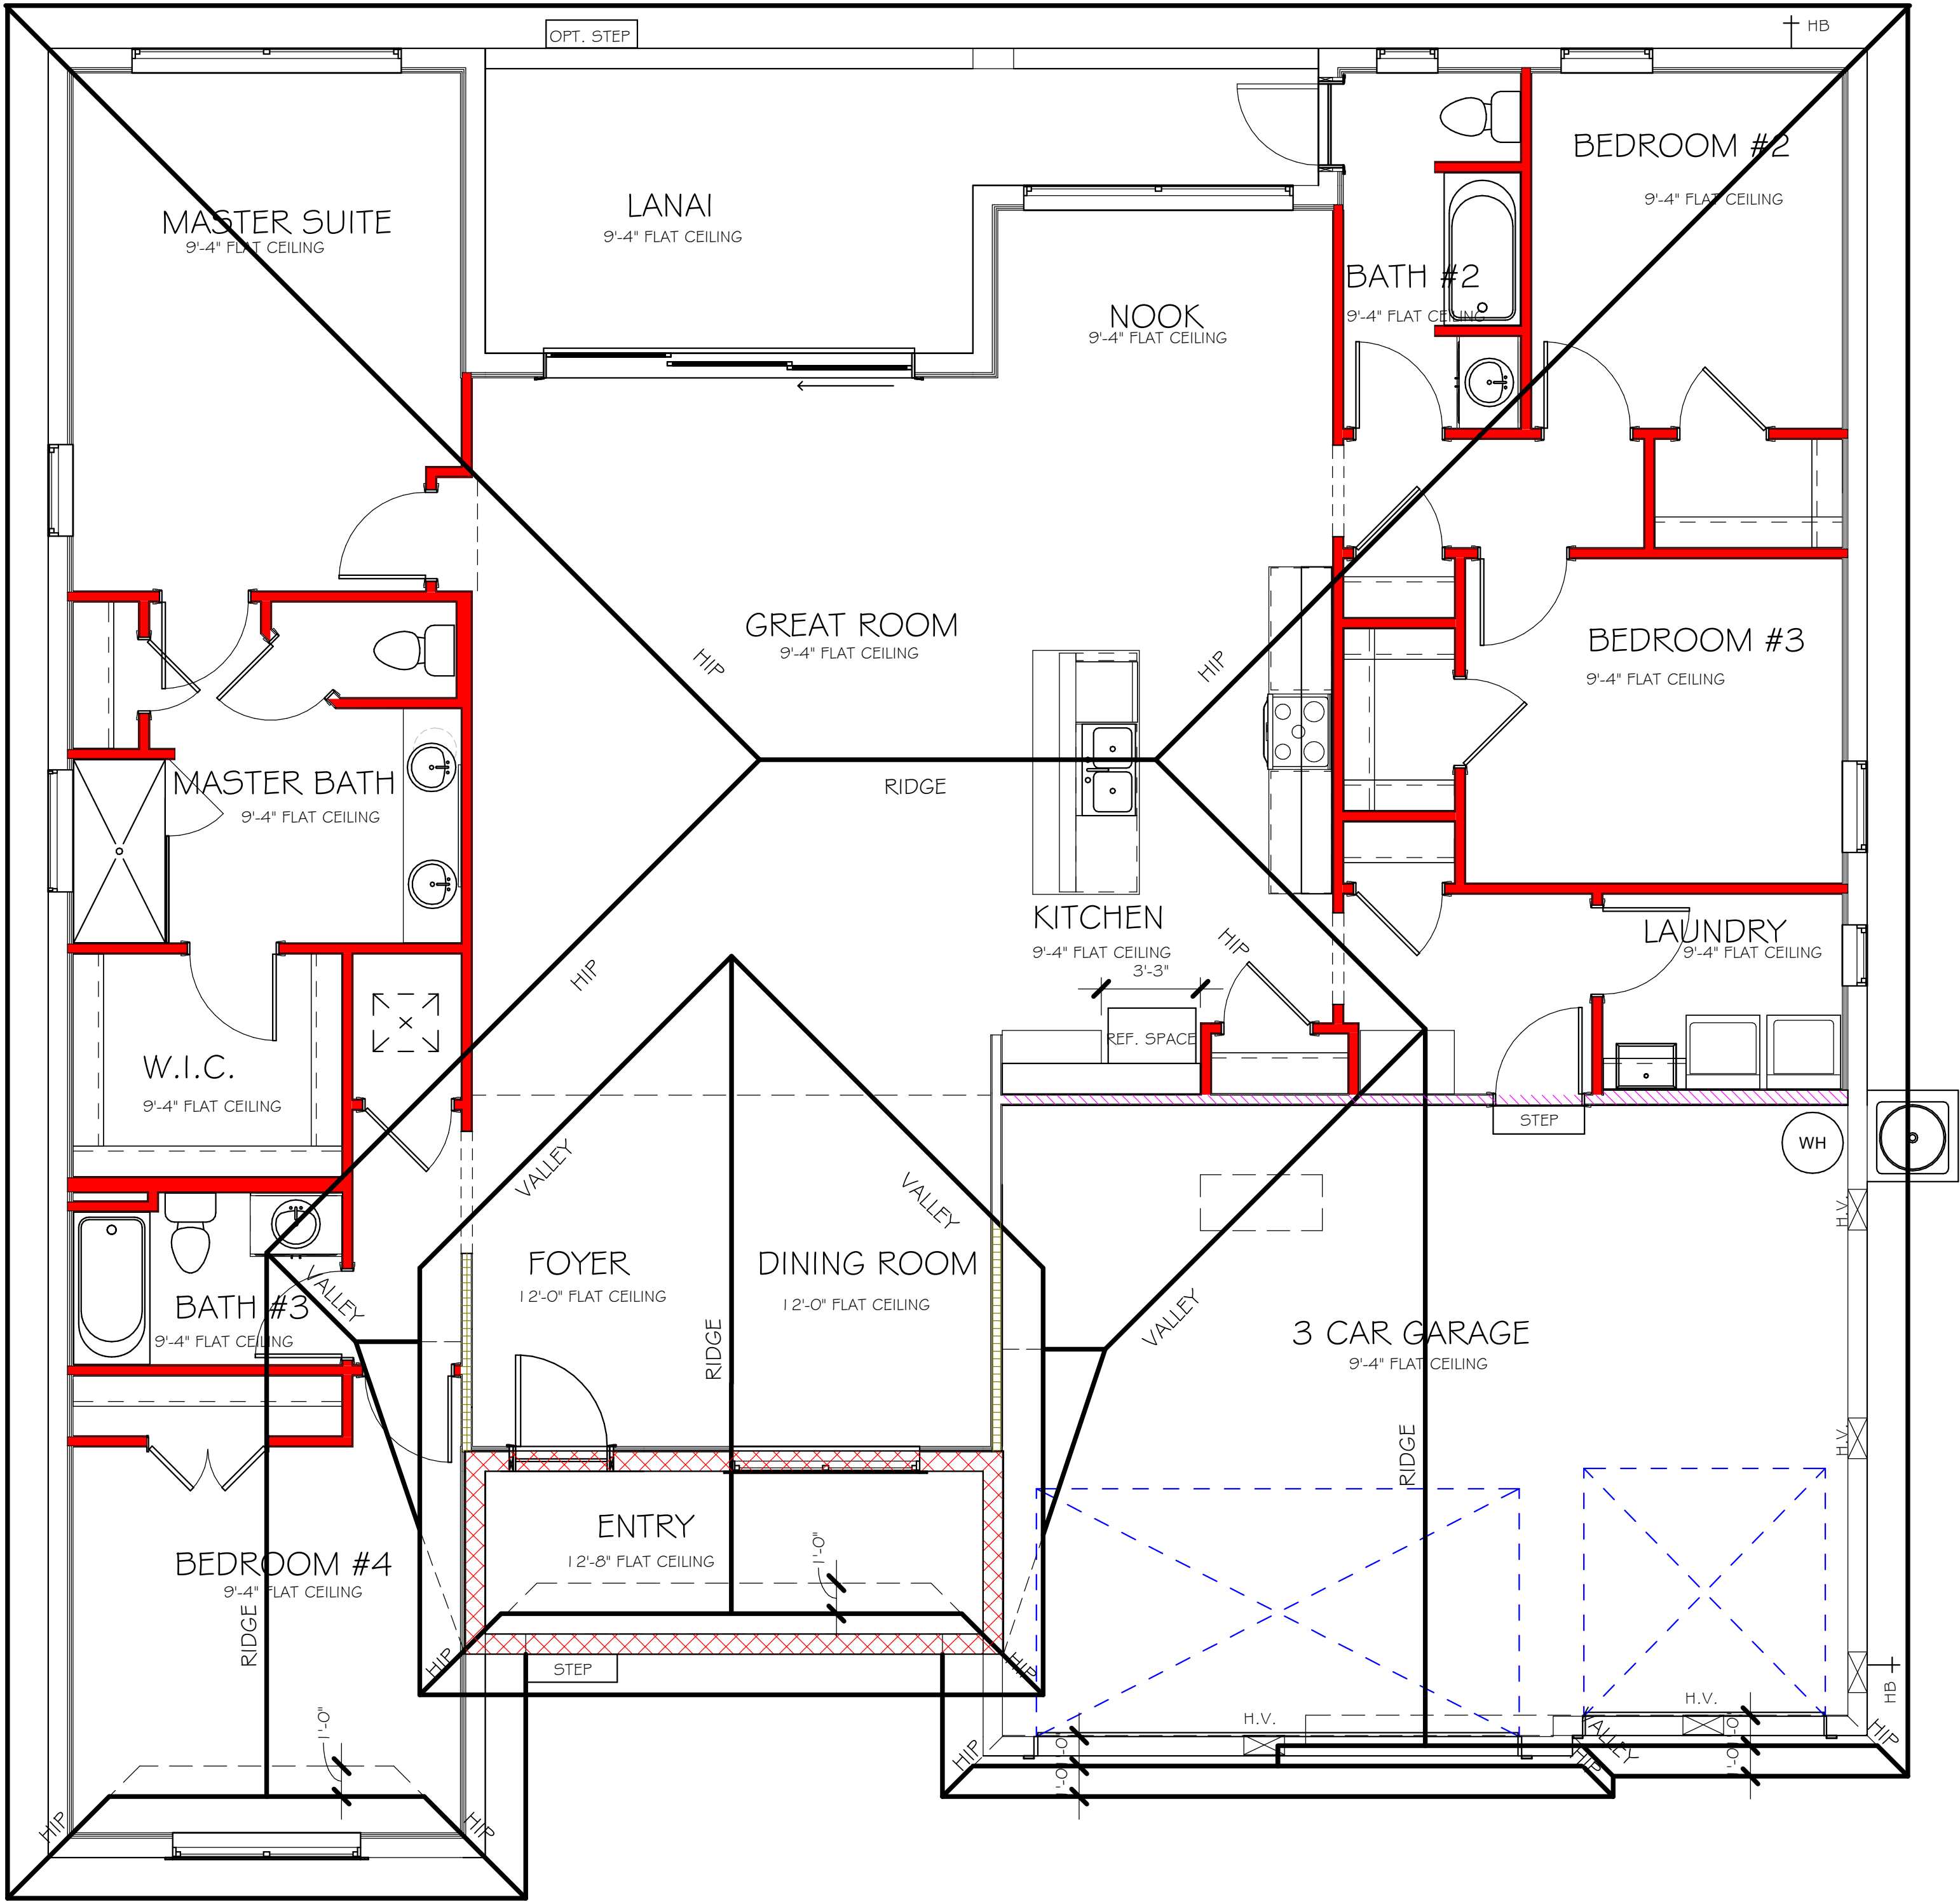


ROOF PLAN "AR"
1/4" = 1'-0"

No.	Description	Date

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

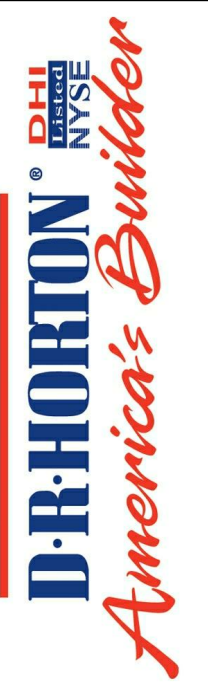

D.R. HORTON
America's Builder

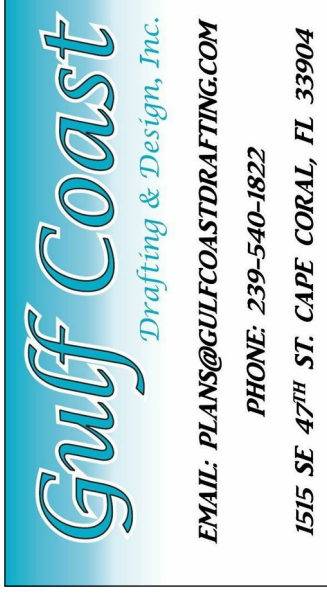

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 37-38

BLOCK: 4758

SUBDIVISION: CAPE CORAL SPOT LOTS

ADDRESS: 4352 SW 20TH PLACE

D.R.H. #: 578630130

MODEL
2414

GCD JOB # 11565

DATE: 04/01/20

DRAWN BY: JBL


CHECKED BY: JWC

REVISED:

PLAN: ROOF

SCALE: As indicated

A-4 AR

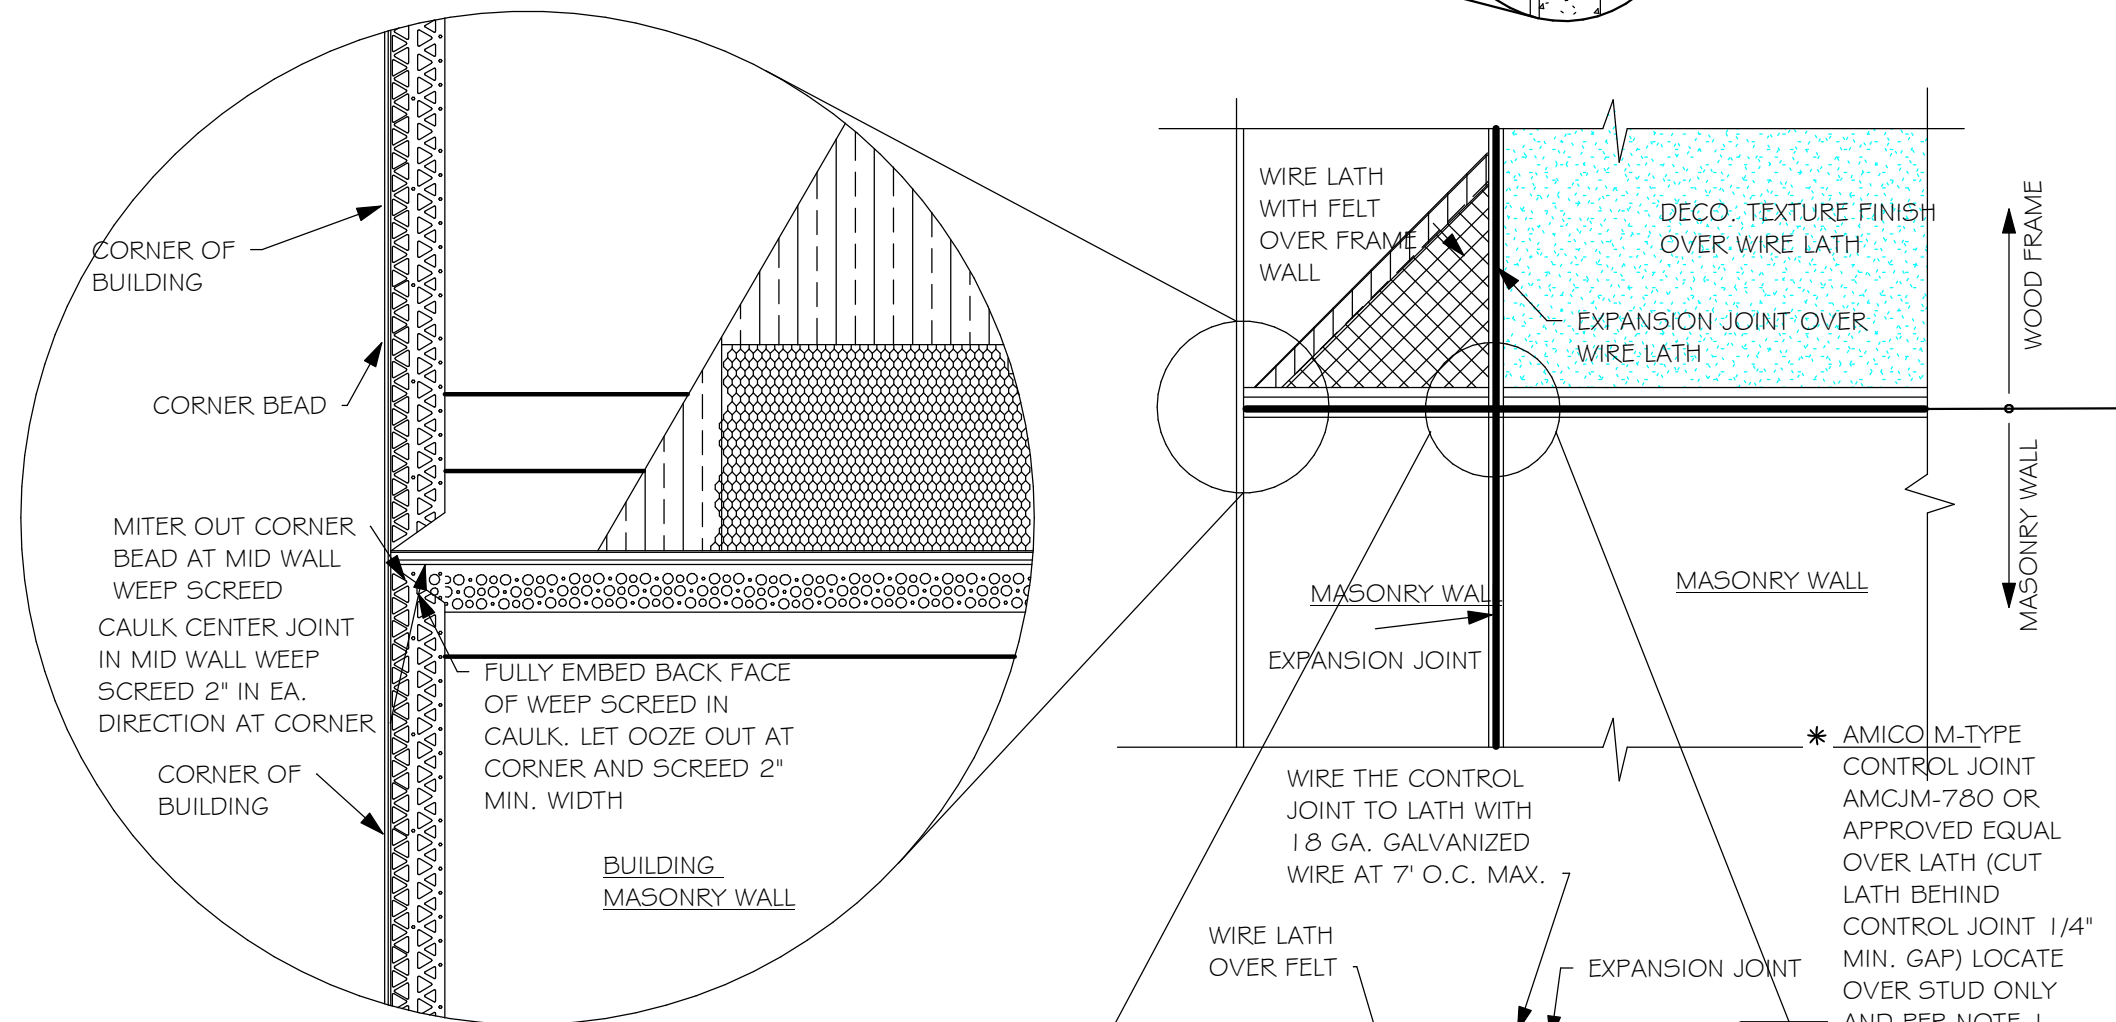

DETAIL

FRAME WALL

FELT PAPER

FELT STRIP

WIRE LATH OVER MID WALL

WEEP SCREED OVER FELT STRIP

MID WALL WEEP SCREED OVER FELT STRIP

MITER OVER SCREED

FELT STRIP OVER BLOCK WALL

MASONRY WALL

EXPANSION JOINT

FRAME ONLY

MAX OF 144 SQ. FT. BETWEEN CONTROL JOINTS. NOT GREATER THAN 18'-0" O.C. MAX AREA RATIO OF CONTROL JOINTS 5-2-211 TO

DECO. TEXTURE FINISH OVER WIRE LATH

INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE
WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

WHERE "PAN" FLASHING IS USED AT THE SILL, ALSO INCORPORATE FLASHING OR PROTECTION AT THE HEAD AND SIDES

"PAN FLASHING" IS A GENERIC TERM THAT USED TO REFER TO "METAL PAN FLASHING". HOWEVER MANY MODERN MATERIALS HAVE BEEN DEVELOPED FOR THE SAME FUNCTION SUCH AS:

- FLEXIBLE PEEL AND STICK FLASHING MEMBRANE
- FLUID APPLIED FLASHING

FOR SUCH PRODUCTS FOLLOW THE MANUFACTURER'S INSTALLATION REQUIREMENTS

FOR IN-DEPTH FLASHING INSTRUCTIONS, REFER TO THE FOLLOWING PUBLICATIONS:

- FMA/AAMA 100
- FMA/AAMA 200
- FMA/WDMA 250
- FMA/AAMA/WDMA 300

THE FLASHING INSTRUCTIONS FROM THE WINDOW/ DOOR MFR., OR THE FLASHING MFR.,
SHALL SUPERCEDE THIS DETAIL

SCALE: N.T.S.

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE. FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
7. TREATED WOOD REQUIREMENTS:-
ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY.
ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LAMAI CEILINGS + COVERED ENTRY CEILINGS
1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS, 5/8" INTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

ROOF SHEATHING
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES.
A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "T" CLIPS TO INSURE SUPPORTED PANEL EDGES. THE ROOF SHEATHING SHALL BE NAILED WITH 8d RING SHANK NAILS @ 4" O.C. EDGE AND 6" O.C. FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSSES WITHOUT SPLITTING. RING SHANK NAILS PER #803.2.3.1 - 0.113" NOMINAL SHANK DIAMETER, RING DIAMETER OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL, 0.0179" THICK, 26 GAUGE A250 ALUM ZINC, OR GALVANIZED STEEL 0.01719" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURERS PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, AND SHINGLED ROOFS. DRIP EDGE SHALL BE EXTENDED OUTSIDE EDGE OF SHINGLES AND EXTEND A MINIMUM OF 1" OVER SHEATHING AND TO THE INSULATION. DRIP EDGE SHALL EXTEND BAY MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.



15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURER. INSTALLATION SHALL COMPLY WITH MANUFACTURERS REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

FASTENERS
FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 12 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESISTANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL

INSTALL STEEL PEEB AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING,
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,
A. AMOUNT AND PLACEMENT OF MORTART
B. AMOUNT AND PLACEMENT OF ADHESIVE
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS,
3. UNDERLAYMENT
4. SLOPE REQUIREMENT.


A.P.A. RATED STURDI-FLOOR, EXPOSURE I, TONGUE & GROOVE EDGES
SPAN RATING 48/24 OR BETTER, GLUED AND NAILED

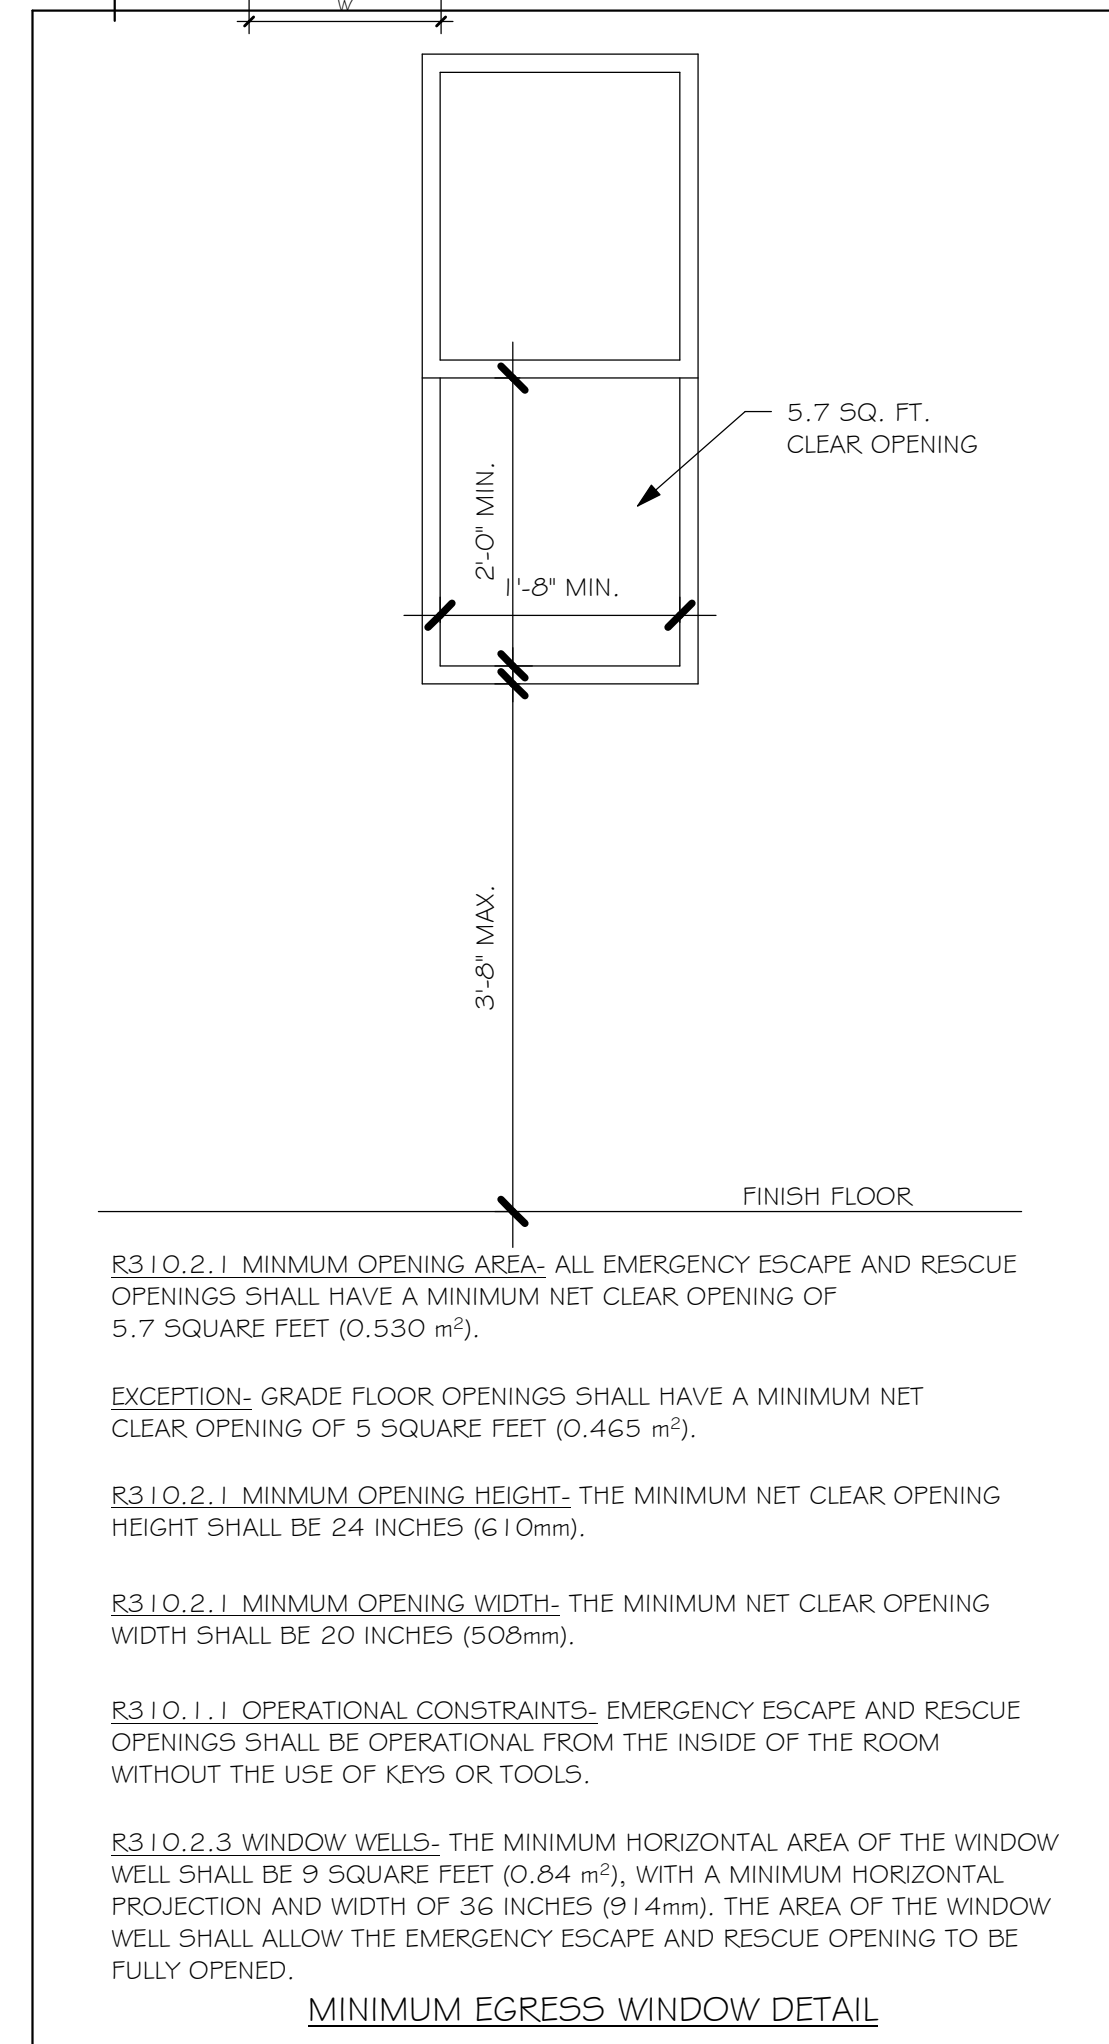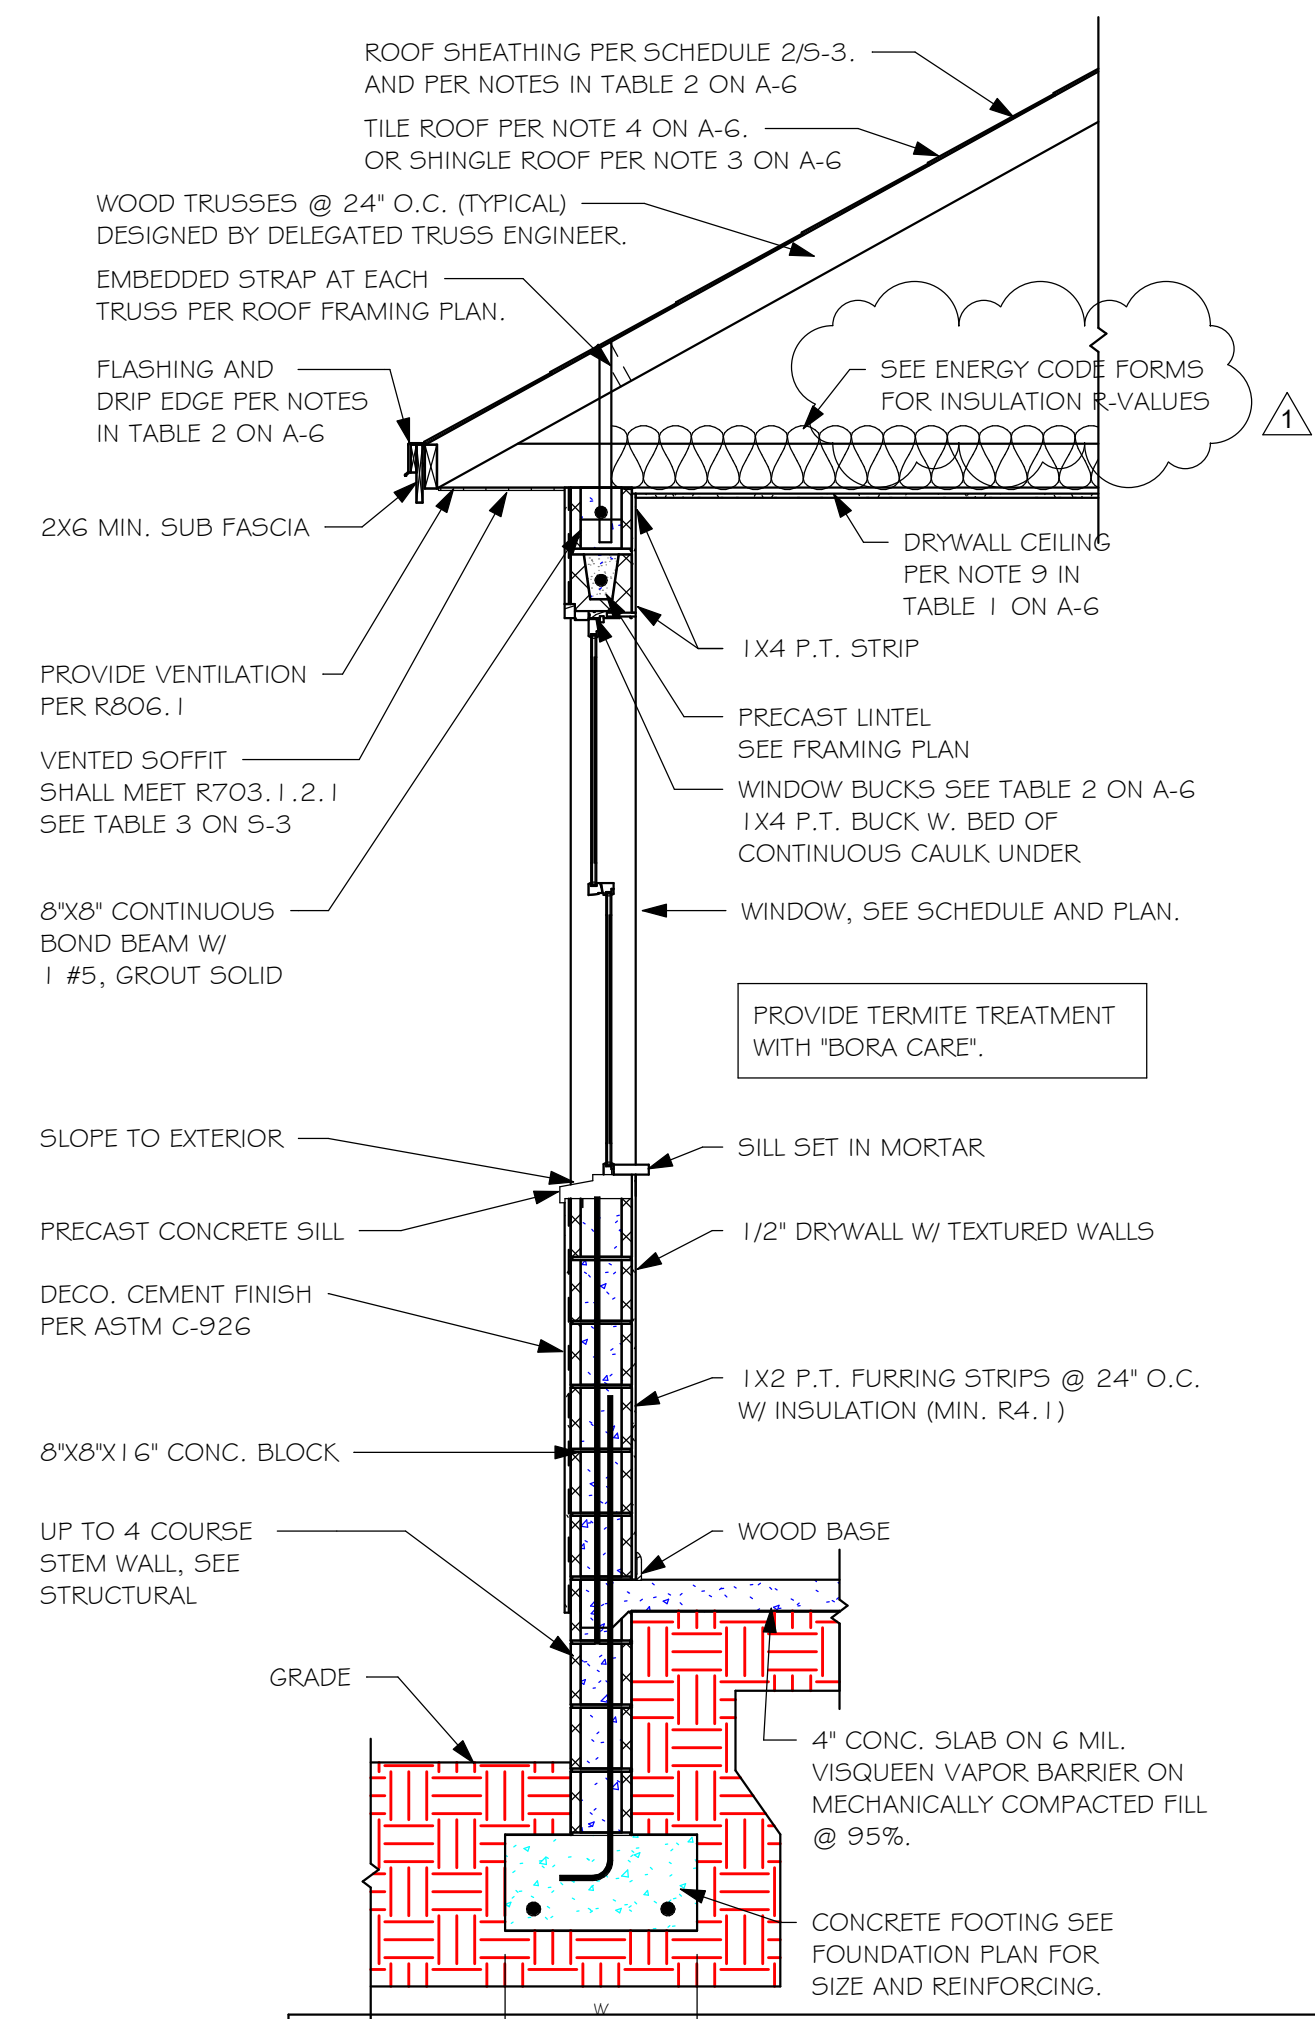


No.	Description	Date
1	UPDATED ENERGY CODE NOTE ON A-6	07/06/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1-Master 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\CAPE SPOT LOTS\11565 LOT 37-38 BLK 4758 2414 AR\REV11565 2414 AR.rvt

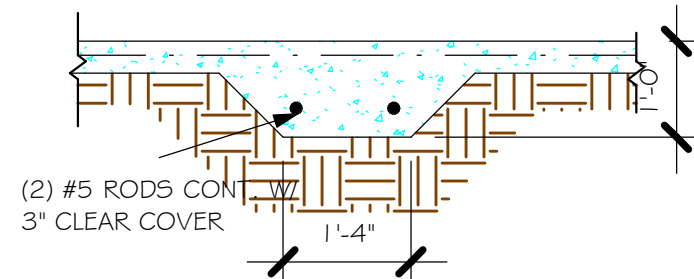

"F5" FOOTING
1/2" = 1'-0"

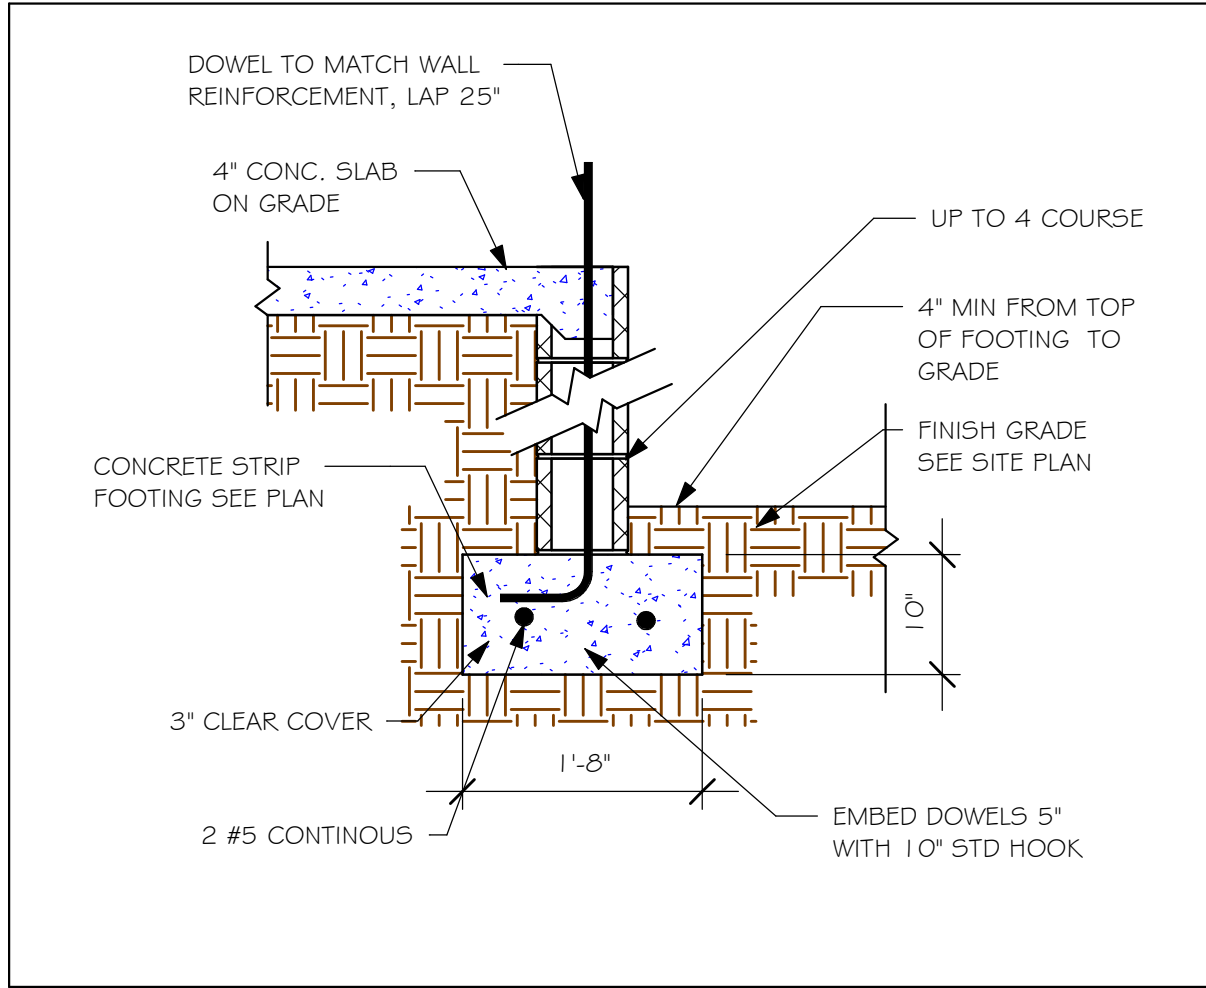

NOTE: REINFORCING IN FOOTINGS SHALL BE CONTINUOUS AT CORNERS AND INTERSECTIONS. ADD CORNER BAR 25" X 25" AT EACH LONGITUDINAL BAR.

WALL FOOTING SCHEDULE					
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING
	F1	CONT.	1'-4"	0'-8"	2-#5
X	F2	CONT.	1'-8"	0'-10"	2-#5
X	F3	CONT.	1'-0"	1'-8"	2-#5
	F4	CONT.	1'-4"	1'-8"	2-#5
X	F5	CONT.	1'-4"	1'-0"	2-#5
	F6	CONT.	1'-4"	1'-0"	2-#5
	F6A	CONT.	0'-8"	0'-8"	1-#5
	TE	CONT.	0'-8"	0'-8"	1-#5

PROVIDE CORNER BARS IN FOOTING PER 6/3-3

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
X	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
X	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
X	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
X	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
X	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-


FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

PLAN NOTES:

1. TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
2. "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
3. PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
4. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
5. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
6. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/5-3.


FOOTING F2 IS ADEQUATE FOR THE POINT LOAD FROM GIRDER A1 ABOVE. THE PRESENCE OF THE WINDOW DISTRIBUTES THE LOAD.

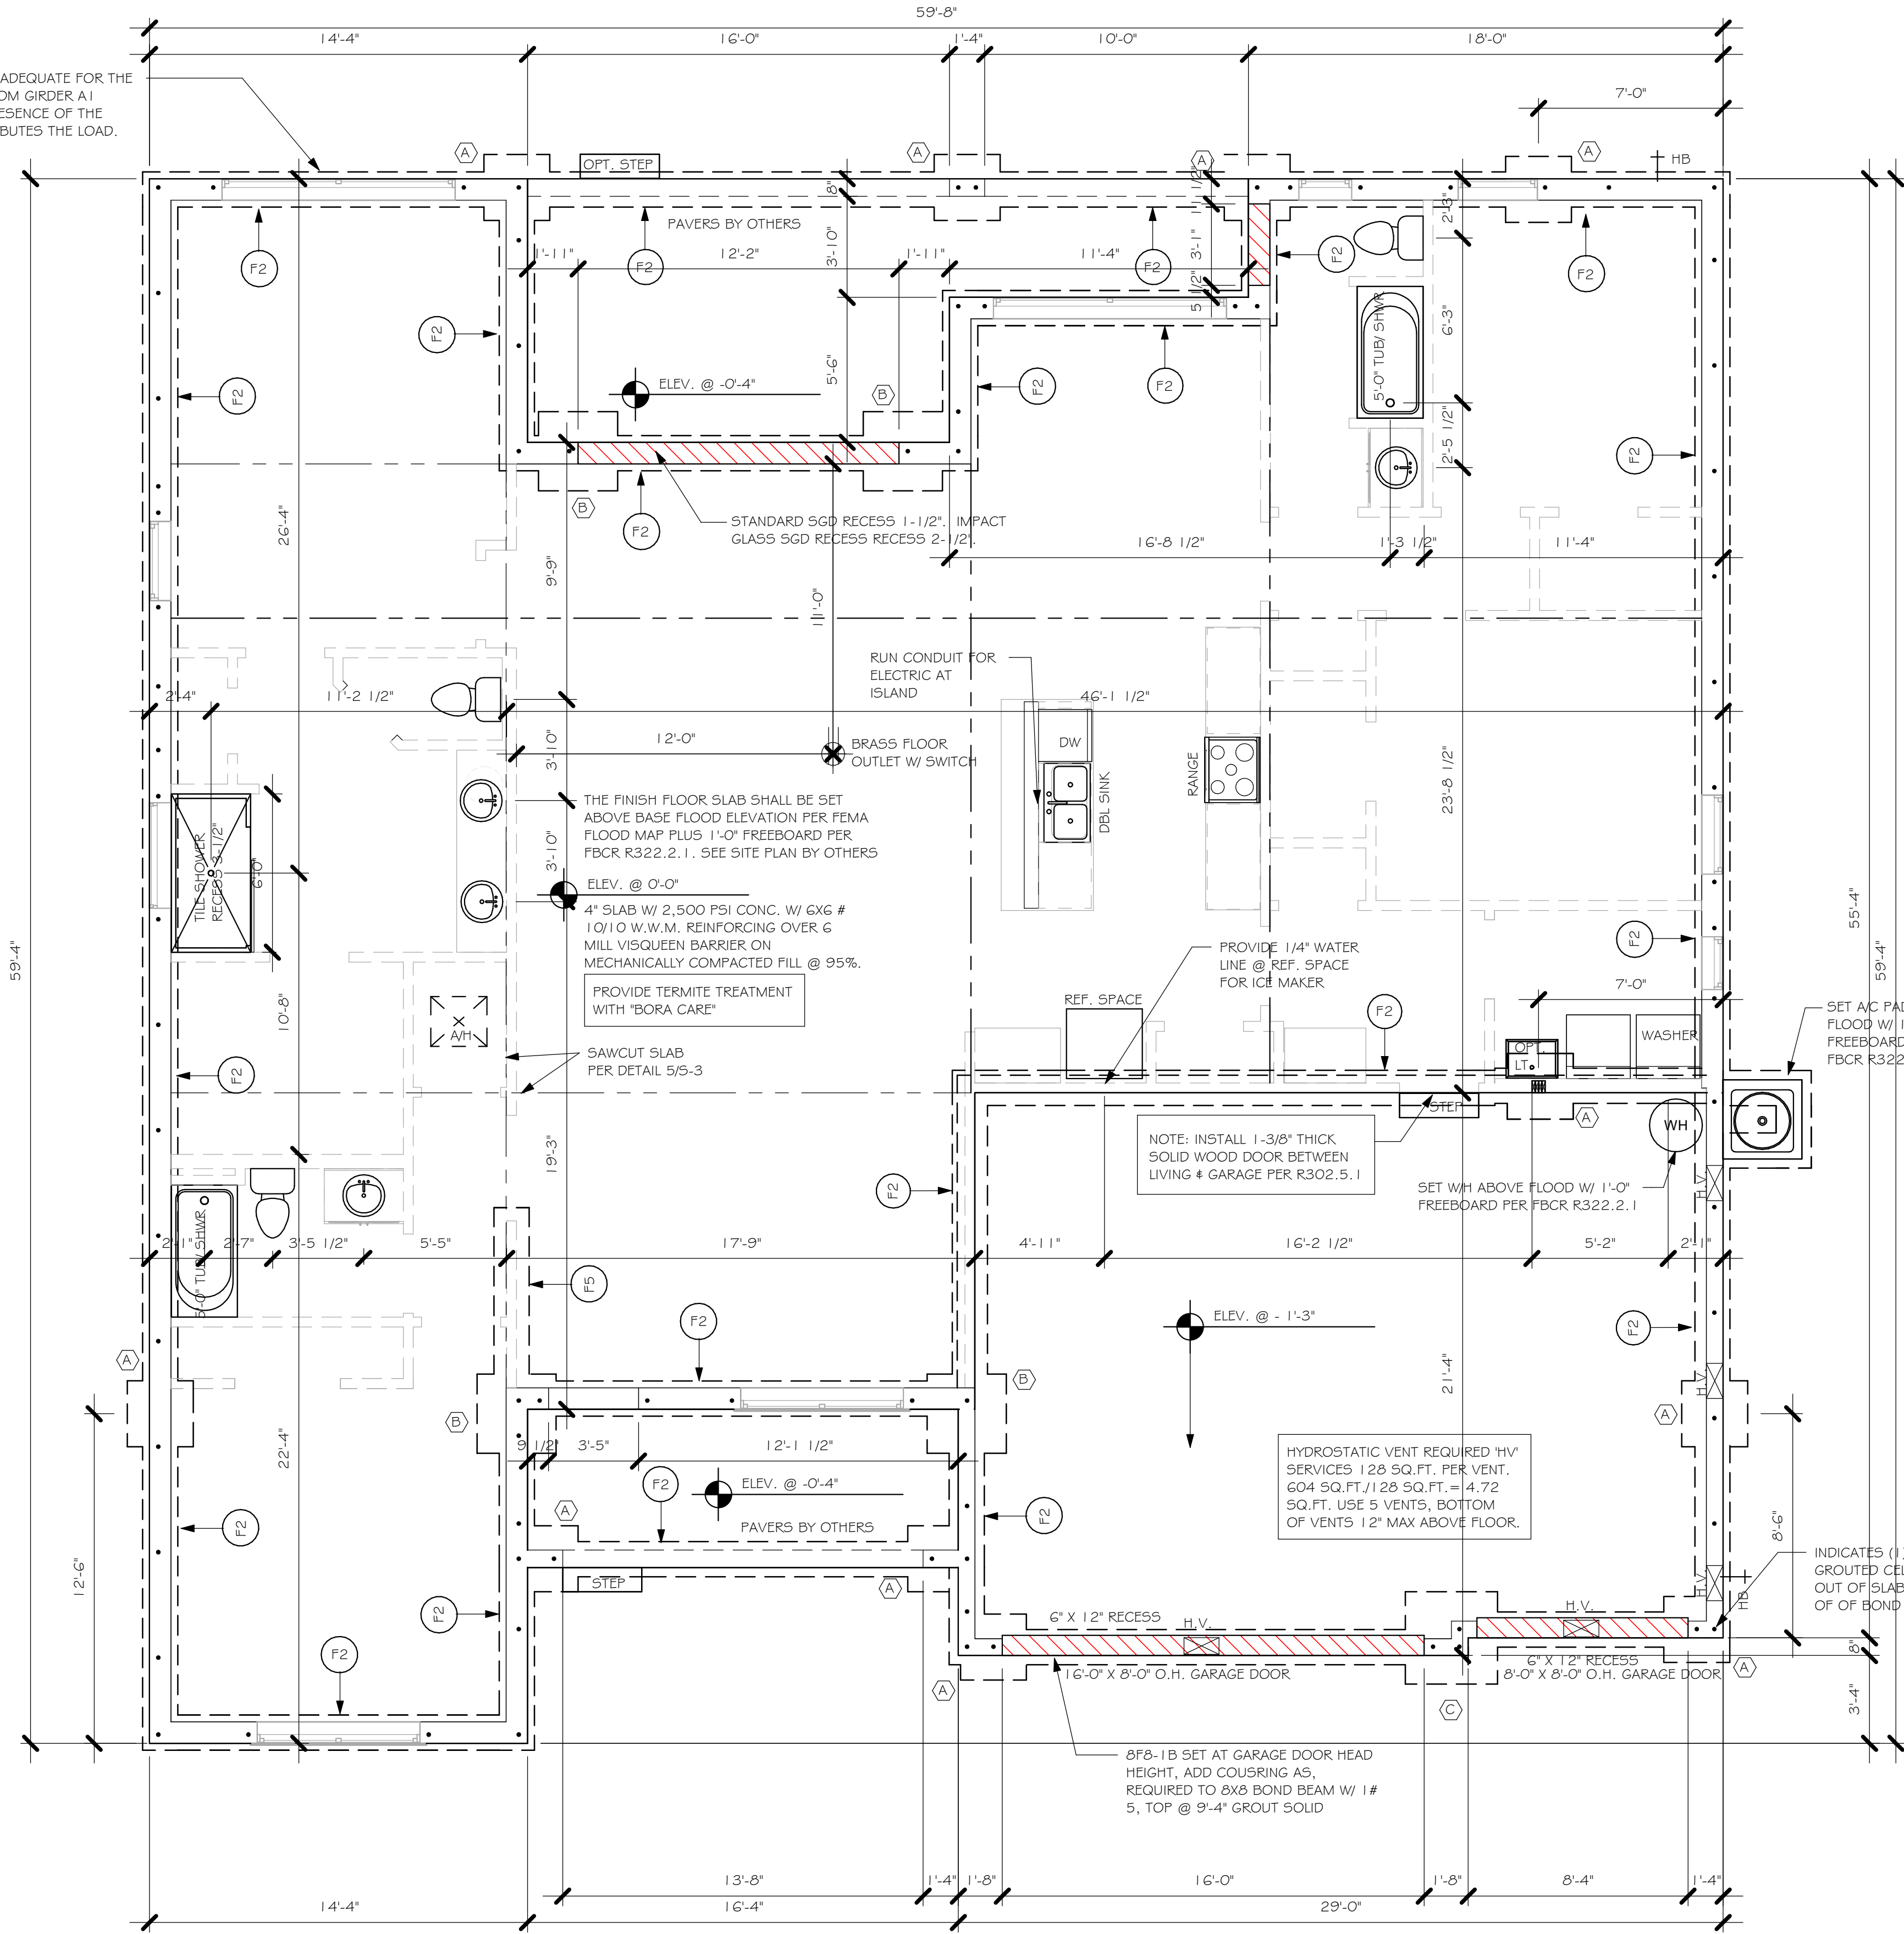

FOUNDATION PLAN "AR"

1/4" = 1'-0"

This item has been digitally signed by Derek Bergner on the date adjacent to this seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

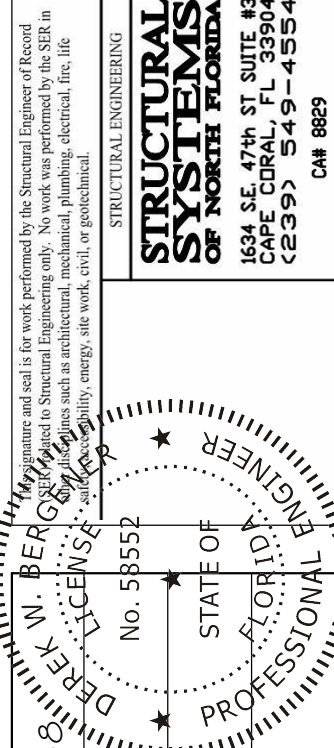

LOT: 37-38
SUBDIVISION: CAPE CORAL SPOT LOTS
ADDRESS: 4352 SW 20TH PLACE
D.R.H. #: 578630130

MODEL
2414
GCD JOB # 11565

DATE: 04/01/20
DRAWN BY: JBL
CHECKED BY: JWC
REVISED:
PLAN: FOUNDATION PLAN
SCALE: As indicated

S-1 AR



D-R HORTON
NYSE
America's Builder

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL
SYSTEMS
OF NORTH FLORIDA
CAPE CORAL, FL 33904
(239) 549-4554
CA 889



TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
INSTALL METAL G AT ALL TRUSSES TO 1450 lb UPLIFT. FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.		
1450	(1) METAL G TO 40	(8) 0.148x1 1/2", EMBED 4"
1810	(1) METAL G TO 40	(9) 0.148x1 1/2", EMBED 4"
2120	(1) HHETAL G TO 40	(10) 0.148x1 1/2", EMBED 4"
1875 (1 PLY)	(2) METAL G TO 40	(10) 0.148x1 1/2", EMBED 4"
1795 (2 PLY)	(2) METAL G TO 40	(14) 0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) METAL G TO 40	(12) 0.162x3 1/2", EMBED 4"
3965/SYP 3330/SFP	(2) HHETAL 2 TO 40	(12) 0.162x3 1/2", EMBED 4"
4235/SYP 3640/SFP	MGT (2 PLY)	(22) 0.148x3" ATR, EPOXY 12"
4670/SYP 4015/SFP	HTT4	(18) 0.162x2 1/2" ATR, EPOXY 12"
5445/SYP 5360/SFP	HTT5	(26) 0.148x3" ATR, EPOXY 12"
10690/SYP 10690/SFP	HTT5KT	(26) SDW 10x2 1/2" ATR, EPOXY 12"
10790/SYP 10790/SFP	(1)HGT - 2	(26) 0.148x3" TO GIRDER
	(1)HGT - 3	(2) 3/4" Ø ATR, EPOXY 12"
		(16) 0.148x3" TO GIRDER,
		(2) 3/4" Ø ATR, EPOXY 12"

TRUSS STRAPPING TO STUDWALL/ WOOD BEAM		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
INSTALL AT ALL TRUSSES TO 840 lb UPLIFT. FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.		
850	(1) MTS 1 G TO 20	(14) 1 Odx 1-1/2"
1700	(2) MTS 1 G TO 20	(14) 1 Odx 1-1/2"
2550	(3) MTS 1 G TO 20	(14) 1 Odx 1-1/2"
1125	(1) HTS20 TO 30	(24) 1 Odx 1-1/2"
2250	(2) HTS20 TO 30	(24) 1 Odx 1-1/2"
3375	(3) HTS20 TO 30	(24) 1 Odx 1-1/2"
4500	(4) HTS20 TO 30	(24) 1 Odx 1-1/2"

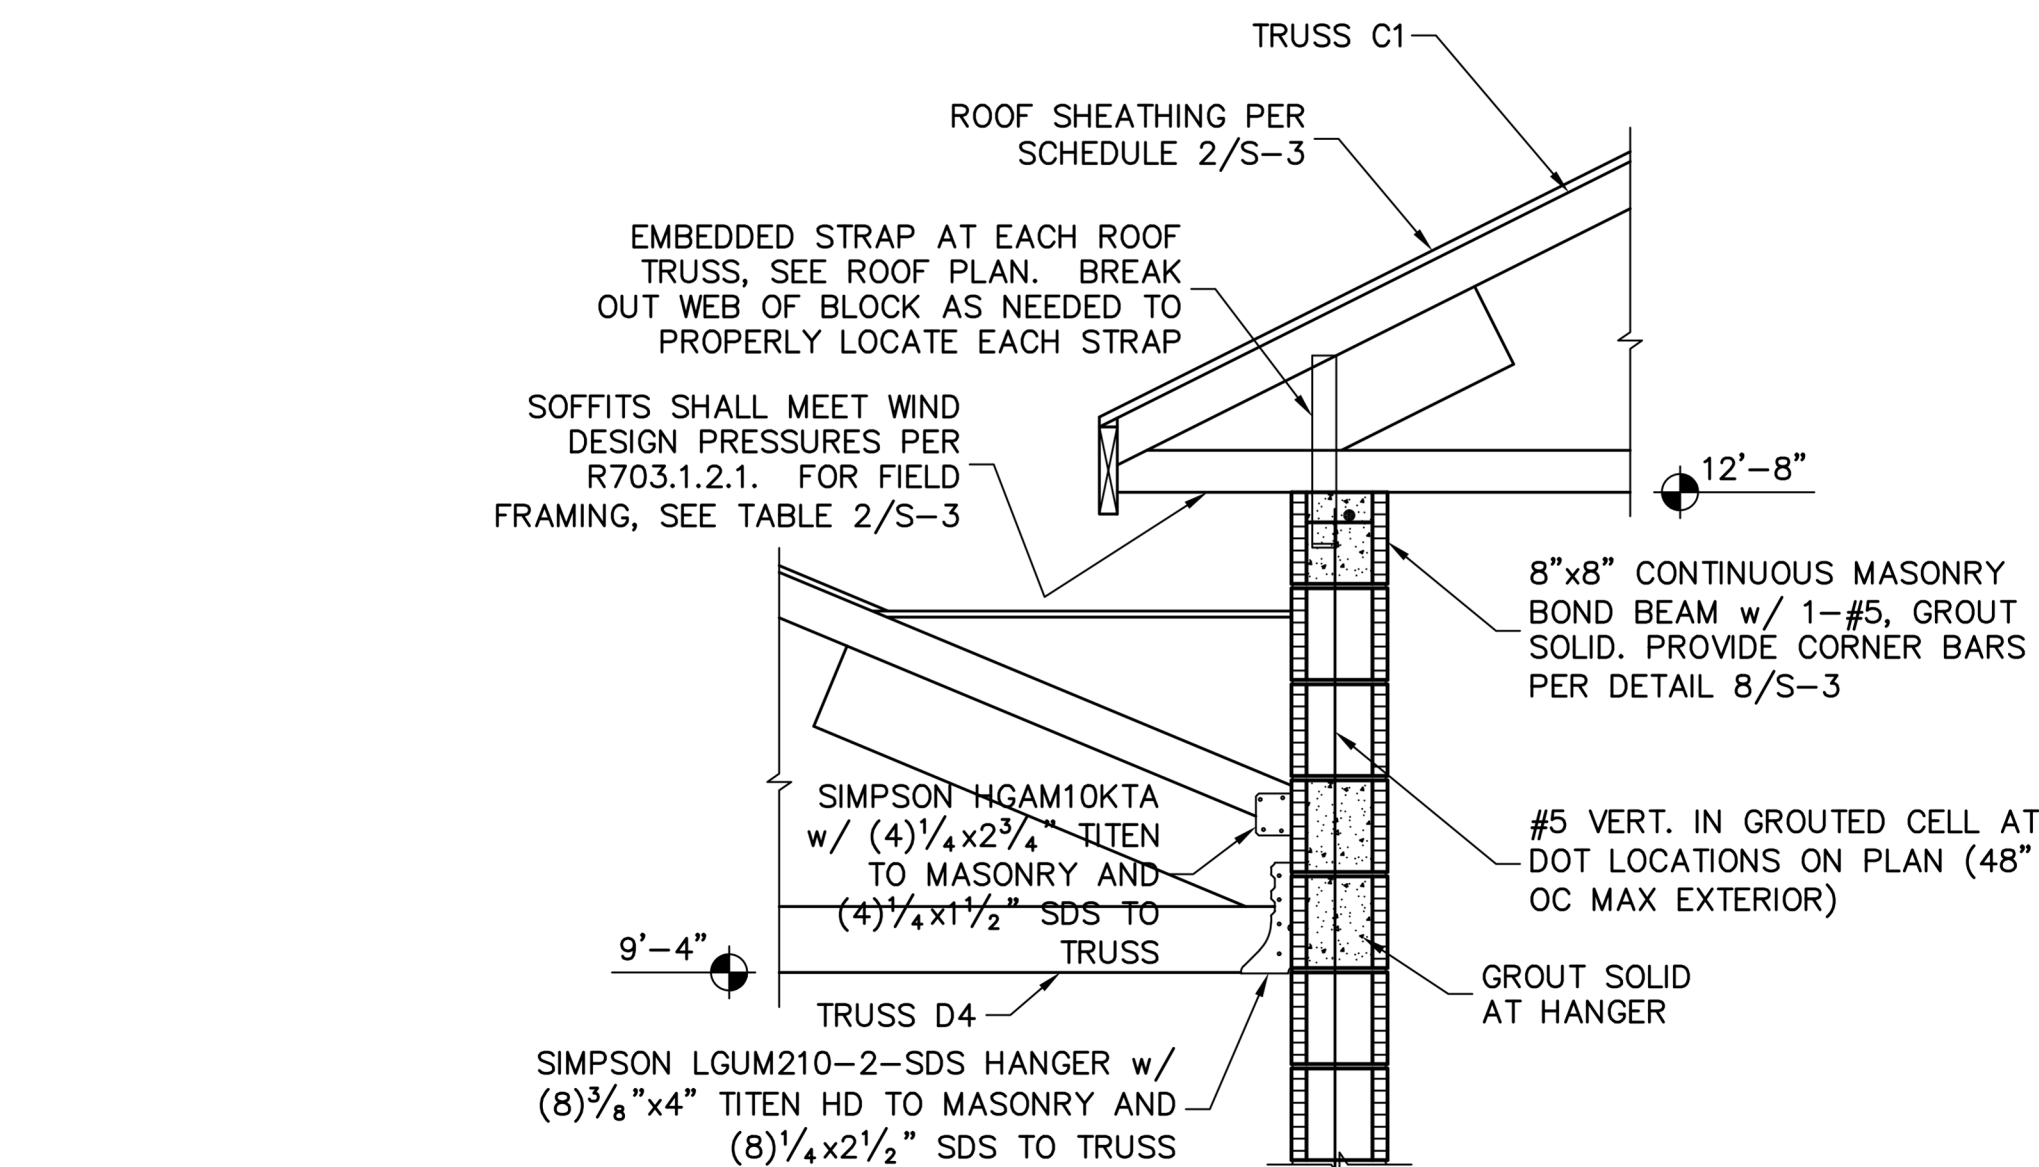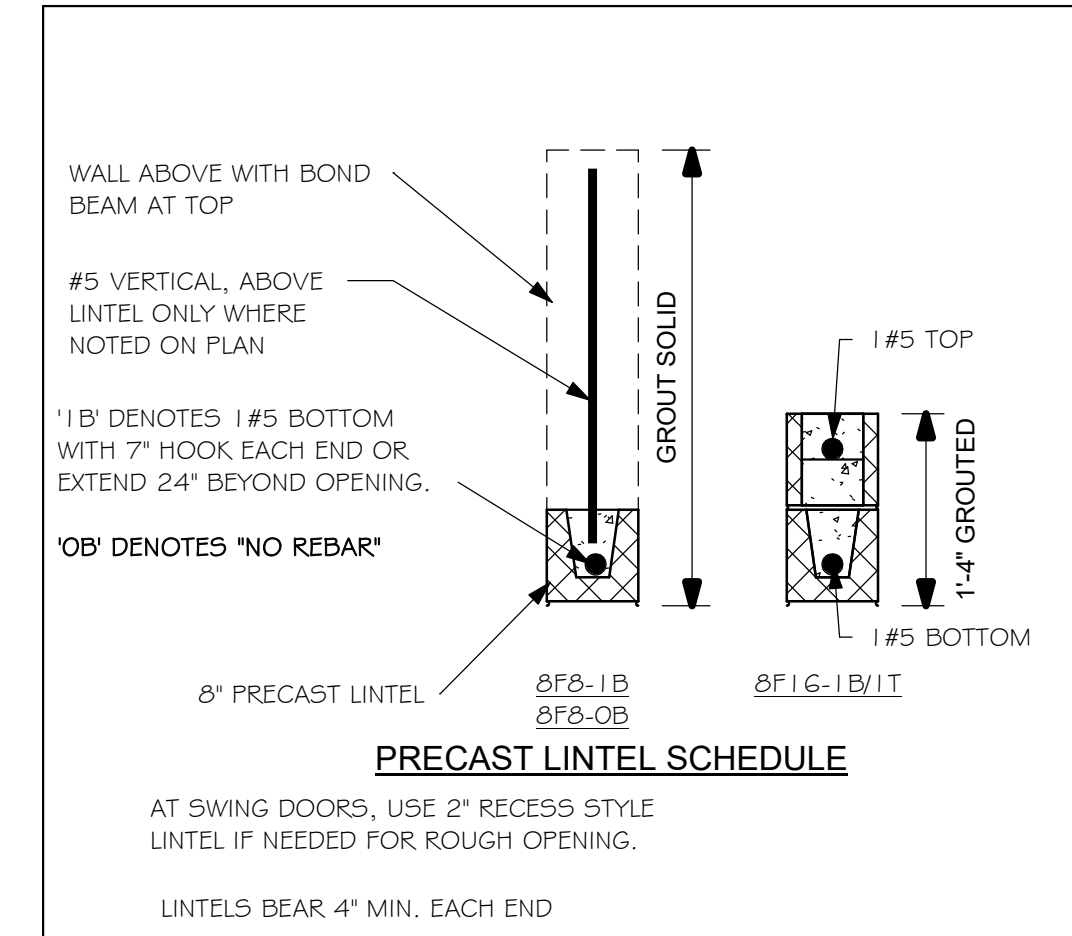


1 STRAPPING AT TRUSS D4

SCALE: 3/4" = 1'-0"

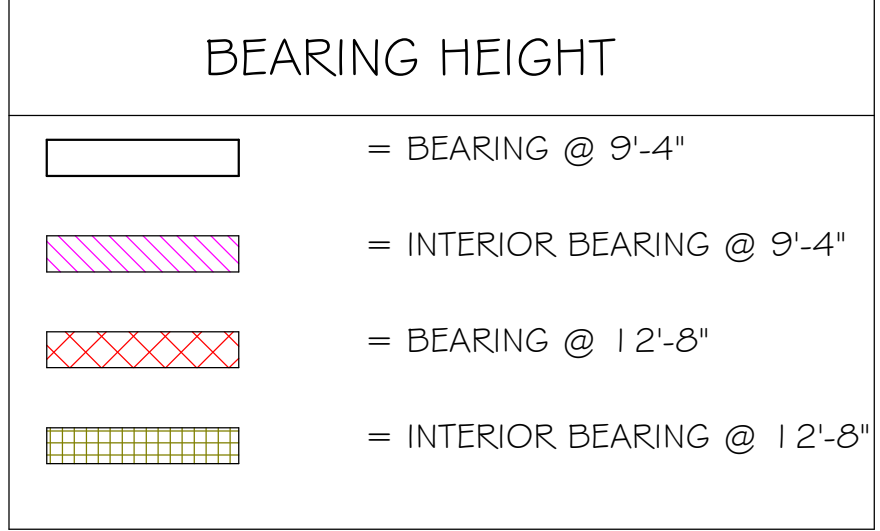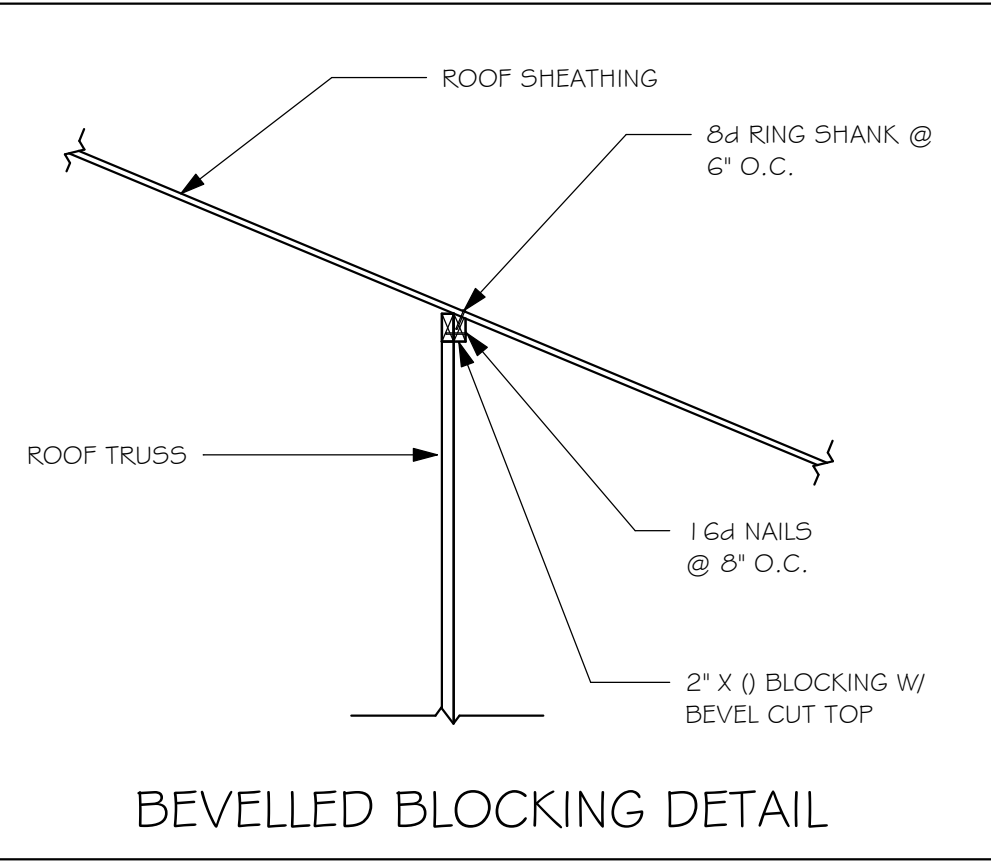

- PLAN NOTES:
- ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET 5-3.
 - PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON 5-3.
 - 8F8-1B etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 11/S-3.

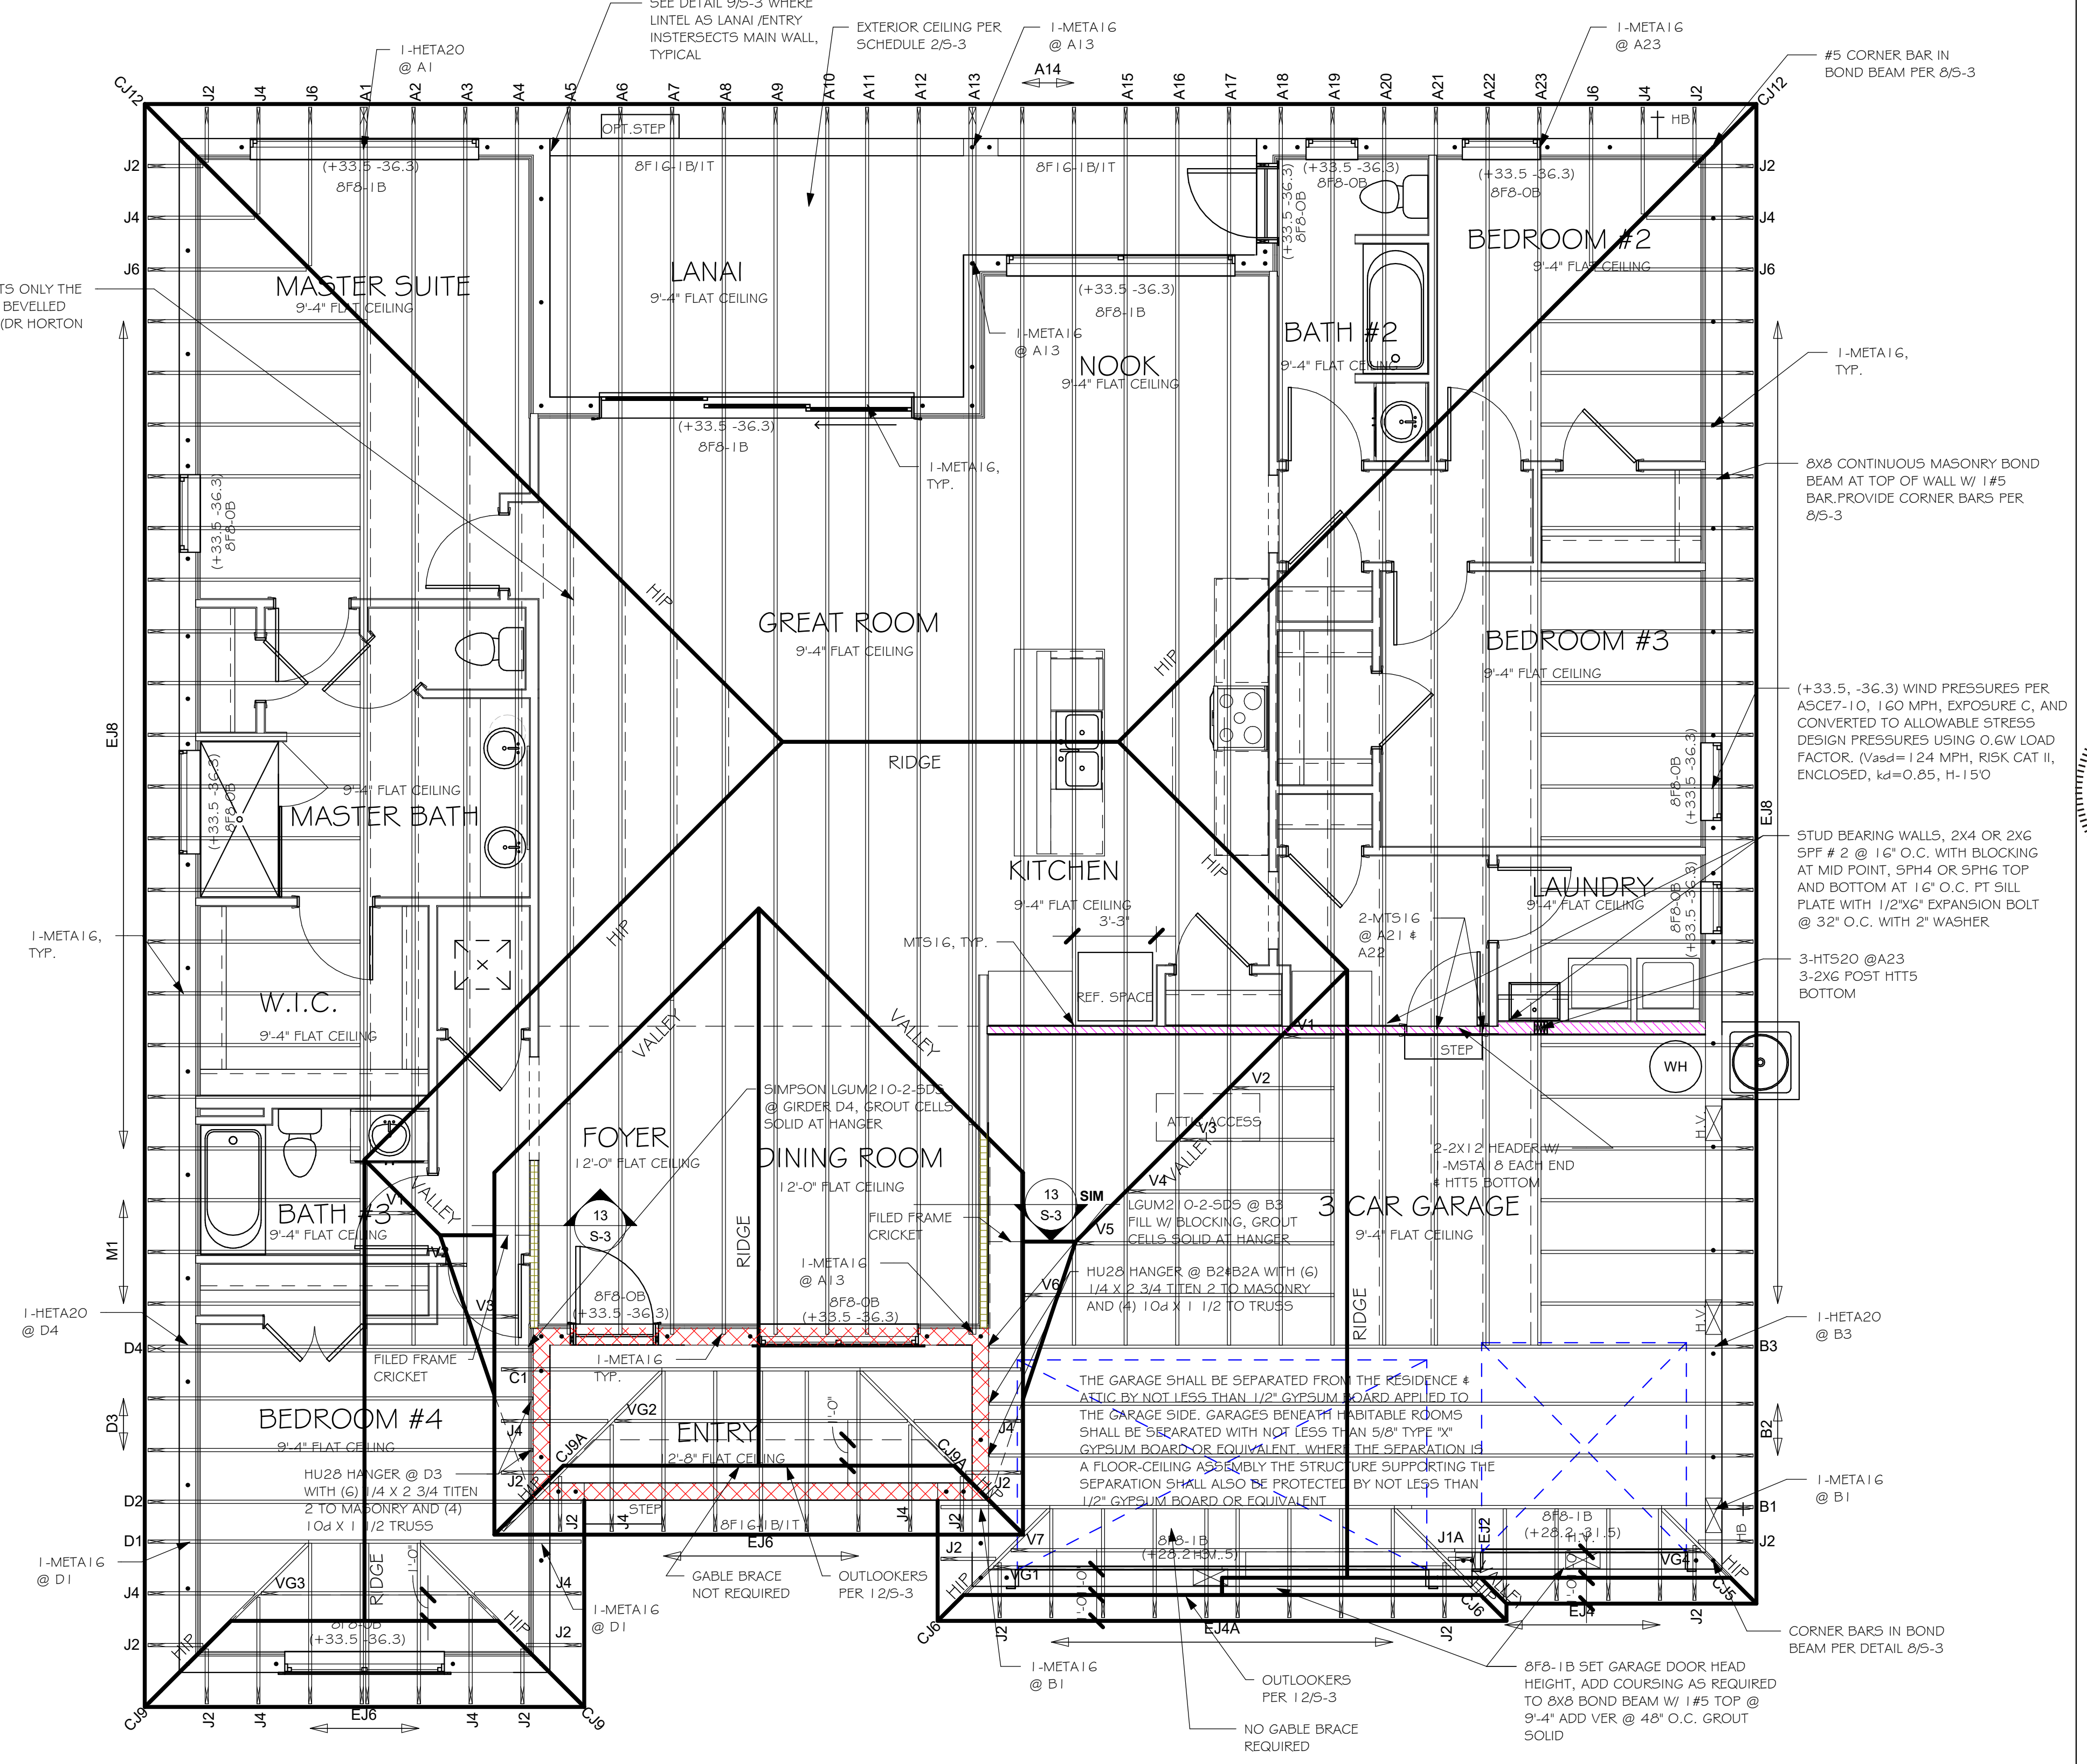

ROOF FRAMING PLAN "AR"

1/4" = 1'-0"

TRUSS BEARING CONDITIONS AND STRAPPING IS BASED ON TRUSS LAYOUT PREPARED BY SCOSTA JOB # 44142 DATED: 08/15/18 REVISED: 01/14/2020

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\CAPE SPOT LOTS\11565 LOT 37-38 BLK 4758 2414 AR\REVIT\11565 2414 AR.rvt

D-R HORTON
America's Builder

Gulf Coast
Drafting & Design, Inc.

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1515 SE 47th ST. CAPE CORAL, FL 33904
PHONE: 239-540-8222
EMAIL: PLANS@GULFCOASTDRAFTING.COM
CA 889

LOT: 37-38
SUBDIVISION: CAPE CORAL SPOT LOTS
ADDRESS: 4352 SW 20TH PLACE
D.R.H. #: 578630130

MODEL
2414

DATE: 04/01/20
DRAWN BY: JBL
CHECKED BY: JWC
REVISED:
PLAN: ROOF FRAMING PLAN
SCALE: As indicated

S-2 AR



2 NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED
HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

- 1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.
- 2) USE "INTERIOR ZONE 4" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "END ZONE 5" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "END ZONE 5" COLUMN.
- 3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.
- 4) SUBMIT PRODUCT APPROVALS TO THE BUILDING DEPARTMENT AS REQUIRED BY THE LOCAL JURISDICTION.
- 5) MANUFACTURED SOFFIT PRODUCTS SHALL BE INSTALLED PER MFR ENGINEERING SPEC SHEETS.

ON IRREGULAR SHAPED BUILDINGS,
THERE IS NO GUIDANCE IN THE CODE
FOR HOW FAR A CORNER MUST
PROTRUDE FROM THE MAIN BUILDING
TO BE CONSIDERED 'ZONE 5'. WE
HAVE CHOSEN '>15\'', THIS IS SUBJECT
TO JUDGEMENT CALL BY THE
AUTHORITY HAVING JURISDICTION.

END ZONE 5 PRESSURE AT "PRIMARY" OUTSIDE OF BUILDING (BOLD LINE)

INTERIOR ZONE 4 PRESSURES

TYPICAL HOUSE PLAN

END ZONE 5 PRESSURE AT "SECONDARY" OUTSIDE OF BUILDING (DOTTED LINE)

END ZONE WIDTH = 5'-0" MEASURED FROM FACE OF BUILDING

>15'

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.




7 MATERIAL IS SIMPLY A SPACER AND MAY BE 1x4 OR 1x6 OR OMITTED ENTIRELY AND THE SPACER MAY BE TACKED IN PLACE WITH MASONRY NAILS OR PINS.



NOTES:

- 1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
- 2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

RETROFIT UPLIFT CONNECTOR SCHEDULE

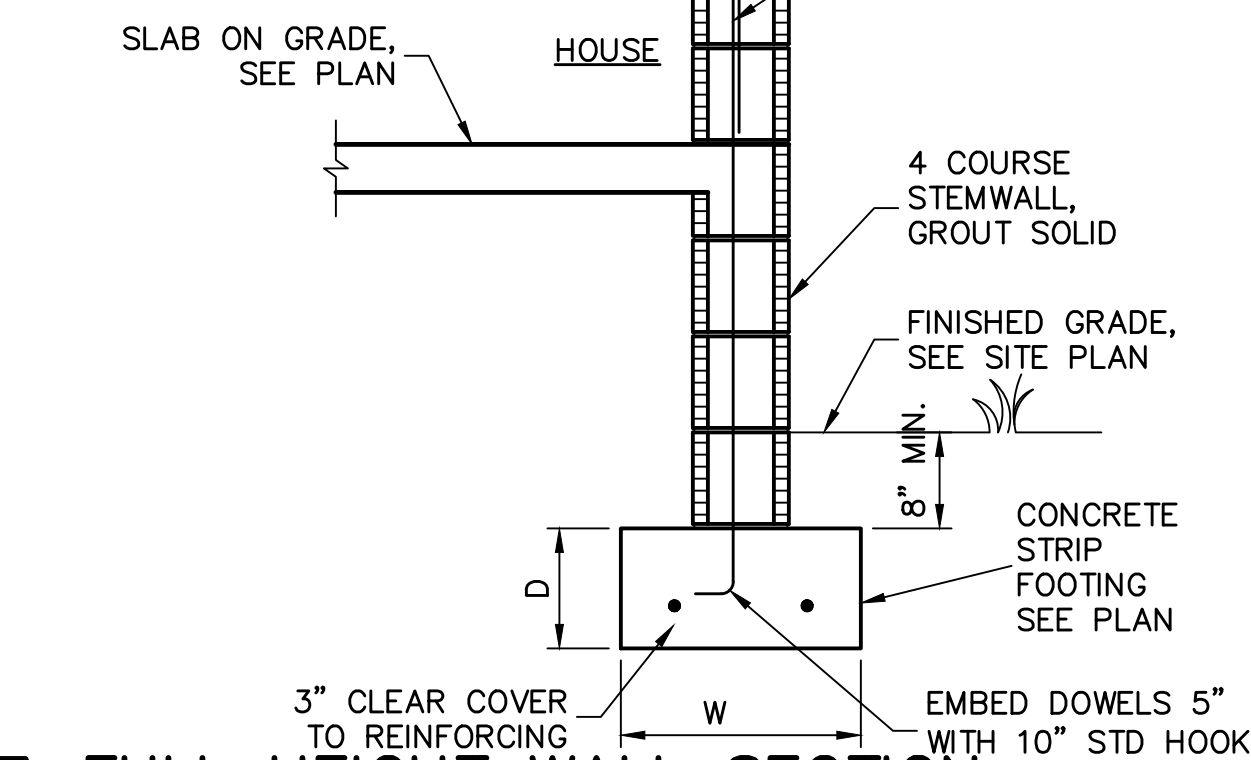

FULL HEIGHT WALL SECTION



OUTLOOKER DETAIL



At Exterior Stud Walls and Gable Ends with Wall Sheathing, apply plaster over metal lath over water resistive barrier as follows:

Plaster R703.7.2: 3-coat 7/8" thick portland cement based plaster per ASTM C926.


Metal Lath R703.7.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C847, G60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gage nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gage staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).

Water Resistive Barrier (WRB) R703.7.3:

Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the 1st layer).

[illegible]

STRUCTURAL ENGINEERING:
STRUCTURAL
SYSTEMS
OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

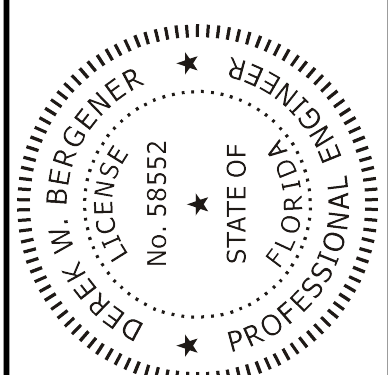

BUILDER:

D.R. HORTON • RHI
NYSE

America's Builder

STRUCTURAL DETAILS
MODEL 2414 A
4352 S.W. 20TH PLACE
CAPE CORAL, FLORIDA
PLOTS: 37-38 SUBDIVISION: CAPE CORAL SPOT - HOF

DESIGN/DRAWN DWB/GH
CHECKED DWB
DATE 04/17/20
SCALE VARIES
JOB NO. DR11565
SHEET

S-3

SHEET 3 OF 3