
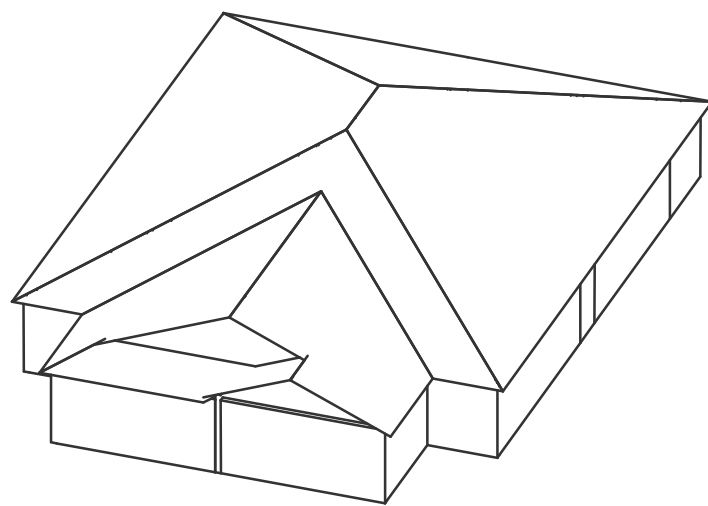
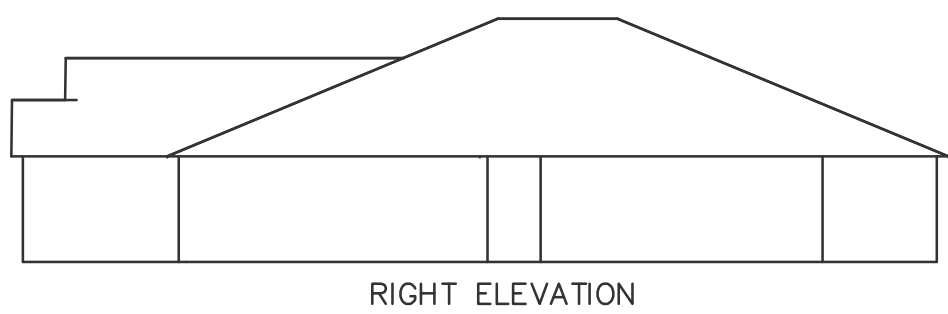


TYPICAL JACK CUTS

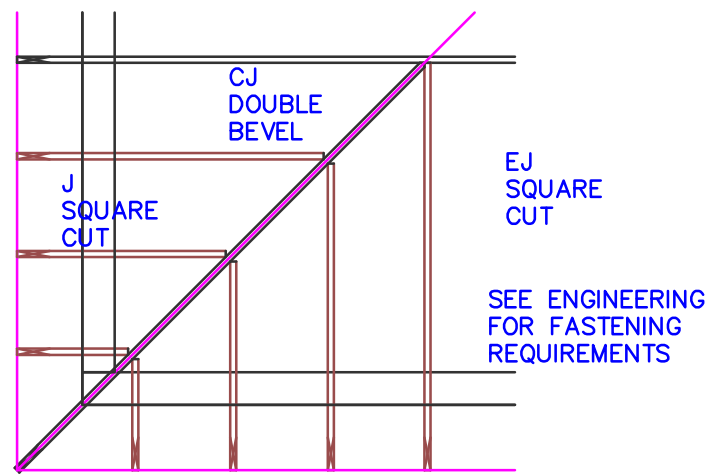

Engineer of Record for the Structure
Structural Systems of N. Fl. Inc.
Derek Bergener, PE 58552
1634 SE 47th Street # 3
Cape Coral, FL 33904

This document has been reviewed for
conformance with the design intent of the
structure and specified design criteria.

☒ Accepted As-Is ☐ Accepted As Noted ☐ Revise and Resubmit

DESIGN CRITERIA	
TOP CHORD LIVE LOAD	20
TOP CHORD DEAD LOAD	20
BOTTOM CHORD LIVE LOAD	10#
BOTTOM CHORD DEAD LOAD	10
TOTAL LOAD	50
DURATION FACTOR	1.25
WIND DESIGN SPEED (MPH)	160
ASCE 7-10 CAT II EXP C MWFRS	
CLOSED	280 280
MAX. WALL HT FOR WIND LOAD	9'-4"

TILE

****UNLESS NOTED****
REACTION VALUES ARE UNDER 5000#
UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE
*******CAUTION*******

DO NOT ATTEMPT TO ERECT TRUSSES WITH-
OUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING
DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION,
ORIENTATION AND WEB BRACING

REFER TO WTCA/TP1 BSCI-B1 SUMMARY
SHEET FOR HANDLING METHODS & TEMPORARY
BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA
CORP. +/- BEARING DIFFERENCES SHOWN ARE CRITICAL.
IF ANY HEIGHTS DEVIATE - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

9'-4" A.F.F.		0'-0" ELEV.
RAKED BEAM		ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.

TYPICAL HANGER SCHEDULE

(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 160
COMMON NAILS EXCEPT THE FOLLOWING
LUS24 - 100 COMMON THJA26 - 100 x 1-1/2

*******ATTENTION*******

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY
BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS,
PITCHES, OVERHANGS, ELEVATIONS, CEILING &
BEARING CONDITIONS. SCOSTA CORPORATION IS
RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH
PLANS AND/OR INFORMATION PROVIDED BY
CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN.
CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF
INFORMATION AND PLANS PROVIDED TO SCOSTA
CORPORATION, AND TO VERIFY CONFORMANCE TO
FIELD CONDITIONS, AND/OR OWNER CHANGES.
TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE
APPROVED LAYOUT.

APPROVED BY: _____
DATE: _____ REQUESTED DELIVERY DATE: _____
JOBSITE CONTACT NAME: _____
PHONE #: _____
E-MAIL: _____





SCOSTA CORP.

WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES

3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242


SCALE: 1/4"=1'-0"	DATE: 06/18/19	REVISED BY: KD 11/27/19	DRAWN BY: CD
JOB ADDRESS: 1526 TWIN VILLA		1 of 1	
CUSTOMER: LEE/COLLIER/CHARLOTTE		JOB # 44151GB	

L:\0-New Data\1-MASTER 2019\2019-BUILDERS\DK HORTON
2019\SUBDIVISIONS\LINDSFORD II TV'S\11738 LOT 609-G10 1526 ARREVIT\1738 1526
AR.rvt

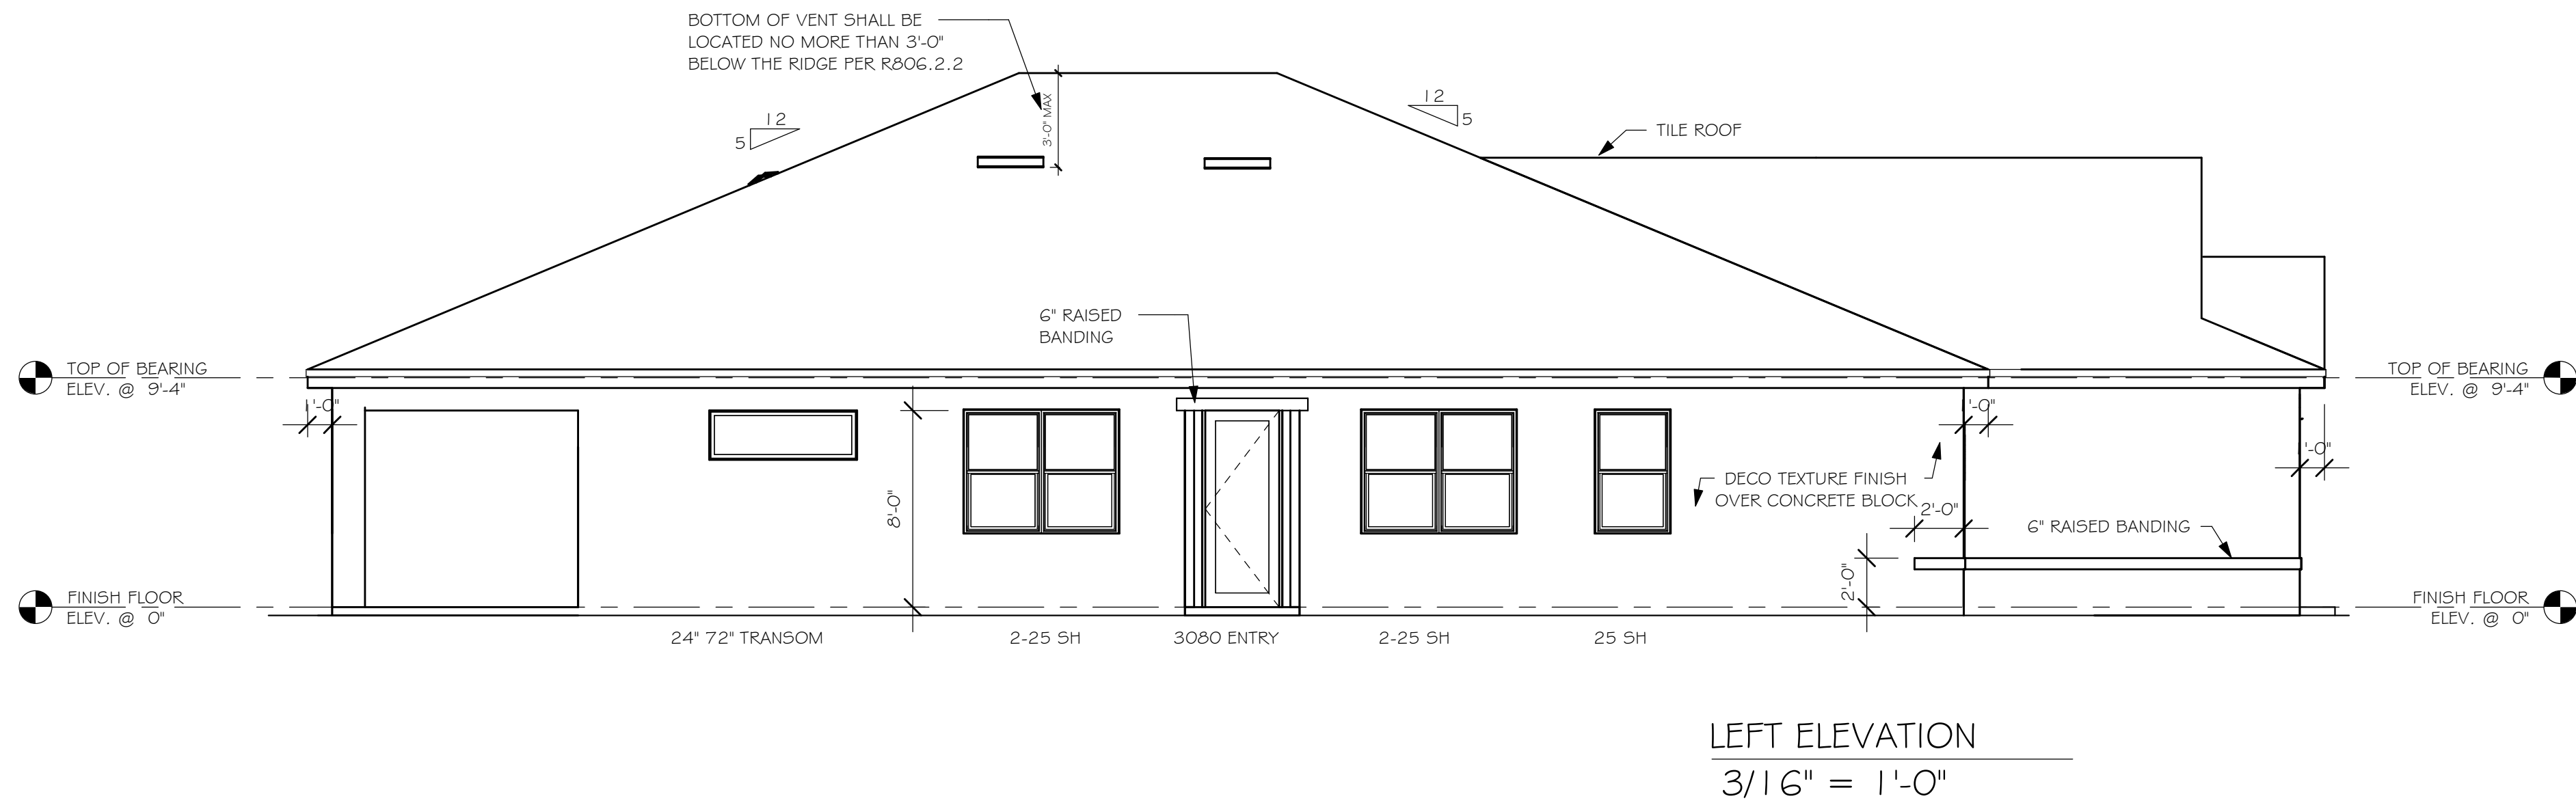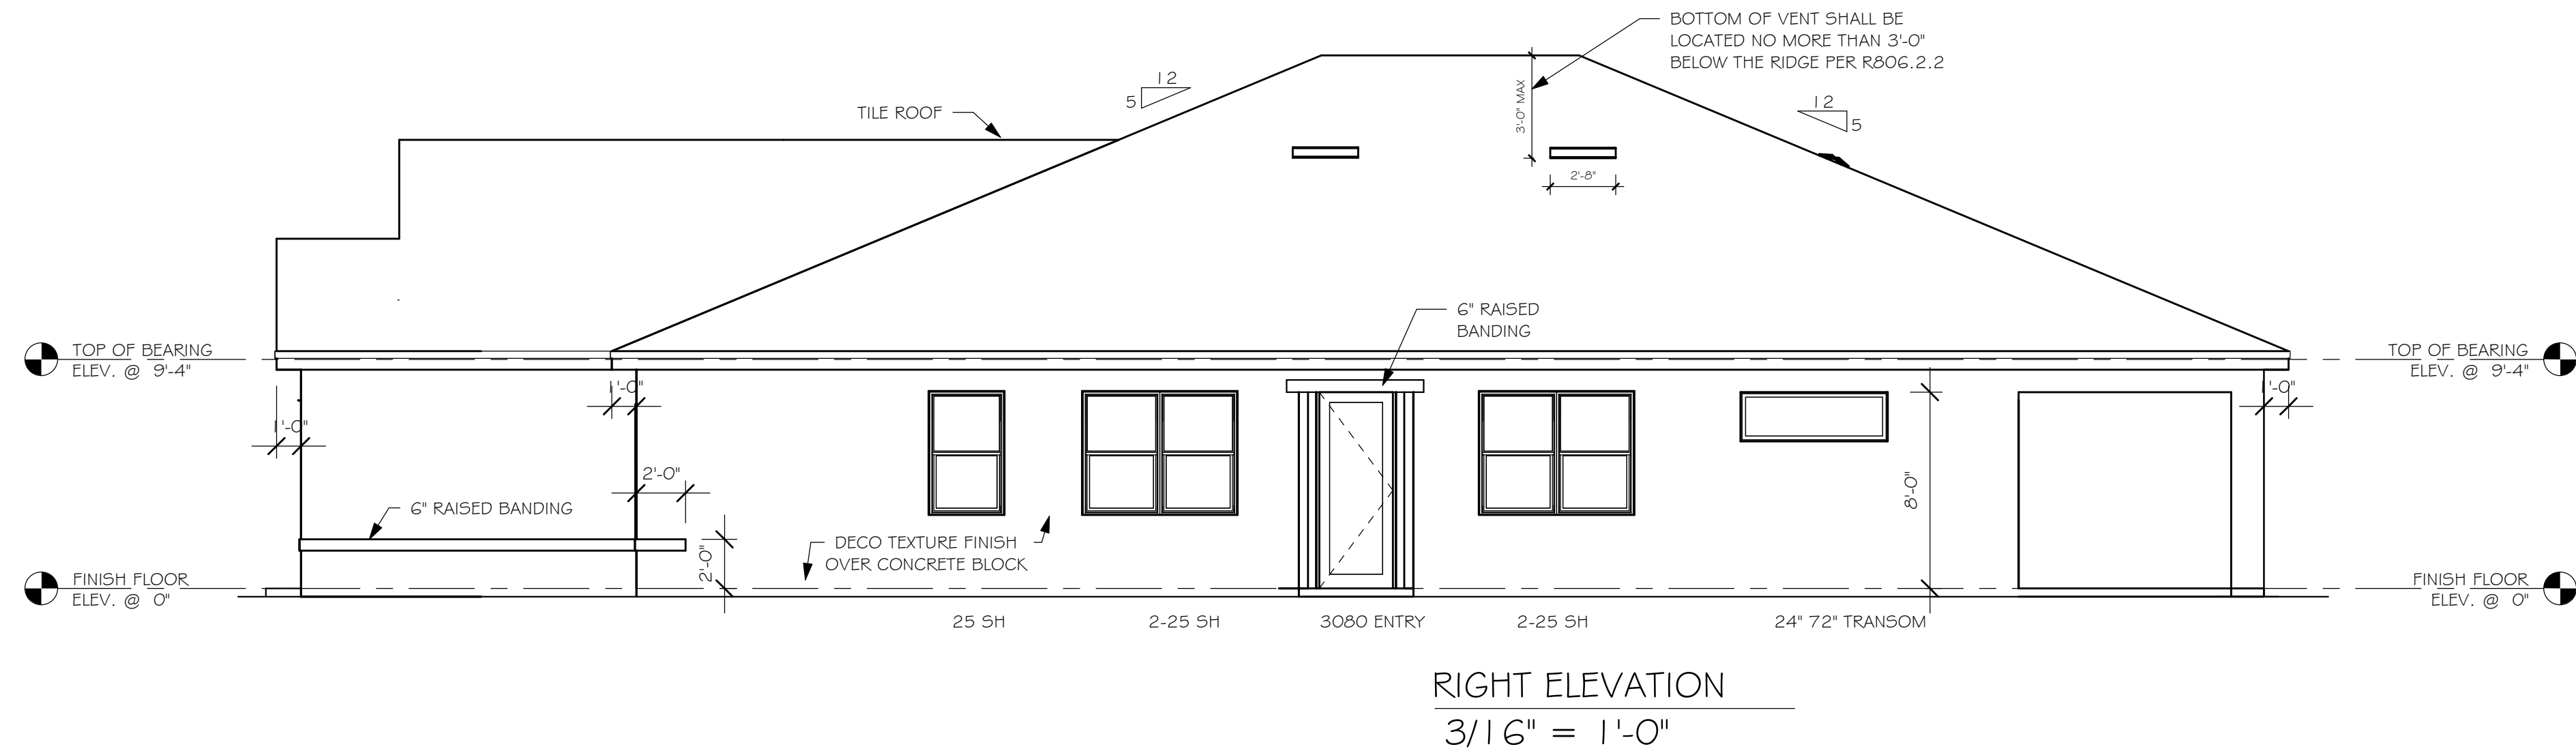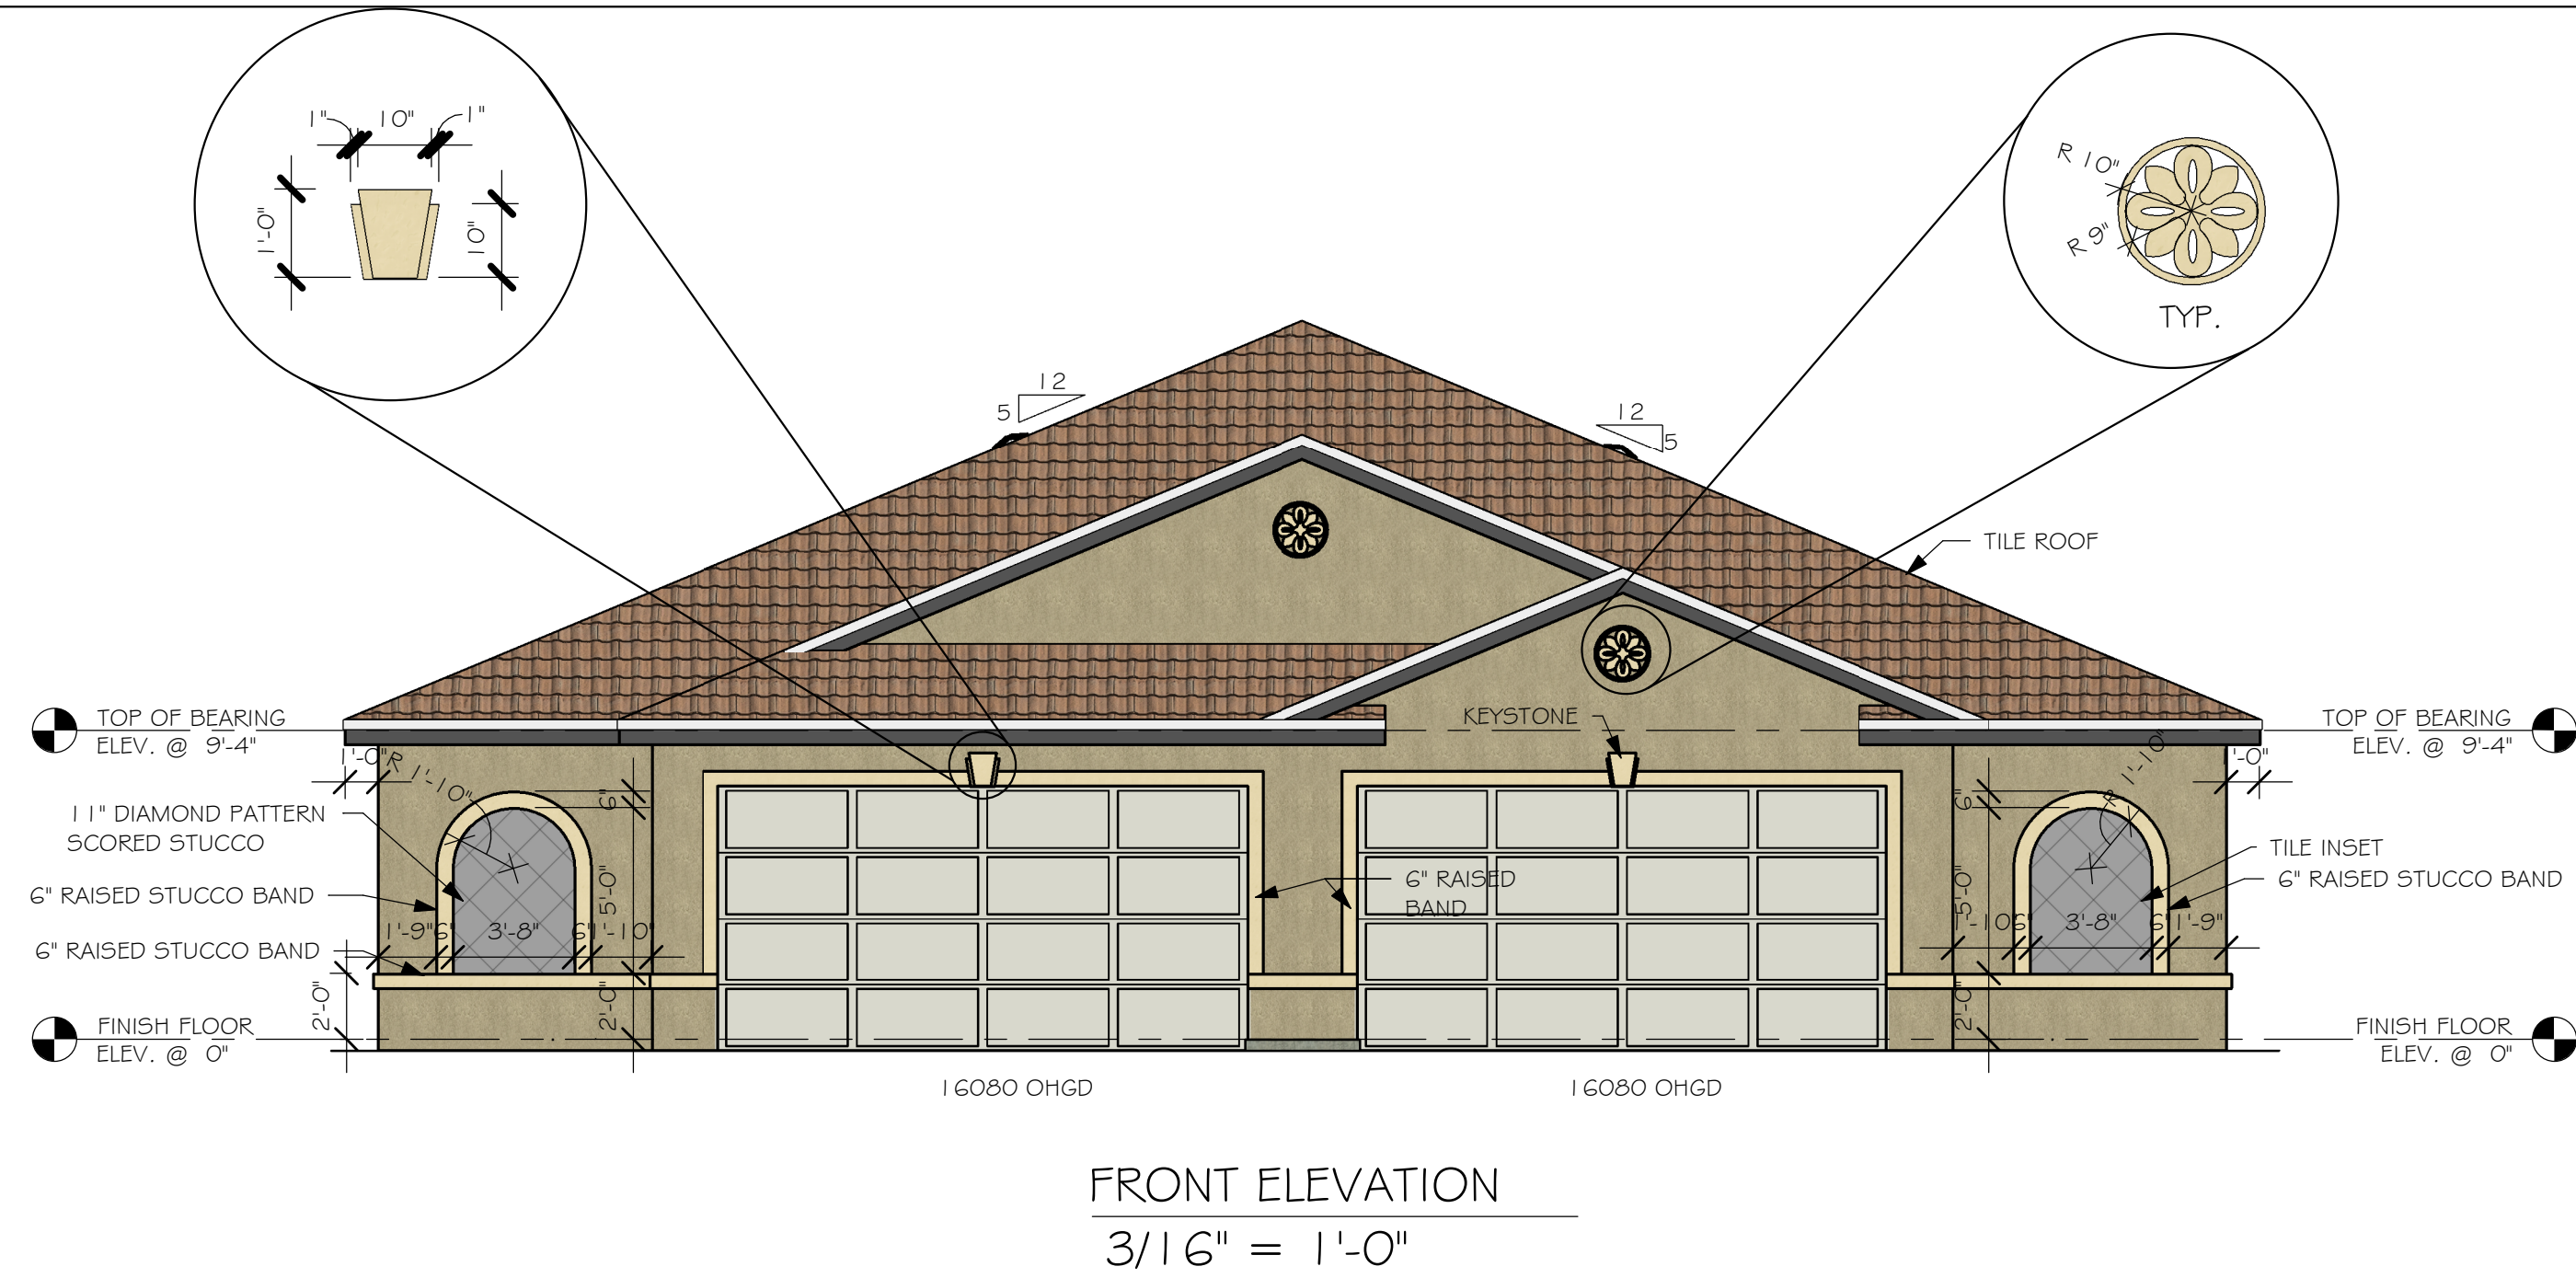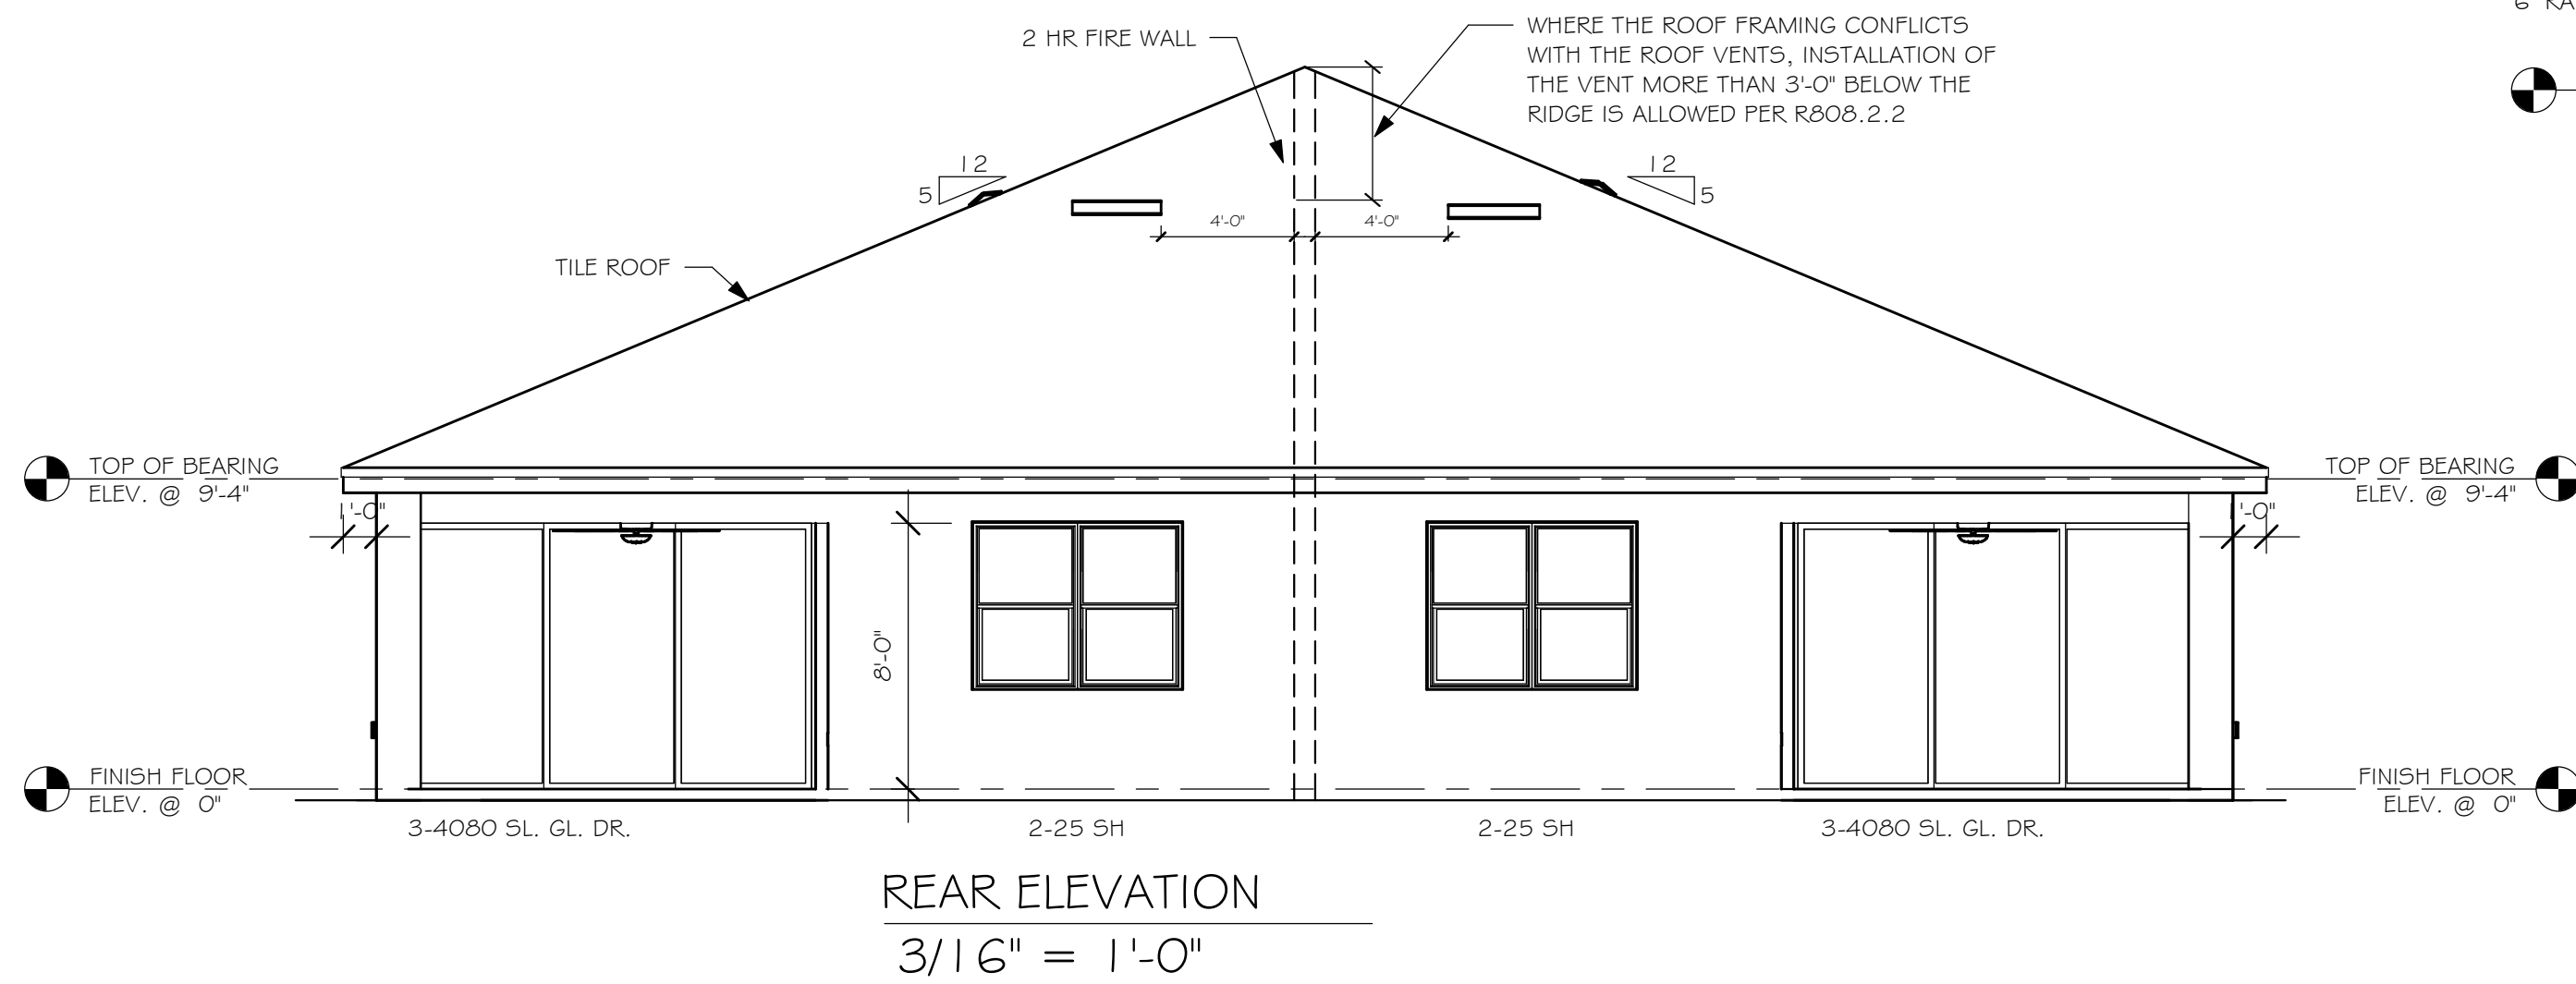

This item has been digitally signed
by Derek Bergener on the date
adjacent to the seal. Printed
copies of this document are not
considered signed and sealed and
the signature must be verified on
any electronic copies.

This is a multi-page document.
I performed structural
engineering only on those
pages which contain my seal,
Derek Bergener, and company
name Structural Systems.

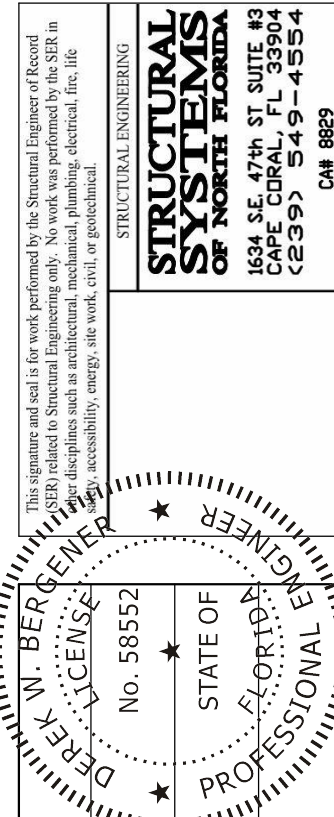

LOT: 609-G10
SUBDIVISION: LINDSFORD II TV'S
ADDRESS: 4225-4221 BLOOMFIELD STREET
D.R.H. #: 578910223-224

MODEL
1526 VILLA
GCD JOB # 11738

DATE: 07/28/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: ELEVATION
SCALE: As indicated

A-1








DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

STRUCTURAL SYSTEMS
OF NORTH FLORIDA
Derek W. Bergener, P.E.
1515 SE 47th ST. CAPE CORAL, FL 33904
(239) 549-4554
Fax 889

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

D.R. HORTON
America's Builder

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DRK HORTON
2019\SUBDIVISIONS\LINDSFORD II TV\51 1738 LOT 609-G-10 1526 ARREVIT\1738 1526
AR.vrt

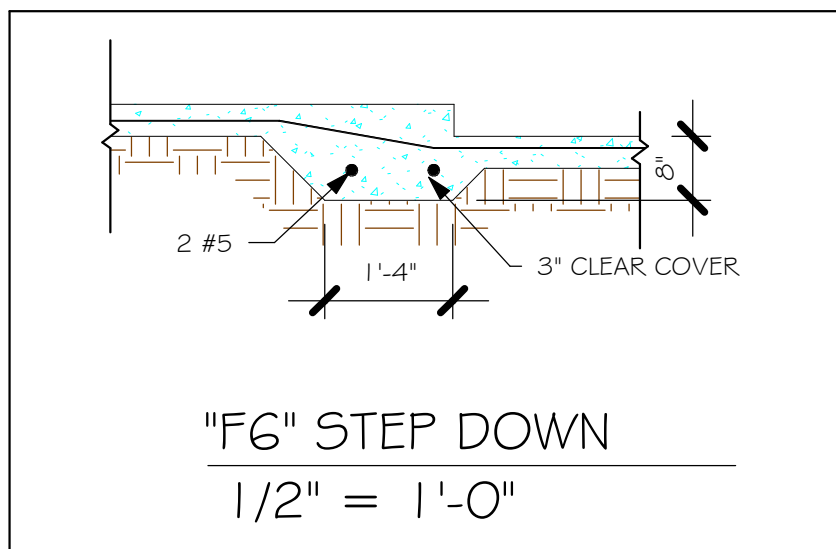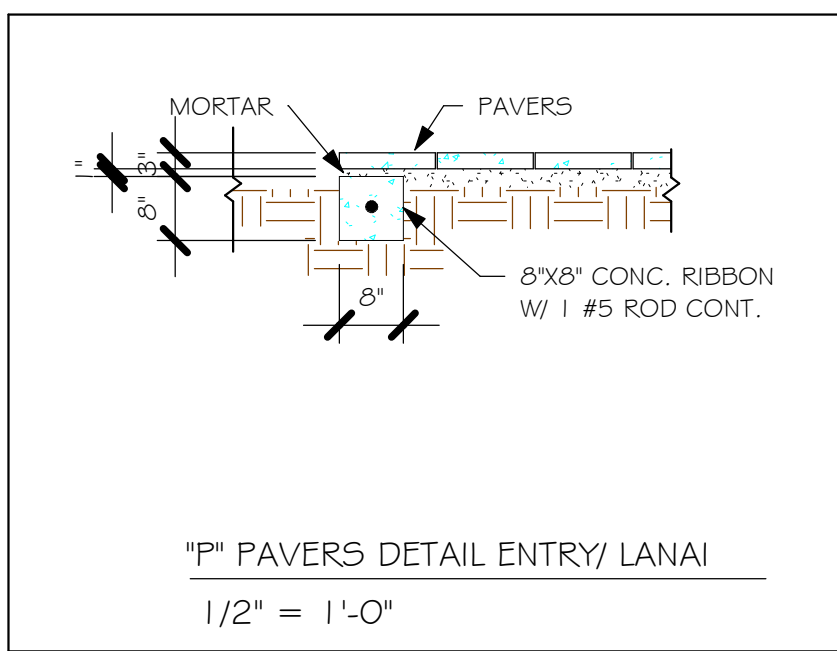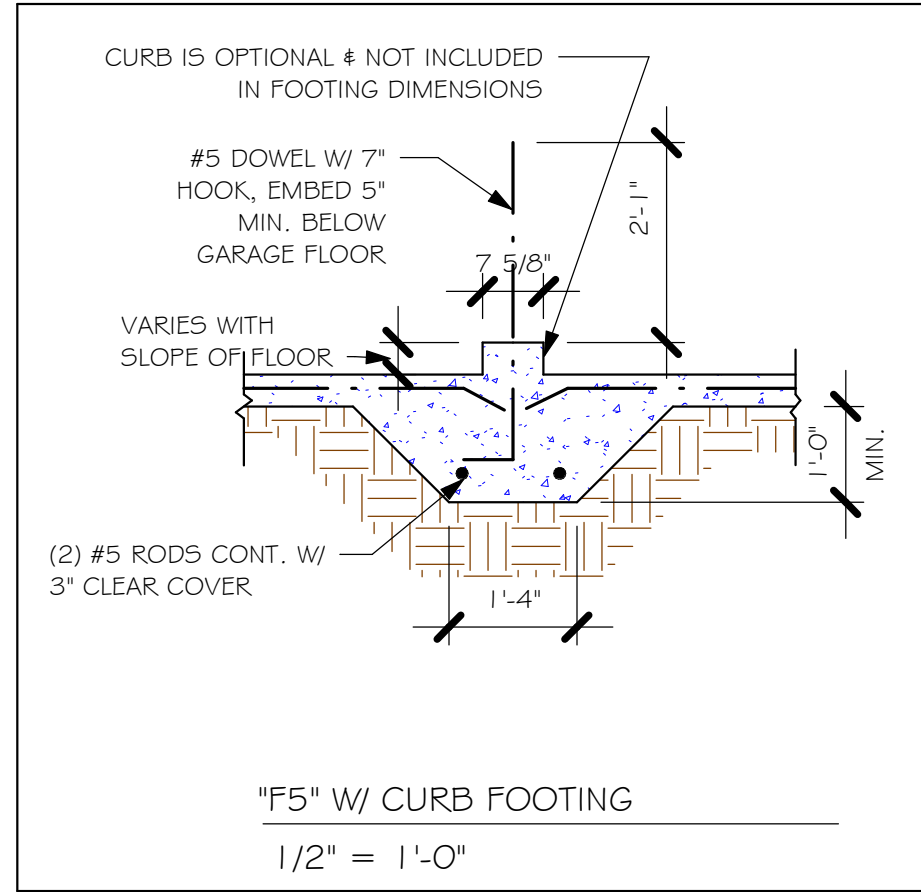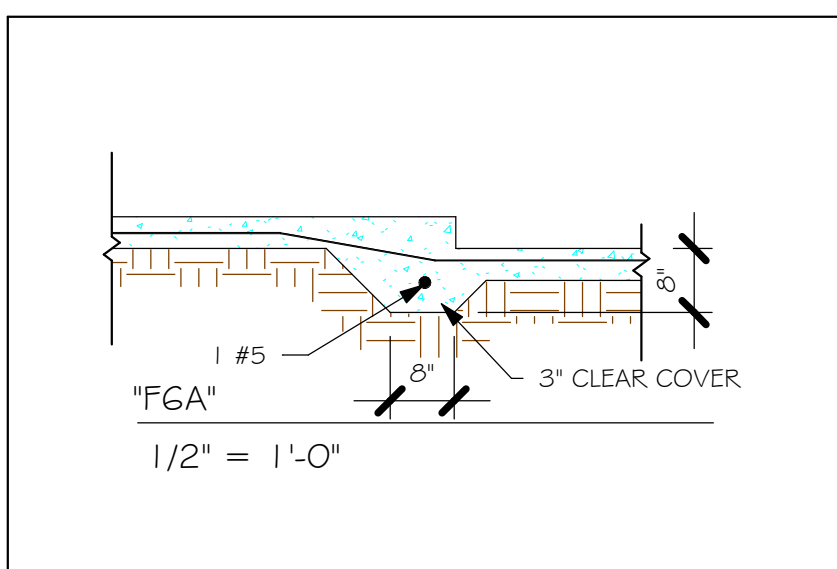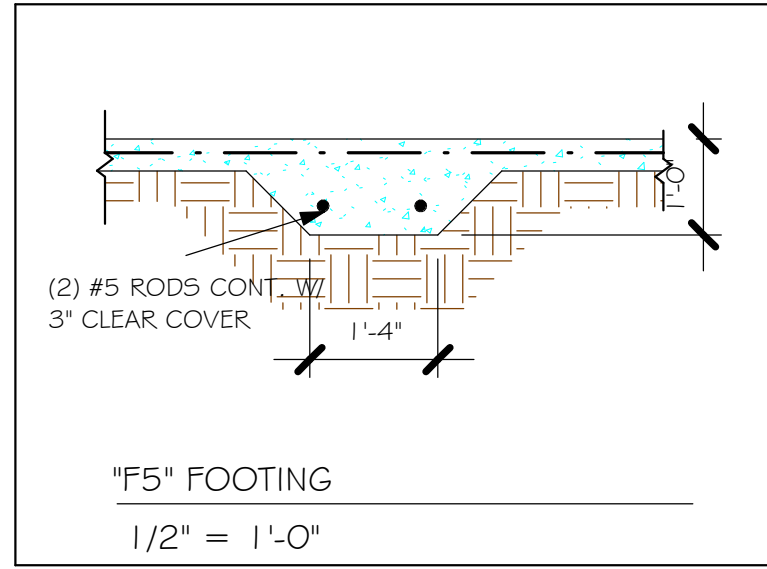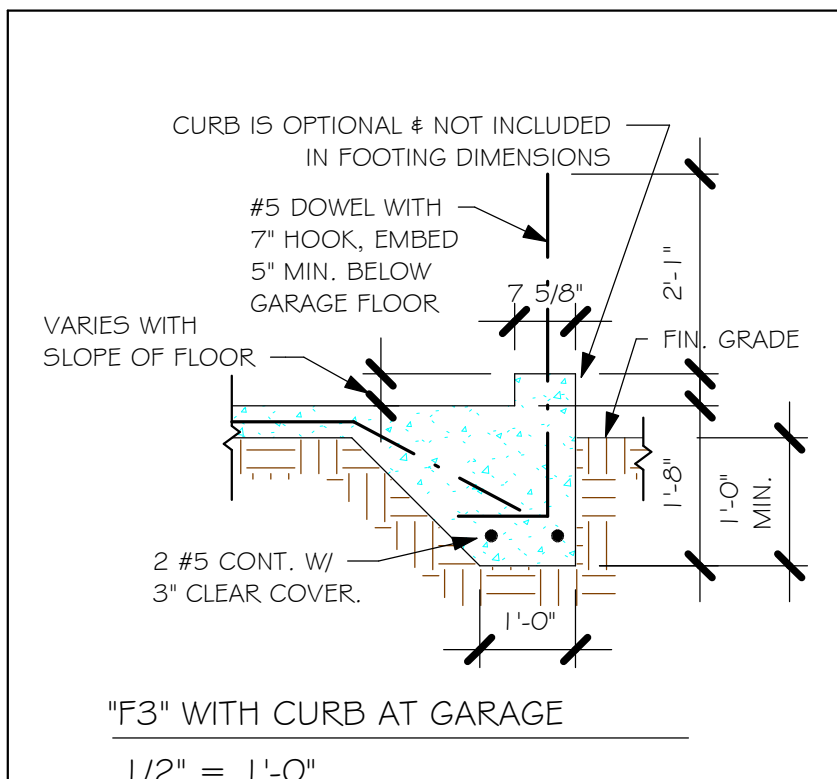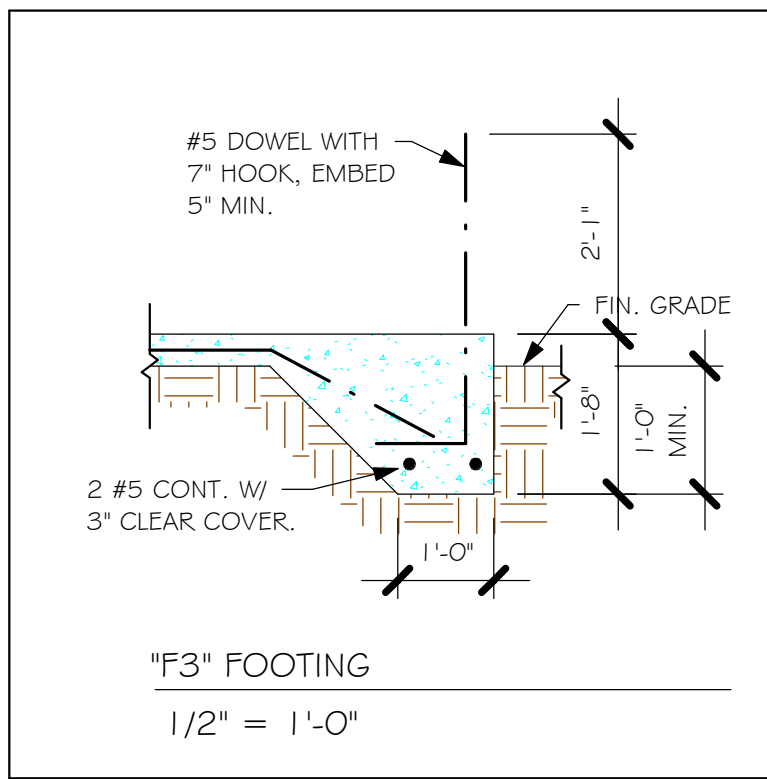

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
X	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
X	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
X	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
X	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
X	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

USED	WALL FOOTING SCHEDULE					
	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
X	F1	CONT.	1'-4"	0'-8"	2-#5	
X	F2	CONT.	1'-8"	0'-10"	2-#5	
X	F3	CONT.	1'-0"	1'-8"	2-#5	
X	F4	CONT.	1'-4"	1'-8"	2-#5	
X	F5	CONT.	1'-4"	1'-0"	2-#5	
X	F6	CONT.	1'-4"	1'-0"	2-#5	
X	F6A	CONT.	0'-8"	0'-8"	1-#5	
X	TE	CONT.	0'-8"	0'-8"	1-#5	


PROVIDE CORNER BARS PER 6/5-1

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"

PLAN NOTES:

- TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
- "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- (#) DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/5-1.

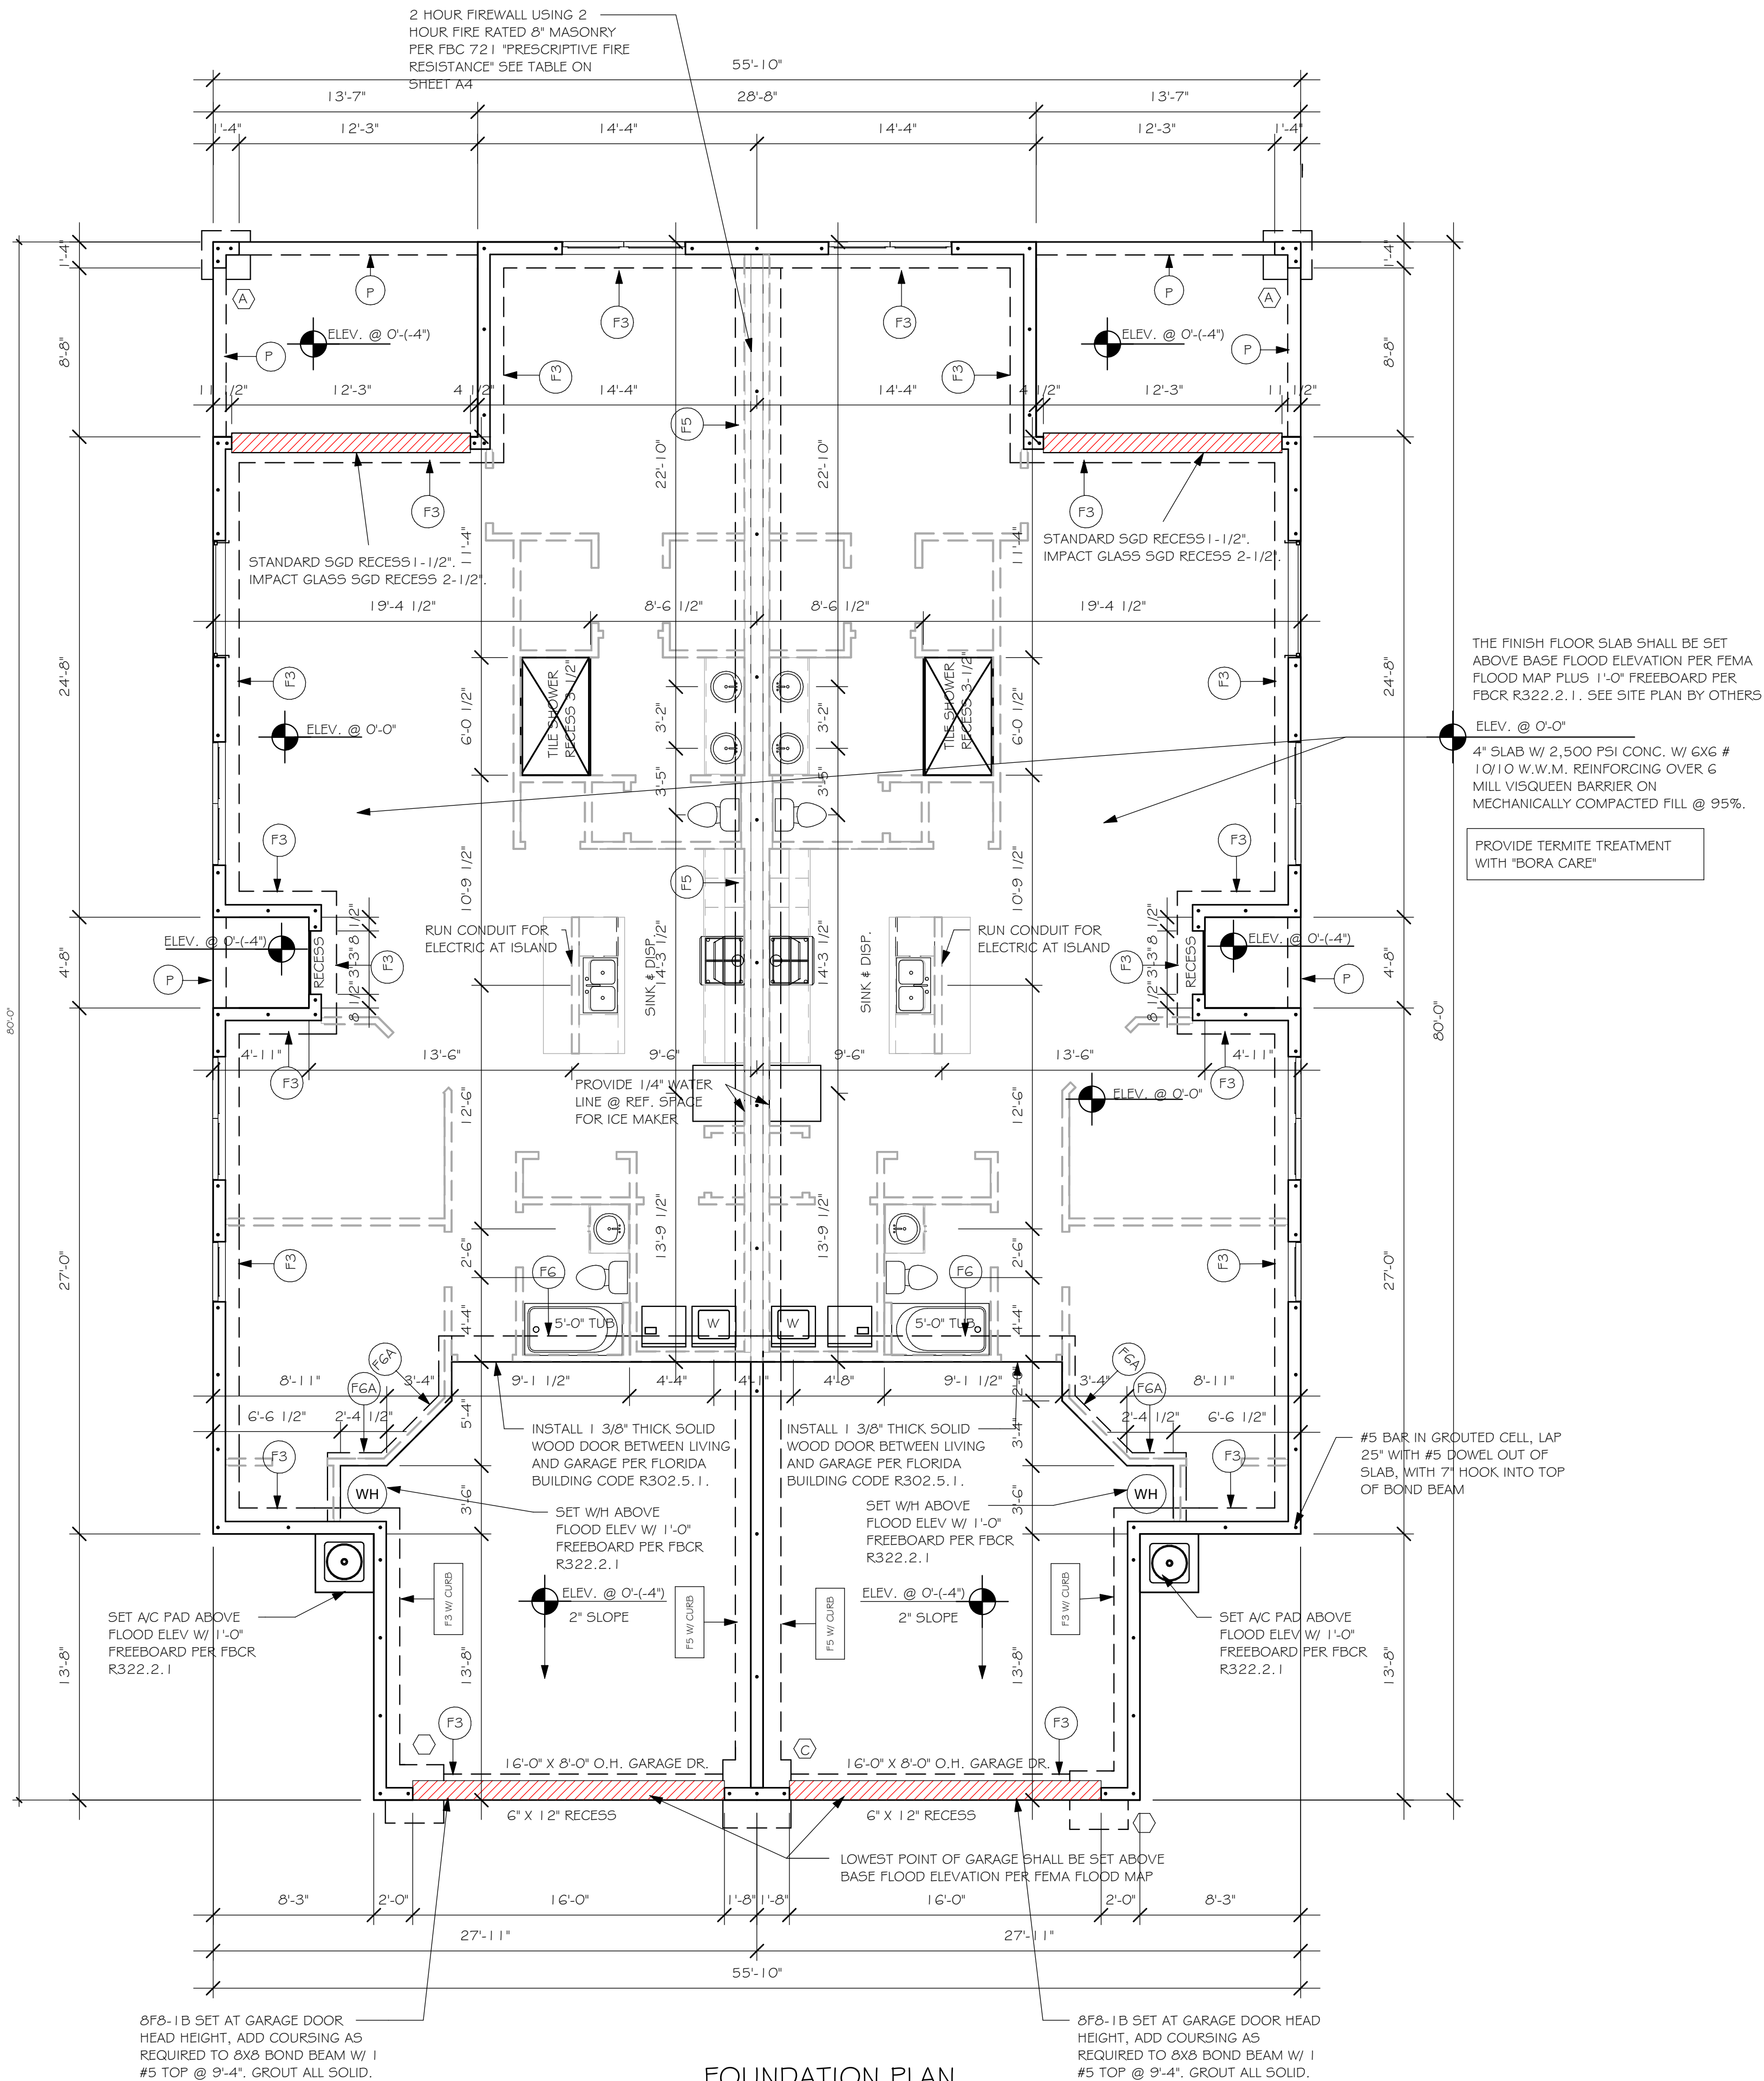

FOUNDATION PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DK HORTON
2019\SUBDIVISIONS\LINDSFORD II TV\51 1738 LOT 609-G-10 1526 ARREVIT\1738 1526
AR-VT

DOOR SCHEDULE							
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
1	16080 OHGD	GARAGE DOOR	8'-0"	16'-0"	+28.2/-31.5	+28.2/-31.5	2
2	3080 ENTRY	DISTINCTION	8'-0"	3'-0"	+33.5/-36.3	+33.5/-44.8	2
3	(3)-4080 SL. GL. DR.	DISTINCTION	8'-0"	12'-0"	+29.4/-33.3	+29.4/-33.3	2

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE C, AND
CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING
0.6W LOAD FACTOR. V_{asd}= 124 MPH

GARAGE DOOR ASSUMES 2' IN ZONE 5.


WINDOW SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
A	25 SH		5'-3"	3'-2"	+33.5/-36.3	+33.5/-44.8	2
B	2-25 SH		5'-3"	6'-4"	+33.5/-36.3	+33.5/-44.8	6
C	24'X72" FIXED GLASS		2'-0"	6'-0"	+33.5/-36.3	+33.5/-44.8	2

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE C, AND
CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING
0.6W LOAD FACTOR. V_{asd}= 124 MPH

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

PLAN NOTES	
1)	VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
2)	PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
3)	PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
4)	NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
5)	PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
6)	KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
7)	INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
8)	WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
9)	THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
10)	INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.5.1.
11)	ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PRVENTION DEVICE
12)	ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
13)	ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE


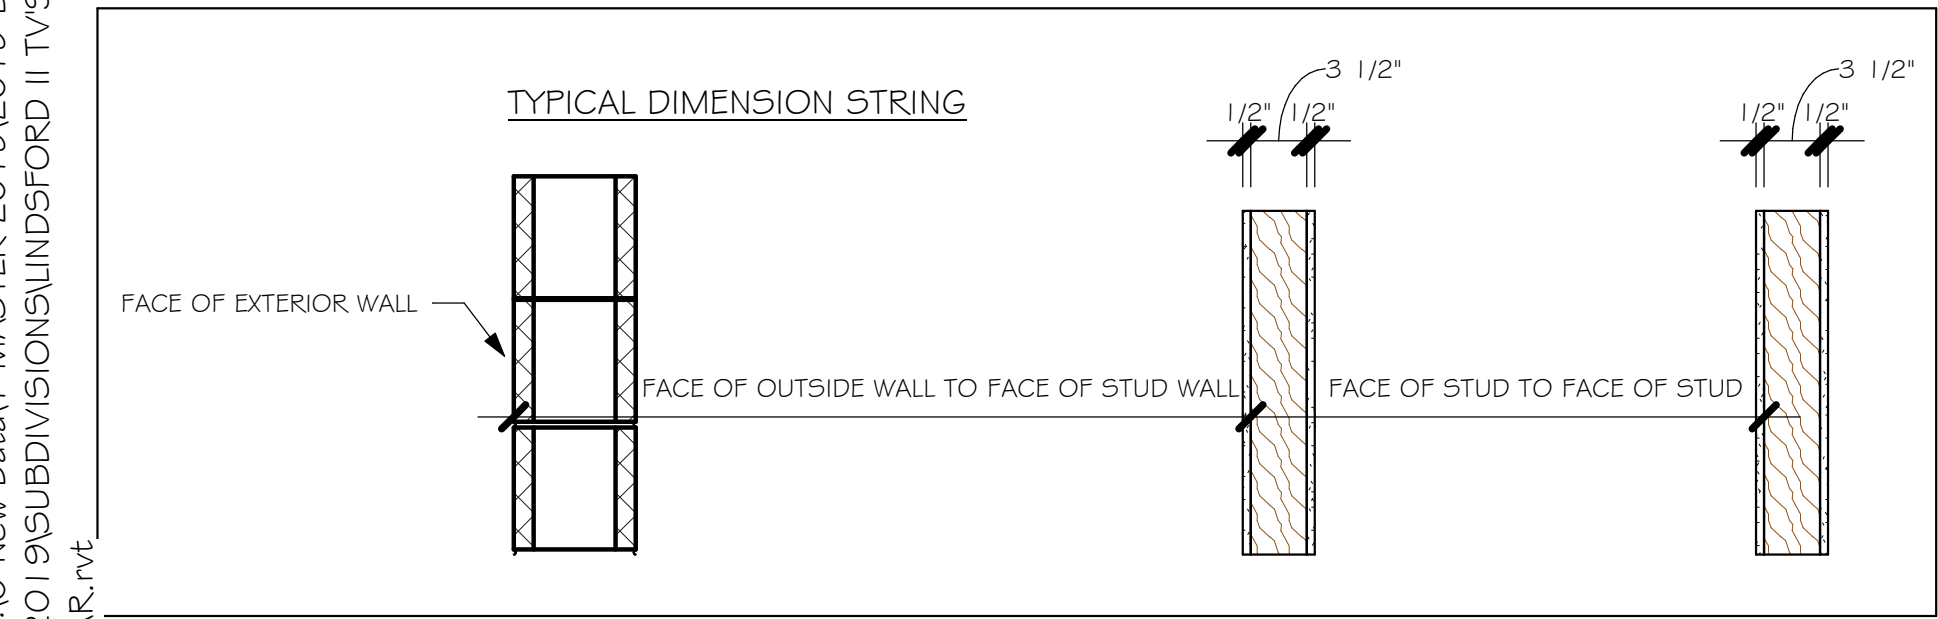


INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	L.V. = LOUVERED DOOR
5	2'-0"	
6	1'-8"	
7	1'-6"	
8	2'-11"	

SQUARE FOOTAGE UNIT 1	
LIVING AREA	1,513
GARAGE AREA	433
LANAI AREA	146
FRONT PORCH/ ENTRY AREA	29
TOTAL SQUARE FOOTAGE	2,121

SQUARE FOOTAGE UNIT 2	
LIVING AREA	1,513
GARAGE AREA	433
LANAI AREA	146
FRONT PORCH/ ENTRY AREA	29
TOTAL SQUARE FOOTAGE	2,121


BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

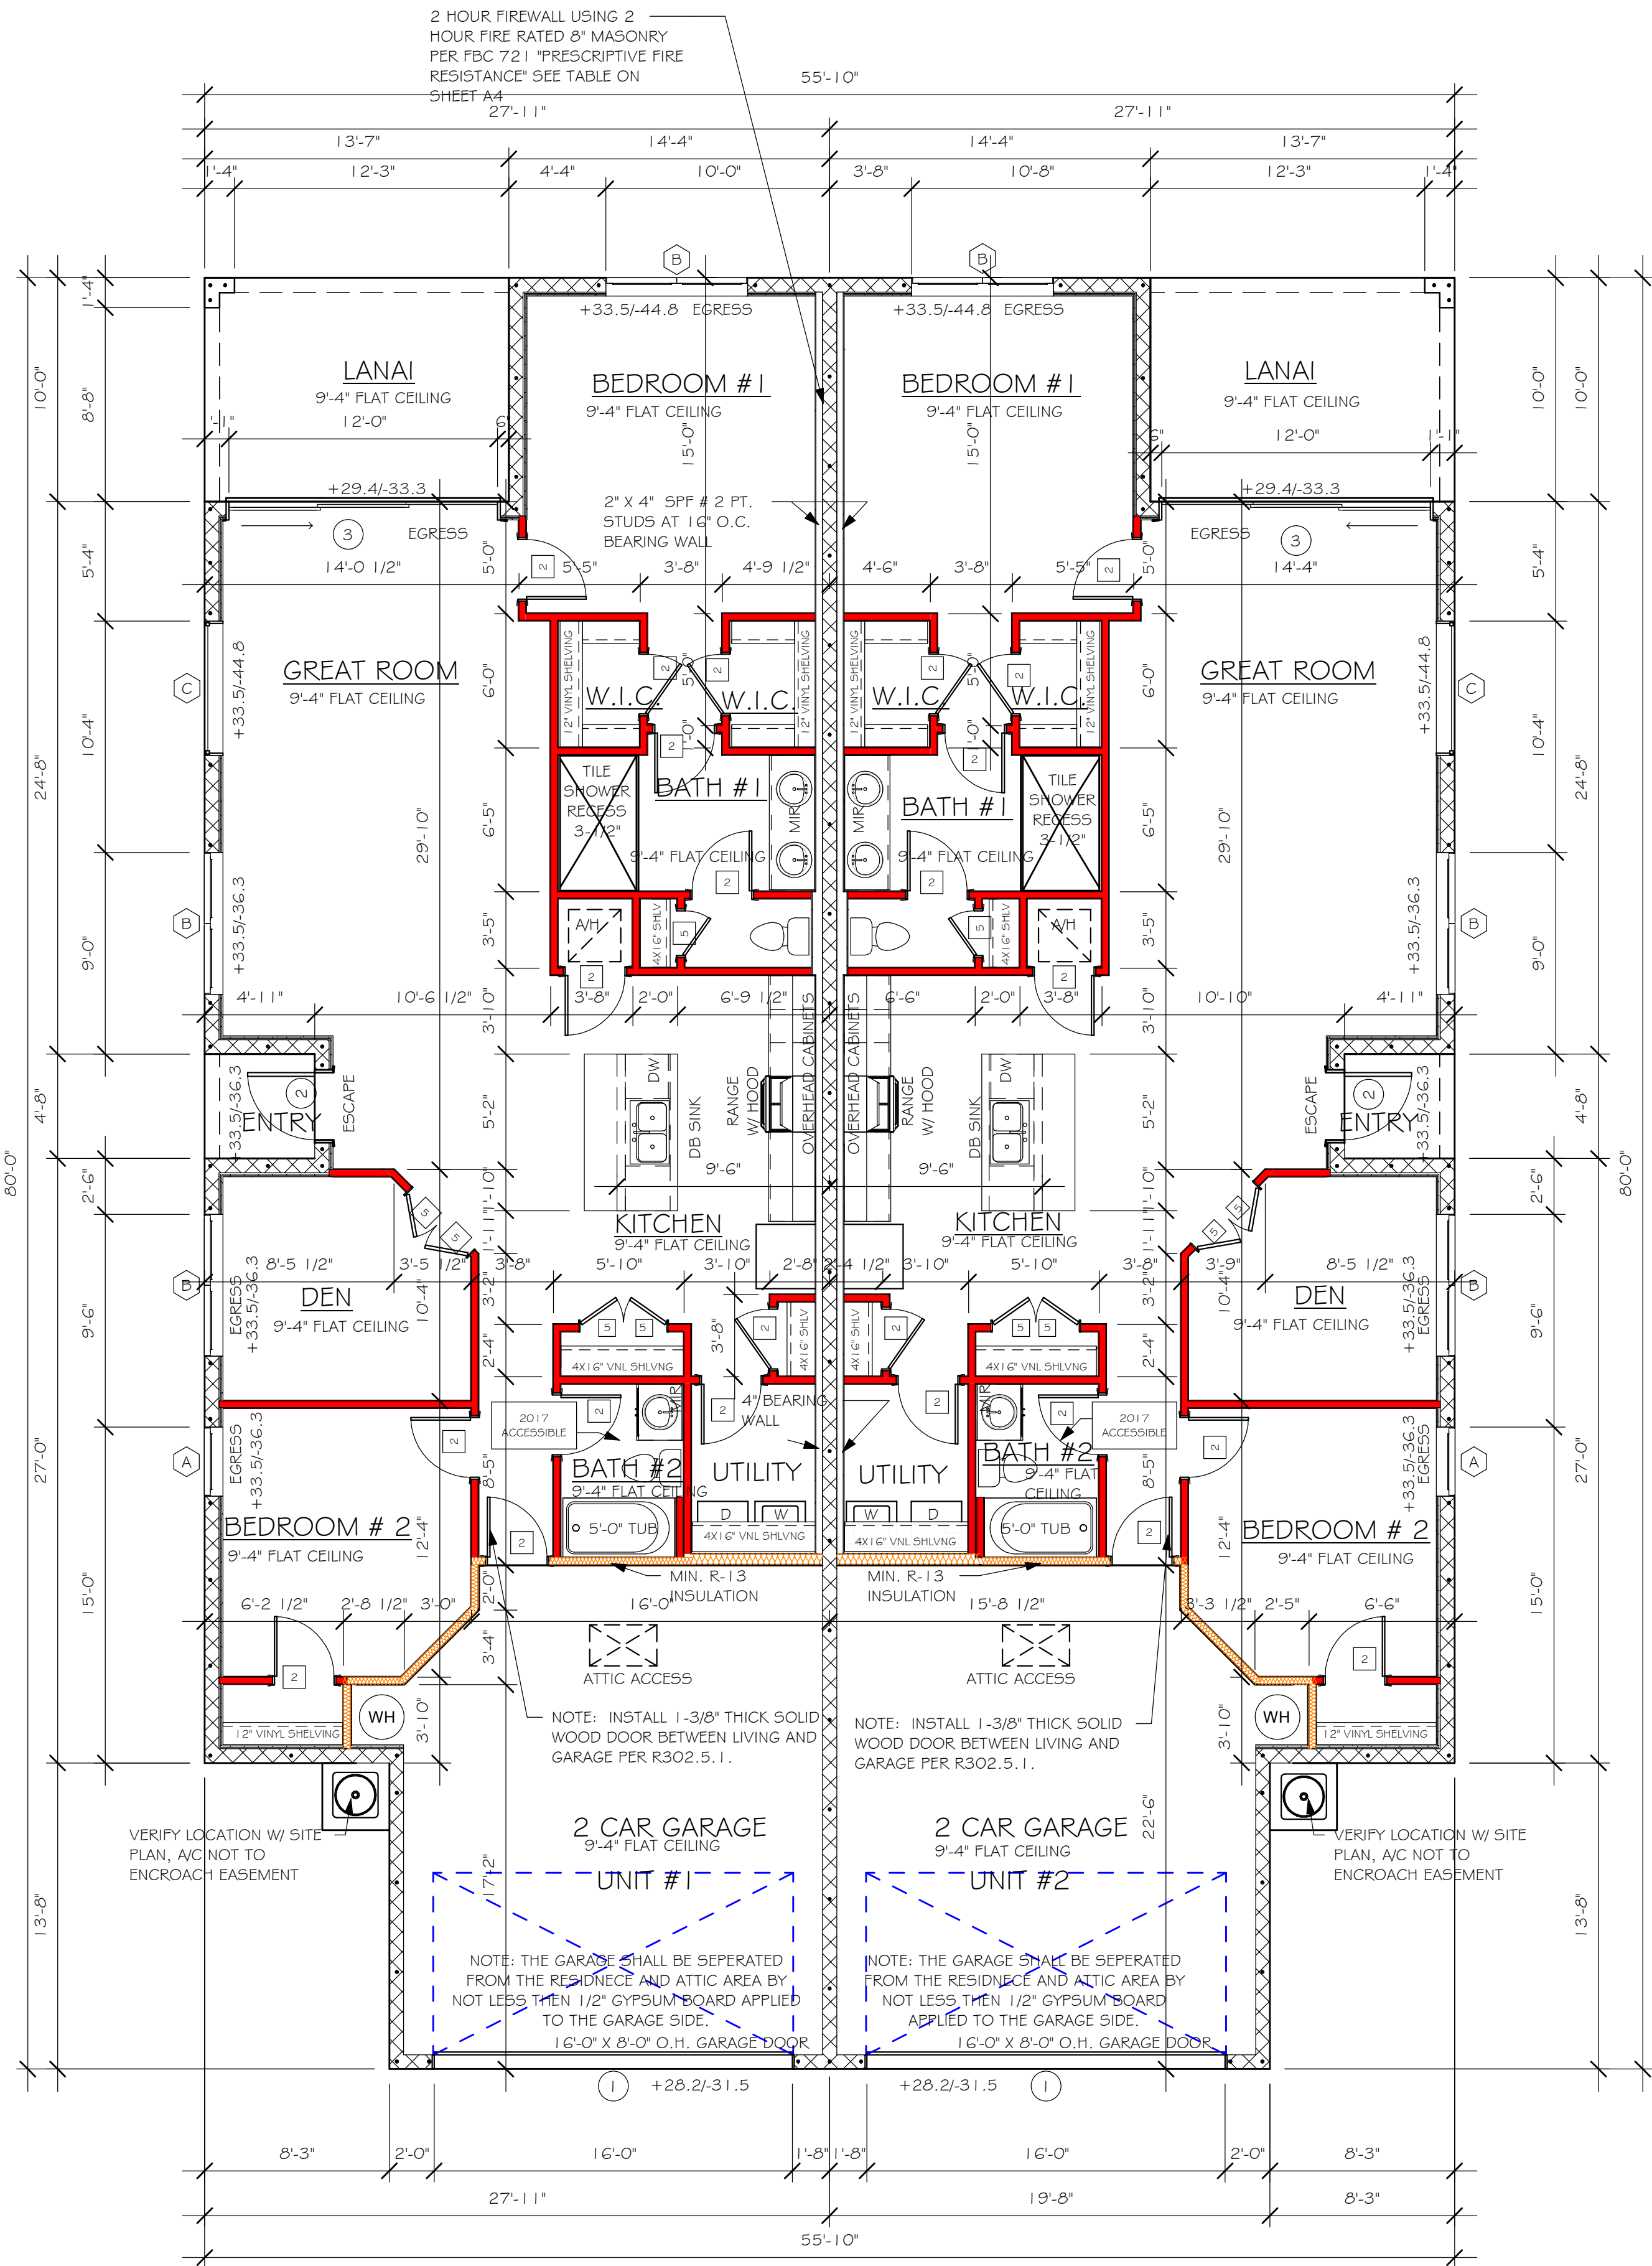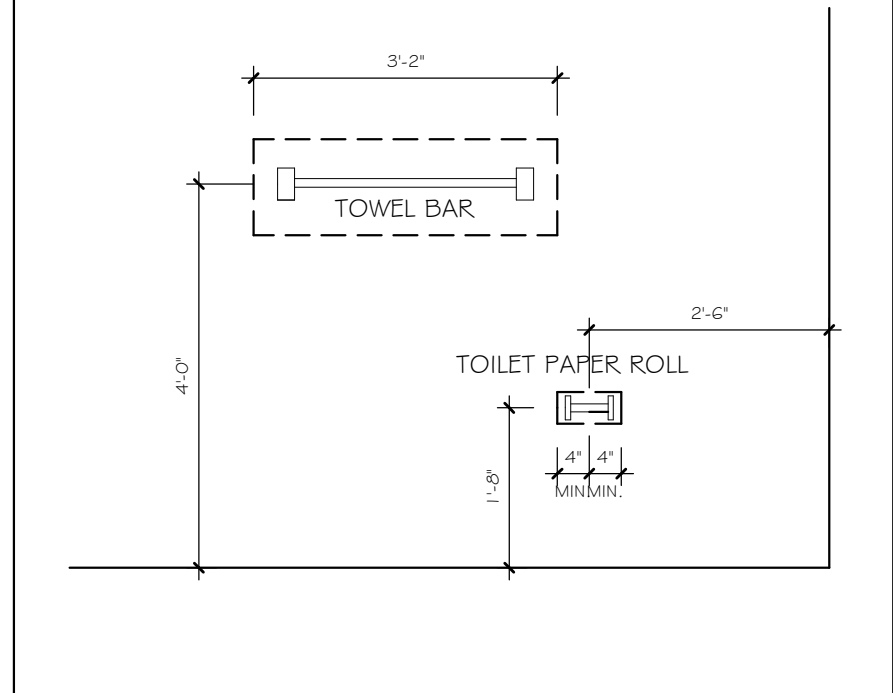

FLOOR PLAN

3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

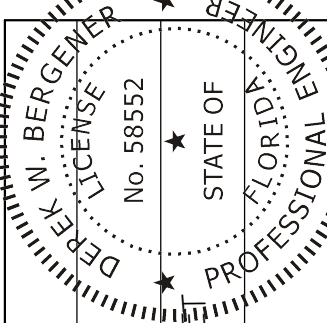

LOT: 609-G-10	LOT: 609-G-10
SUBDIVISION: LINDSFORD II TV's	SUBDIVISION: LINDSFORD II TV's
ADDRS: 4225-4221 BLOOMFIELD STREET	ADDRS: 4225-4221 BLOOMFIELD STREET
D.R.H. #: 578910223-224	D.R.H. #: 578910223-224

MODEL	MODEL
1526 VILLA	1526 VILLA
GCD JOB # 11738	GCD JOB # 11738

DATE:	07/28/20
DRAWN BY:	JSL
CHECKED BY:	JWC
REVISED:	
PLAN:	FLOOR
SCALE:	As indicated

A-3

TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
1450	(1) META16 TO 40	(8) 0.148x1 1/2", EMBED 4"
1810	(1) META16 TO 40	(9) 0.148x1 1/2", EMBED 4"
2120	(1) HHETA16 TO 40	(10) 0.148x1 1/2", EMBED 4"
1875 (1 PLY)	(2) META16 TO 40	(10) 0.148x1 1/2", EMBED 4"
1795 (2 PLY)	(2) META16 TO 40	(14) 0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) META16 TO 40	(12) 0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) HHETA16 TO 40	(12) 0.162x3 1/2", EMBED 4"
3965/5YP 3330/5FP	MGT (2 PLY)	(22) 0.148x3" ATR, EPOXY 12"
4235/5YP 3640/5FP	HTT4	(18) 0.162x2 1/2", 50° ATR, EPOXY 12"
4670/5YP 4015/5FP	HTT5	(26) 0.148x3", 50° ATR, EPOXY 12"
5445/5YP 5360/5FP	HT5KT	(26) 5D#10x2 1/2", 30° ATR, EPOXY
10690/5YP 10690/5FP	(1) HGT - 2	(26) 0.148x3" TO GIRDER
		(2) 3/4" Ø ATR, EPOXY 12"
	(1) HGT - 3	(16) 0.148x3" TO GIRDER
		(2) 3/4" Ø ATR, EPOXY 12"

NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON -C OF WALL.
- CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.
- SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD. WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 105-3.


SIMPSON CATALOG C-C- 2019

MODEL 1526 VILLA (EACH UNIT): ATTIC VENTILATION FBCR R806


SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED		
MARK	ATTIC	SOFFIT	ATTIC AREA/150	REGD AIR FLOW OF SOFFIT HAS	QUAD 4 SOFFIT HAS
1st STORY	2100.0 SQ. FT.	137.3 SQ. FT.	14.0 SQ. FT.	10.20%	8.15%
"SOFFIT ONLY" DOES NOT QUALIFY			ROOF VENTS ARE REQUIRED		
SOFFIT MODEL			ROOF VENT MODEL		
ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW			22.3/8" BASE		
			LOMANCO 770-D 0.97 SQ. FT. FREE AIR		

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)



Design No. U301	Bearing Wall Rating 2 HR.	Finish Rating 66 Min.
1. Nailheads - Exposed or covered with joint finisher.		
2. Joints - Exposed or covered with fiber tape and joint finisher. As an alternate, nominal 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard. Joints reinforced.		
3. Nails - 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 8d cement coated nails 2-3/8 in. long, 0.113 in. shank diam, 9/32 in. diam heads.		
4. Gypsum Board - 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 8" o.c. Outer layer attached to studs over inner layer with the 2-3/8 in. long nails spaced 8" o.c. Vertical joints located over studs. All joints in face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side. When Steel Framing Members* (Item 5) are used, base layer attached to furring channels with 1 in. long Type S bugle-head steel screws spaced max. 24 in. o.c.; face layer attached with 1-5/8 in. long Type S bugle-head steel screws spaced max. 12 in. o.c.		
AMERICAN GYPSUM CO. - Types AG-C, AGX-11, AGX-C, BEIJING NEW BUILDING MATERIALS CO LTD - Type DBX-1, CERTAINTED GYPSUM, INC. - Types 1, FRPC, EGRG, ProRoc Type C or ProRoc Type X, CERTAINTED GYPSUM CANADA, INC. - ProRoc Type C, ProRoc Type X, ProRoc Type Abuse-Resistant, CANADIAN GYPSUM COMPANY - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX, G+P GYPSUM CORP., SUB OF GEORGIA-PACIFIC CORP. - Types 5, 9, C, DAP, DO, DA, DGG, DS, GPF56, LAFARGE NORTH AMERICA INC. - Types LGFC-C, LGFC2, LGFC2A, LGFC3, LGFC3A, LGFC3A, NATIONAL GYPSUM CO. - Types FSK, FSK-C, FSK-G, FSW, FSW-3, FSW-C, FSW-G, PASCO GYPSUM, DIV OF PACIFIC COAST BUILDING PRODUCTS INC. - Types C, PG-2, PG-3, PG-3W, PG-4, PG-5, PG-5W, PG-SWS, PG-9 or PG-C, TEMPLE-INLAND FOREST PRODUCTS CORP. - Type TG-C, SIAM GYPSUM INDUSTRY (SARABURI) CO LTD - Type EX-1, STANDARD GYPSUM L.L.C. - Types SGC, SG-C or SG-C, UNITED STATES GYPSUM CO. - Types AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX, USG MEXICO S A DE C V - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX, 4A. Gypsum Board - (As an alternate to Item 4) - Nom. 3/4 in. thick, installed as described in Item 4. CANADIAN GYPSUM COMPANY - Types AR, IP-AR, UNITED STATES GYPSUM CO. - Types AR, IP-AR, USG MEXICO S A DE C V - Types AR, IP-AR, 4B. Gypsum Board - (As an alternate to Items 4 and 4A) - 5/8 in. thick, 2 ft. wide, tongue and groove edge, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 4. Joint covering (Item 2) not required. CANADIAN GYPSUM COMPANY - Types SHX, UNITED STATES GYPSUM CO. - Types SHX, USG MEXICO S A DE C V - Types SHX, 5. Molded Plaster - Not shown, Optional - Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details. ASSOCIATED MATERIALS INC ALSIDE, DIV OF GENTERK BUILDING PRODUCTS LTD HEARTLAND BUILDING PRODUCTS INC VYTEC CORP NEBRASKA PLASTICS INC 6. Steel Framing Members - (Optional, Not shown)* - Furring channels and resilient sound isolation clip as described below: A. Furring Channels - Formed of No. 25 MSG galv. steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. o.c. perpendicular to studs. Channels secured to studs as described in Item B. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 16 SWG galv. steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 4. B. Steel Framing Members * - Resilient sound isolation clip used to attach furring channels (Item 6A) to studs. Clips spaced 48 in. o.c. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. PAC INTERNATIONAL INC - Type RSIC-1. *Bearing the UL Classification Mark		

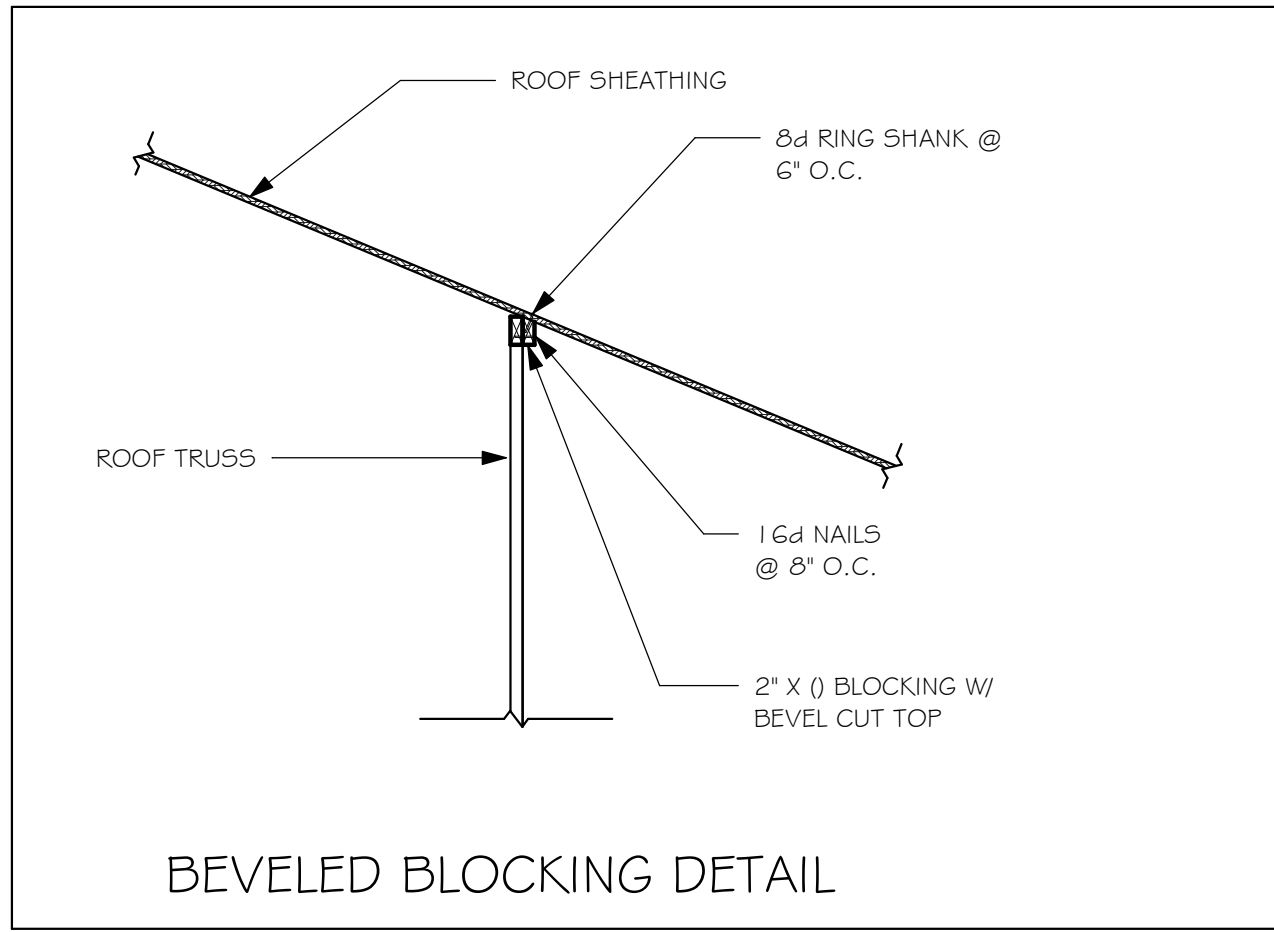

TRUSS BEARING CONDITIONS AND STRAPPING BASED ON TRUSS LAYOUT PREPARED BY SCOSTA JOB#: 44151GB DATED: 06/18/19 REVISED: 11/27/19

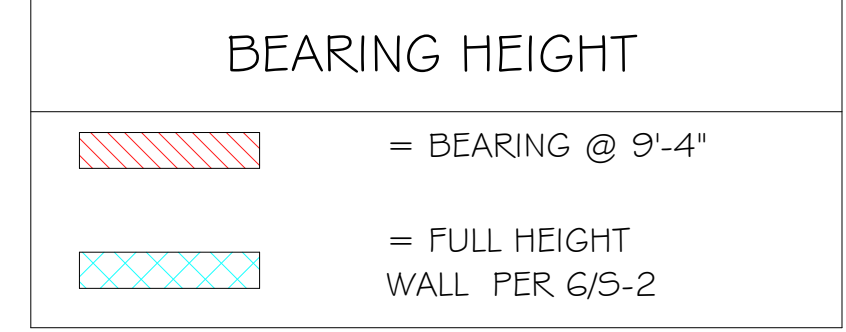

- PLAN NOTES:
- ROOF AND FLOOR TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - ROOF AND FLOOR FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-1.
 - PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - FOR NAILING OF ROOF AND FLOOR DECK, SEE 1 AND 2 ON S-1.
 - 8F8-1B etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET. AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ #5 CONTINUOUS, SEE DETAIL 11/5-1.
 -

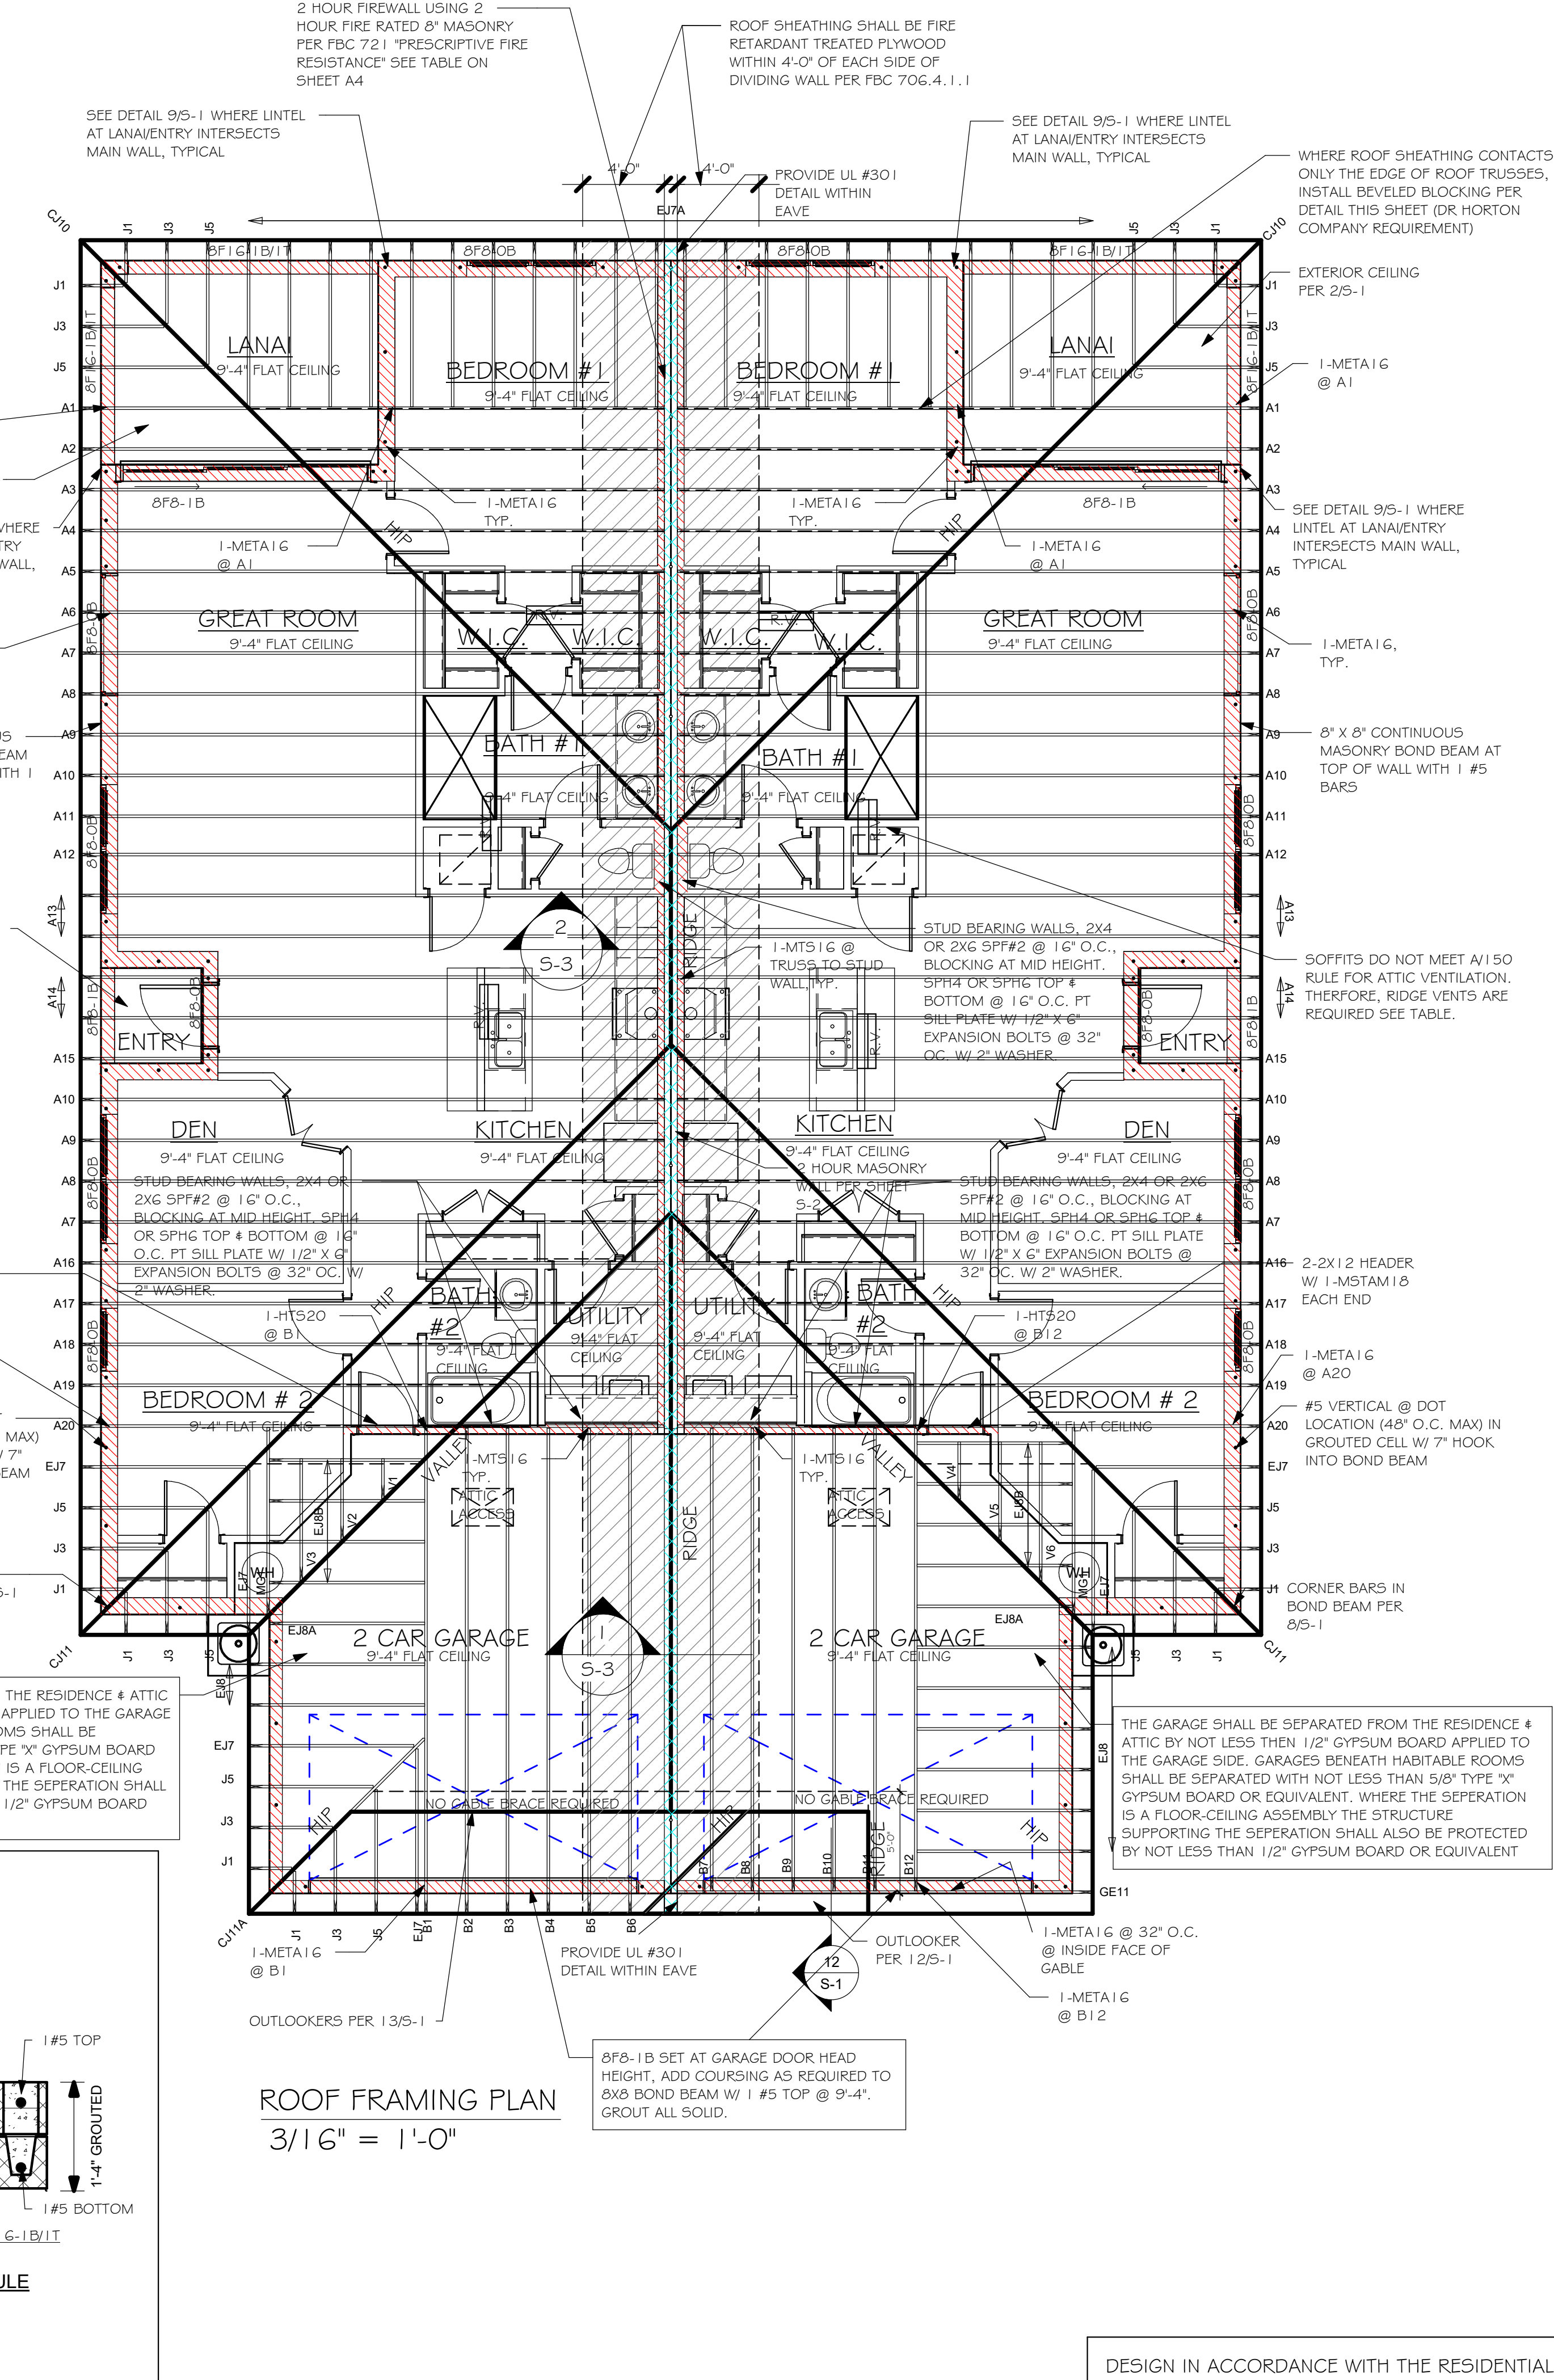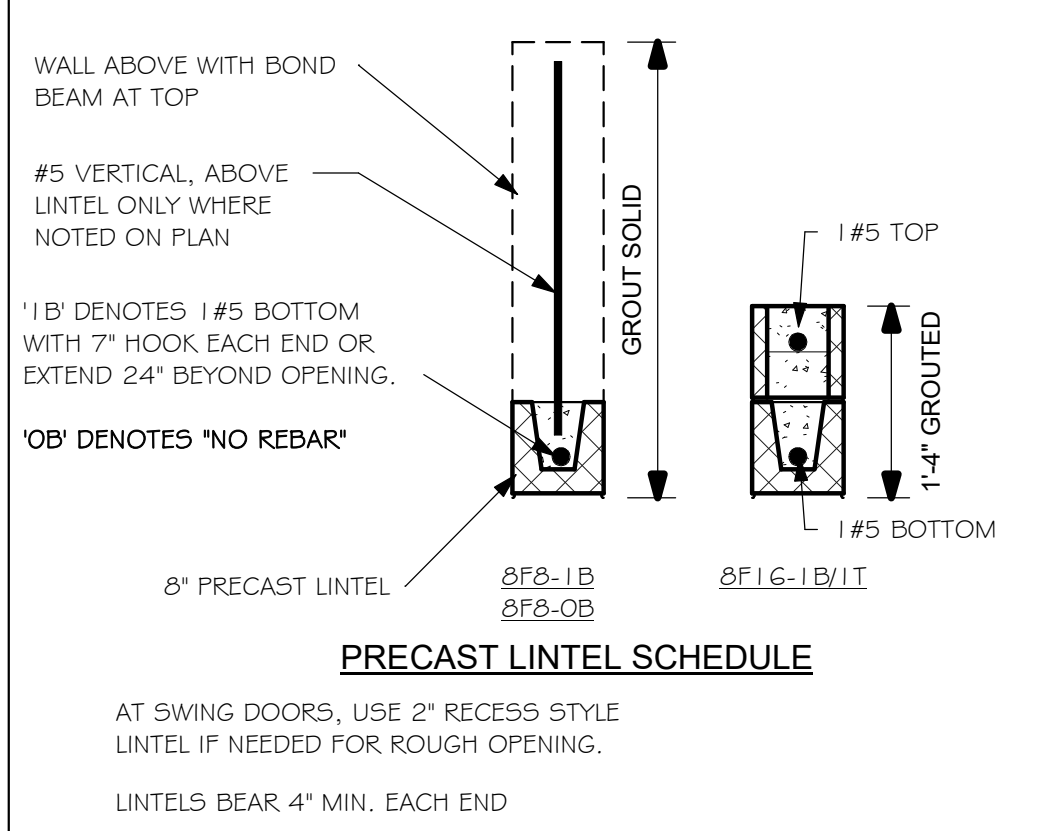

D-R-HORTON
America's Builder

Gulf Coast
Drafting & Design, Inc.

EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 395-540-822
1535 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL ENGINEERING
STATE OF FLORIDA
DANIEL SCOSTA
No. 58552
PROFESSIONAL ENGINEER

LOT: 609-G-10
SUBDIVISION: LINDSFORD II T/Vs
ADDRESS: 4225-4221 BLOOMFIELD STREET
D.R.H. #: 578910223-224
GCD JOB # 11738

DATE: 07/28/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: ROOF
SCALE: As indicated

A-4

ELECTRICAL METER

ELECTRICAL PANEL

1 20 V JUNCTION BOX

SINGLE RECEPTACLE OUTLET

220 V. RECEPTACLE OUTLET

4-PLEX RECEPTACLE OUTLET

DUPLEX RECEPTACLE OUTLET

1/2 SWITCHED DUPLEX OUTLET

DUPLEX RECEPTACLE AT ELEV. A.F.F.

DUPLEX RECEPTACLE - ABOVE COUNTER

SINGLE POLE SWITCH

3 WAY SWITCH

DIMMER SWITCH

MOTION SENSOR SWITCH

AC/DC SMOKE DETECTOR
TO BE INTERCONNECTED
ANY RESIDENT HAVING A FOSSIL-BURNING
HEATER OR APPLIANCE, A FIREPLACE, OR
AN ATTACHED GARAGE SHALL HAVE AN
OPERATIONAL CARBON MONOXIDE ALARM
INSTALLED WITHIN 10 FEET OF EACH
ROOM USED FOR SLEEPING PERPOSES.
PER RULE 9B-3.04.72
SD (SMOKE DETECTOR)
SCD (CARBON MONOXIDE/ SMOKE
DETECTOR)

TELEPHONE OUTLET

TELEVISION RECEPTION OUTLET

SURFACE MOUNTED CEILING LIGHT

FLUSH MOUNTED LIGHT

WALL MTD. BRACKET LIGHT

DUPLEX FLOOD LIGHT

EXHAUST FAN

TRACK MTD. LIGHTS

A/C DISCONNECT

PUSH BUTTON (PB) / DOOR BELL (DB)

INTERCOM

KEYPAD

4' FLUORESCENT LIGHT

2' UNDER COUNTER LIGHT

NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.

ELECTRICAL NOTES:
ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11
ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD.
ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S.
INSTALL PHONE AND T.V PER CONTRACT.
INSTALL ALL ELECTRICAL PER NEC 201.4

AIR CONDITIONING COORDINATION REQUIRED.
PRIOR TO ORDERING ROOF TRUSSES, THE CONTRACTOR SHALL WORK WITH THE AIR CONDITIONING SUB CONTRACTOR TO DESIGN/PLAN AND LAYOUT THE LOCATION OF AIR HANDLING EQUIPMENT, AIR DUCT SIZE AND LOCATION AND COORDINATE THAT DESIGN WITH THE TRUSSES FOR SPACE, CONNECTIVITY, AND POSITION REQUIREMENTS. THE CONTRACTOR MUST ADVISE THE TRUSS COMPANY PRIOR TO ANY CONSTRUCTION OF TRUSSES OF THE AIR CONDITIONING/HANDLING EQUIPMENTS SIZES AND WEIGHT AND DUCT LAYOUT CONCERNS OR REQUIREMENTS THAT MAY HAVE THE POTENTIAL TO CHANGE OR MODIFY THE TRUSSES TO ACCOMMODATE THE SAME. THE CONTRACTOR SHALL COORDINATE CONDENSATION DISCHARGE LINE LOCATION, AND ELECTRICAL SERVICE TO AIR EQUIPMENT, AND PROVIDE ANY LOCAL DISCONNECTS, LIGHTS AND SERVICE PLATFORMS THAT MAY BE REQUIRED.

ELECTRICAL NOTES FOR FIRE RATED WALLS

ELECTRICAL OUTLETS PLACED IN FIRE RATED WALLS SHALL BE IN CONFORMANCE WITH THE UNDERWRITERS LABORATORIES, INC., FIRE RESISTANCE DIRECTORY, CURRENT EDITION. THESE REQUIREMENTS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING SPECIFIC ITEMS:

A) INDIVIDUAL OUTLET/SWITCH BOXES SHALL NOT EXCEED (16) SQUARE INCHES IN AREA.

B) AGGREGATE AREA OF OUTLET/SWITCH BOXES SHALL NOT EXCEED (100) SQUARE INCHES WITHIN (100) SQUARE FEET OF WALL AREA.

C) OUTLET/SWITCH BOXES LOCATED ON OPPOSITE SIDE OF THE SAME WALL SHALL BE SEPERATED BY A MINIMUM OF (24) INCHES.

D) ALL OUTLET/SWITCH BOXES SHALL BE SECURELY ATTACHED TO THE STUDS AND THE OPENING IN THE WALL BOARD FACING SHALL BE CUT SO THAT THE CLEARANCE BETWEEN THE BOX AND THE WALLBOARD DOES NOT EXCEED 1/8 INCH.

200 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(26)	(FLUSH MOUNTED LT)
B	(4)	(VAPORS)
C	(4)	(PENDANT LIGHT
D	(8)	(10" MUSHROOMS)
E	(2)	(24" AVALON 3 LT)
F	(4)	(36" AVALON 4 LT)
G	(X)	(NOT USED)
H	(2)	(COACH LIGHTS)
I	(X)	(COACH LIGHTS)
J	(1)	(J BOX)
K	(2)	(4' FLUORESCENT)
L	(X)	(2' FLUORESCENT)
M	(X)	(5LT CHANDELIER)
N	(X)	(3 LT AVALON)
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

ELECTRICAL PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

D-R HORTON
BY
NYS
America's Builder

Gulf Coast
Drafting & Design, Inc.

EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1823
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 609-G10
SUBDIVISION: LINDSFORD II T/V's
ADDRESS: 4225-4221 BLOOMFIELD STREET
D.R.H. #: 578910223-224

MODEL
1526 VILLA
GCD JOB # 11738

DATE: 07/28/20

DRAWN BY: JSL

CHECKED BY: JWC

REVISED:

PLAN: ELECTRICAL

SCALE: As indicated

A-5

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DRK HORTON
2019\SUBDIVISIONS\LINDSFORD II T/V'S\11738 LOT 609-G10 1526 ARREVIT\11738 1526
AR.vrt

GENERAL NOTES

- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
- ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
- SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
- ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS SHALL BE HOT MOPED DIFFER GALVANIZED OR STAINLESS STEEL CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
- TREATED WOOD REQUIREMENTS:-
ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY.
ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTORS SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION, THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
- CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
- LANAI CEILINGS & COVERED ENTRY CEILINGS
1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-6d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 6d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

SHINGLES

1/5" FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES, ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURER. INSTALLATION SHALL COMPLY WITH MANUFACTURERS REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

FASTENERS

FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 12 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESISTANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL

4

CLAY AND CONCRETE ROOF TILE SPECS


INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE
LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY
WITH THE PROVISIONS OF R905.3 F.B.C.
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT
MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN
APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL
INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:

1. TILE PLACEMENT AND SPACING,
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,
 - A. AMOUNT AND PLACEMENT OF MORTAR
 - B. AMOUNT AND PLACEMENT OF ADHESIVE
 - C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT
4. SLOPE REQUIREMENT.

5

FLOOR SHEATHING AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES
SPAN RATING 48/24 OR BETTER, GLUED AND NAILED

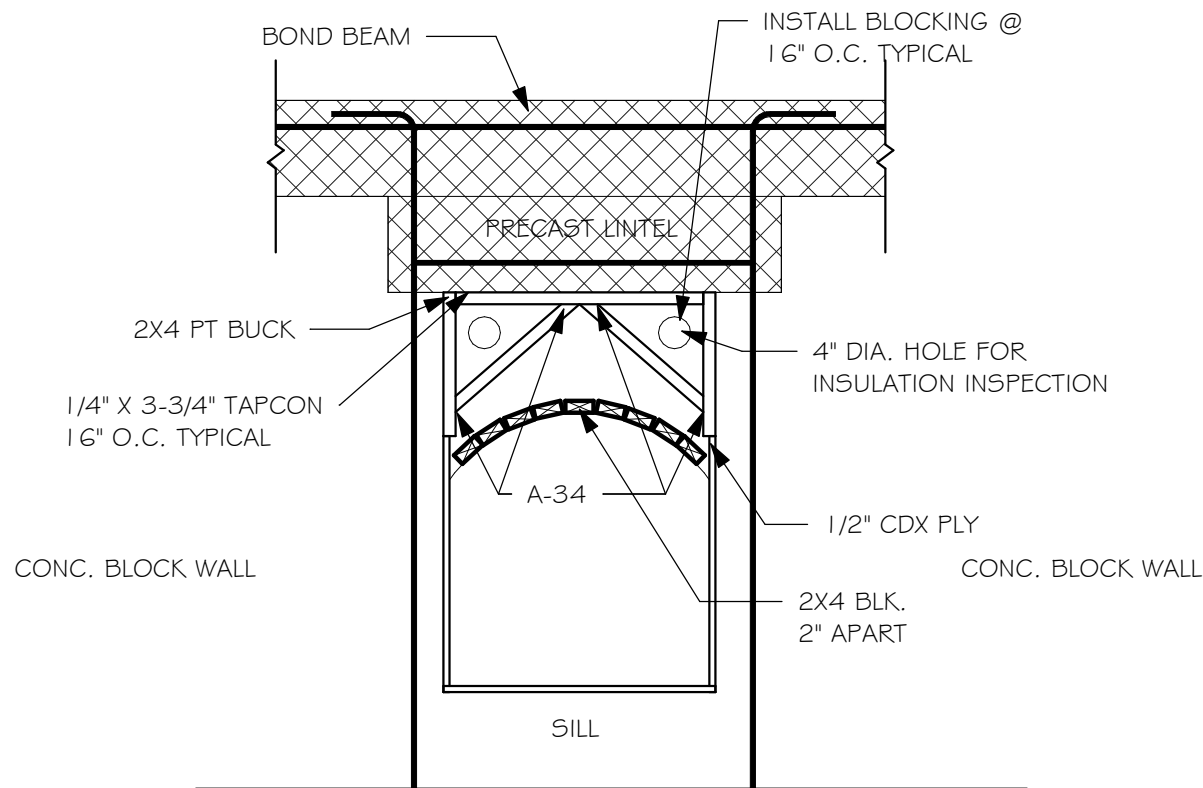


WINDOW OR DOOR ARCH
SPACE FRAMING ABOVE



SPECIAL NOTE:

FRAMING OF DECORATIVE ARCHES AT WINDOW AND DOOR OPENINGS SHALL COMPLY WITH THE FOLLOWING:

4" DIA. HOLE FOR INSULATION INSPECTION

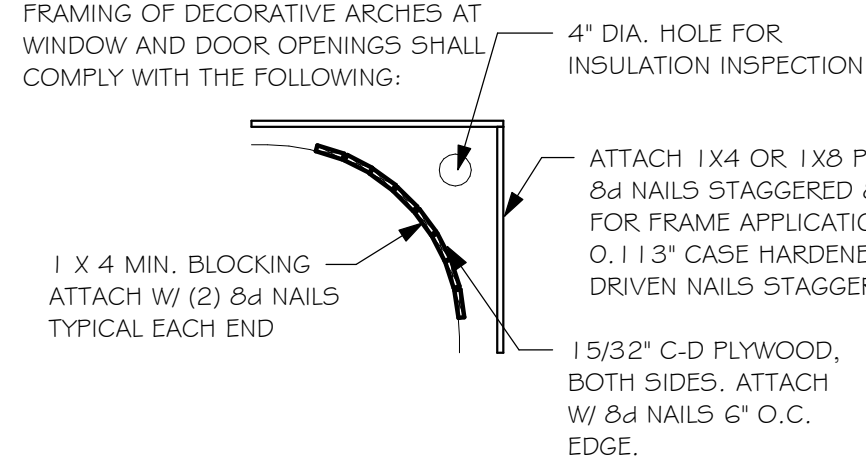

FILL IN FRAMING

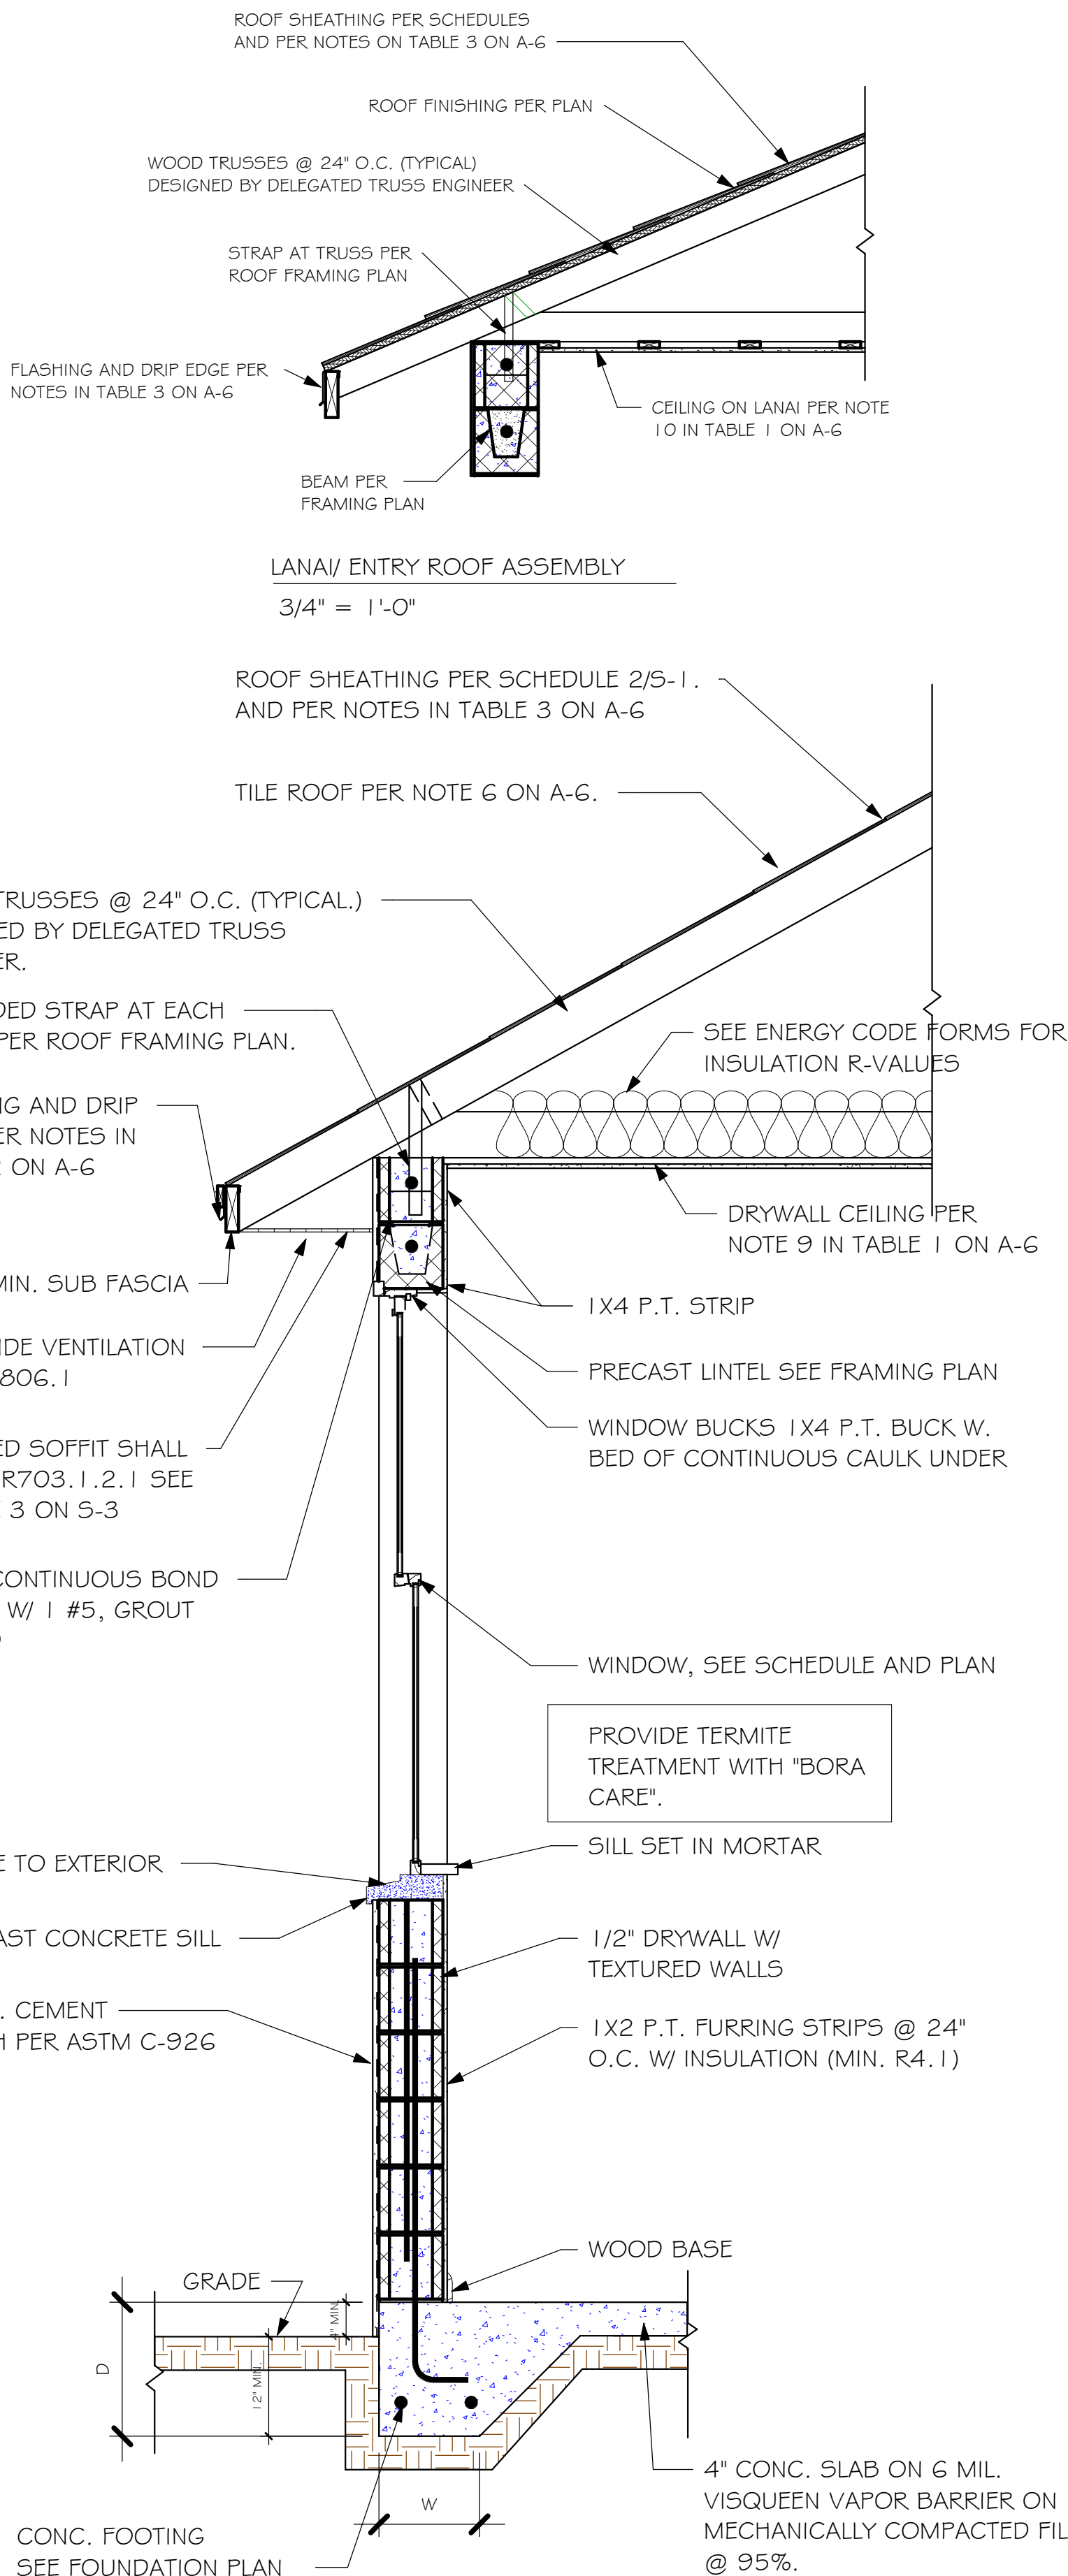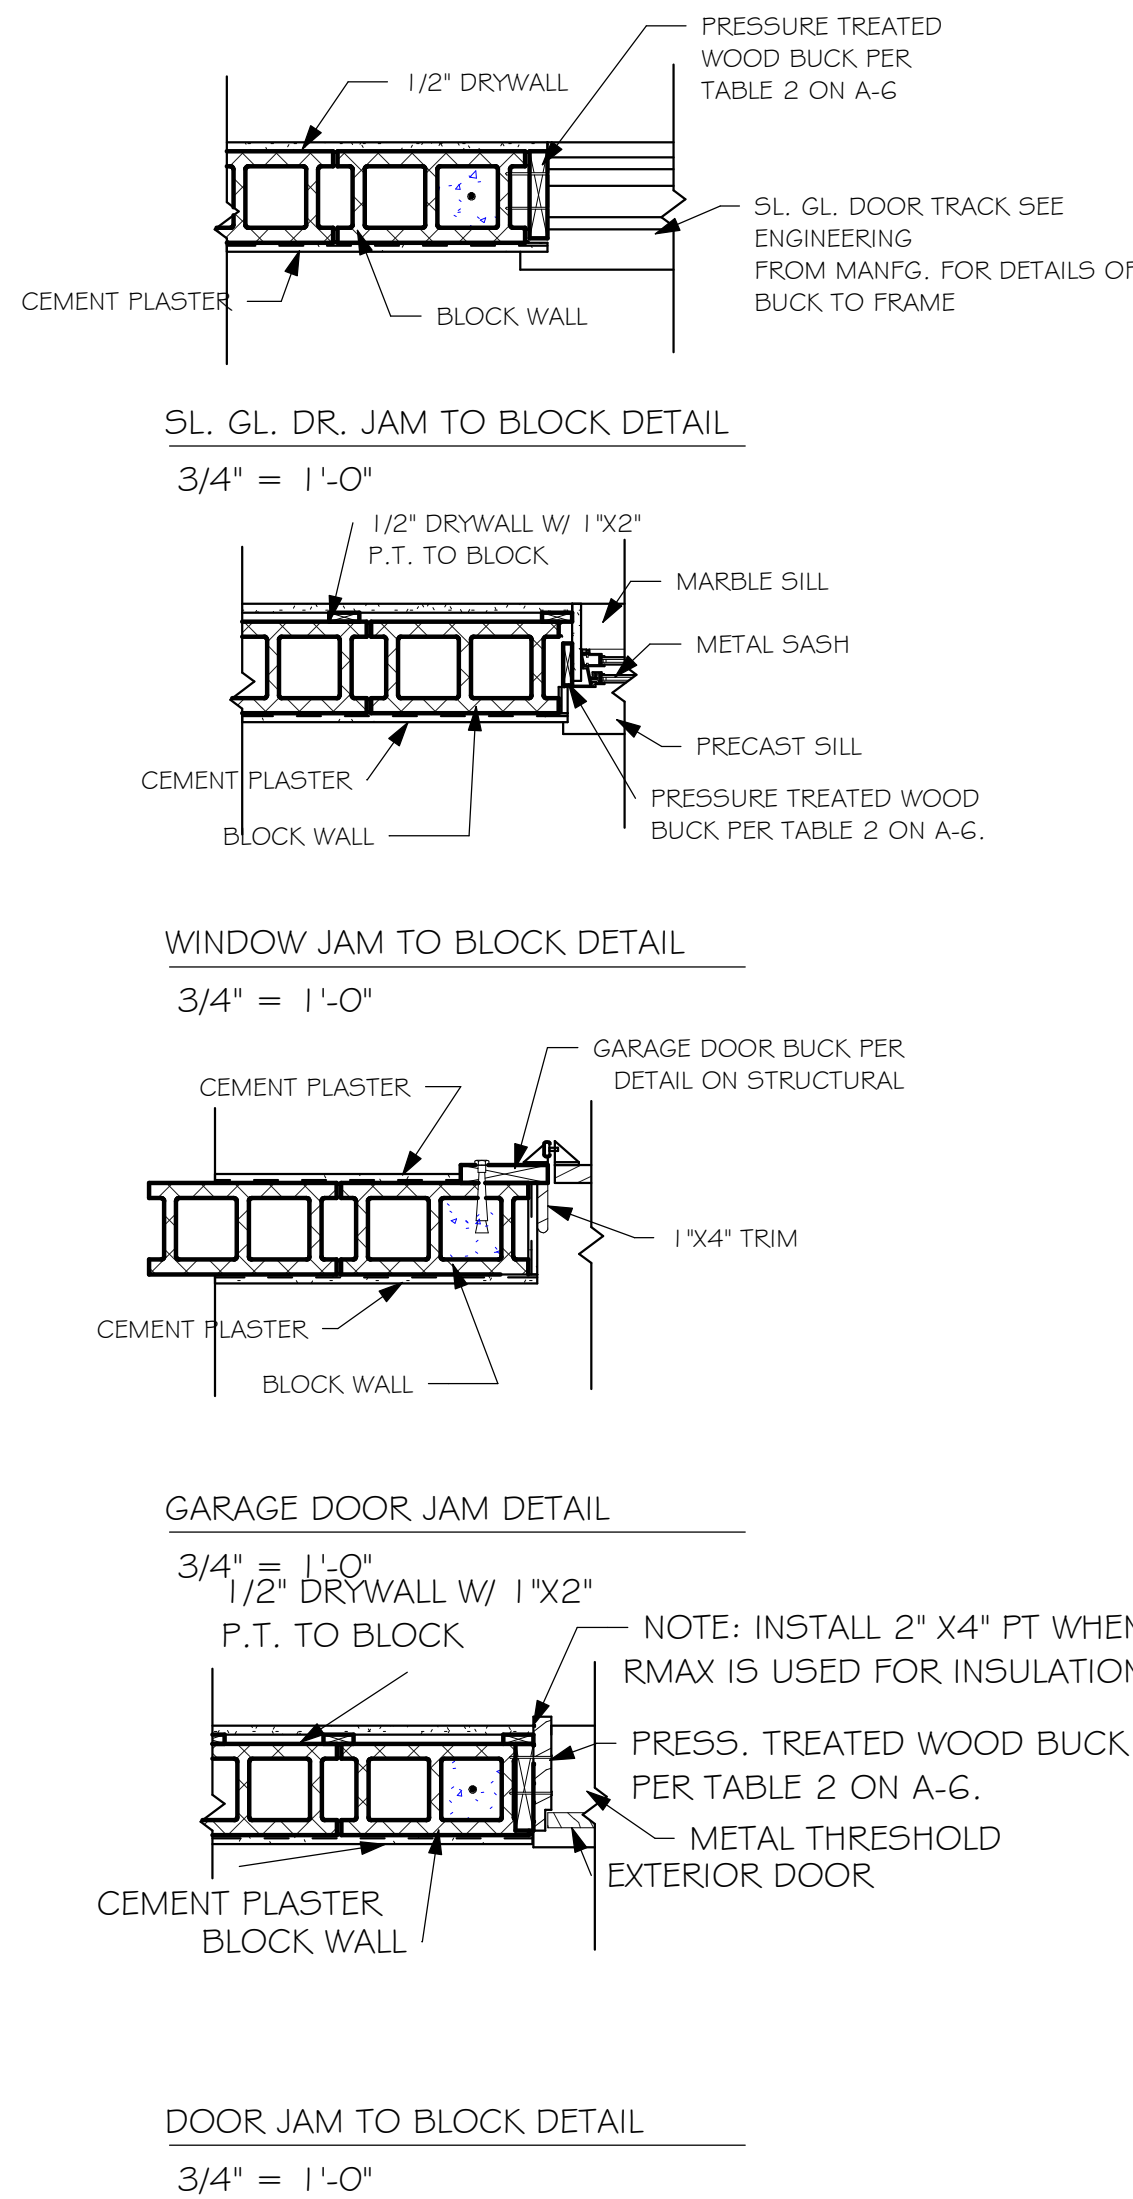


TYPICAL WALL SECTION

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION




A-7



2 NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED
HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.




STEP FOOTING SCALE: NTS



9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

STRUCTURAL ENGINEERING:
STRUCTURAL
SYSTEMS
OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

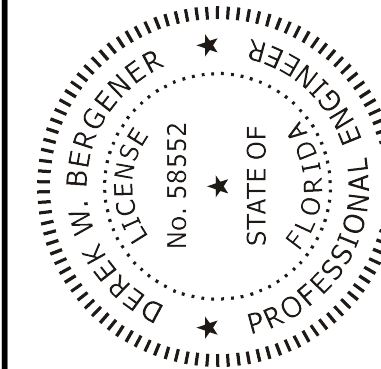

BUILDER:

D.R. HORTON • RHI
NYSE

America's Builder

**STRUCTURAL DETAILS FOR
1526 SIGNATURE VILLA**

4221, 4225 BLOOMFIELD STREET
FORT MYERS, FLORIDA


LOT: 609—610 SUBDIVISION: LINDSFORD II TVs

DESIGN/DRAWN
DWB/DWB
CHECKED
DWB
DATE
07/29/20
SCALE
AS NOTED
JOB NO.
DR 11738
SHEET


S-1

SHEET 1 OF 3


FOR SCOSTA TRUSSES, JOB # 44151GB, DATED 06/18/19, REVISED: 11/27/19

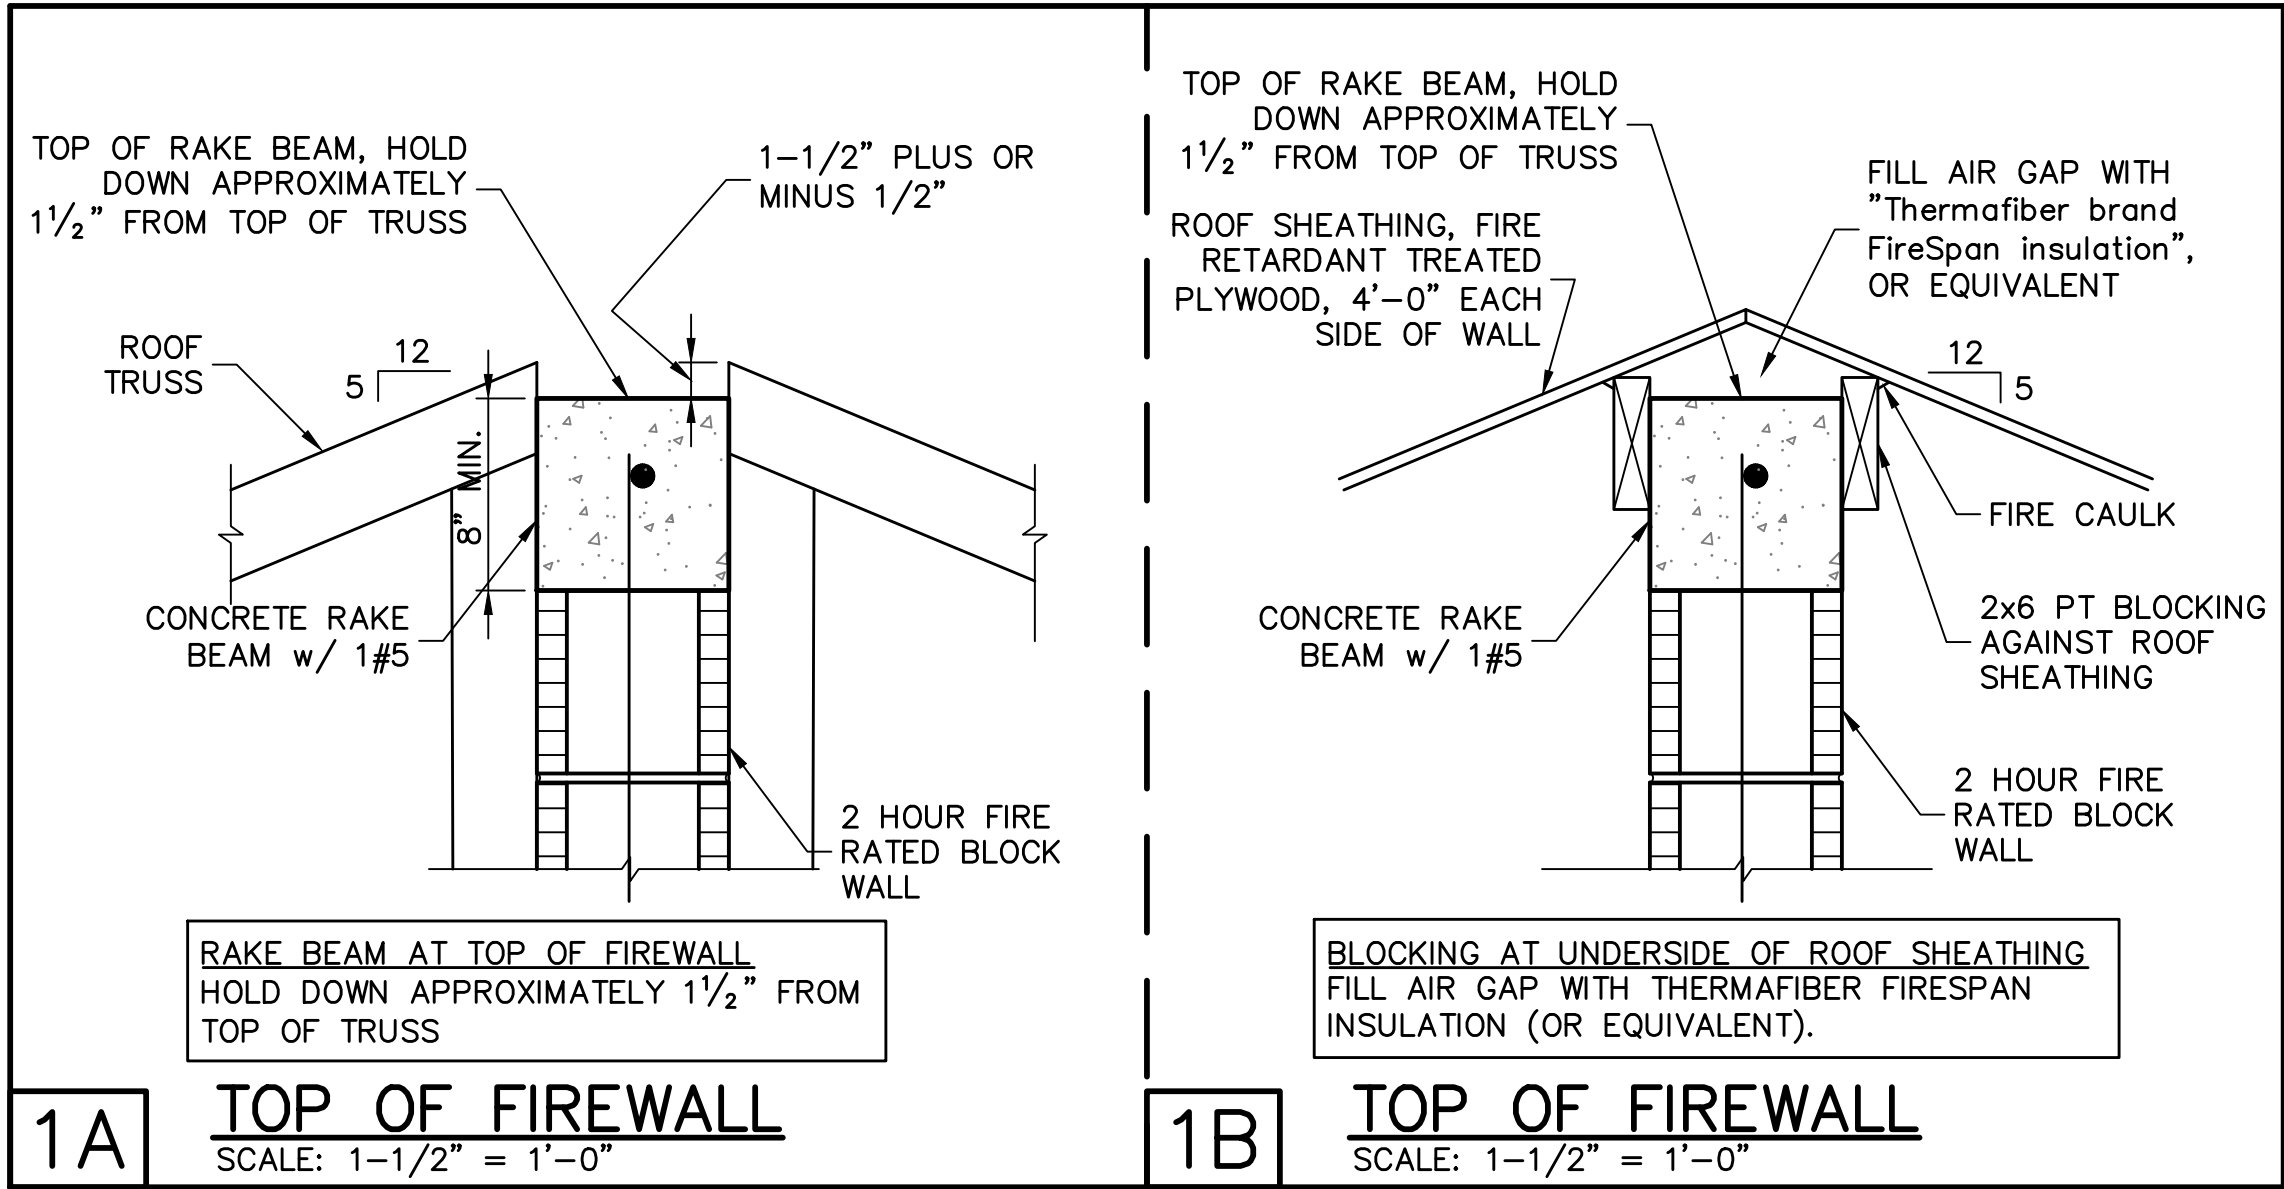

SLOPED TRUSSES

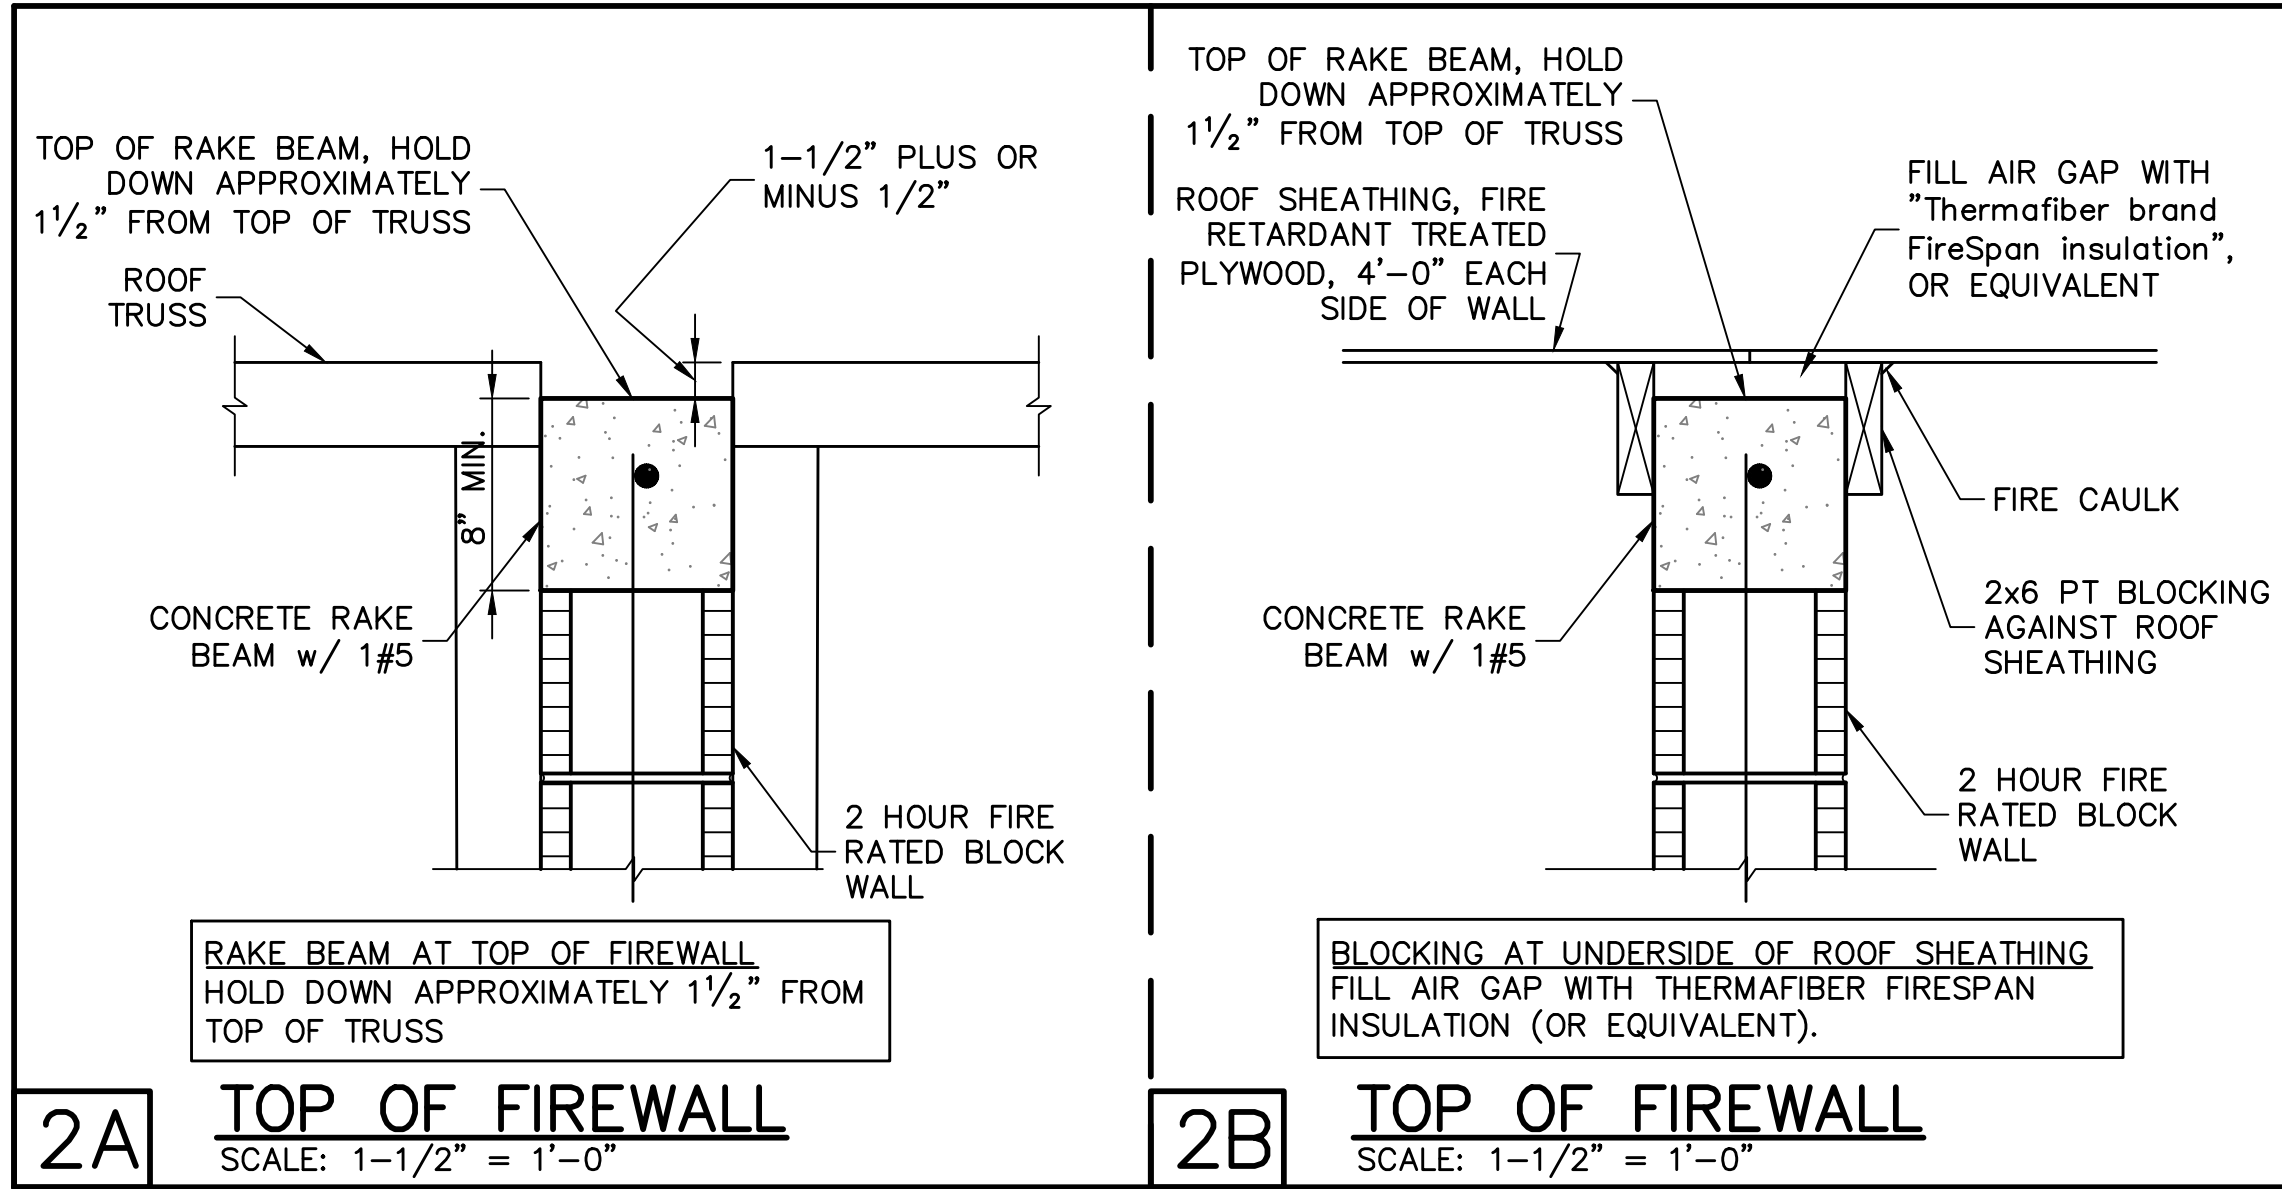

FLAT TRUSSES

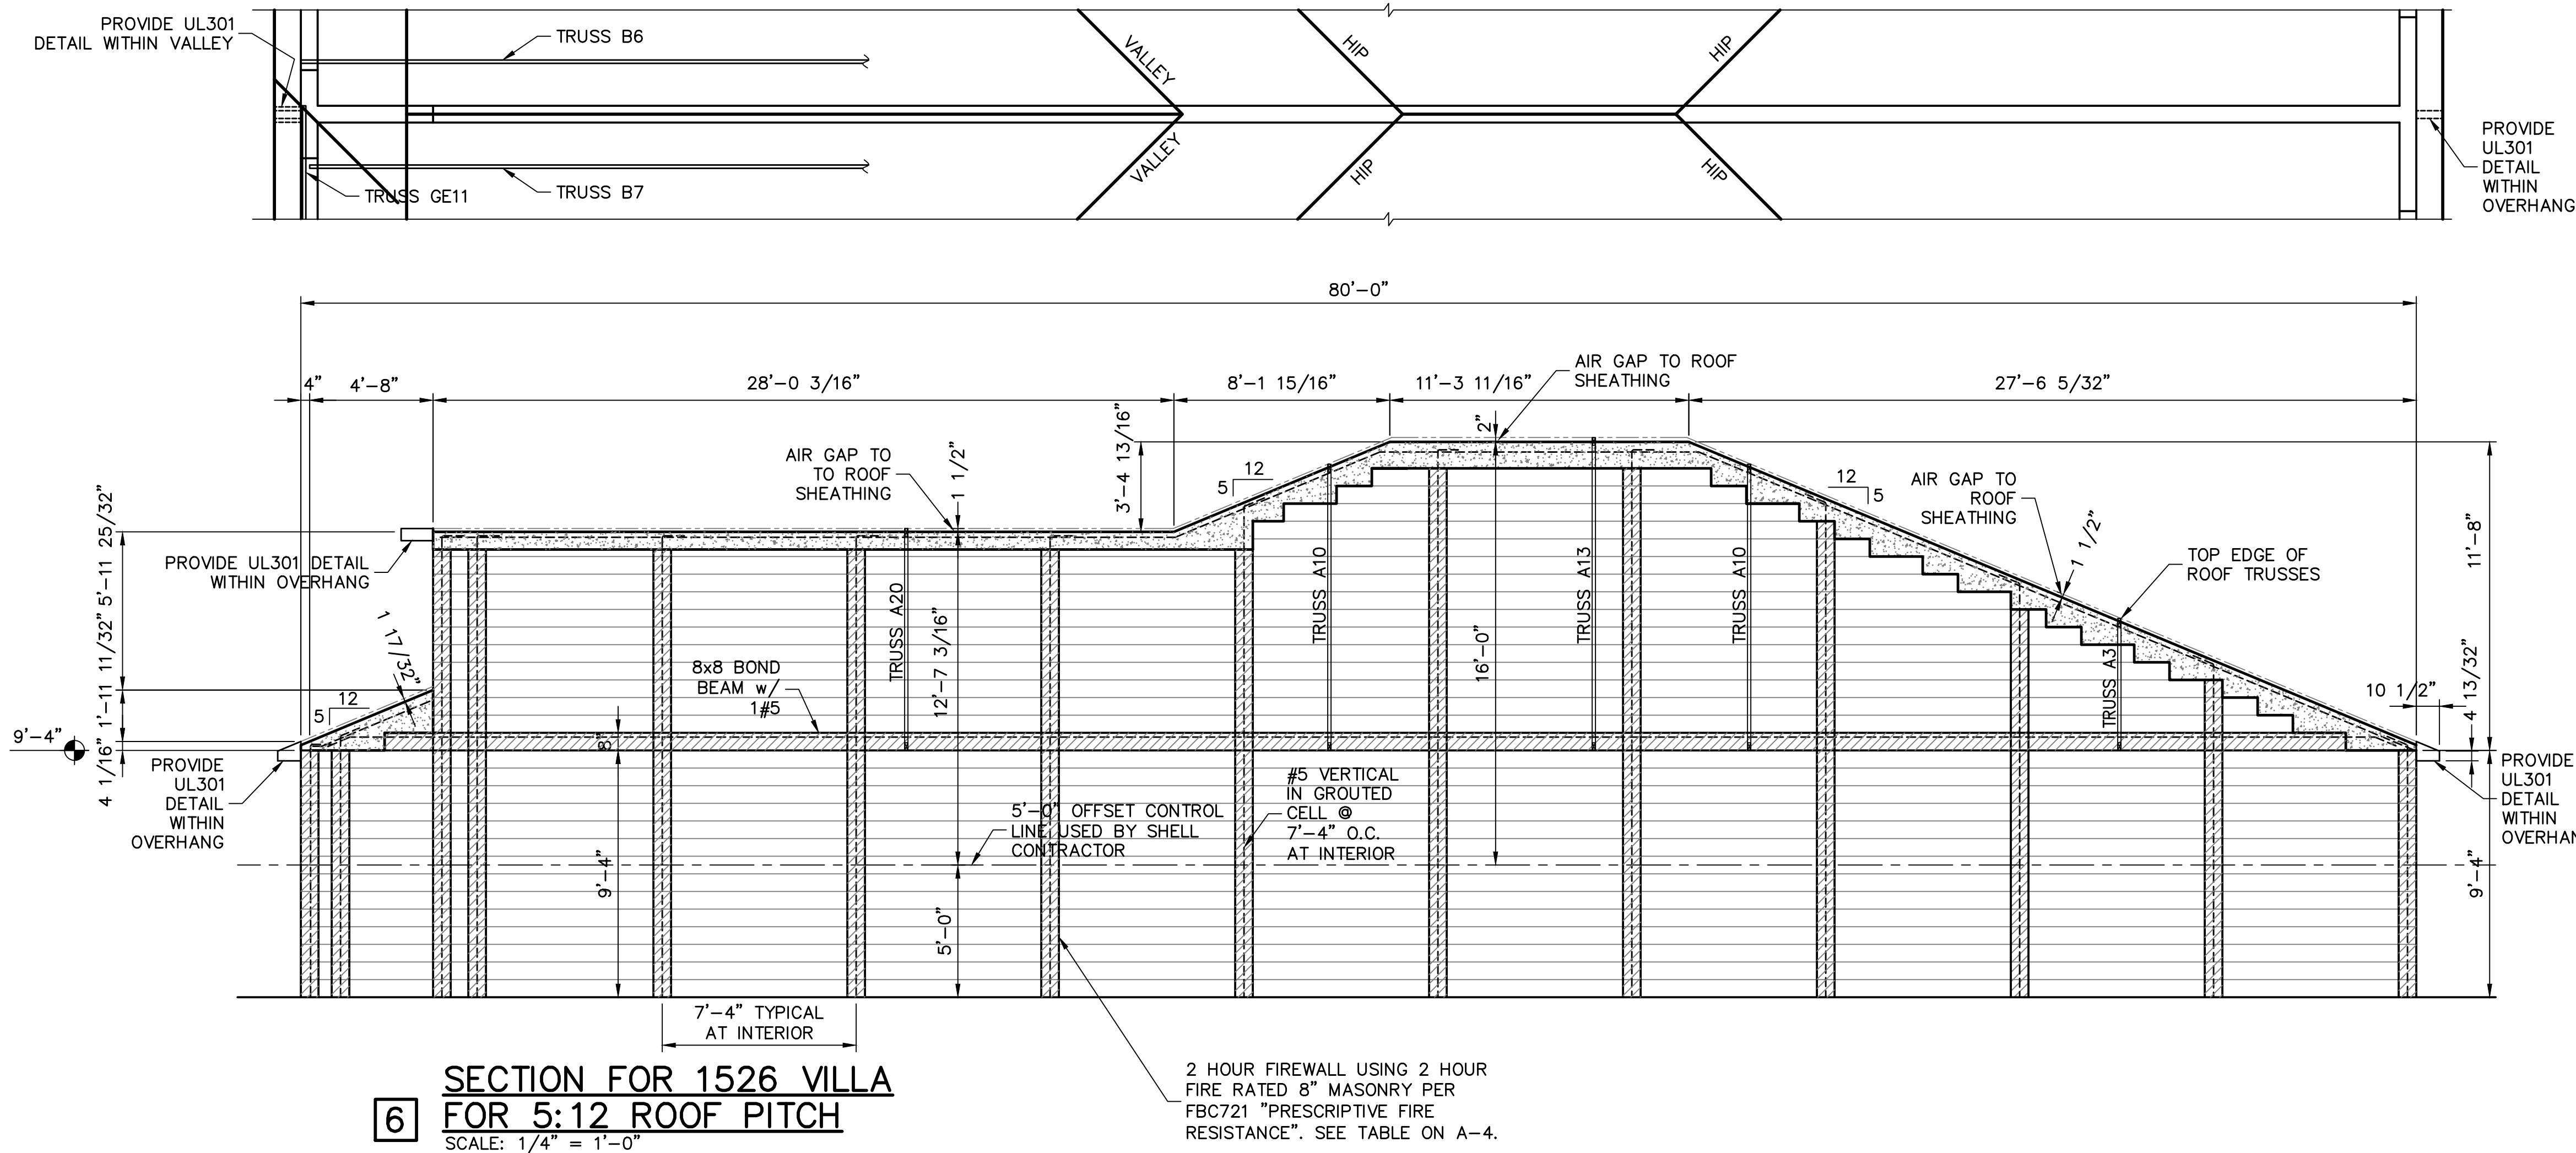

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA # 8629

DESIGNED BY: W. BERGEN
LICENSE NO. 58552
STATE OF FLORIDA
PROFESSIONAL ENGINEER

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL
BUILDER:

D.R. HOHON
America's Builder

STRUCTURAL DETAILS FOR 1526 SIGNATURE VILLA
4221, 4225 BLOOMFIELD STREET
FORT MYERS, FLORIDA
LOT: 609-610 SUBDIVISION: LINDSFORD II TVs

DESIGN/DRAWN DWB/DWB
CHECKED DWB
DATE 07/29/20
SCALE AS NOTED
JOB NO. DR 11738
SHEET

FOR SCOSTA TRUSSES, JOB # 44151GB, DATED 06/18/19, REVISED: 11/27/19

