



# Community Development

18400 Murdock Circle, Port Charlotte, FL 33948

Phone: 941.743.1201 FAX: 941.764.4907

Zoning: 941.743.1964

www.CharlotteCountyFl.gov

"To exceed expectations in the delivery of public services"

For Office Use Only

Permit Number

20

Application Date

CSR Initials

## RESIDENTIAL ONE AND TWO SINGLE FAMILY DWELLING DATA SUMMARY SHEET Florida Building Code Sixth Edition (2017)

OWNER NAME: D.R. Horton, Inc.

PROJECT ADDRESS:

Lot 12/4508 9581 Attica Cir Port Charlotte FL 33981

Number & Street

City,

State,

& Zipcode

**Applicable Codes: Building, Mechanical, Plumbing, Accessibility, & Energy Codes - 6th Edition (2017) Florida Building Code, Residential Volume. Electrical Code - NFPA 70 & NEC 2014**

### Manufacturer's Product Approvals

Doors: see attached

Overhead Doors: see attached

Windows: see attached

Mitered Glass: see attached

Roof Coverings: see attached

### Protection of Openings:

Soffit: see attached

Shutters: see attached

### Method of Design per Florida Building Code (FBC) R301:

Designer's Name: STRUCTURAL SYSTEM OF NORTH FL

☐ Florida Building Code, 6th Ed (2017)

☒ ASCE 7

☐ AISI S230

☐ AF & PA

☐ MAF Guide

☐ ICC 600

☐ TMS/ASCE

☐ Other:

### Design Data:

Basic Wind Speed (Vult) 160 mph (Figure R301.2(4)) Risk Category: ☐ I ☒ II

Nominal Design Wind Speed (Vasd) 124 m.p.h. Flood Design Data N/A Final Floor Elevation see site plan

Exposure Category Section (R301.2.1.4) ☐ B ☒ C ☐ D Soil Design Load-Bearing Value 2000 PSF

### Structural Forces (Section R301.4 / 301.5 / 3601.6)

Floor Design: Live Load 40 p.s.f. Dead Load slab on grade p.s.f.

Roof Design: Live Load 20 p.s.f. Dead Load TC=20 BC=10 p.s.f. Roof Slope 5:12

### Window and Door Wind Pressure Design Loading:

Mean roof height 15 ft

Windows +33.5/-44.8 p.s.f. Doors +33.5/-44.8 p.s.f. Garage Doors +29.4/-44.8 p.s.f.

### Components and Cladding Design Pressures:

Zone 1: 19.2/-30.6 p.s.f. Zone 2: 19.2/-53.2 p.s.f. Zone 3: 19./-78.8 p.s.f. Zone 4: 33.5/-36.3 p.s.f. Zone 5: 33.5/-44.8 p.s.f.


Area Tabulation: TOTAL (Sq. Ft.) 2,973

Living (Sq. Ft.) 2,196 Garage (Sq. Ft.) 446 Lanai (Sq. Ft.) 210

Entry (Sq. Ft.) 121 Storage (Sq. Ft.) Other (Sq. Ft.)

I certify to the best of my knowledge and belief that these plans and specifications have been designed to comply with the structural portion of the Building Code for wind, flood and gravity loads as amended and enforced by the permitting jurisdiction.

Signature: Date:

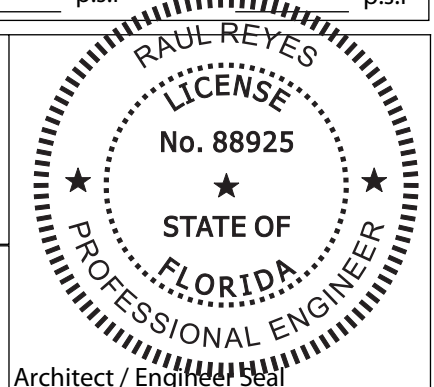

Architect / Engineer Seal

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

<b>JOB No.</b>	<b>MASTER</b>
<b>DATE DRAWN</b>	<b>10/1/2019</b>
<b>DATE PRINTED</b>	<b>2/14/2020</b>

Engineer of Record for the Structure  
Structural Systems of N. Fl, Inc.  
Raul Reyes, PE 88925  
1634 SE 47th Street #3  
Cape Coral, FL 33904

This document has been reviewed for conformance with the design intent of the structure and specified design criteria.

☒ Accepted As-Is      ☐ Accepted As Noted      ☐ Revise and Resubmit

GENERAL TRUSS ENGINEERING CRITERIA & DESIGN LOADS	
DESIGN CODE	FBC2017/TP12014
WIND CODE	MWFRS (Directional)/C-C HYBRID WIND ASCE 7-10
WIND LOAD	160 MPH
EXPOSURE CATEGORY	C
OCCUPANCY CATEGORY	II
IMPORTANCE FACTOR	1.0
WIND DURATION FACTOR	1.60
OPENING CONDITIONS	ENCLOSED
TRUSSES HAVE BEEN DESIGNED FOR A 10.0 PSF BOTTOM CHORD LIVE LOAD NONCONCURRENT WITH ANY OTHER LIVE LOADS	
TRUSS LOADING	ROOF
TCLL	20 PSF
TCDL	20 PSF
BCLL	0 PSF
BCDL	10 PSF
TOTAL	50 PSF
DURATION	1.25
TCDL / TO RESIST UPLIFT	5 PSF
BCDL / TO RESIST UPLIFT	5 PSF

**CAUTION!!**

**DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DRAWINGS AND BSCI-B1 SUMMARY SHEETS.**

**ALL PERMANENT BRACING MUST BE IN PLACE PRIOR TO LOADING TRUSSES. (ie. SHEATHING, SHINGLES, ETC.)**

**ALL INTERIOR BEARING WALLS MUST BE IN PLACE PRIOR TO INSTALLING TRUSSES.**

**REFER TO FINAL ENGINEERING SHEETS FOR THE FOLLOWING.**

- 1) NUMBER OF GIRDER PLIES AND NAILING SCHEDULE.**
- 2) BEARING BLOCK REQUIREMENTS.**
- 3) SCAB DETAILS (IF REQUIRED)**
- 4) UPLIFT AND GRAVITY REACTIONS.**

**WARNING**  
BACK CHARGES WILL NOT BE  
ACCEPTED REGARDLESS OF FAULT  
WITHOUT PRIOR NOTIFICATION BY  
CUSTOMER WITHIN 48 HOURS AND  
INVESTIGATION BY Builders FirstSource.  
NO EXCEPTIONS.

THE GENERAL CONTRACTOR IS RESPONSIBLE FOR ALL CONNECTIONS OTHER THAN TRUSS TO TRUSS, GABLE SHEAR WALL, AND CONNECTIONS. TEMPORARY AND PERMANENT BRACING, AND CEILING AND ROOF DIAPHRAM CONNECTIONS.

ROOF PITCH	5/12
CEILING PITCH	FLAT
TOP CHORD SIZE	2 x 4 MIN.
BOTTOM CHORD SIZE	2 x 4 MIN.
OVERHANG LENGTH	N/A
CANTILEVER	14 1/2"
END CUT	PLUMB
FLOOR TRUSS SPACING	N/A
ROOF TRUSS SPACING	24"


BUILDER	DR Horton
PROJECT	2197 A 160 C LH
MODEL	2197
ADDRESS	--
CITY, STATE	--, FL.
LOT	--
COUNTY	--
DRAWN BY	D.W.
ENG. BY	D.W.

REVISIONS			
No.	DATE	NOTES	BY

**IMPORTANT**  
 This Drawing Must Be Approved And Returned  
 Before Fabrication Will Begin. For Your Protection  
 Check All Dimensions And Conditions Prior To  
 Approval Of Plan.  
**SIGNATURE BELOW INDICATES ALL NOTES  
 AND DIMENSIONS HAVE BEEN ACCEPTED.**

By \_\_\_\_\_ Date \_\_\_\_\_

6850 Taylor Road Punta Gorda, Fl. 33950  
Phone: 941-575-2250 / Fax:941-575-0319

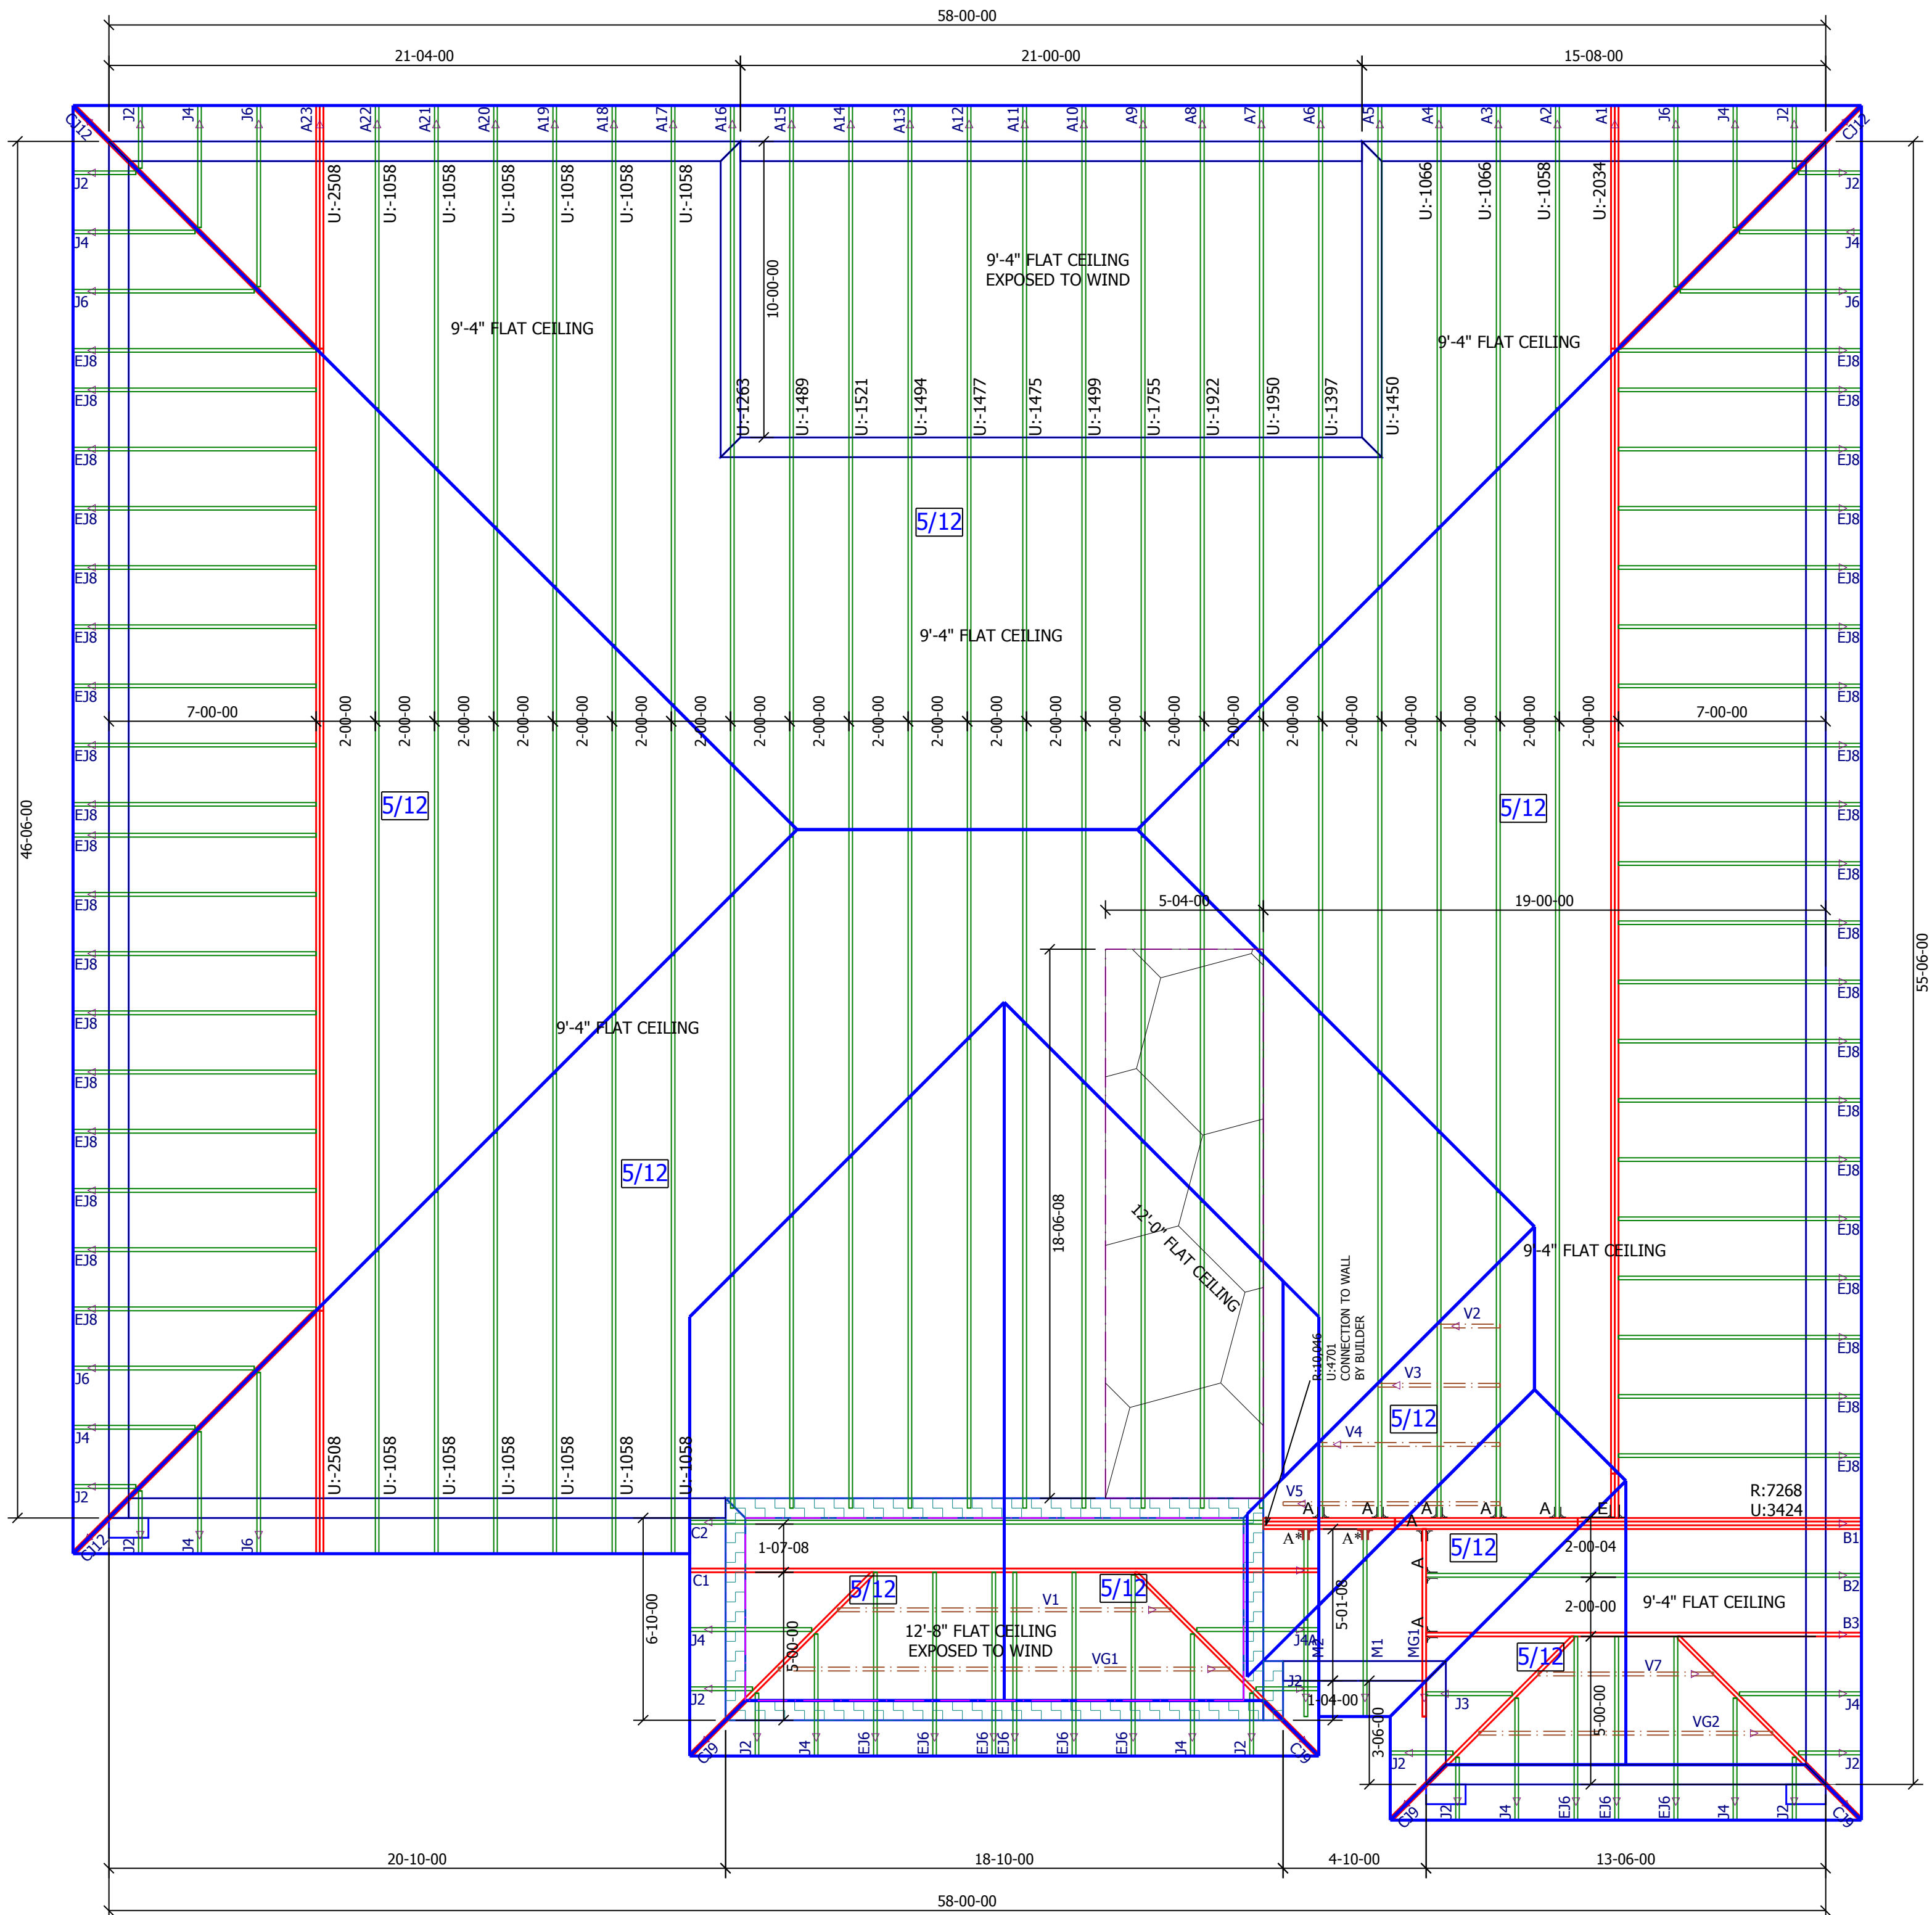

SIMPSON ROOF AND FLOOR TRUSS HANGER SCHEDULE							
ID	QTY/RF	QTY/FL	MODEL	FLOOR	ROOF	UPLIFT	SYMBOL
A*	2	0	LUS24	725	895	490	
A	8	0	HTU26	2940	3200 / 3600	1250 / 1555	
B	0	0	HTU28	3820	3895 / 4680	1235 / 2140	
C	0	0	HTU26-2	2940	3600	1515 / 2175	
D	0	0	HTU28-2	3820	4310 / 4680	1530 / 3485	
E	1	0	HGUS26-2	4355	5320	2155	
F	0	0	HGUS28-2	7460	7460	3235	
G	0	0	HGUS26-3	4355	5230	2155	
H	0	0	HGUS28-3	7460	7460	3235	
I	0	0	HGUS210-4	9100	9100	4095	
J	0	0	SUL26	865	1055	765	
K	0	0	SUR26	865	1055	765	
L	0	0	SUL210	1440	1760	1250	
M	0	0	SUR210	1440	1760	1250	
N	0	0	THJA26	2680	3265	960	
O	0	0	HCJ26	2385	2980	1840	
P	N/A	0	HHUS46	2790	3410	1550	
Q	N/A	0	THA422	2245	2245	1855	
R	N/A	0	THA4222	2245	2245	1855	
S	N/A	0	THA426	2435	2435	1855	

NOTE: UPLIFT VALUE FOR THA422, THA4222, THA426 HANGERS APPLY ONLY TO FACE MOUNT INSTALLATION

(1) PLY	(2) PLY	(3) PLY	CORNER HIP	CORNER HIP	(1) PLY FLR. TRUSS	(1) PLY FLR. TRUSS
LUS24	HTU26, HTU28	HTU26-2, HTU28-2	HGUS24, HGUS26, HGUS28, HGUS24-3, HGUS26-3, HGUS28-3	THJA26	HCJ26	HHUS46
						THA422, THA4222, THA426, THA422-2




NOTES:


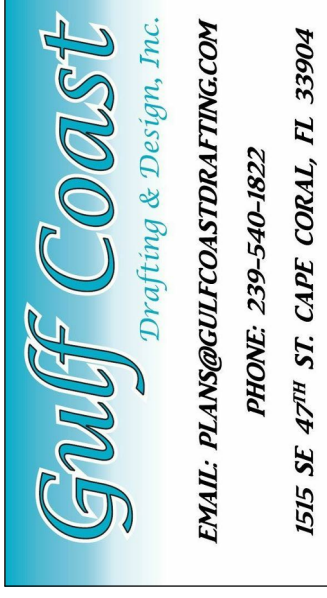
- 1) ALL DIMENSIONS ARE FEET-INCHES-SIXTEENTHS.
- 2) DO NOT CUT OR ALTER TRUSSES IN ANY WAY.
- 3) ALL REACTIONS ARE UNDER 5000 LBS. UNLESS NOTE OTHERWISE.
- 4) ALL UPLIFTS ARE UNDER 1000 LBS. UNLESS NOTED OTHERWISE.
- 5) FRAMING REQUIRED BELOW TRUSSES TO GET DESIRED CEILING CONDITIONS.
- 6) ONLY TRUSS TO TRUSS CONNECTIONS SUPPLIED W/ TRUSS PACKAGE.





L:\O-New Data\1 - MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773 LOT 12 BLK 4508 2197 ALREV\11773 2197 AL.rvt

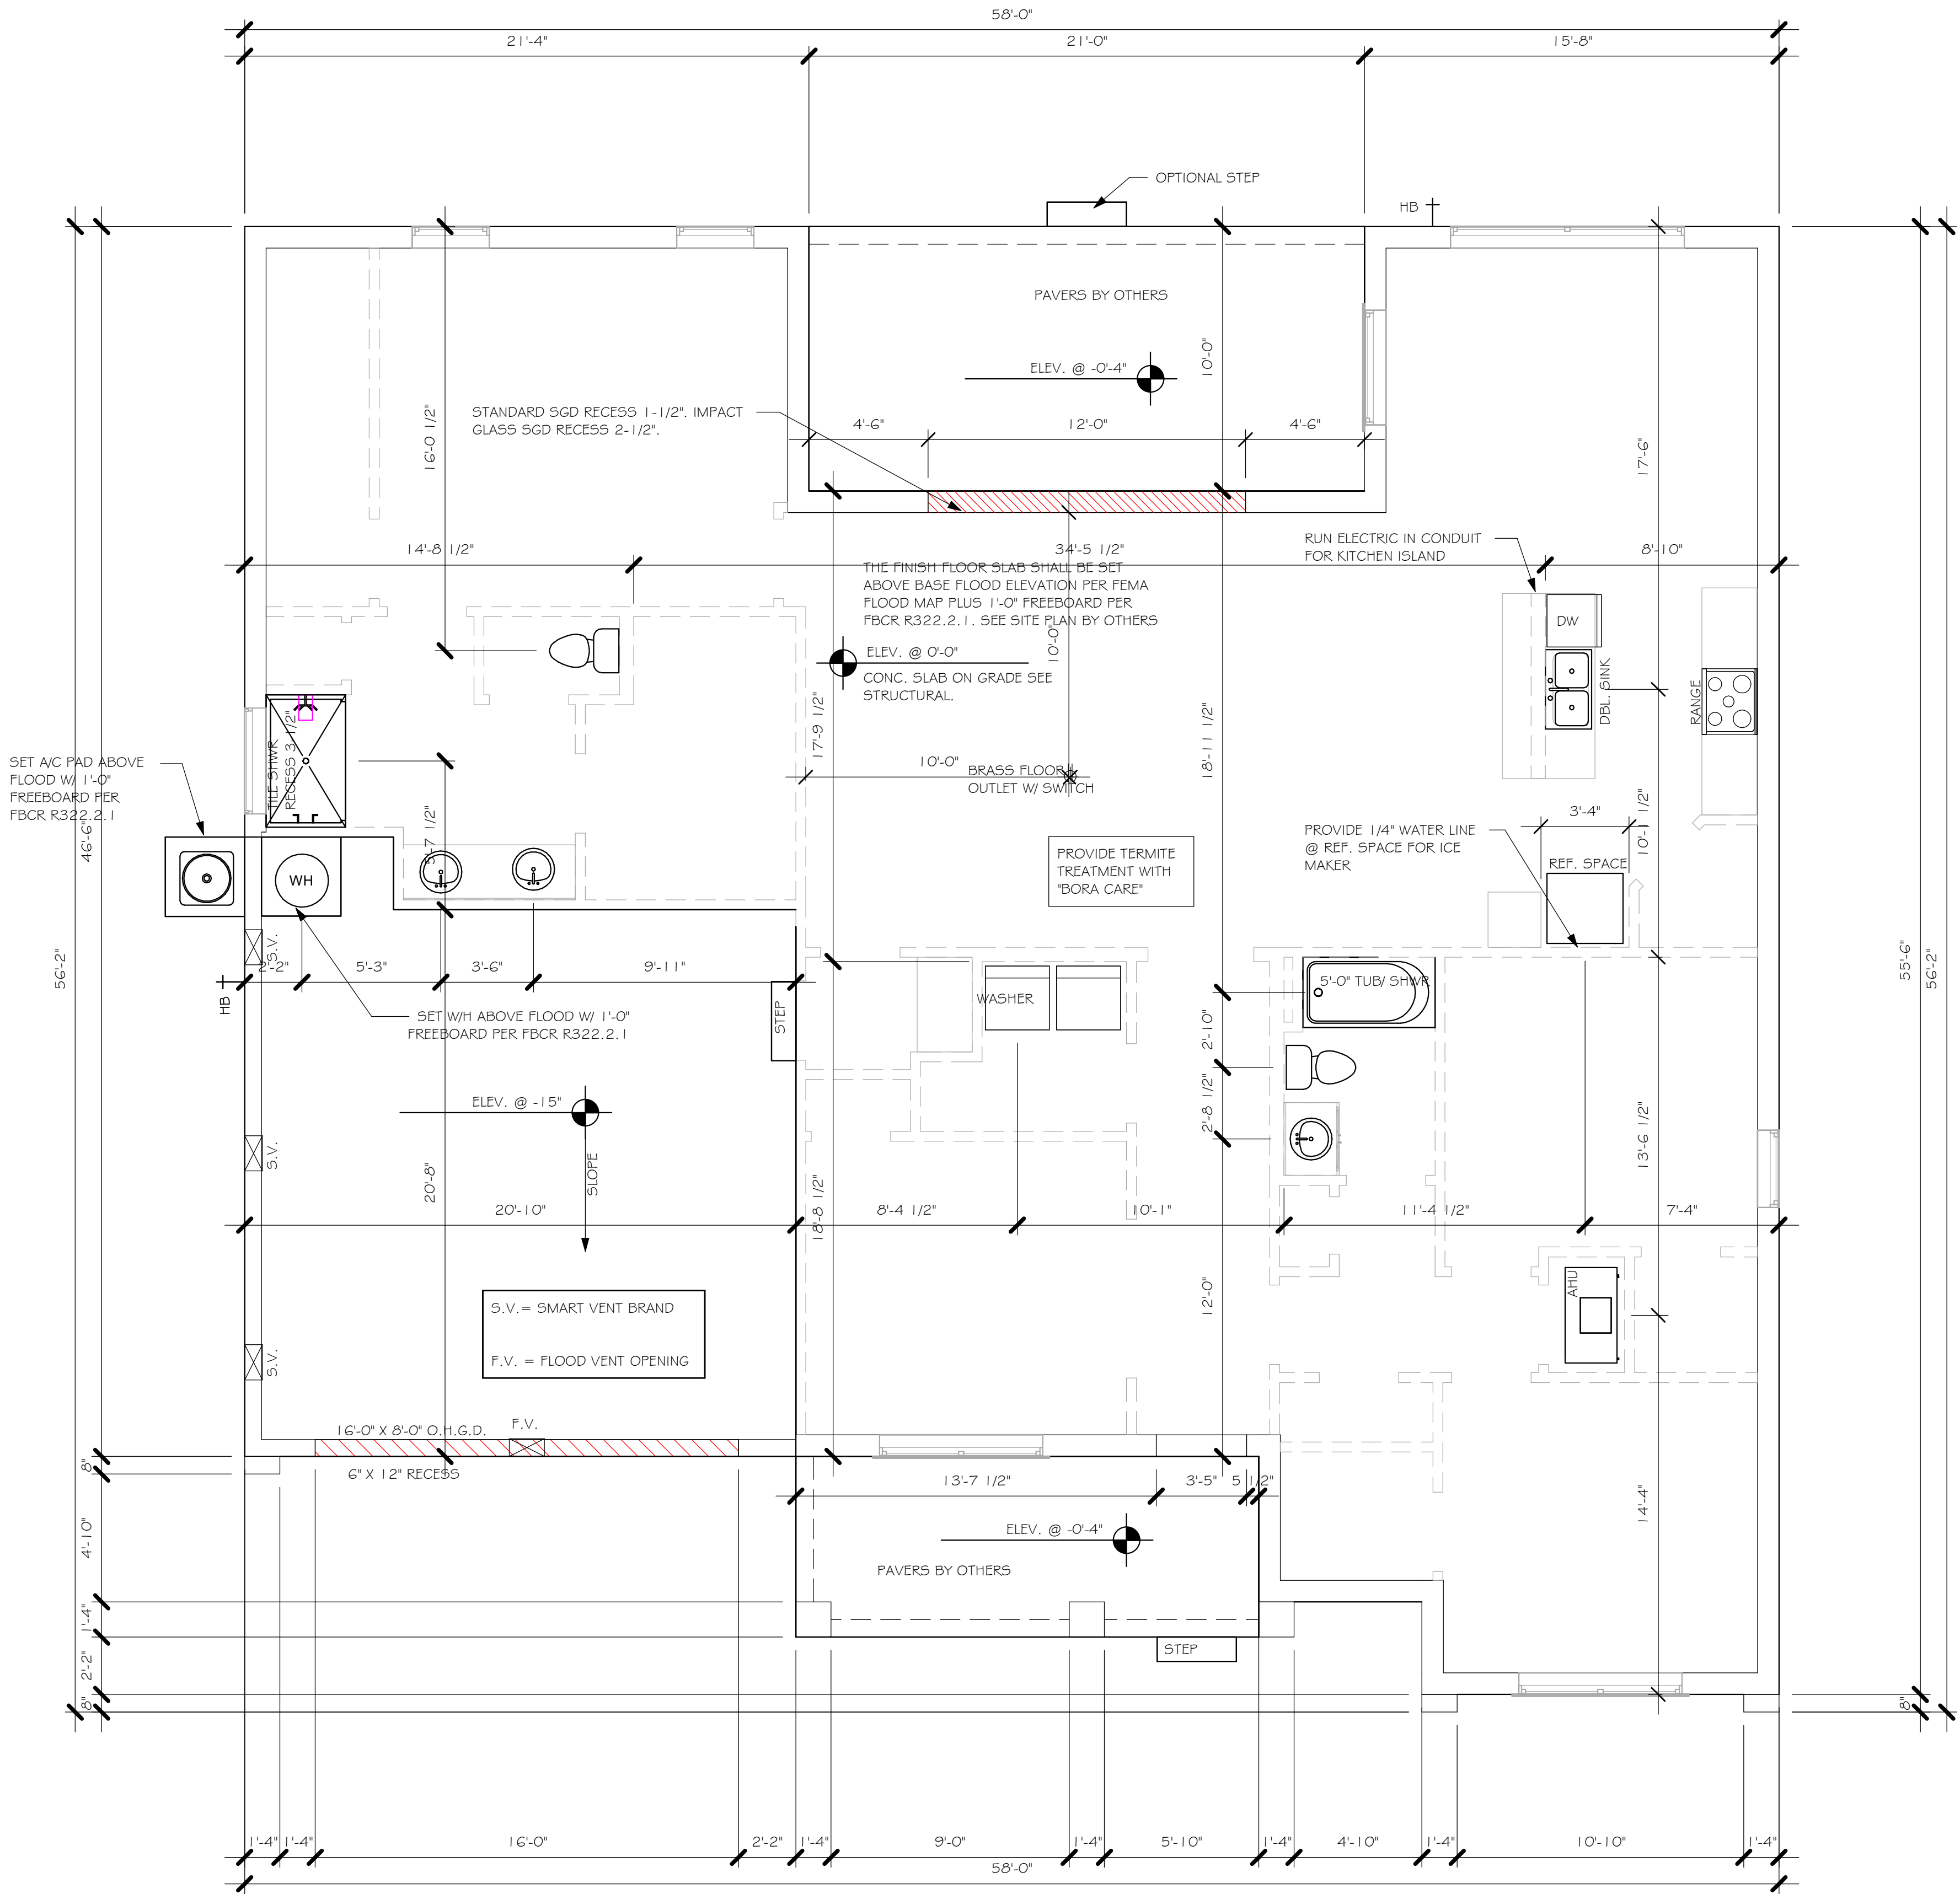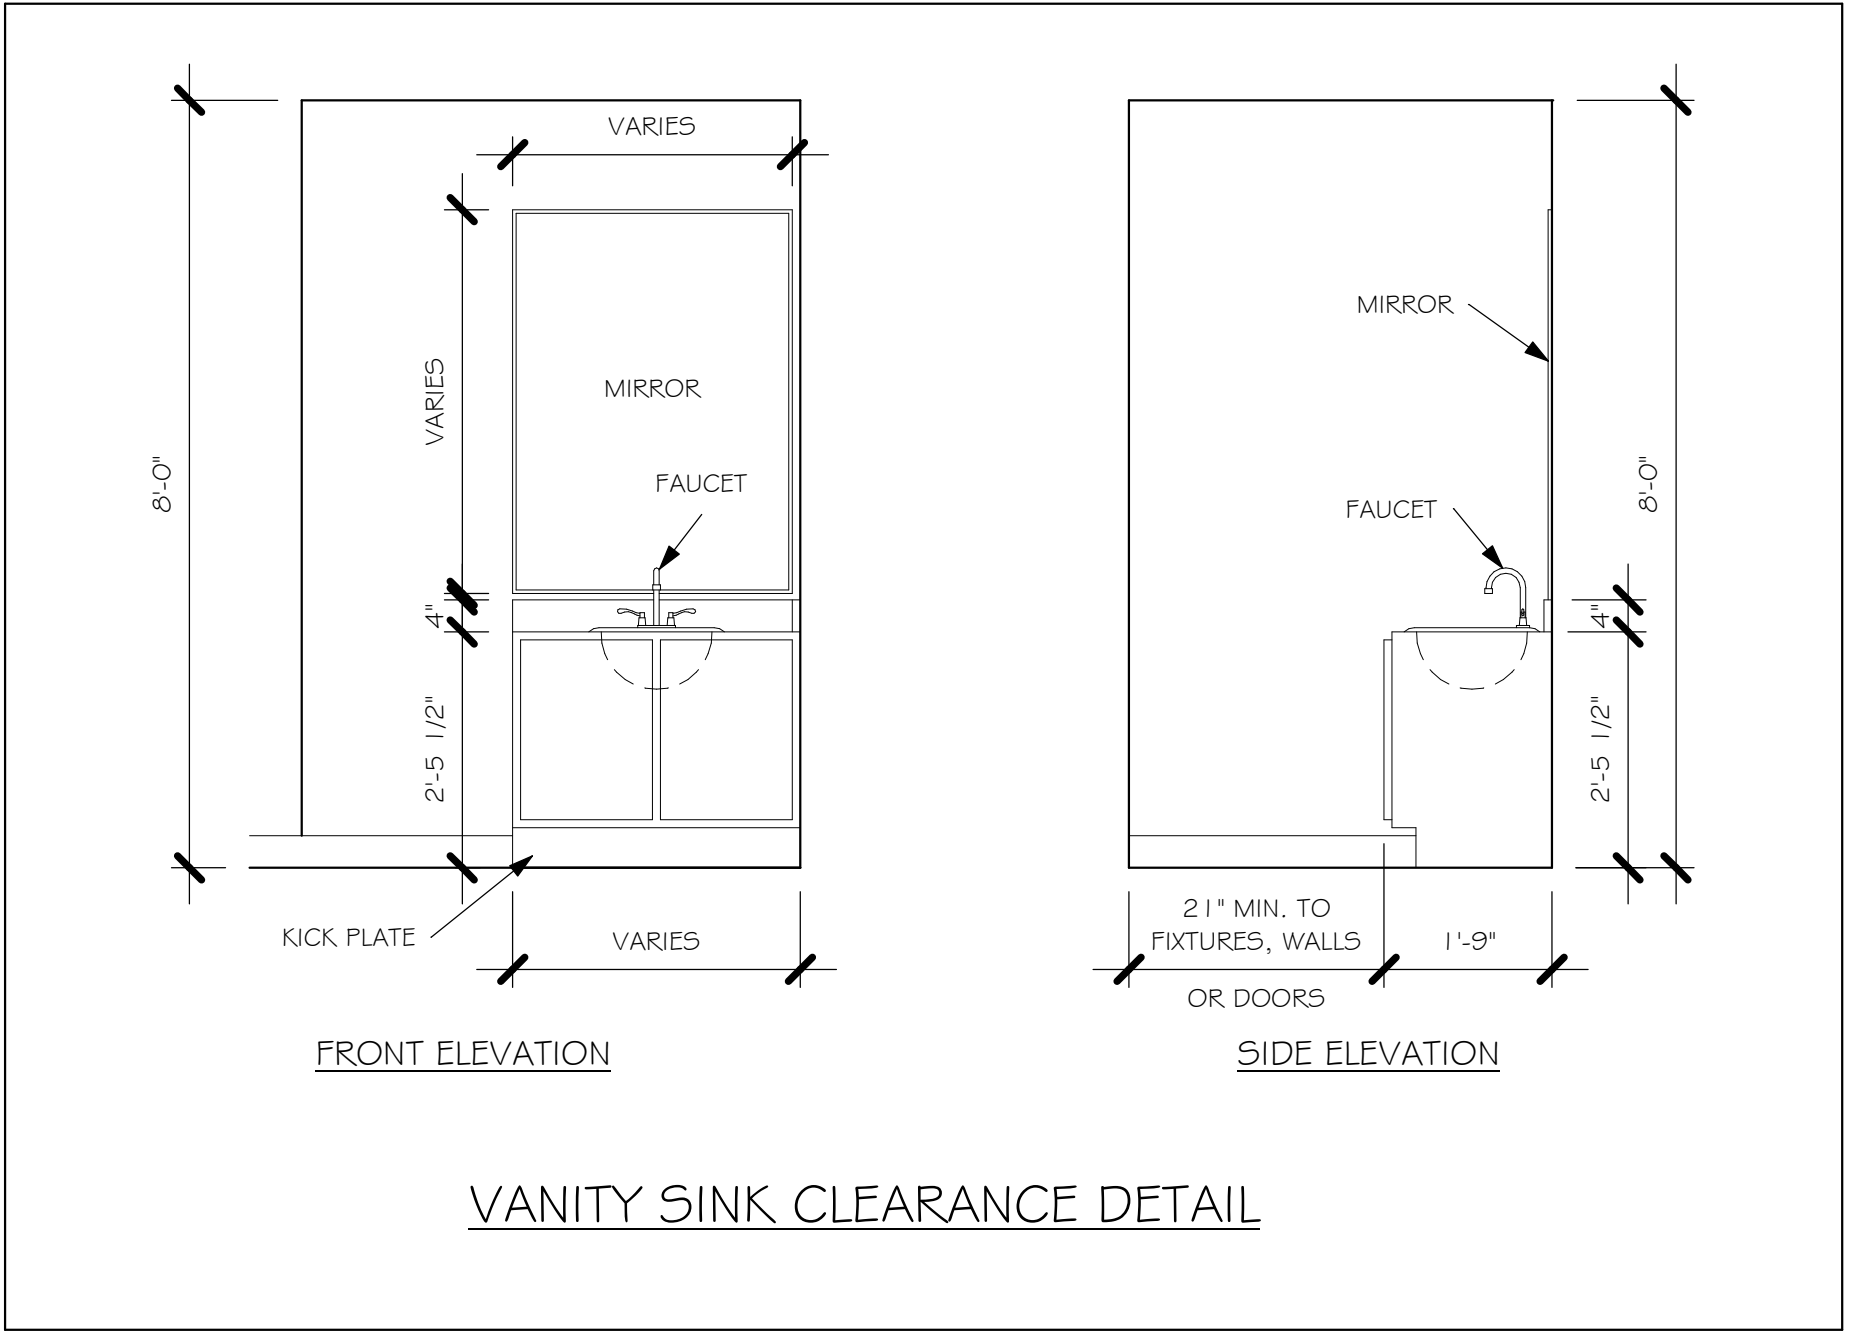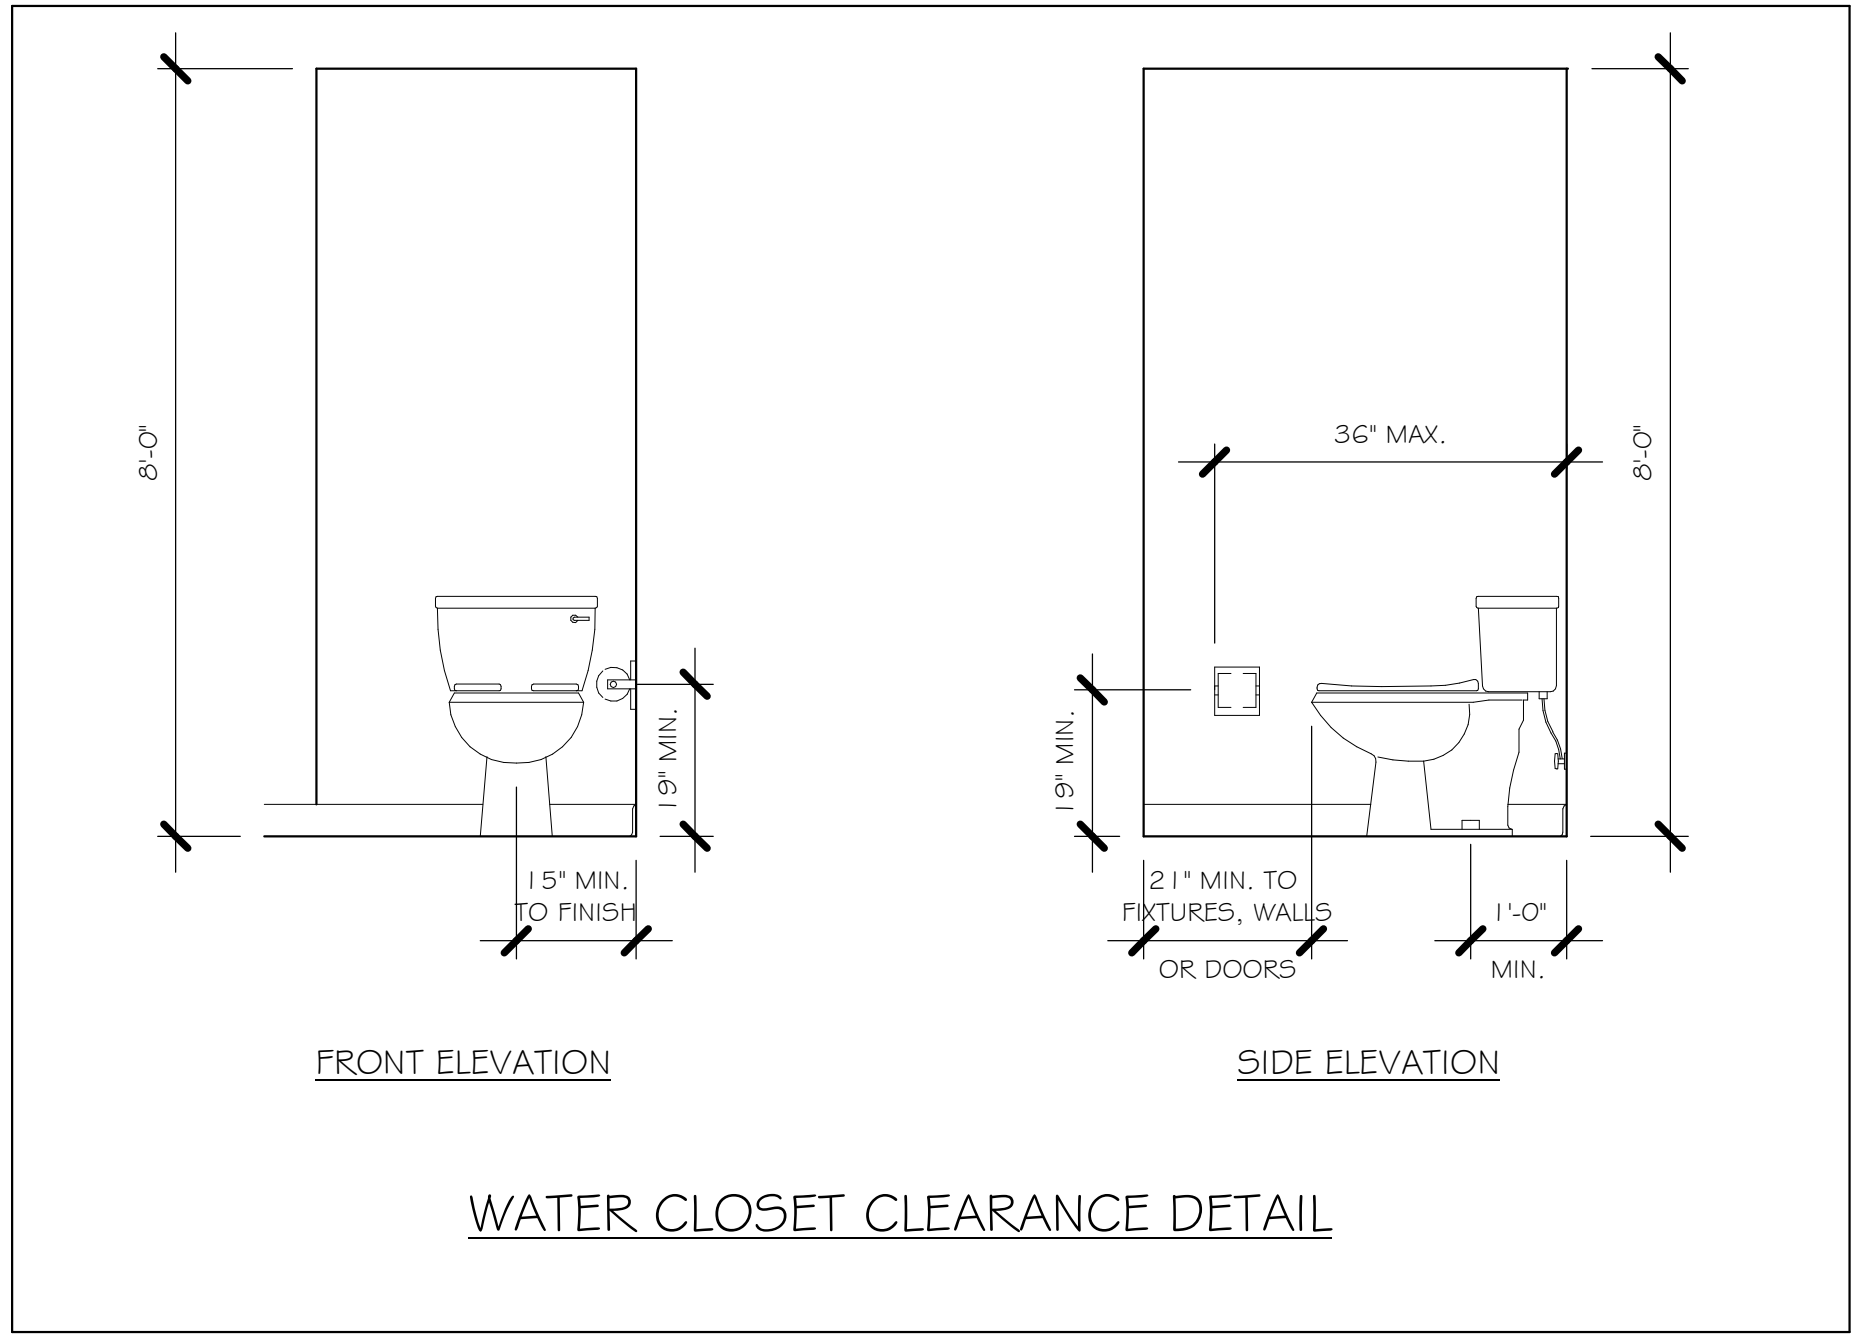

 <b>D.R. HORTON</b> <i>America's Builder</i>	
 <b>Gulf Coast</b> Drafting & Design, Inc. EMAIL: PLANS@GULFCOASTDRAFTING.COM PHONE: 239-540-1822 1515 SE 47th ST. CAPE CORAL, FL 33904	
BLOCK: 4508	
SUBDIVISION: SOUTH GULF COVE	
ADDRESS: 9581 ATTICA CIRCLE	
D.R.H. #: 579660040	
MODEL 2197	
GCD JOB # 11773	
DATE: 09/22/20	
DRAWN BY: JSL	
CHECKED BY: JWC	
REVISED:	
PLAN: SLAB & PLUMBING PLAN	
SCALE: As indicated	
A-2 AL	



L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773 LOT 12 BLK 4508 2197 ALREVIT\1773 2197 AL.rvt

DOOR SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	WIDTH	HEIGHT	COMMENTS	QTY
1	16080 OHGD		16'-0"	8'-0"		1
2	3080 ENTRY		3'-0"	8'-0"		1
3	(3)-4080 5L. GL. DR.		12'-0"	8'-0"		1

WINDOW SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	COMMENTS	QTY
A	2-25 SH		5'-1"	6'-2"		1
B	2-26 SH		6'-2"	6'-2"		1
C	48" X 16"	FIXED GLASS	1'-4"	4'-0"		1
D	25 SH		5'-1"	2'-11"		3
E	2-35 SH		5'-1"	8'-10"		1
F	35 SH		5'-1"	4'-4"		1

OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT


SQUARE FOOTAGE		
GARAGE AREA		Not Enclosed
TOTAL AREA		Not Enclosed
LANAI AREA		Redundant Area
ENTRY AREA		Redundant Area
LIVING AREA		-2196 SF

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-10"	B.F. = BI-FOLD DOOR
3	2'-8"	B.P. = BI-PASS DOOR
4	2'-6"	L.V. = LOUVERED DOOR
5	2'-4"	
6	2'-0"	
7	1'-8"	
8	1'-6"	

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

- PLAN NOTES**
- VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
  - PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
  - PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
  - NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS, SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
  - PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
  - KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
  - INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
  - WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
  - THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE # ATTIC BY NOT LESS THEN 1 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSUM BOARD OR EQUIVALENT
  - INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.
  - ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
  - ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
  - ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

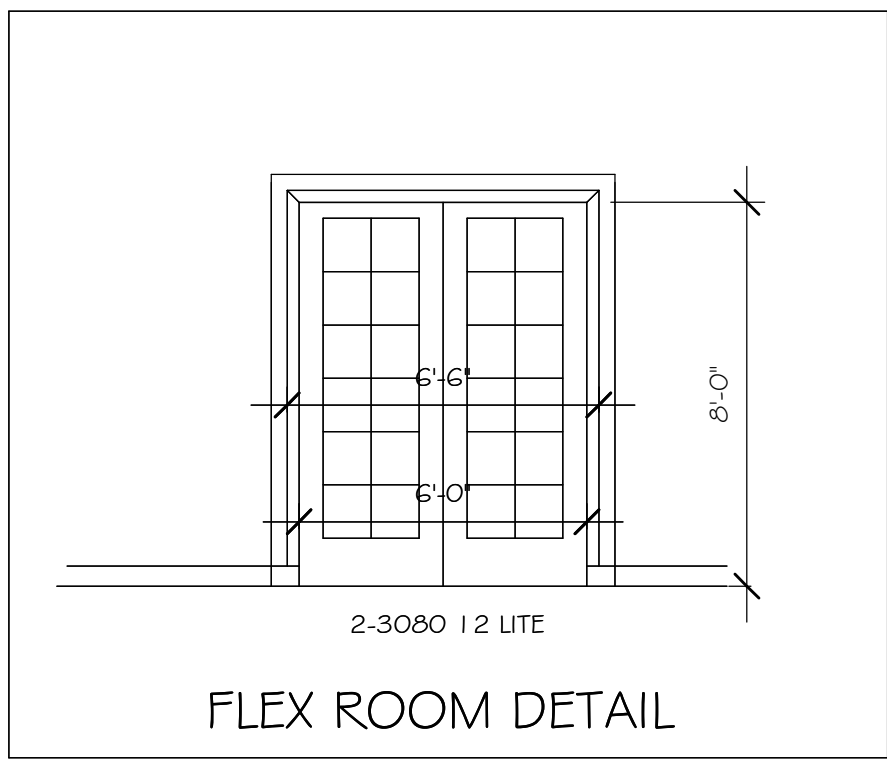


BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F.
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS


TOP OF WALL (MAIN)  
ELEV. @ 9'-4"

FINISH FLOOR  
ELEV. @ 0"

LANAI ELEVATION  
1/2" = 1'-0"

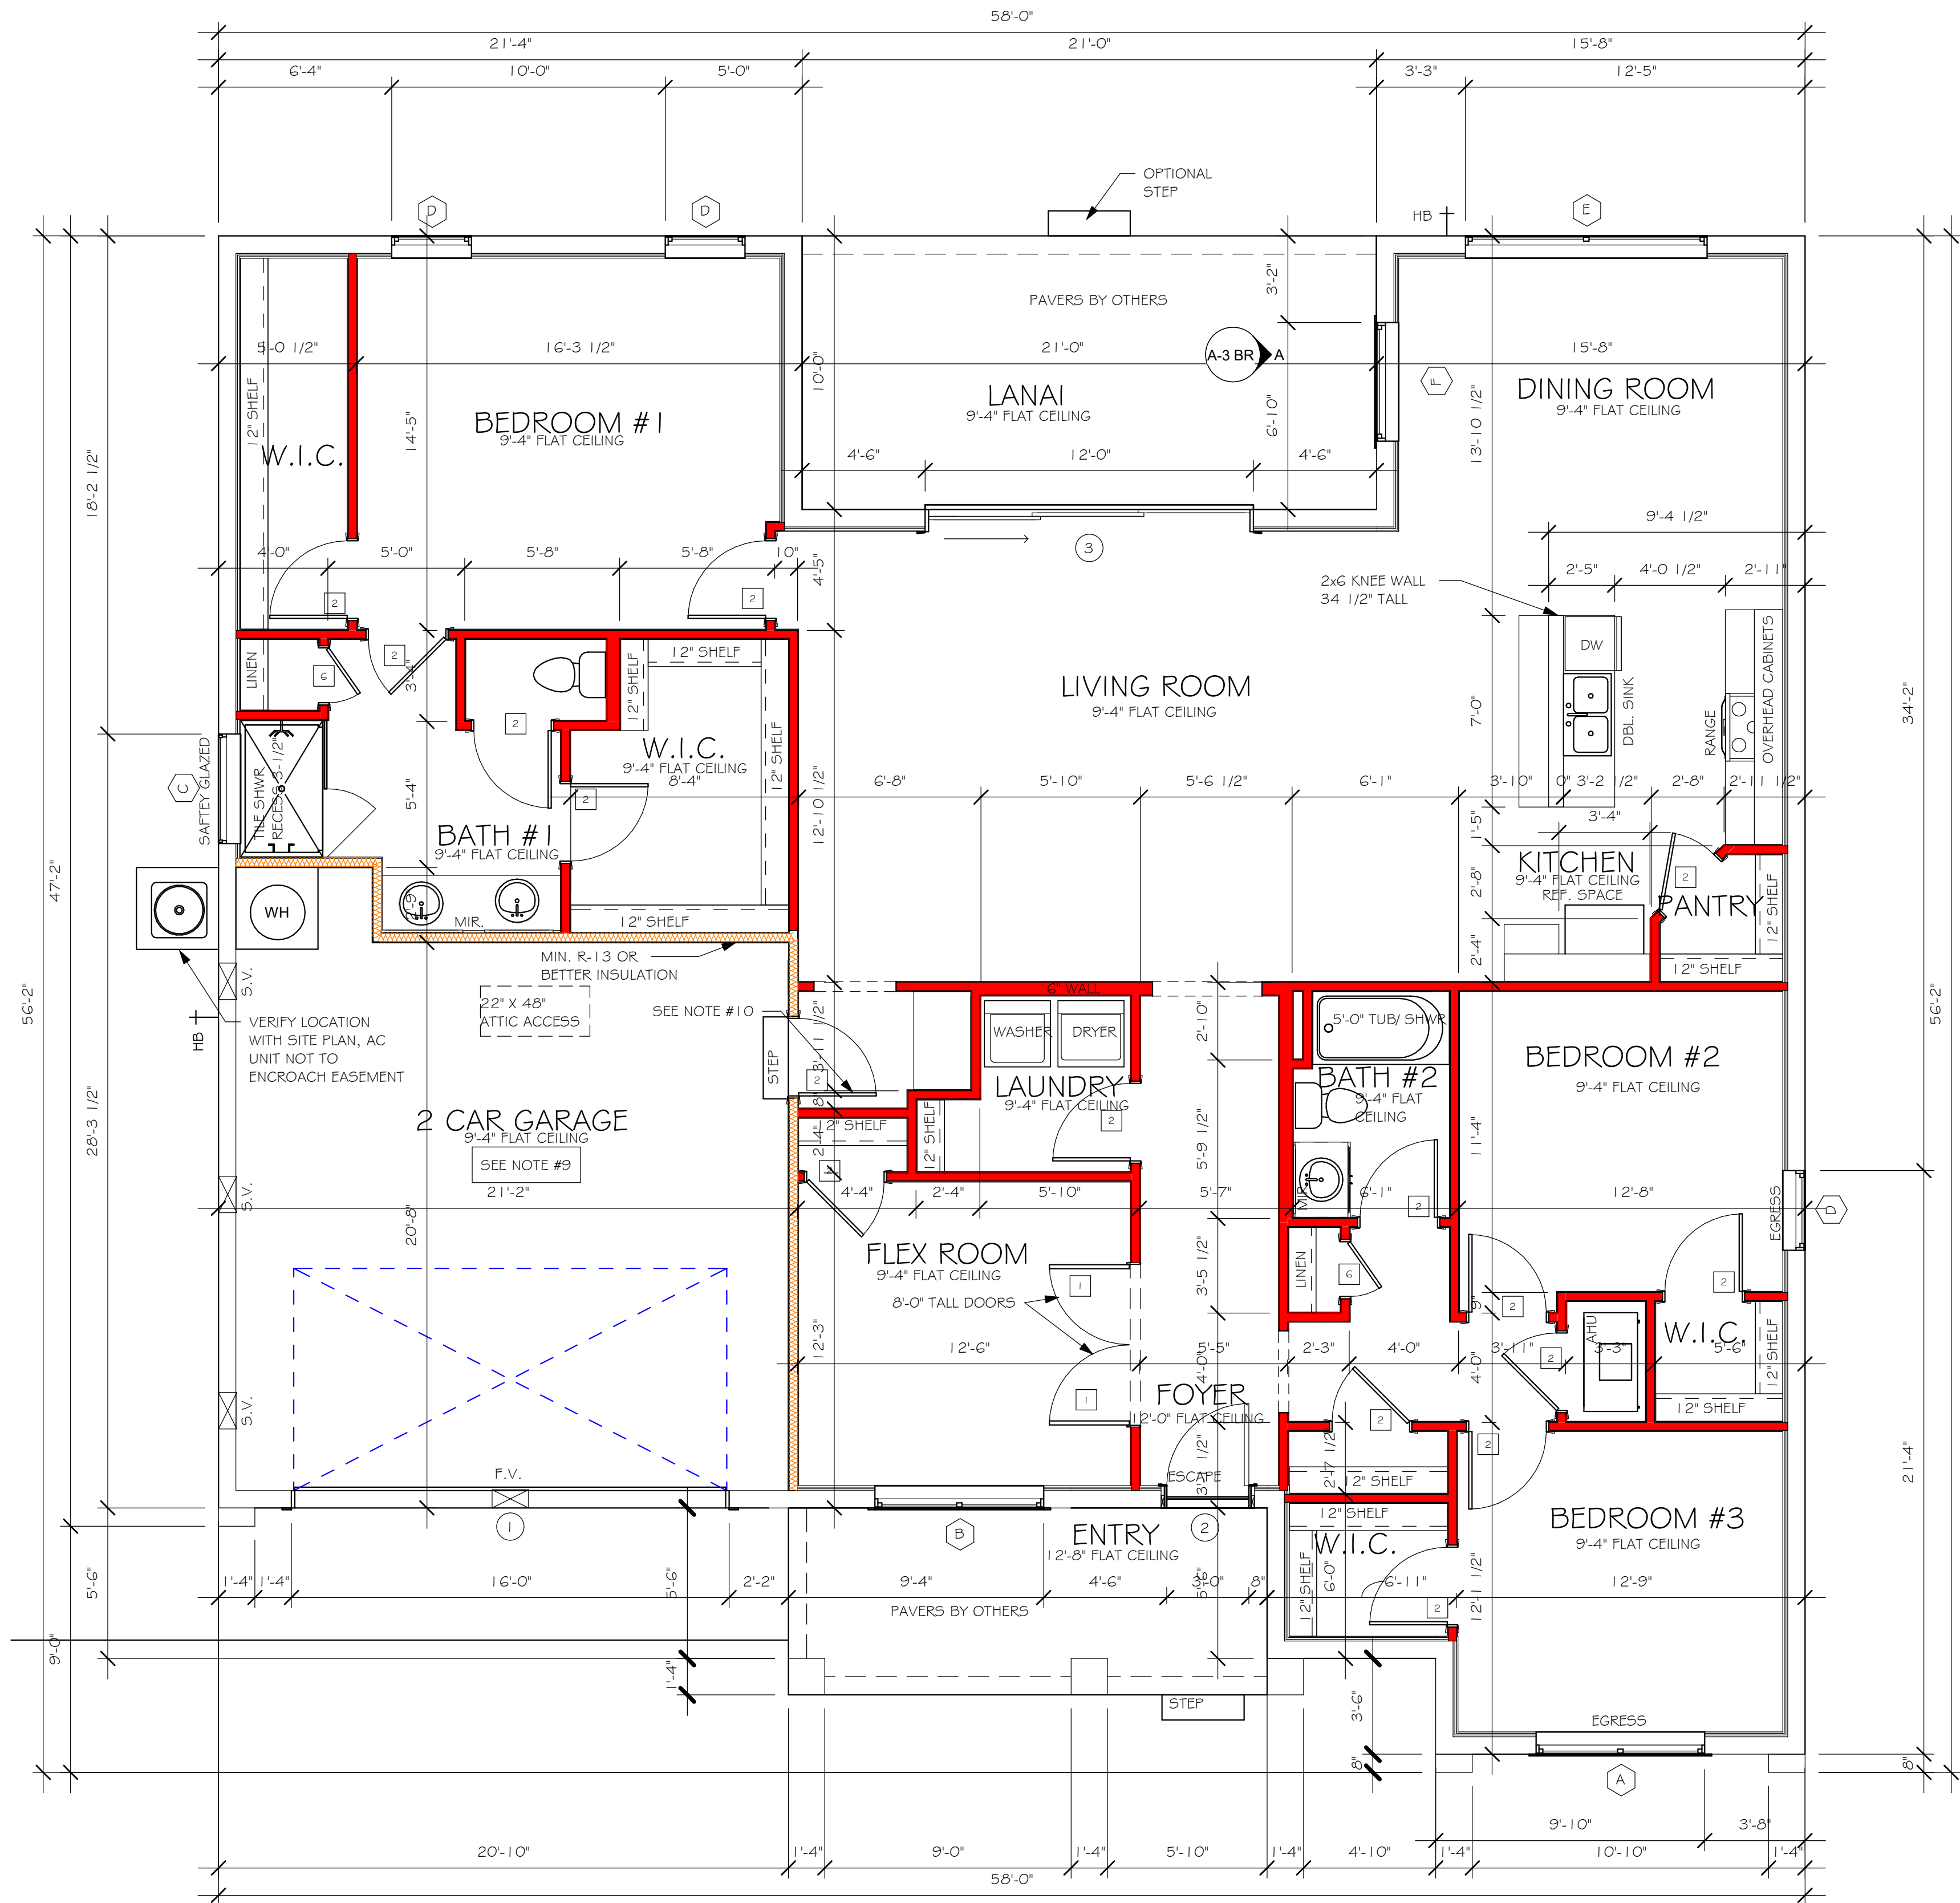

FLOOR PLAN "A"  
1/4" = 1'-0"

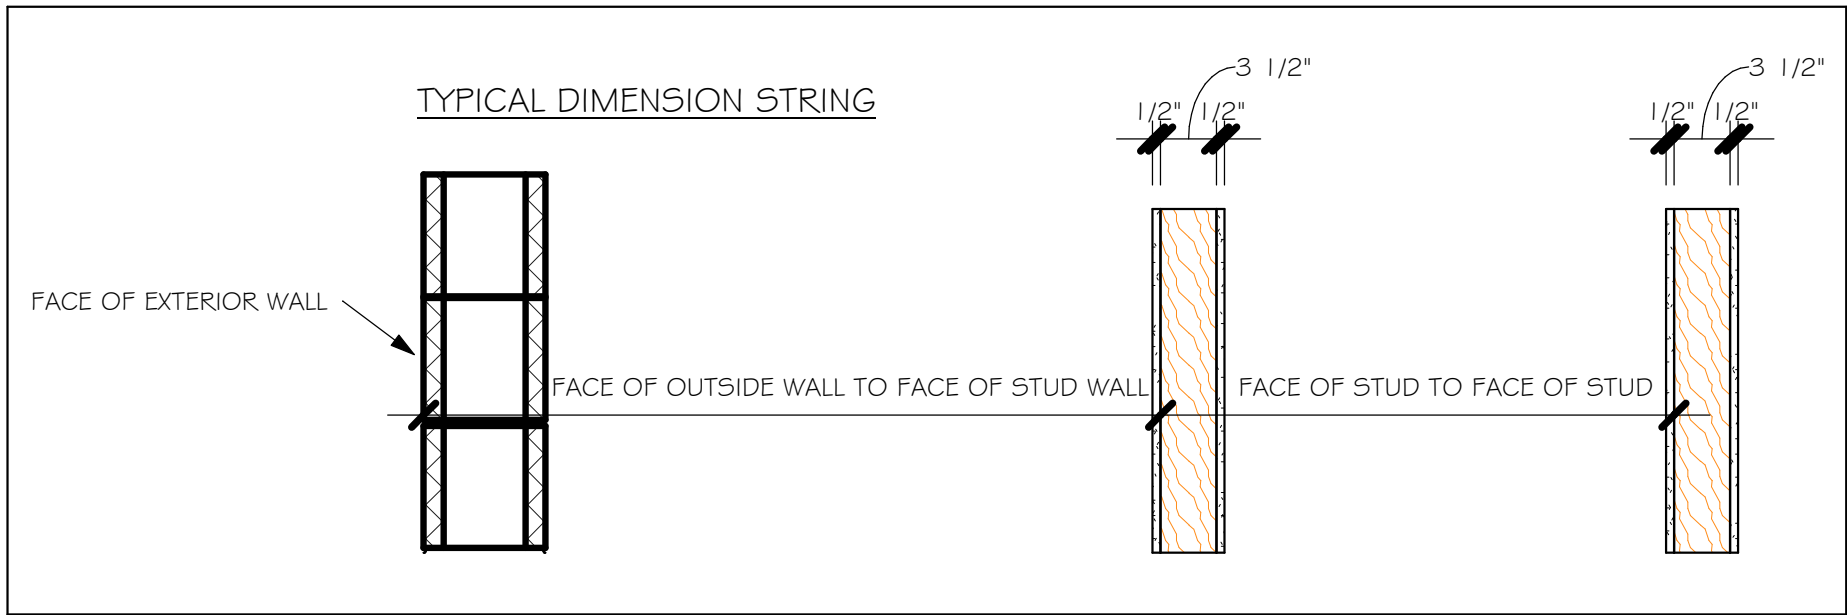

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION

**D-R HORTON**  
America's Builder

**Gulf Coast**  
Drafting & Design, Inc.

EMAIL: [PLANS@GULFCOASTDRAFTING.COM](mailto:PLANS@GULFCOASTDRAFTING.COM)  
PHONE: 239-540-8822  
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 12  
SUBDIVISION: SOUTH GULF COVE  
ADDRESS: 9581 ATTICA CIRCLE  
D.R.H. #: 579660040

MODEL  
2197

DATE: 09/22/20  
DRAWN BY: JSL  
CHECKED BY: JWC  
REVISED:  
PLAN: FLOOR  
SCALE: As indicated


A-3 AL



L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773 LOT 12 BLK 4508 2197 AL\REV\11773 2197 AL.rvt


MODEL 2197 A: ATTIC VENTILATION FBCR R806										
COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS										
AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)				
ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED				
MARK	ATTIC	SOFFIT	ATTIC AREA(150)	REQD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA(300)	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT		
1st STORY	3267.1 SQ. FT.	313.3 SQ. FT.	21.9 SQ. FT.	6.99%	8.15%	---	SQ. FT.	---	---	%
			"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED				
			SOFFIT MODEL			ROOF VENT MODEL				
			ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW			32" BASE 22-3/8" BASE LOMANCO 770-D 0.97 SQ. FT. FREE AIR				

WALL HEIGHT	
	= MAIN WALL @ 9'-4"
	= ENTRY WALL @ 12'-8"

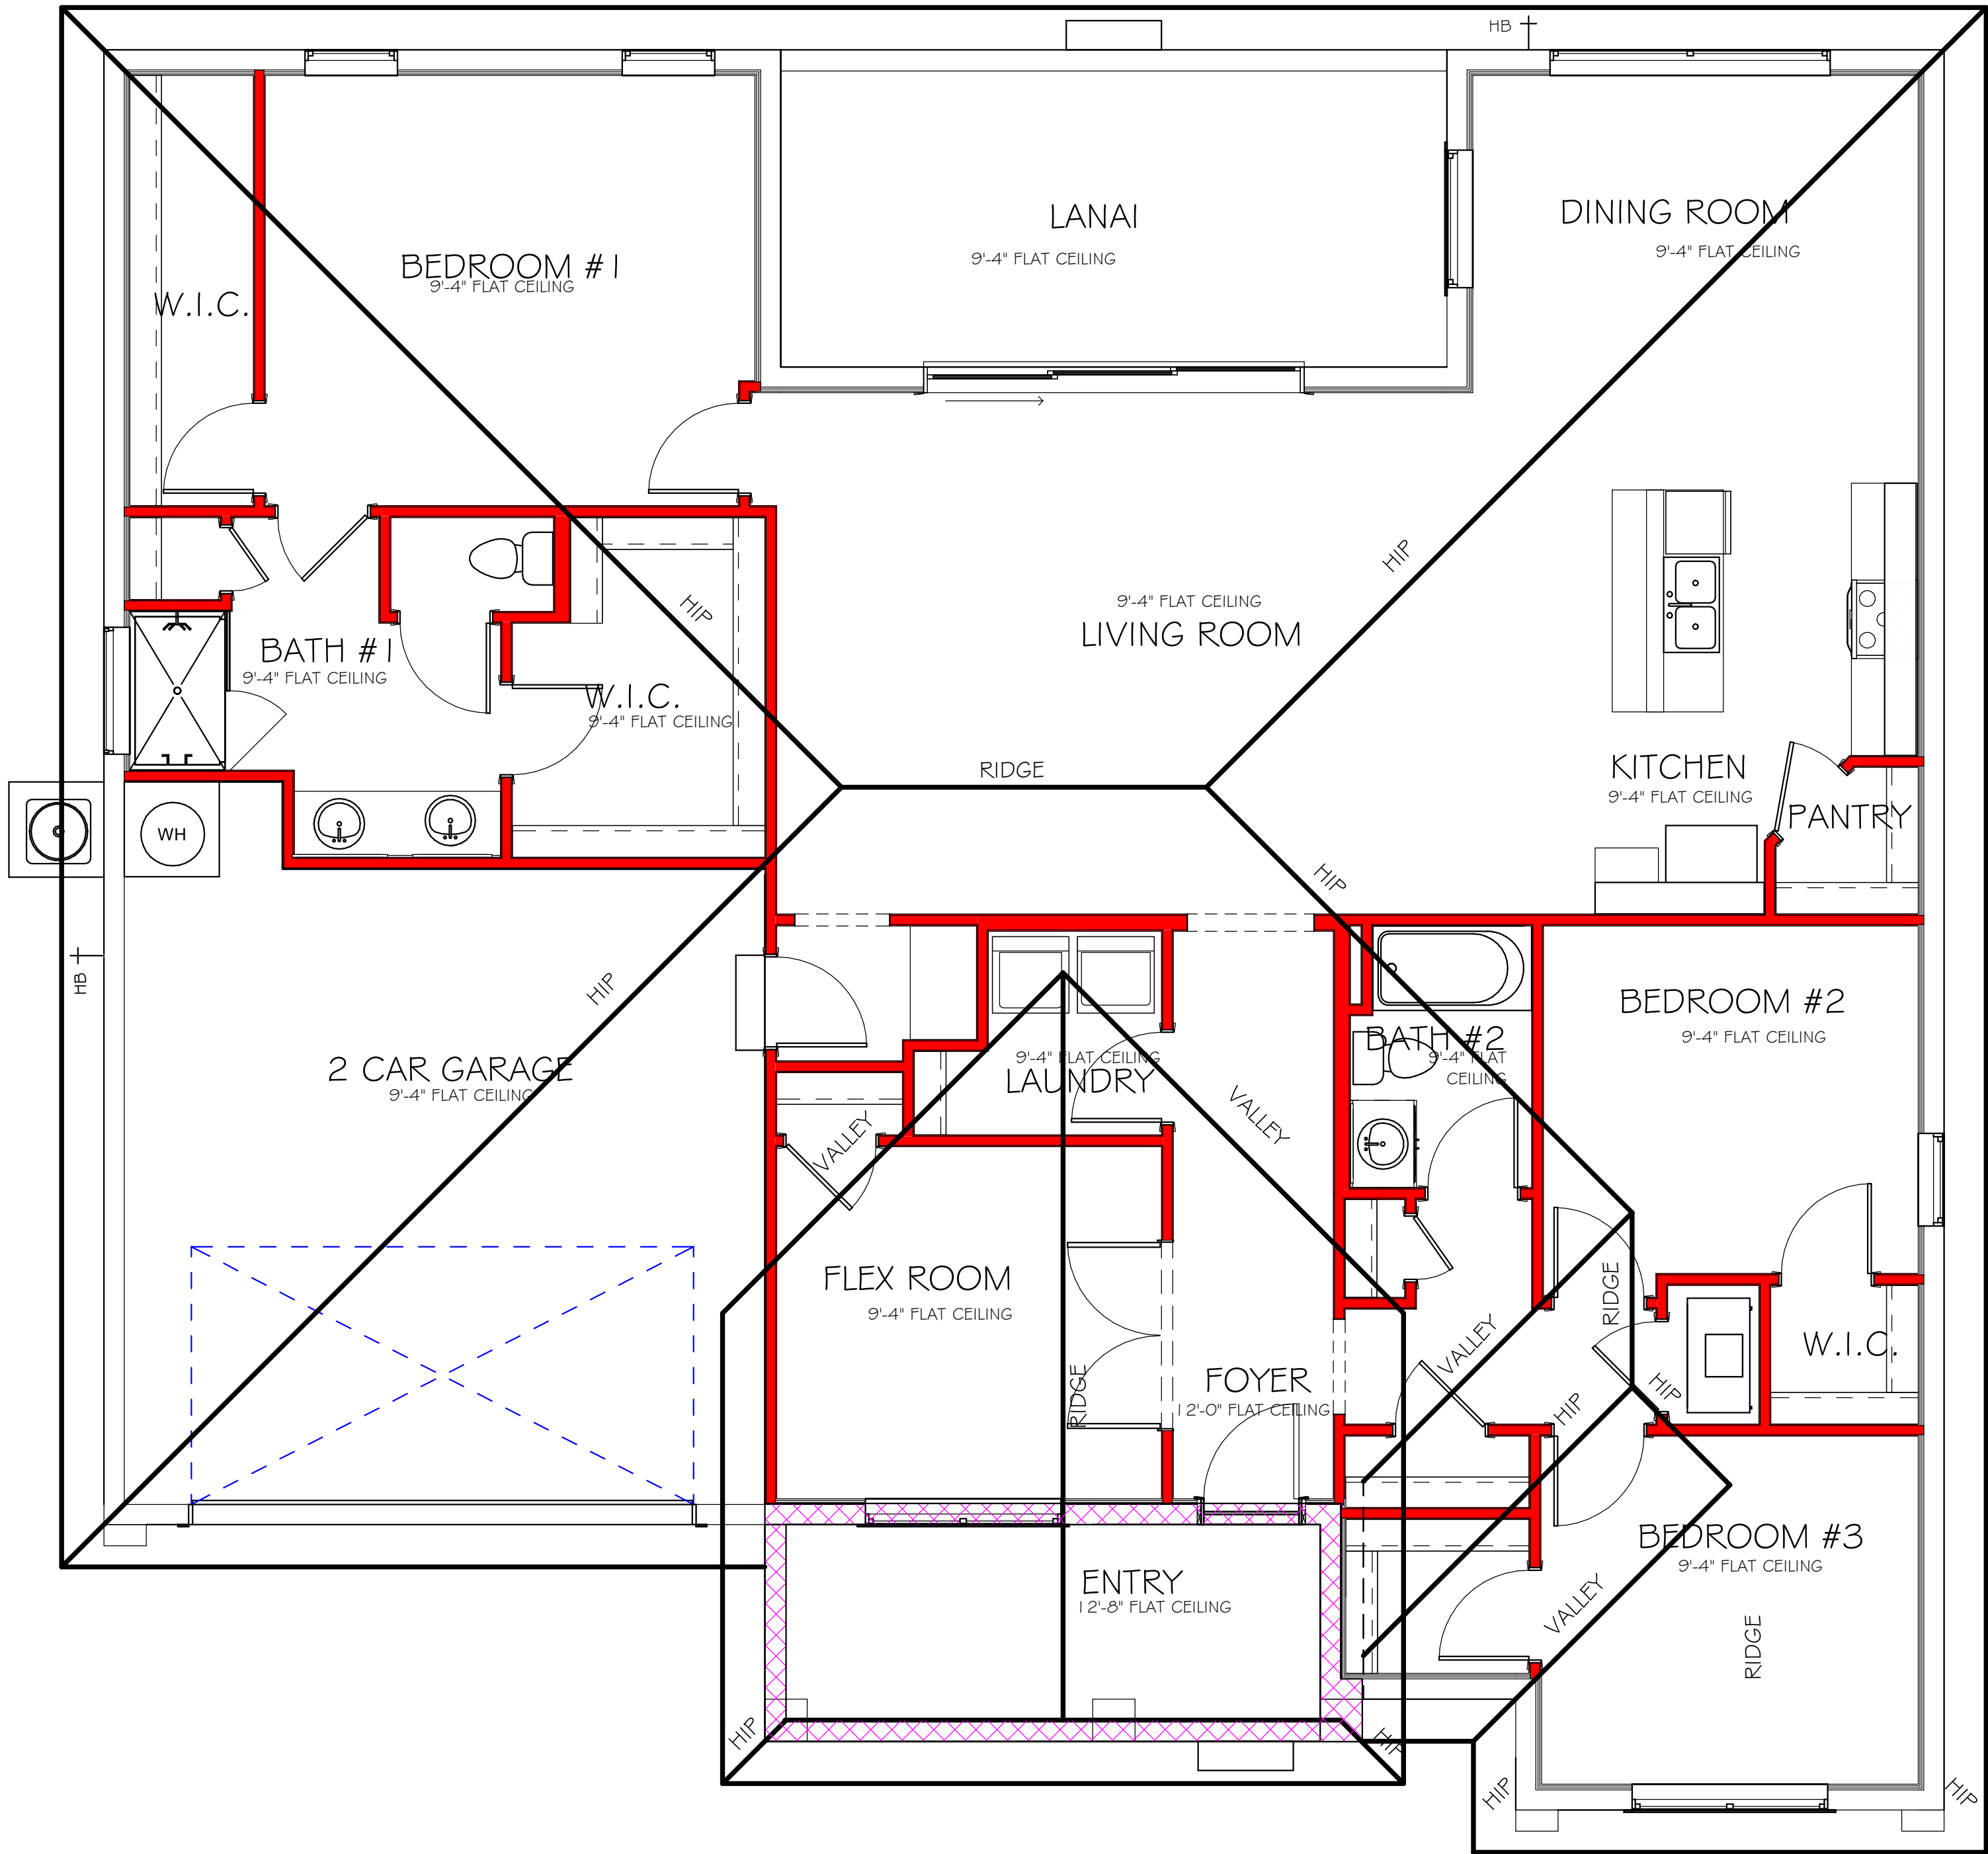


ROOF PLAN "AL"  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



**D.R. HORTON**  
America's Builder

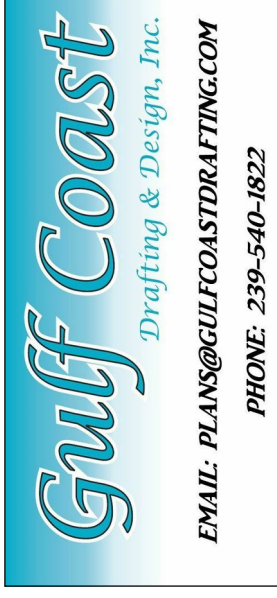


**Gulf Coast**  
Drafting & Design, Inc.  
EMAIL: PLANS@GULFCOASTDRAFTING.COM  
PHONE: 239-540-1822  
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 12	BLOCK: 4508
SUBDIVISION: SOUTH GULF COVE	
ADDRESS: 9581 ATTICA CIRCLE	
D.R.H. #: 579660040	


<b>MODEL</b> <b>2197</b>	GCD JOB # 11773	
		DATE: 09/22/20
		DRAWN BY: JSL
		CHECKED BY: JWC
		REVISED:
PLAN: ROOF	SCALE: As indicated	
<b>A-4 AL</b>		

L:\O-New Data\1 - MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773 LOT 12 BLK 4508 2197 ALREV\11773 2197 AL.rvt

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AGDC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES, PER RULE 9B-3.04-72
	SD (SMOKE DETECTOR)
	SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES:	
ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C. 210.12 AND 408.11	
ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASIC FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD.	
ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S.	
INSTALL PHONE AND T.V. PER CONTRACT.	
INSTALL ALL ELECTRICAL PER NEC 2014	

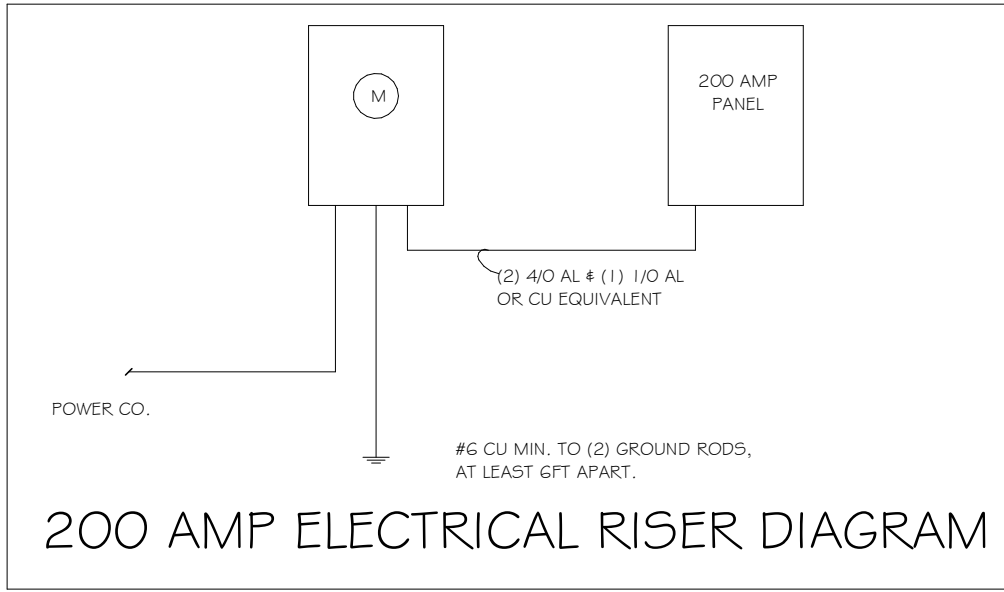

LIGHTING SCHEDULE		
200 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(17)	(FLUSH MOUNTED LT)
B	(1)	(VAPORS)
C	(3)	(PENDANT LIGHT (10' MUSHROOMS))
D	(14)	(24" 3 LT)
E	(3)	(36" 4 LT)
F	(X)	(NOT USED)
G	(X)	(COACH LIGHTS)
H	(2)	(COACH LIGHTS)
I	(X)	(J BOX)
J	(1)	(J BOX)
K	(X)	(4' FLUORESCENT)
L	(X)	(2' FLUORESCENT)
M	(X)	(SLT CHANDELIER)
N	(X)	(3 LT)
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

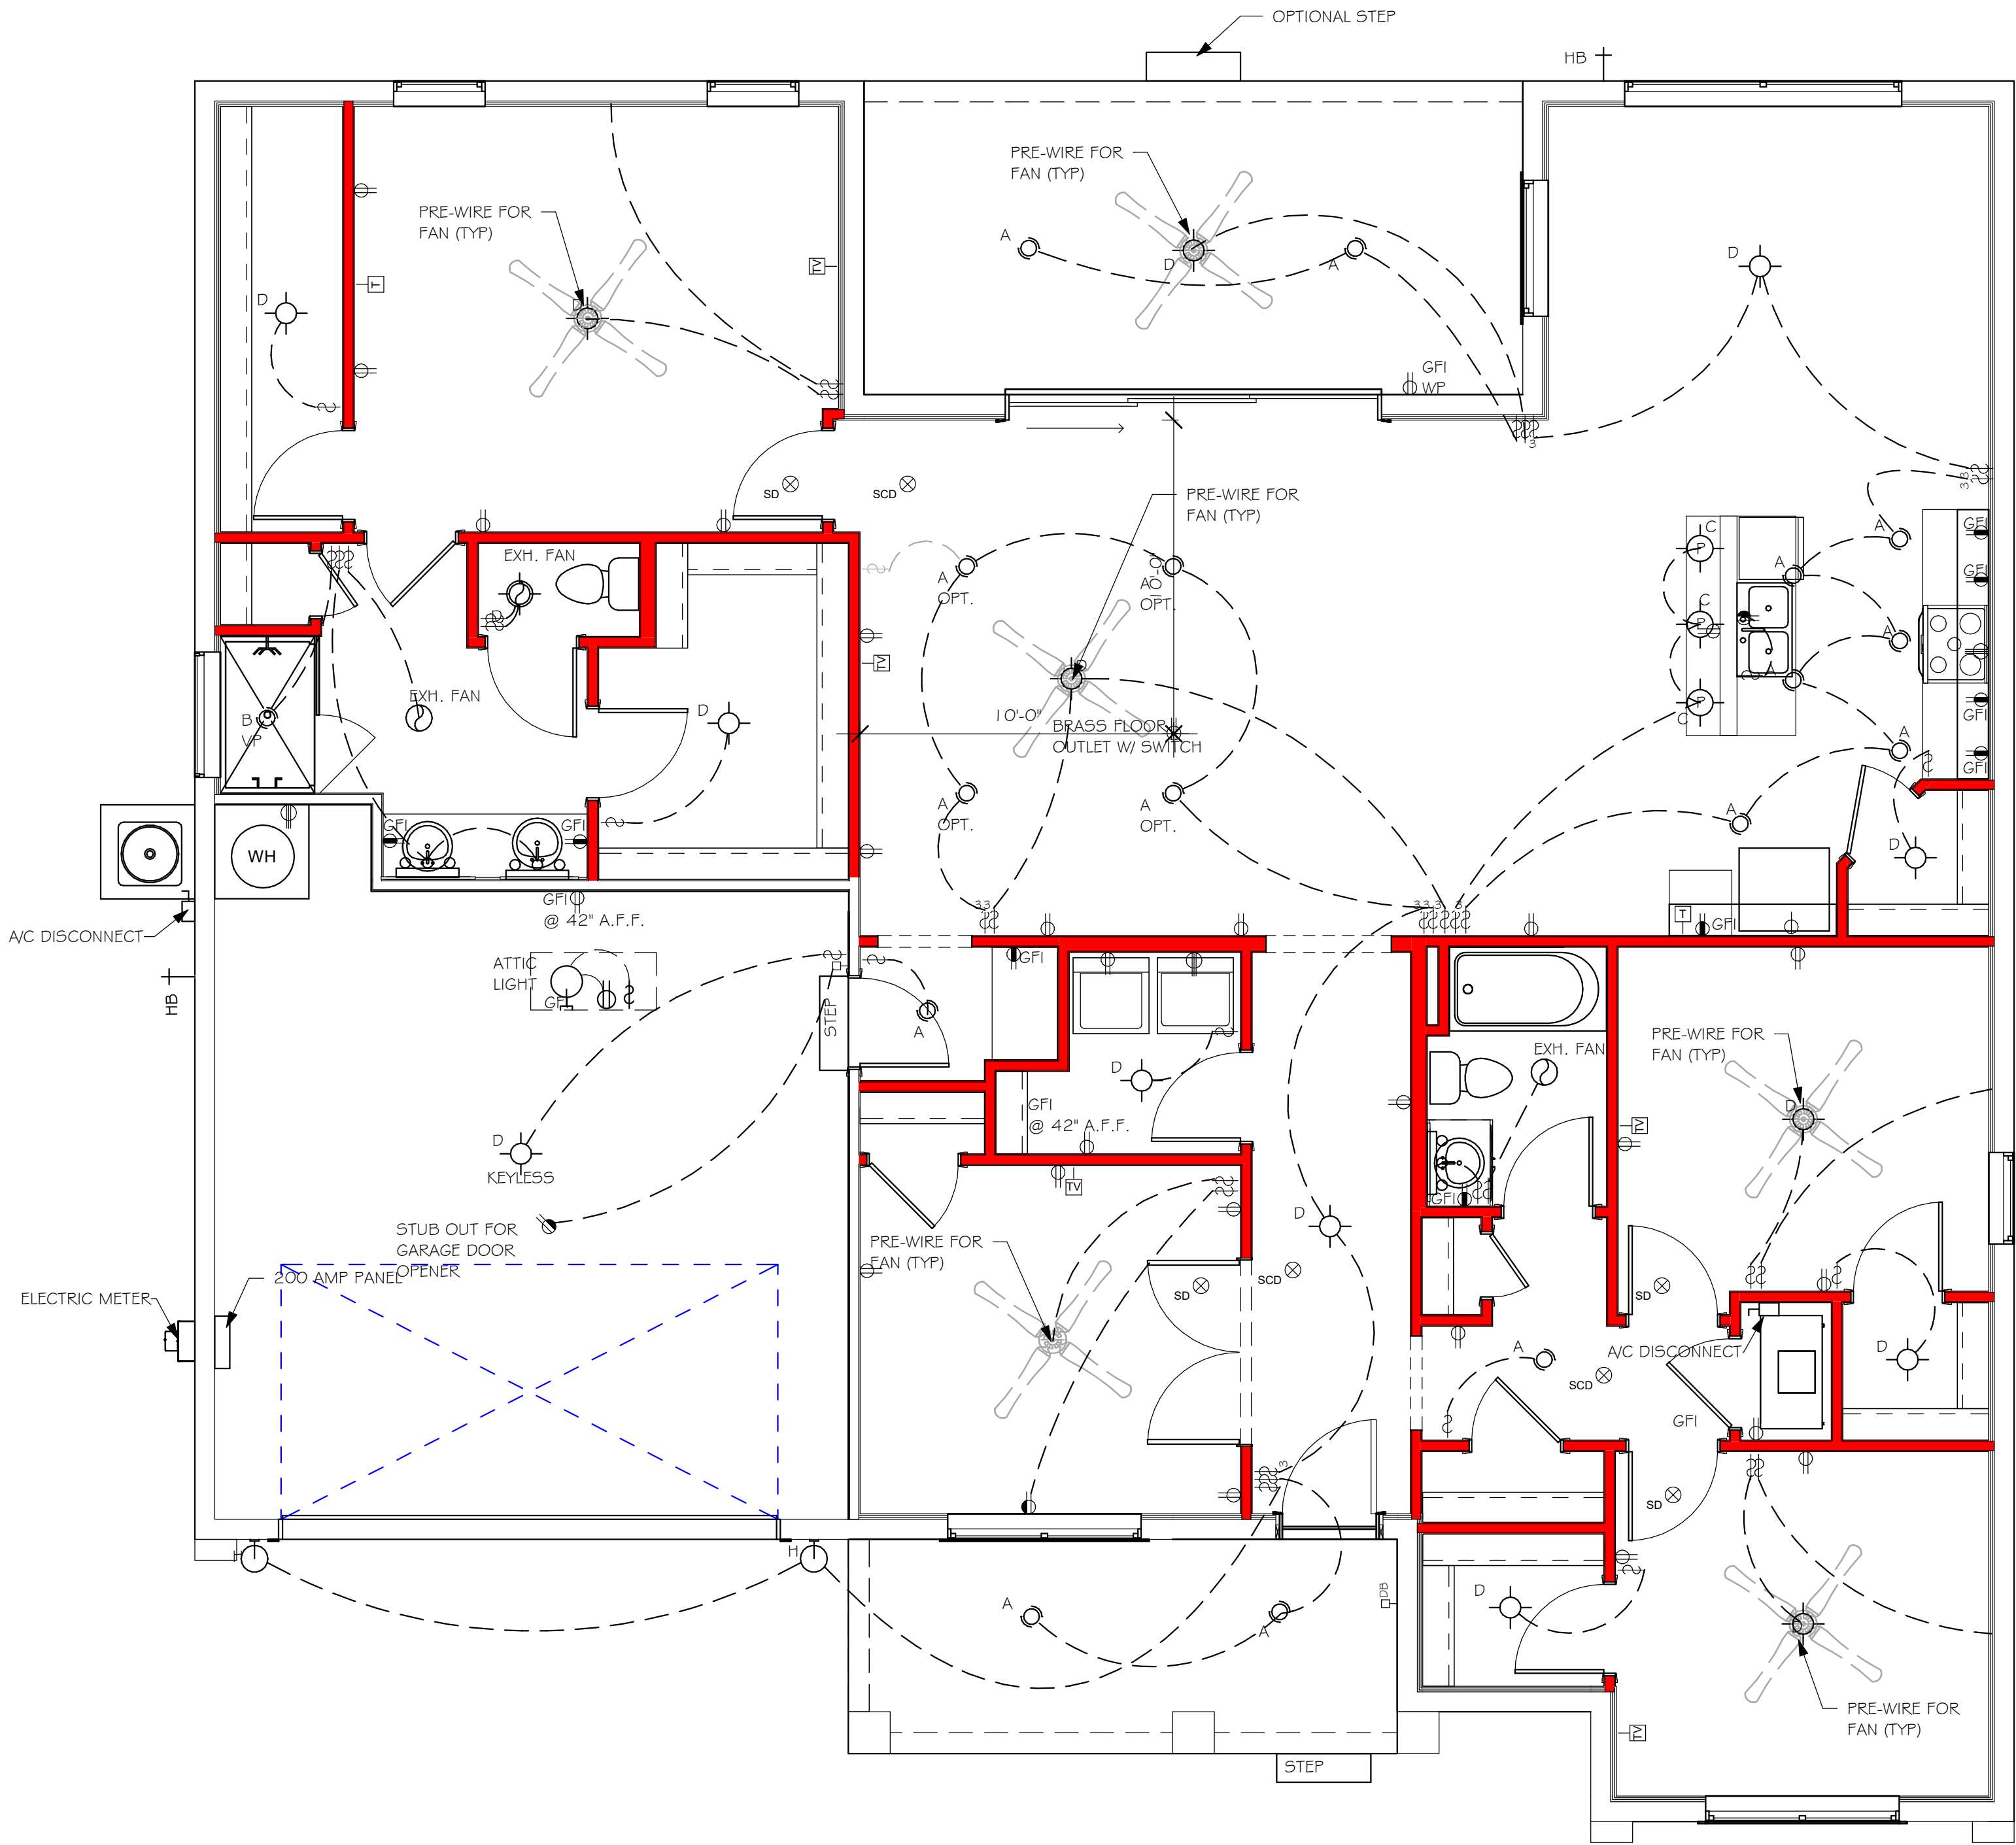

ELECTRICAL PLAN "AL"  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION


D.R. HORTON  
America's Builder

Gulf Coast  
Drafting & Design, Inc.  
EMAIL: PLANS@GULFCOASTDRAFTING.COM  
PHONE: 339-540-822  
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 12	BLOCK: 4508
SUBDIVISION: SOUTH GULF COVE	
ADDRESS: 9581 ATTICA CIRCLE	
D.R.H. #: 579660040	
MODEL 2197	GCD JOB # 11773
DATE: 09/22/20	
DRAWN BY: JSL	
CHECKED BY: JWC	
REVISED:	
PLAN: ELECTRICAL	
SCALE: As indicated	
A-5 AL	




L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773\11773 LOT 12 BLK 4508 2197 ALREVIT\1773 2197 AL.rvt

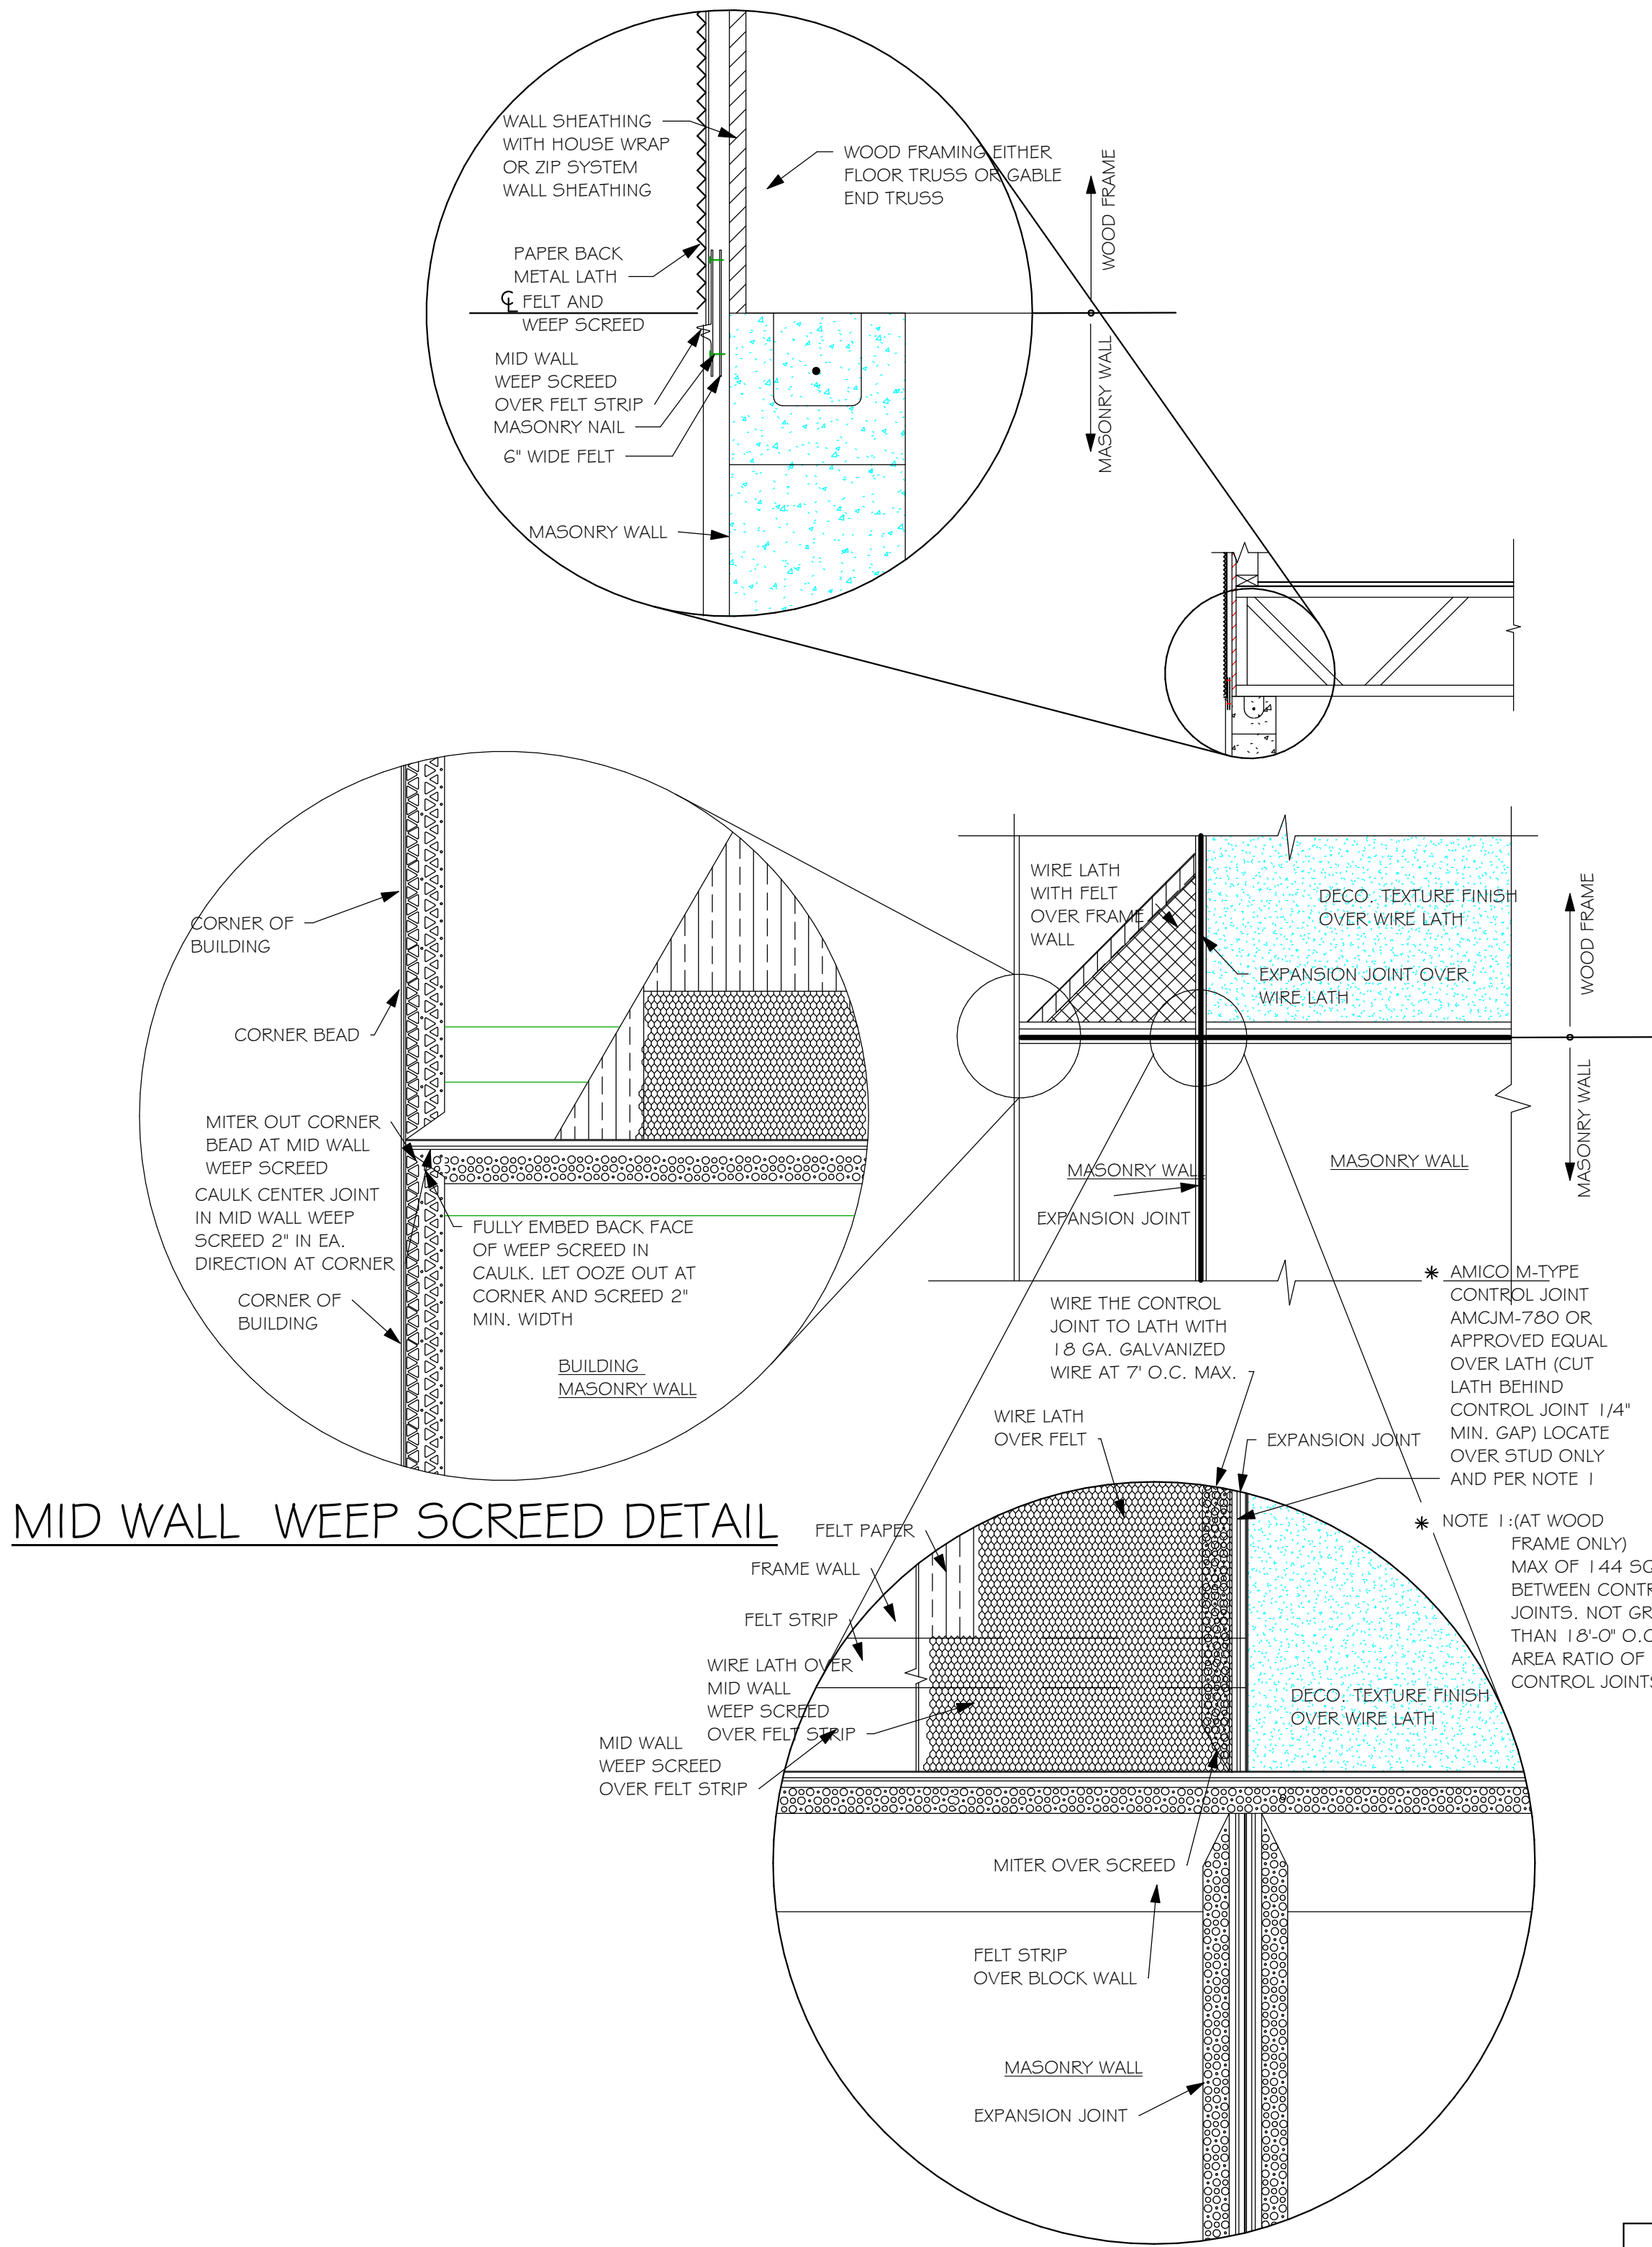

MID WALL WEEP SCREED DETAIL

WEEP SCREED DETAIL

INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

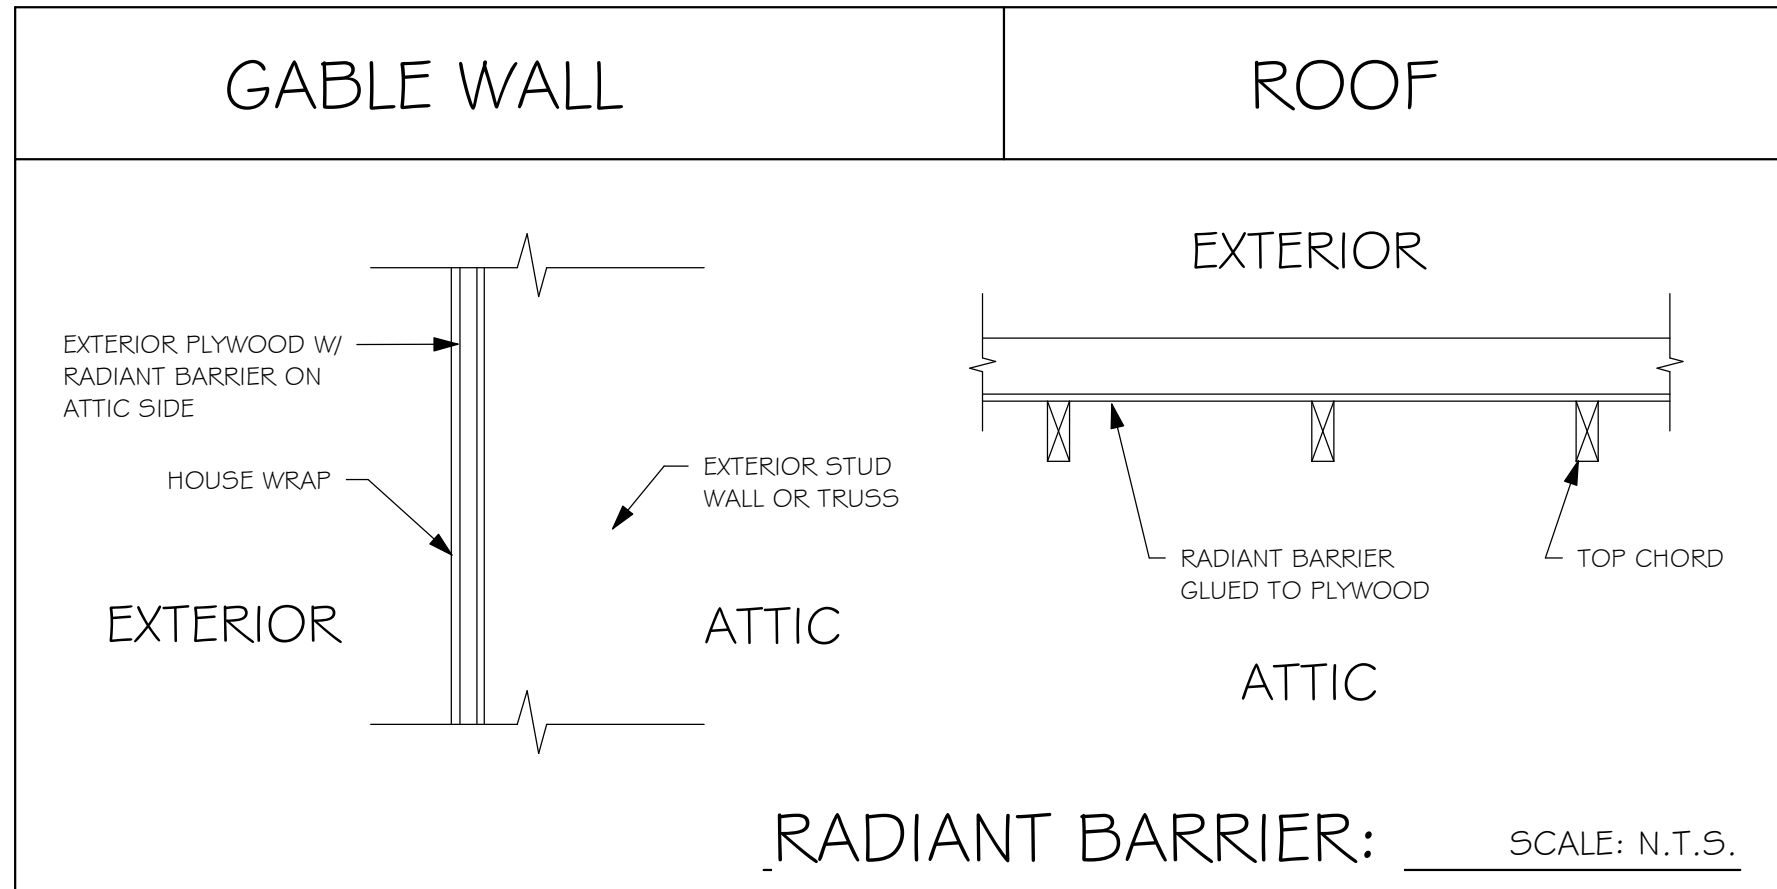

NOTE: EXTERIOR WALLS ADJACENT TO ATTIC SPACE, INCLUDING KNEEWALLS AND GABLE END WALLS, MUST HAVE RADIANT BARRIER AND HOUSE WRAP.

## RESIDENTIAL SPECIFICATIONS

### GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. FOR REQUIRED SOILD BEARING, SEE STRUCTURAL. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT. ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL. CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
7. TREATED WOOD REQUIREMENTS:- ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LANAI CEILINGS & COVERED ENTRY CEILINGS 1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.


2

### GENERAL ROOF ASSEMBLY

**ROOF SHEATHING**  
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "I" CLIPS AT UNSUPPORTED PANEL EDGES. FOR FASTENING, SEE STRUCTURAL.

**FLASHING**  
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURERS PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

**DRIP EDGE**  
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

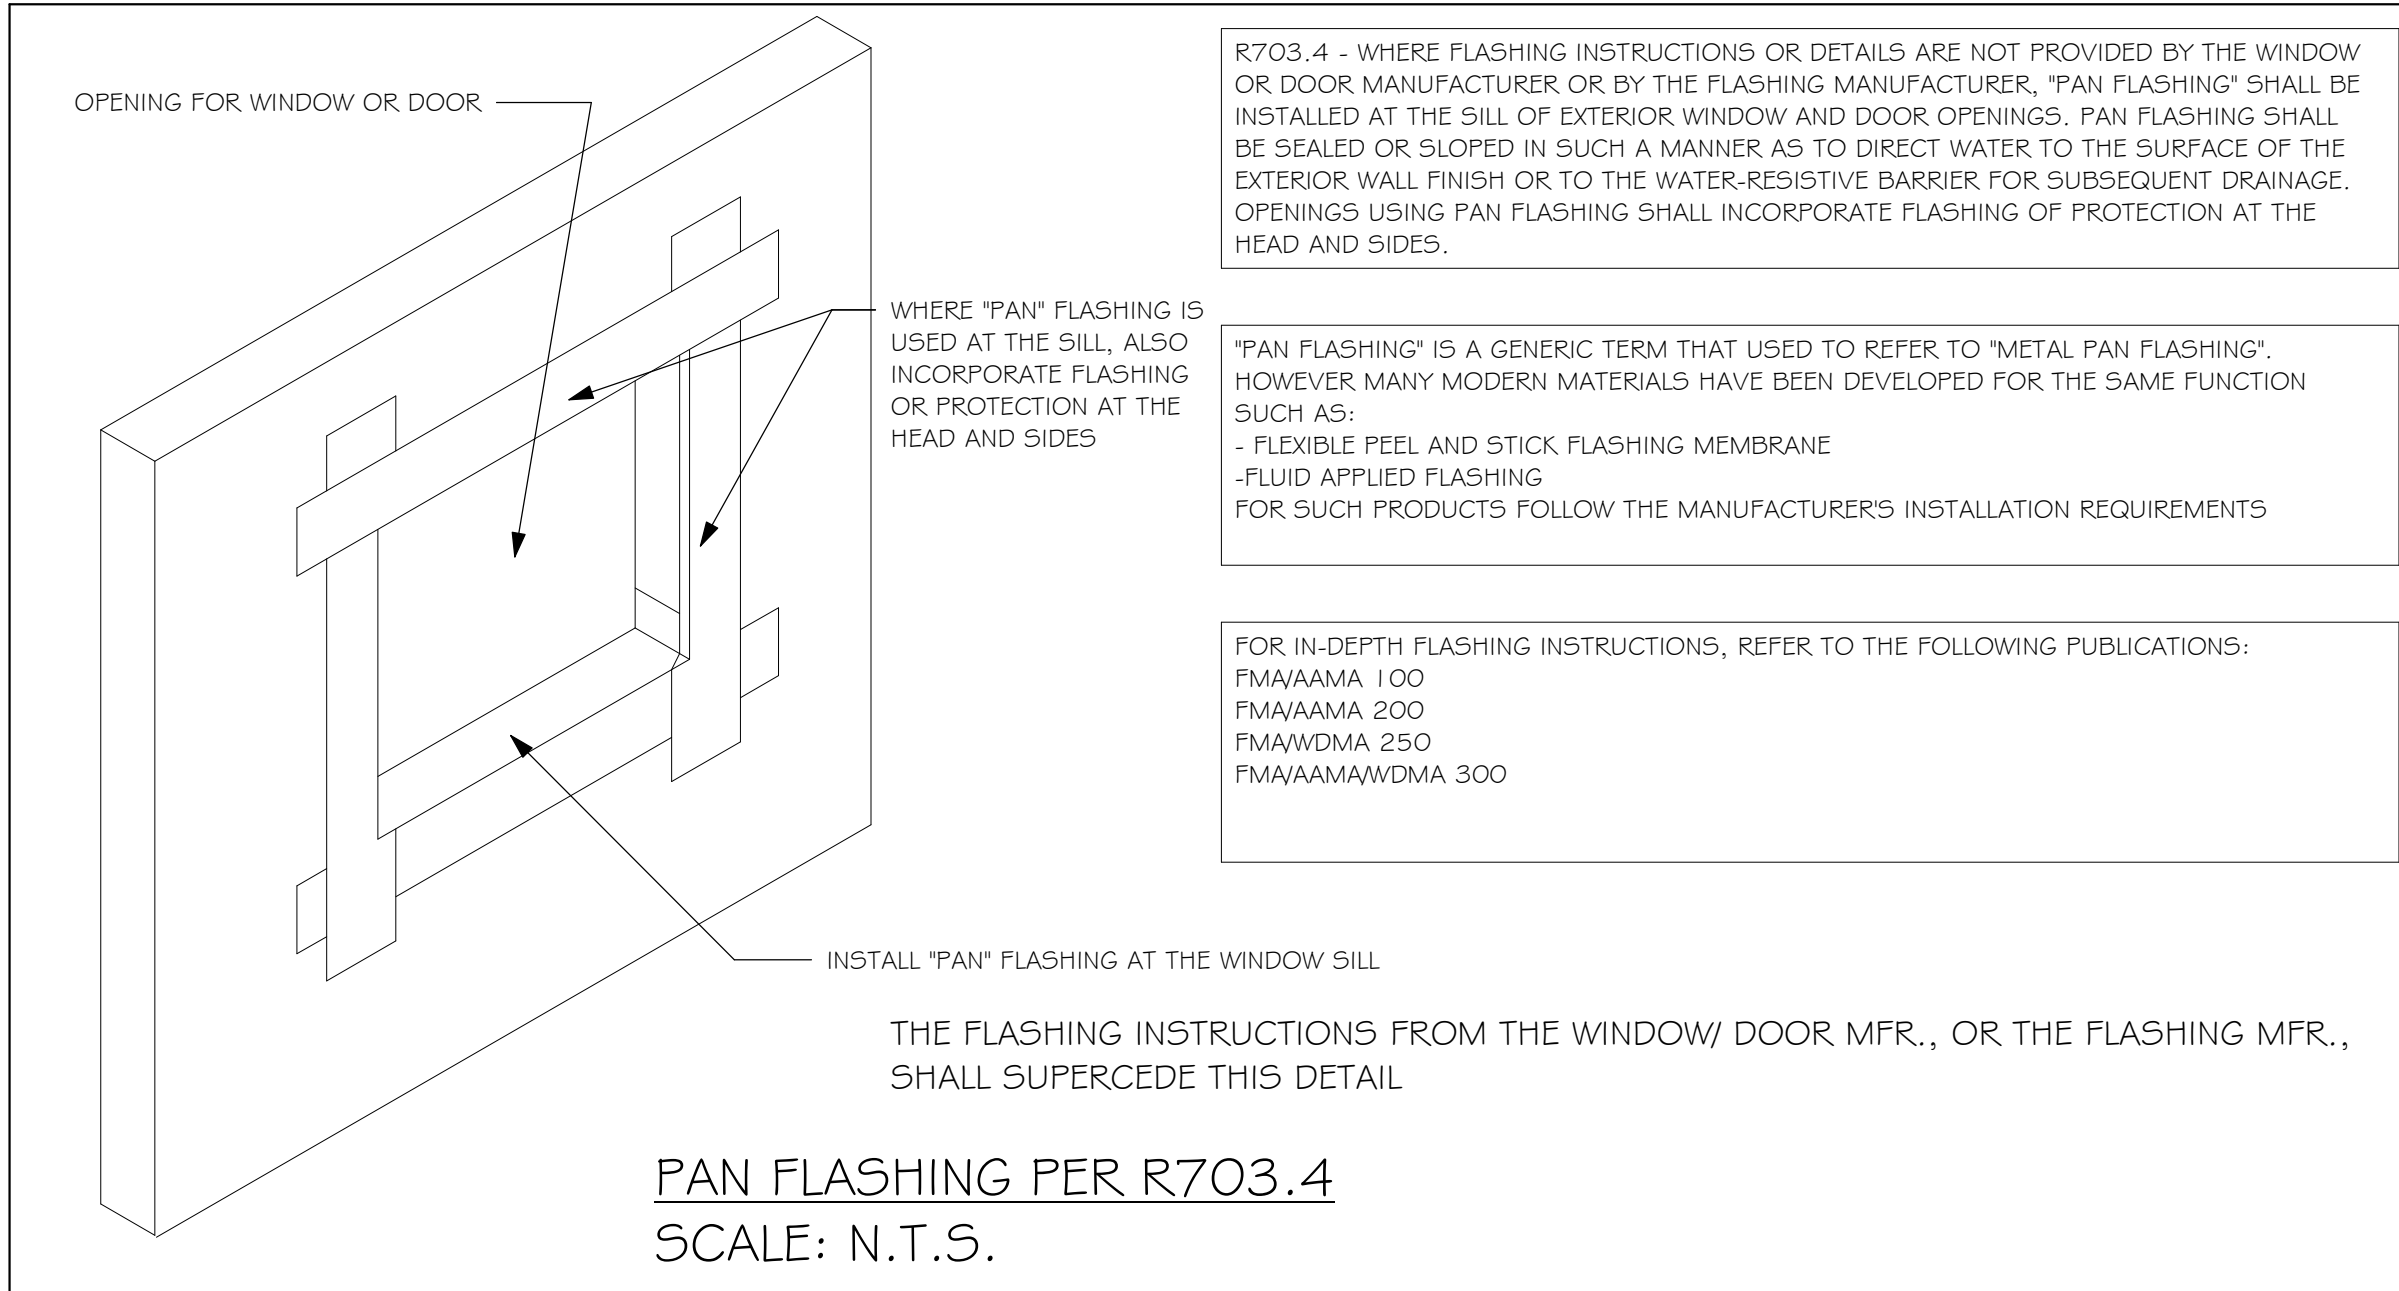

### ASPHALT SHINGLE ROOF SPECS

#### SHINGLES

15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462. FOR FASTENING, SEE STRUCTURAL. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

4



### CLAY AND CONCRETE ROOF TILE SPECS

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF. THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C. MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK. APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:  
1. TILE PLACEMENT AND SPACING,  
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,  
A. AMOUNT AND PLACEMENT OF MORTAR  
B. AMOUNT AND PLACEMENT OF ADHESIVE  
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.  
3. UNDERLAYMENT  
4. SLOPE REQUIREMENT.

5

### FLOOR SHEATHING AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES SPAN RATING 48/24 OR BETTER, SEE STRUCTURAL.

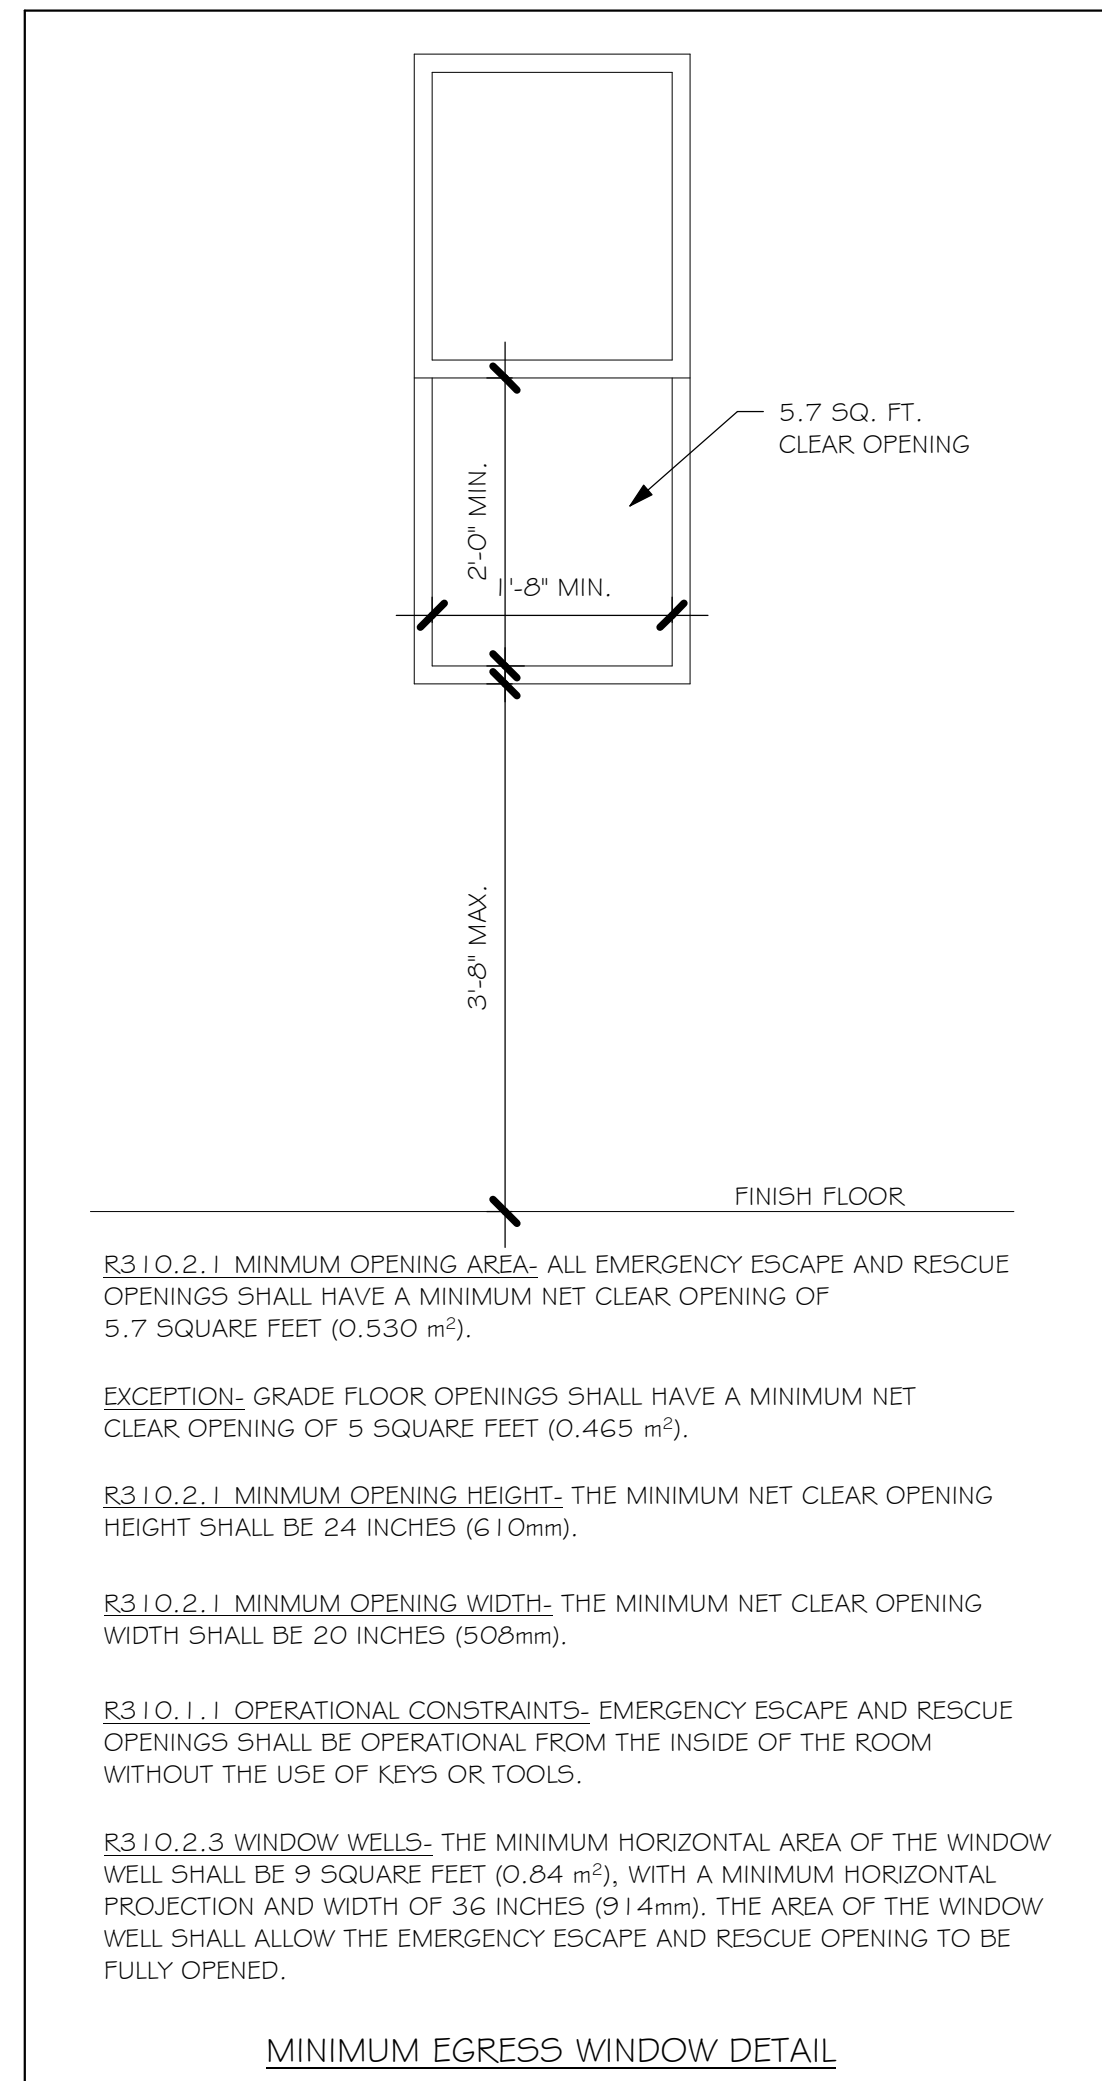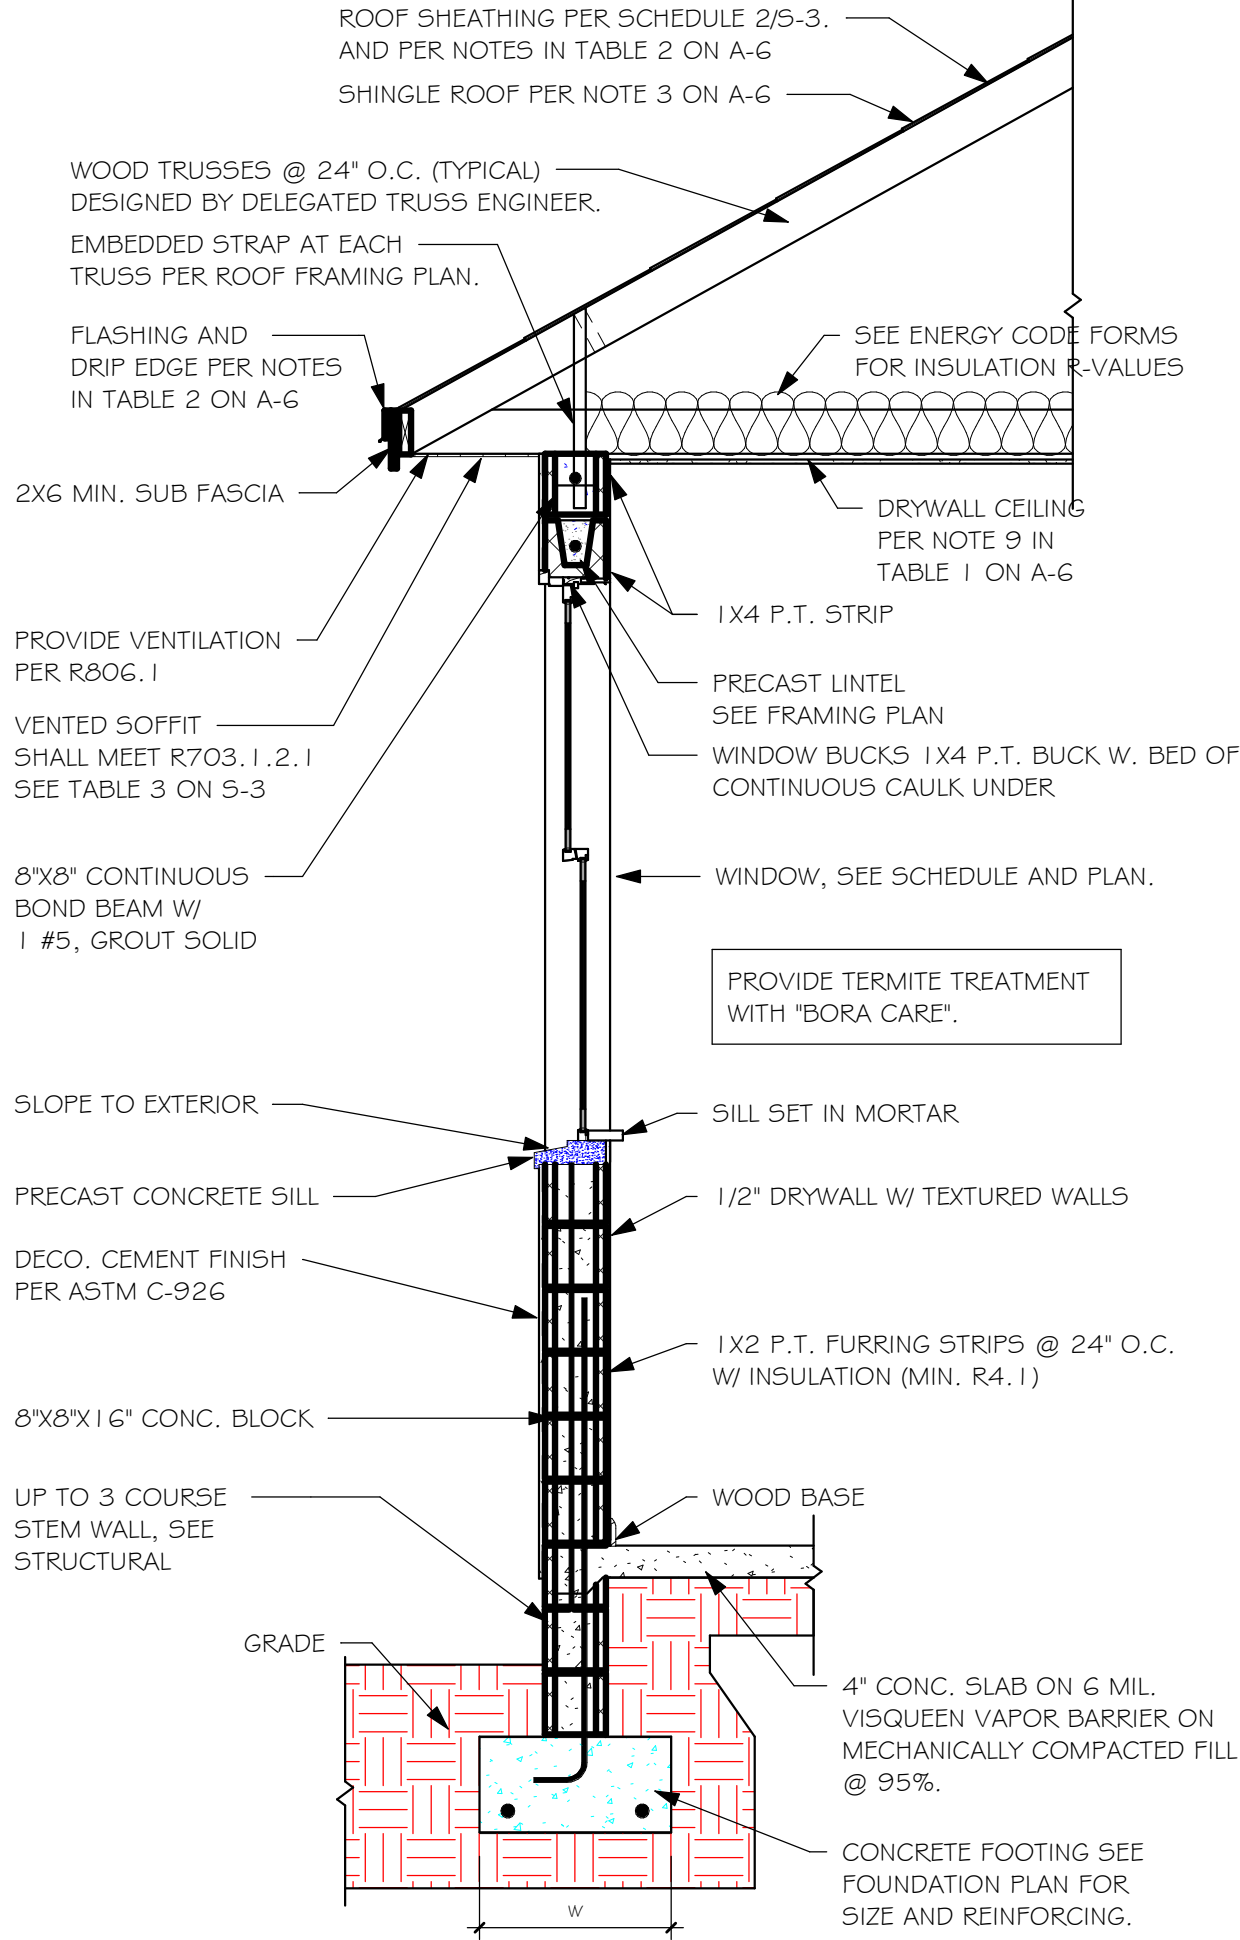

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION



L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOTS\11773 LOT 12 BLK 4508 2197 ALREV\11773 2197 AL REV

### FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

#### PLAN NOTES:

1. TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
2. "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
3. PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
4. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
5. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
6. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/S-3.


### PAD FOOTING SCHEDULE

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
X	A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
X	B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
X	C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
X	D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
X	E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

### WALL FOOTING SCHEDULE

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE	REMARKS
X	F1	CONT.	1'-4"	0'-8"	2-#5		
X	F2	CONT.	1'-8"	0'-10"	2-#5		
X	F3	CONT.	1'-0"	1'-8"	2-#5		
X	F4	CONT.	1'-4"	1'-8"	2-#5		
X	F5	CONT.	1'-4"	1'-0"	2-#5		
X	F6	CONT.	1'-4"	1'-0"	2-#5		
X	F6A	CONT.	0'-8"	0'-8"	1-#5		
X	TE	CONT.	0'-8"	0'-8"	1-#5		


ADD CURB TO GARAGE, SEE DETAIL.

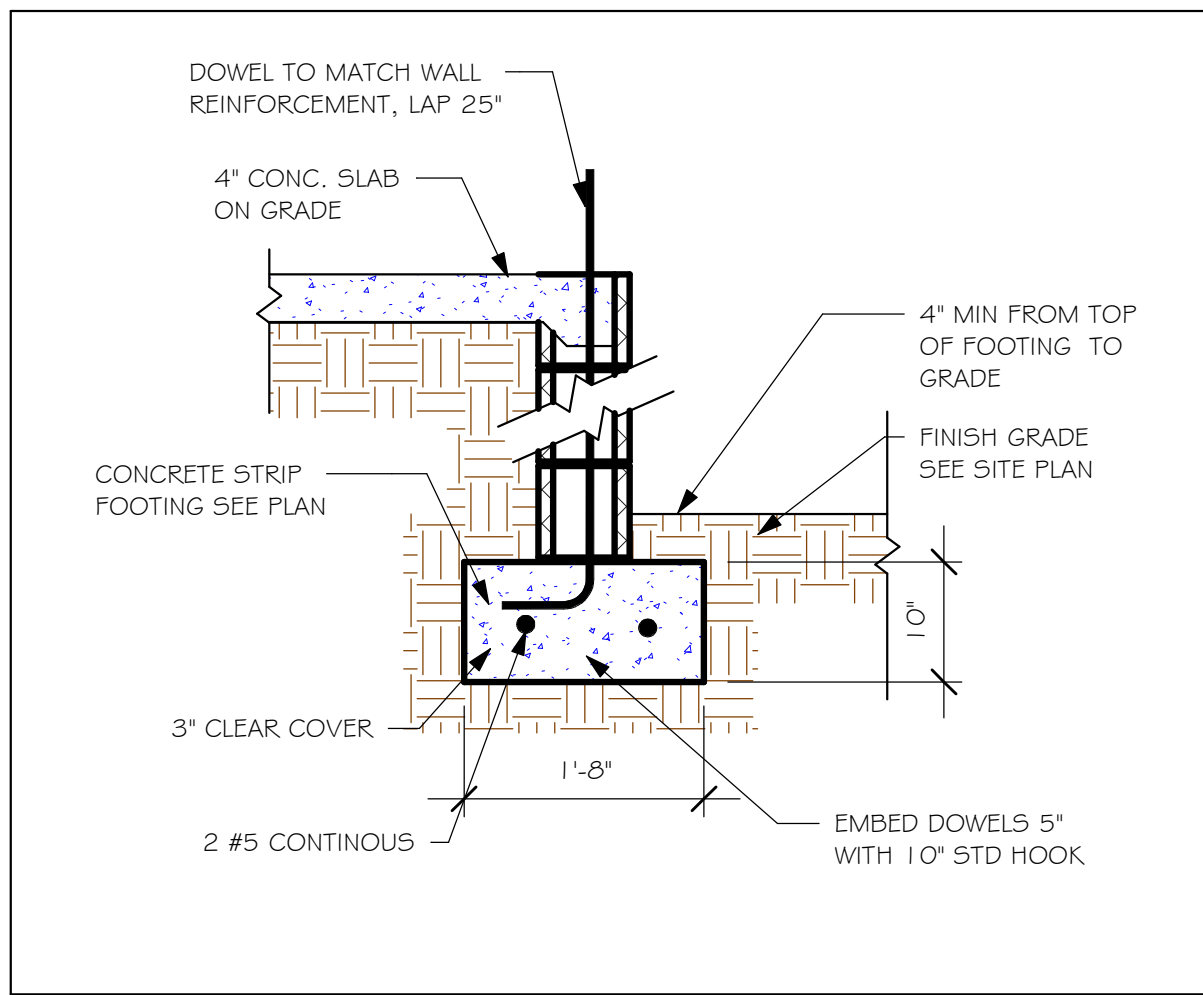

NOTE: REINFORCING IN FOOTINGS SHALL BE CONTINUOUS AT CORNERS AND INTERSECTIONS. ADD CORNER BAR 25" X 25" AT EACH LONGITUDINAL BAR.


### "F2" FOOTING

3/4" = 1'-0"

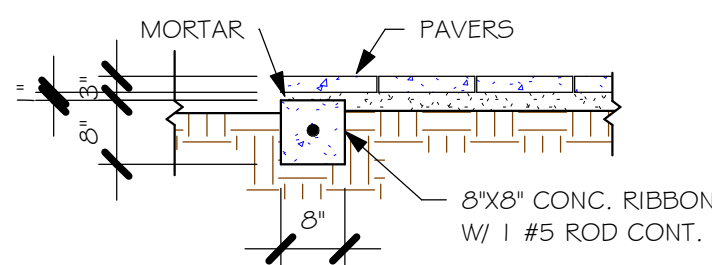

### "P" PAVERS DETAIL

1/2" = 1'-0"

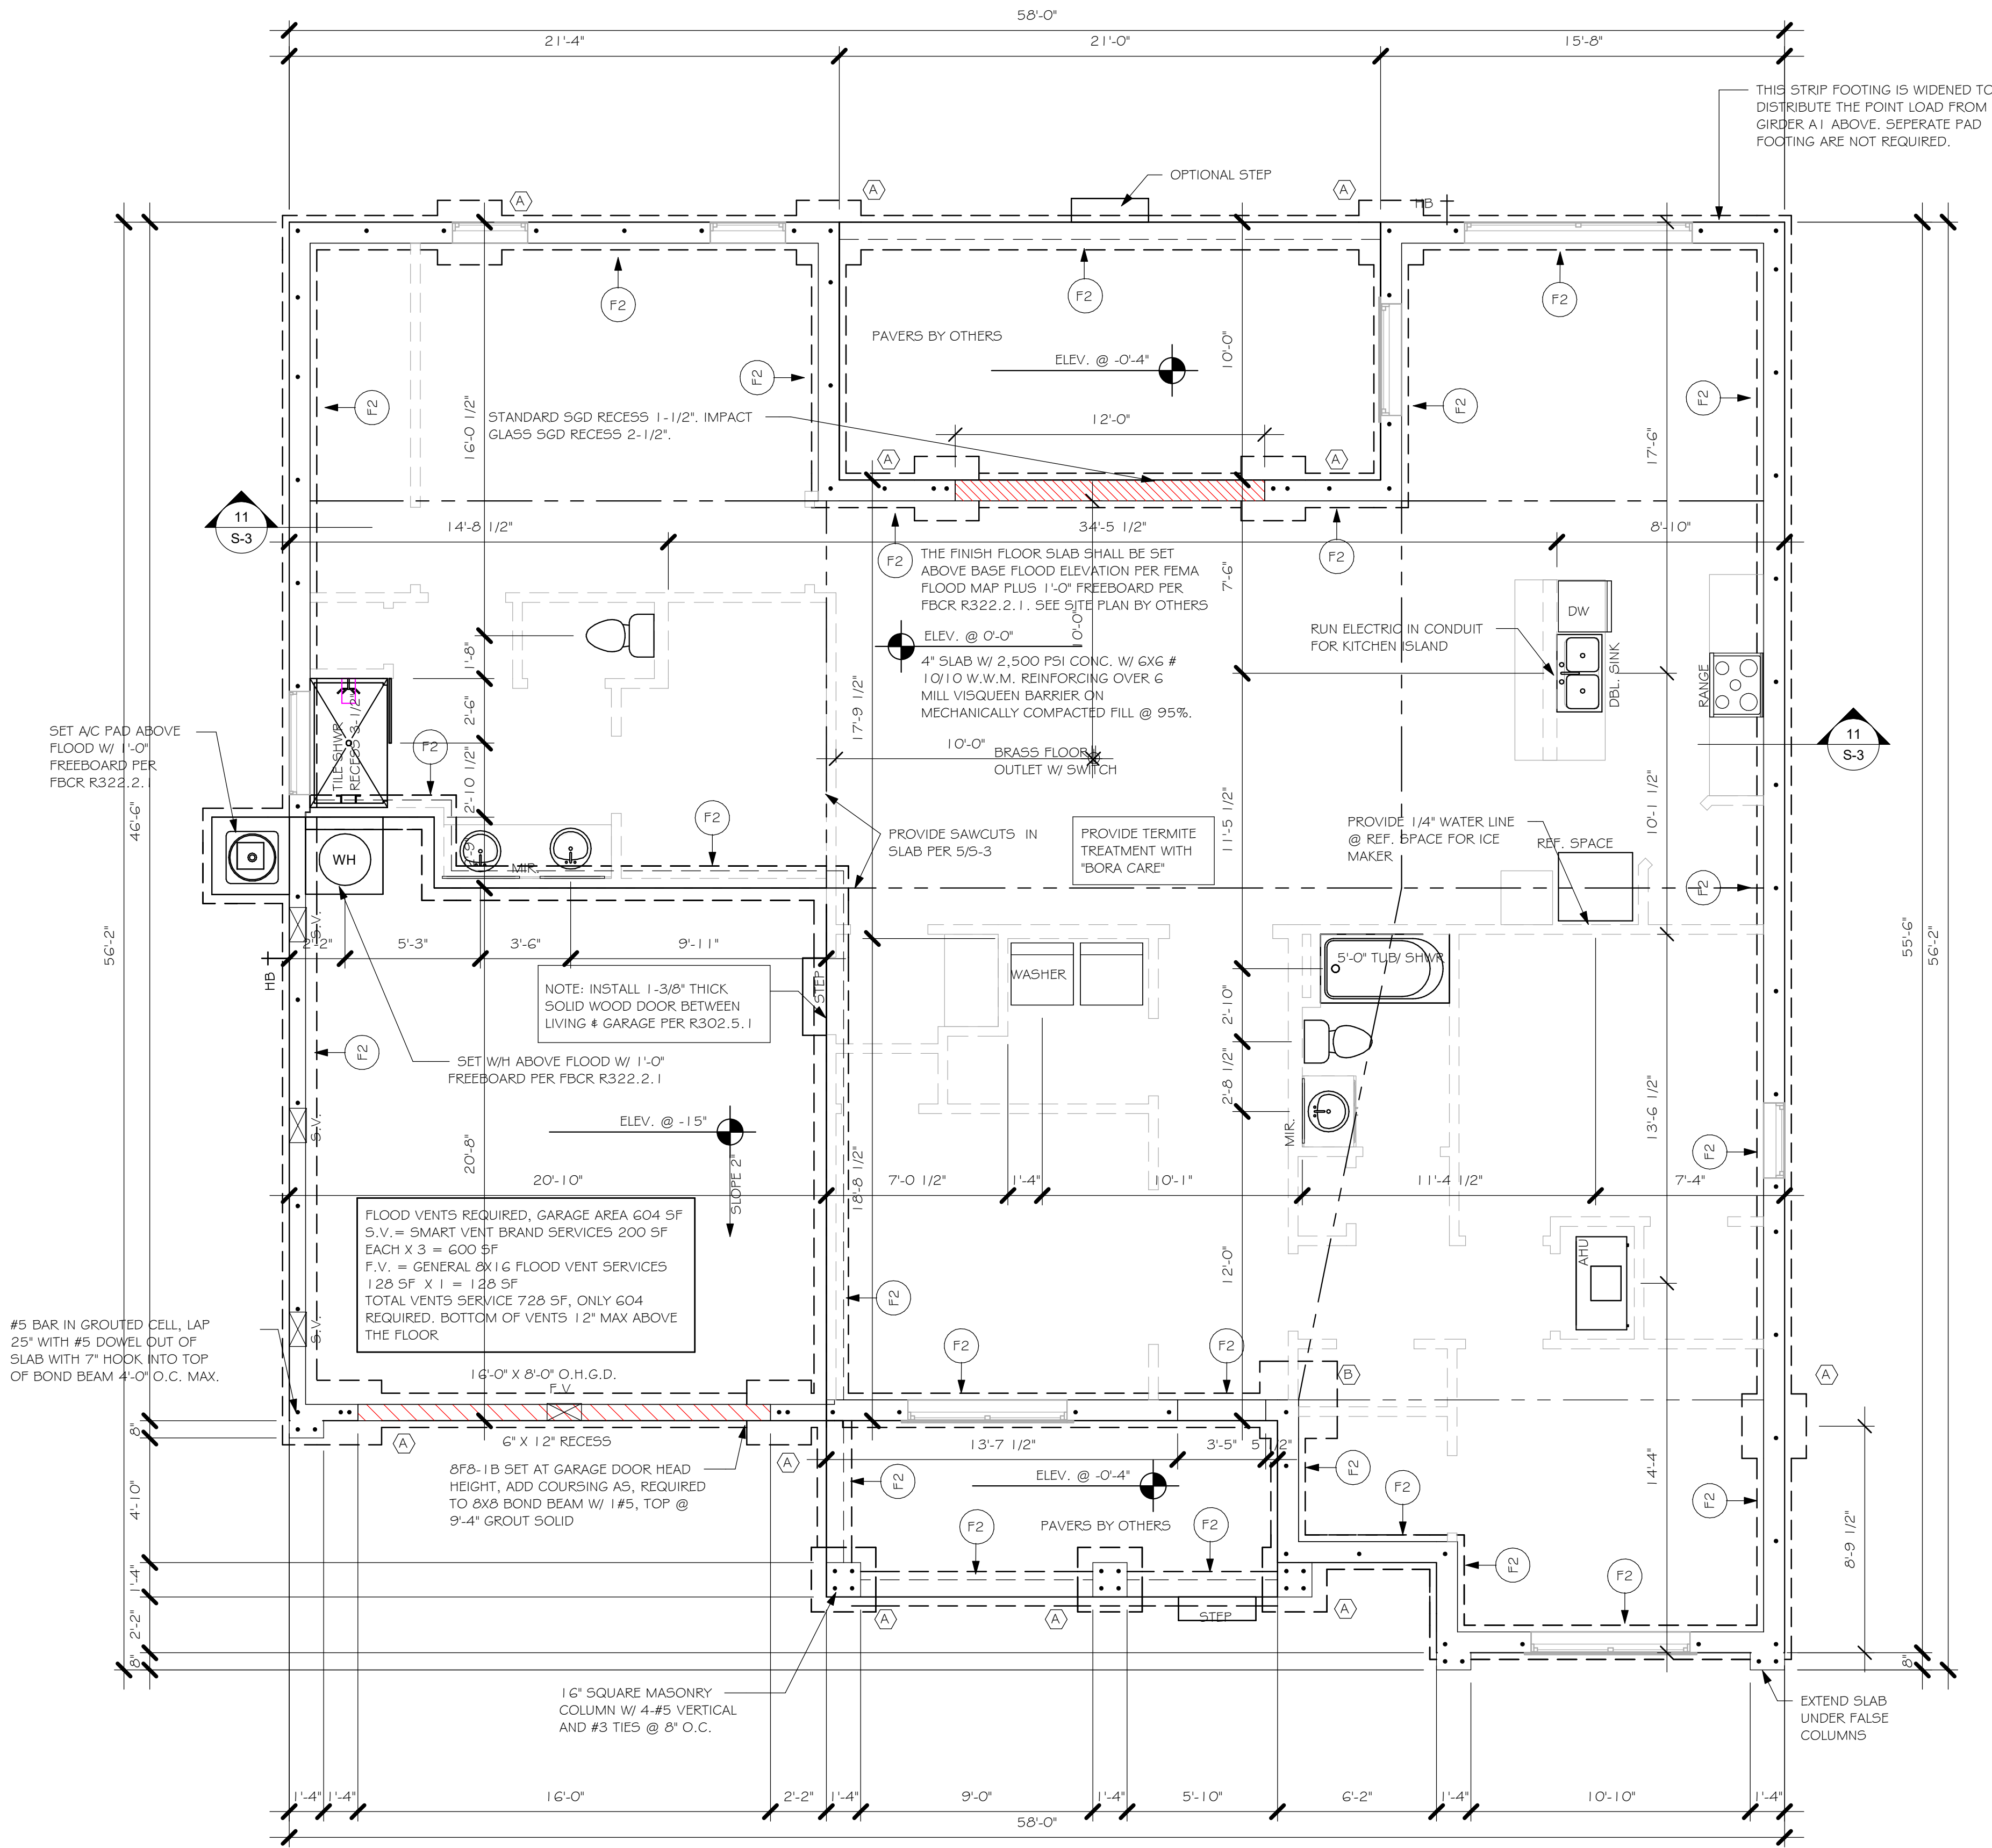

### FOUNDATION PLAN "AL"

1/4" = 1'-0"




DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.







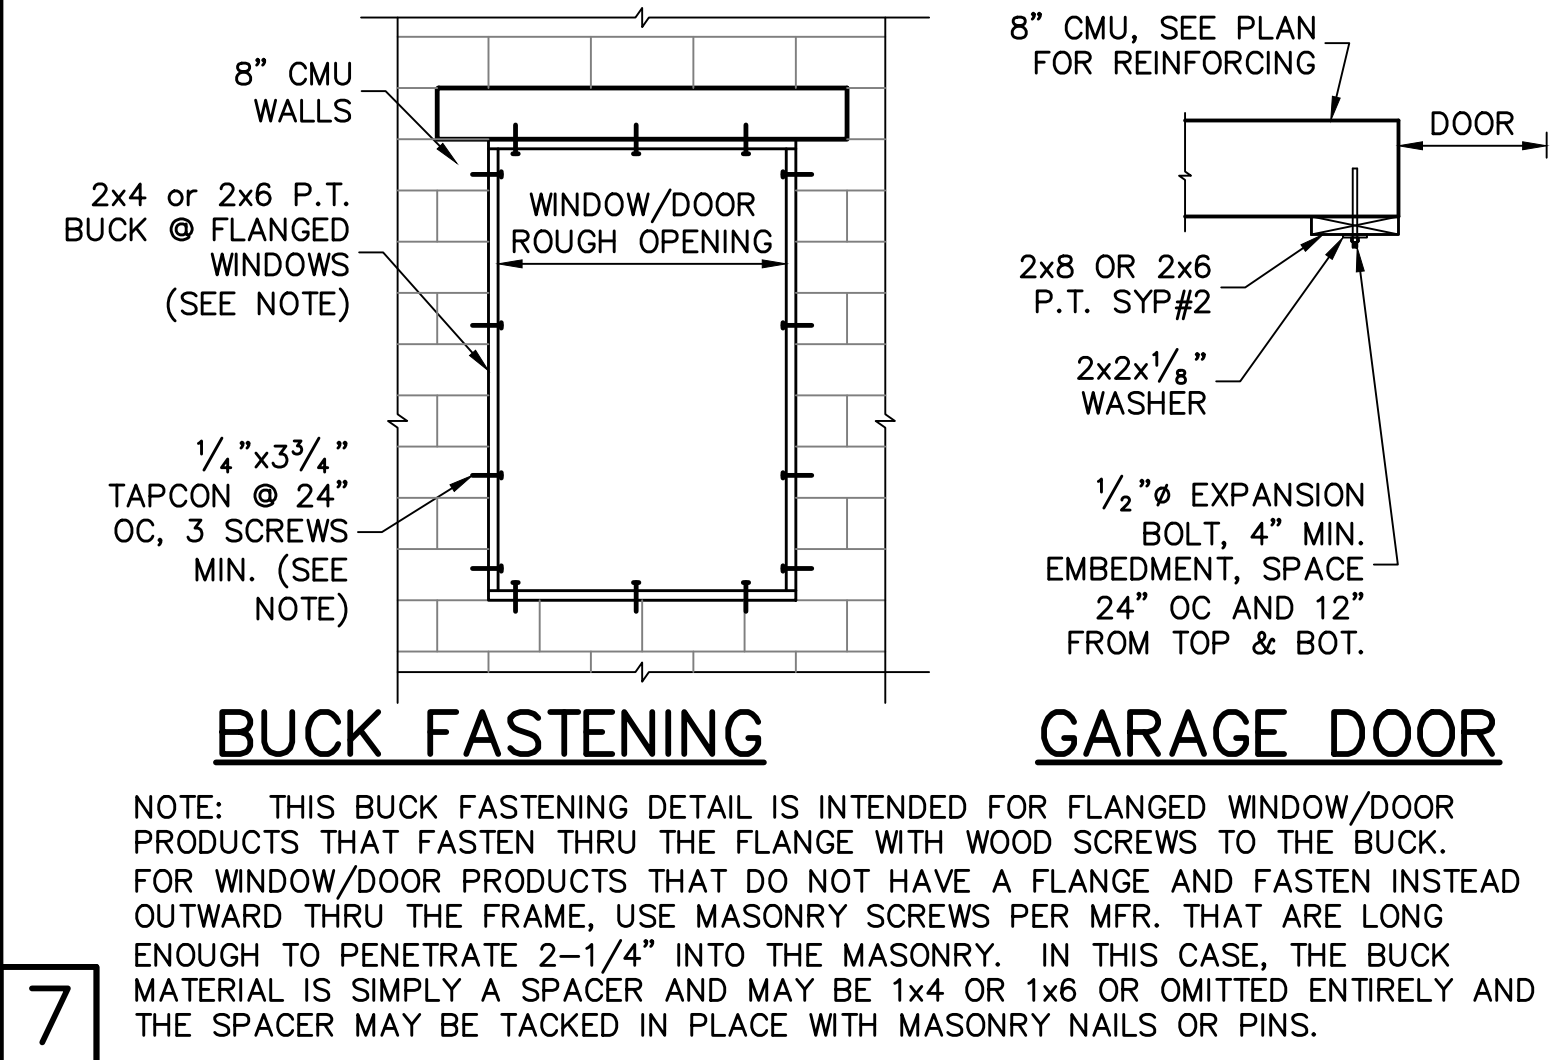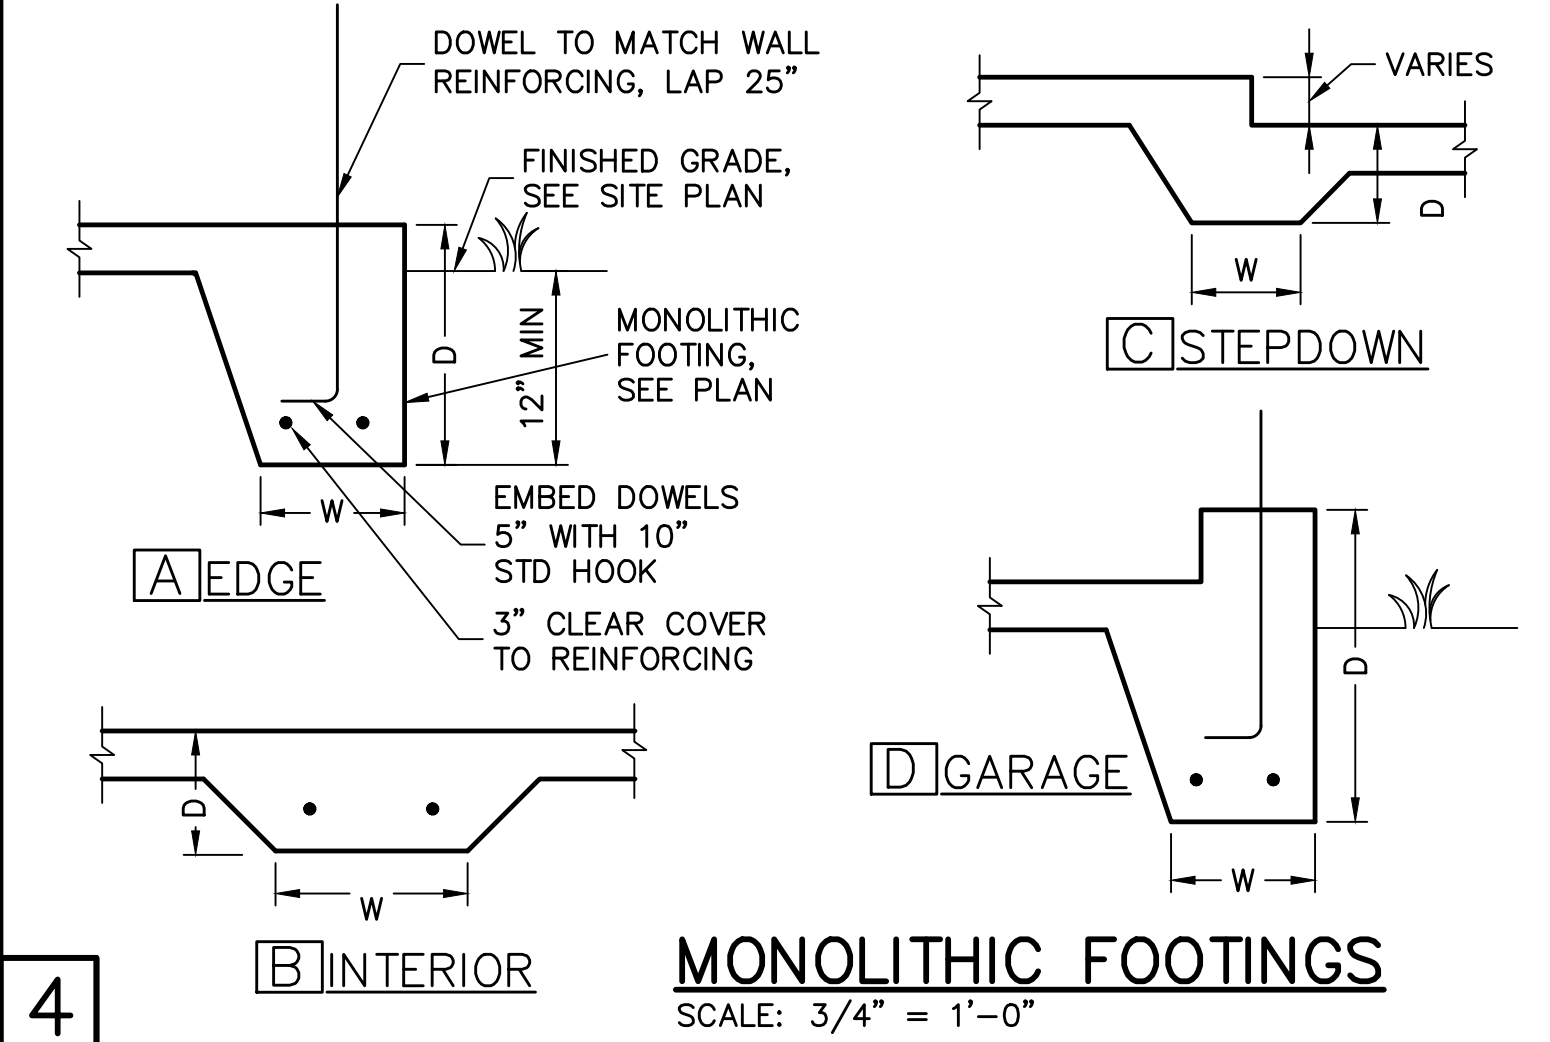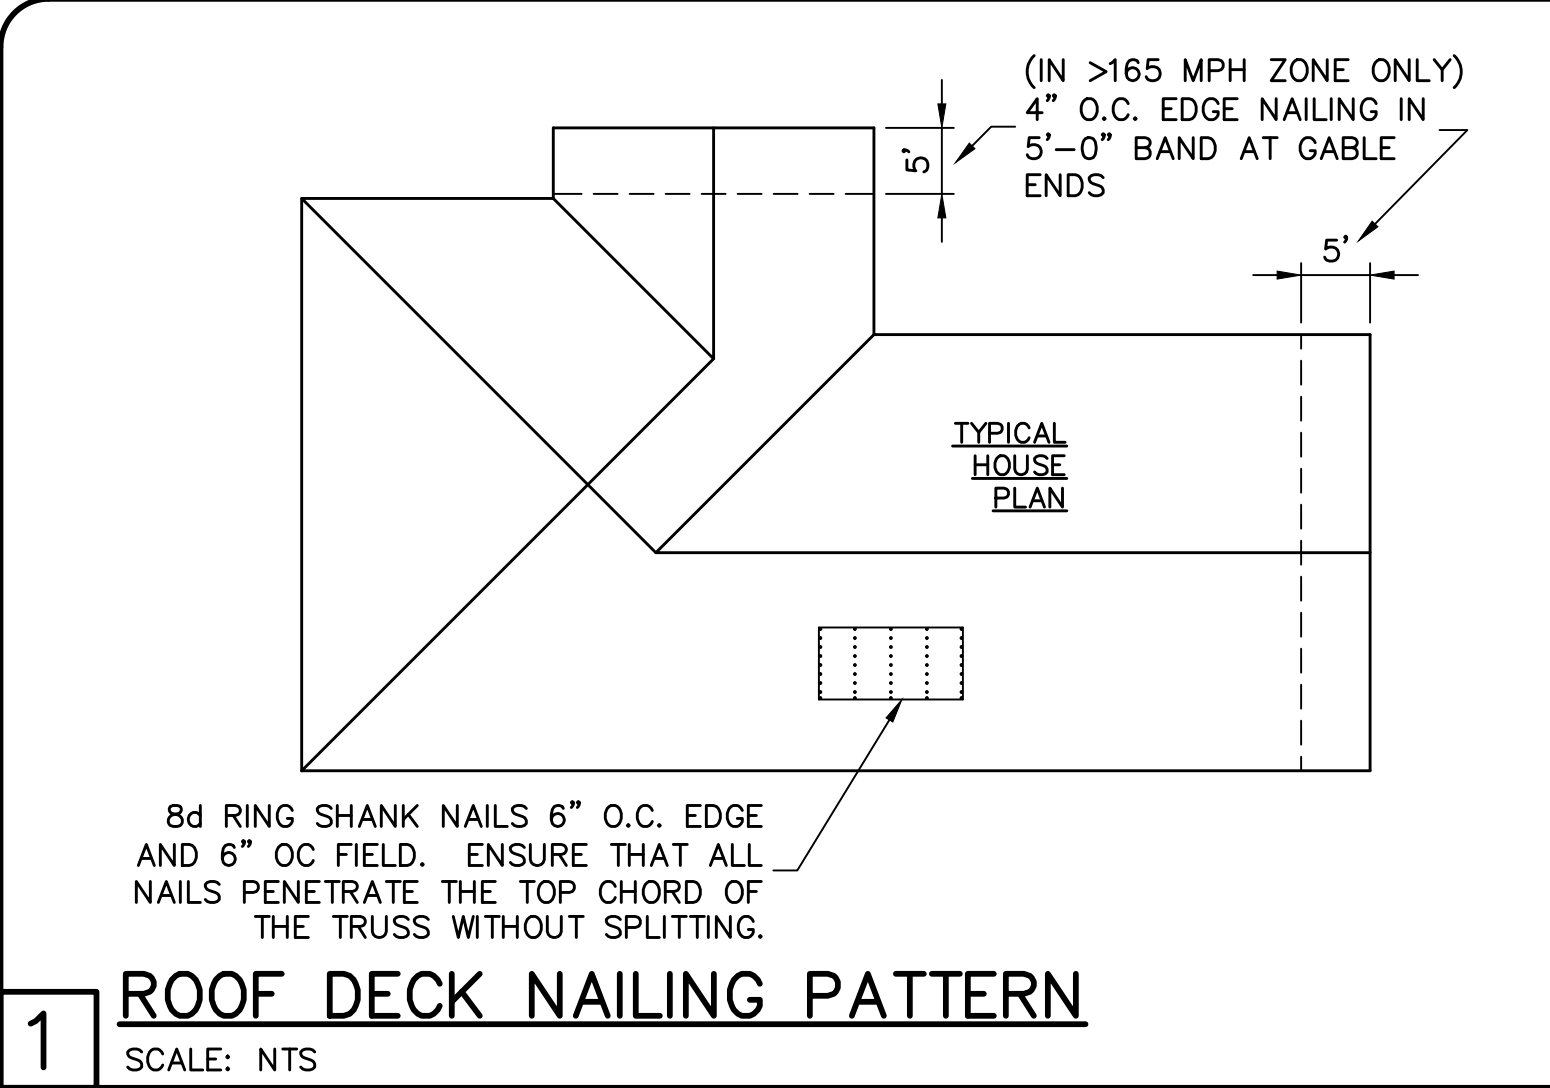

RETROFIT STRAPS TO CONCRETE/MASONRY			
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR		
TO 840	1-MTSM16 or 20	7-10dx1 1/2"	4-1/4"x2 1/4" TITEN
TO 1045	1-HTSM16 or 20	8-10dx1 1/2"	4-1/4"x2 1/4" TITEN
TO 2090	2-HTSM16 or 20	8-10dx1 1/2"	4-1/4"x2 1/4" TITEN
TO 4300	2-LGT2	16-16d, 7-1/4"x2 1/4"	TITEN
TO 3480	HTT16	18-16d, 7/8"Ø ALLTHREAD, DRILL & EPOXY 10" EMBED W/ SIMPSON SET.	
TO 10530	HGT-2/3	TWO 3/4"Ø ALTHREAD, DRILL & EPOXY 12" EMBED WITH SIMPSON SET.	







NOTES:  
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.  
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

**10** **RETROFIT UPLIFT CONNECTOR SCHEDULE**

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD.  (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED)  (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 3/8" EXTERIOR GYPBOARD CEILING, FASTEN W/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED W/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.

NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

**2**

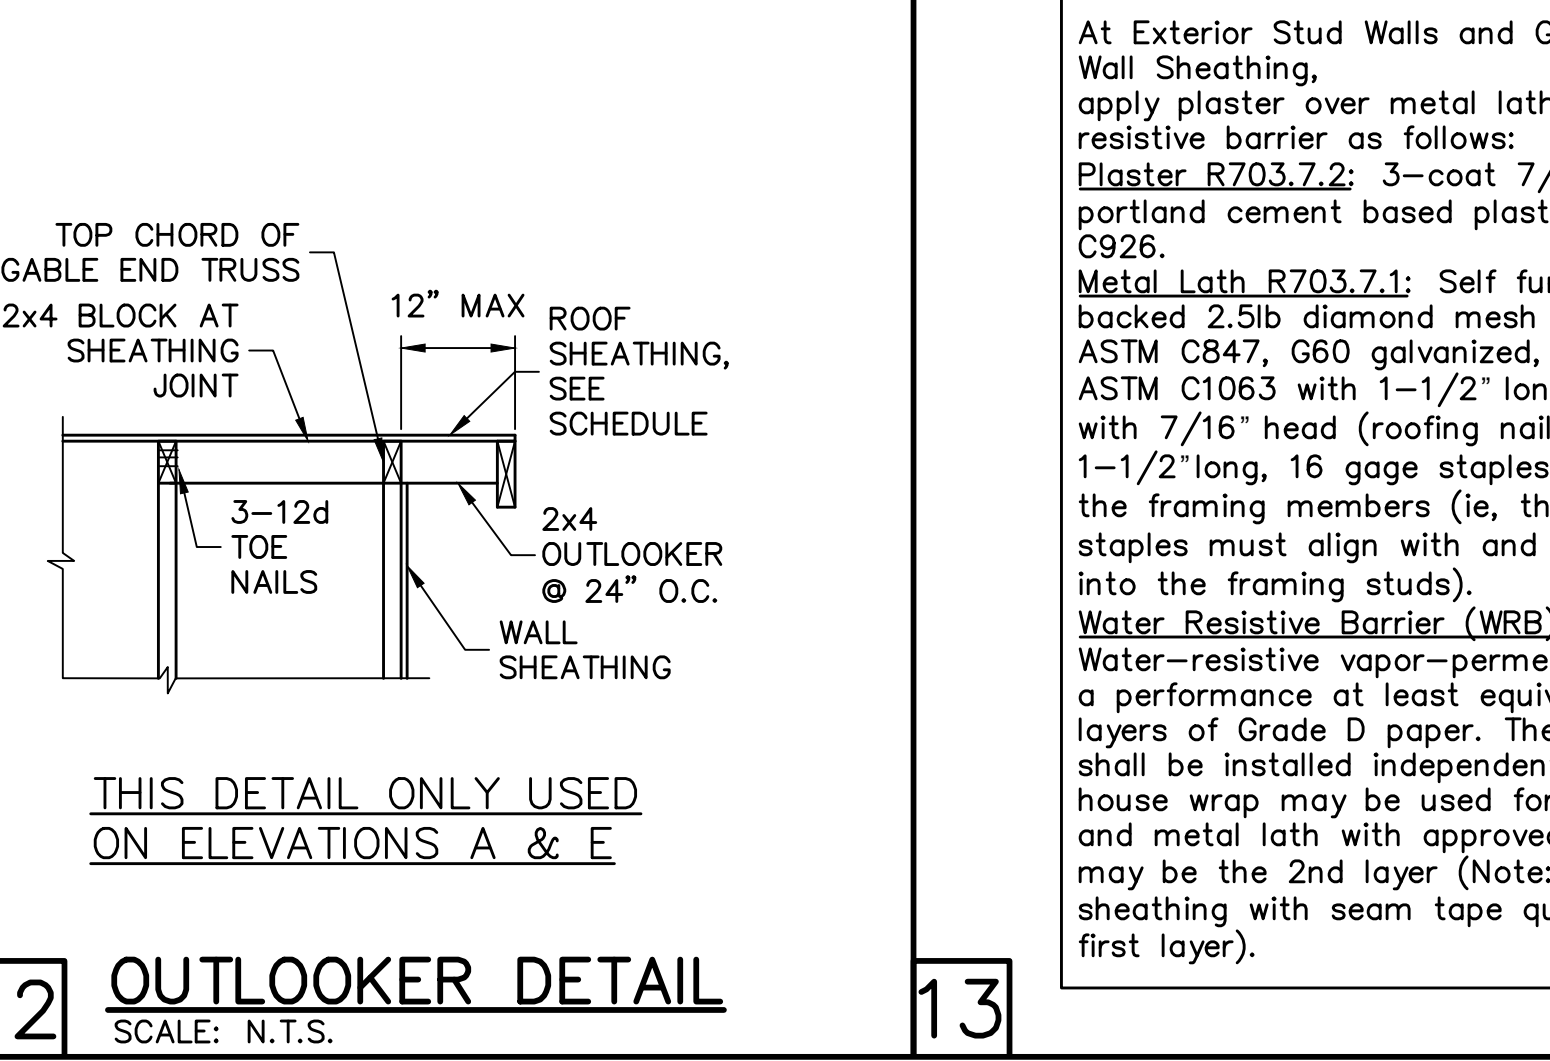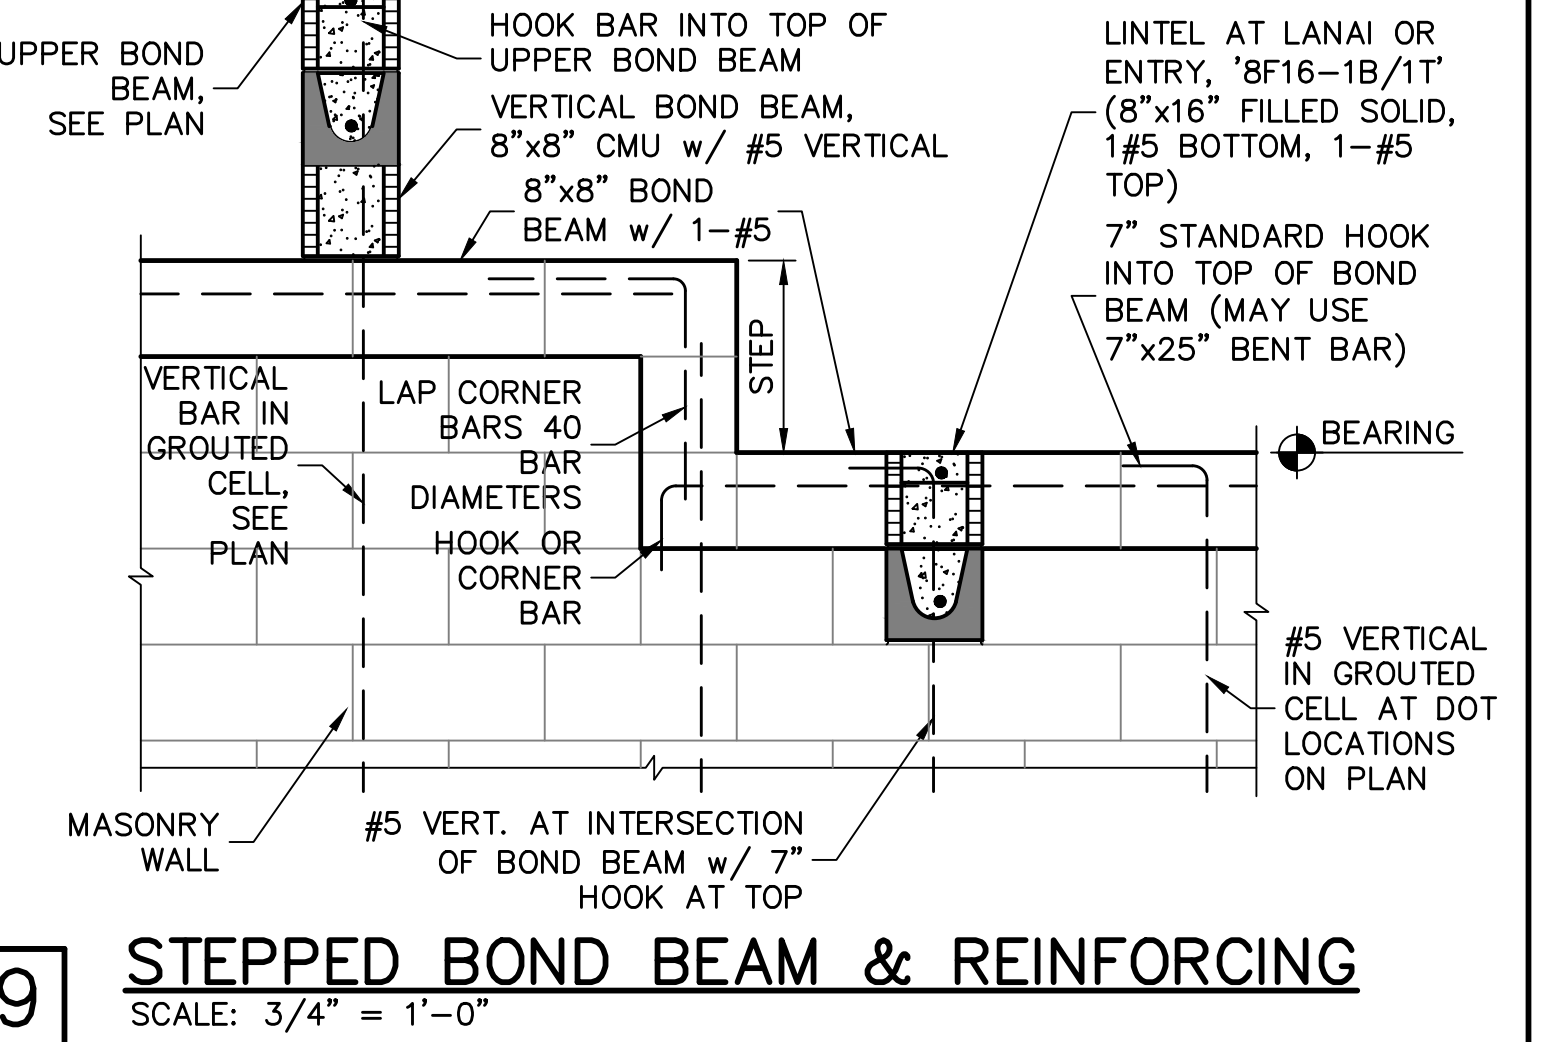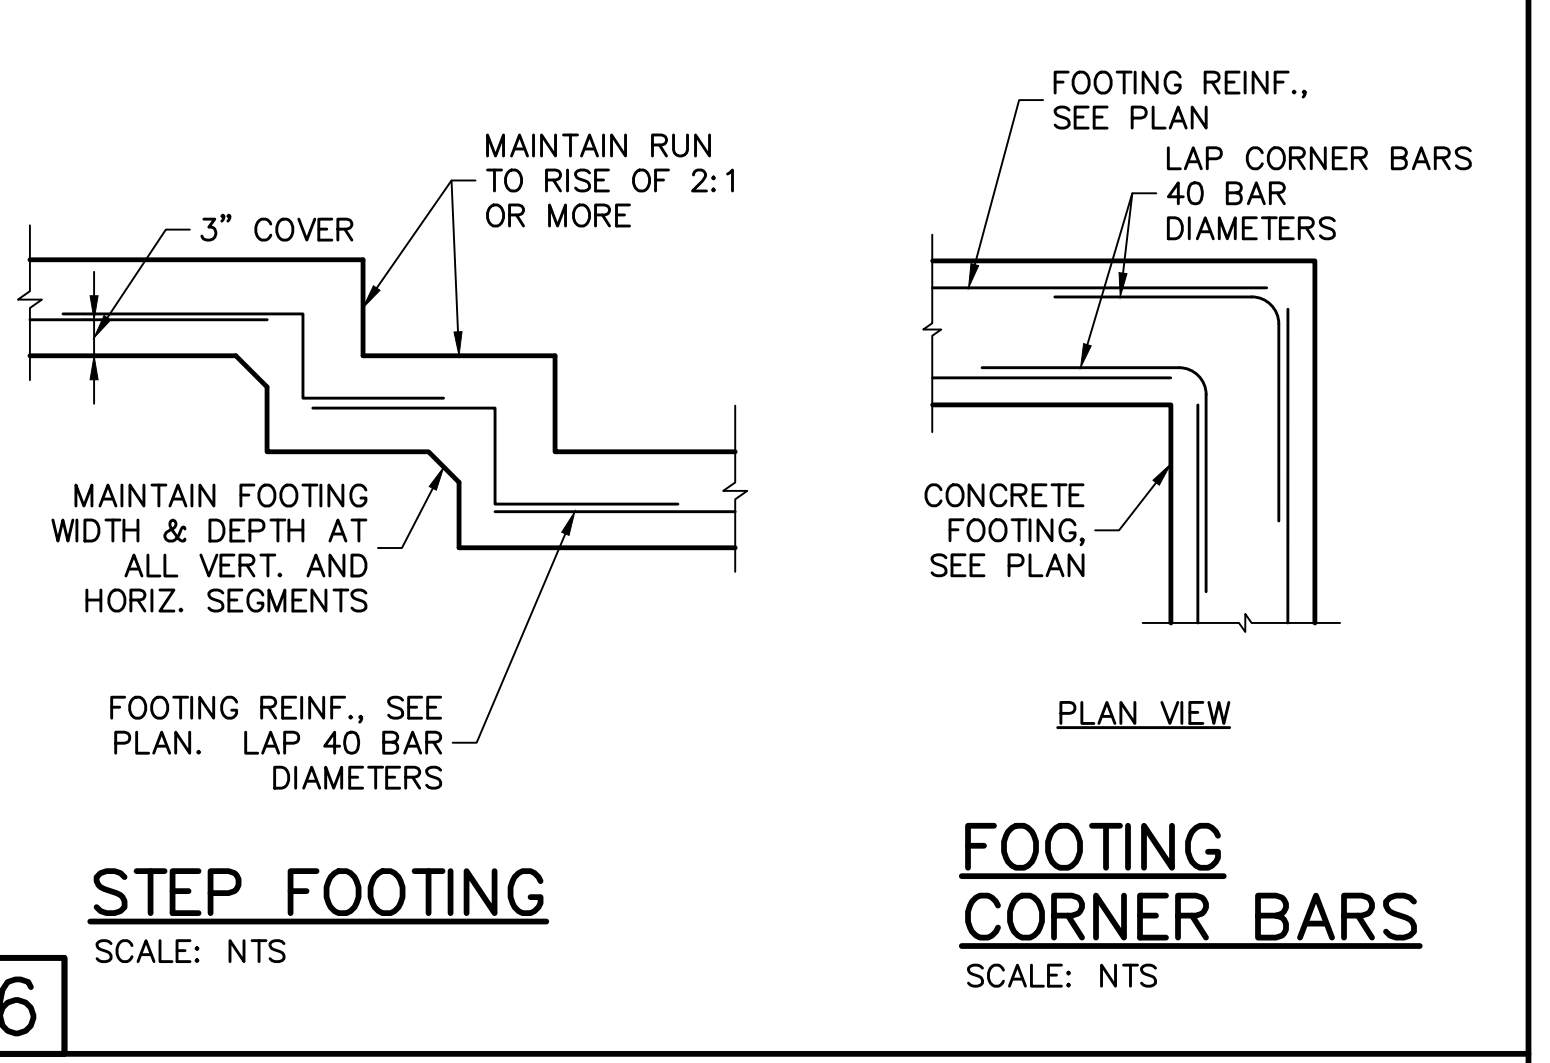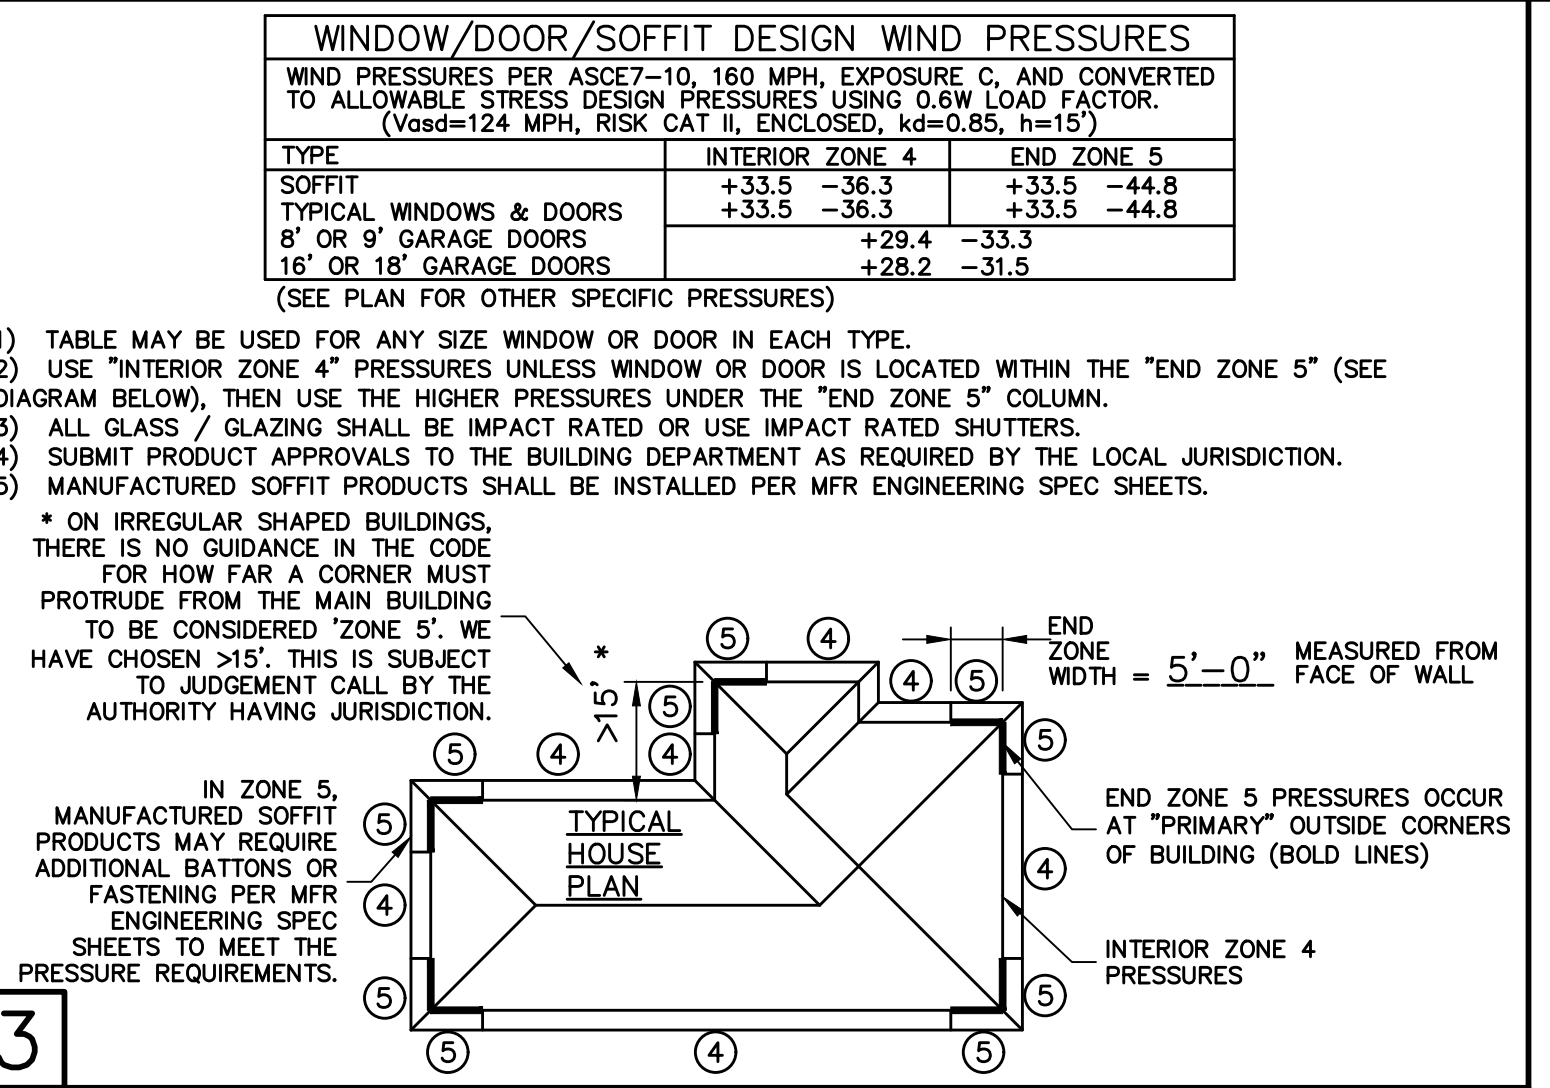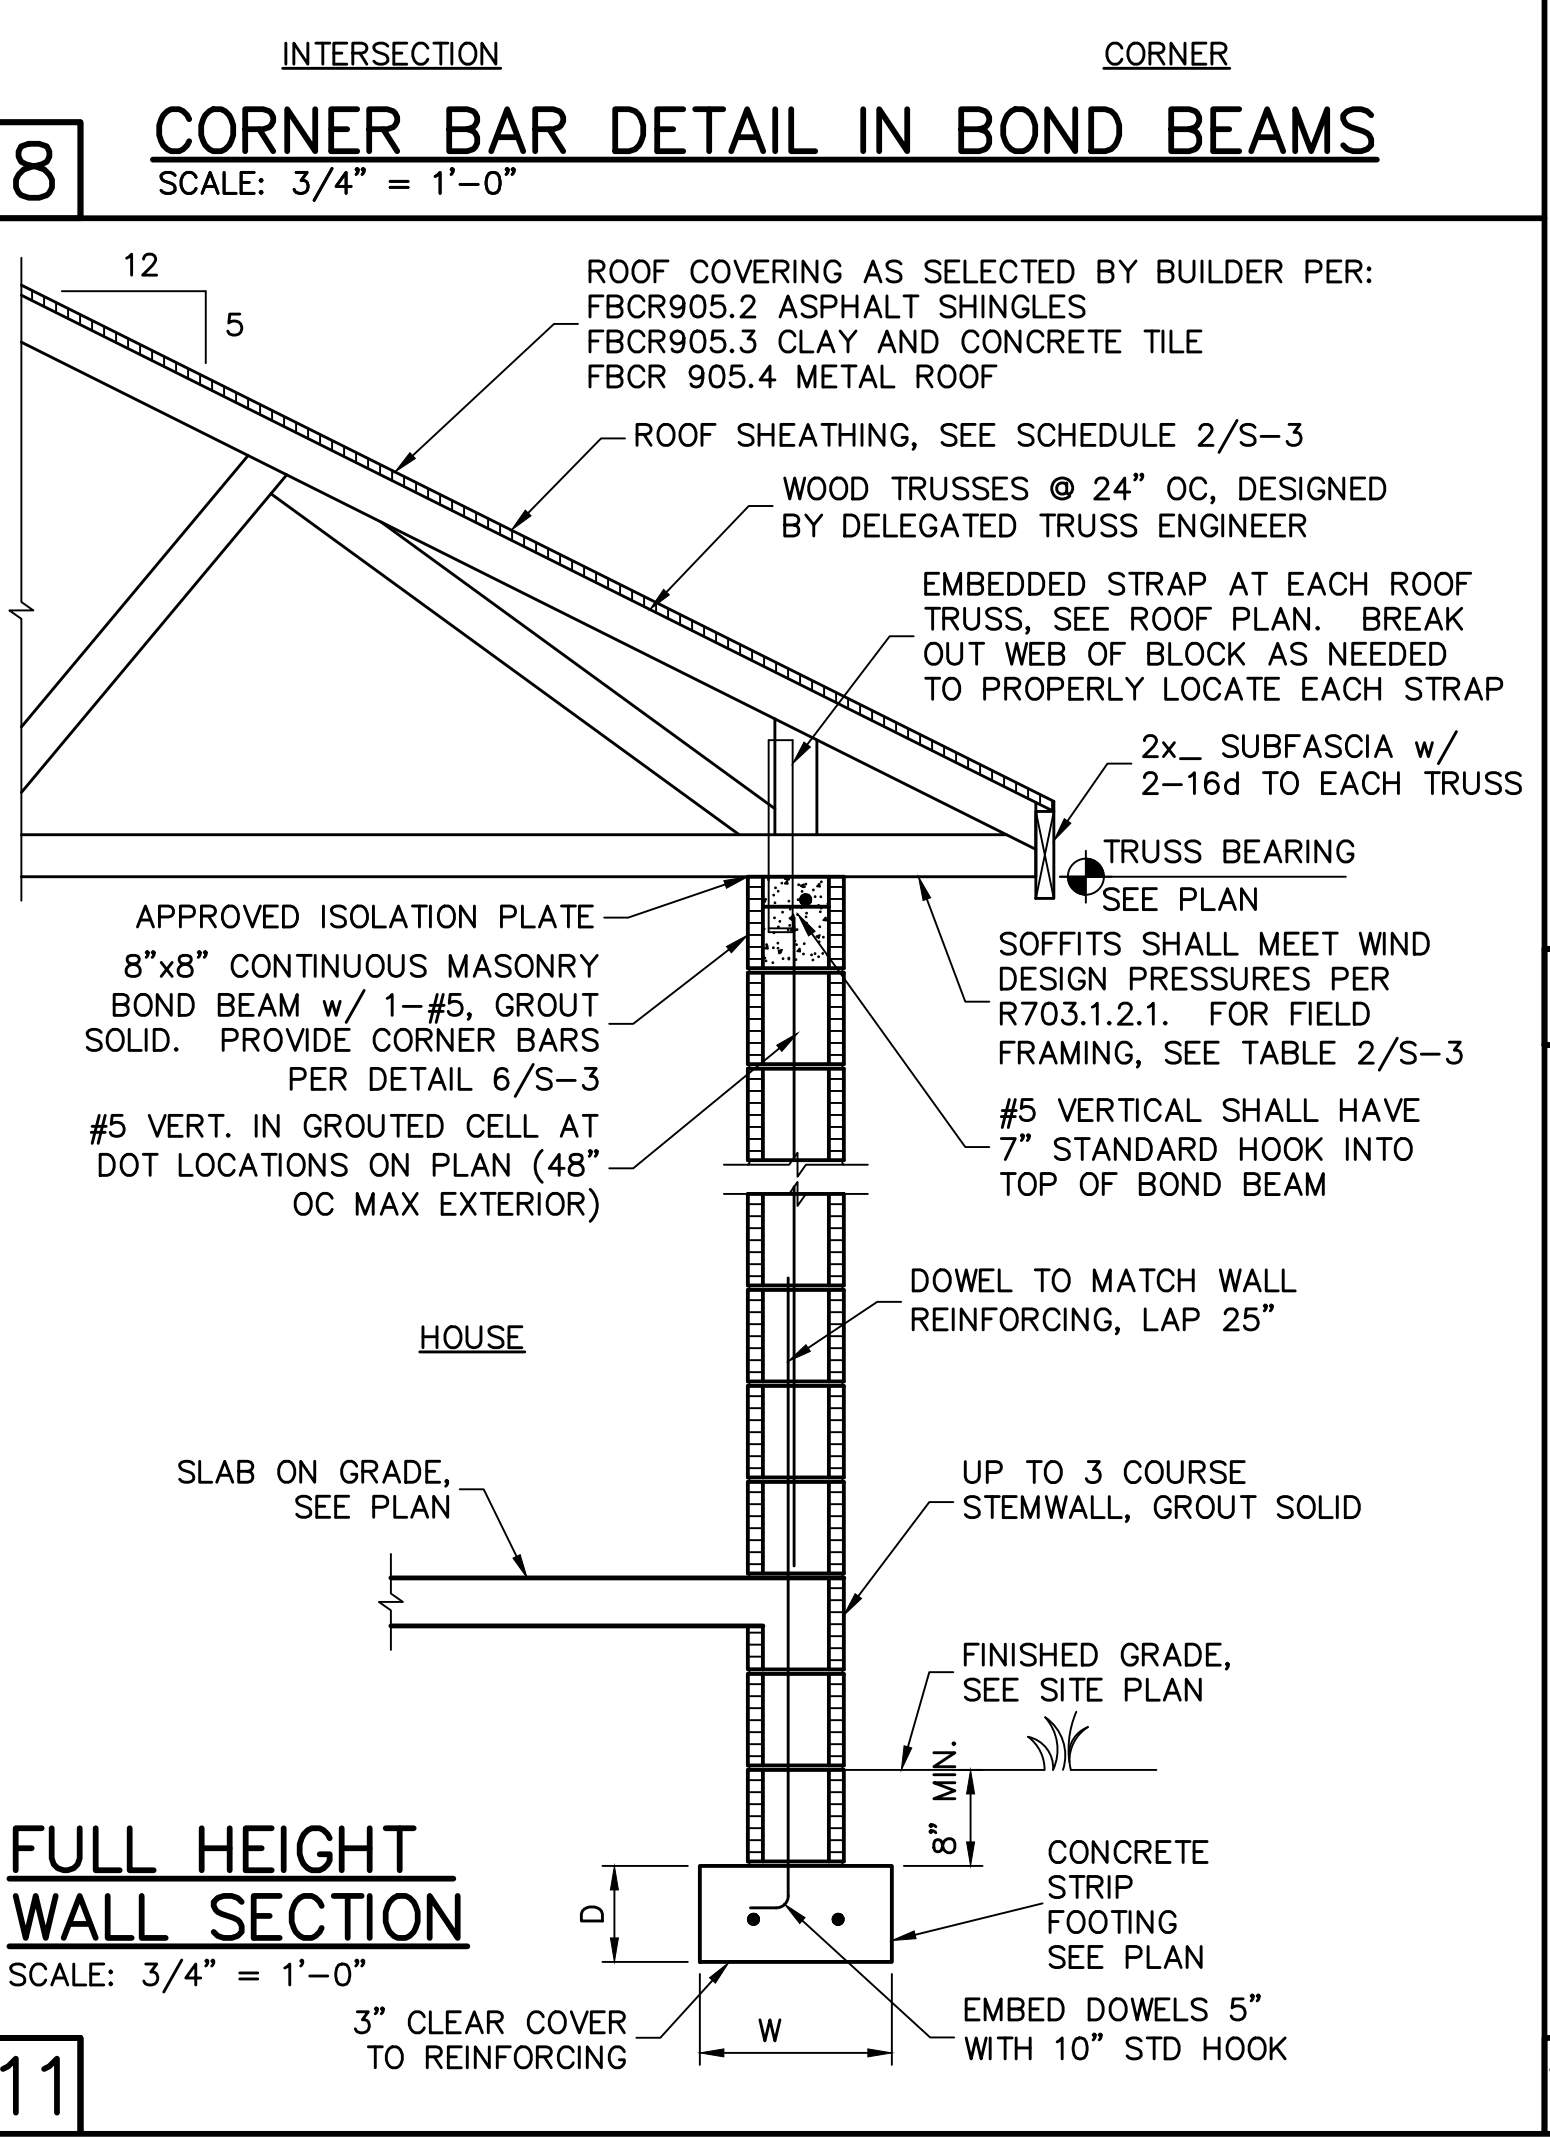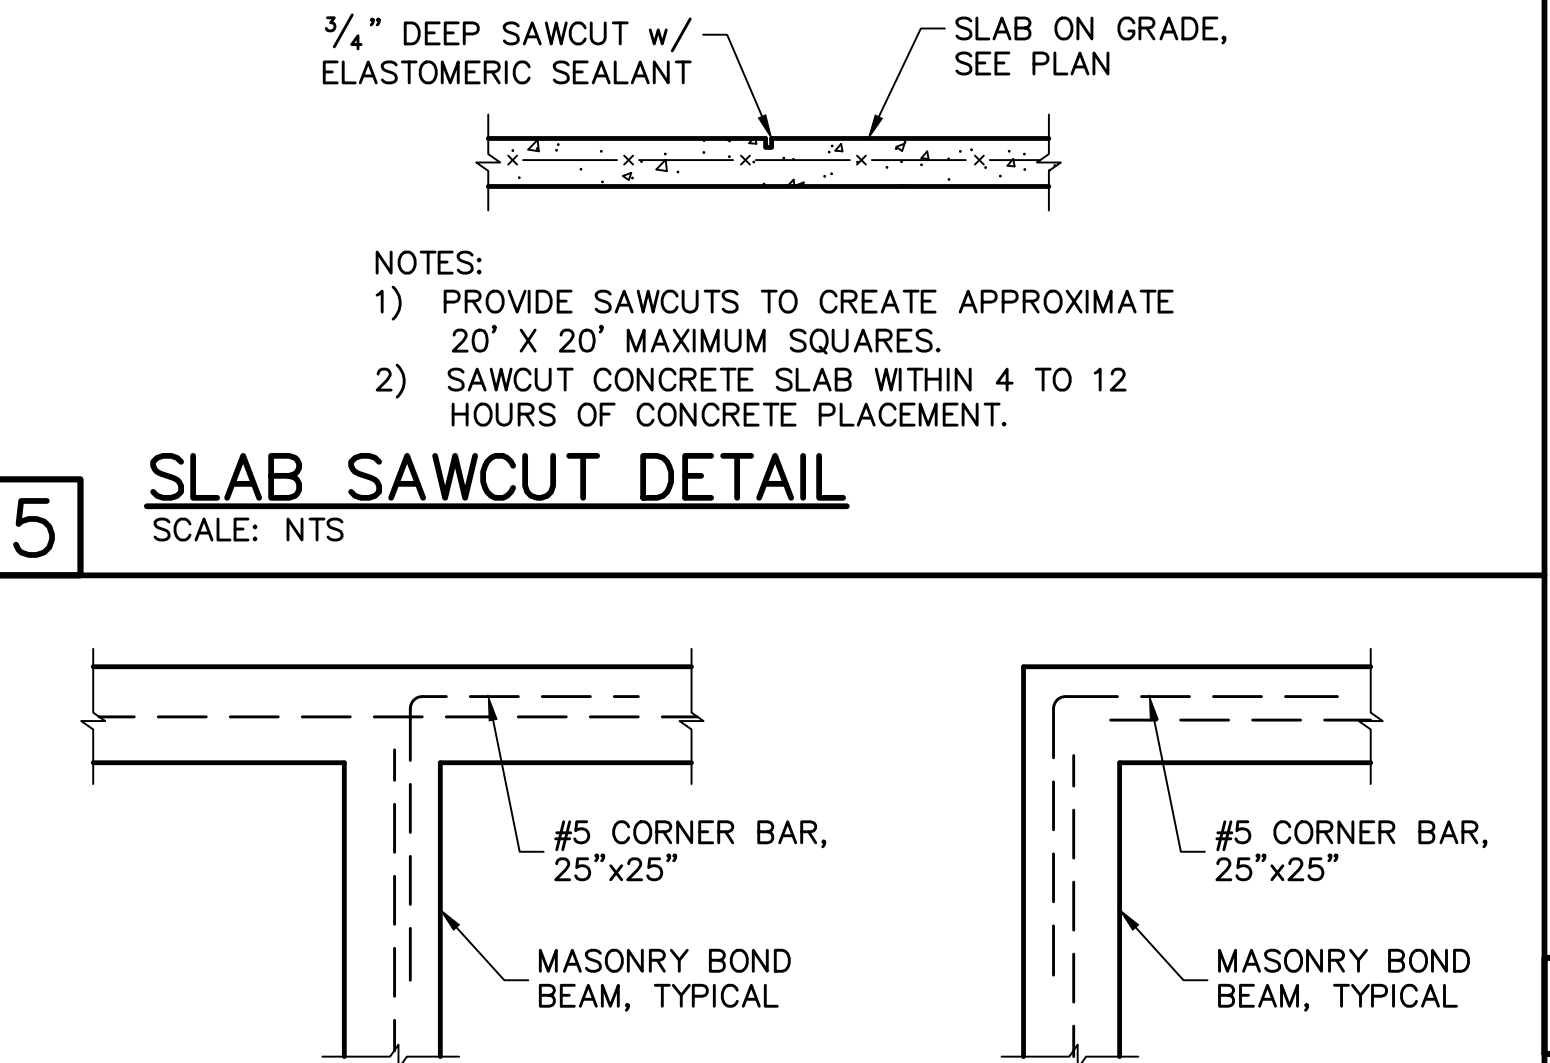

- DESIGN CRITERIA:
- DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL
- FLOOR & ROOF UNIFORM LOADS:  
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF  
ROOF: LIVE TOP CHORD 20 PSF  
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TOLL)  
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL  
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL  
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF  
DEFLECTION CRITERIA:  
FLOOR L/480 LIVE, L/360 TOTAL  
ROOF L/240 LIVE, L/180 TOTAL
  - WIND LOADS:  
WIND DESIGN PER, ASCE7-10  
BASIC WIND SPEED (ASCE7-10) 160 MPH  
NOMINAL WIND SPEED (Vg=124 MPH) 124 MPH  
BUILDING CATEGORY II  
IMPORTANCE FACTOR 1.00  
EXPOSURE C  
MEAN ROOF HEIGHT = 15 FT  
ROOF PITCH 5/12  
ENCLOSURE CLASS C  
INTERNAL PRES. COEFF. +/- 0.18  
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.  
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS.
  - REINFORCED CONCRETE:  
DESIGN AS PER ACI 318-14  
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:  
SLAB ON GRADE f'c = 2500 PSI  
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWR OR FIBERESH.  
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI  
BEAMS AND COLUMNS f'c = 3000 PSI  
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI  
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:  
FOOTINGS 3" CENTERED  
SLAB ON GRADE 1 1/2"  
BEAMS 1 1/2"  
COLUMNS 1 1/2"  
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.  
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3  
GRADE 60 FOR #4 TO #11  
  
WELDED WIRE FABRIC - ASTM A185  
  
SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.  
  
FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.
  - REINFORCED MASONRY:  
DESIGN PER ACI 530-13  
REQUIRED COMPRESSIVE STRENGTHS:  
MASONRY WALLS f'm = 1500 PSI  
  
REINFORCING STEEL - ASTM A615 GRADE 60.  
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.  
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE 'S' MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.
  - DELEGATED-ENGINEERED WOOD ROOF TRUSSES:  
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY" AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.
  - FOUNDATION:  
CONVENTIONAL SHALLOW CONCRETE FOOTINGS  
SOIL BEARING CAPACITY 2000 PSF  
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY.  
IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.
  - DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.
  - MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
  - SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

REVISIONS	BY

STRUCTURAL ENGINEERING:  
**STRUCTURAL SYSTEMS OF NORTH FLORIDA**  
1634 S.E. 47th STREET, SUITE #3  
CAPE CORAL, FL 33904  
(239) 549-4554  
CA# 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

PROFESSIONAL ENGINEER  
No. 88925  
STATE OF FLORIDA  
LAW REVISIONS


**D.R. HOHON**  
*America's Builder*

**STRUCTURAL DETAILS  
MODEL 2197 A**  
9581 ATTICA CIRCLE  
PORT CHARLOTTE, FLORIDA  
LOT: 12 BLOCK: 4508 SUBDIVISION: SOUTH GULF COVE


DESIGN/DRAWN  
DWB/GH  
CHECKED  
DWB  
DATE  
09/24/20  
SCALE  
VARIES  
JOB NO.  
DR 11773  
SHEET  
**S-3**  
SHEET 3 OF 4

FOR SCOSTA TRUSSES; ELEVATION A & E, JOB # 44134, DATED: 08/13/18, REVISED: 02/11/20



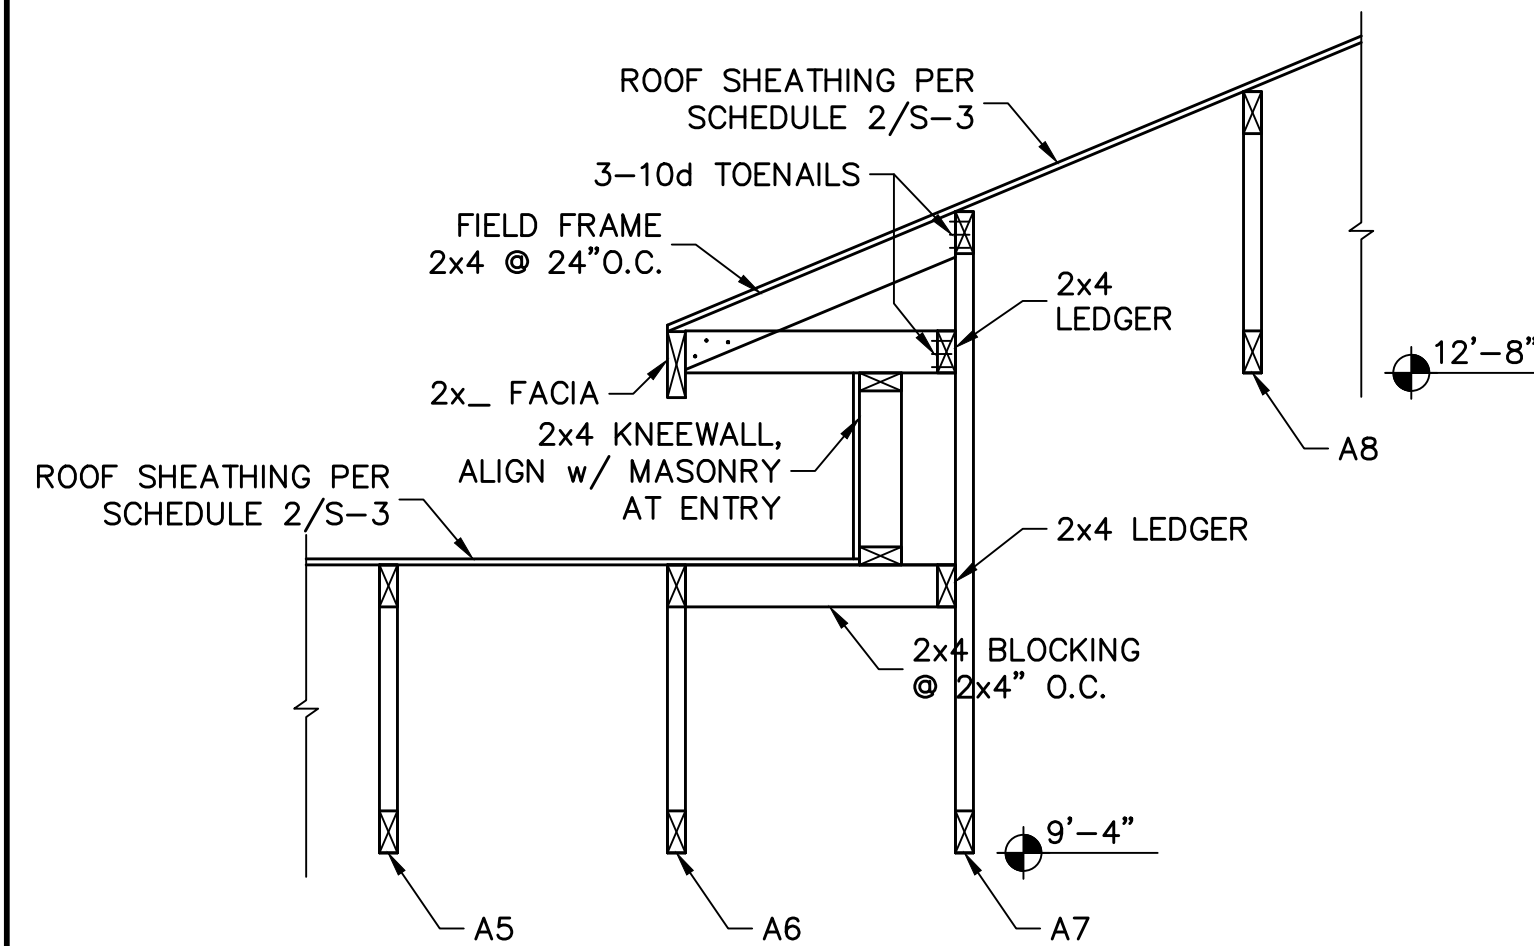

# 1 EAVE DETAIL w/ FALSE KNEEWALL

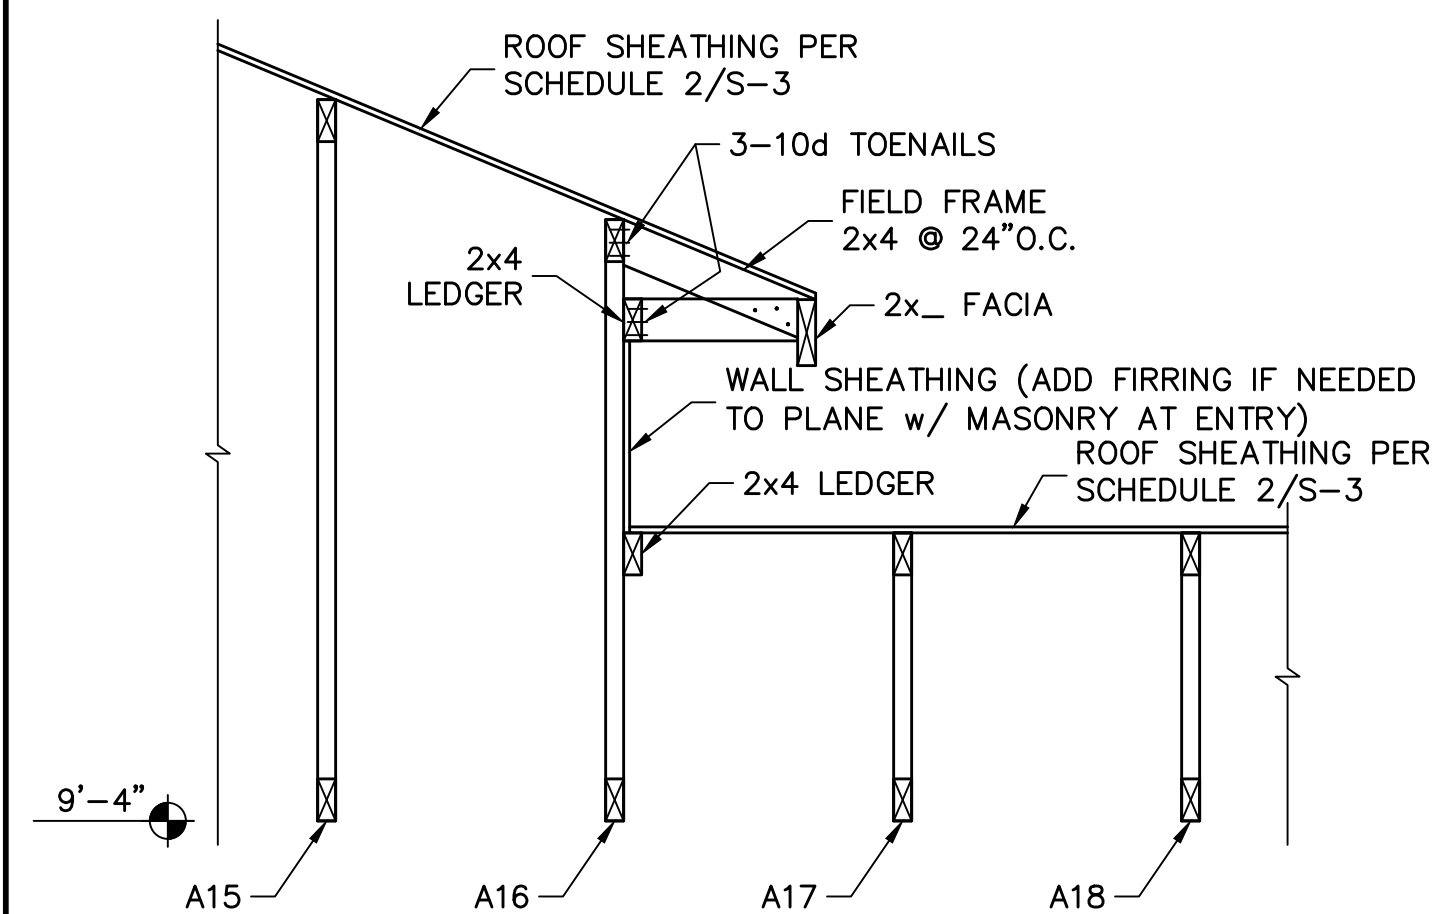


**2** EAVE DETAIL  
SCALE: 3/4" = 1'-0"

FOR SCOSTA TRUSSES, ELEVATION A & E, JOB # 44134, DATED: 08/13/18, REVISED: 02/11/20

[illegible]

STRUCTURAL ENGINEERING:  
**STRUCTURAL  
SYSTEMS**  
OF NORTH FLORIDA  
1634 S.E. 47TH STREET, SUITE #3  
CAPE CORAL, FL 33904  
(239) 549-4554  
CA# 8829

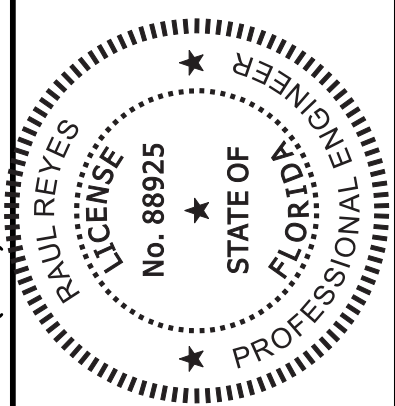

BUILDER:

BUILDER:

---

**D·R·HORTON** · PHI  
NSI

*America's Builder*

# STRUCTURAL DETAILS MODEL 2197 A

9581 ATLICA CIRCLE  
PORT CHARLOTTE, FLORIDA  
LOT: 12 BLOCK: 4508 SUBDIVISION: SOUTH GULF COVE

DESIGN/DRAWN DWB/GH
CHECKED DWB
DATE 09/24/20
SCALE VARIES
JOB NO. DR 11773
SHEET
S-4
SHEET 4 OF 4