
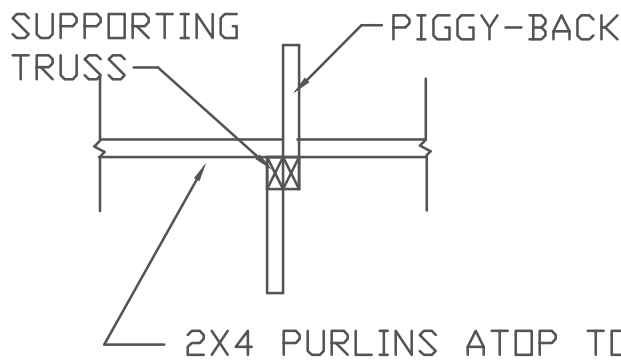
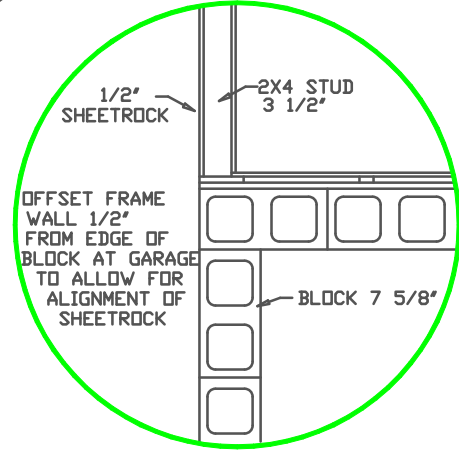
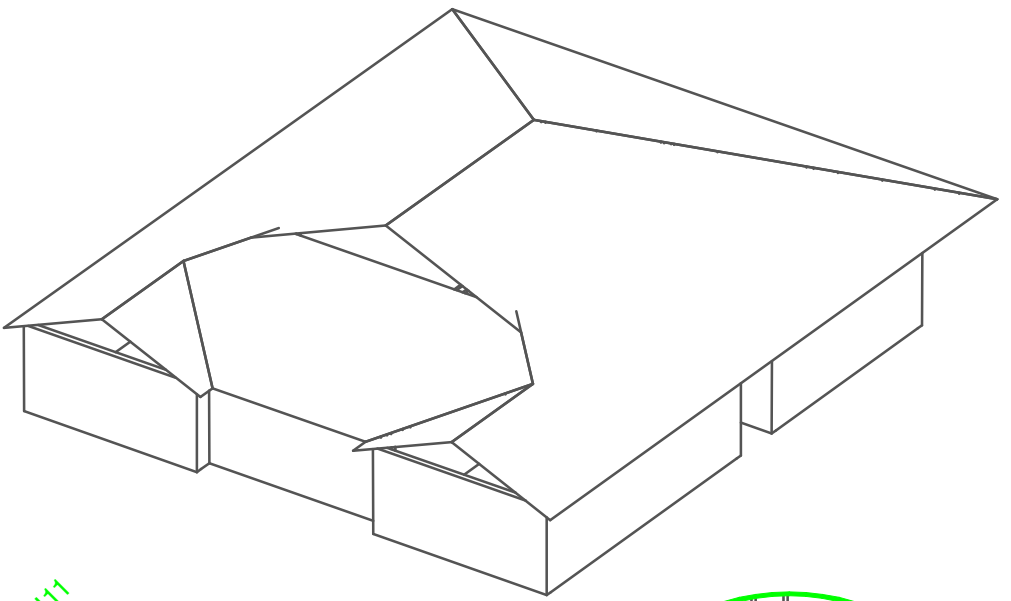


Engineer of Record for the Structure
Structural Systems of N. Fl, Inc.
Raul Reyes, PE 88925
1634 SE 47th Street #3
Cape Coral, FL 33904

This document has been reviewed for
conformance with the design intent of the
structure and specified design criteria.



☒ Accepted As-Is ☐ Accepted As Noted ☐ Revise and Resubmit

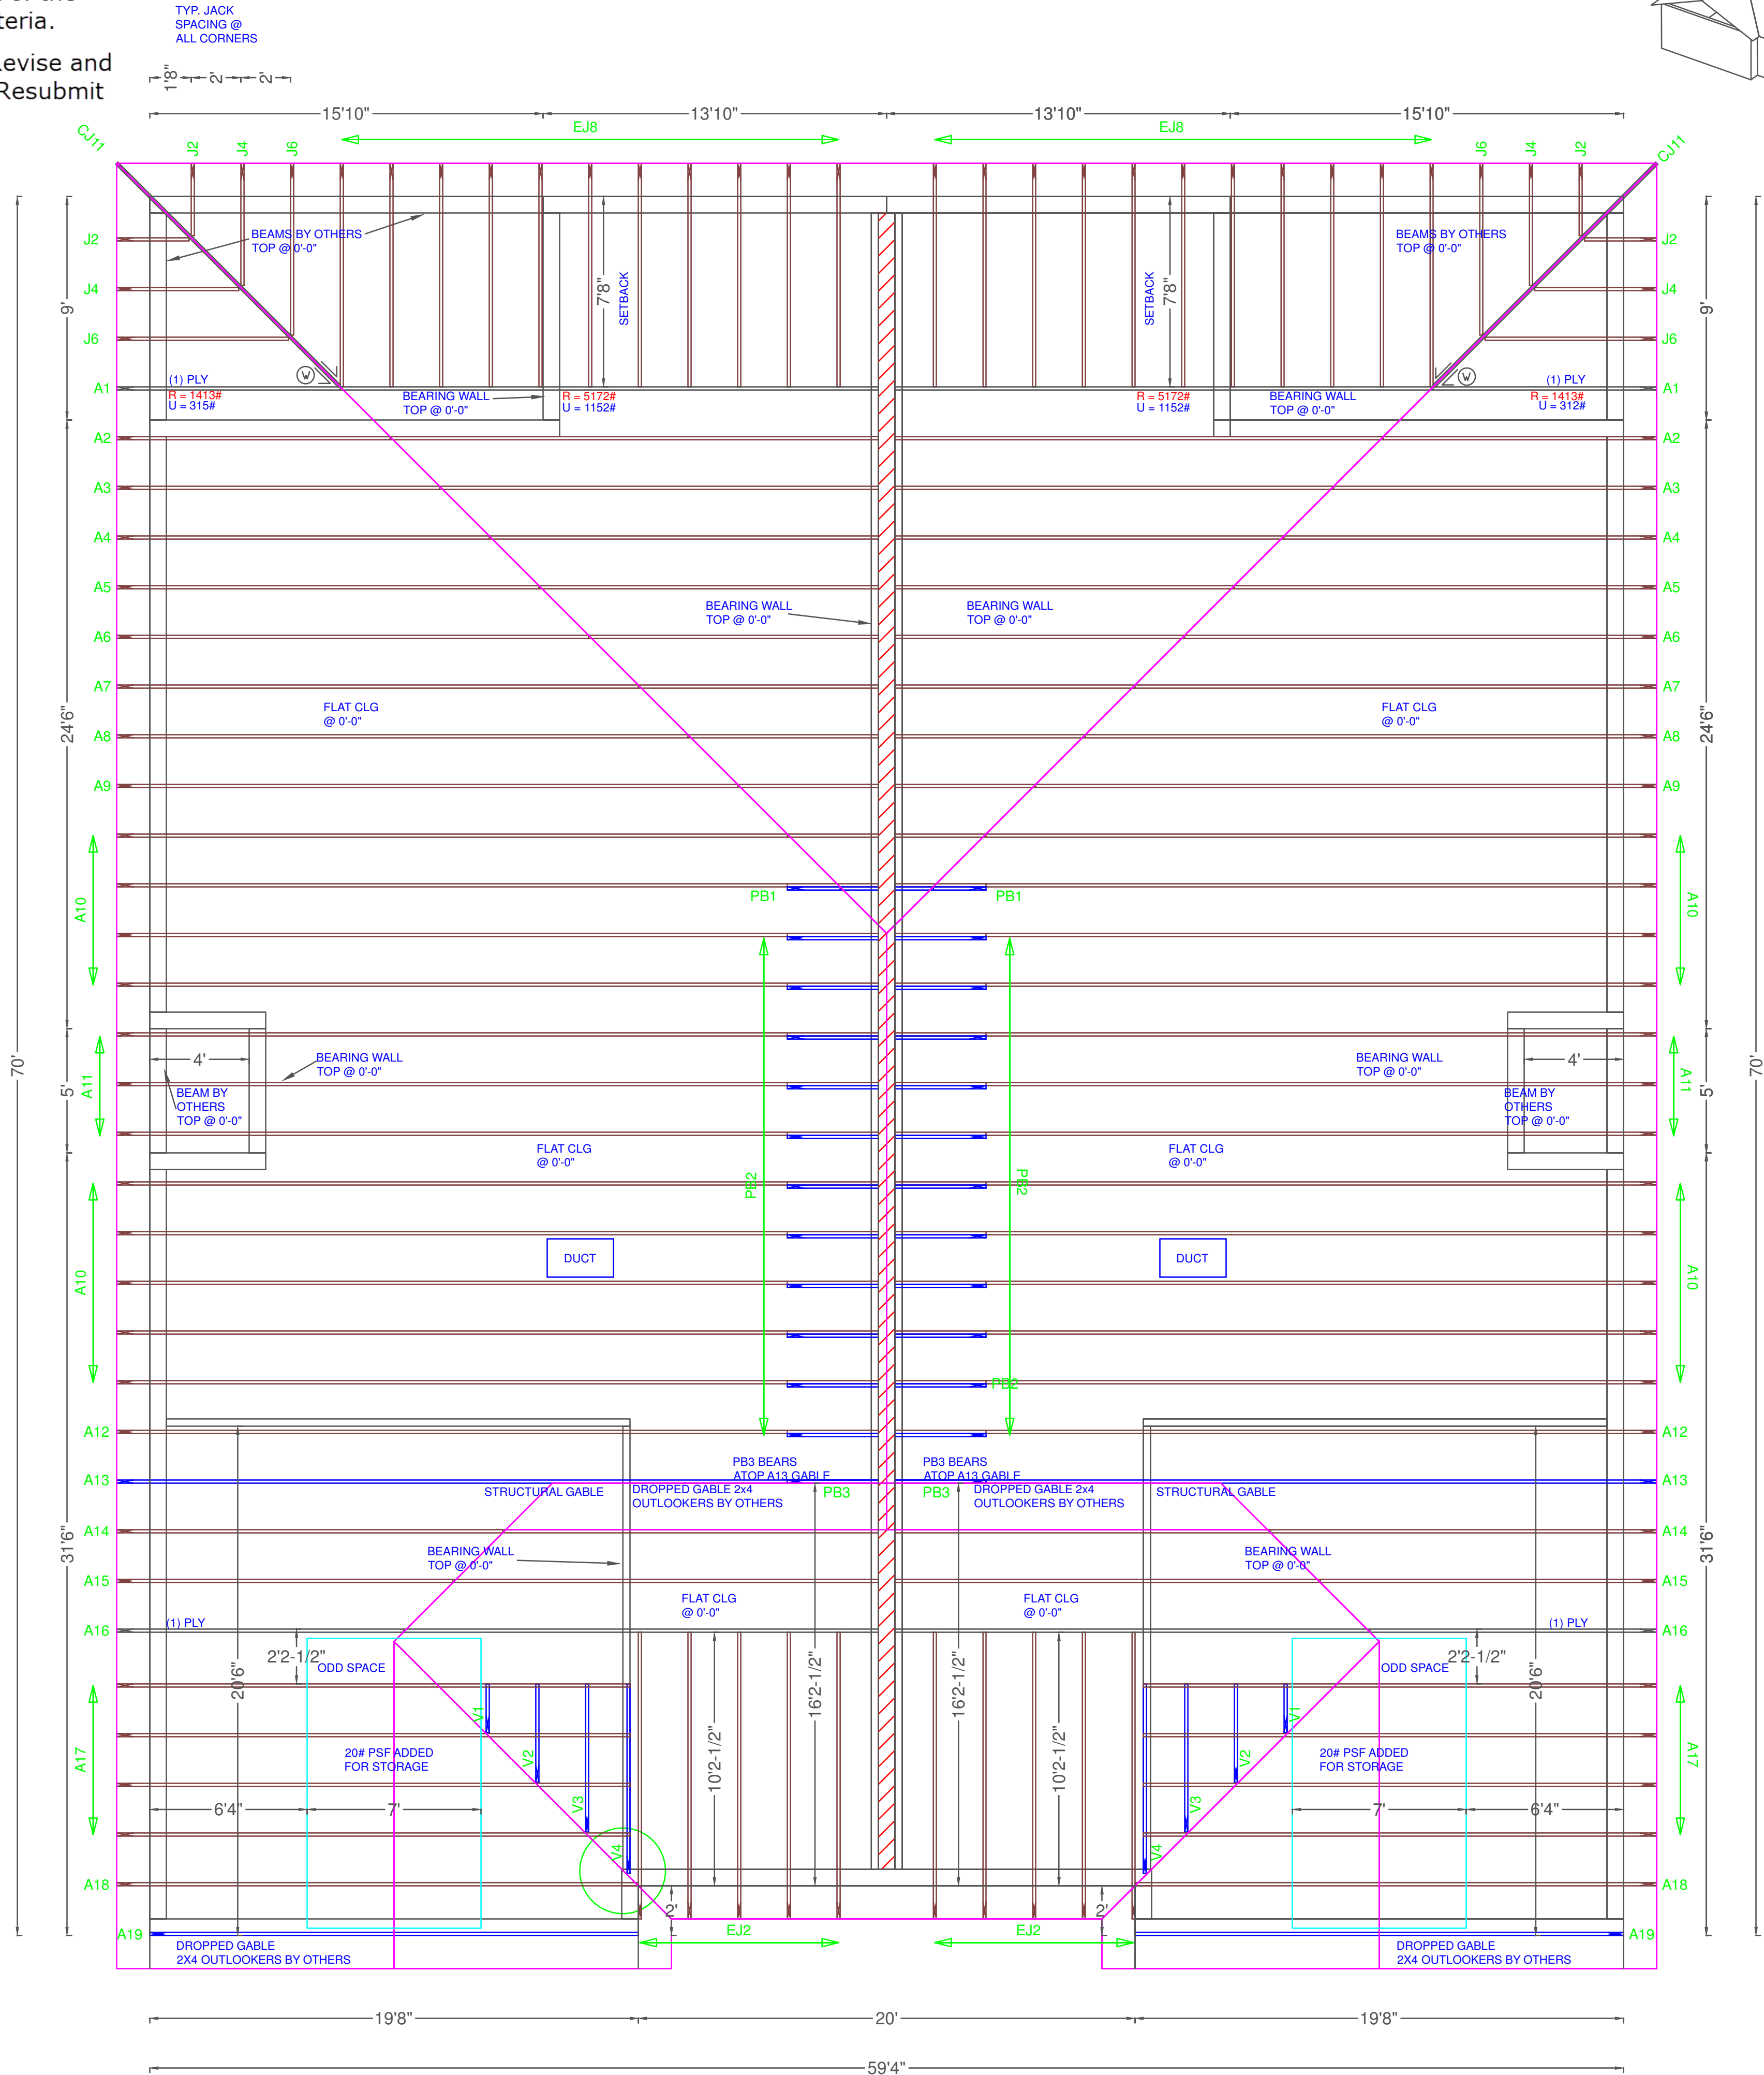

SEE SUPPORTING TRUSS & PIGGY-BACK
ENGINEERING FOR ADDITIONAL INFORMATION

SCAB PIGGY-BACK DETAIL

TYPICAL JACK CUTS

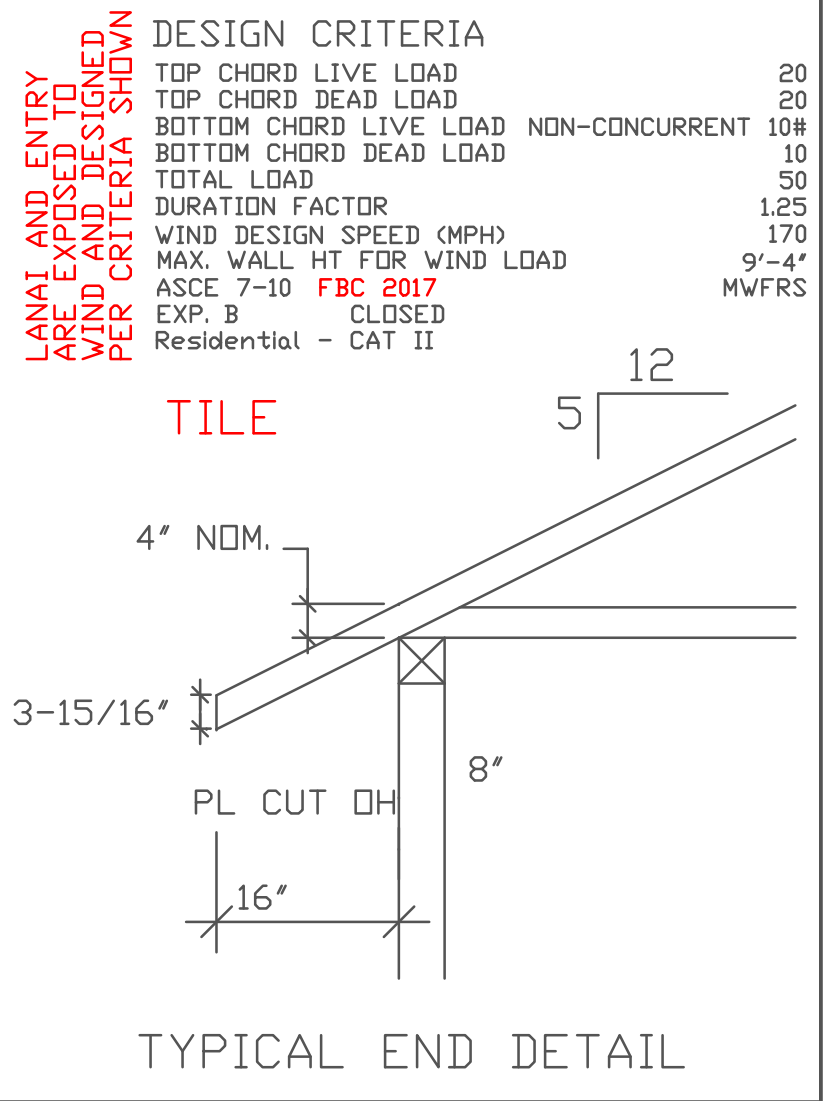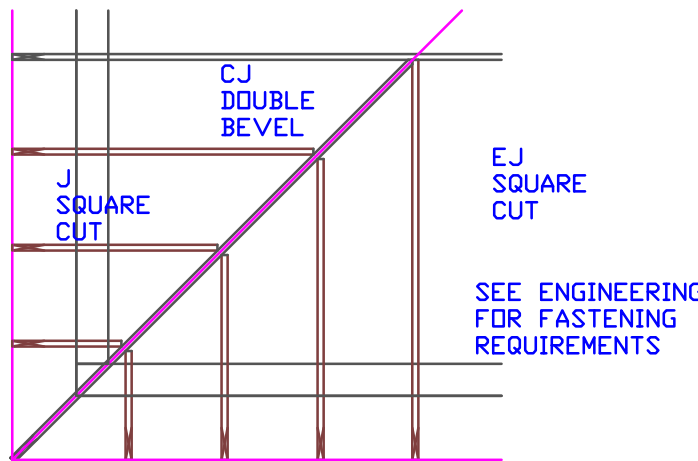

****UNLESS NOTED****
REACTION VALUES ARE UNDER 5000#
UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE
*******CAUTION*******
DO NOT ATTEMPT TO ERECT TRUSSES WITH-
OUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING
DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION,
ORIENTATION AND WEB BRACING
REFER TO VTCA/TPI BSCI-B1 SUMMARY
SHEET FOR HANDLING METHODS & TEMPORARY
BRACING, WHICH IS ALWAYS REQUIRED
BEARING HEIGHTS BASED ON PLANS PROVIDED TO
SCOSTA CORP. +/- BEARING DIFFERENCES SHOWN ARE
CRITICAL. IF ANY HEIGHTS DEVIATE - INFORM SCOSTA
CORP.

BEARING WALL & BEAM HEIGHTS

9'-4" A.F.F.	0'-0"	ELEV.
RAKED BEAM		ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.

TYPICAL HANGER SCHEDULE

(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 16D
COMMON NAILS EXCEPT THE FOLLOWING
LUS24 - 10D COMMON THJA26 - 10D x 1-1/2


*******ATTENTION*******

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY
BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS,
PITCHES, OVERHANGS, ELEVATIONS, CEILING &
BEARING CONDITIONS. SCOSTA CORPORATION IS
RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH
PLANS AND/OR INFORMATION PROVIDED BY
CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN.
CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF
INFORMATION AND PLANS PROVIDED TO SCOSTA
CORPORATION, AND TO VERIFY CONFORMANCE TO
FIELD CONDITIONS, AND/OR OWNER CHANGES.
TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE
APPROVED LAYOUT.

APPROVED BY: _____
DATE: _____ REQUESTED DELIVERY DATE: _____
JOBSITE CONTACT NAME: _____
PHONE #: _____
E-MAIL: _____




SCALE: 1/4"=1'-0"	DATE: 07/02/19	REVISED BY: 08/06/19 K.J.G.	DRAWN BY: J.CLEVELAND
JOB ADDRESS: 1503 F TWIN VILLA/COLLIER		1 OF 1	
CUSTOMER: D.R. HORTON		JOB #: 44060-N	

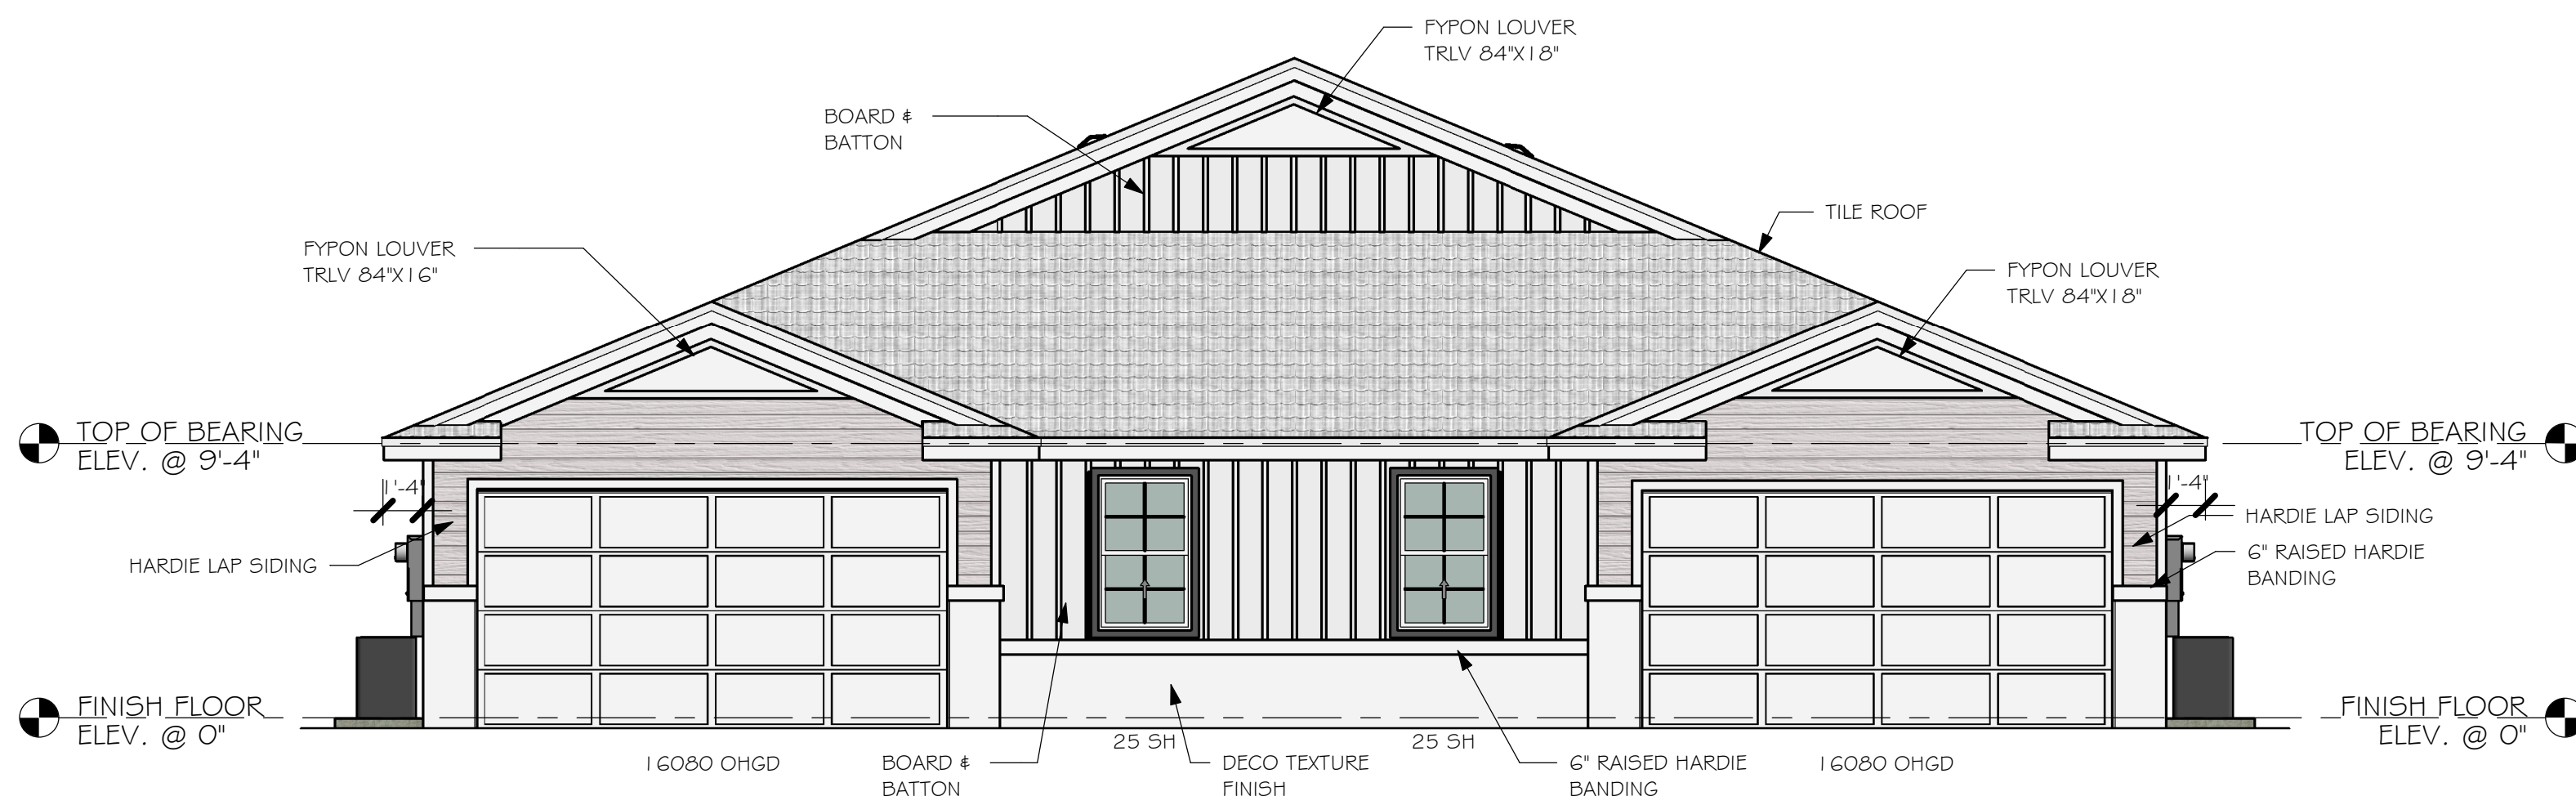

FRONT ELEVATION

3/16" = 1'-0"

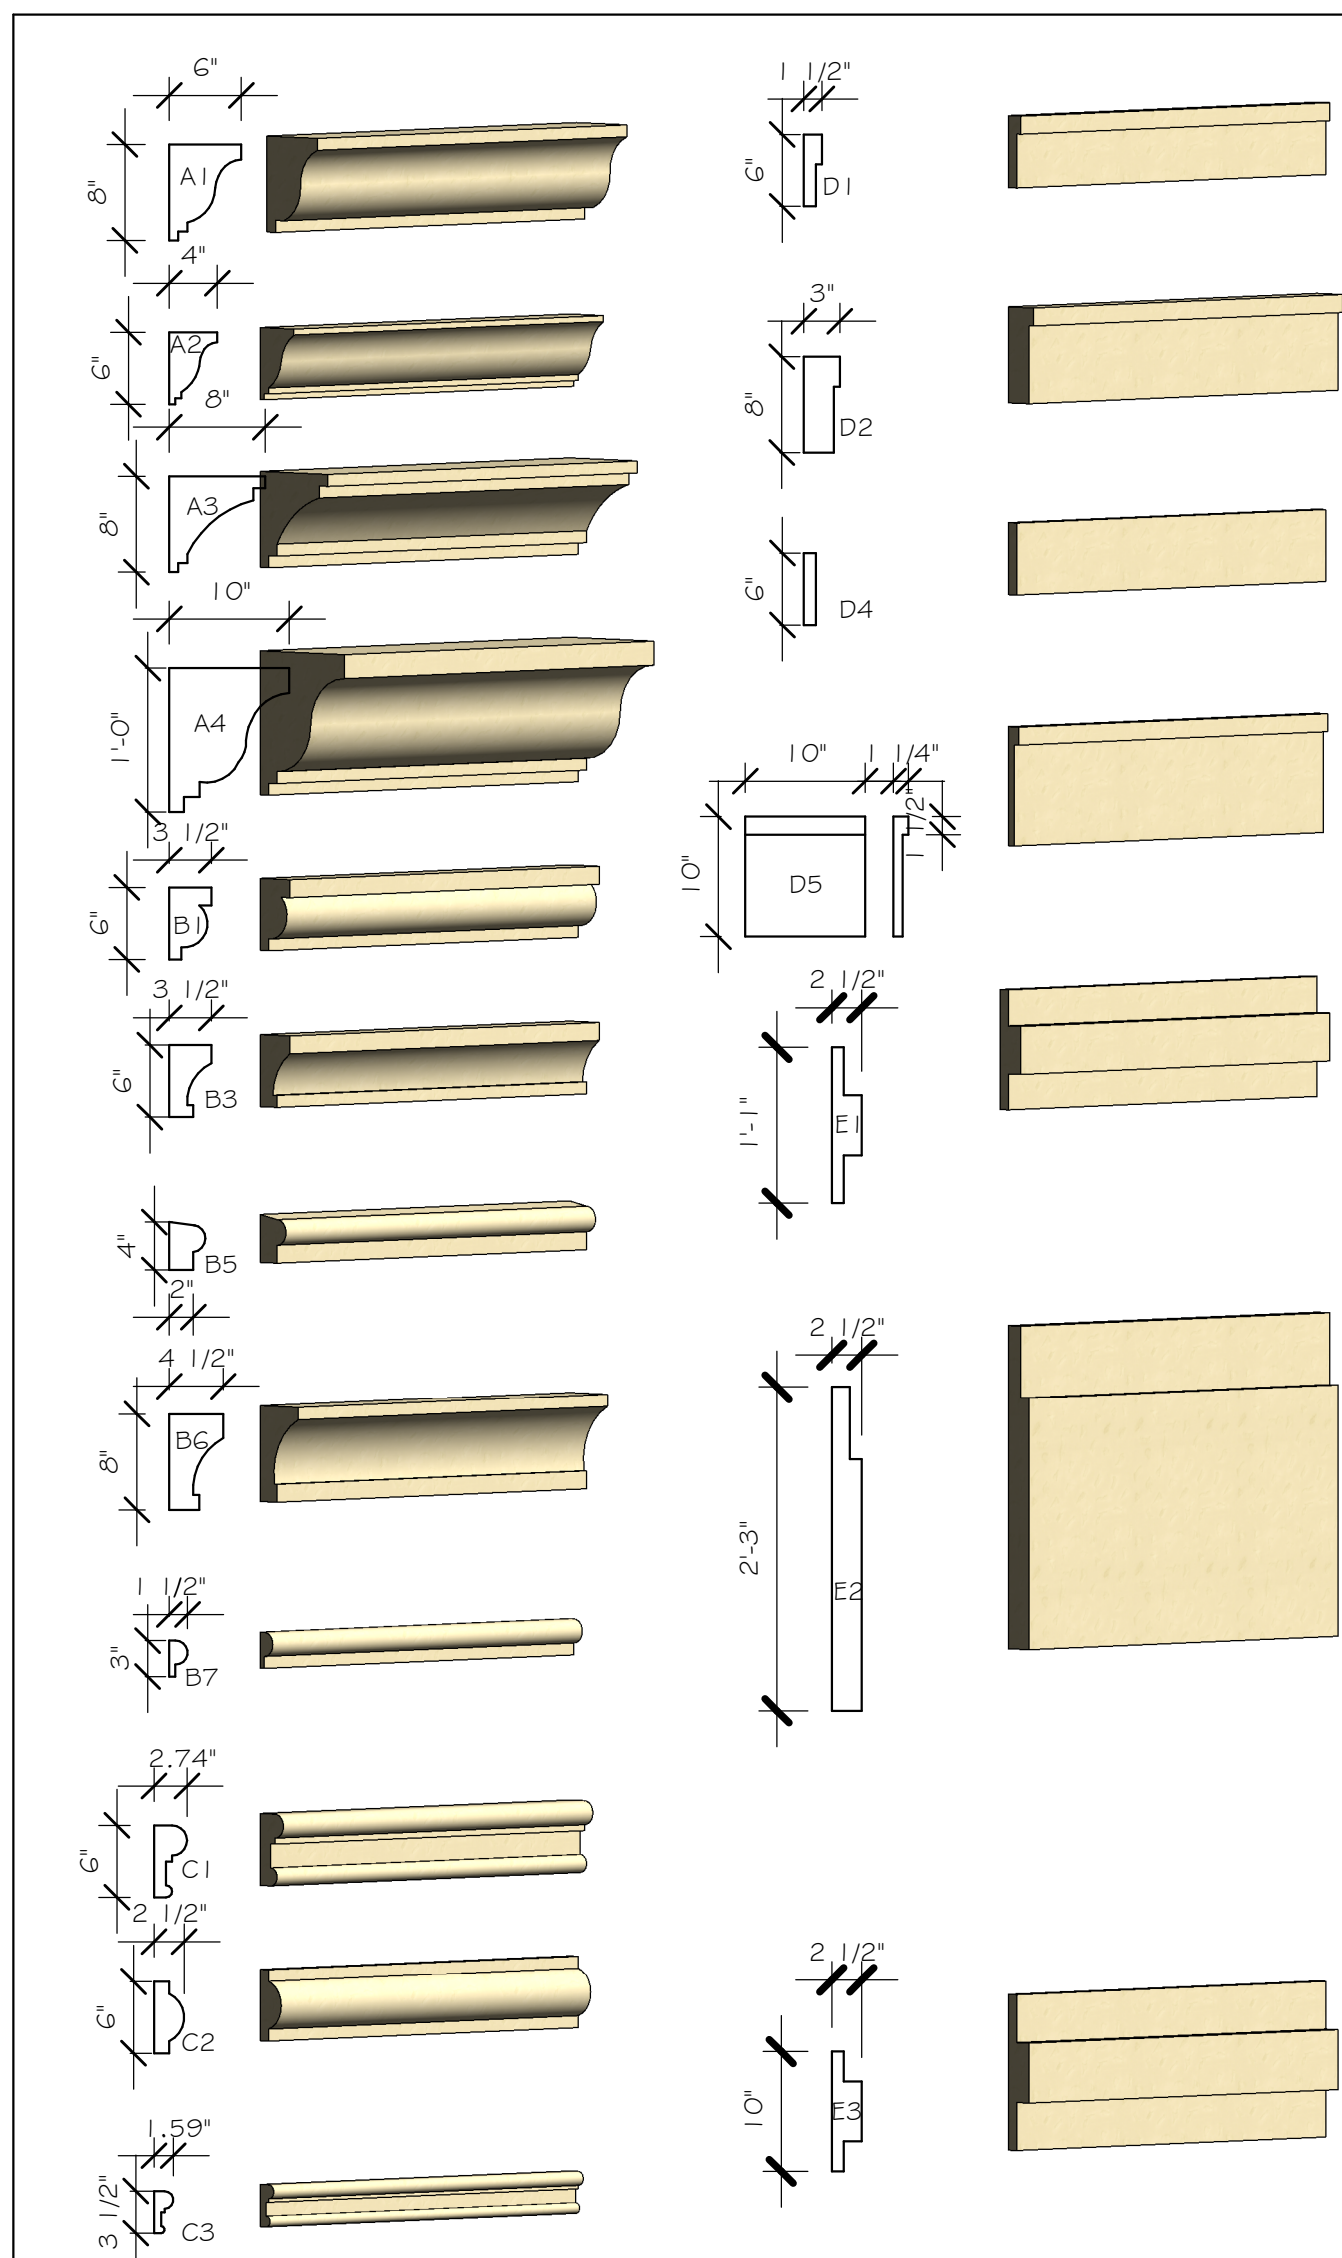

BANDING DETAILS

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

L:\O-New Data\1 - MASTER 2019\2019-BUILDERS\DR HORTON
2019\SUBDIVISIONS\ENBROOK\1820 LOT 7-B\1503 PREVIEW\1820 1503 F.dwg

DOOR SCHEDULE							
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY

1	1 6080 OHGD	GARAGE DOOR	8'-0"	16'-0"	+26.4/-29.4	+26.4/-29.4	2
2	2-4080 SL. GL. DR.	DISTINCTION	8'-0"	8'-0"	+27.6/-31.2	+27.6/-31.2	2
3	3080 ENTRY	DISTINCTION	8'-0"	3'-0"	+31.2/-33.0	+31.2/-41.0	2

GARAGE DOOR ASSUMES 2' IN ZONE 5.

WINDOW SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY

A	25 SH		5'-5"	3'-4"	+31.2/-33.0	+31.2/-41.0	4
B	2-25 SH		5'-3"	6'-4"	+31.2/-33.0	+31.2/-41.0	4

WIND PRESSURES PER ASCE7-10 170 MPH, EXPOSURE B AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. V_{asd}= 132 MPH

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

- PLAN NOTES
- 1)

VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
- 2)

PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
- 3)

PROVIDE SAFETY GLAZING AT BATH SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
- 4)

NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
- 5)

PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
- 6)

KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
- 7)

INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
- 8)

WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" 5/8" RESISTANT PER SEC. 702.3.5
- 9)

THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
- 10)

INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.
- 11)

ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE
- 12)

ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
- 13)

ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.




INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	
5	2'-0"	L.V. = LOUVERED DOOR
6	1'-8"	
7	1'-6"	
8	2'-11"	

SQUARE FOOTAGE UNIT #1	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

SQUARE FOOTAGE UNIT #2	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

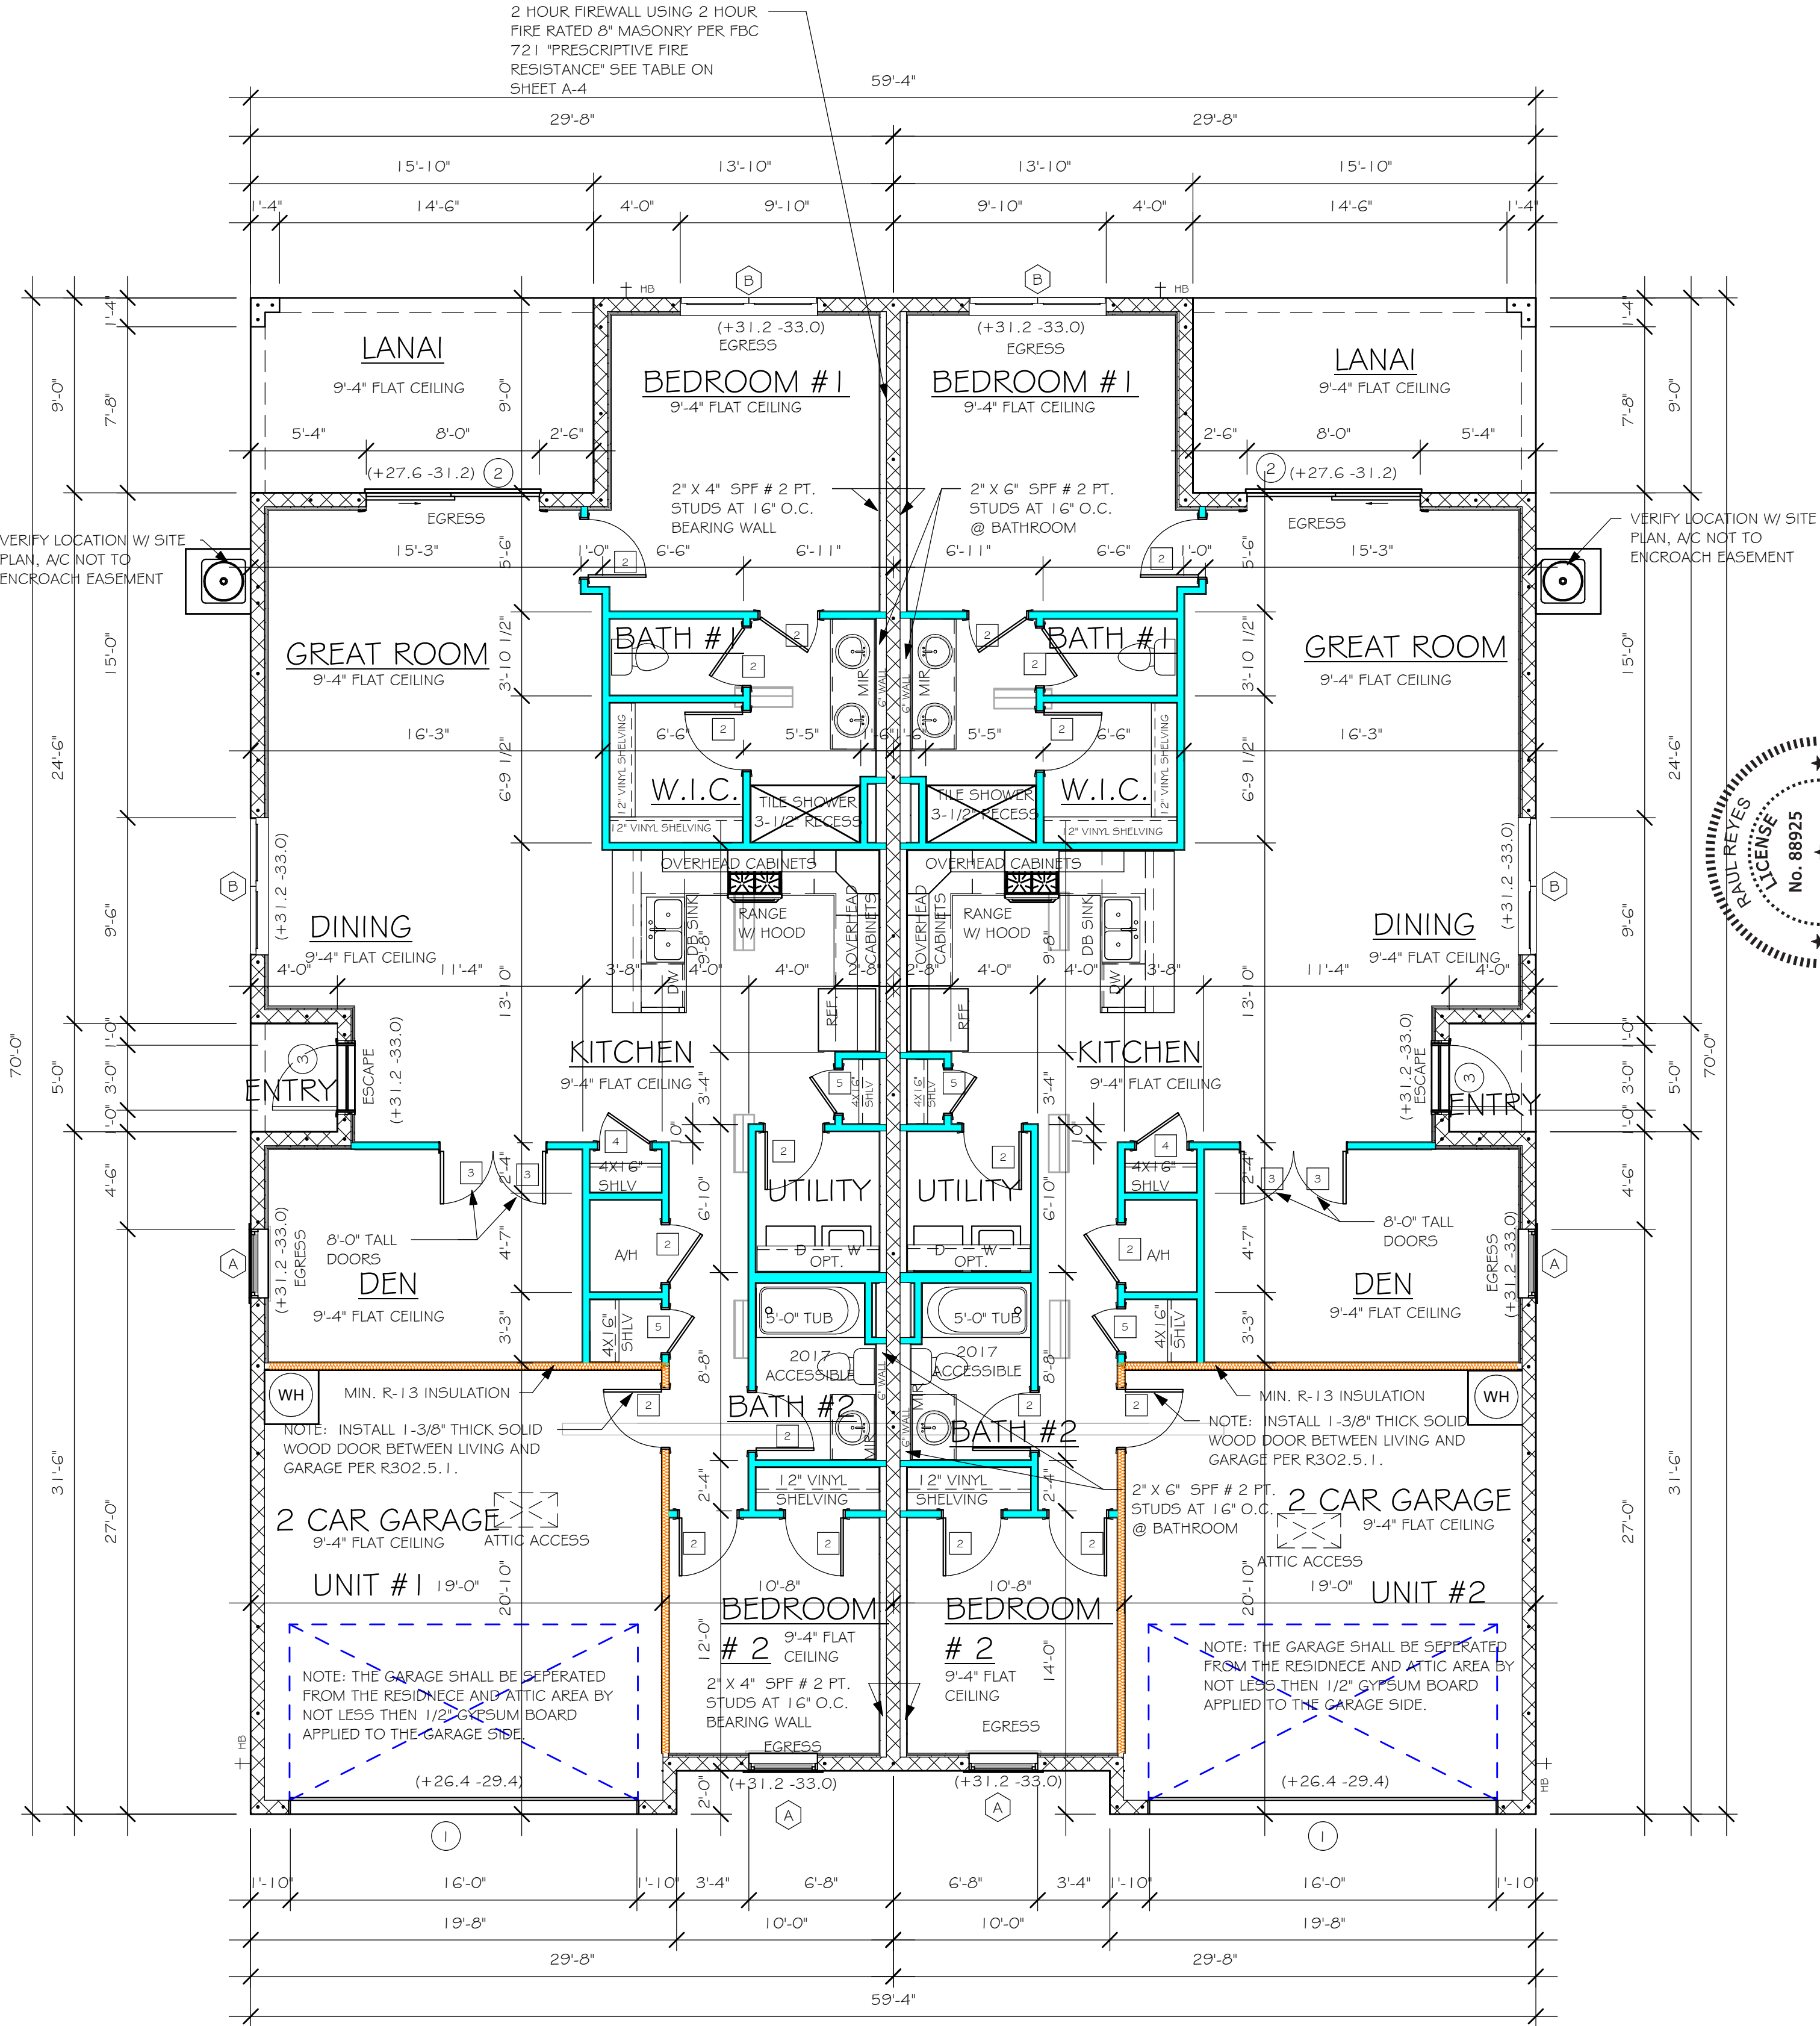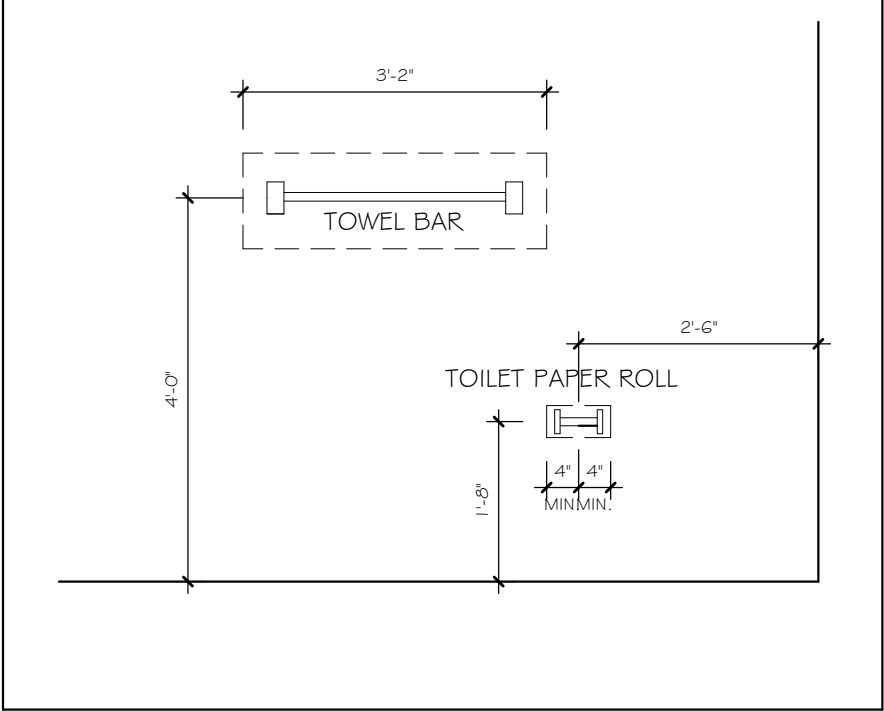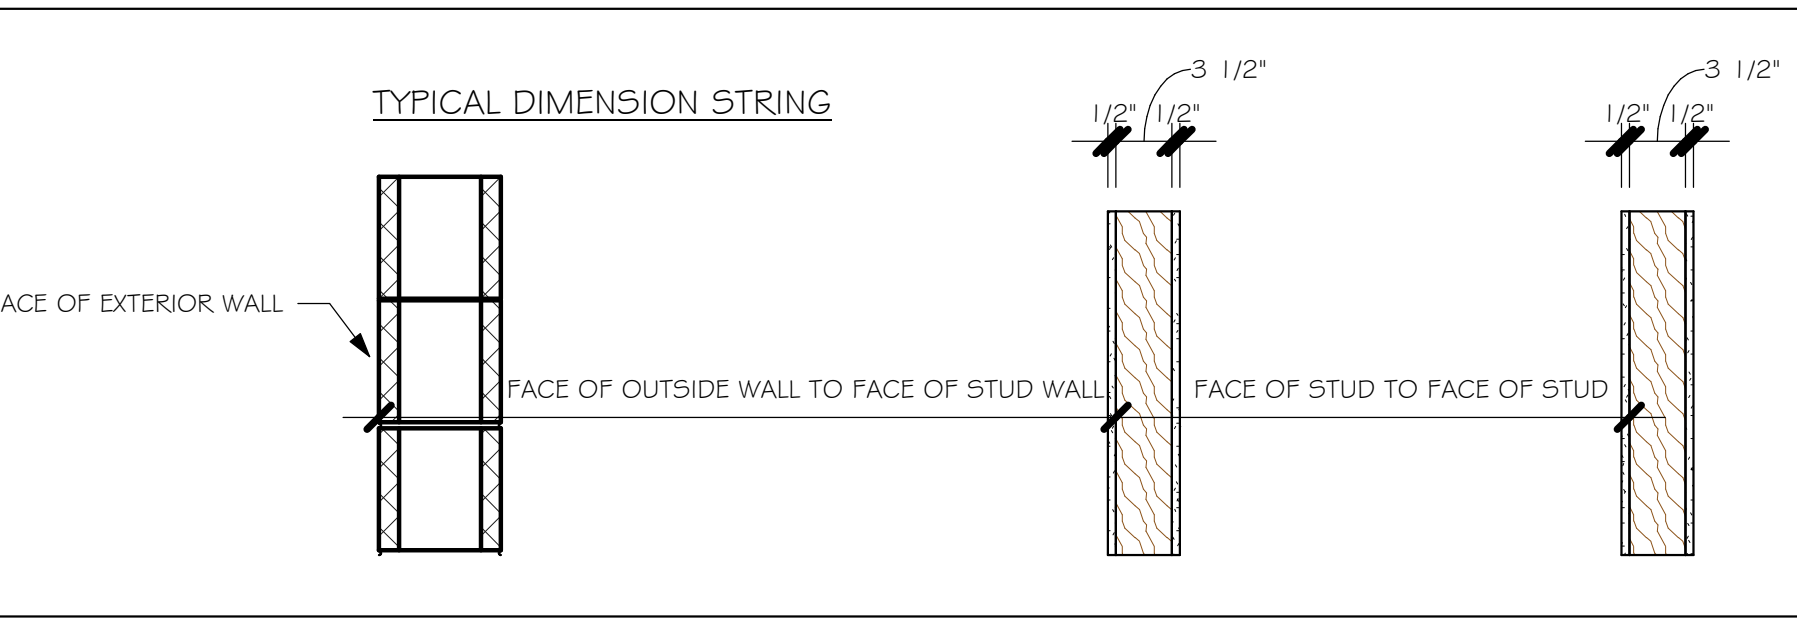

FLOOR PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

D-R HORTON

NYSE

America's Builder

Gulf Coast

Drafting & Design, Inc.

EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

Professional Engineer
No. 88925
STATE OF FLORIDA
Professional Engineer
PAUL REYES

Structural Engineering
No. 88925
STATE OF FLORIDA
Professional Engineer
PAUL REYES

STRUCTURAL ENGINEERING
GULF COAST
OF NORTH FLORIDA
DANIEL L. HORTON
DANIEL L. HORTON
239-549-4554
DANIEL L. HORTON

LOT: 7-B
SUBDIVISION: ENBROOK
ADDRESS: 1167-1163 TRANQUIL BROOK DR
D.R.H. #: 579640007-008

MODEL 1503
VILLA F

DATE: 09/09/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: FLOOR
SCALE: As indicated

A-3

L:\0-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON
-2019\5\BUD\VISIONS\ENBROOK\11820 LOT 7-B-1503 REV\11820 1503 F.vrt

TRUSS STRAPPING TO MASONRY			
	MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
INSTALL META1 G AT ALL TRUSSES TO 1450 lb UPLIFT. FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.	1450	(1) META1 G TO 40	(8) 0.148x1 1/2", EMBED 4"
	1810	(1) HETA1 G TO 40	(9) 0.148x1 1/2", EMBED 4"
	2120	(1) HHETA1 G TO 40	(10) 0.148x1 1/2", EMBED 4"
	1875 (1 PLY)	(2) META1 G TO 40	(10) 0.148x1 1/2", EMBED 4"
	1795 (2 PLY)	(2) META1 G TO 40	(12) 0.162x3 1/2", EMBED 4"
	2365 (2 PLY)	(2) HETA1 G TO 40	(12) 0.162x3 1/2", EMBED 4"
	2365 (2 PLY)	(2) HETA1 G TO 40	(12) 0.162x3 1/2", EMBED 4"
	3965/SYP 3330/SFP	MGT (2 PLY)	(22) 0.148x3" ATR, EPOXY 1 2"
	4235/SYP 3640/SFP	HTT4	(18) 0.162-2 1/2", 5/8" ATR, EPOXY 1 2"
	4670/SYP 4015/SFP	HTT5	(26) 0.148x3", 5/8" ATR, EPOXY 1 2"
10790/SYP 10790/SFP	5445/SYP 5360/SFP	HTT5KT	(26) 0.148x3" TO GIRDER
	10690/SYP 10690/SFP	(1)HGT - 2	(2) 3/4" Ø ATR, EPOXY 1 2"
		(1)HGT - 3	(16) 0.148x3" TO GIRGER, (2) 3/4" Ø ATR, EPOXY 1 2"

- NOTES:
1. PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON -C OF WALL.
 2. CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.
 3. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
 4. WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 1015-3.


SIMPSON CATALOG C-C- 2019

TRUSS STRAPPING TO STUDWALL/ WOOD BEAM			
	MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
INSTALL AT ALL TRUSSES TO 840 lb UPLIFT. FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.	850	(1)MTS1 G TO 20	(14) 1 Odk1-1/2"
	1700	(2) MTS1 G TO 20	(14) 1 Odk1-1/2"
	2550	(3) MTS1 G TO 20	(14) 1 Odk1-1/2"
	1125	(1) HTS20 TO 30	(24) 1 Odk1-1/2"
	2250	(2) HTS20 TO 30	(24) 1 Odk1-1/2"
	3375	(3) HTS20 TO 30	(24) 1 Odk1-1/2"
	4500	(4) HTS20 TO 30	(24) 1 Odk1-1/2"

NOTES:

1. PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2. CONNECTORS ARE SIMPSON SRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

SIMPSON CATALOG C-C- 2019

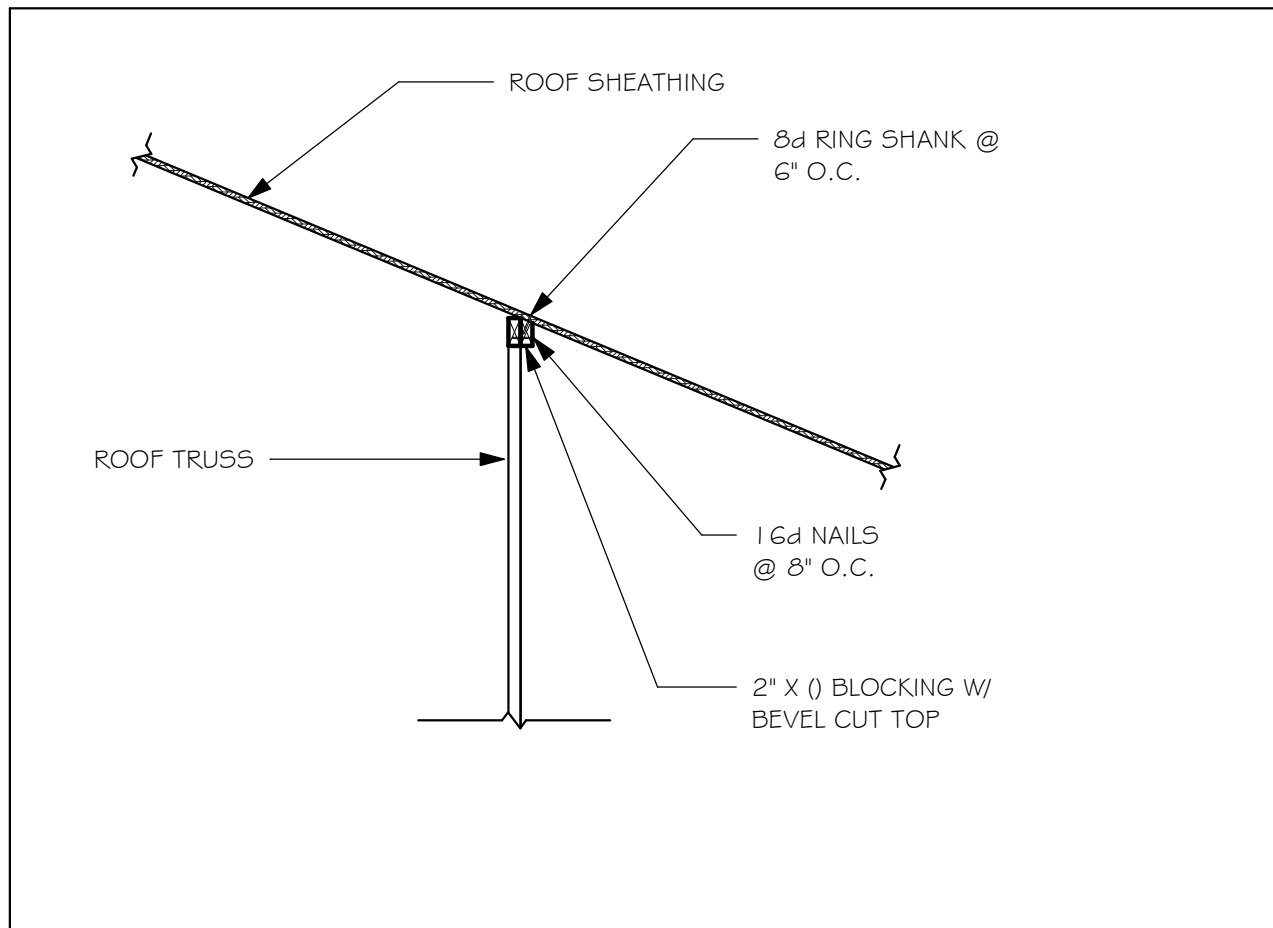


- PLAN NOTES:
1. ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 2. ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-1
 3. PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 4. FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON S-1.
 5. [8F8-1B] etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 6. AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 115-1.

2 HOUR FIREWALL USING 8" MASONRY PER FBC 721 "PRESCRIPTIVE FIRE RESISTANCE"			
F.B.C. TABLE 722.3.2			
MINIMUM EQUIVALENT THICKNESS' (IN) BEARING OR NON-BEARING CONCRETE MASONRY WALLS			
TYPE OF AGGREGATE	FIRE - RESISTANCE RATING (HOURS)		
	2	4	HR
1. PUMICE OR EXPANDED SLAG	3.2"		
2. EXPANDED SHALE, CLAY OR SLATE	3.6"		
3. LIMESTONE, GINDERS, OR UNEXPANDED SLAG	4.0"		
4. CALCAREOUS OR SILICEOUS GRAVEL	4.2"		
FOR THE 2 HOUR FIREWALL, PURCHASE ONLY BLOCK WITH 2 HOUR FIRE RATED MARKING, LABEL OR DOCUMENTATION.			

MODEL 1503: ATTIC VENTILATION FBC R806


COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS

AREAS (SQ. FT.)		ATTIC VENTILATION REQUIRED (ATTIC AREA/50 = 14.55 SQ. FT.)	ATTIC VENTILATION REQUIRED (ATTIC AREA/300 = 7.28 SQ. FT.)
MARK	ATTIC	SOFFIT	QUAD 4 SOFFIT HAS
(1)	2103.0 SQ. FT.	148.0 SQ. FT.	9.03%
		"SOFFIT ONLY" DOES NOT QUALIFY	
SOFFIT MODEL		ROOF VENT MODEL	
ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW		LOMANCO 770-D 0.97 SQ. FT. FREE AIR	

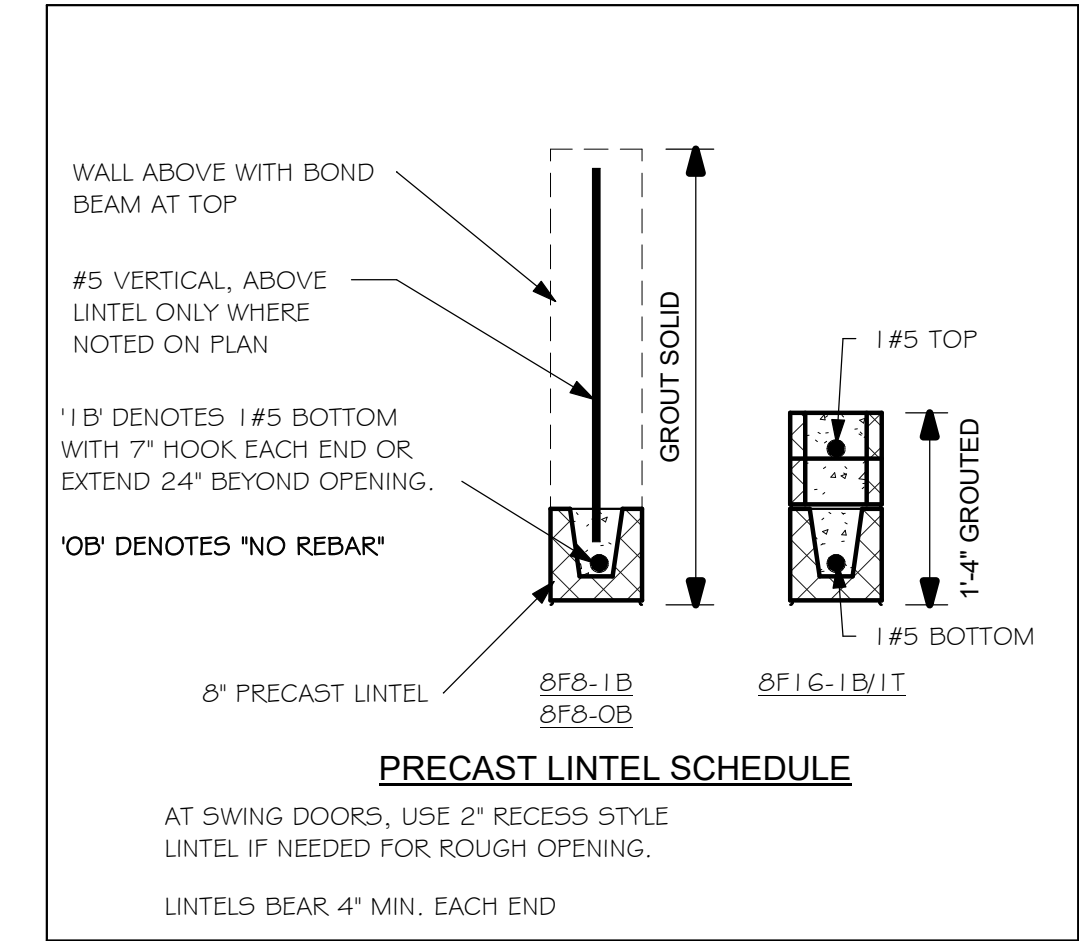

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)

Design No. U301	Bearing Wall Rating 2 HR.	Finish Rating 66 Min.
1. Nailheads - Exposed or covered with joint finisher. 2. Joints - Exposed or covered with fiber tape and joint finisher. As an alternate, nominal 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard. Joints reinforced. 3. Nails - 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 8d cement coated nails 2-3/8 in. long, 0.113 in. shank diam, 9/32 in. diam heads. 4. Gypsum Board - 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 16" o.c. Outer layer attached to studs over inner layer with the 2-3/8 in. long nails spaced 8" o.c. Vertical joints located over studs. All joints in face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side. When used in widths other than 48 in., gypsum board to be installed horizontally. When Steel Framing Members* (Item 6) are used, base layer attached to furring channels with 1 in. long Type S bugle-head steel screws spaced max. 24 in. o.c.; face layer attached with 1-5/8 in. long Type S bugle-head steel screws spaced max. 12 in. o.c. AMERICAN GYPSUM CO - Types AG-C, AGX-11, AGX-C, BELING NEW BUILDING MATERIALS CO LTD - Type DBX-1. CERTAINTED GYPSUM, INC. - Types 1, FRPC, EGRC, ProRoC Type C or ProRoC Type X. CERTAINTED GYPSUM CANADA, INC. - ProRoC Type C, ProRoC Type X, ProRoC Type Atrac-Resistant. CANADIAN GYPSUM COMPANY - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRG, WRX. G-P GYPSUM CORP. SUB OF GEORGIA-PACIFIC CORP. - Types 5, 9, C, DAP, DD, DA, DGG, DS, GPFS8, LA-FARGE NORTH AMERICA INC - Types LGFC-C, LGFC-2, LGFC2A, LGFCB, LGFCB, LGFC-CIA. NATIONAL GYPSUM CO - Types FSK, FSK-C, FSK-G, FSW, FSW-3, FSW-C, FSW-G. PABCO GYPSUM, DIV OF PACIFIC COAST BUILDING PRODUCTS INC - Types PG-2, PG-3, PG-3W, PGL, PLS-C, PLSW, PLSW3, PLSW3, PLSW3-C. TEMPLE-INLAND FOREST PRODUCTS CORP - Type TG-C. SIAM GYPSUM INDUSTRY (SARABURI) CO LTD - Type EX-1. STANDARD GYPSUM LLC - Types SGC, SGC-C or SGC-C. UNITED STATES GYPSUM CO - Types AR, C, FRX-G, IP-AR, IP-X1, IP-X2, IPO-AR, SCX, SHX, WRG, WRX. USG MEXICO S A DE C V - Types AR, C, IP-AR, IP-X1, IP-X2, IPC-AR, SCX, SHX, WRG, WRX. 4A. Gypsum Board - (As an alternate to Item 4) - Nom. 3/4 in. thick, installed as described in Item 4. CANADIAN GYPSUM COMPANY - Types AR, IP-AR. UNITED STATES GYPSUM CO - Types AR, IP-AR. USG MEXICO S A DE C V - Types AR, IP-AR. 4B. Gypsum Board - (As an alternate to Items 4 and 4A) - 5/8 in. thick, 2 1/2" wide, tongue and groove edge, applied horizontally as the outer layer to one side of the assembly. Secured as described in Item 4. Joint covering (Item 2) not required. CANADIAN GYPSUM COMPANY - Types SHX. UNITED STATES GYPSUM CO - Types SHX. USG MEXICO S A DE C V - Types SHX. 5. Molded Plastic - Not shown. Optional - Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details. ASSOCIATED MATERIALS INC ALSID, DIV OF GENTEK BUILDING PRODUCTS LTD HEARTLAND BUILDING PRODUCTS INC VTREC CORP NEBRASKA PLASTICS INC 6. Steel Framing Members - (Optional, Not shown) - Furring channels and resilient sound isolation clip as described below. A. Furring Channels - Formed of No. 25 MSG galv. steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. o.c. perpendicular to studs. Channels secured to studs as described in Item 5. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 SWG galv. steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-lapping JG framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 4. B. Steel Framing Members - Resilient sound isolation clip used to attach furring channels (Item 6A) to studs. Clips spaced 48 in. o.c. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. PAC INTERNATIONAL INC - Type RSIC-1. *Bearing the UL Classification Mark		

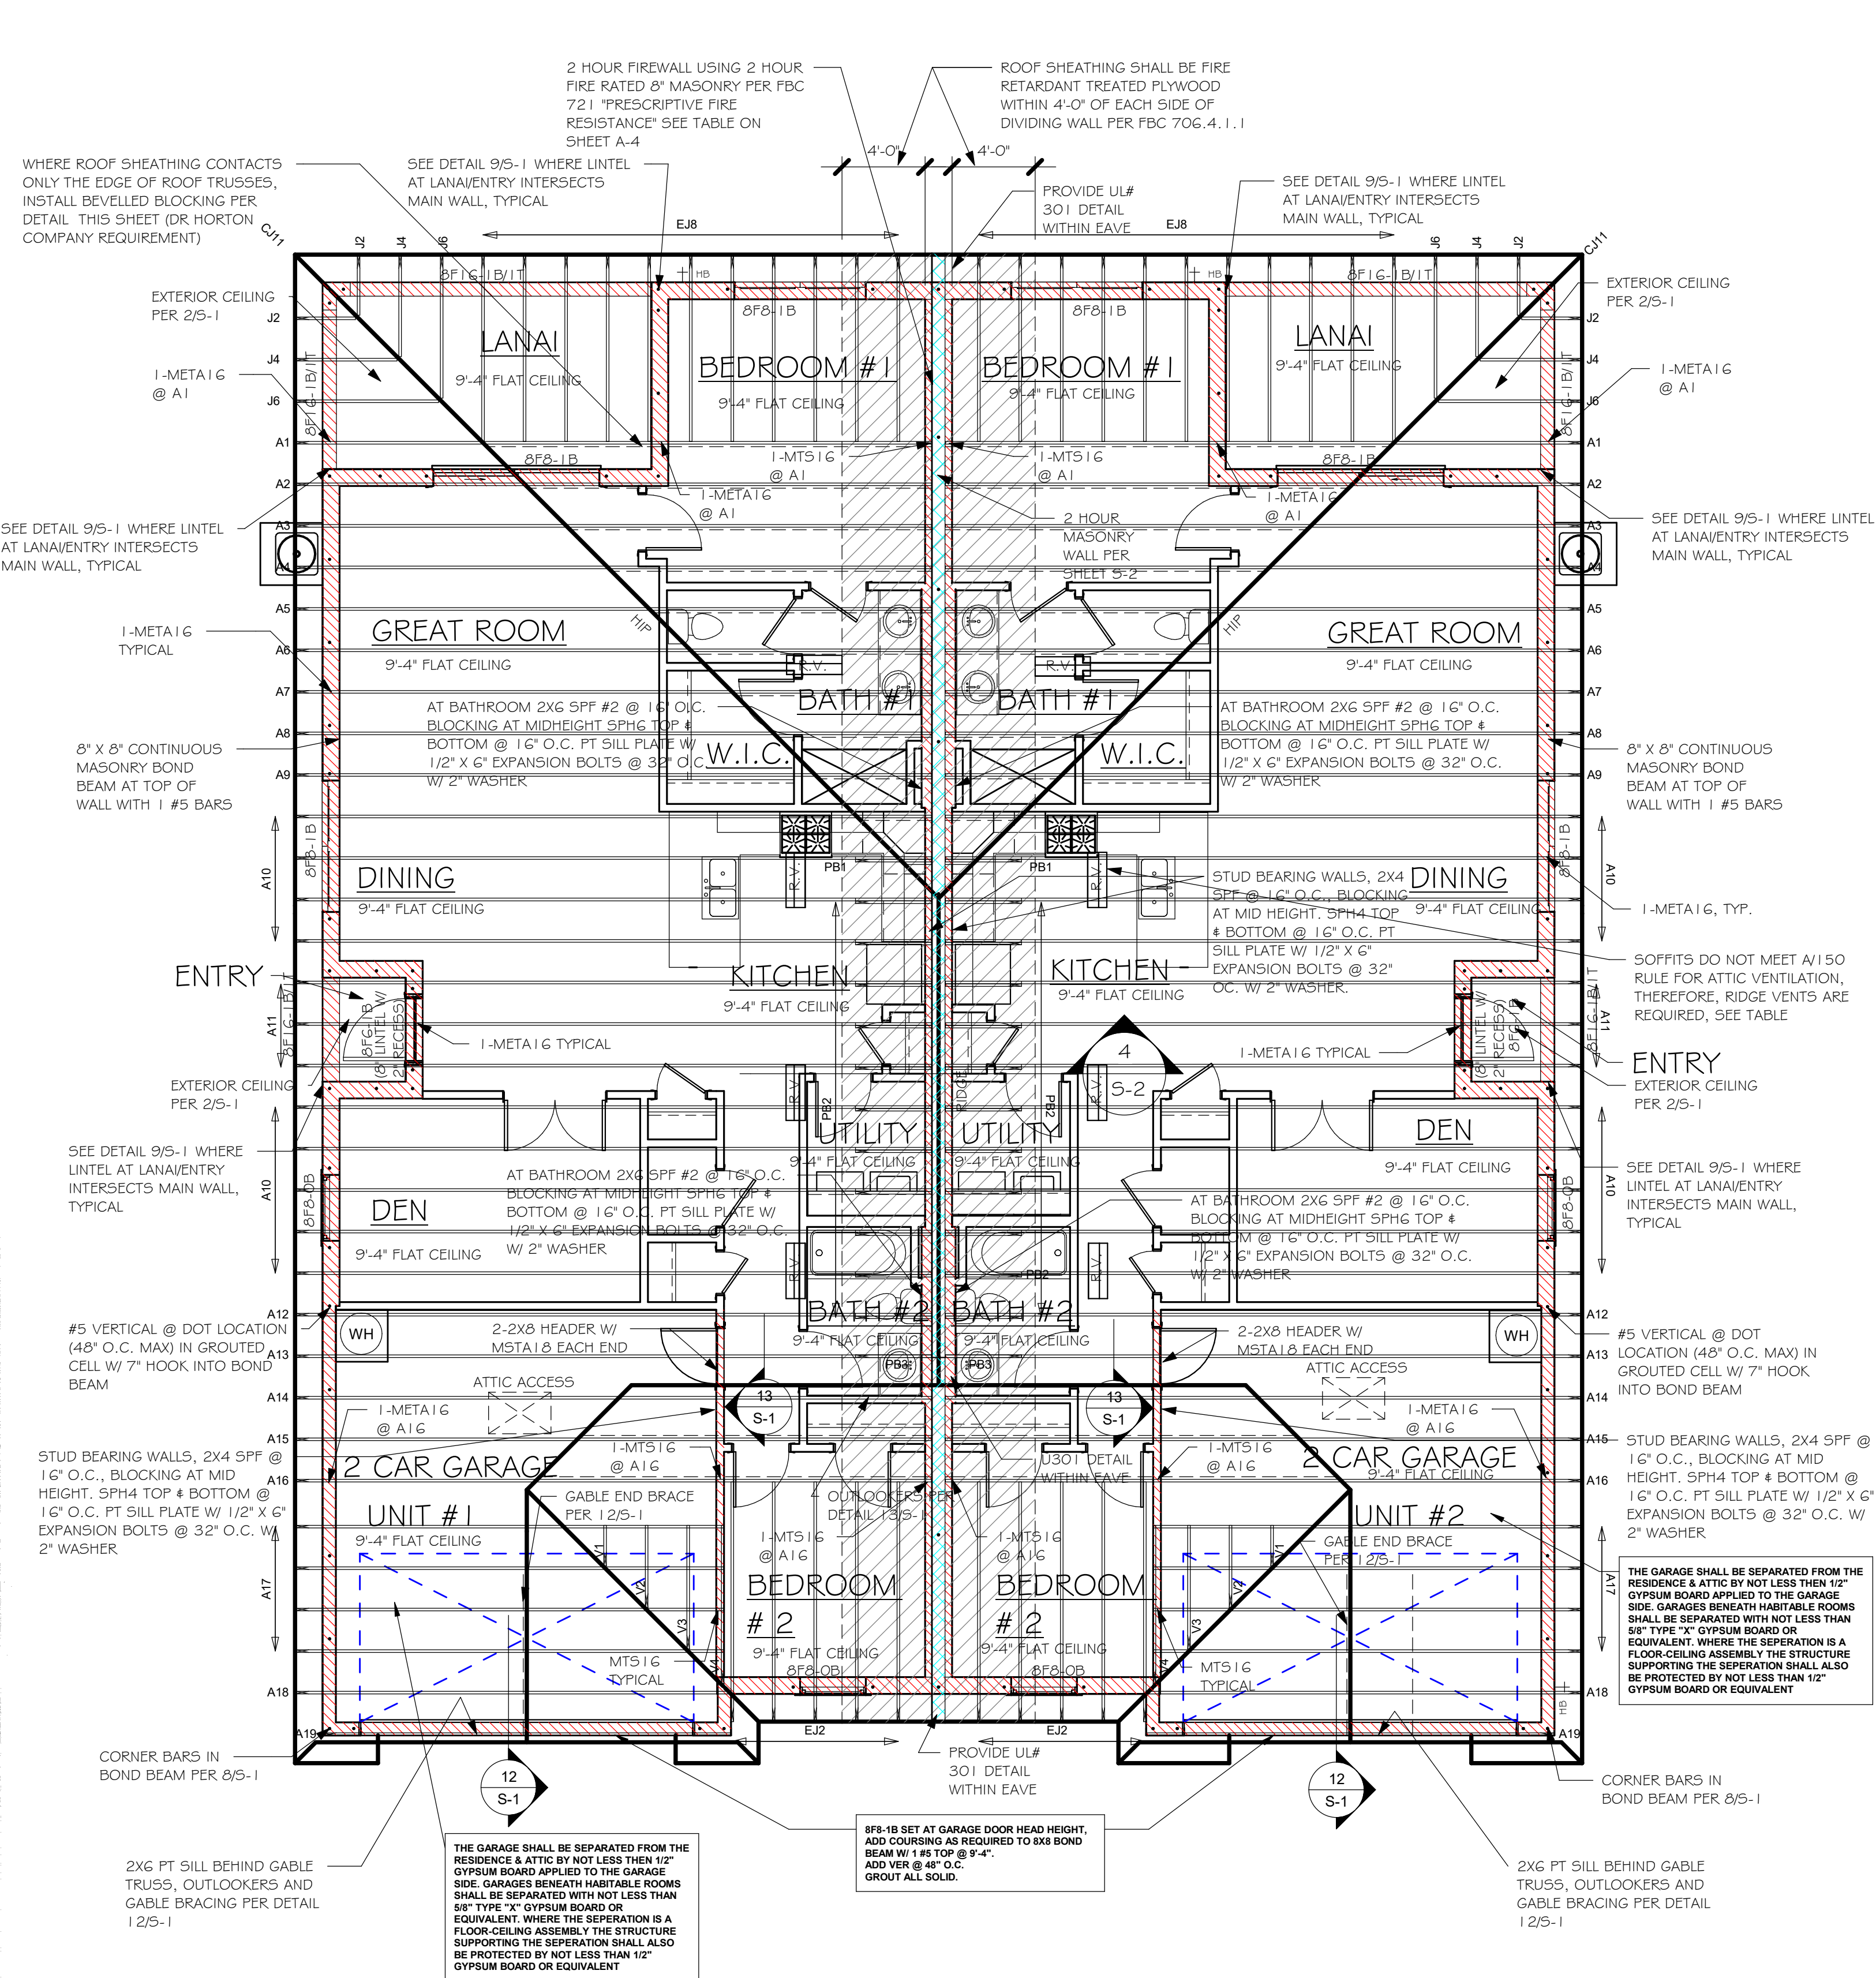

TRUSS BEARING CONDITIONS AND STRAPPING
BASED ON TRUSS LAYOUT PREPARED BY
SCOSTA JOB# 44060-N DATED: 07/02/19
REVISED: 08/06/19

BEARING HEIGHT


8F8-1B SET AT GARAGE DOOR HEAD HEIGHT, ADD COURSING AS REQUIRED TO 8X8 BOND BEAM W/ 1 #5 TOP & 8 4\"/>

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 335-540-9222
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL
SYSTEMS
OF NORTH FLORIDA
INC.
1515 SE 47th ST. CAPE CORAL, FL 33904
(239) 549-4554
CEN 8867

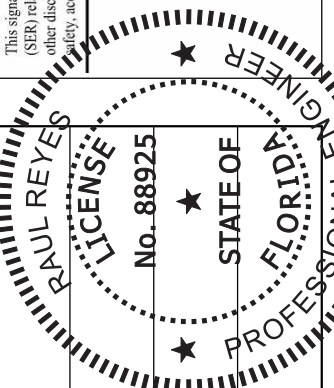


LOT: 7-B
SUBDIVISION: ENBROOK
ADDRES: 1167-1163 TRANQUIL BROOK DR
D.R.H. #: 579640007-008

MODEL 1503
VILLA F
GCD JOB # 11820

DATE: 09/09/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: ROOF
SCALE: As indicated
A-4

L:\0-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON
2019\5\BIDDING\BROOK 11820 LOT 7-8 1503 PREVIEW\1820 1503 F.wd

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES, PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	AC DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASIC FLOOD ELEVATION PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V. PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2014	

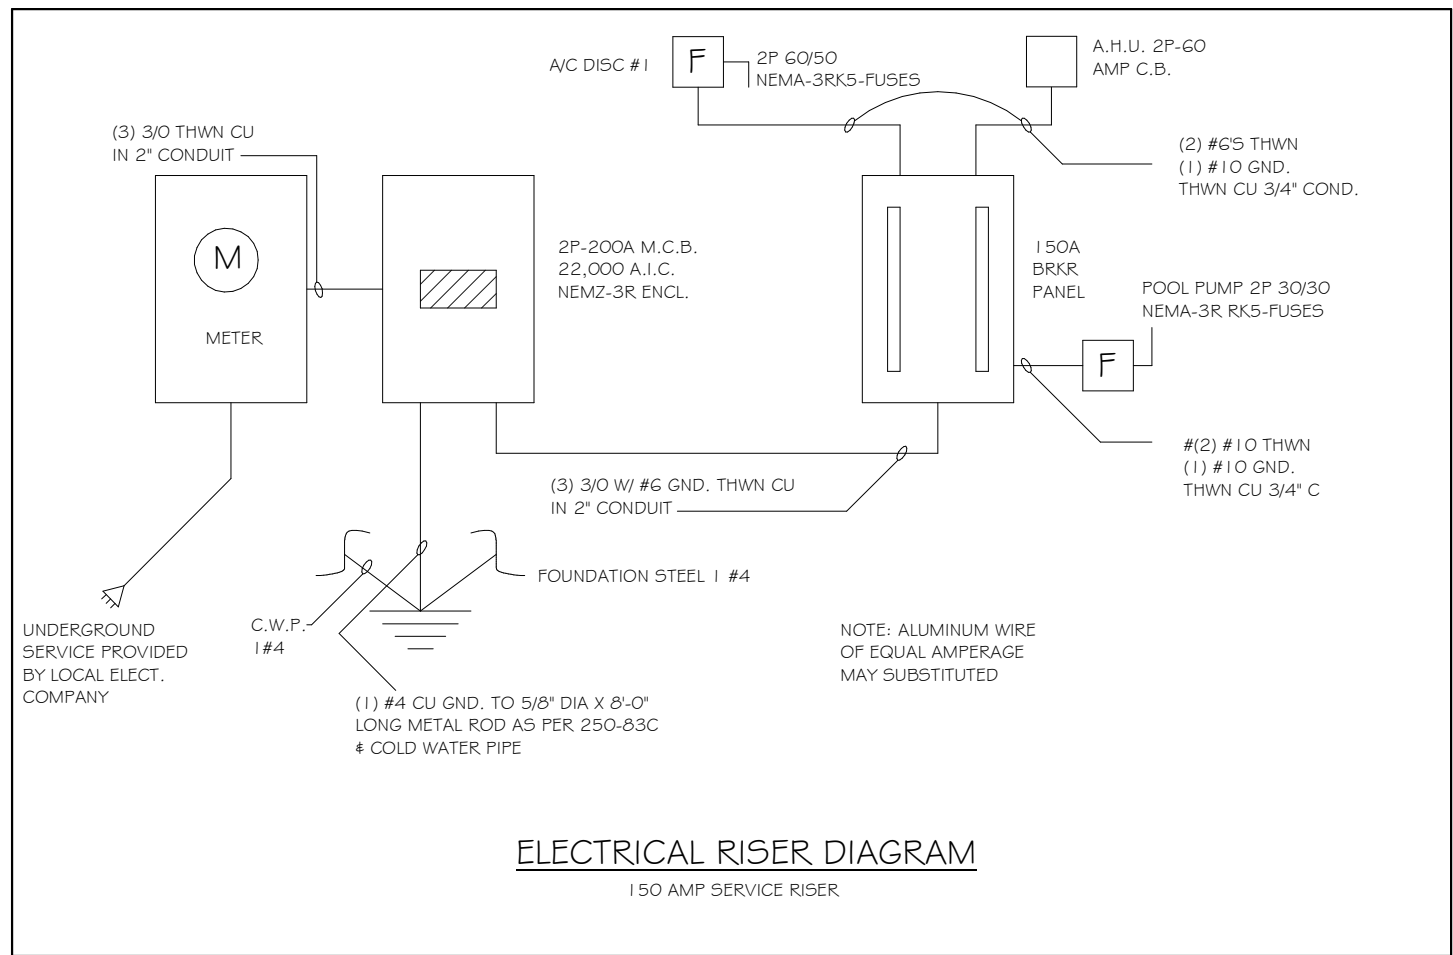

AIR CONDITIONING COORDINATION REQUIRED.
PRIOR TO ORDERING ROOF TRUSSES, THE CONTRACTOR SHALL WORK WITH THE AIR CONDITIONING SUB CONTRACTOR TO DESIGN/PLAN AND LAYOUT THE LOCATION OF AIR HANDLING EQUIPMENT, AIR DUCT SIZE AND LOCATION AND COORDINATE THAT DESIGN WITH THE TRUSSES FOR SPACE, CONNECTIVITY, AND POSITION REQUIREMENTS. THE CONTRACTOR MUST ADVISE THE TRUSS COMPANY PRIOR TO ANY CONSTRUCTION OF TRUSSES OF THE AIR CONDITIONING/HANDLING EQUIPMENT'S SIZE AND WEIGHT AND DUCT LAYOUT CONCERNS OR REQUIREMENTS THAT MAY HAVE THE POTENTIAL TO CHANGE OR MODIFY THE TRUSSES TO ACCOMMODATE THE SAME. THE CONTRACTOR SHALL COORDINATE CONDENSATION DISCHARGE LINE LOCATION, AND ELECTRICAL SERVICE TO AIR EQUIPMENT, AND PROVIDE ANY LOCAL DISCONNECTS, LIGHTS AND SERVICE PLATFORMS THAT MAY BE REQUIRED.

ELECTRICAL NOTES FOR FIRE RATED WALLS


ELECTRICAL OUTLETS PLACED IN FIRE RATED WALLS SHALL BE IN CONFORMANCE WITH THE UNDERWRITERS LABORATORIES, INC., FIRE RESISTANCE DIRECTORY, CURRENT EDITION, THESE REQUIREMENTS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING SPECIFIC ITEMS:

A) INDIVIDUAL OUTLET/SWITCH BOXES SHALL NOT EXCEED (16) SQUARE INCHES IN AREA.

B) AGGREGATE AREA OF OUTLET/SWITCH BOXES SHALL NOT EXCEED (100) SQUARE INCHES WITHIN (100) SQUARE FEET OF WALL AREA.

C) OUTLET/SWITCH BOXES LOCATED ON OPPOSITE SIDE OF THE SAME WALL SHALL BE SEPERATED BY A MINIMUM OF (24) INCHES.

D) ALL OUTLET/SWITCH BOXES SHALL BE SECURELY ATTACHED TO THE STUDS AND THE OPENING IN THE WALL BOARD FACING SHALL BE CUT SO THAT THE CLEARANCE BETWEEN THE BOX AND THE WALLBOARD DOES NOT EXCEED 1/8" INCH.

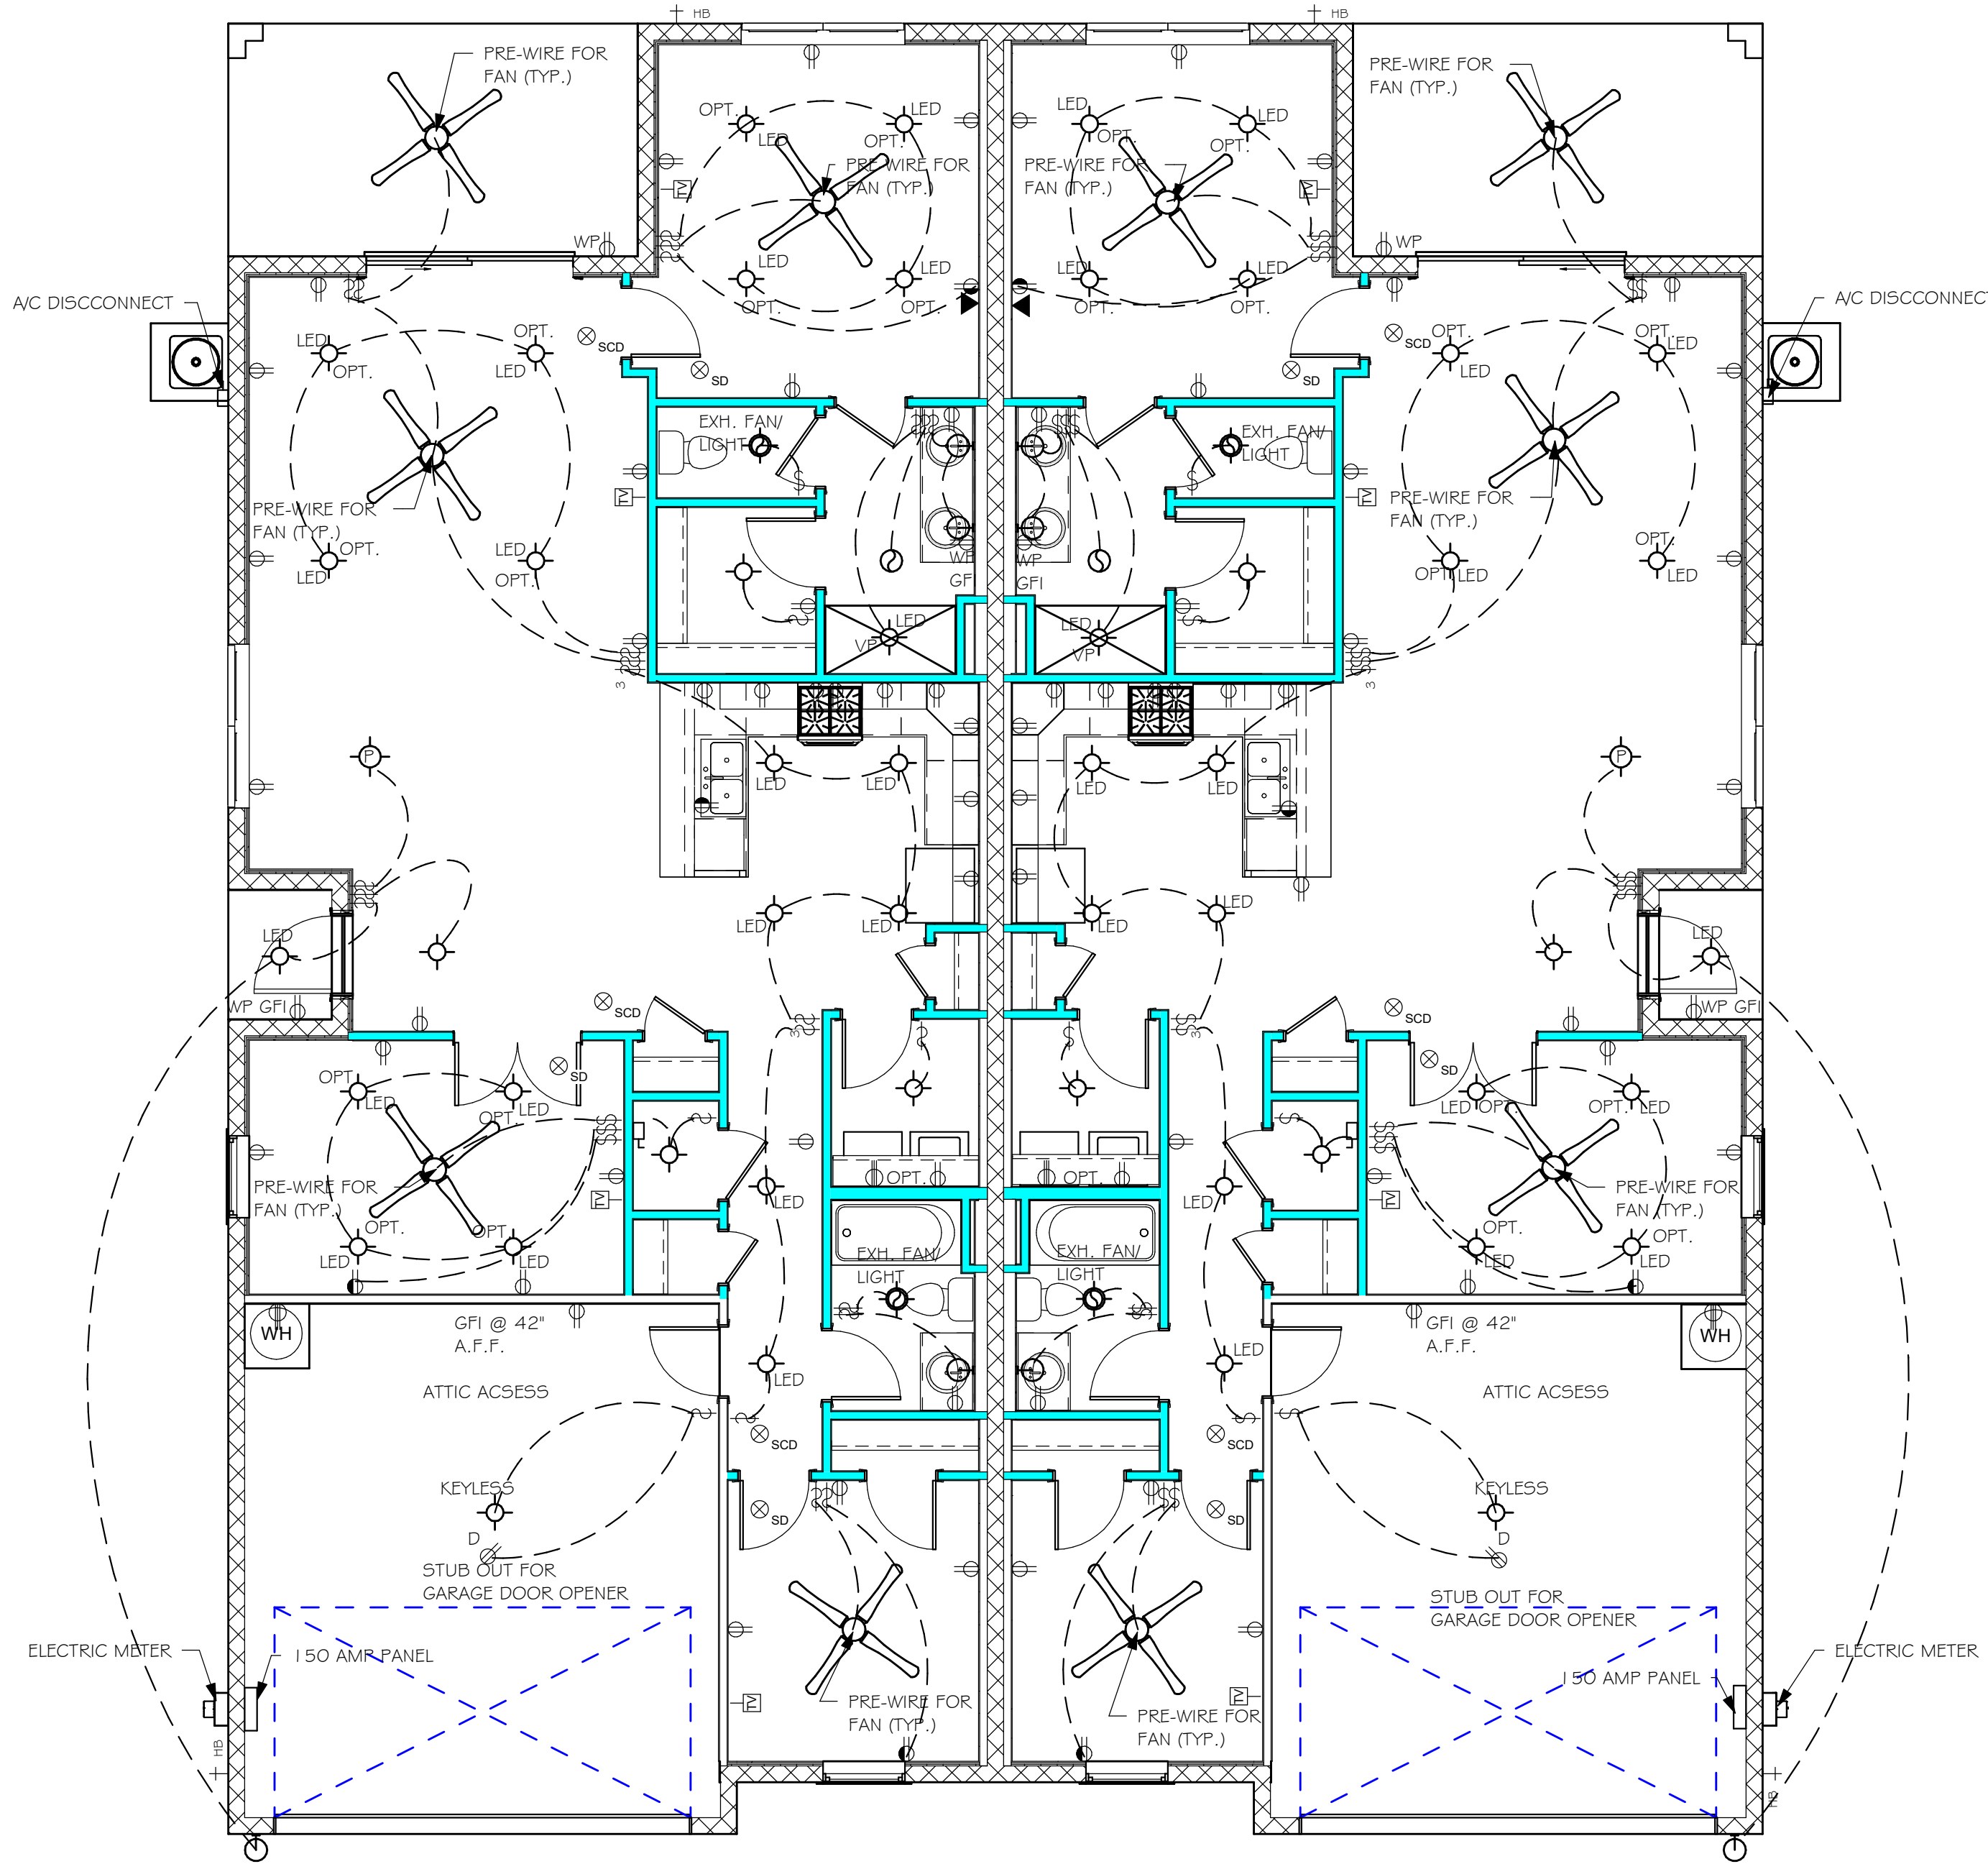

ELECTRICAL PLAN

3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DR HORTON
2019\SUBDIVISIONS\ENBROOK\1820 LOT 7-8\1503 PREVIEW\1820 1503 F.pdf

1

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

- THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND FITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
- ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
- SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE. FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
- STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
- ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. USP FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
- TREATED WOOD REQUIREMENTS:- ALL WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
- THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
- CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
- LANAI CEILINGS & COVERED ENTRY CEILINGS
1X4 STRIPPING @ 16" O.C. FASTENED WITH 8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

2

GENERAL ROOF ASSEMBLY

ROOF SHEATHING
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "H" CLIPS AT UNSUPPORTED PANEL EDGES. THE ROOF SHEATHING SHALL BE NAILED WITH 8d RING SHANK NAILS @ 5' O.C. EDGE AND 6' O.C. FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSSES WITHOUT SPLITTING. RING SHANK NAILS PER R803.2.3.1 - 0.13" NOMINAL SHANK DIAMETER, RING DIAMETER OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE, A750 ALUM. ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE, ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURER'S PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

3

ASPHALT SHINGLE ROOF SPEC'S

SHINGLES
15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, AND SHALL BE SECURED TO THE ROOF WITH NO LESS THAN 6 FASTENERS PER SHINGLE STRIP, OR A MINIMUM OF 2 FASTENERS PER SHINGLE TAB, AND SHALL IN NO CASE BE FASTENED WITH LESS FASTENERS THAN THAT REQUIRED BY THE MANUFACTURER. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

FASTENERS
FASTENERS FOR ASPHALT SHINGLES SHALL COMPLY WITH ASTM F 1667, AND SHALL BE MADE WITH GALVANIZED STEEL, STAINLESS STEEL OR ALUMINUM WITH A MINIMUM SHANK SIZE OF 12 GAUGE (0.105") WITH A MINIMUM 3/8" DIAMETER HEAD SHANK AND SHALL BE A LENGTH TO PENETRATE THE SHEATHING.

THE NAIL COMPONENT OF PLASTIC CAP NAILS SHALL MEET OR EXCEED THE REQUIREMENTS OF ASTM A 641, CLASS 1, OR EQUAL, AND SHALL BE CORROSION RESISTANT BY ELECTRO GALVANIZATION, MECHANICAL GALVANIZATION, HOT DIPPED GALVANIZATION OR SHALL BE MADE OF STAINLESS STEEL, NON-FERROUS METAL.

4


CLAY AND CONCRETE ROOF TILE SPEC'S

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF. THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.

MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.

APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDE BUT NOT BE LIMITED TO THE FOLLOWING:

- TILE PLACEMENT AND SPACING,
- ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,
 - AMOUNT AND PLACEMENT OF MORTAR
 - AMOUNT AND PLACEMENT OF ADHESIVE
 - C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
- UNDERLAYMENT
- SLOPE REQUIREMENT.

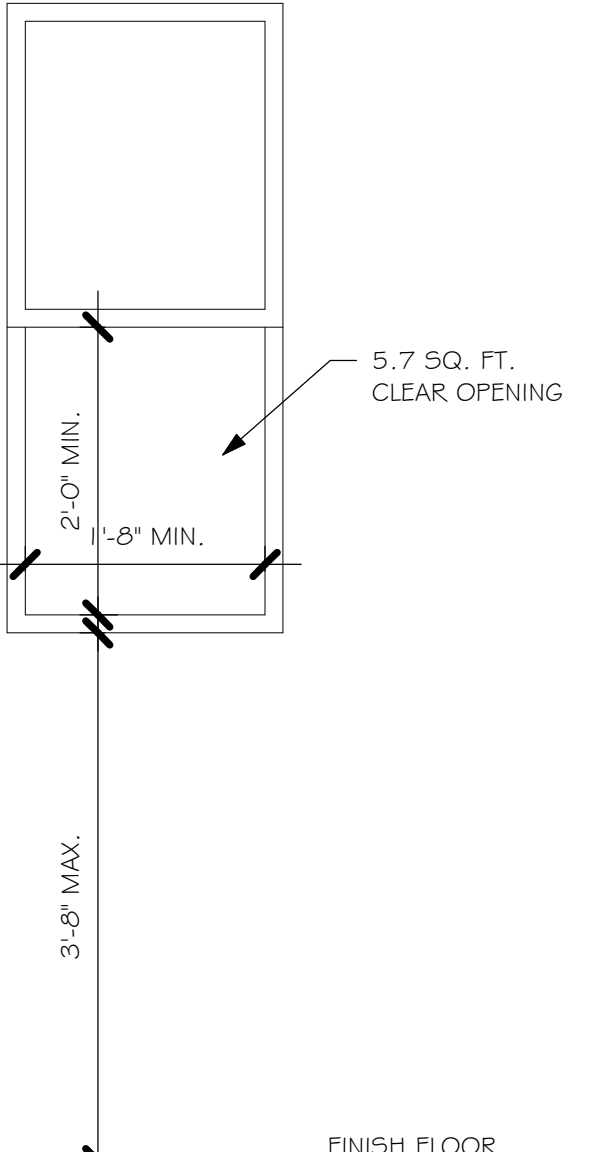

5.7 SQ. FT. CLEAR OPENING

2'-0" MIN.

1'-8" MIN.

3'-5" MAX.

FINISH FLOOR

R310.2.1 MINIMUM OPENING AREA: ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.530 m²).

EXCEPTION: GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5 SQUARE FEET (0.465 m²).


R310.2.1 MINIMUM OPENING HEIGHT: THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES (610mm).

R310.2.1 MINIMUM OPENING WIDTH: THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES (508mm).

R310.1.1 OPERATIONAL CONSTRAINTS: EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS.

R310.2.3 WINDOW WELLS: THE MINIMUM HORIZONTAL AREA OF THE WINDOW WELL SHALL BE 9 SQUARE FEET (0.84 m²), WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES (914mm). THE AREA OF THE WINDOW WELL SHALL ALLOW THE EMERGENCY ESCAPE AND RESCUE OPENING TO BE FULLY OPENED.

MINIMUM EGRESS WINDOW DETAIL

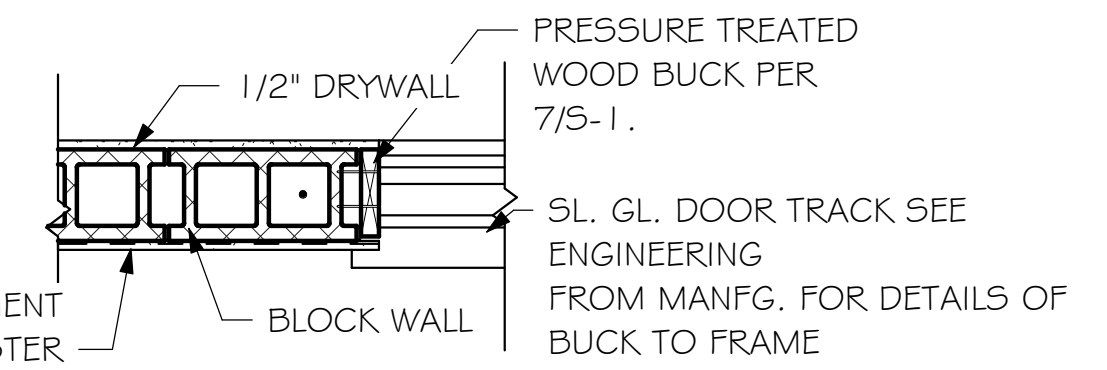

1/2" DRYWALL


PRESSURE TREATED WOOD BUCK PER 7/5-1.

SL. GL. DOOR TRACK SEE ENGINEERING FROM MANFG. FOR DETAILS OF BUCK TO FRAME

CEMENT PLASTER

BLOCK WALL

SL. GL. DR. JAM TO BLOCK DETAIL

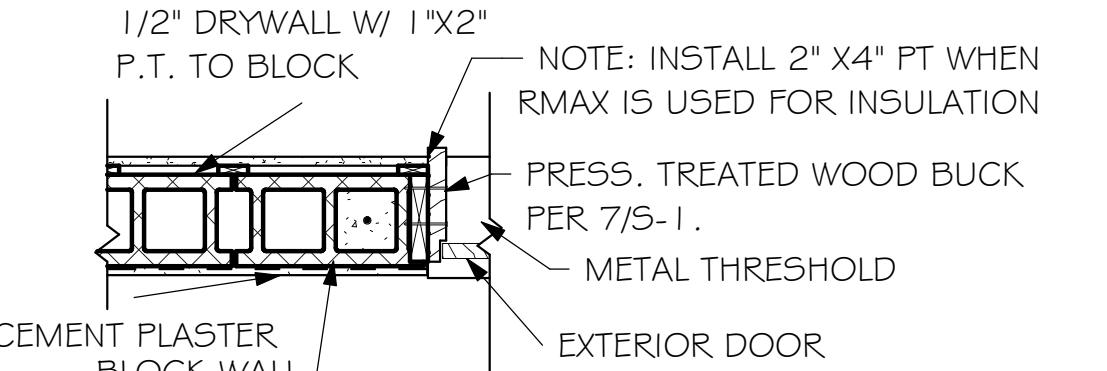

1/2" DRYWALL W/ 1"x2" P.T. TO BLOCK

NOTE: INSTALL 2" X4" PT WHEN RMAX IS USED FOR INSULATION

PRESS. TREATED WOOD BUCK PER 7/5-1.


METAL THRESHOLD

CEMENT PLASTER

BLOCK WALL

EXTERIOR DOOR

DOOR JAM TO BLOCK DETAIL

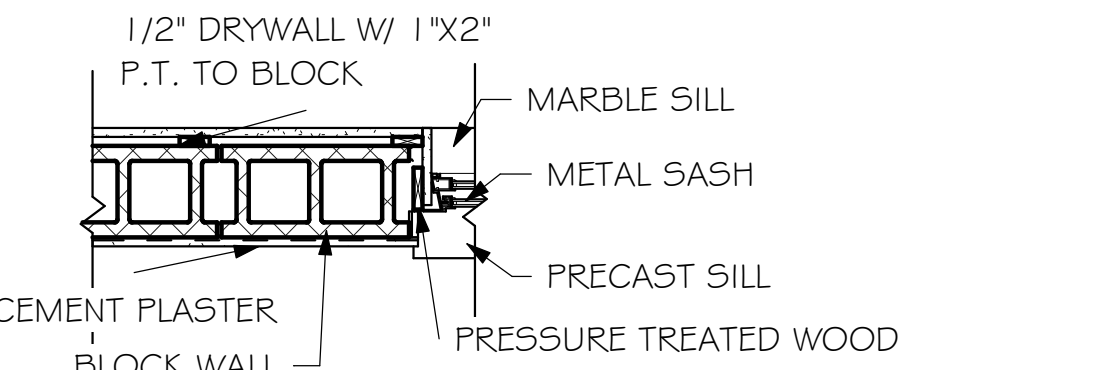

1/2" DRYWALL W/ 1"x2" P.T. TO BLOCK

MARBLE SILL

METAL SASH


PRECAST SILL

PRESSURE TREATED WOOD BUCK PER 7/5-1.

CEMENT PLASTER

BLOCK WALL

WINDOW JAM TO BLOCK DETAIL

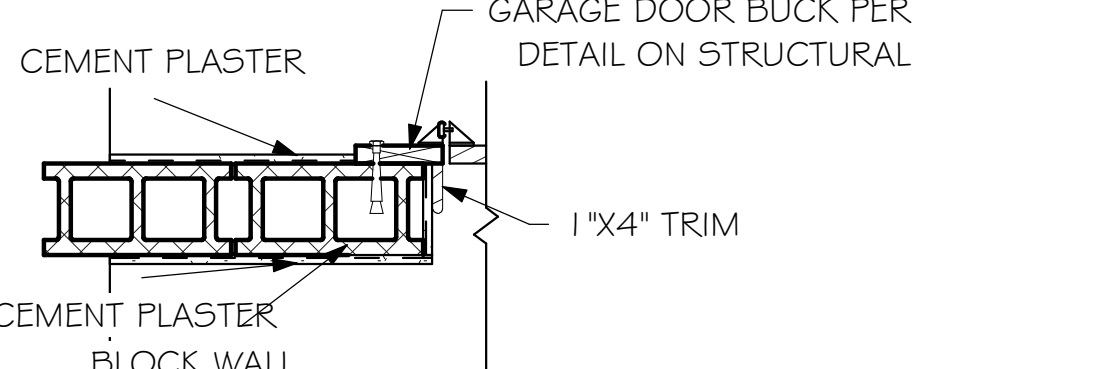

CEMENT PLASTER


GARAGE DOOR BUCK PER DETAIL ON STRUCTURAL

1"x4" TRIM

CEMENT PLASTER

BLOCK WALL

GARAGE DOOR JAM DETAIL

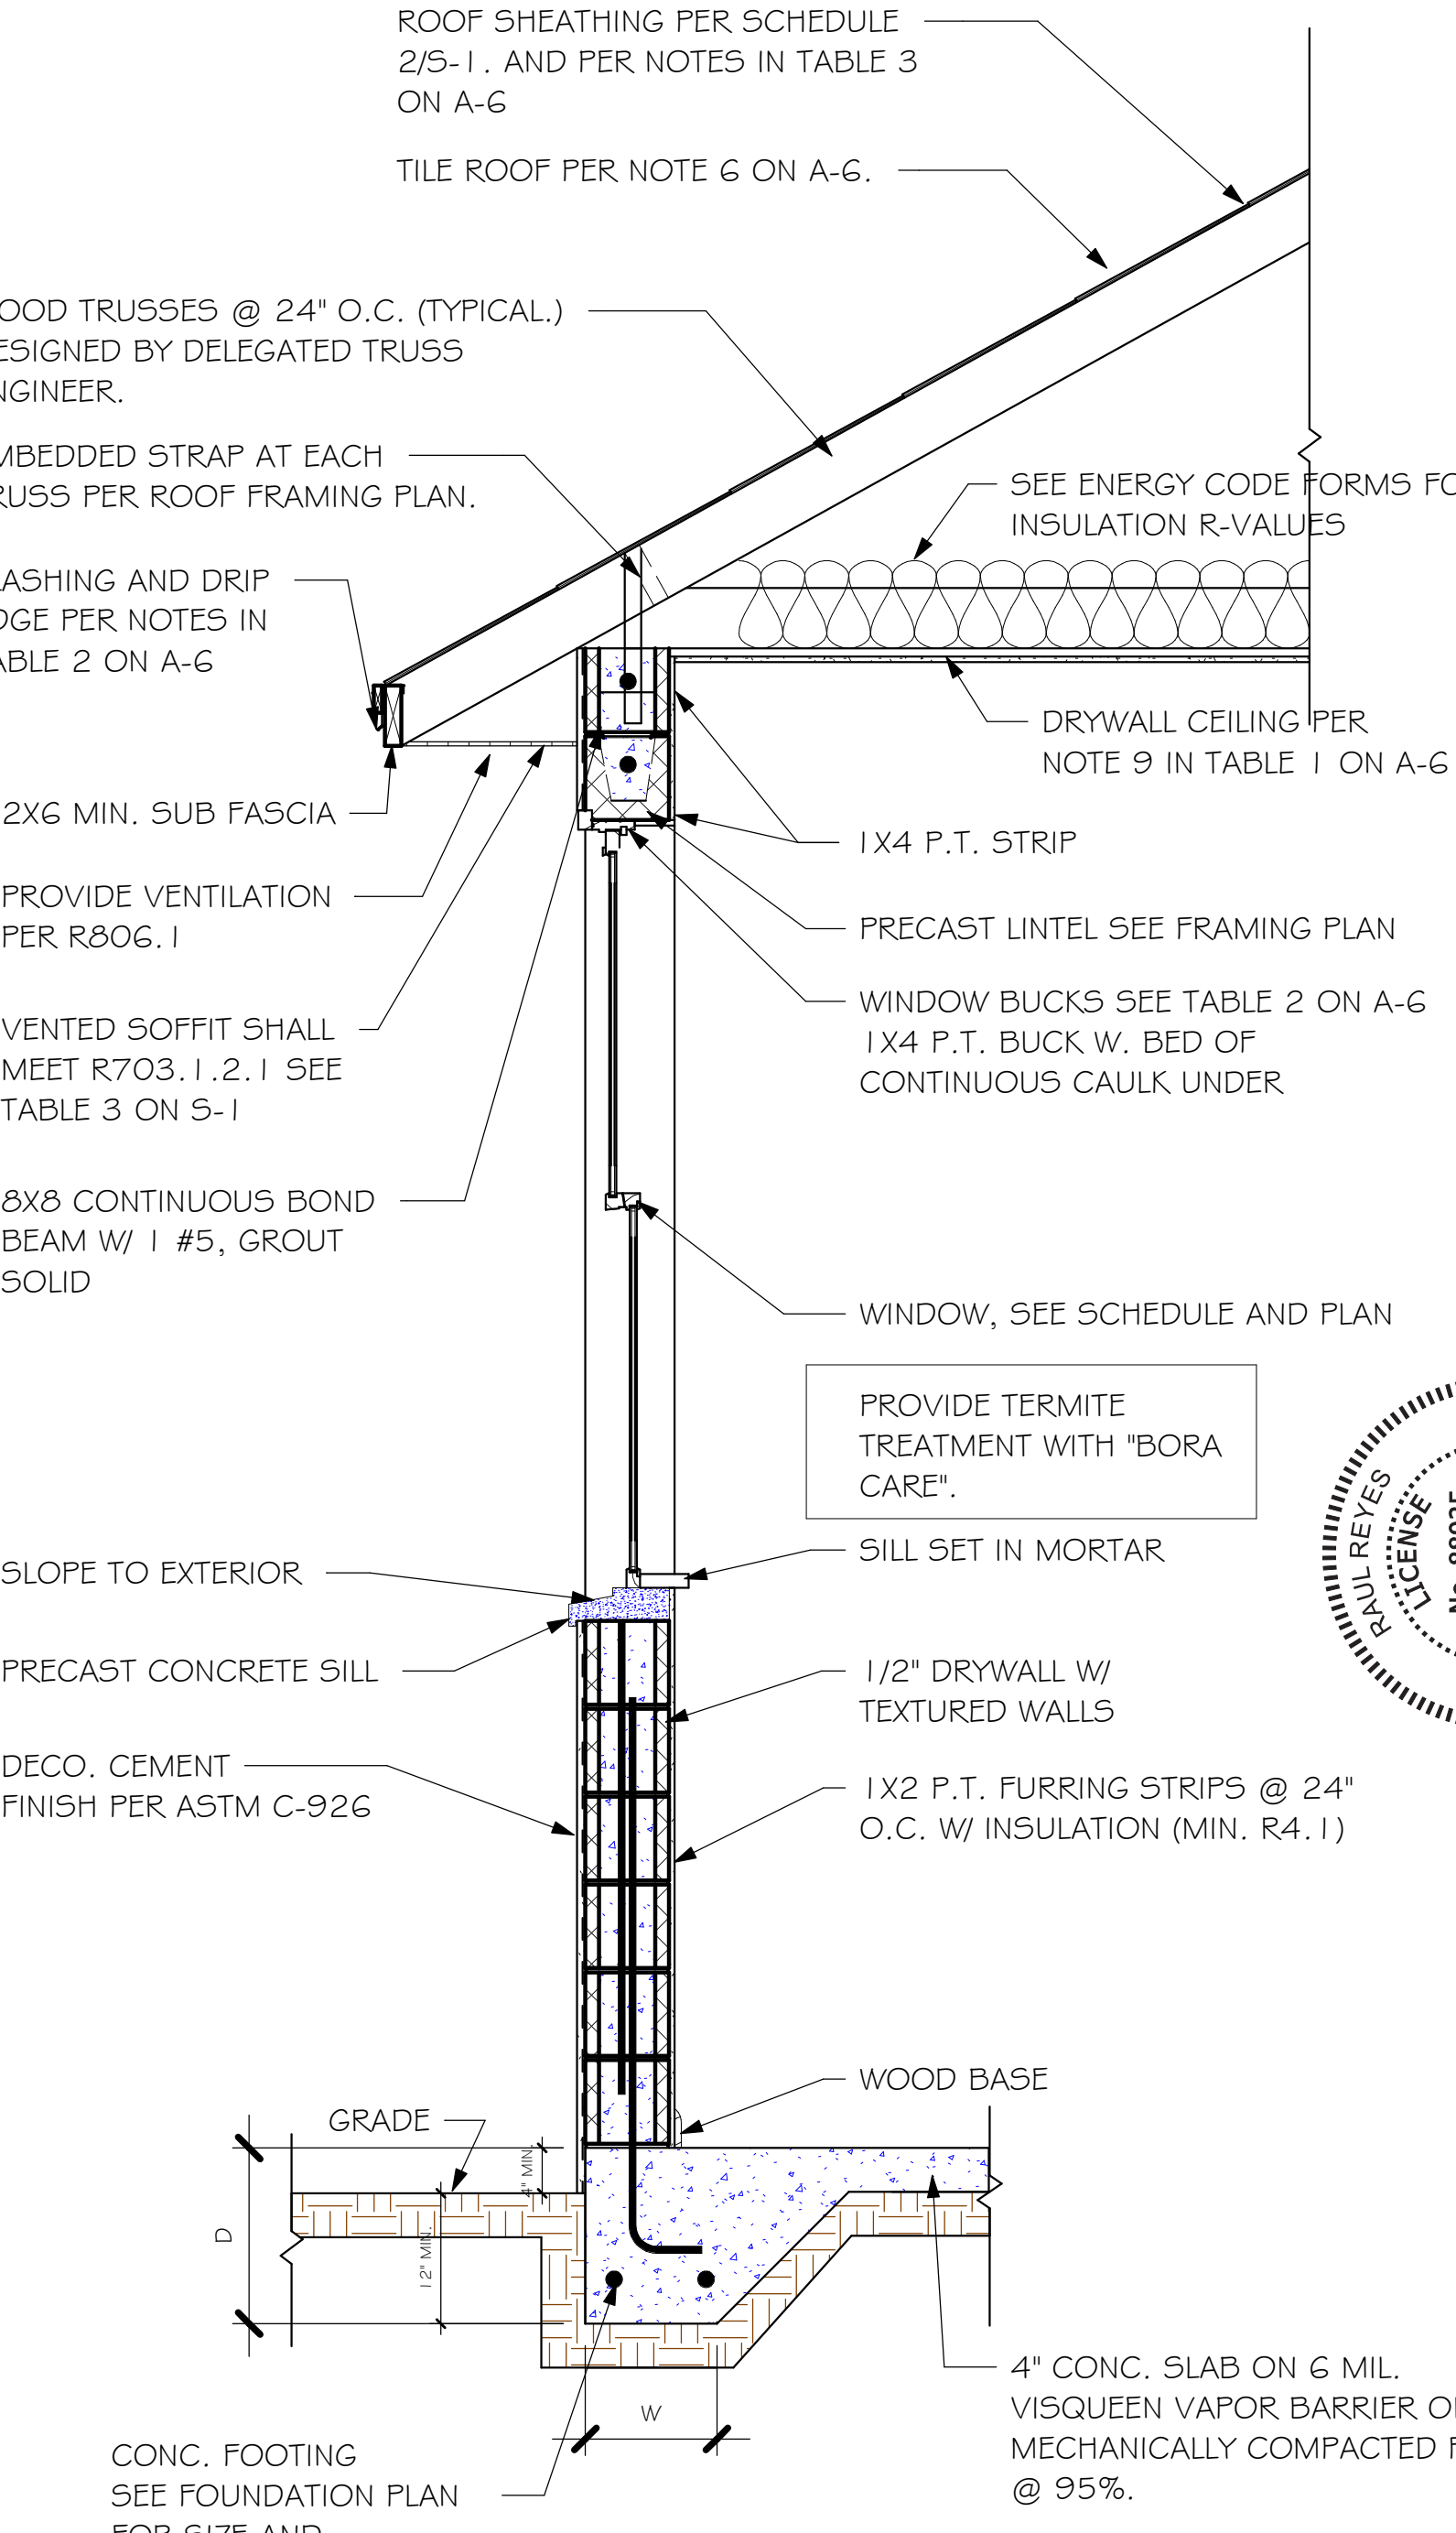

ROOF SHEATHING PER SCHEDULE 2/5-1. AND PER NOTES IN TABLE 3 ON A-6

TILE ROOF PER NOTE 6 ON A-6.

WOOD TRUSSES @ 24" O.C. (TYPICAL.) DESIGNED BY DELEGATED TRUSS ENGINEER.

EMBEDDED STRAP AT EACH TRUSS PER ROOF FRAMING PLAN.

FLASHING AND DRIP EDGE PER NOTES IN TABLE 2 ON A-6

2X6 MIN. SUB FASCIA

PROVIDE VENTILATION PER R806.1

VENTED SOFFIT SHALL MEET R703.1.2.1 SEE TABLE 3 ON S-1

8X8 CONTINUOUS BOND BEAM W/ 1 #5, GROUT SOLID

ROOF FINISHING PER PLAN

WOOD TRUSSES @ 24" O.C. (TYPICAL) DESIGNED BY DELEGATED TRUSS ENGINEER

STRAP AT TRUSS PER ROOF FRAMING PLAN

FLASHING AND DRIP EDGE PER NOTES IN TABLE 3 ON A-6

BEAM PER FRAMING PLAN

CEILING ON LANAI PER NOTE 10 IN TABLE 1 ON A-6

SEE ENERGY CODE FORMS FOR INSULATION R-VALUES

DRYWALL CEILING PER NOTE 9 IN TABLE 1 ON A-6

1X4 P.T. STRIP

PRECAST LINTEL SEE FRAMING PLAN

WINDOW BUCKS SEE TABLE 2 ON A-6 1X4 P.T. BUCK W. BED OF CONTINUOUS CAULK UNDER

WINDOW, SEE SCHEDULE AND PLAN

PROVIDE TERMITE TREATMENT WITH "BORA CARE".

SILL SET IN MORTAR

1/2" DRYWALL W/ TEXTURED WALLS

1X2 P.T. FURRING STRIPS @ 24" O.C. W/ INSULATION (MIN. R4.1)

WOOD BASE

4" CONC. SLAB ON 6 MIL. VISQUEEN VAPOR BARRIER ON MECHANICALLY COMPACTED FILL @ 95%.


CONC. FOOTING SEE FOUNDATION PLAN FOR SIZE AND REINFORCING.

DECO. CEMENT FINISH PER ASTM C-926

PRECAST CONCRETE SILL

SLOPE TO EXTERIOR

TYPICAL WALL SECTION

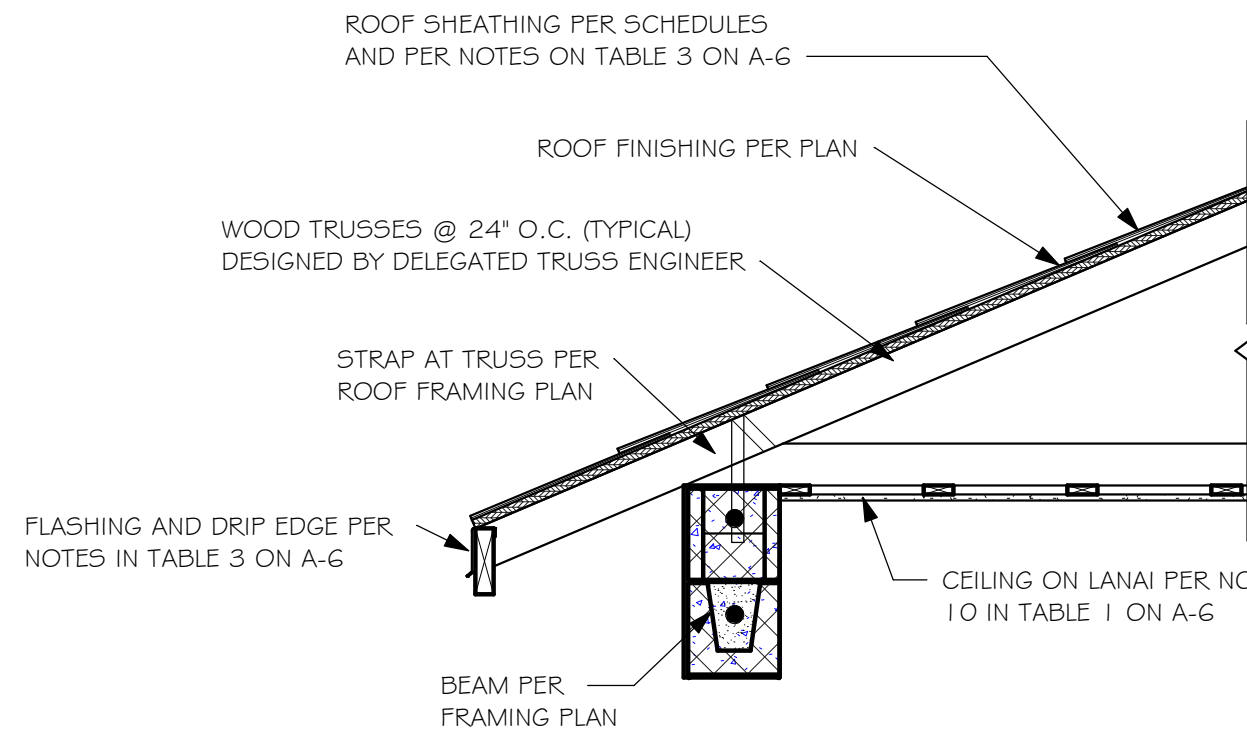

ROOF SHEATHING PER SCHEDULES AND PER NOTES ON TABLE 3 ON A-6

WOOD TRUSSES @ 24" O.C. (TYPICAL) DESIGNED BY DELEGATED TRUSS ENGINEER

STRAP AT TRUSS PER ROOF FRAMING PLAN

FLASHING AND DRIP EDGE PER NOTES IN TABLE 3 ON A-6

BEAM PER FRAMING PLAN

CEILING ON LANAI PER NOTE 10 IN TABLE 1 ON A-6

ROOF FINISHING PER PLAN

WOOD TRUSSES @ 24" O.C. (TYPICAL) DESIGNED BY DELEGATED TRUSS ENGINEER

STRAP AT TRUSS PER ROOF FRAMING PLAN

FLASHING AND DRIP EDGE PER NOTES IN TABLE 3 ON A-6

BEAM PER FRAMING PLAN

CEILING ON LANAI PER NOTE 10 IN TABLE 1 ON A-6

LANAI/ ENTRY ROOF ASSEMBLY

3/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

D.R.HORTON NYSE LISTED
America's Builder

Gulf Coast Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM PHONE: 239-540-8222
1515 SE 47th ST. CAPE CORAL, FL 33904

STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1515 SE 47th ST. CAPE CORAL, FL 33904
(239) 549-4254
CEN 889



PROFESSIONAL ENGINEER
No. 88925
STATE OF FLORIDA
P.L. LICENSE

LOT: 7-B
SUBDIVISION: ENBROOK
ADDRES: 1167-1163 TRANQUIL BROOK DR
D.R.H. #: 579640007-008

MODEL 1503
VILLA F
GCD JOB # 11820



DATE: 09/09/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: SECTIONS
SCALE: As indicated

A-6

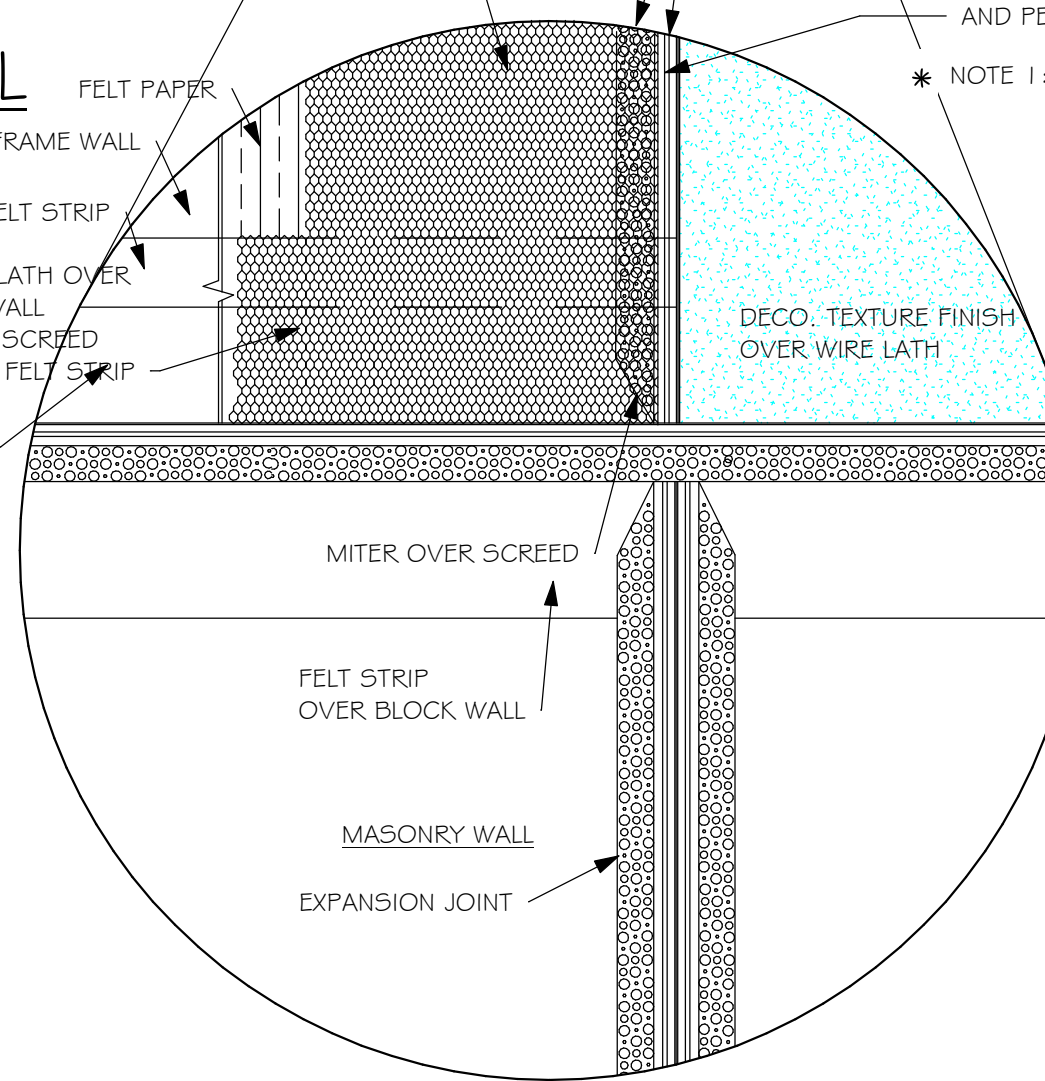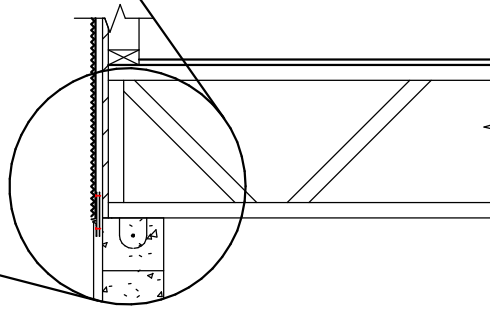


WEEP SCREED DETAIL

INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE
WOOD STUD FRAMING IS ABOVE MASONRY WALLS

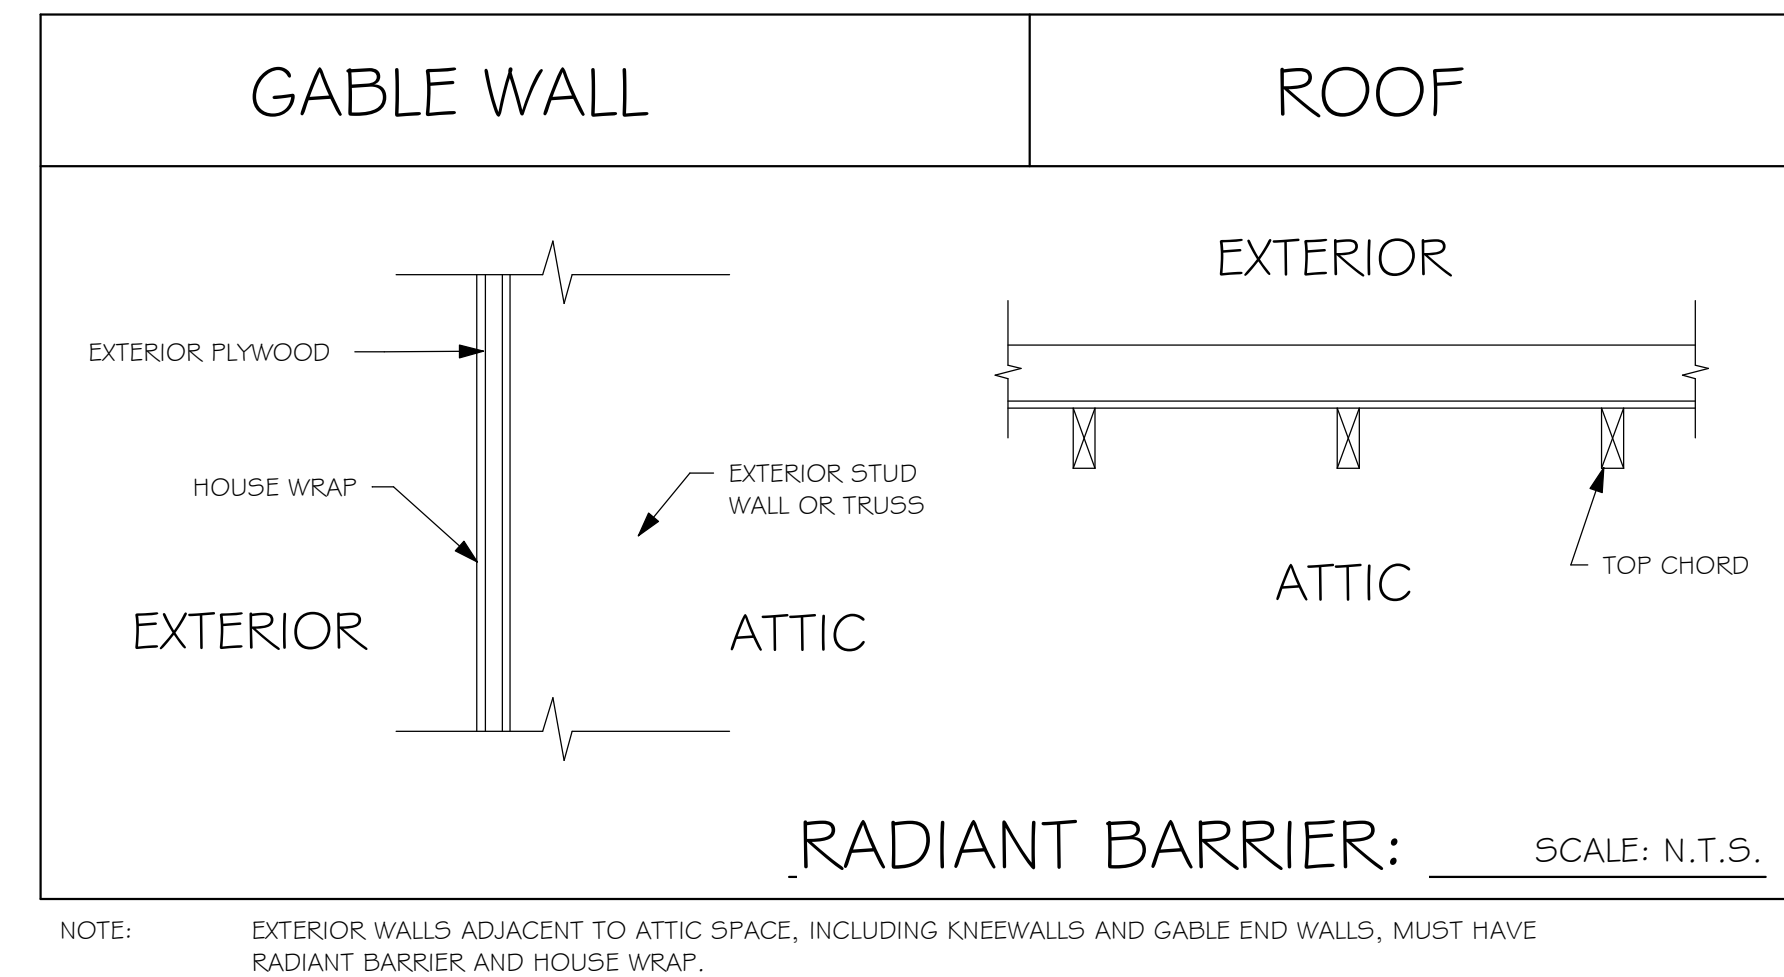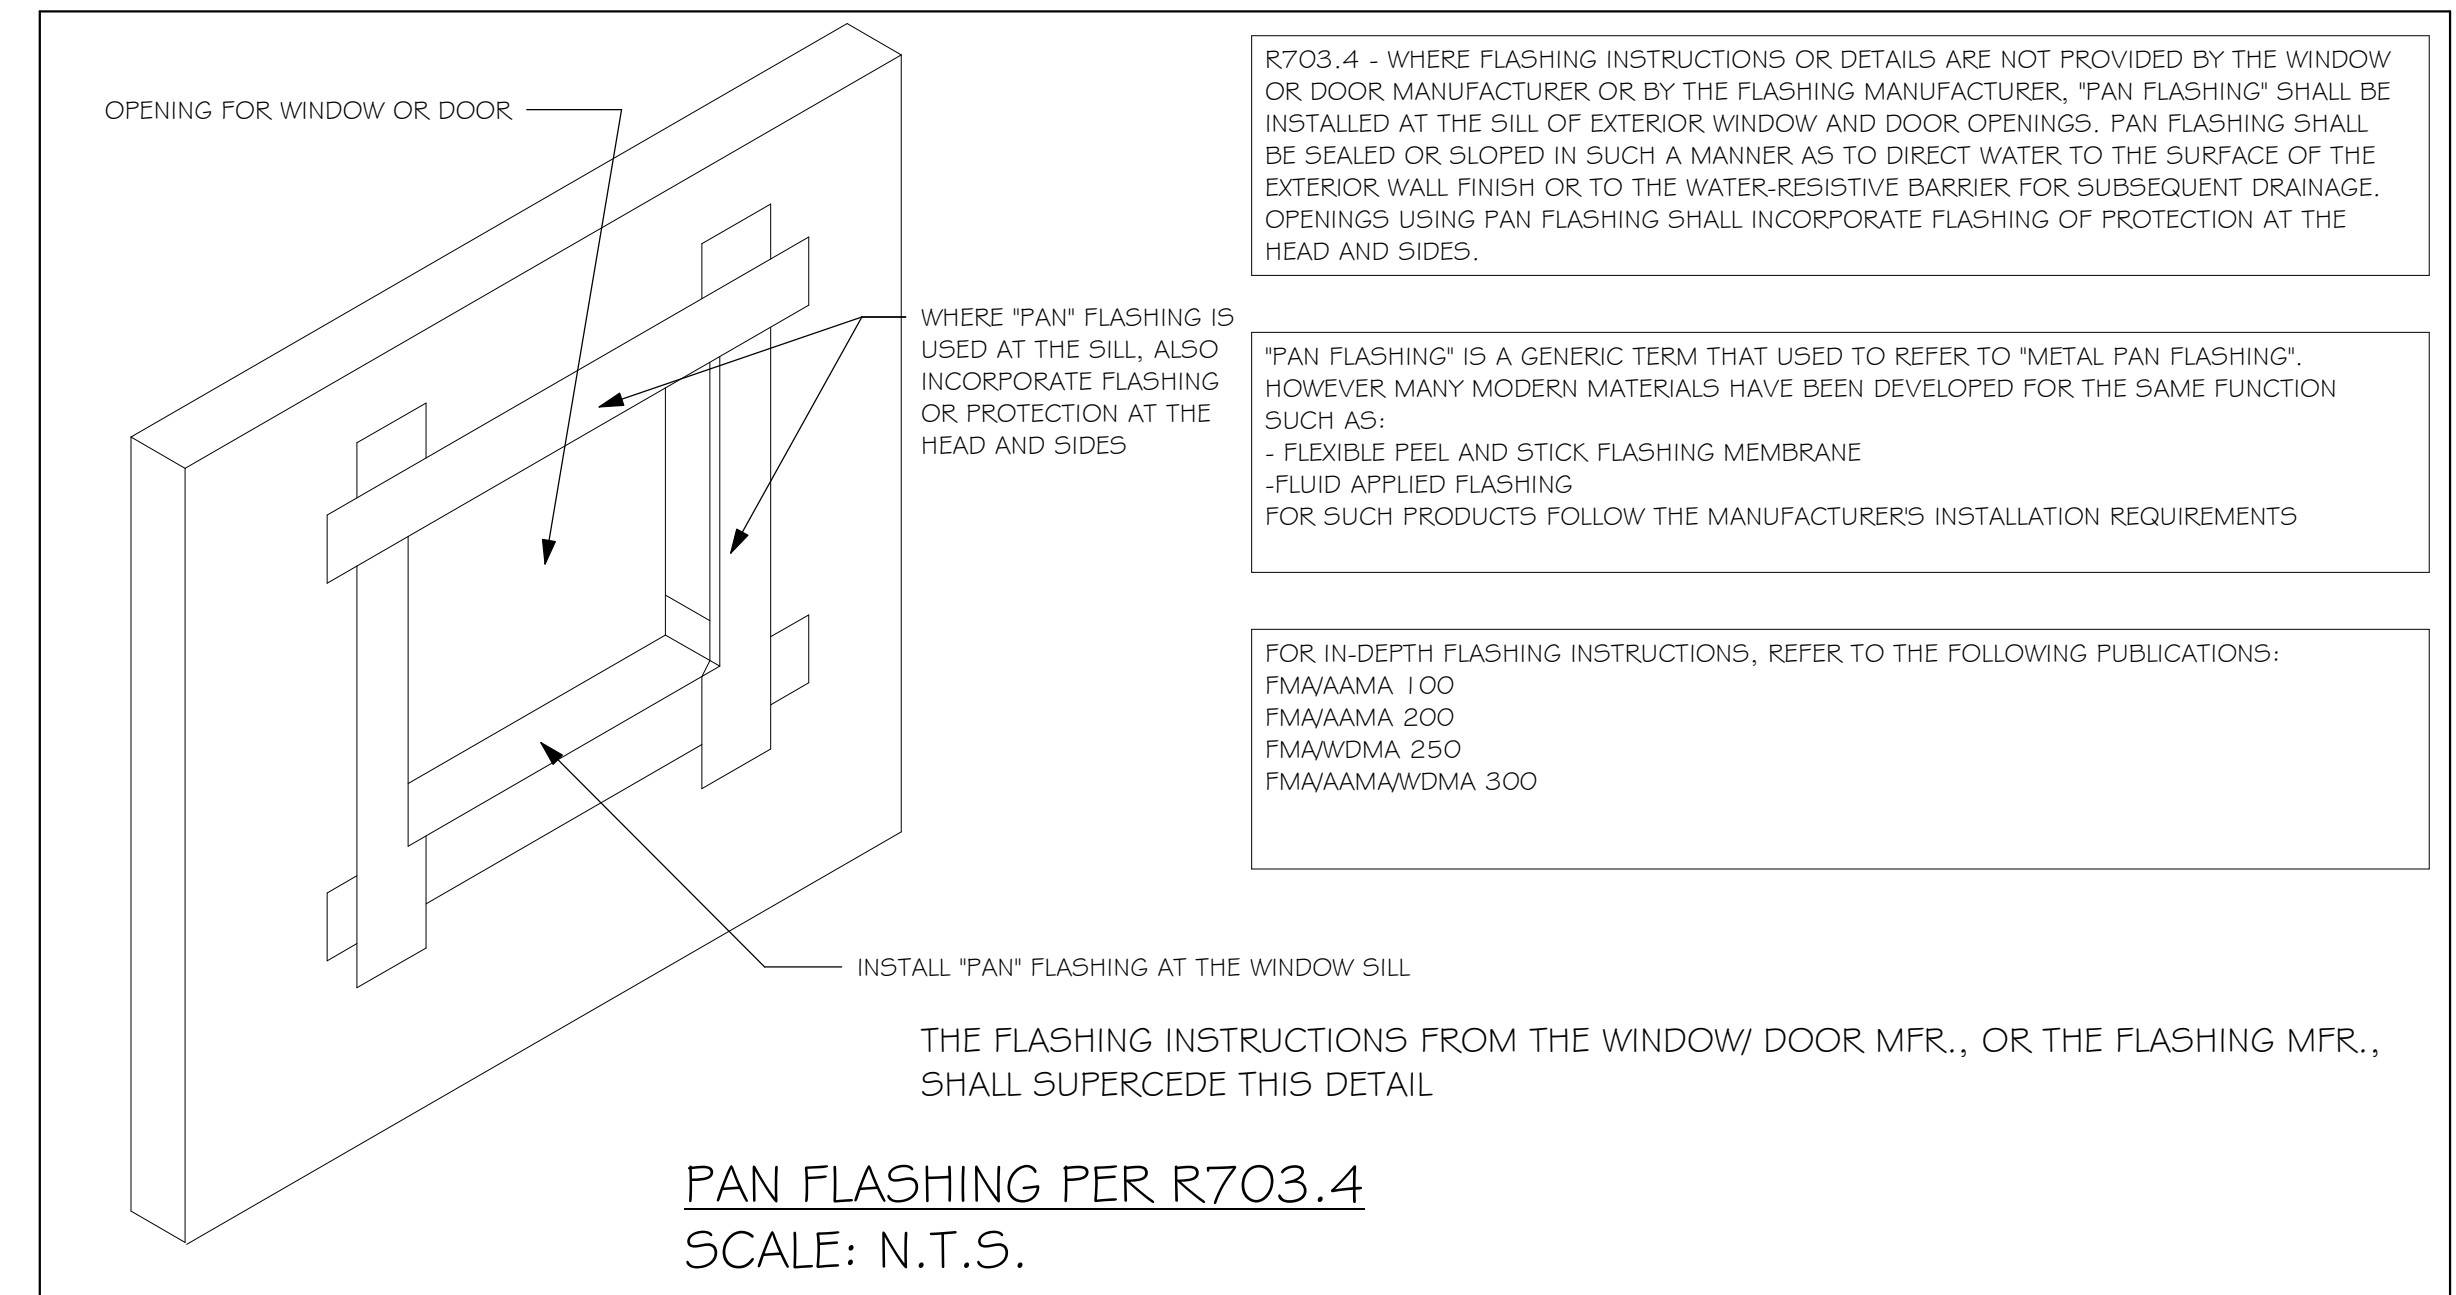


NOTE: EXTERIOR WALLS ADJACENT TO ATTIC SPACE, INCLUDING KNEEWALLS AND GABLE END WALLS, MUST HAVE RADIANT BARRIER AND HOUSE WRAP.

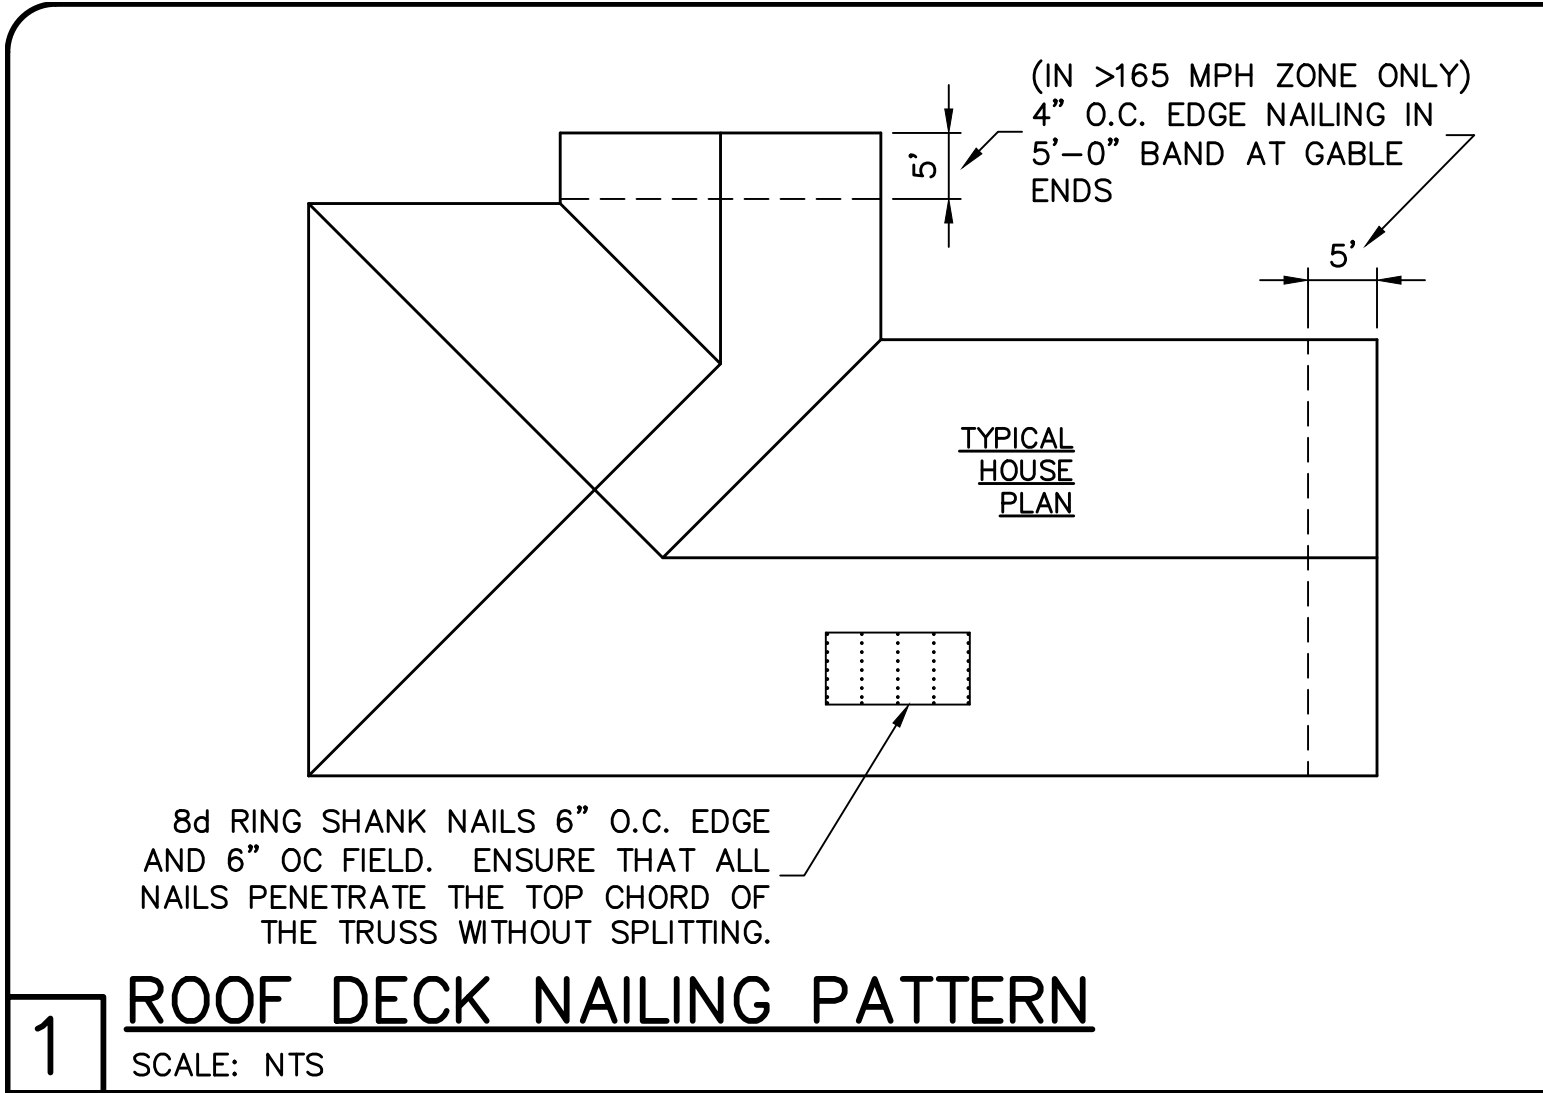


1 **ROOF DECK NAILING PATTERN**
SCALE: NTS

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD, PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED) (RING SHANK NAILS PER FB03.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 3/8" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.


2 **NOTE:** EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

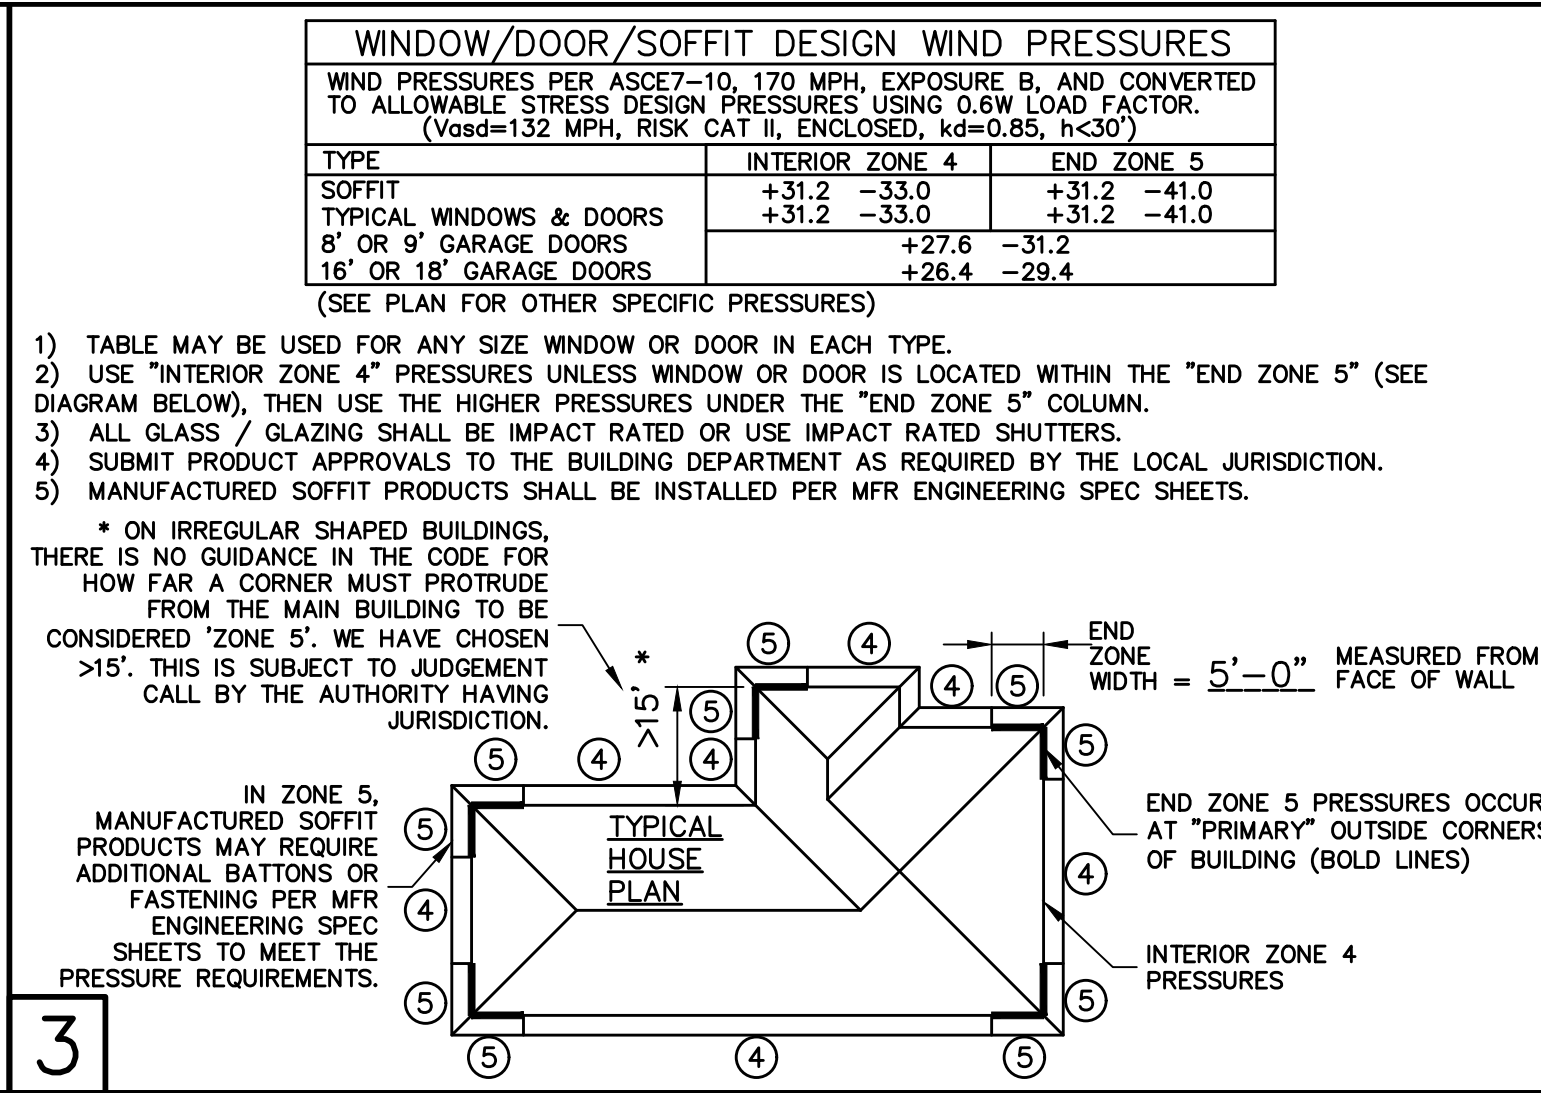


3 **WINDOW/DOOR/SOFFIT DESIGN WIND PRESSURES**
WIND PRESSURES PER ASCE7-10, 170 MPH, EXPOSURE B, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vgnd=132 MPH, RISK CAT II, ENCLOSED, Kd=0.85, I=307)
(SEE PLAN FOR OTHER SPECIFIC PRESSURES)
1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.
2) USE "INTERIOR ZONE 4" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "END ZONE 5" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "END ZONE 5" COLUMN.
3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.
4) SUBMIT PRODUCT APPROVALS TO THE BUILDING DEPARTMENT AS REQUIRED BY THE LOCAL JURISDICTION.
5) MANUFACTURED SOFFIT PRODUCTS SHALL BE INSTALLED PER MFR ENGINEERING SPEC SHEETS.
6) ON IRREGULAR SHAPED BUILDINGS, THERE IS NO GUIDANCE IN THE CODE FOR HOW FAR A CORNER MUST PROTRUDE FROM THE MAIN BUILDING TO BE CONSIDERED "ZONE 5". WE HAVE CHOSEN >15'. THIS IS SUBJECT TO JUDGEMENT CALL BY THE AUTHORITY HAVING JURISDICTION.
7) IN ZONE 5, MANUFACTURED SOFFIT PRODUCTS MAY REQUIRE ADDITIONAL BATTENS OR FASTENING PER MFR ENGINEERING SPEC SHEETS TO MEET THE PRESSURE REQUIREMENTS.
8) END ZONE 5 PRESSURES OCCUR AT "PRIMARY" OUTSIDE CORNERS OF BUILDING (BOLD LINES)
9) INTERIOR ZONE 4 PRESSURES

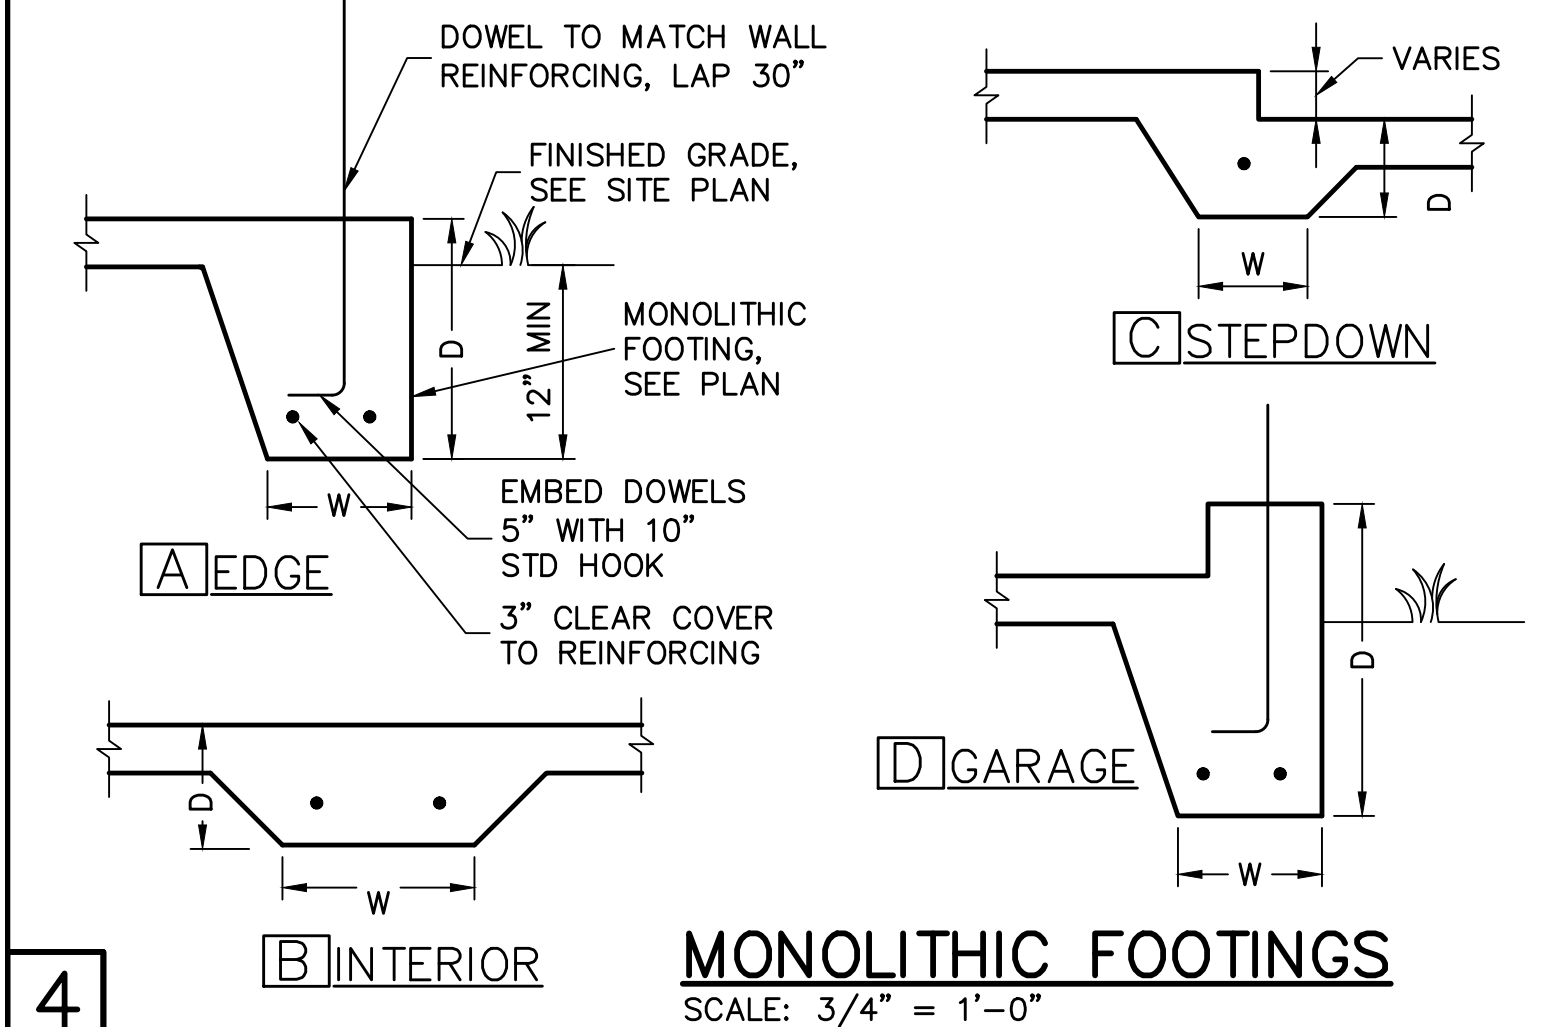

4 **MONOLITHIC FOOTINGS**
SCALE: 3/4" = 1'-0"

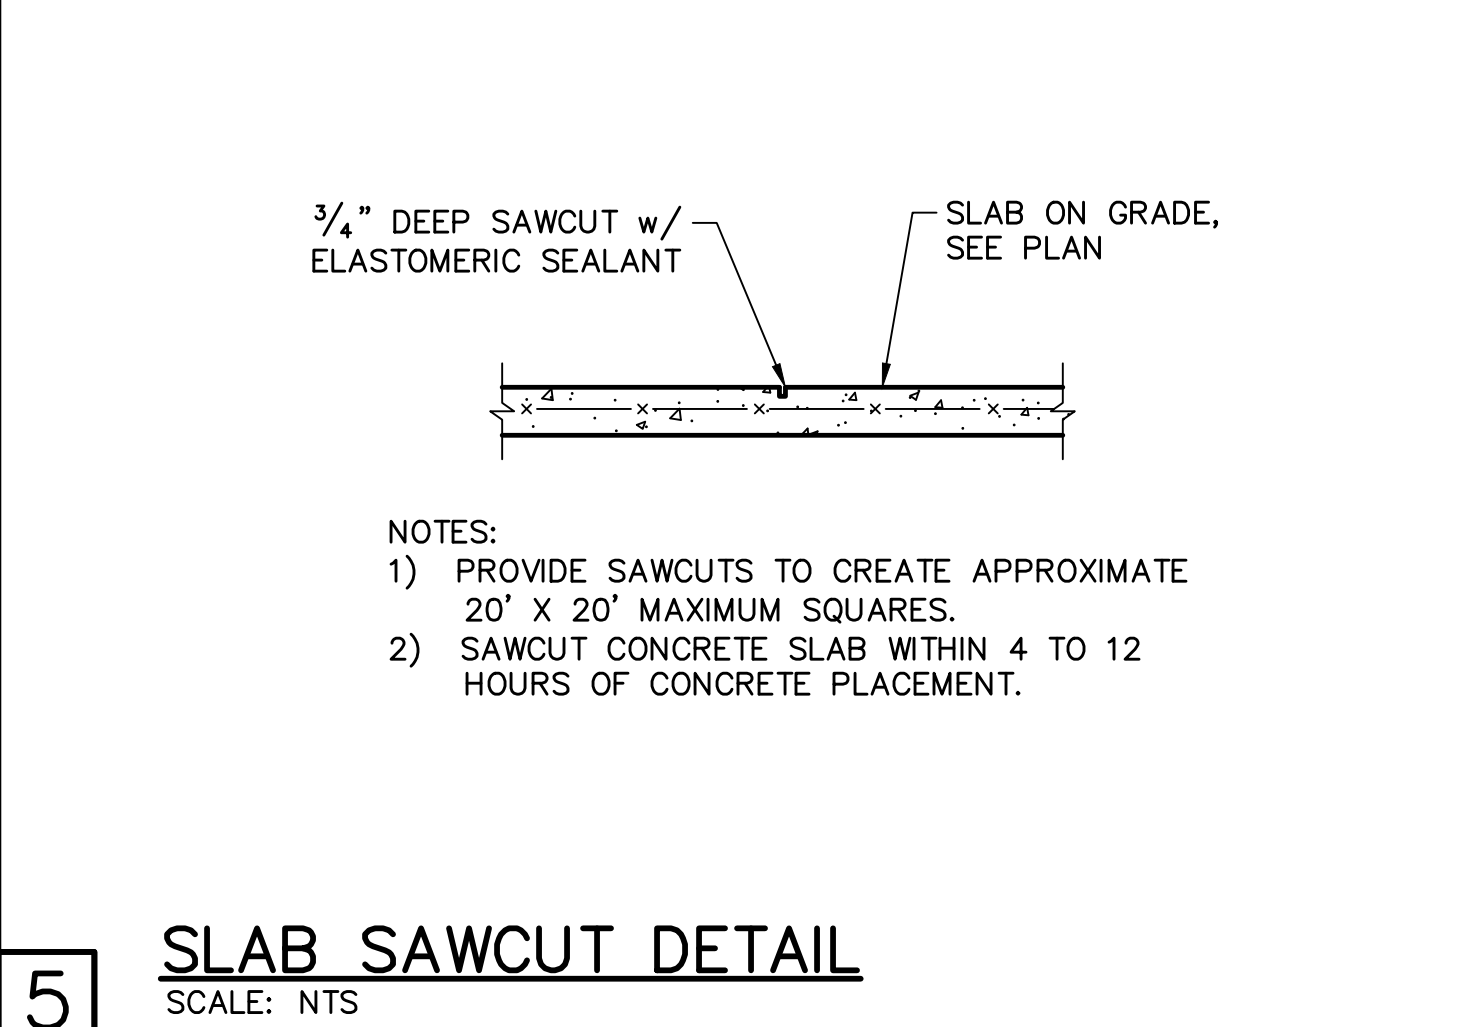


5 **SLAB SAWCUT DETAIL**
SCALE: NTS

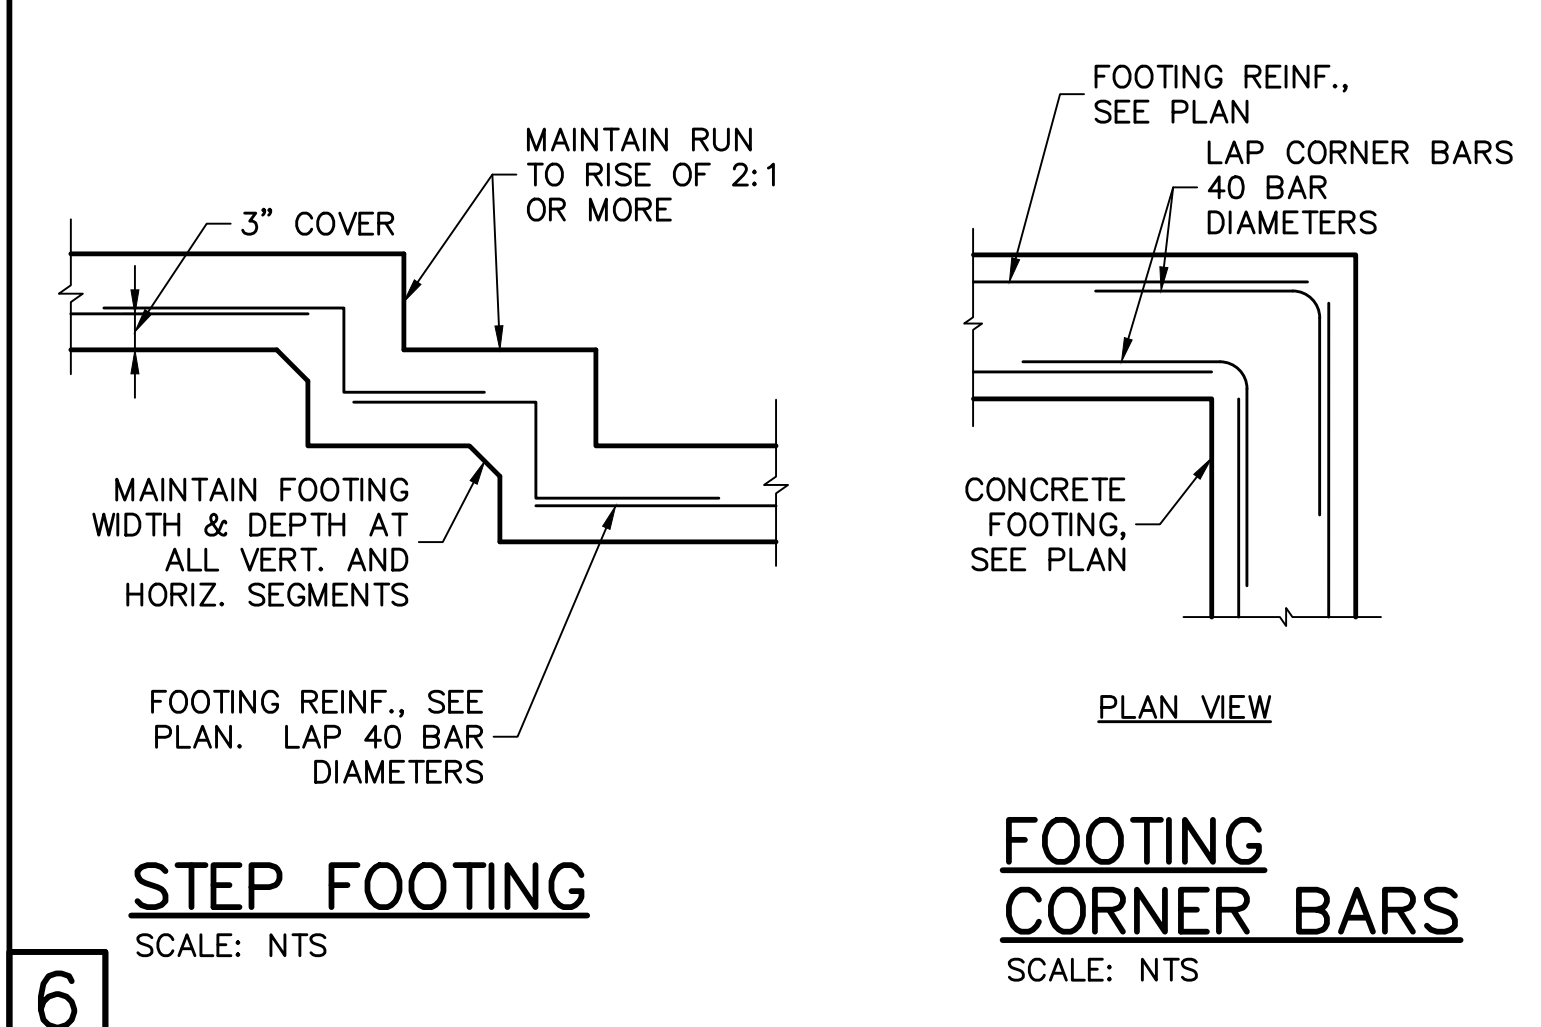


6 **STEP FOOTING**
SCALE: NTS


7 **FOOTING CORNER BARS**
SCALE: NTS

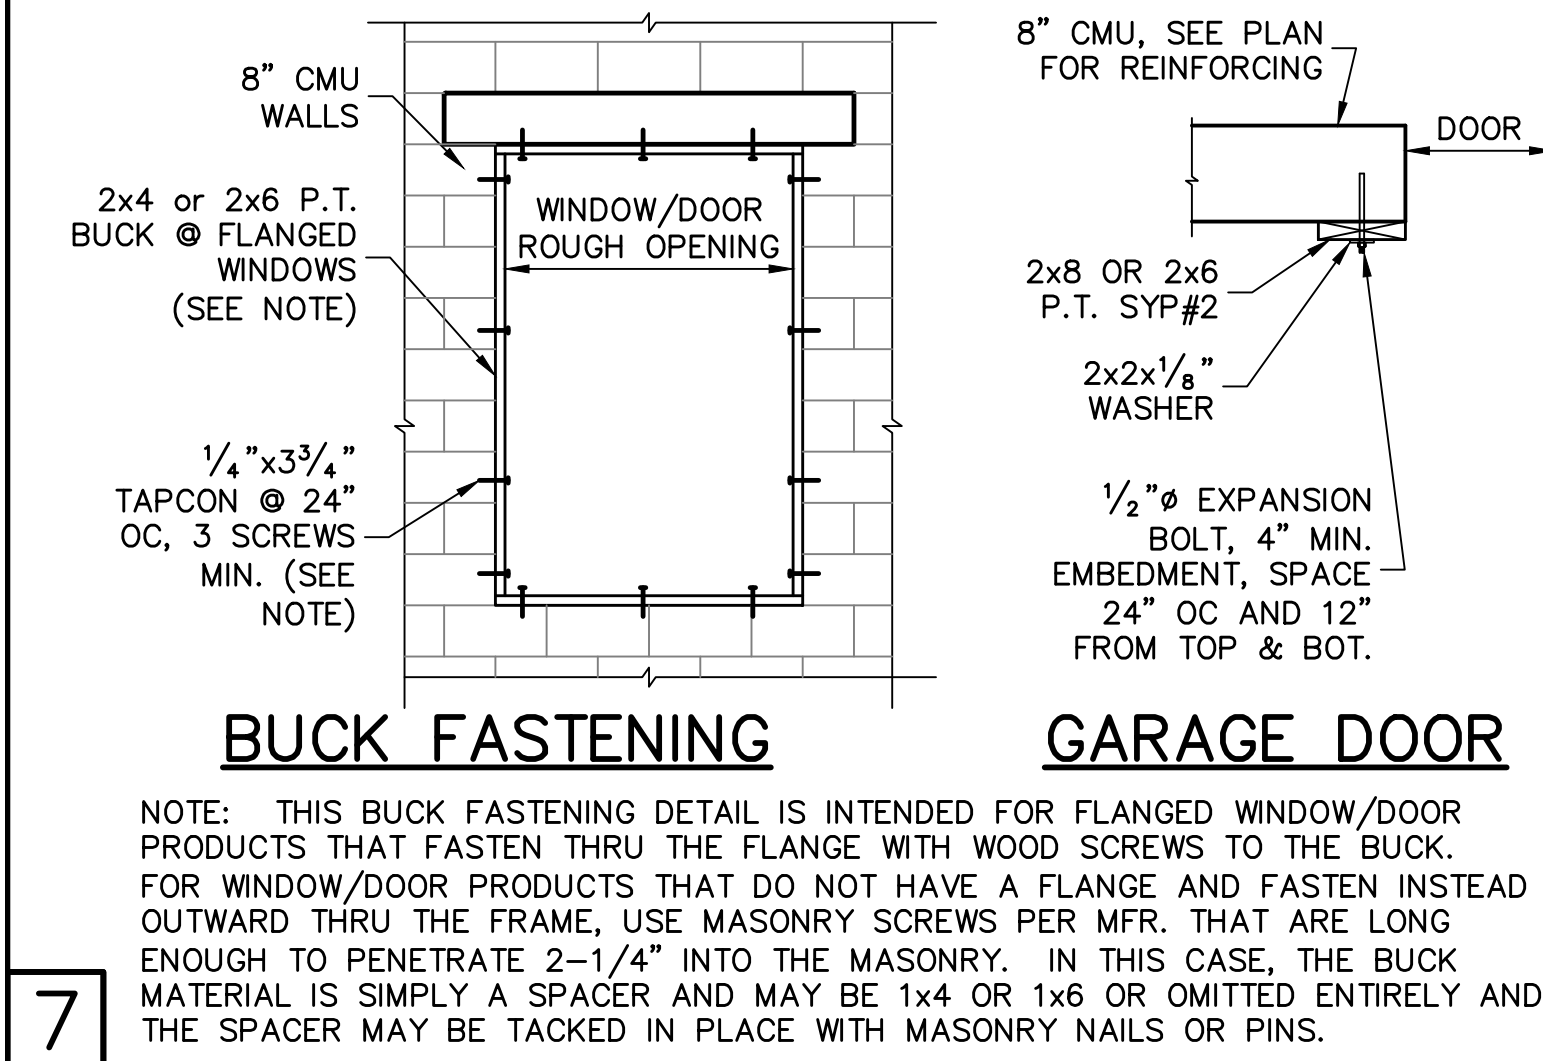

7 **BUCK FASTENING**
GARAGE DOOR

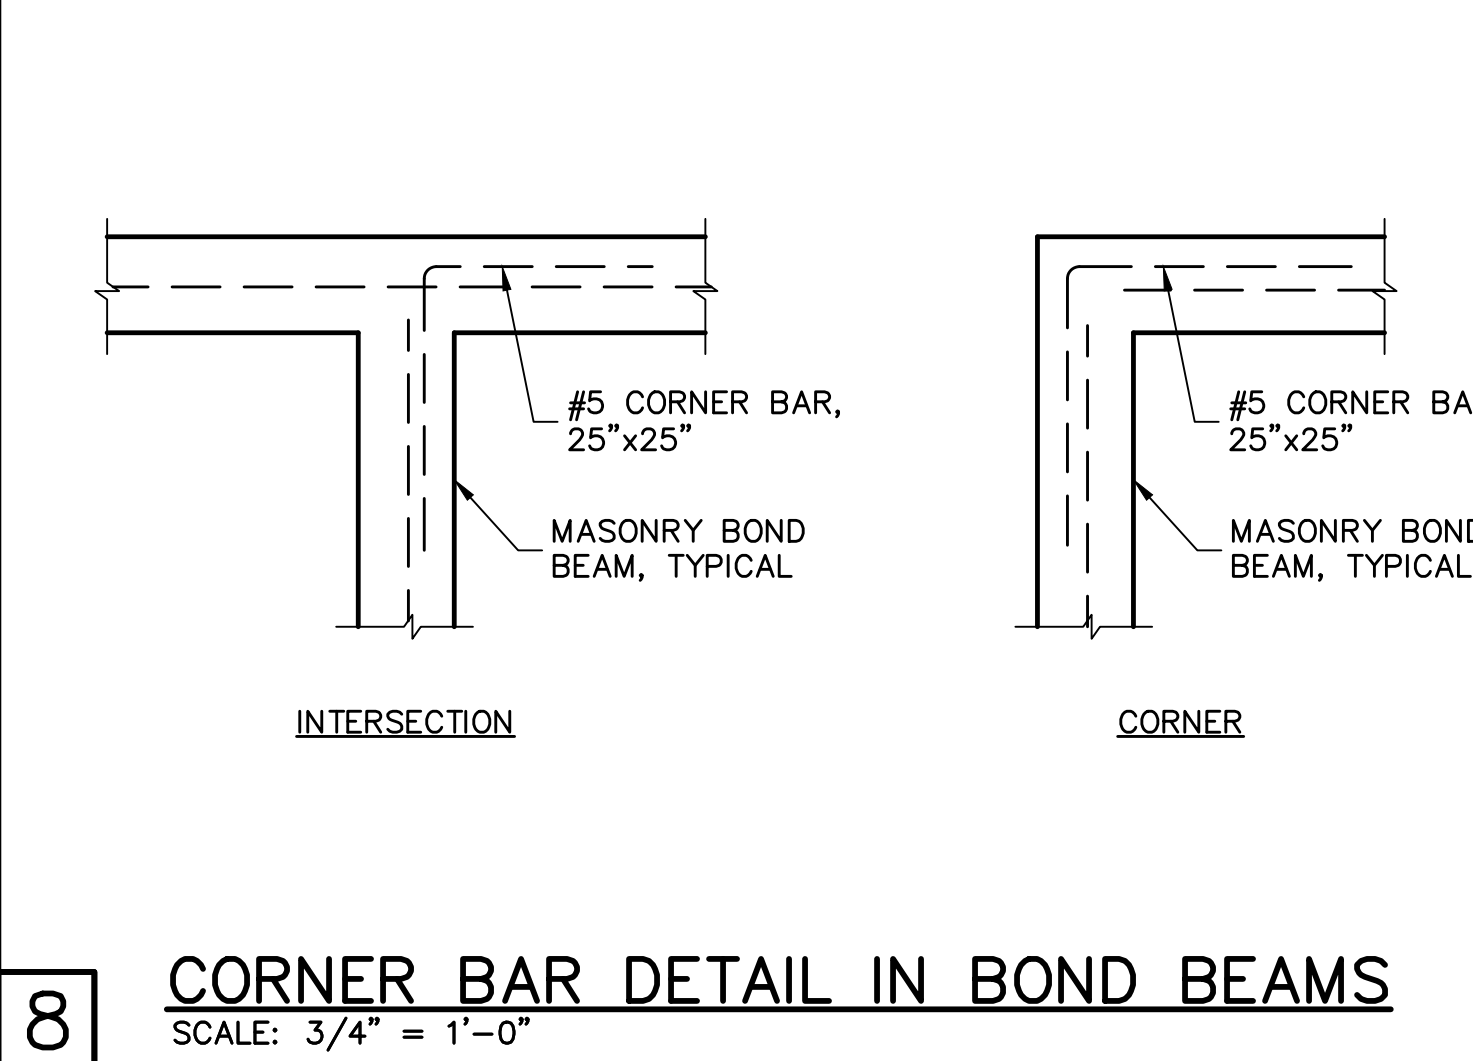

8 **CORNER BAR DETAIL IN BOND BEAMS**
SCALE: 3/4" = 1'-0"

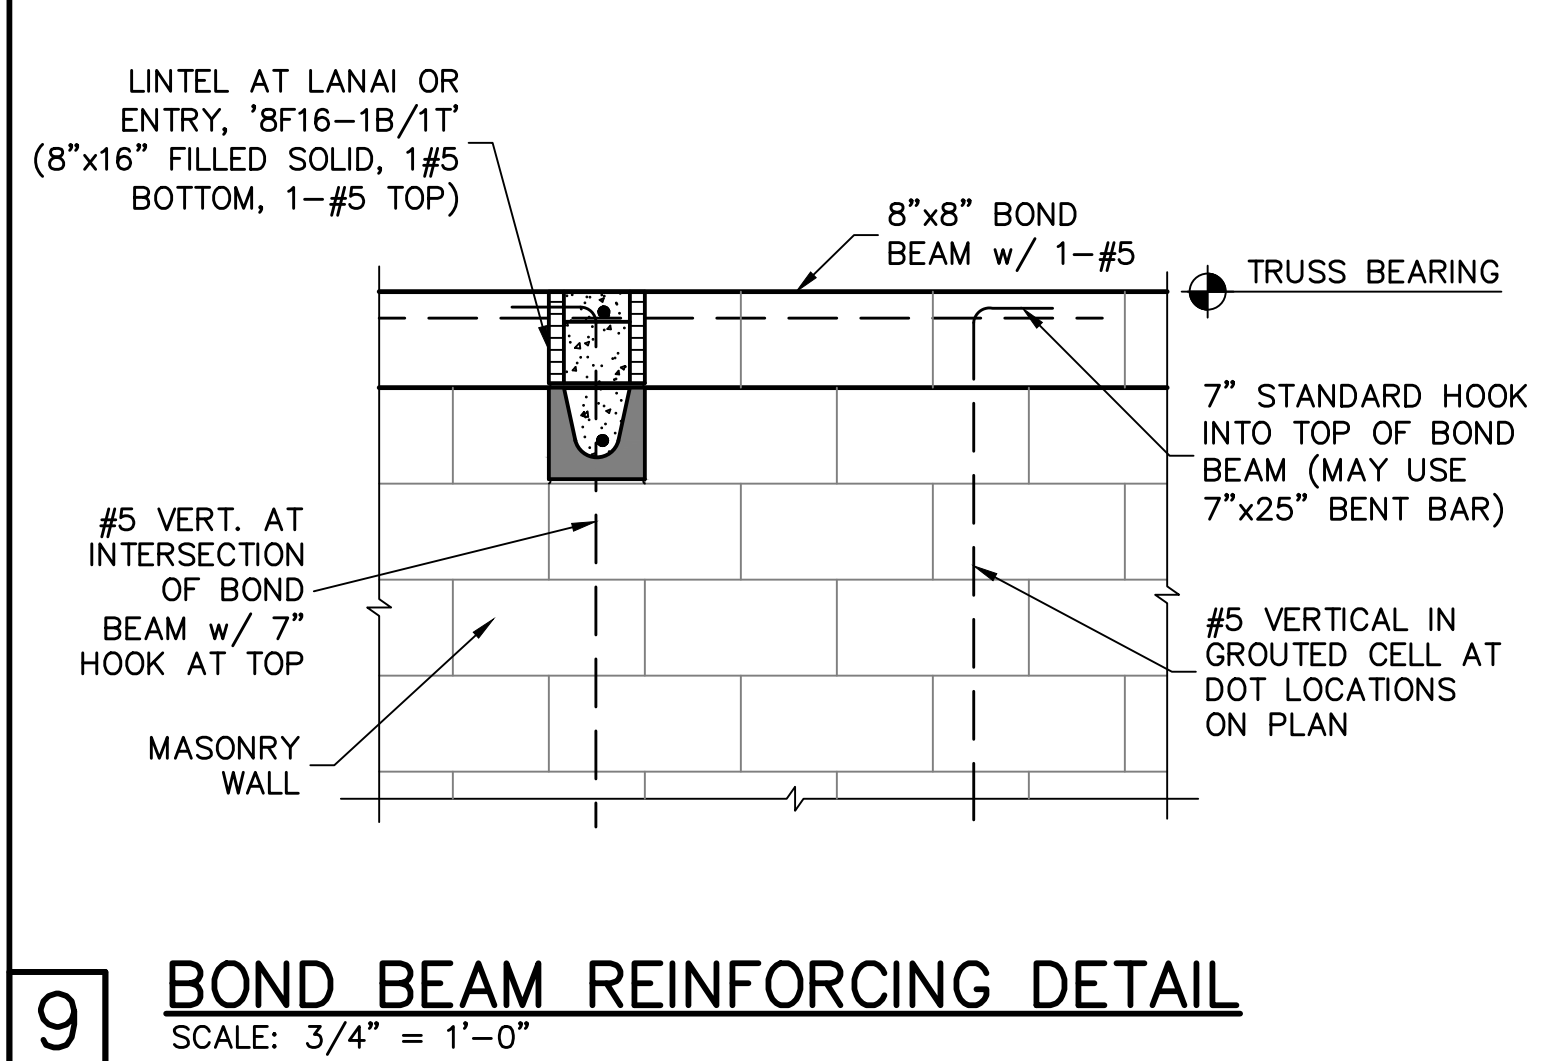


9 **BOND BEAM REINFORCING DETAIL**
SCALE: 3/4" = 1'-0"


RETROFIT STRAPS TO CONCRETE/MASONRY		
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR	
TO 840	1-MTSM16 or 20	7-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 1045	1-HTSM16 or 20	8-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 2090	2-HTSM16 or 20	8-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 4300	2-LGT2	16-16d, 7-1/4x2 1/4" TITEN
TO 3480	HTT16	18-16d, 3/8" ALLTHREAD, DRILL & EPOXY 10" EMBED W/ SIMPSON SET.
TO 10530	HGT-2/3	TWO 3/4" ALLTHREAD, DRILL & EPOXY 12" EMBED WITH SIMPSON SET.

NOTES:
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

10 **RETROFIT UPLIFT CONNECTOR SCHEDULE**

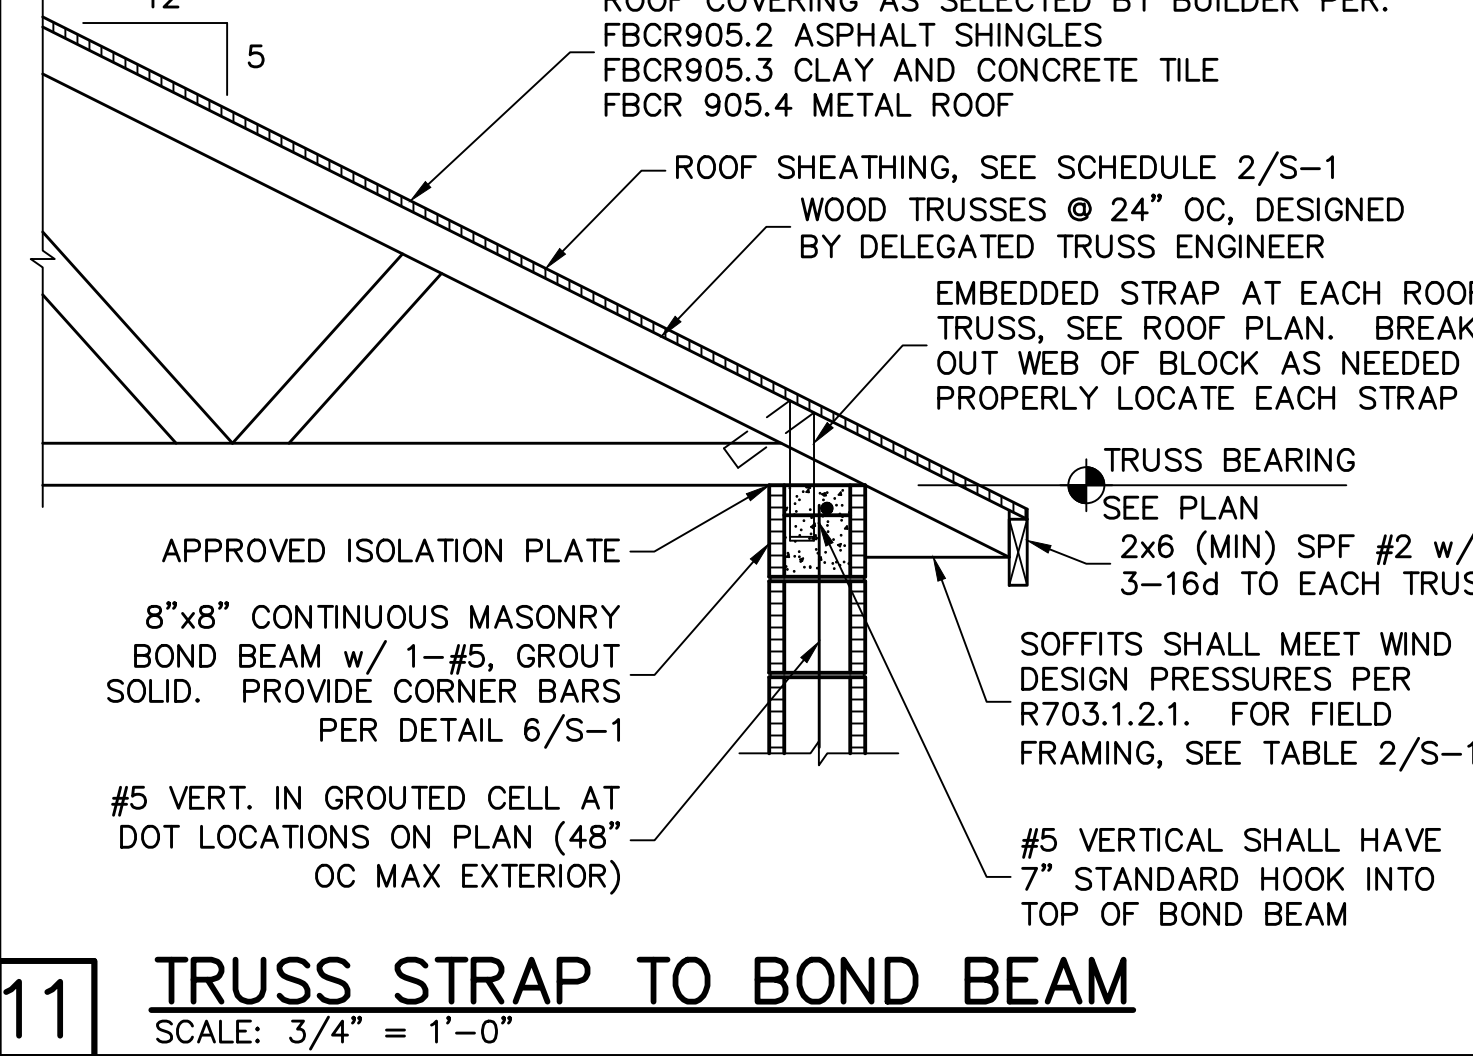

11 **TRUSS STRAP TO BOND BEAM**
SCALE: 3/4" = 1'-0"

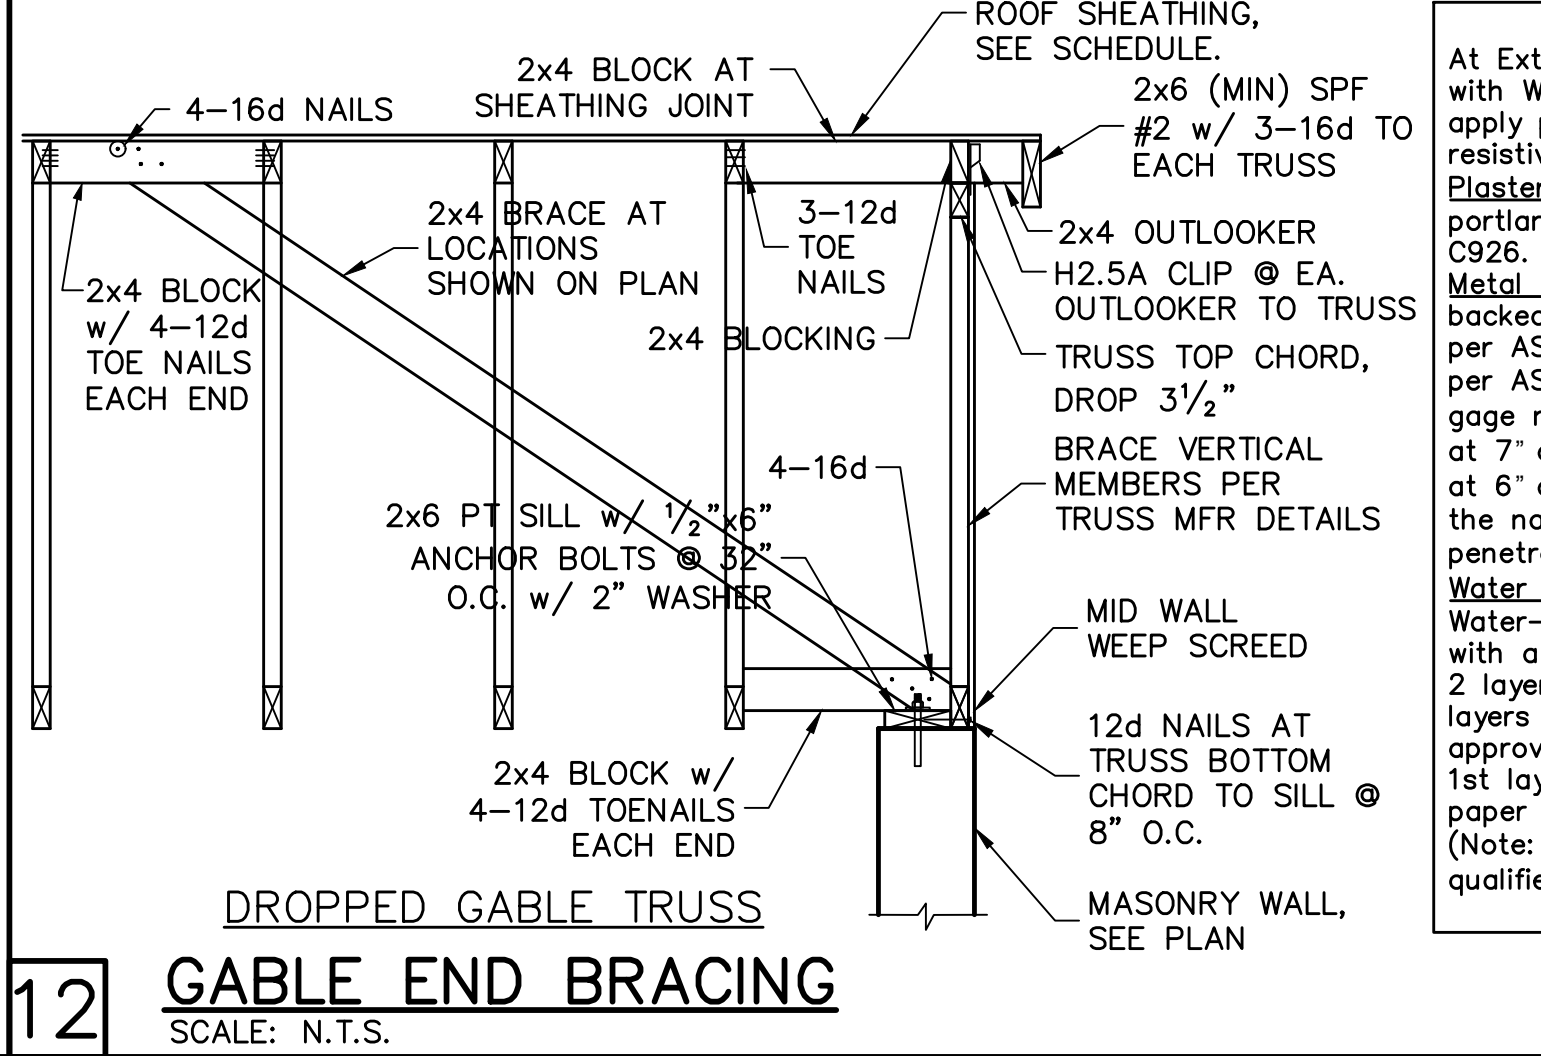

12 **GABLE END BRACING**
SCALE: N.T.S.

DESIGN CRITERIA:
DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL.

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF
DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER ASCE7-10
BASIC WIND SPEED (ASCE7-10) 170 MPH
NOMINAL WIND SPEED (Vgnd TABLE R301.2.1.3) 132 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE B
MEAN ROOF HEIGHT < 30 FT
ROOF PITCH 5/12
ENCLOSURE CLASS ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH.
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3" CENTERED
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3
GRADE 60 FOR #4 TO #11

WELDED WIRE FABRIC - ASTM A185

SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.

FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER ACI 530-13
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI

REINFORCING STEEL - ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.


5. DELEGATED-ENGINEERED WOOD ROOF & FLOOR TRUSSES:
ALL WOOD ROOF AND FLOOR TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS
SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

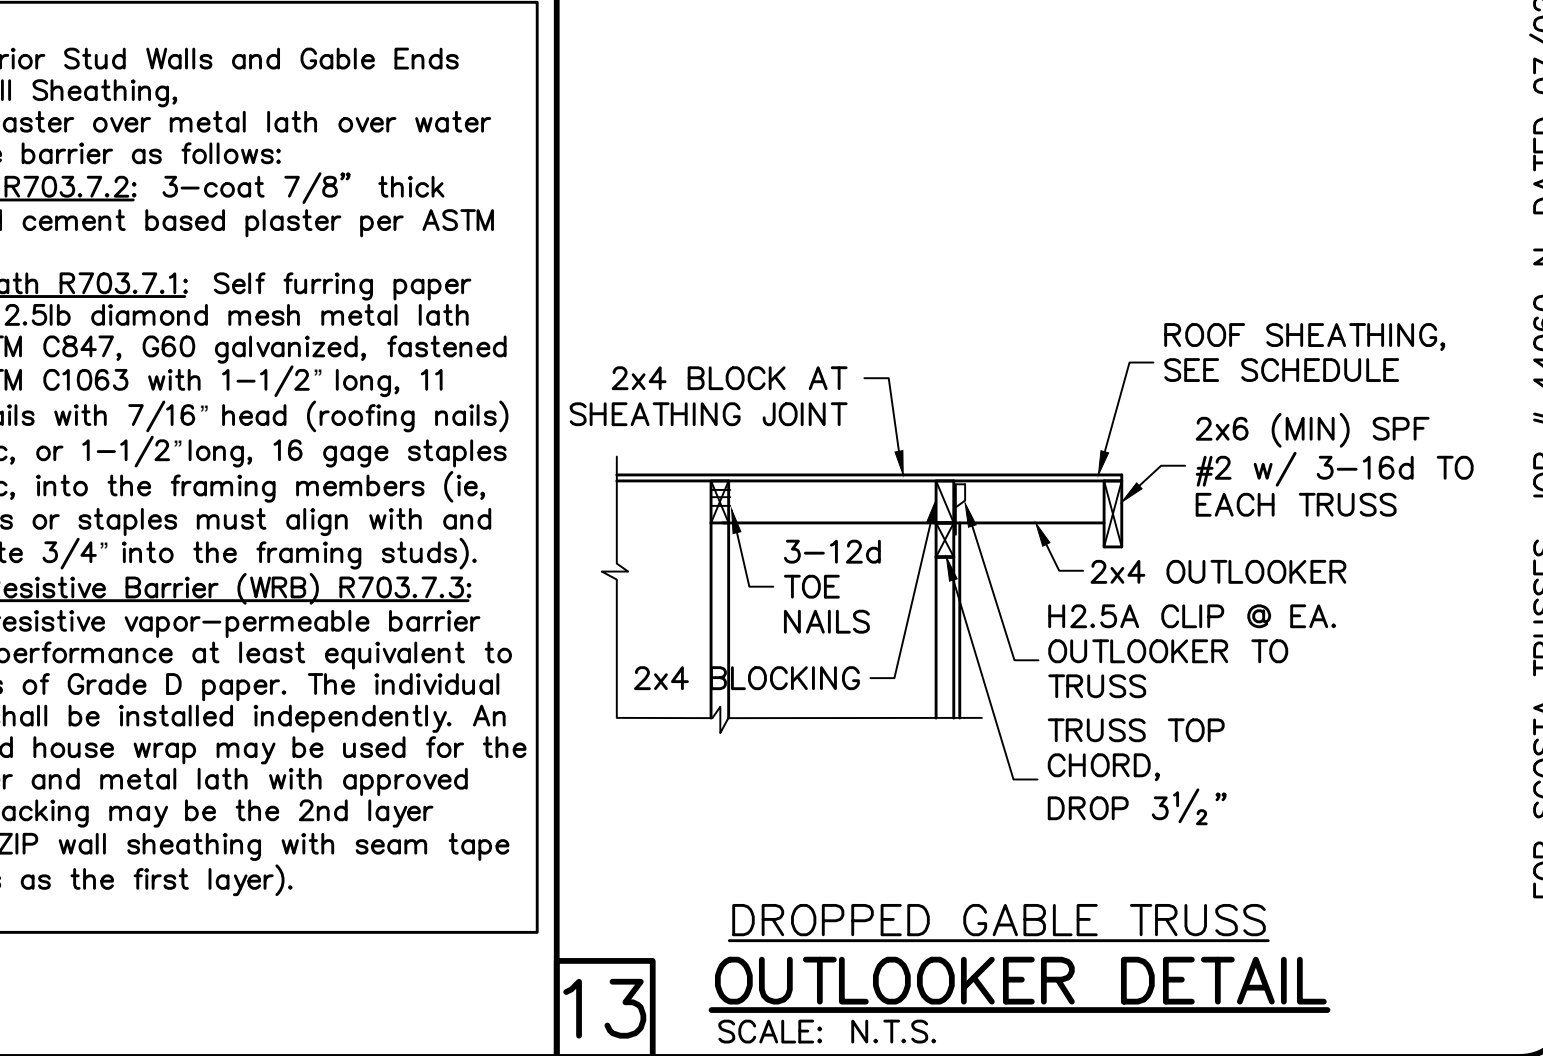

13 **DROPPED GABLE TRUSS OUTLOOKER DETAIL**
SCALE: N.T.S.

REVISIONS

BY

STRUCTURAL ENGINEERING:

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

SEAL

RECEIVED

FLORIDA

PROFESSIONAL ENGINEER

No. 88925

STATE OF FLORIDA

D.R. HOHON

America's Builder

STRUCTURAL DETAILS FOR

1503 SIGNATURE VILLA

1163, 1167 TRANQUIL BROOK DRIVE
NAPLES, FLORIDA
LOT: 7-8 SUBDIVISION: ENBROOK

DESIGN/DRAWN

DWB/DWB

CHECKED

DWB

DATE

09/10/20

SCALE

AS NOTED

JOB NO.







DR 11820

SHEET

S-1


SHEET 1 OF 2

FOR SCOSTA TRUSSES, JOB # 44060-N, DATED 07/02/19, REVISED: 08/06/19

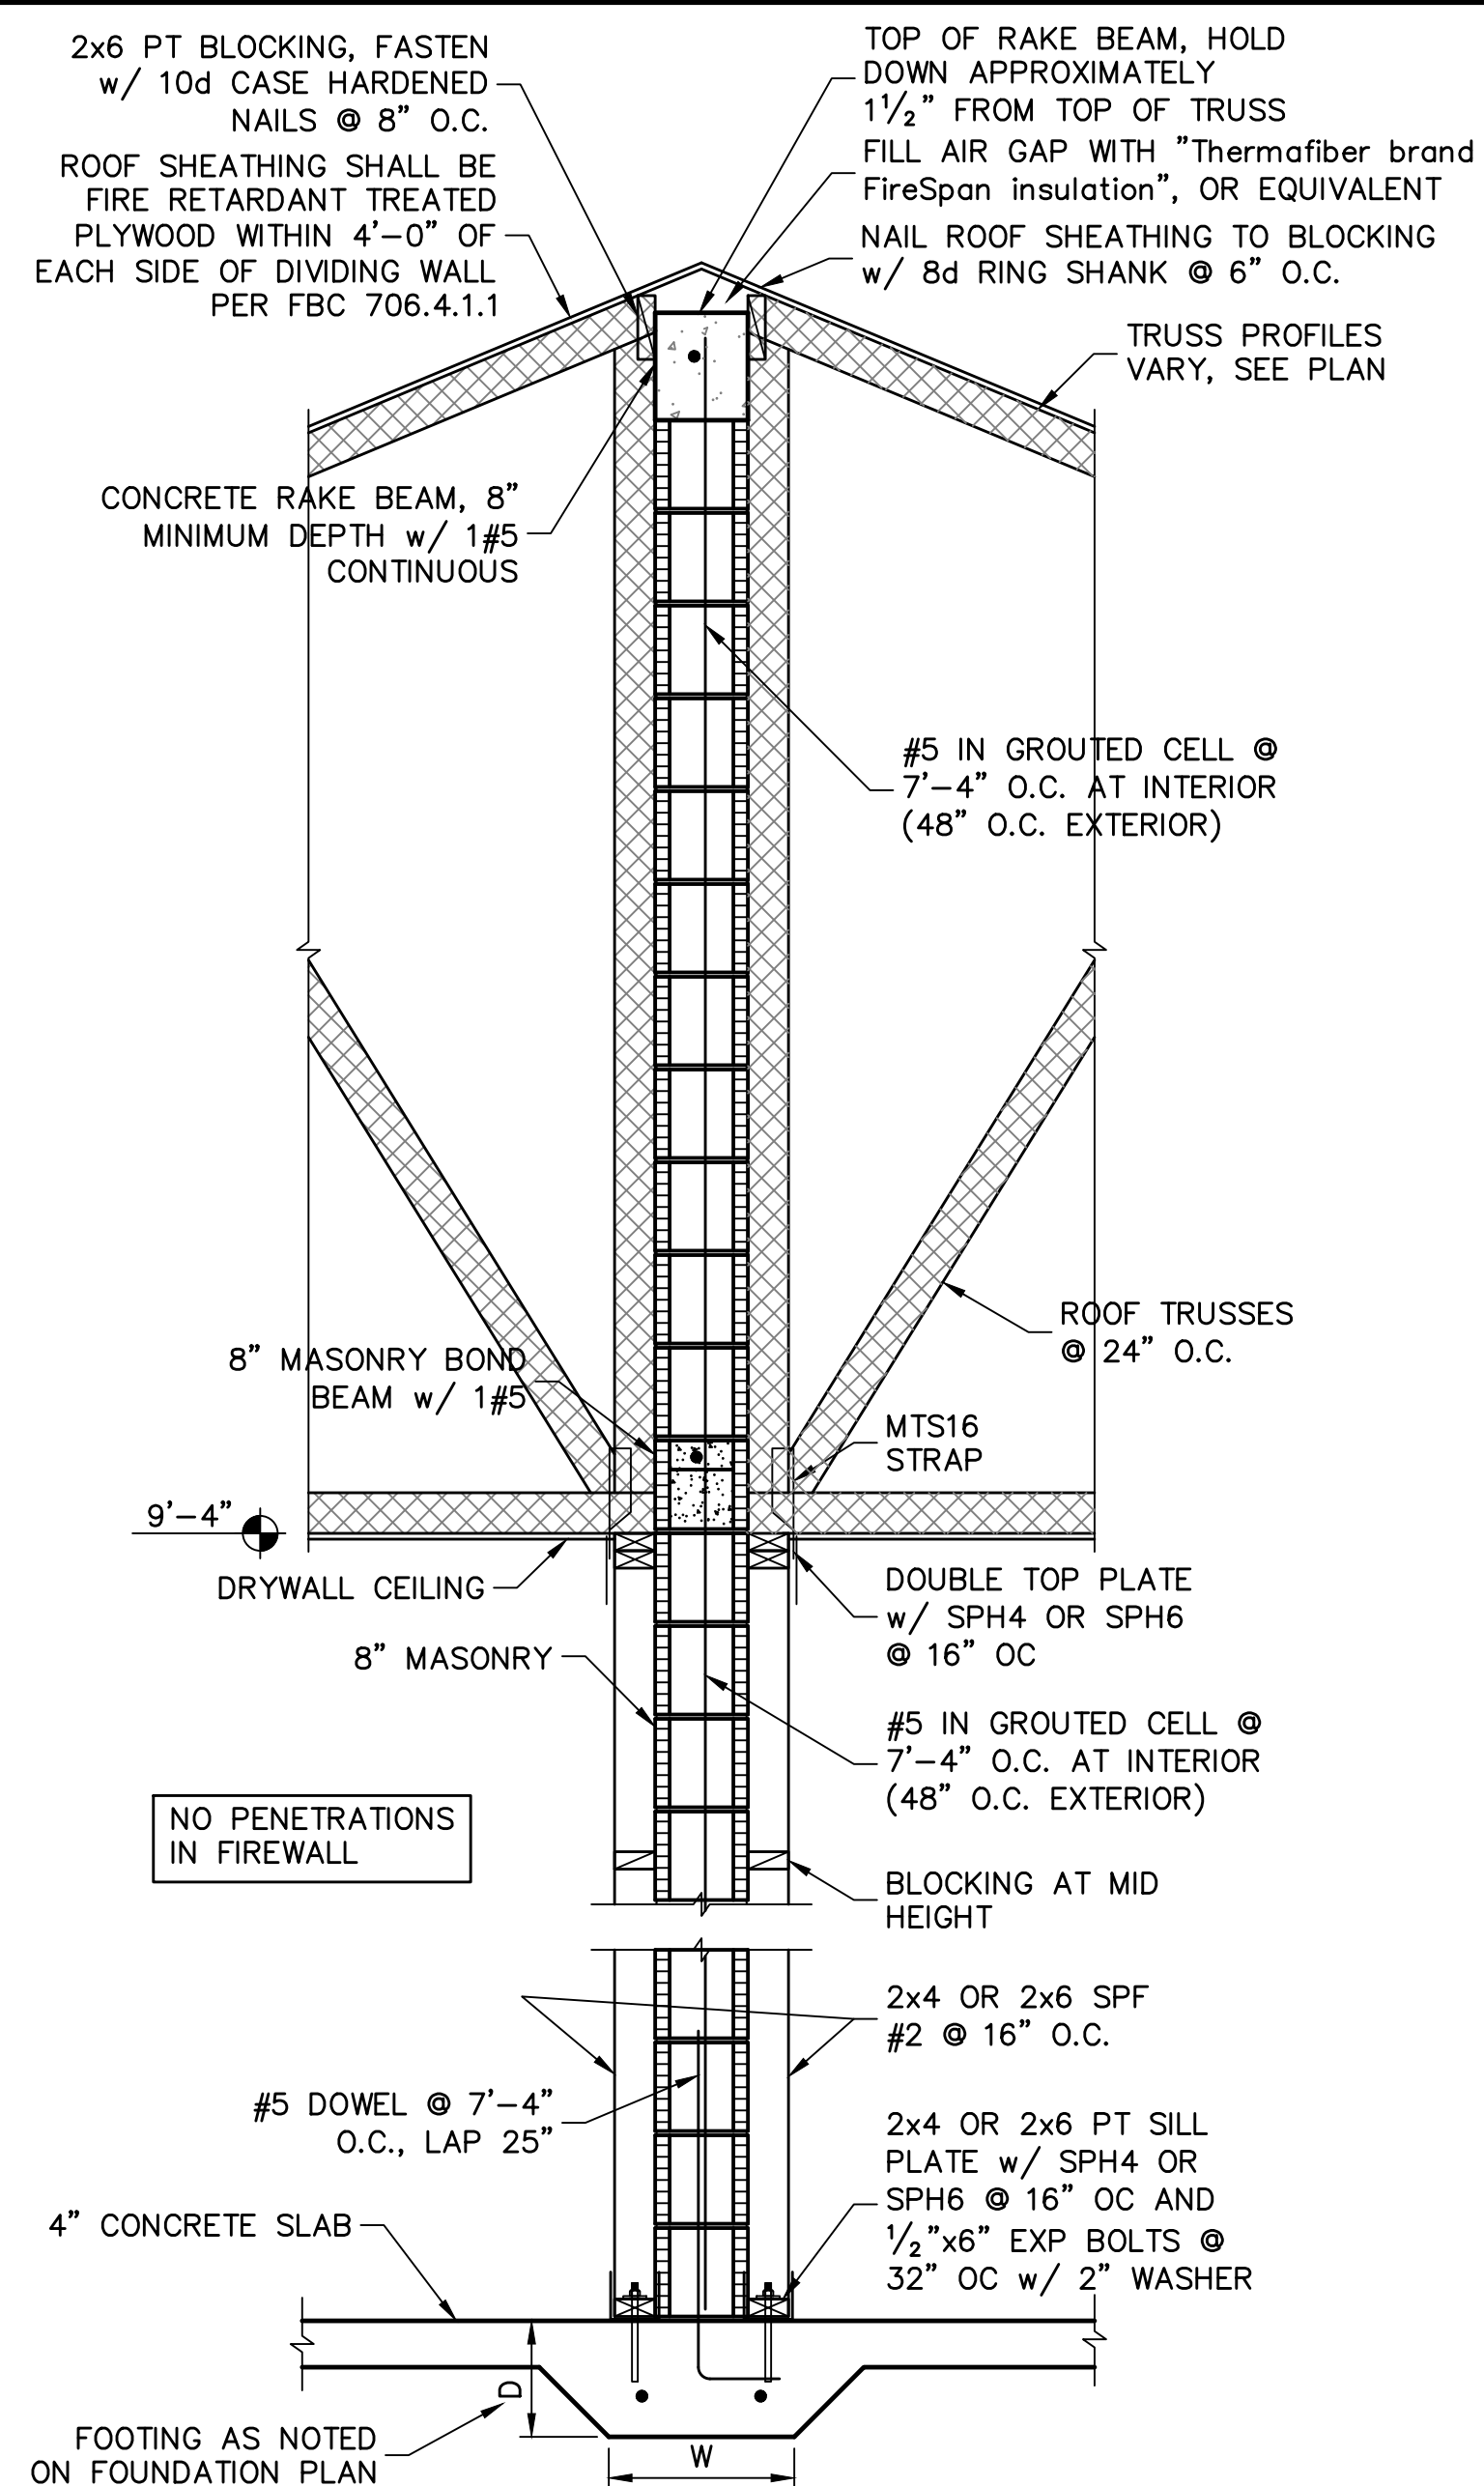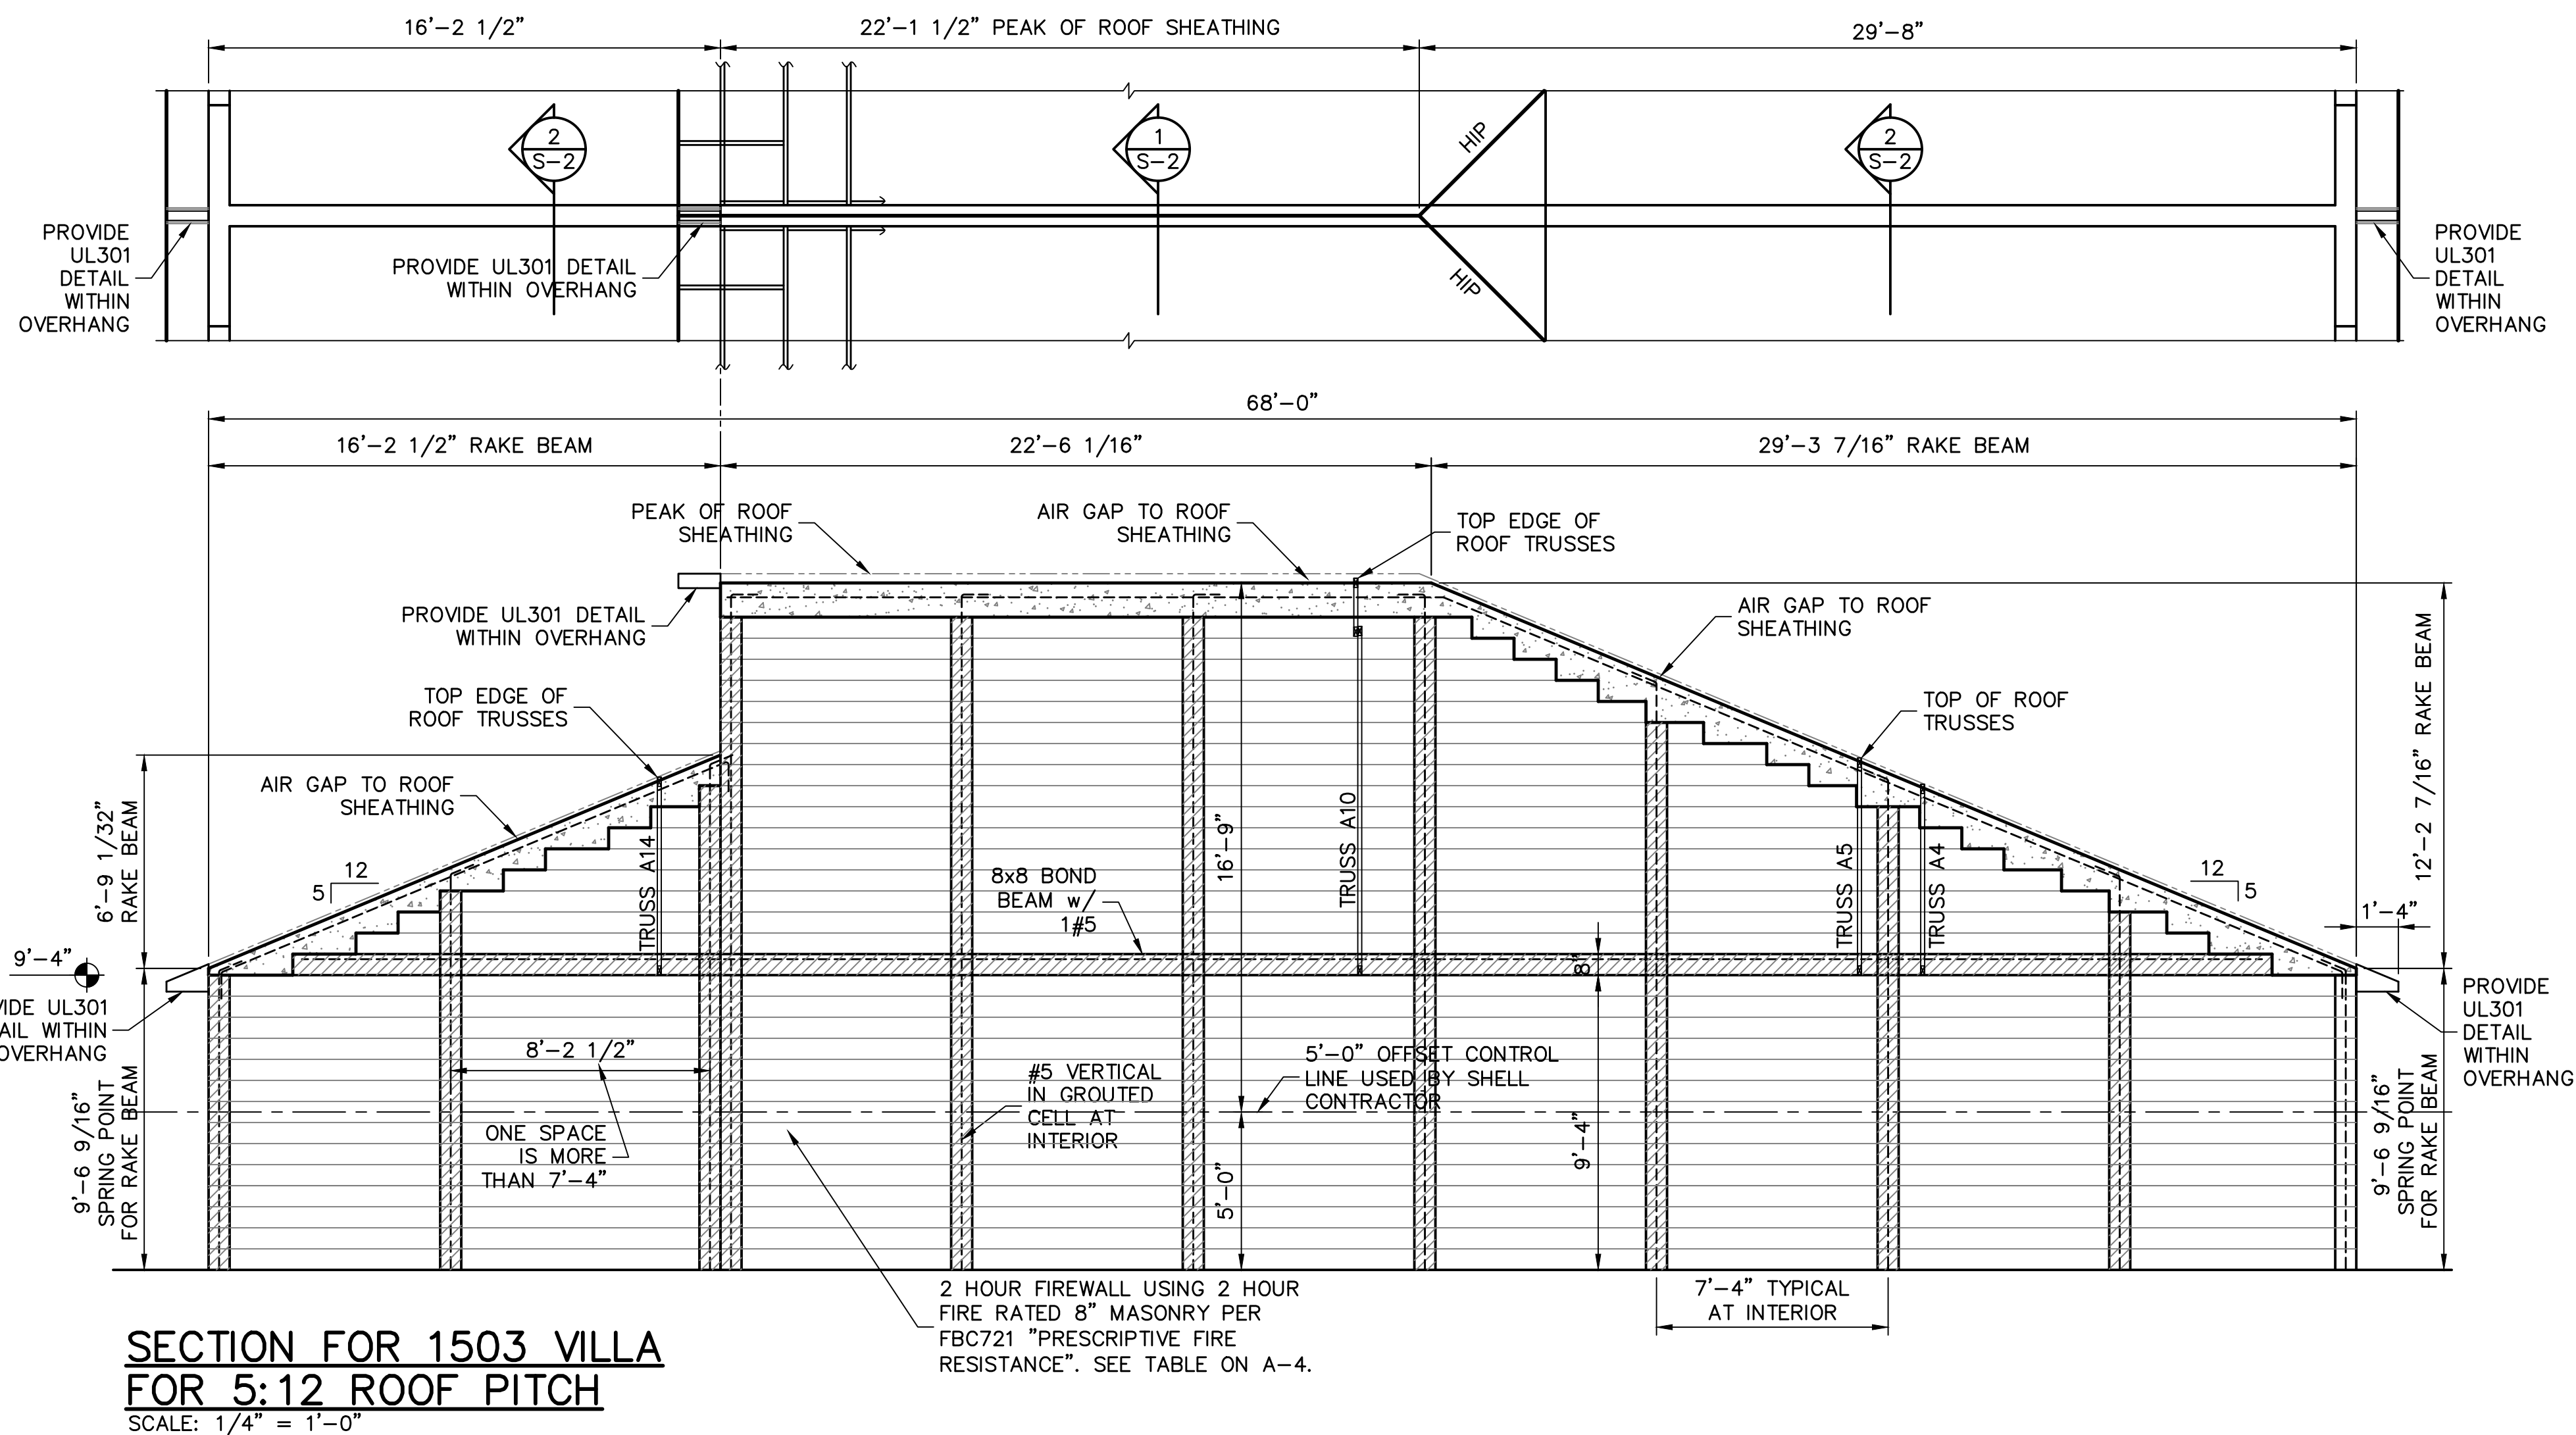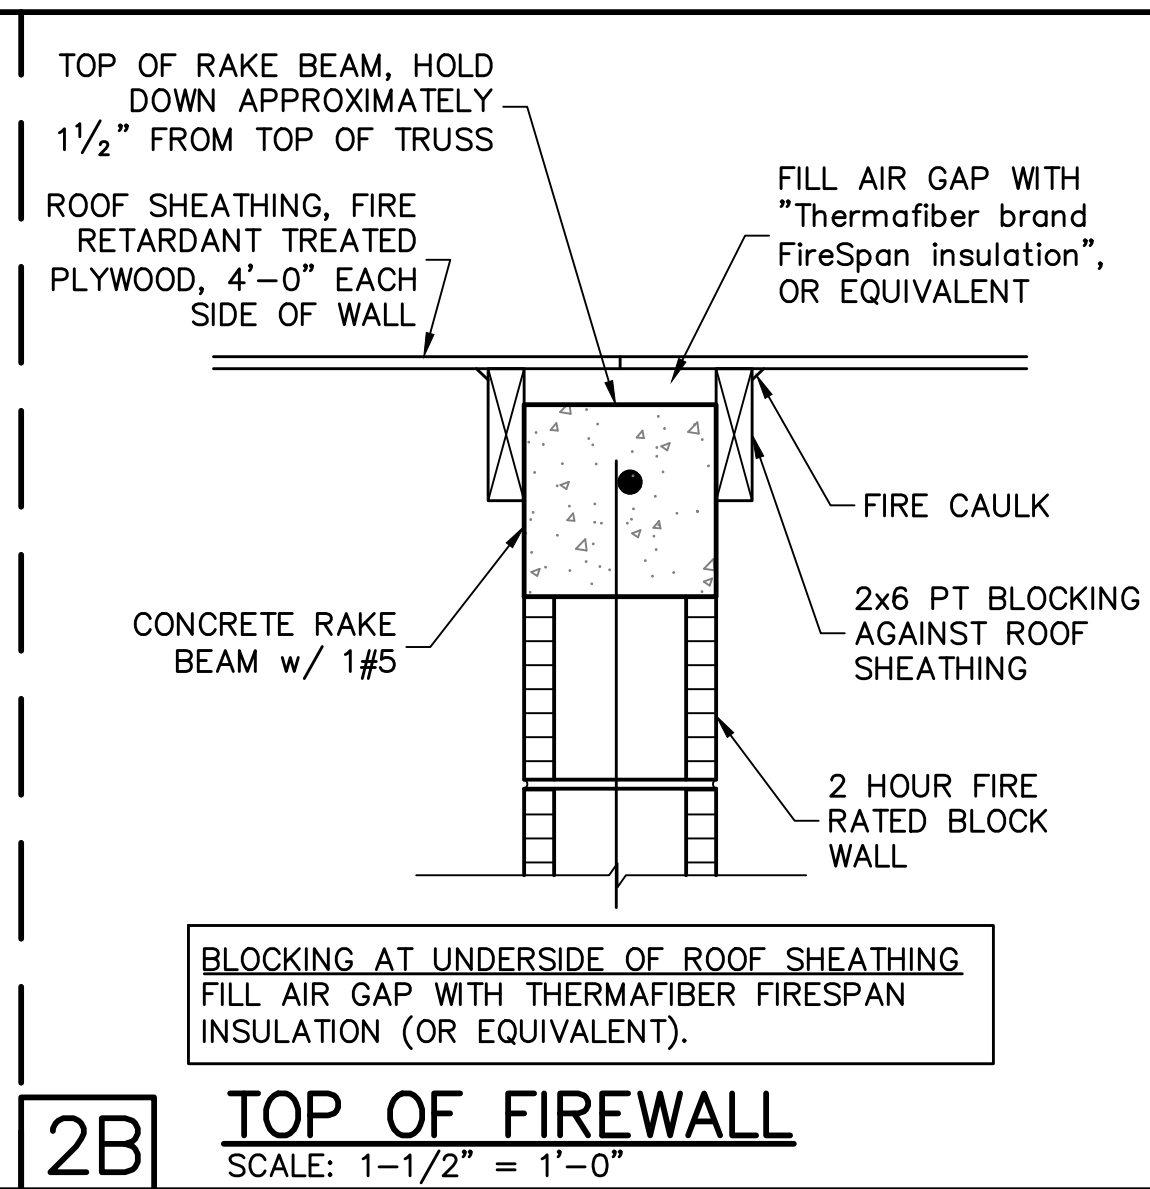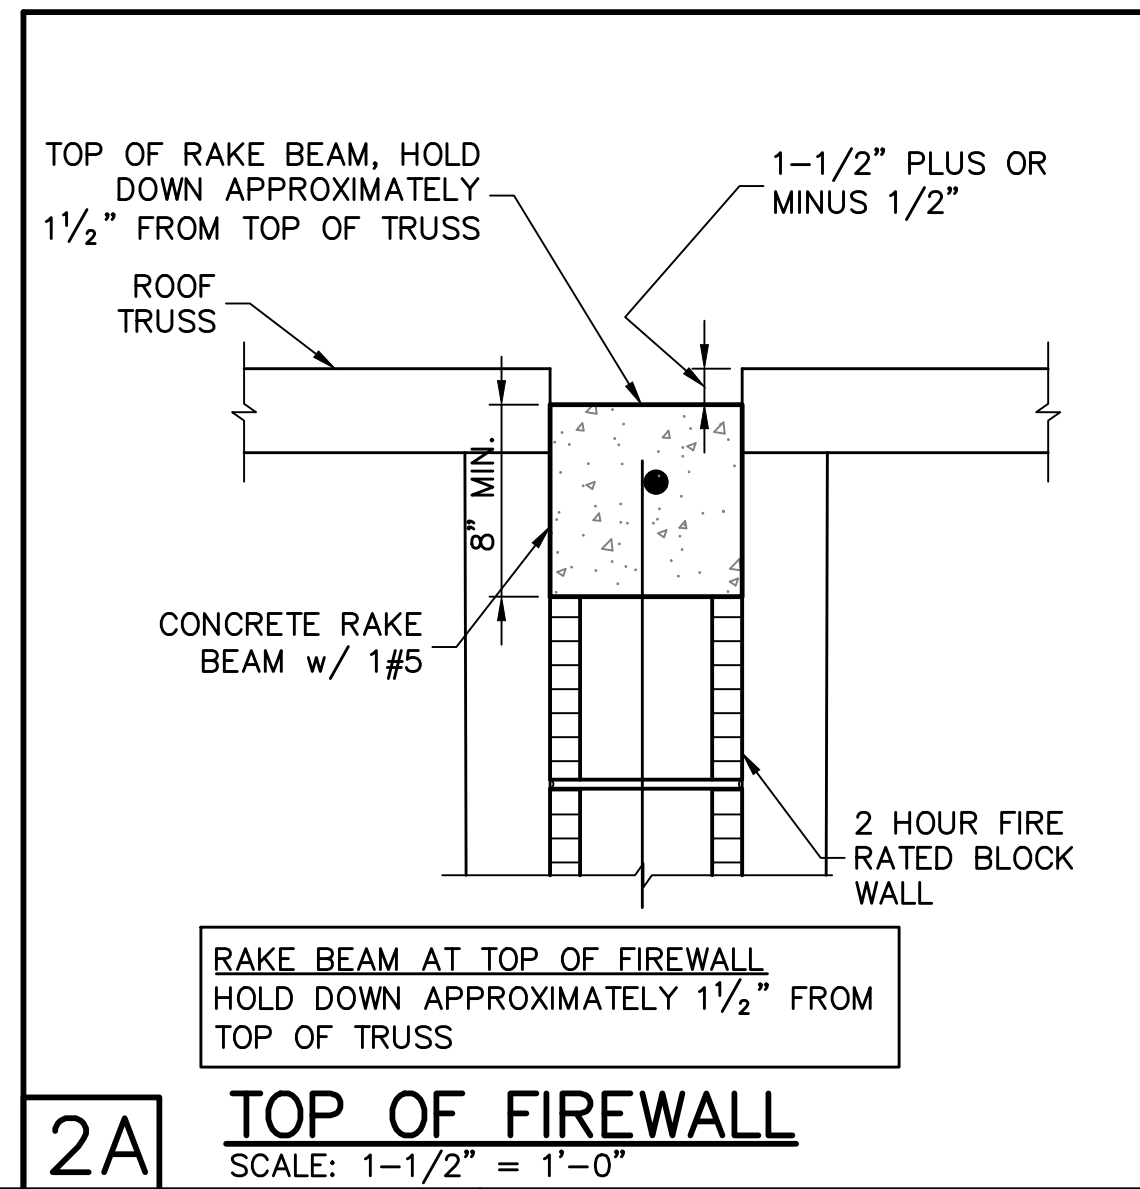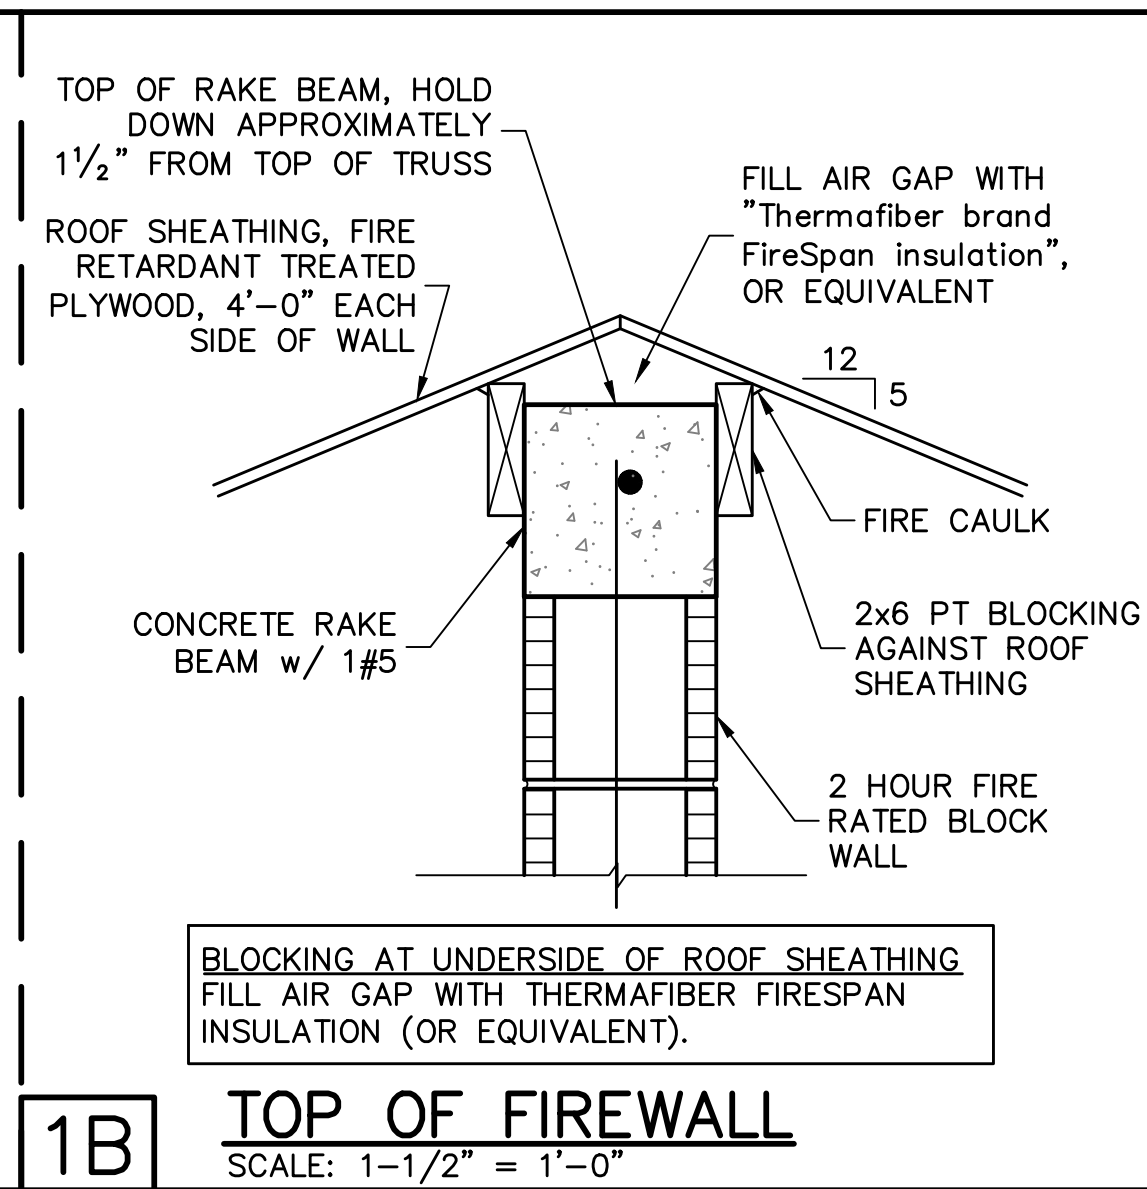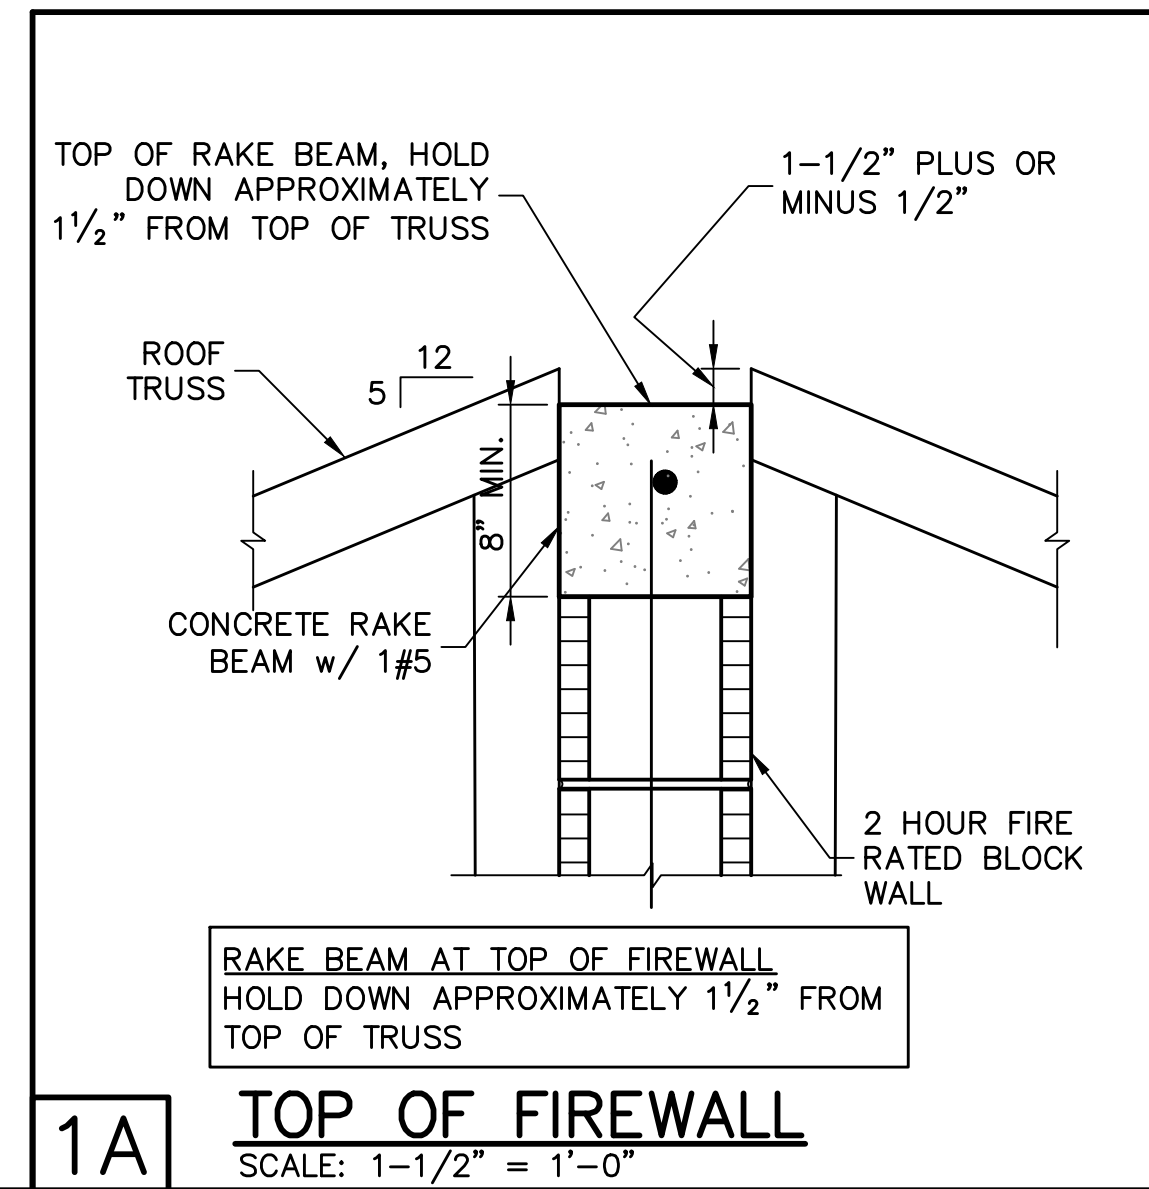

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8629

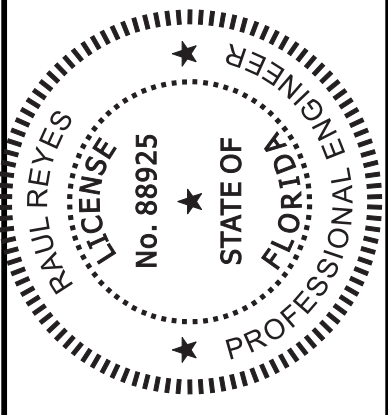

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL
BUILDER:
D.R. HOHON
America's Builder

STRUCTURAL DETAILS FOR
1503 SIGNATURE VILLA
1163, 1167 TRANQUIL BROOK DRIVE
NAPLES, FLORIDA
LOT: 7-8 SUBDIVISION: ENBROOK

DESIGN/DRAWN
DWB/DWB
CHECKED
DWB
DATE
09/10/20
SCALE
AS NOTED
JOB NO.
DR 11820
SHEET

S-2
SHEET 2 OF 2

FOR SCOSTA TRUSSES, JOB # 44060-N, DATED 07/02/19, REVISED: 08/06/19