



Community Development

18400 Murdock Circle, Port Charlotte, FL 33948

Phone: 941.743.1201 FAX: 941.764.4907

Zoning: 941.743.1964

www.CharlotteCountyFl.gov

"To exceed expectations in the delivery of public services"

For Office Use Only

Permit Number

20 _____

Application Date

CSR Initials _____

RESIDENTIAL ONE AND TWO SINGLE FAMILY DWELLING DATA SUMMARY SHEET Florida Building Code Sixth Edition (2017)

OWNER NAME: D.R. Horton, Inc.

PROJECT ADDRESS:

Lot 24/4227 8301 Agate St Port Charlotte FL 33981

Number & Street

City,

State,

& Zipcode

Applicable Codes: Building, Mechanical, Plumbing, Accessibility, & Energy Codes - 6th Edition (2017) Florida Building Code, Residential Volume. Electrical Code - NFPA 70 & NEC 2014

Manufacturer's Product Approvals

Doors: see attached

Overhead Doors: see attached

Windows: see attached

Mitered Glass: see attached

Roof Coverings: see attached

Protection of Openings:

Soffit: see attached

Shutters: see attached

Method of Design per Florida Building Code (FBC) R301:

Designer's Name: STRUCTURAL SYSTEM OF NORTH FL

☐ Florida Building Code, 6th Ed (2017)

☒ ASCE 7

☐ AISI S230

☐ AF & PA

☐ MAF Guide

☐ ICC 600

☐ TMS/ASCE

☐ Other: _____

Design Data:

Basic Wind Speed (Vult) 160 mph (Figure R301.2(4)) Risk Category: ☐ I ☒ II

Nominal Design Wind Speed (Vasd) 124 m.p.h. Flood Design Data N/A Final Floor Elevation see site plan

Exposure Category Section (R301.2.1.4) ☐ B ☒ C ☐ D Soil Design Load-Bearing Value 2000 PSF

Structural Forces (Section R301.4 / 301.5 / 3601.6)

Floor Design: Live Load 40 p.s.f. Dead Load slab on grade p.s.f.

Roof Design: Live Load 20 p.s.f. Dead Load TC=20 BC=10 p.s.f. Roof Slope 5:12

Window and Door Wind Pressure Design Loading:

Mean roof height 15 ft

Windows +33.5/-44.8 p.s.f. Doors +33.5/-44.8 p.s.f. Garage Doors +29.4/-44.8 p.s.f.

Components and Cladding Design Pressures:

Zone 1: 19.2/-30.6 p.s.f. Zone 2: 19.2/-53.2 p.s.f. Zone 3: 19./-78.8 p.s.f. Zone 4: 33.5/-36.3 p.s.f. Zone 5: 33.5/-44.8 p.s.f.


Area Tabulation: TOTAL (Sq. Ft.) 2,780

Living (Sq. Ft.) 1,982 Garage (Sq. Ft.) 446 Lanai (Sq. Ft.) 270

Entry (Sq. Ft.) 82 Storage (Sq. Ft.) Other (Sq. Ft.)


I certify to the best of my knowledge and belief that these plans and specifications have been designed to comply with the structural portion of the Building Code for wind, flood and gravity loads as amended and enforced by the permitting jurisdiction.

Signature: _____ Date: _____

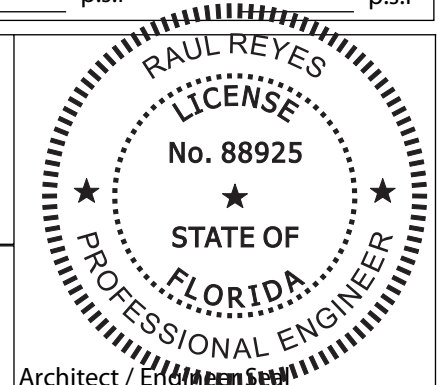


Architect / Engineer Seal

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

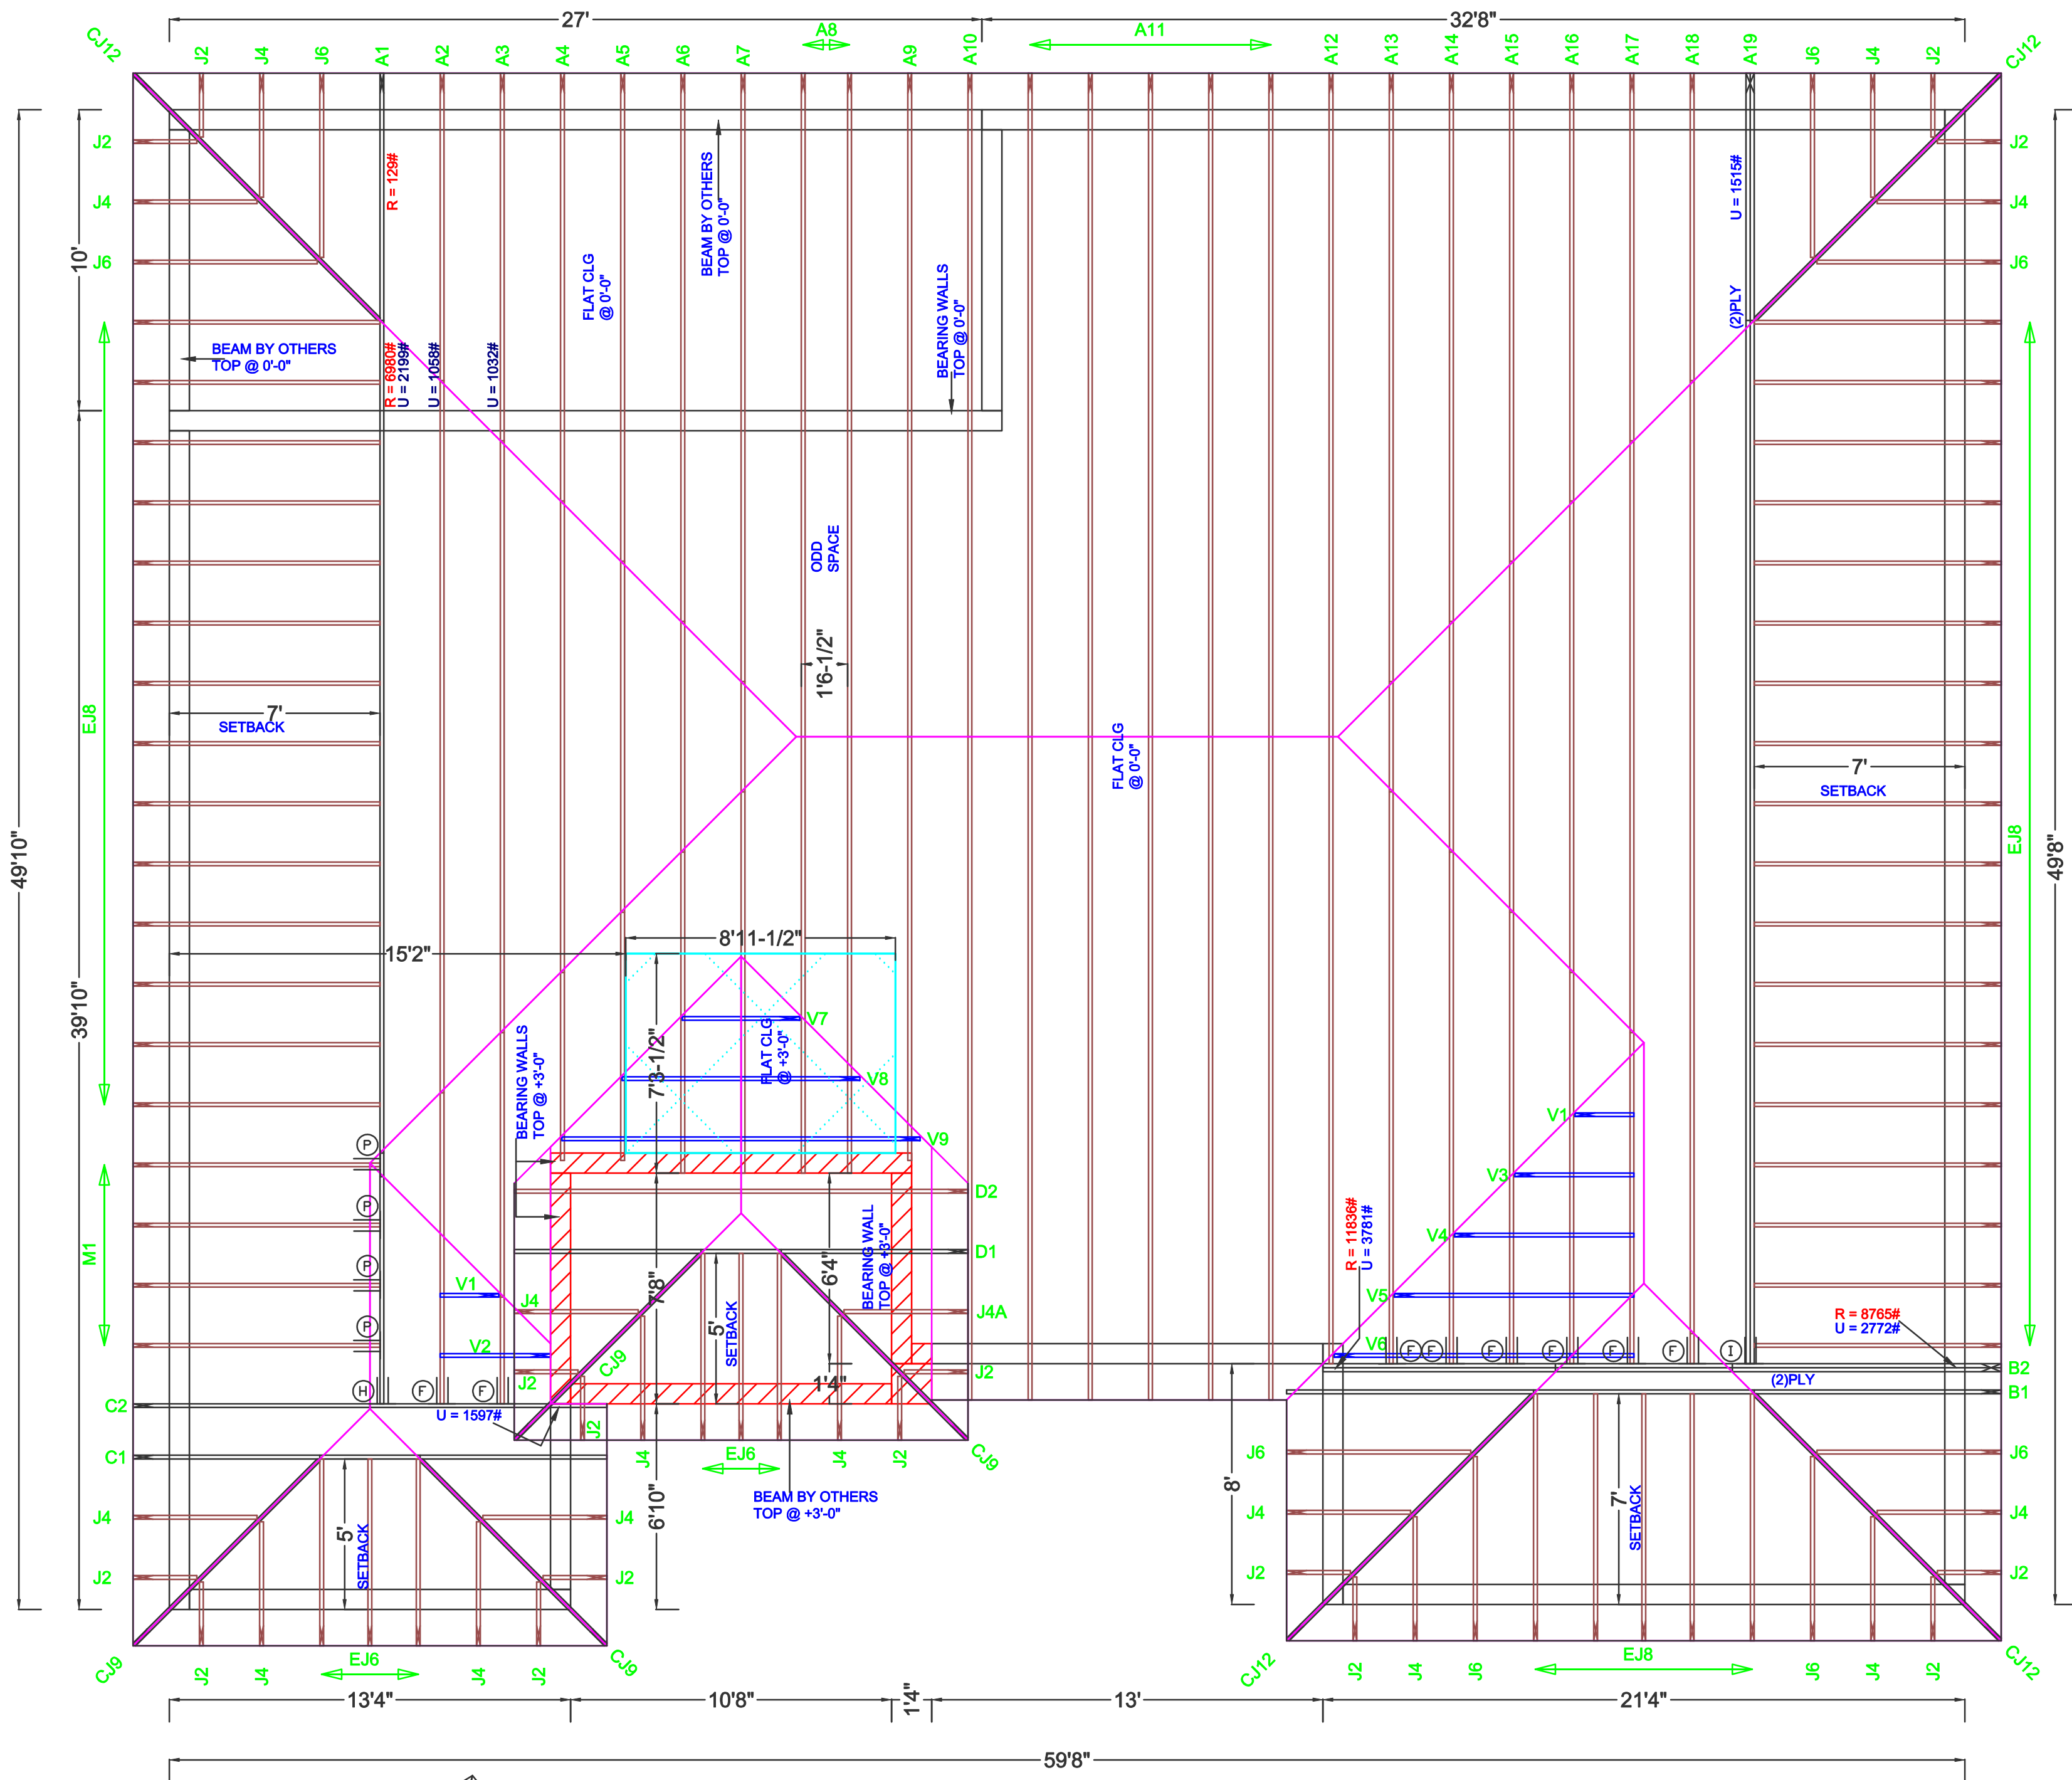

TYPICAL JACK CUTS

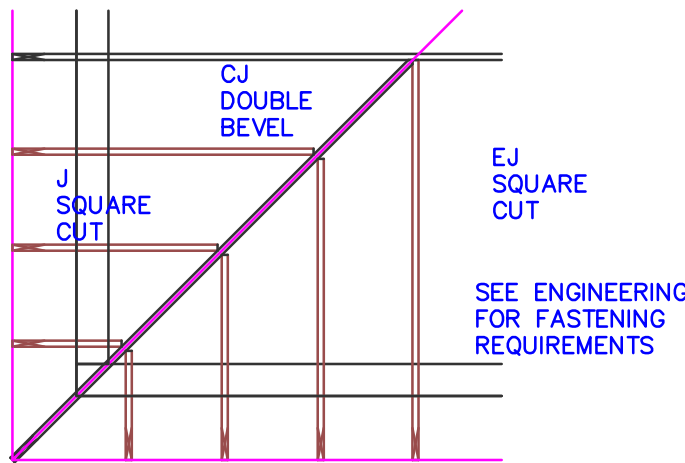

DESIGN CRITERIA

TOP CHORD LIVE LOAD	20
TOP CHORD DEAD LOAD	20
BOTTOM CHORD LIVE LOAD	NON-CURRENT 10#
BOTTOM CHORD DEAD LOAD	10
TOTAL LOAD	50
DURATION FACTOR	1.25
WIND DESIGN SPEED (MPH)	160
ASCE 7-10 CAT II EXP C MWFRS	
CLOSED	FBC 2017
MAX. WALL HT FOR WIND LOAD	12'-4"

TILE OR SHINGLE

****UNLESS NOTED****

REACTION VALUES ARE UNDER 5000#

UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE

*******CAUTION*******

DO NOT ATTEMPT TO ERECT TRUSSES WITH-
OUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING
DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION,
ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY
SHEET FOR HANDLING METHODS & TEMPORARY
BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA
CORP. +/- BEARING DIFFERENCES SHOWN ARE CRITICAL.
IF ANY HEIGHTS DEViate - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

9'-4" A.F.F.	0'-0"	ELEV.
12'-4" A.F.F.	+3'-0"	ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.
		ELEV.

TYPICAL HANGER SCHEDULE

- | | |
|-----------------------|-----------------------|
| (C) SIMPSON HUS 26 | (M) SIMPSON HGUS 28-3 |
| (F) SIMPSON HUS 28 | (N) SIMPSON HHUS 48 |
| (H) SIMPSON HGUS 28 | (P) SIMPSON LUS 24 |
| (I) SIMPSON HGUS 28-2 | (B) SIMPSON THA 422 |
| (W) SIMPSON THJA26 | (X) |

HANGER VALUES HAVE BEEN BASED ON 16D
COMMON NAILS EXCEPT THE FOLLOWING
LUS24 - 10D COMMON THJA26 - 10D x 1-1/2

*******ATTENTION*******

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY
BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS,
PITCHES, OVERHANGS, ELEVATIONS, CEILING &
BEARING CONDITIONS. SCOSTA CORPORATION IS
RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH
PLANS AND/OR INFORMATION PROVIDED BY
CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN.
CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF
INFORMATION AND PLANS PROVIDED TO SCOSTA
CORPORATION, AND TO VERIFY CONFORMANCE TO
FIELD CONDITIONS, AND/OR OWNER CHANGES.
TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE
APPROVED LAYOUT.

APPROVED BY: _____
DATE: _____ REQUESTED DELIVERY DATE: _____
JOBSITE CONTACT NAME: _____
PHONE #: _____
E-MAIL: _____


SCOSTA CORP.

WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES


3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242

SCALE: 1/4"=1'-0"	DATE: 08/06/18	REVISED BY: 01/28/20 CD	DRAWN BY: KRISTY
JOB ADDRESS: 1989 A GARAGE RIGHT LEE/COLLIER/CHARLOTTE		1 OF 1	
CUSTOMER: D.R. HORTON		JOB # 44133	


Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\5SUBDIVISIONS\GULF COVE SPOT
LOT5\1 2020 LOT 24 BLK 4227 1989 ARREV\1 2020 1989 AR.rvt

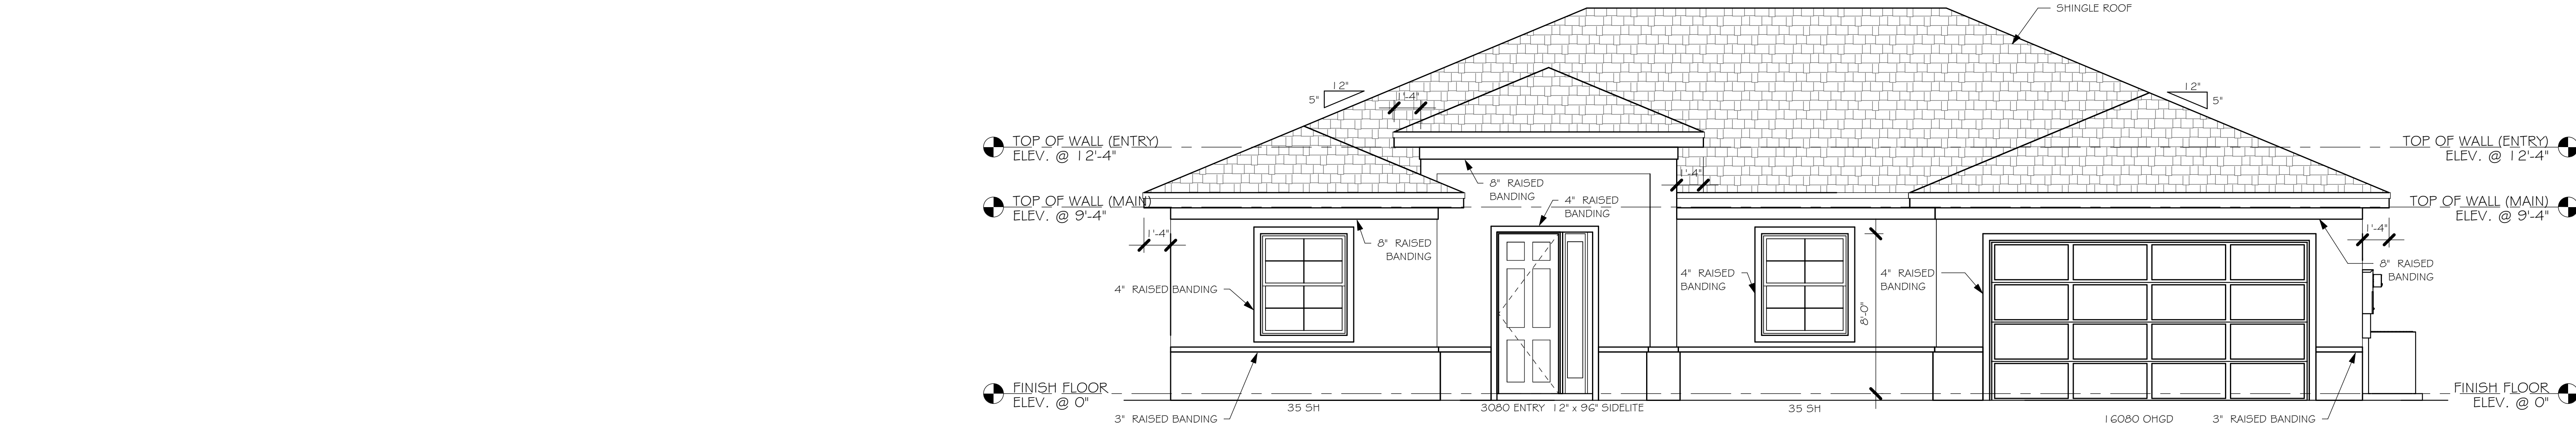


FRONT ELEVATION "AR"
1/4" = 1'-0"

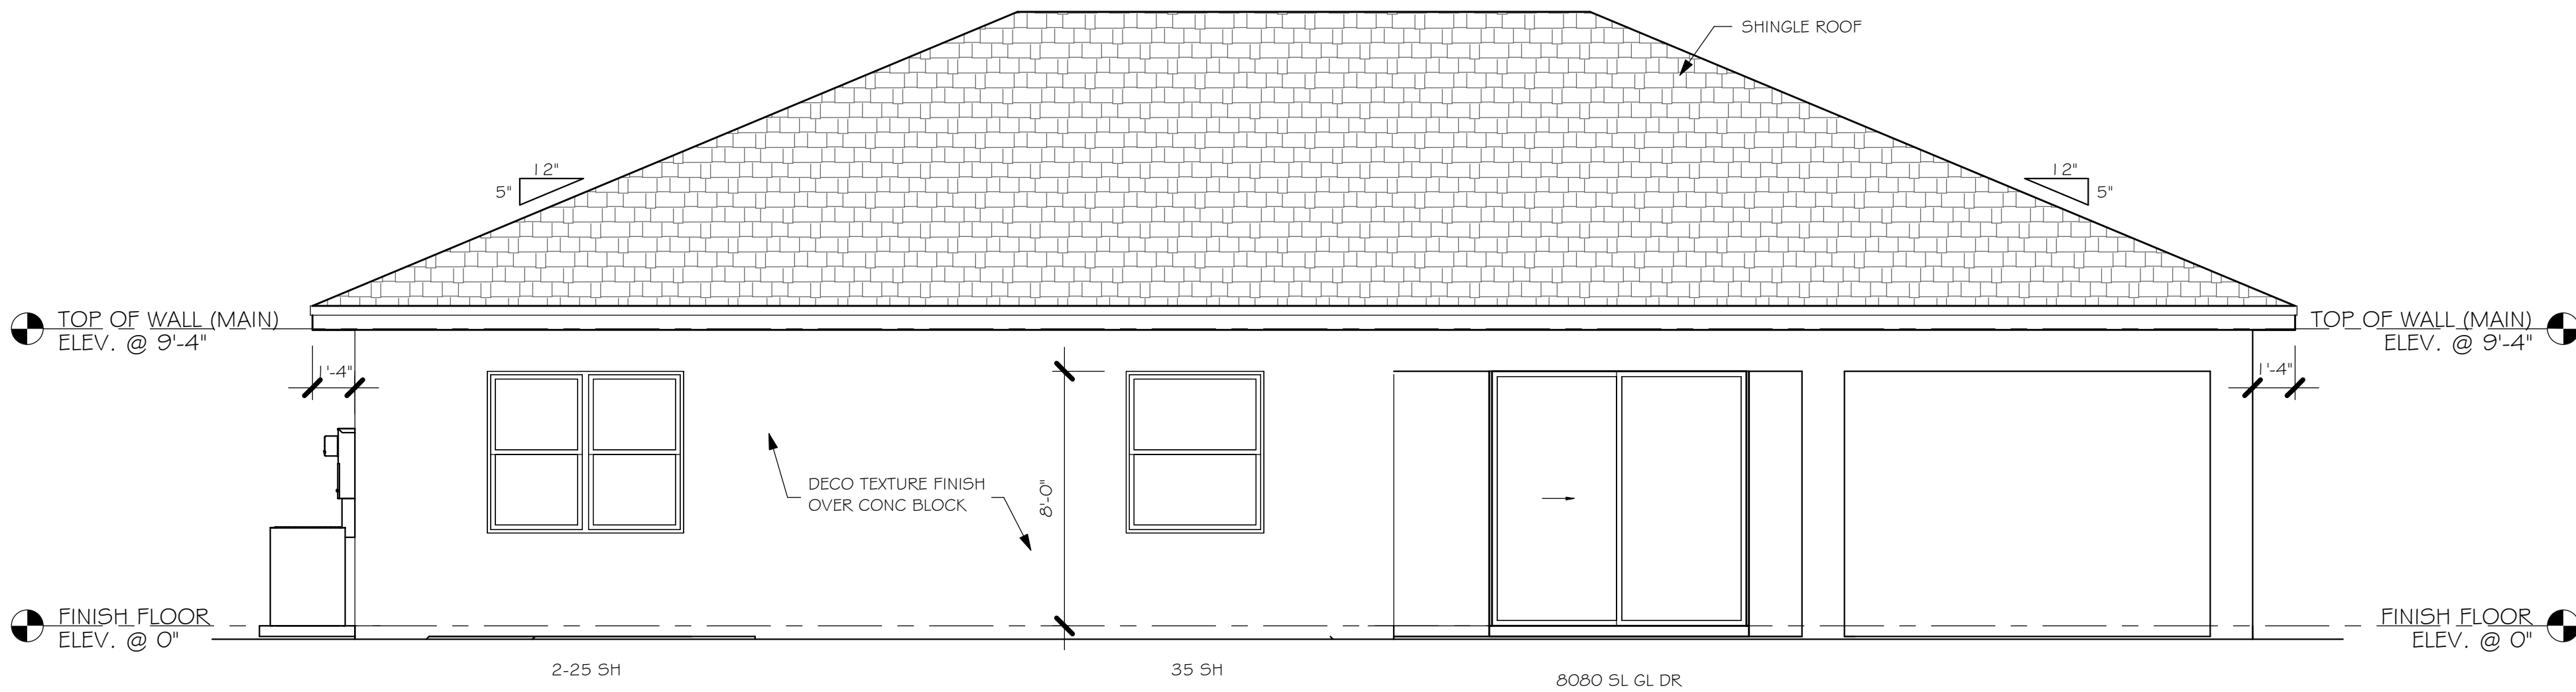

REAR ELEVATION "AR"
1/4" = 1'-0"

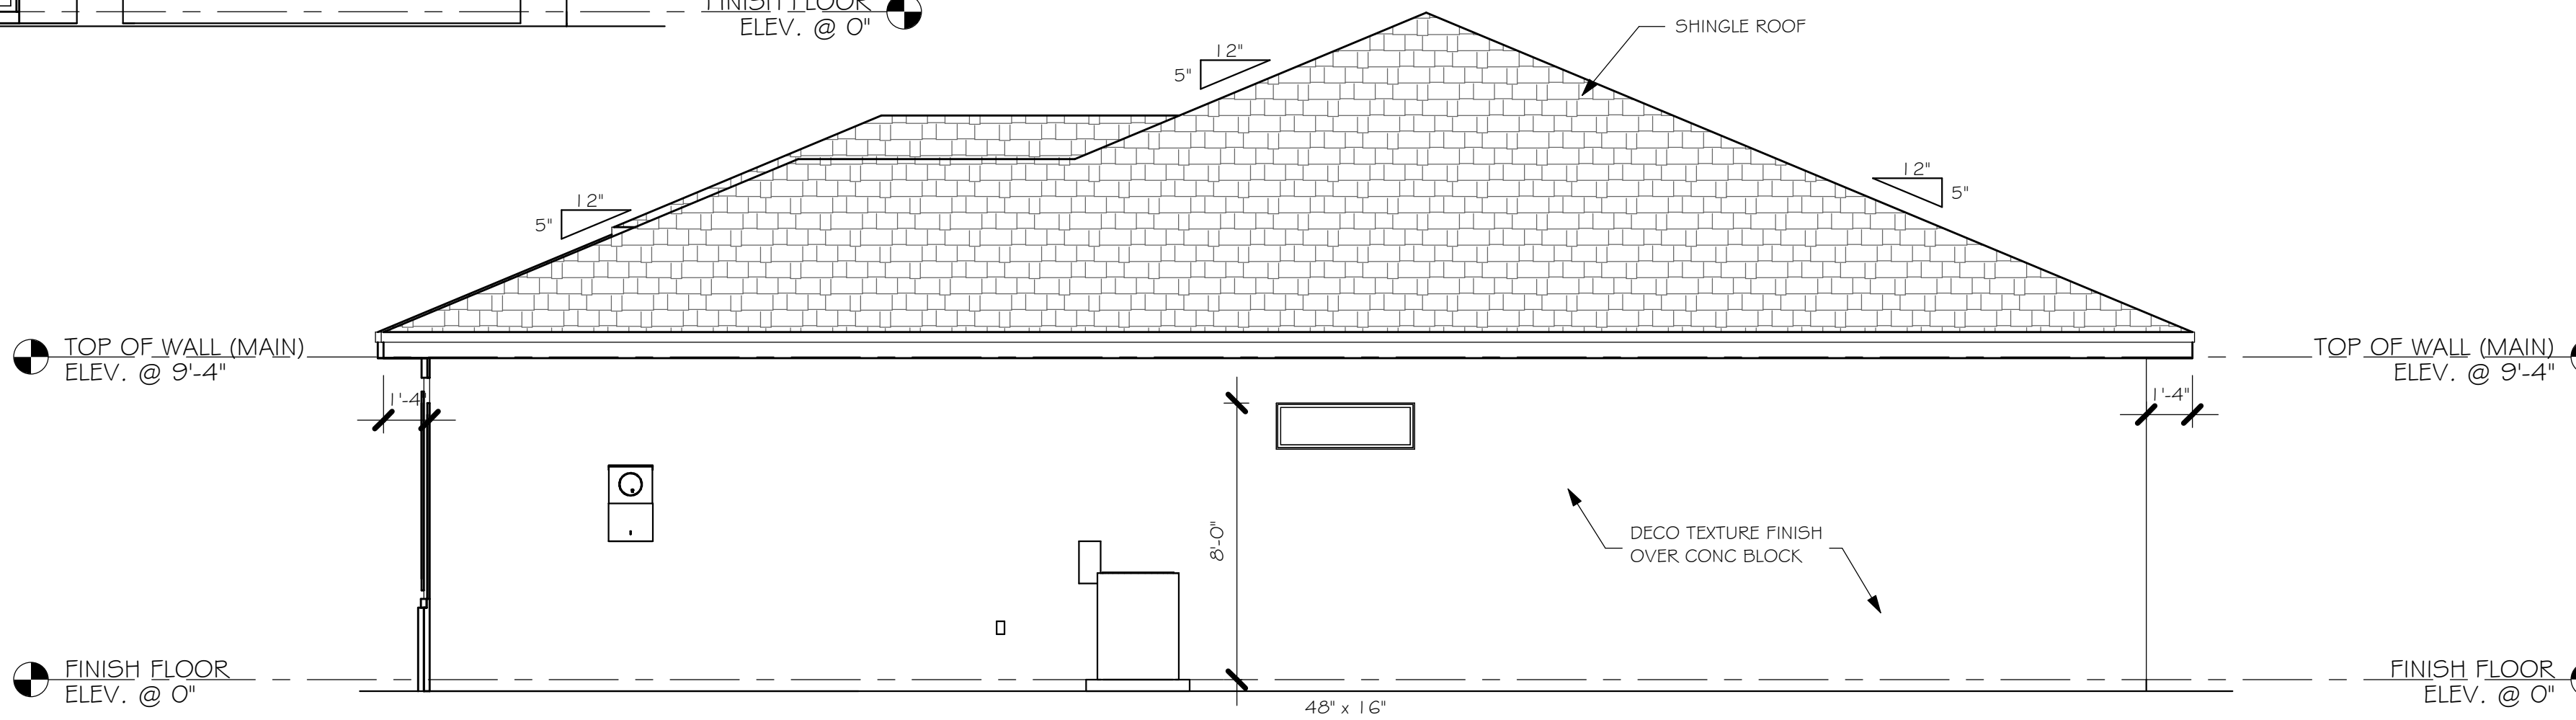

RIGHT ELEVATION "AR"
1/4" = 1'-0"



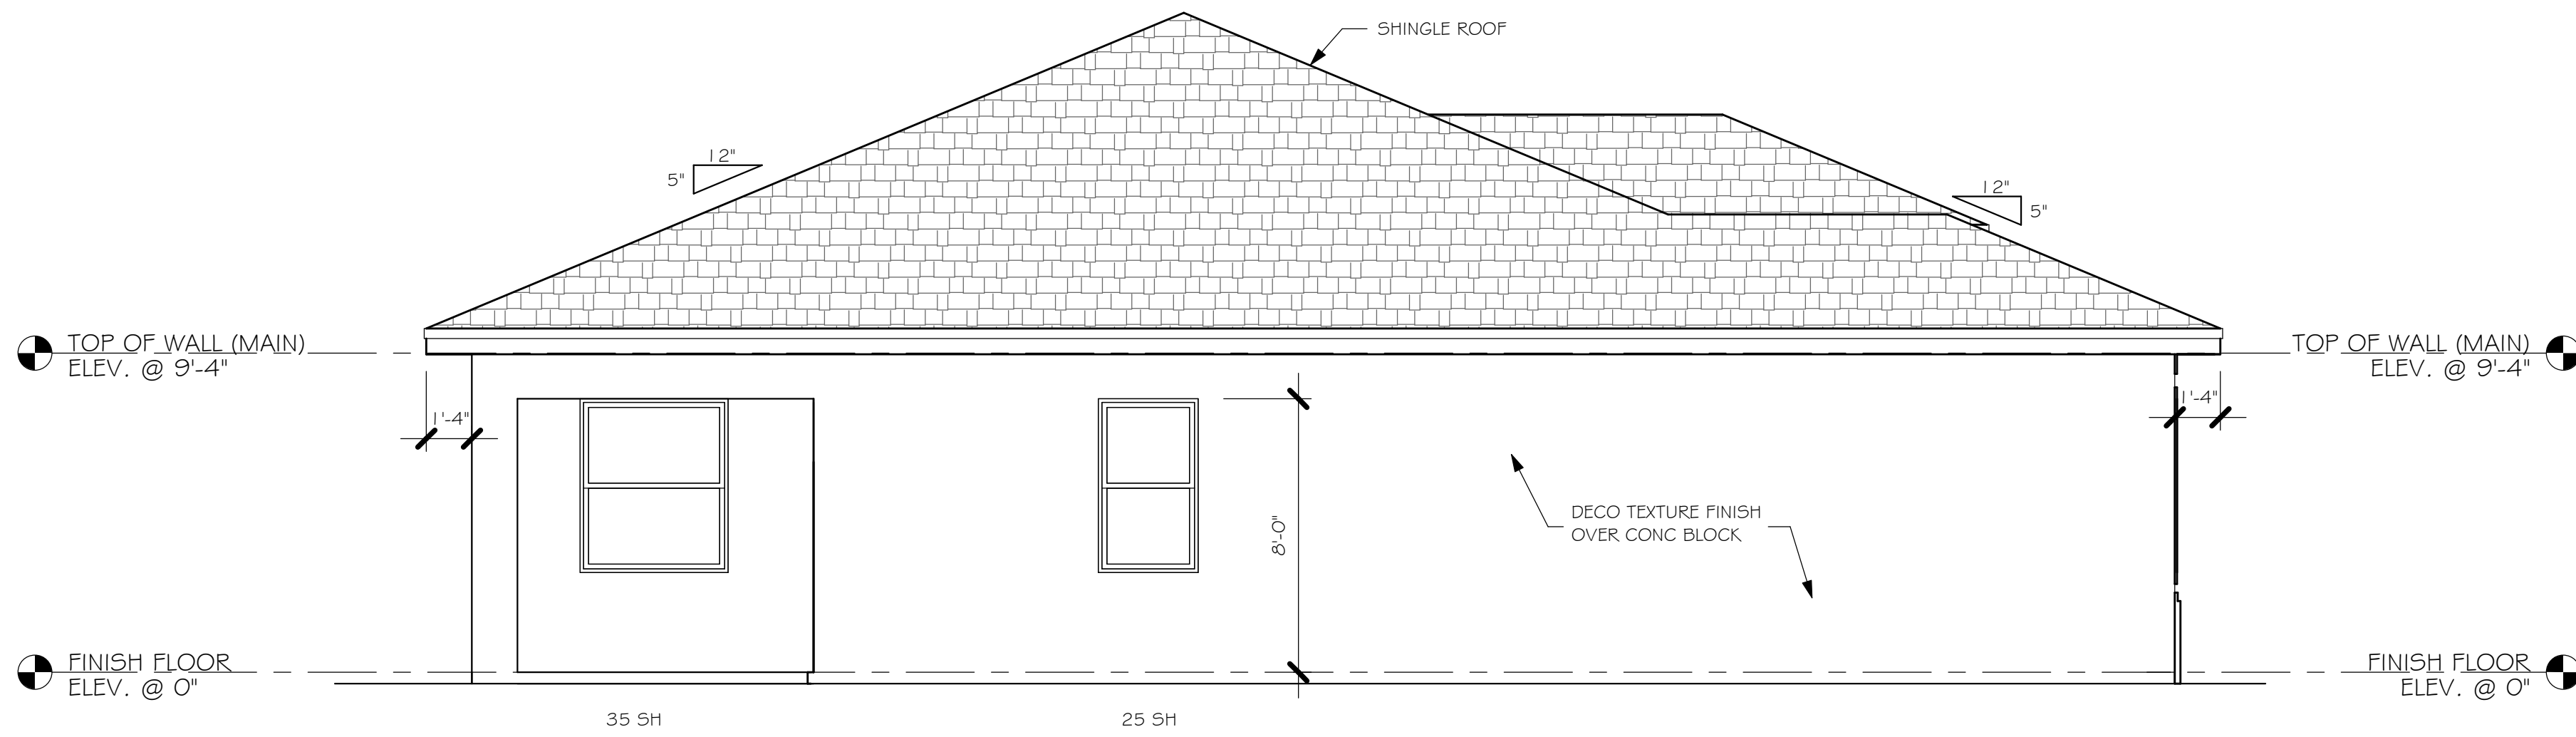


LEFT ELEVATION "AR"
1/4" = 1'-0"

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT
LOT5\1 2020 LOT 24 BLK 4227 1989 AR\REVIT\1 2020 1989 AR.rvt

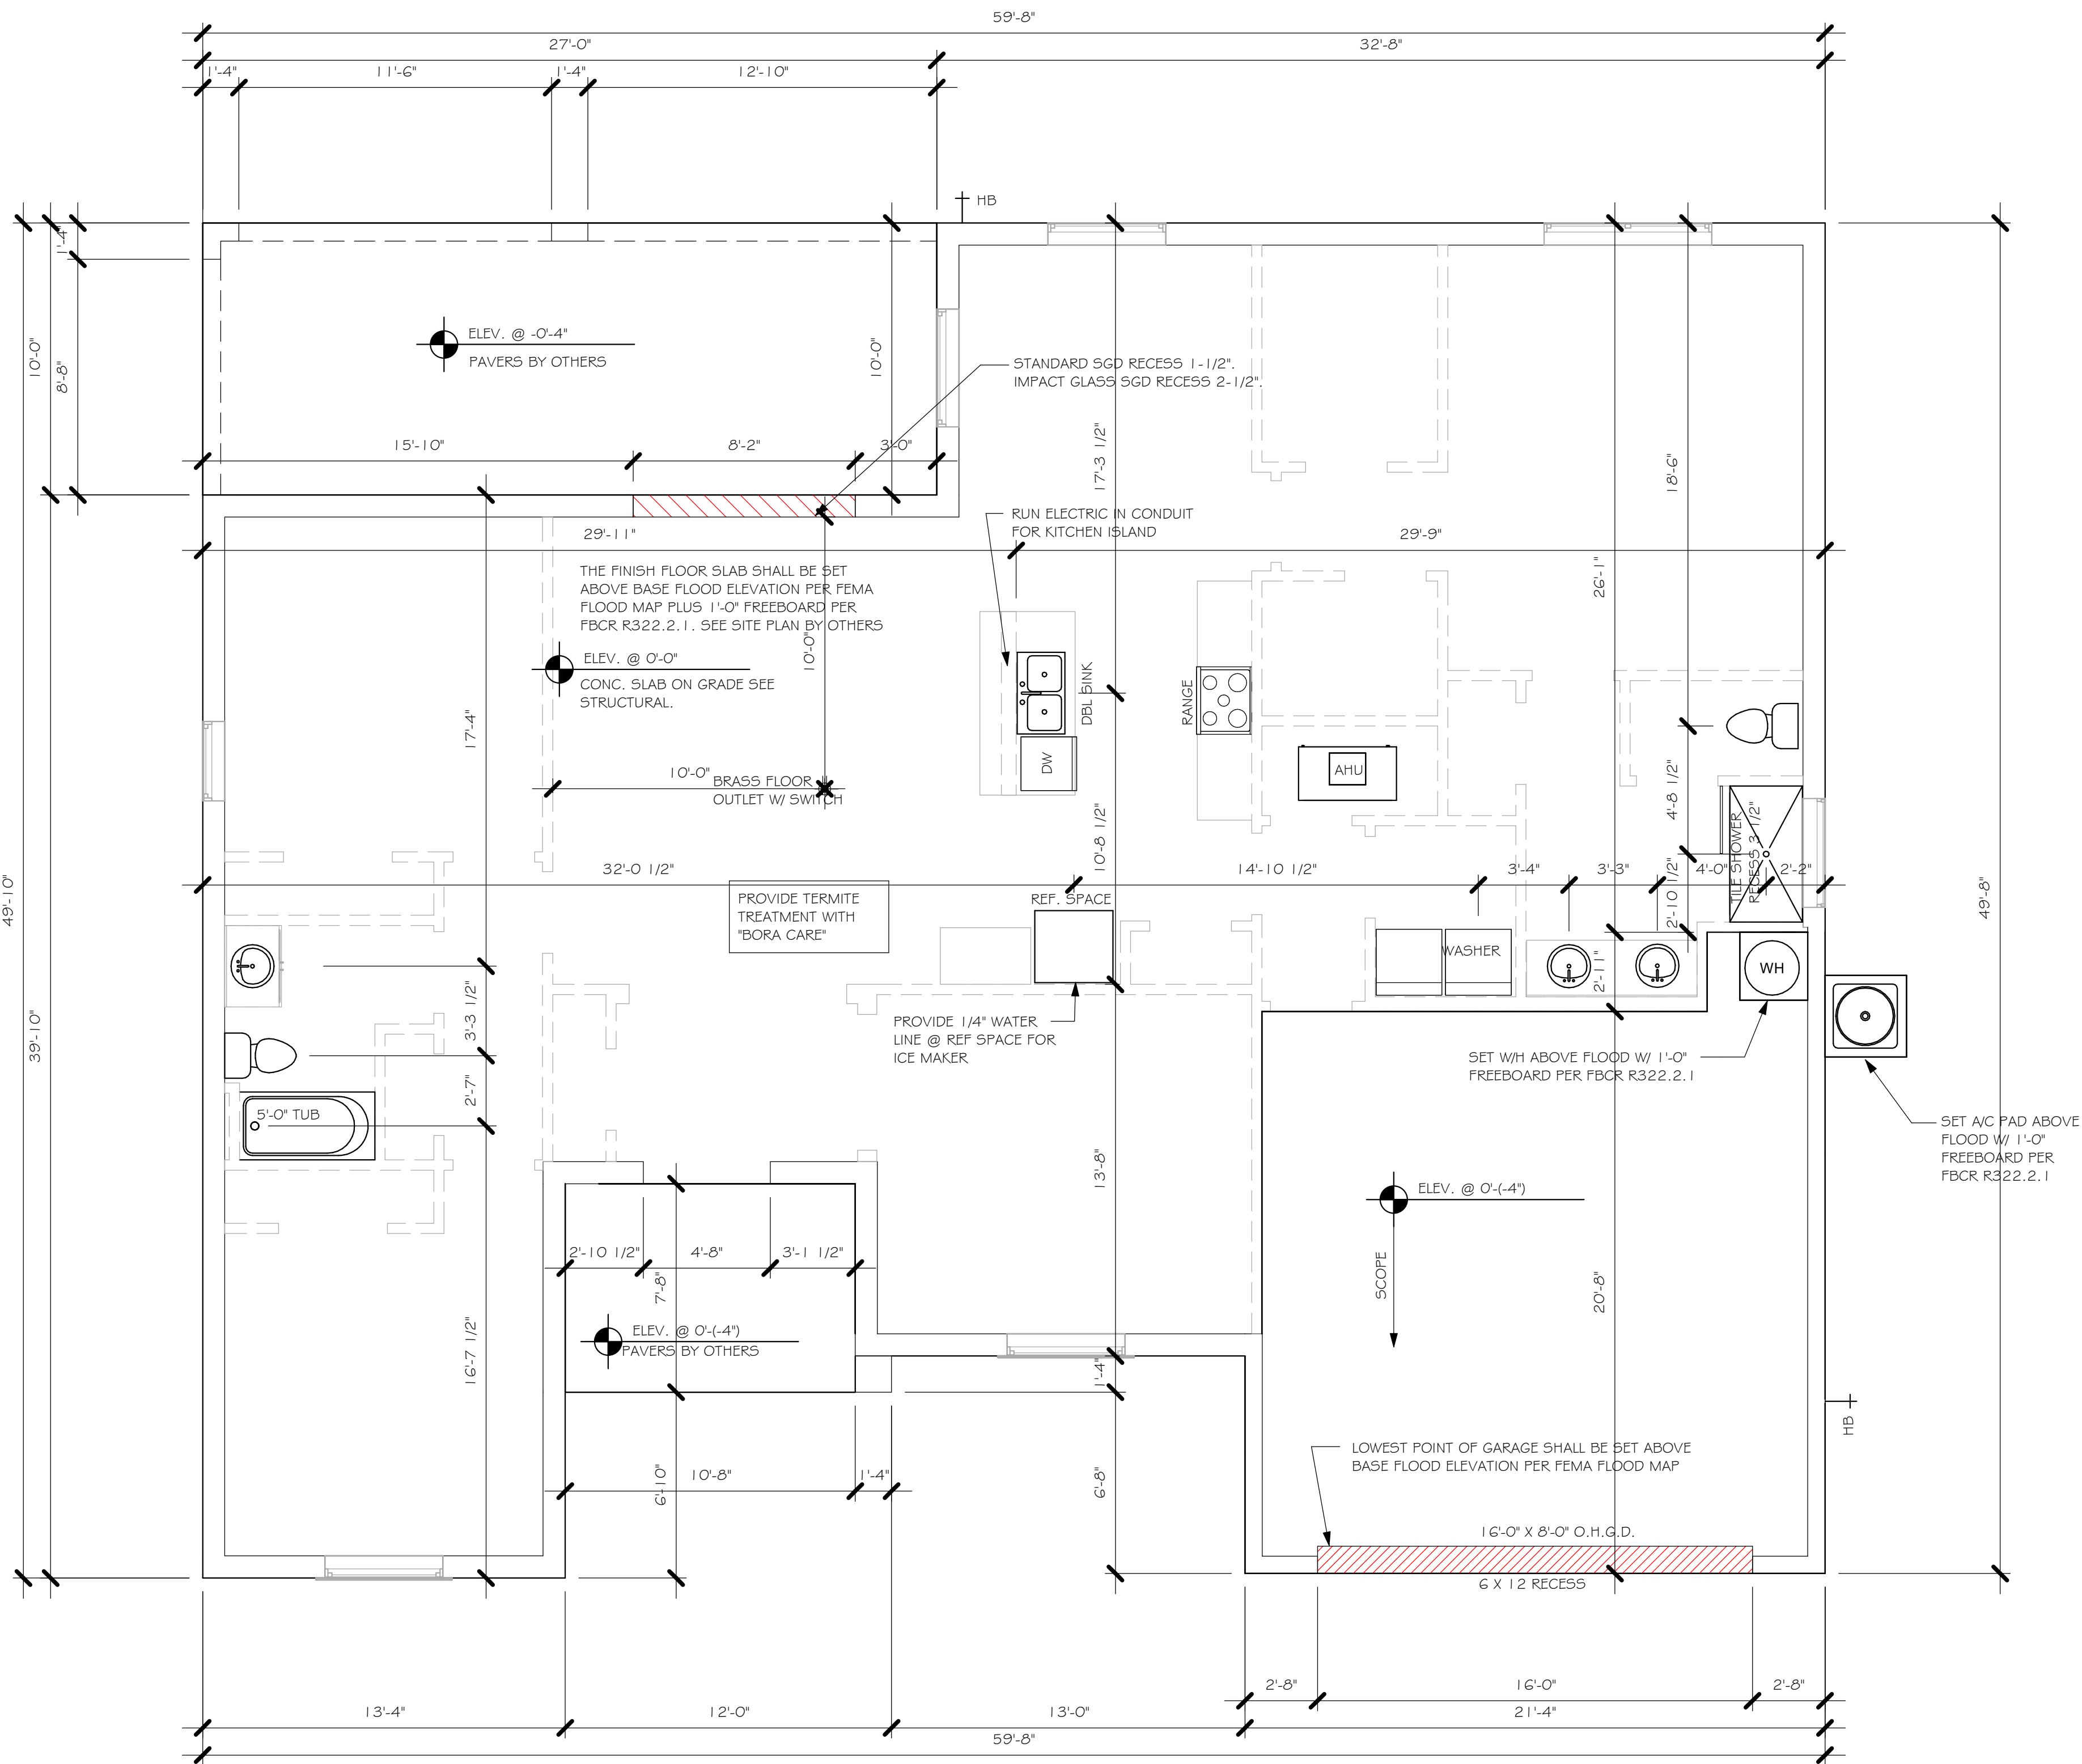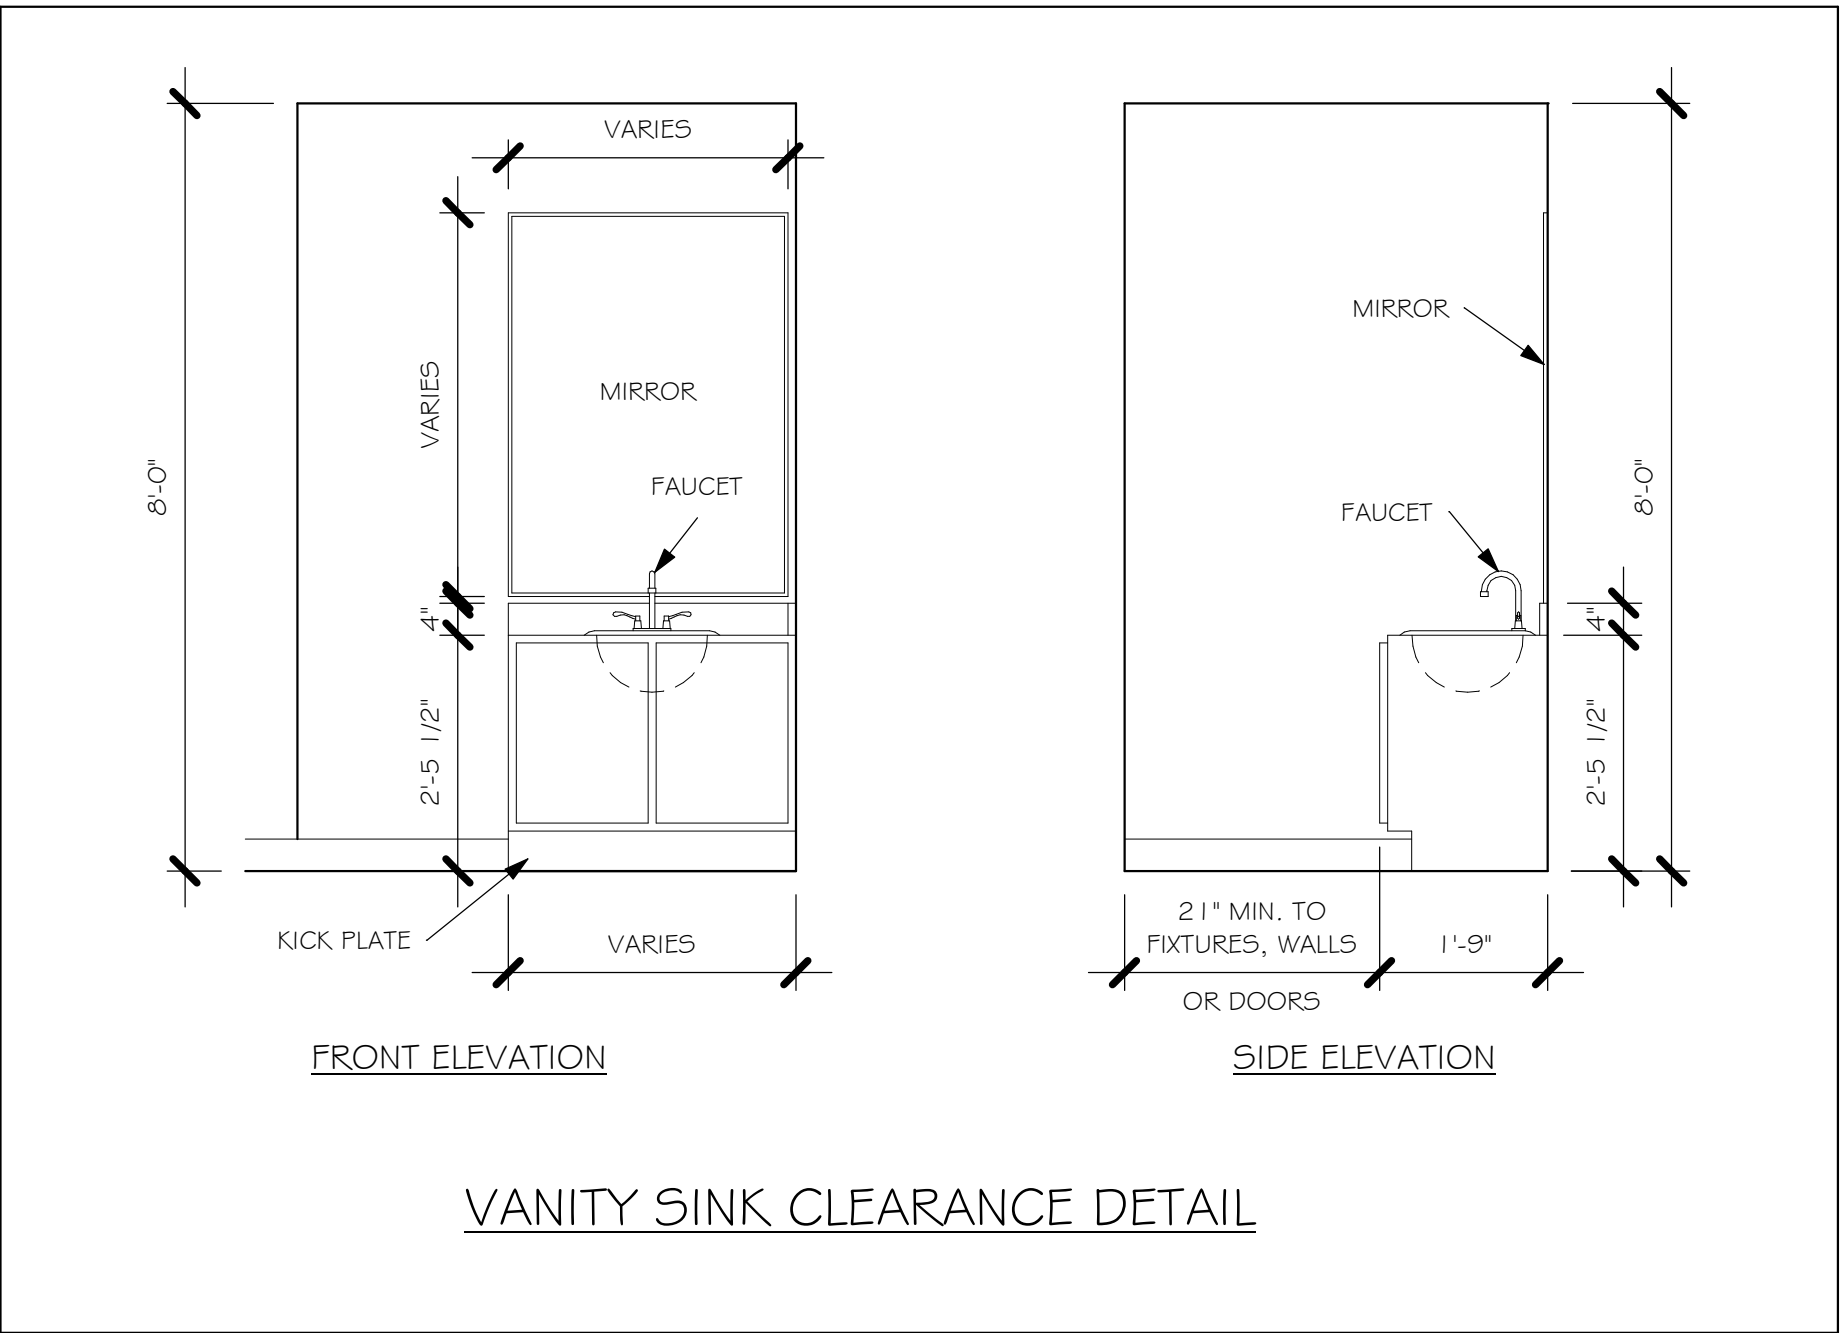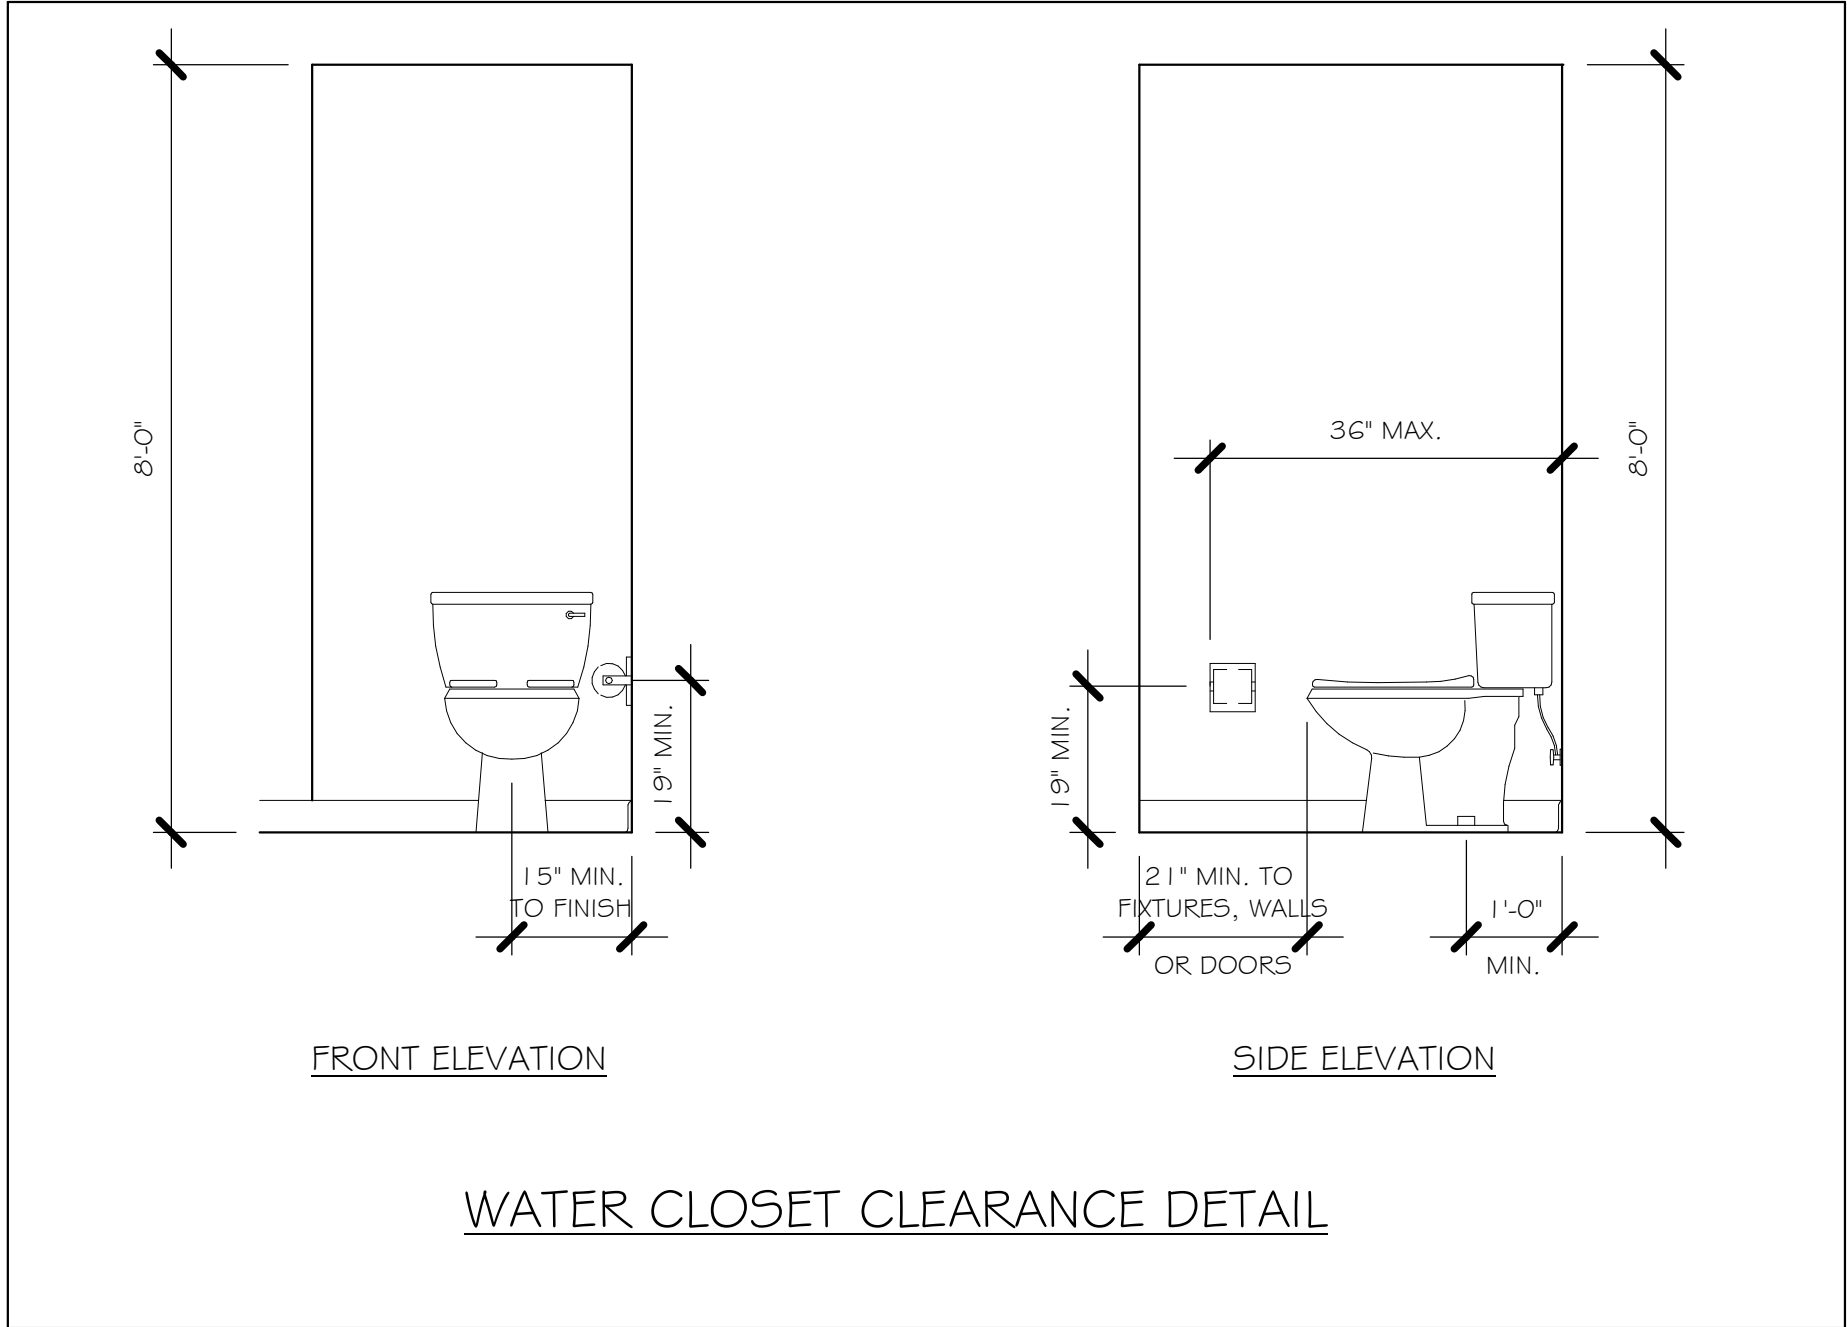

SLAB & PLUMBING PLAN "AR"
1/4" = 1'-0"

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

LOT: 24	BLOCK: 4227
SUBDIVISION: SOUTH GULF COVE	
ADDRS: 8301 AGATE STREET	
D.R.H. #: 579660042	

MODEL	1989
GCD JOB #	12020

DATE:	10/09/20
DRAWN BY:	JSL
CHECKED BY:	JWC
REVISED:	12/08/20
PLAN:	SLAB & PLUMBING
SCALE:	As indicated

Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT
LOT 24 BLK 4227 1989 AR REVIT\2020 1989 AR.rvt

DOOR SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	COMMENTS	QTY
1	1 6080 OHGD		8'-0"	1 6'-0"		1
2	3080 ENTRY		8'-0"	3'-0"		1
3	1 2" SIDE LITE		8'-0"	1'-0"		1
4	2-4080 SL. GL. DR.		8'-0"	8'-0"		1

WINDOW SCHEDULE						
MARK	DESCRIPTION	MANUFACTURER	WIDTH	HEIGHT	COMMENTS	QTY
A	25 SH		3'-1"	5'-3"		1
B	35 SH		4'-6"	5'-3"		4
C	2-25 SH		6'-4"	5'-3"		1
D	48" X 1 6"	FIXED GLASS	4'-2"	1'-6"		1

OPT IMPACT GLASS MAY BE INSTALLED IN LIEU OF SHUTTERS VERIFY W/ CONTRACT

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

- PLAN NOTES
- 1) VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS

2) PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.

3) PROVIDE SAFETY GLAZING AT BATH SHOWER PER FLORIDA BUILDING CODE R 308.4.5.

4) NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)

5) PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE

6) KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.

7) INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS

8) WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5

9) THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE # ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT

10) INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.

11) ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH RG 12.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PREVENTION DEVICE

12) ALL CLOSET SHELVES TO BE 12". ALL PANTRY # LINEN TO BE (4)-1 6" SHELVES 18" O.F.F. W/ 15" INCREMENT.

13) ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

3'-2"



TOWEL BAR

2'-6"

TOILET PAPER ROLL

SQUARE FOOTAGE		
ENTRY AREA		82 SF
LANAI AREA		270 SF
GARAGE AREA		446 SF
LIVING AREA		1982 SF
TOTAL AREA		2780 SF

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-10"	
3	2'-8"	B.F. = BI-FOLD DOOR
4	2'-6"	B.P. = BI-PASS DOOR
5	2'-4"	
6	2'-0"	L.V. = LOUVERED DOOR
7	1'-8"	
8	1'-6"	

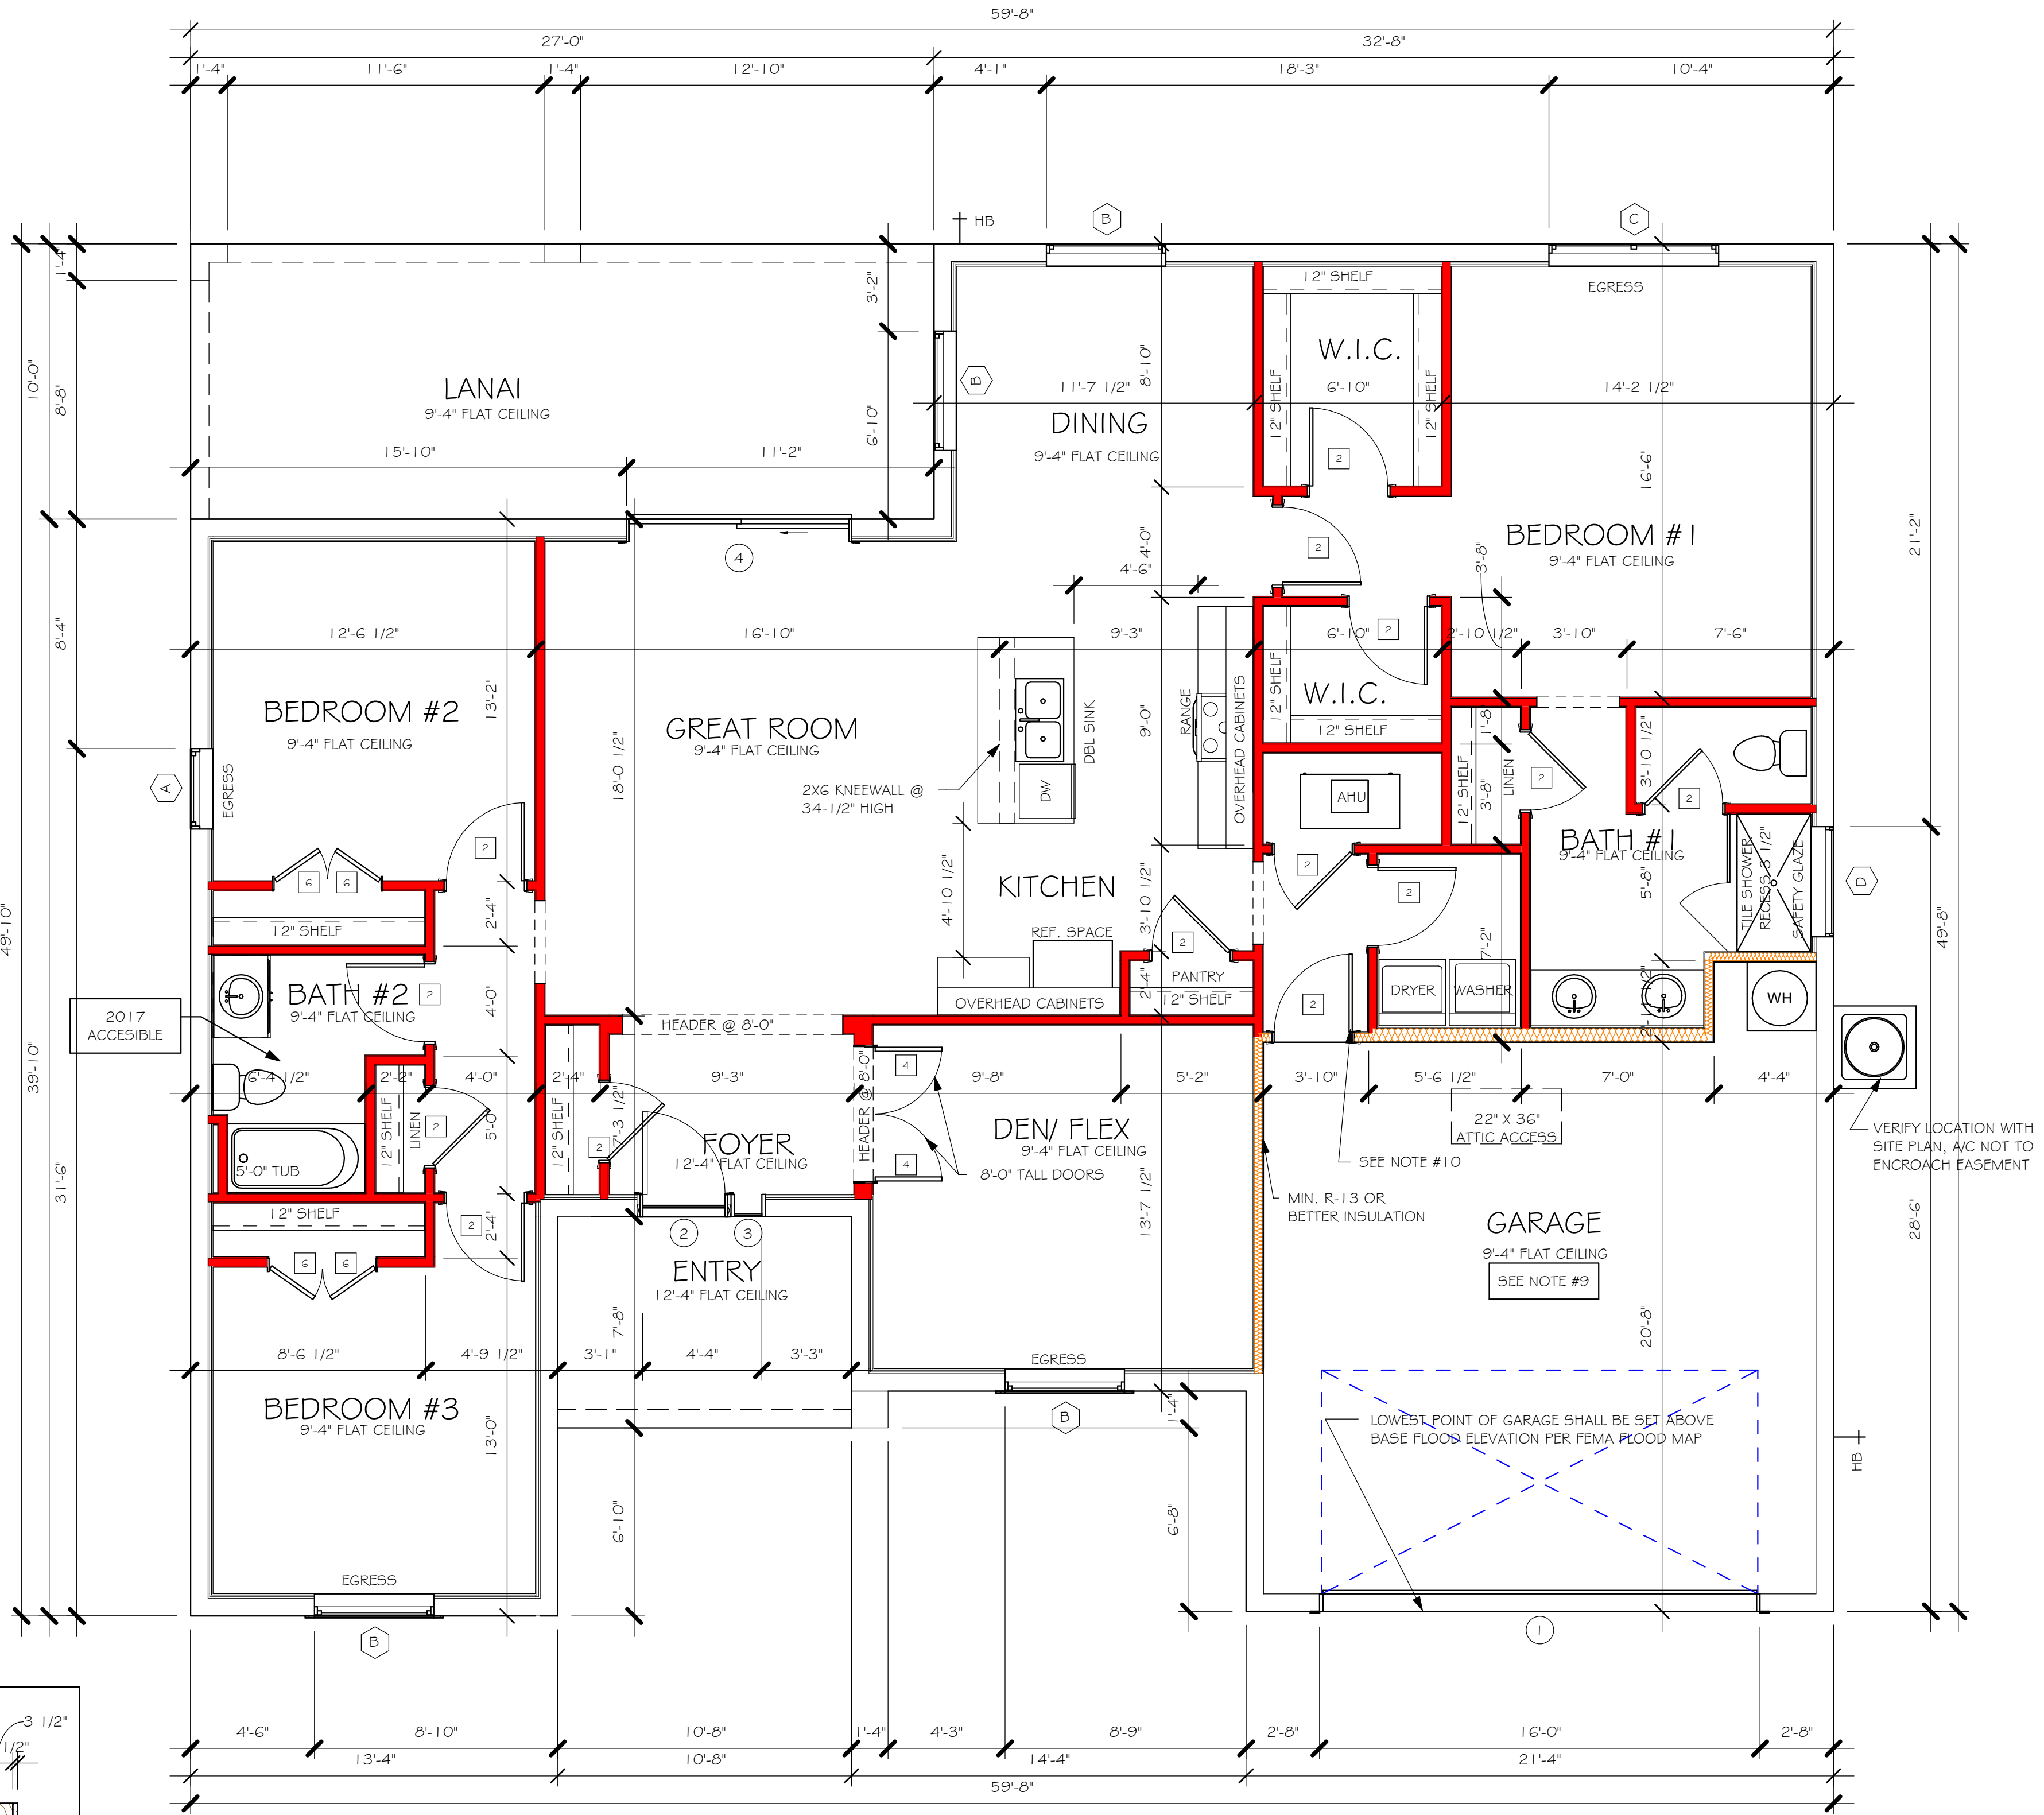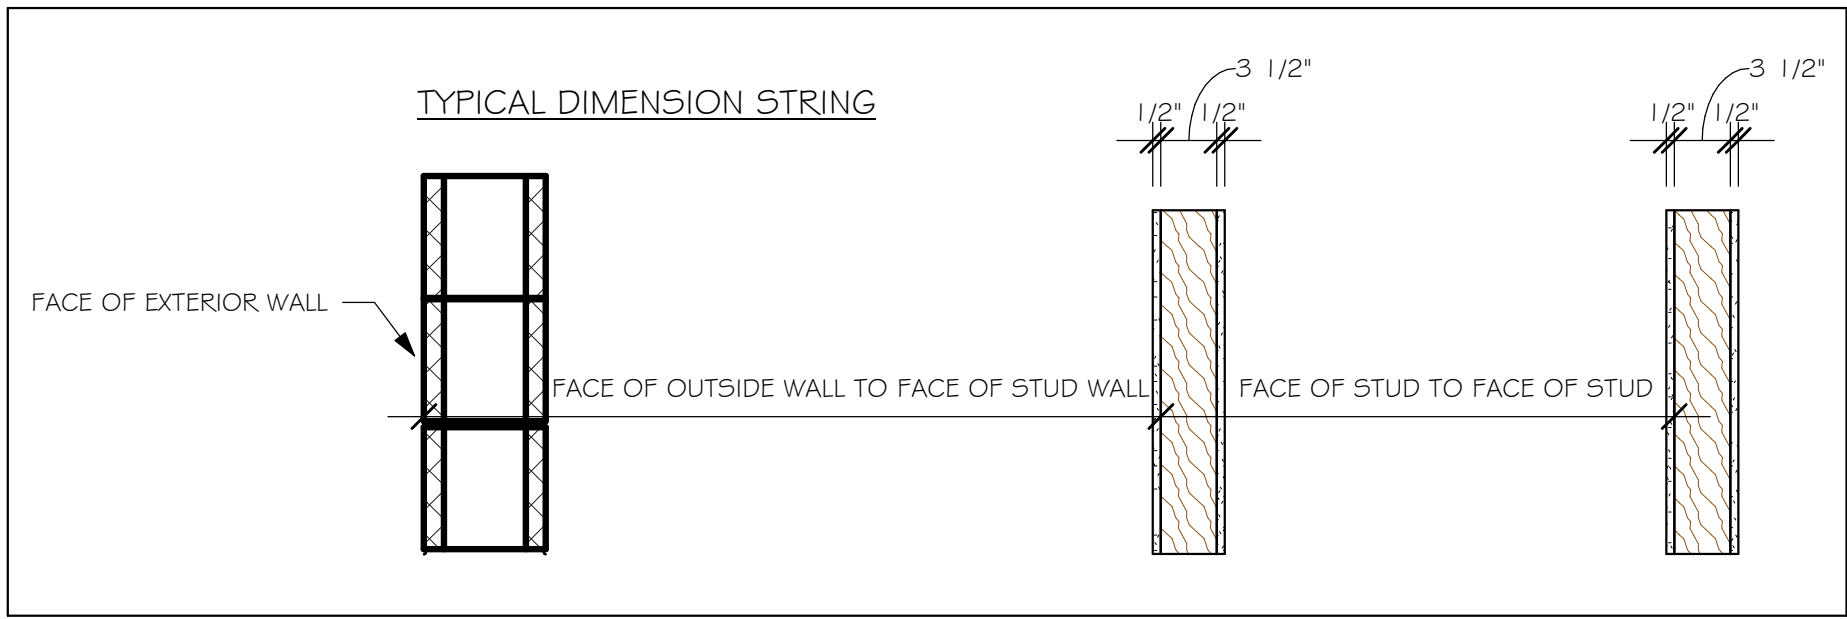

FLOOR PLAN "AR"
1/4" = 1'-0"



No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20


DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT
LOT5\1 2020 LOT 24 BLK 4227 1989 AR\REVIT\1 2020 1989 AR.rvt

MODEL 1989 A: ATTIC VENTILATION FBCR R806
COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS

AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED		
MARK	ATTIC	SOFFIT	ATTIC AREA/50	REQD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	3102.1 SQ. FT.	320.4 SQ. FT.	20.60%	6.46%	0.15%	11.34 SQ. FT.	-	1.1%
"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED					
SOFFIT MODEL			ROOF VENT MODEL					
ACM QUAD 4, FULL VENT, NARROW PATTERN, 0.15% FREE AIR FLOW			22" X 36" ATTIC ACCESS					
			LOMANCO 770-D 0.97 SQ. FT. FREE AIR					


WALL HEIGHT	
	= MAIN WALL @ 9'-4"
	= ENTRY WALL @ 12'-4"

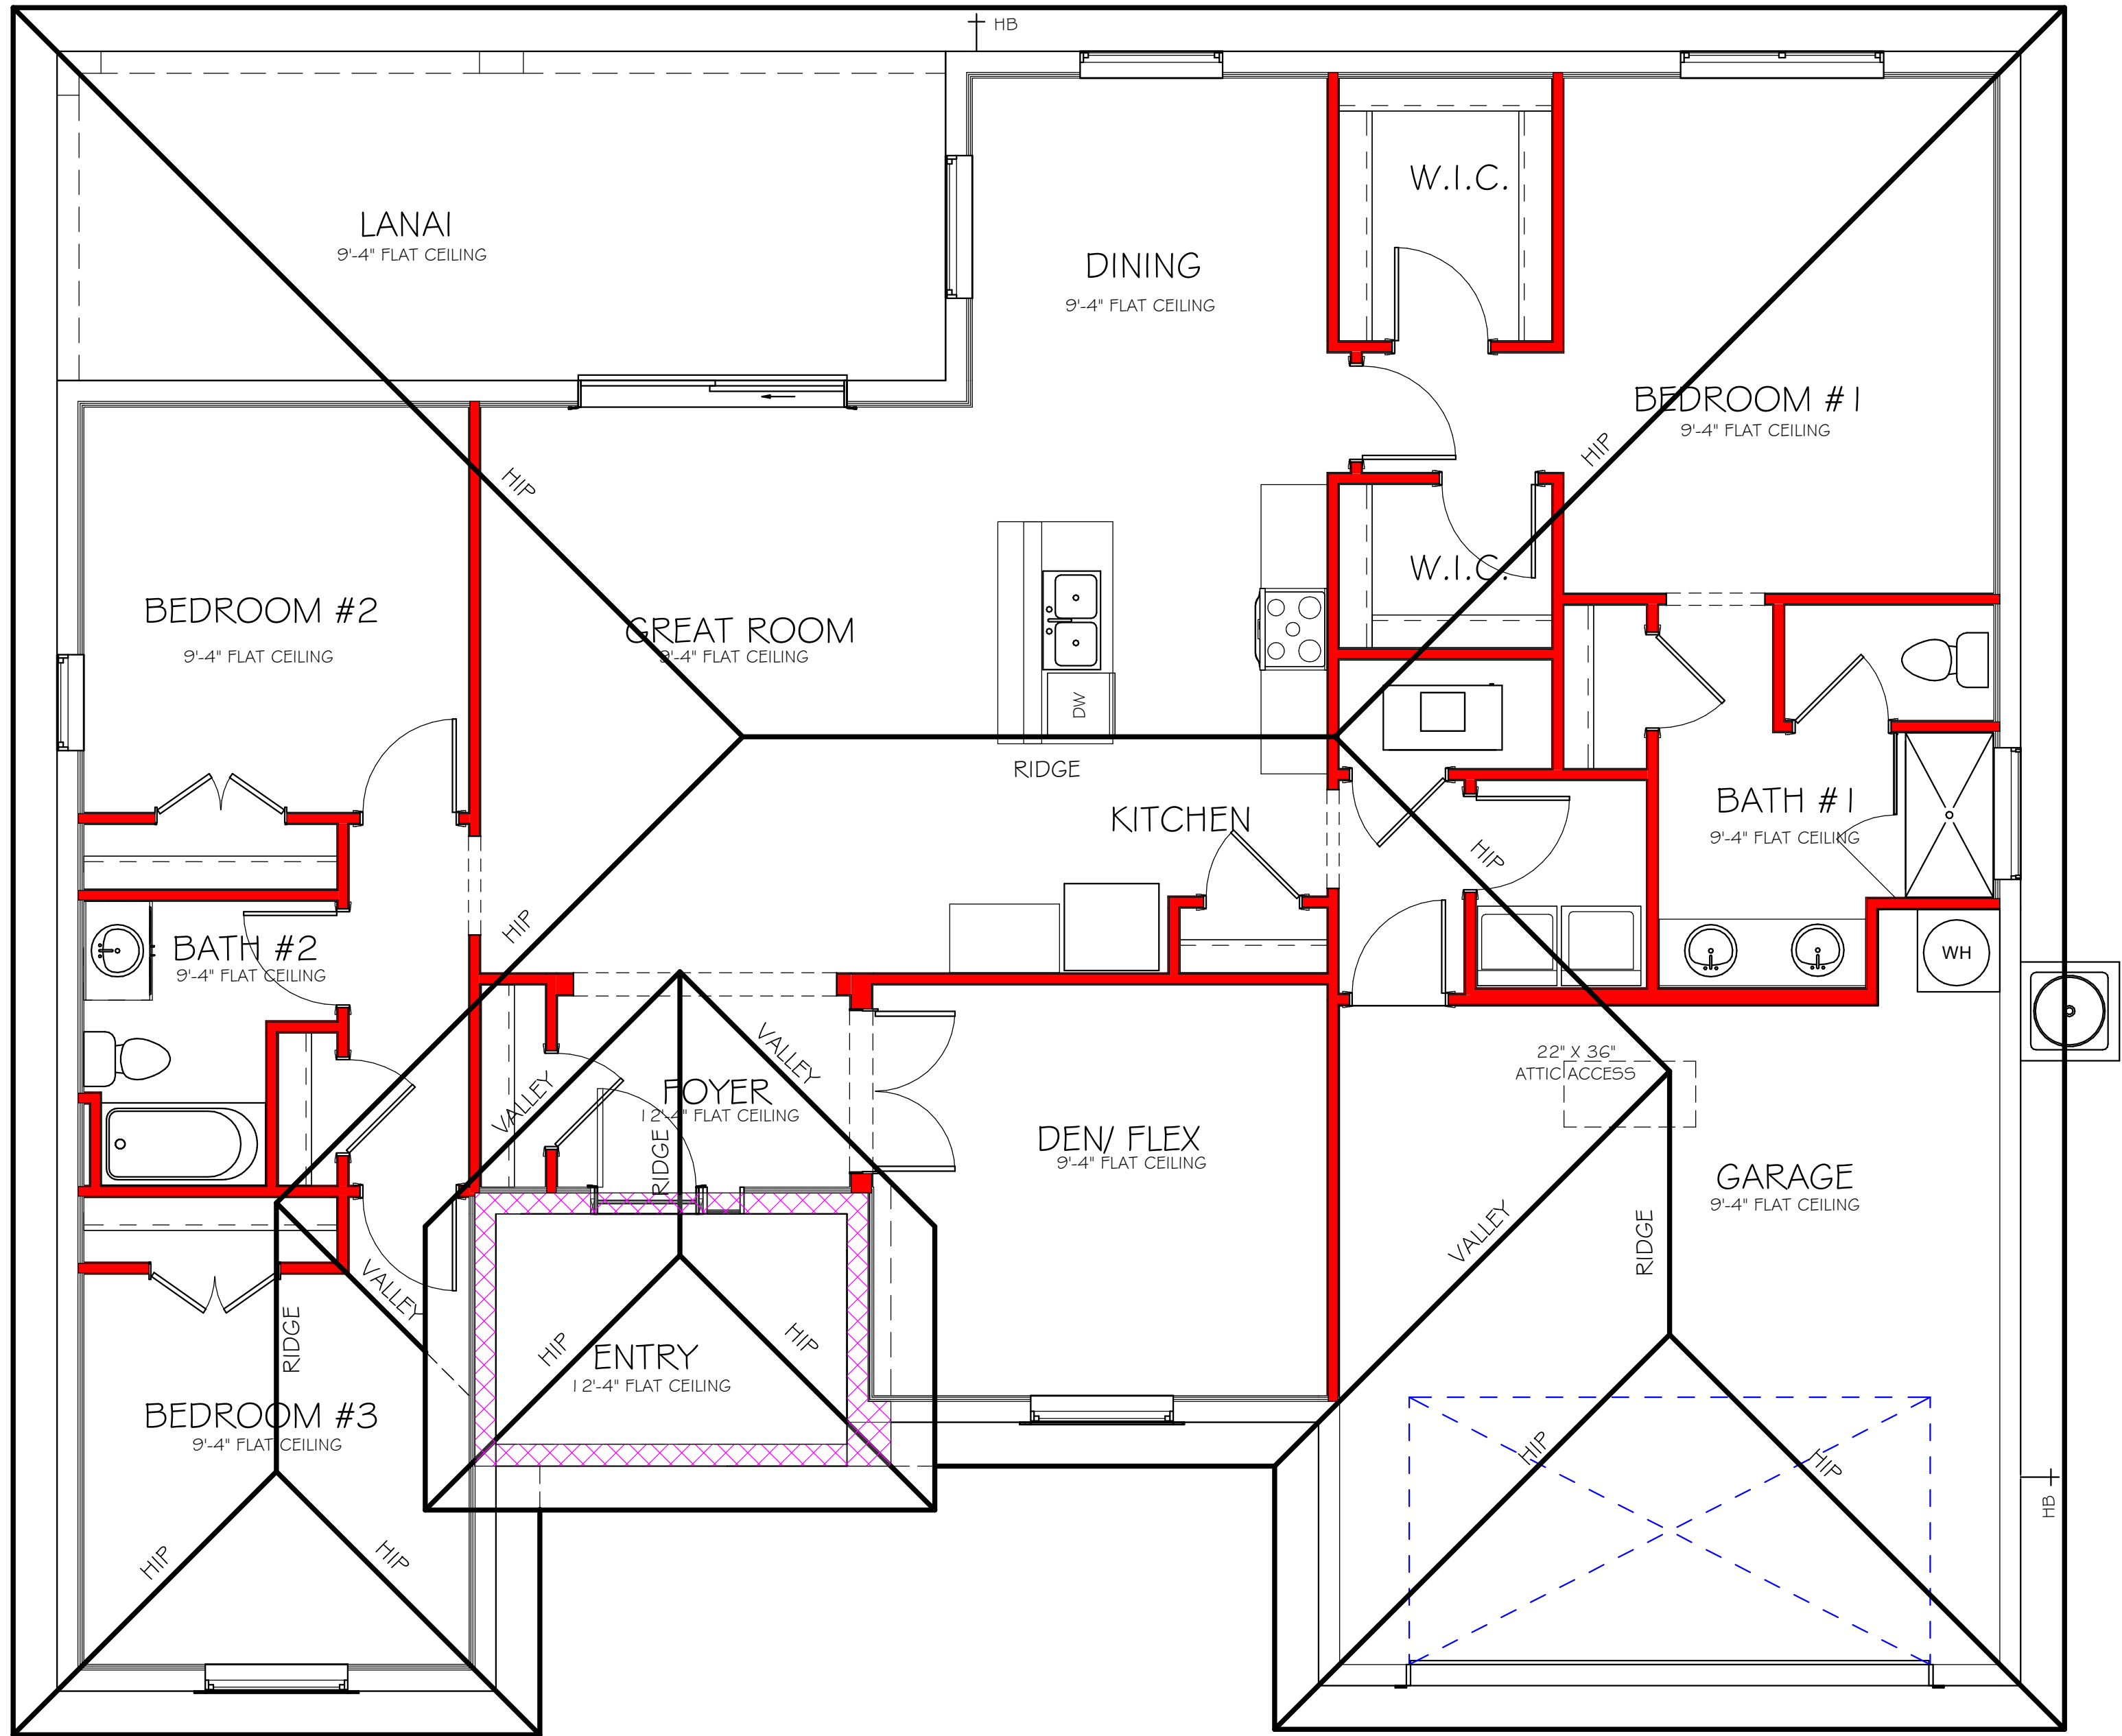


ROOF PLAN "AR"
1/4" = 1'-0"

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2017 - 6TH EDITION

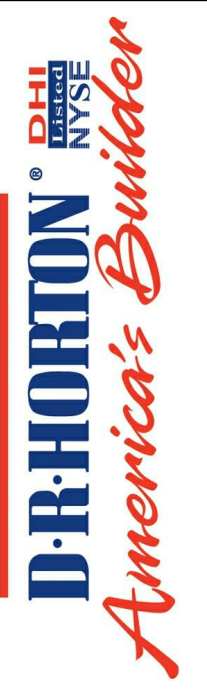

D.R. HORTON
America's Builder

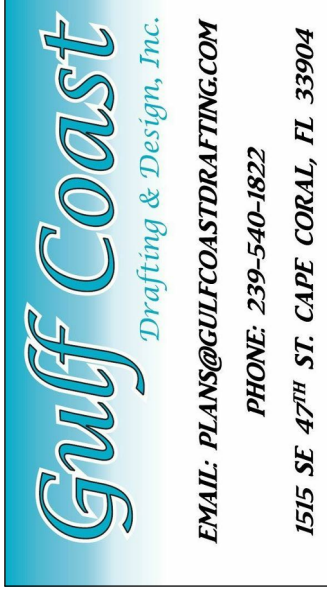

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-1822
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 24

BLOCK: 4227

SUBDIVISION: SOUTH GULF COVE

ADDRESS: 8301 AGATE STREET

D.R.H. #: 579660042

MODEL 1989

GCD JOB # 12020

DATE: 10/09/20

DRAWN BY: JSL

CHECKED BY: JWC


REVISED: 12/08/20

PLAN: ROOF


SCALE: As indicated

A-4 AR


Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE SPOT LOT\1 2020 LOT 24 BLK 4227 1989 ARREVIT\1 2020 1989 AR.rvt

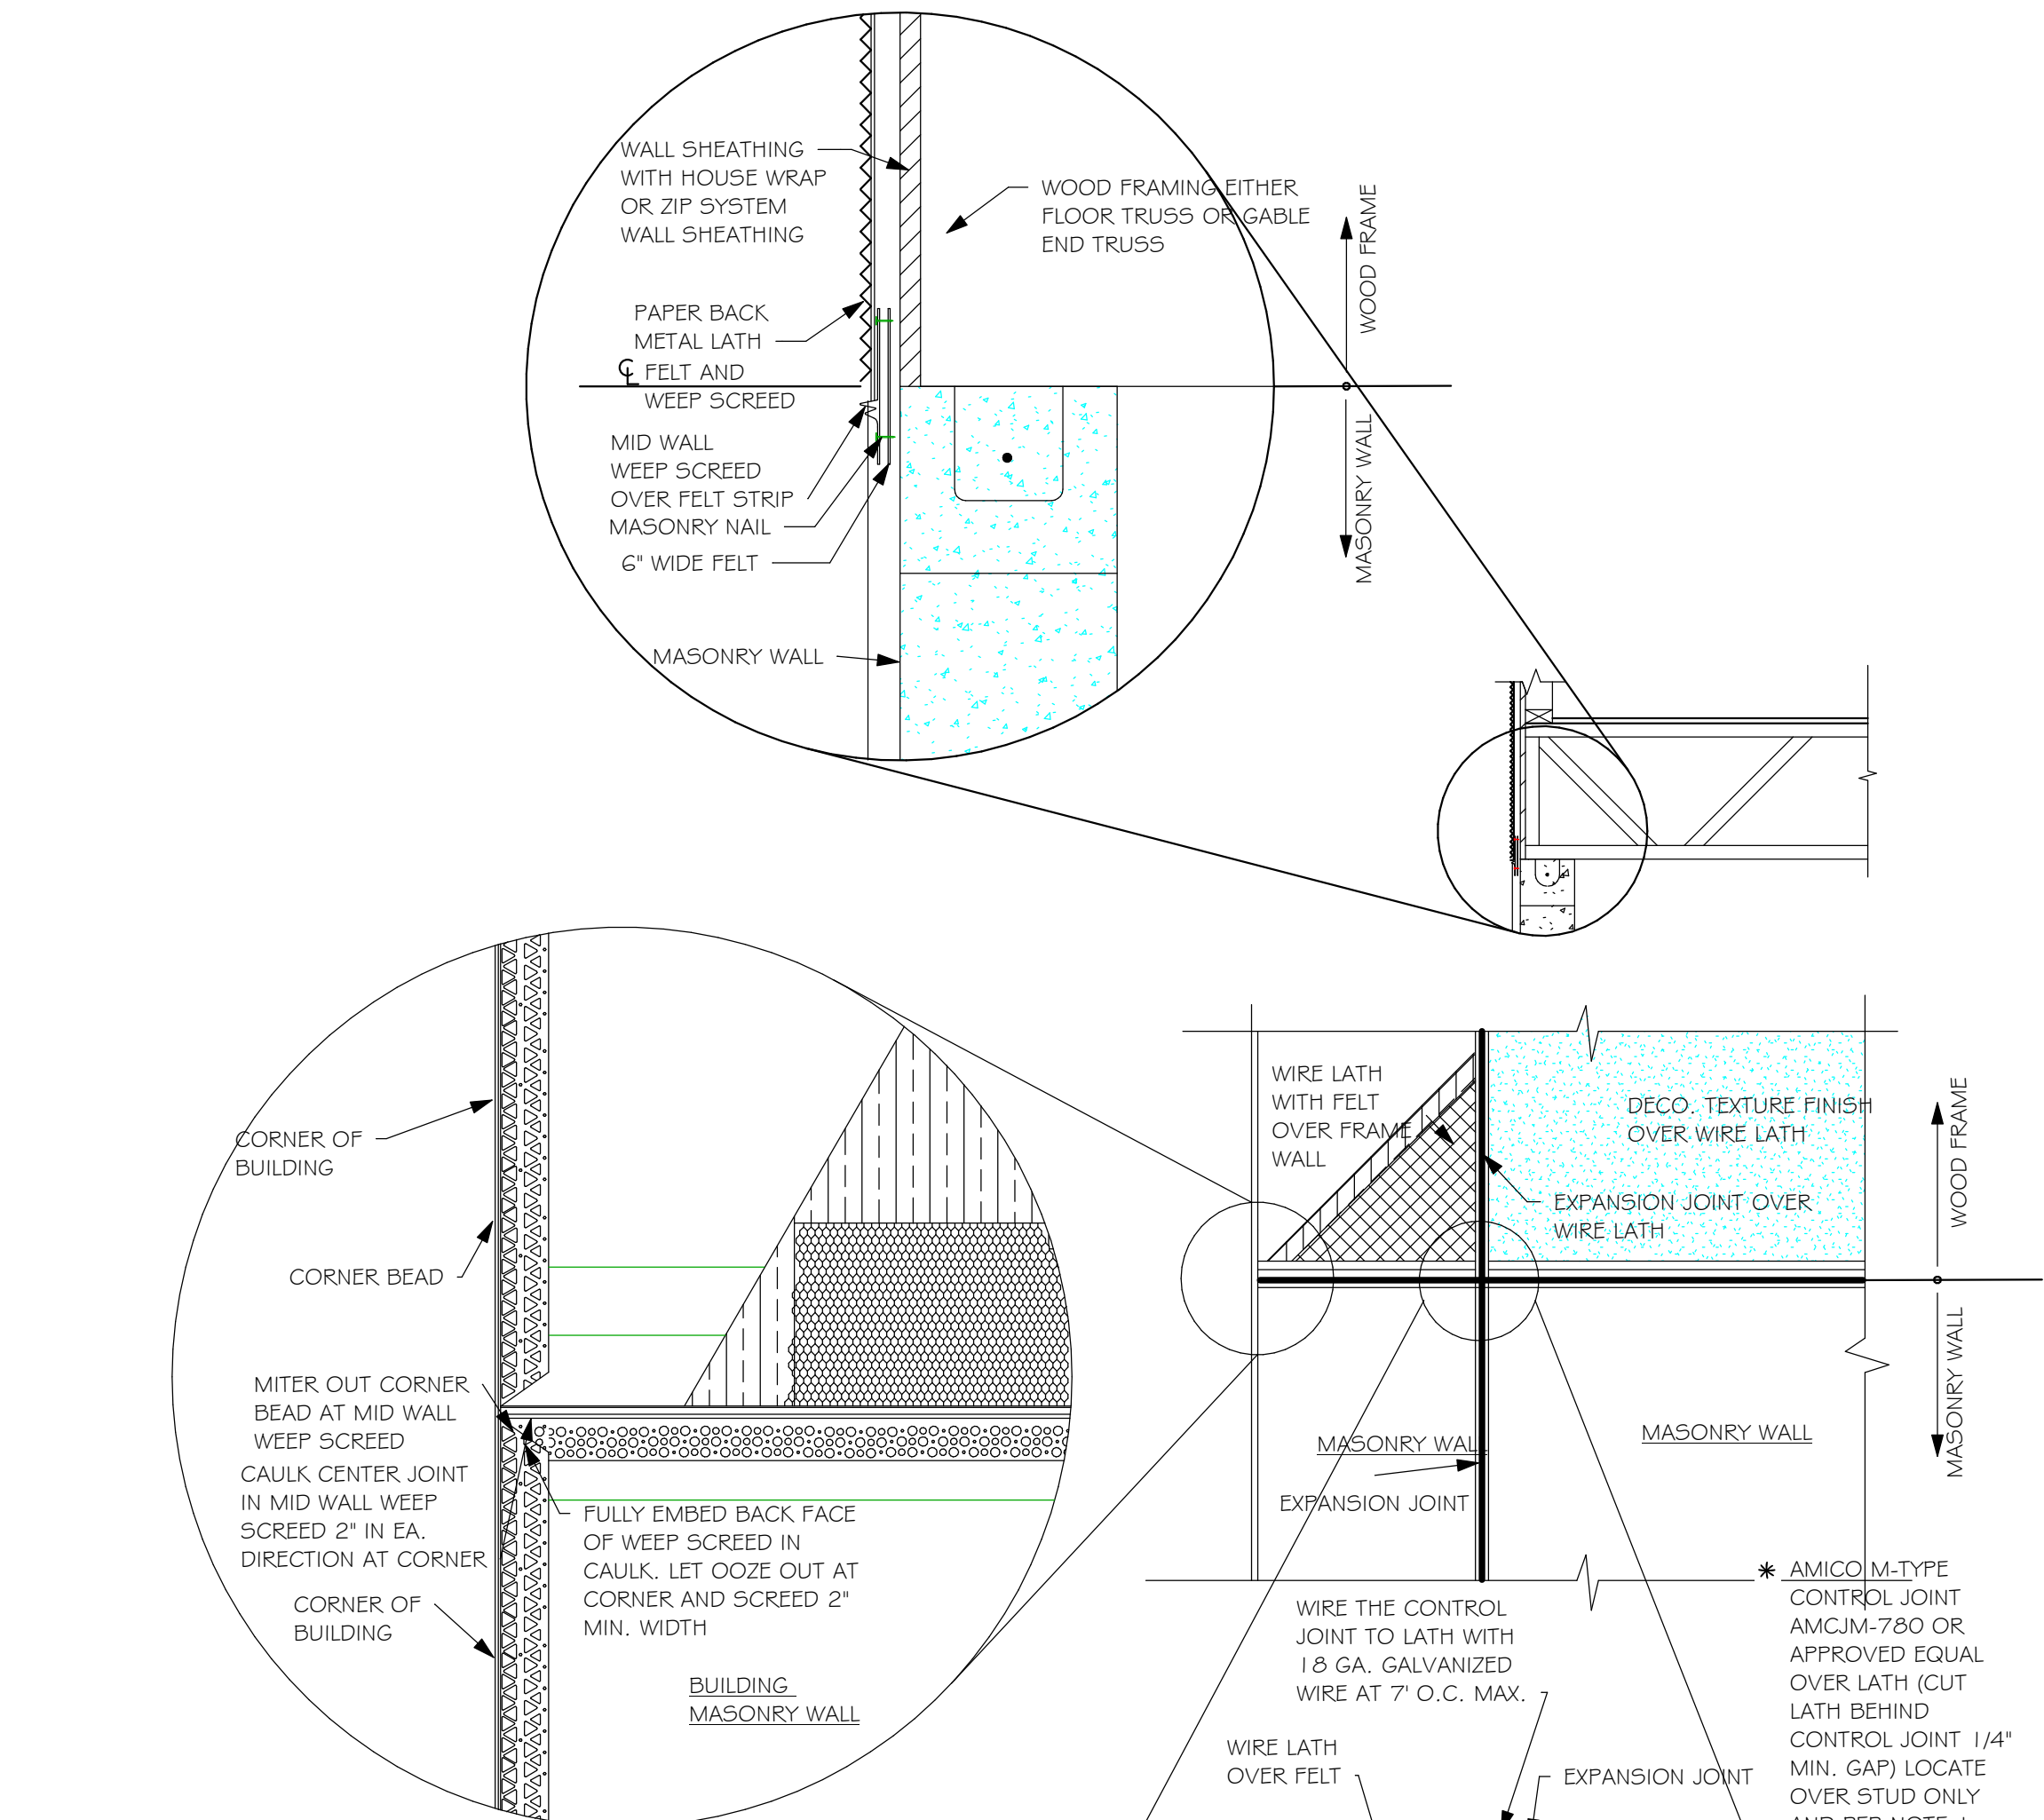

MID WALL WEEP SCREED DETAIL

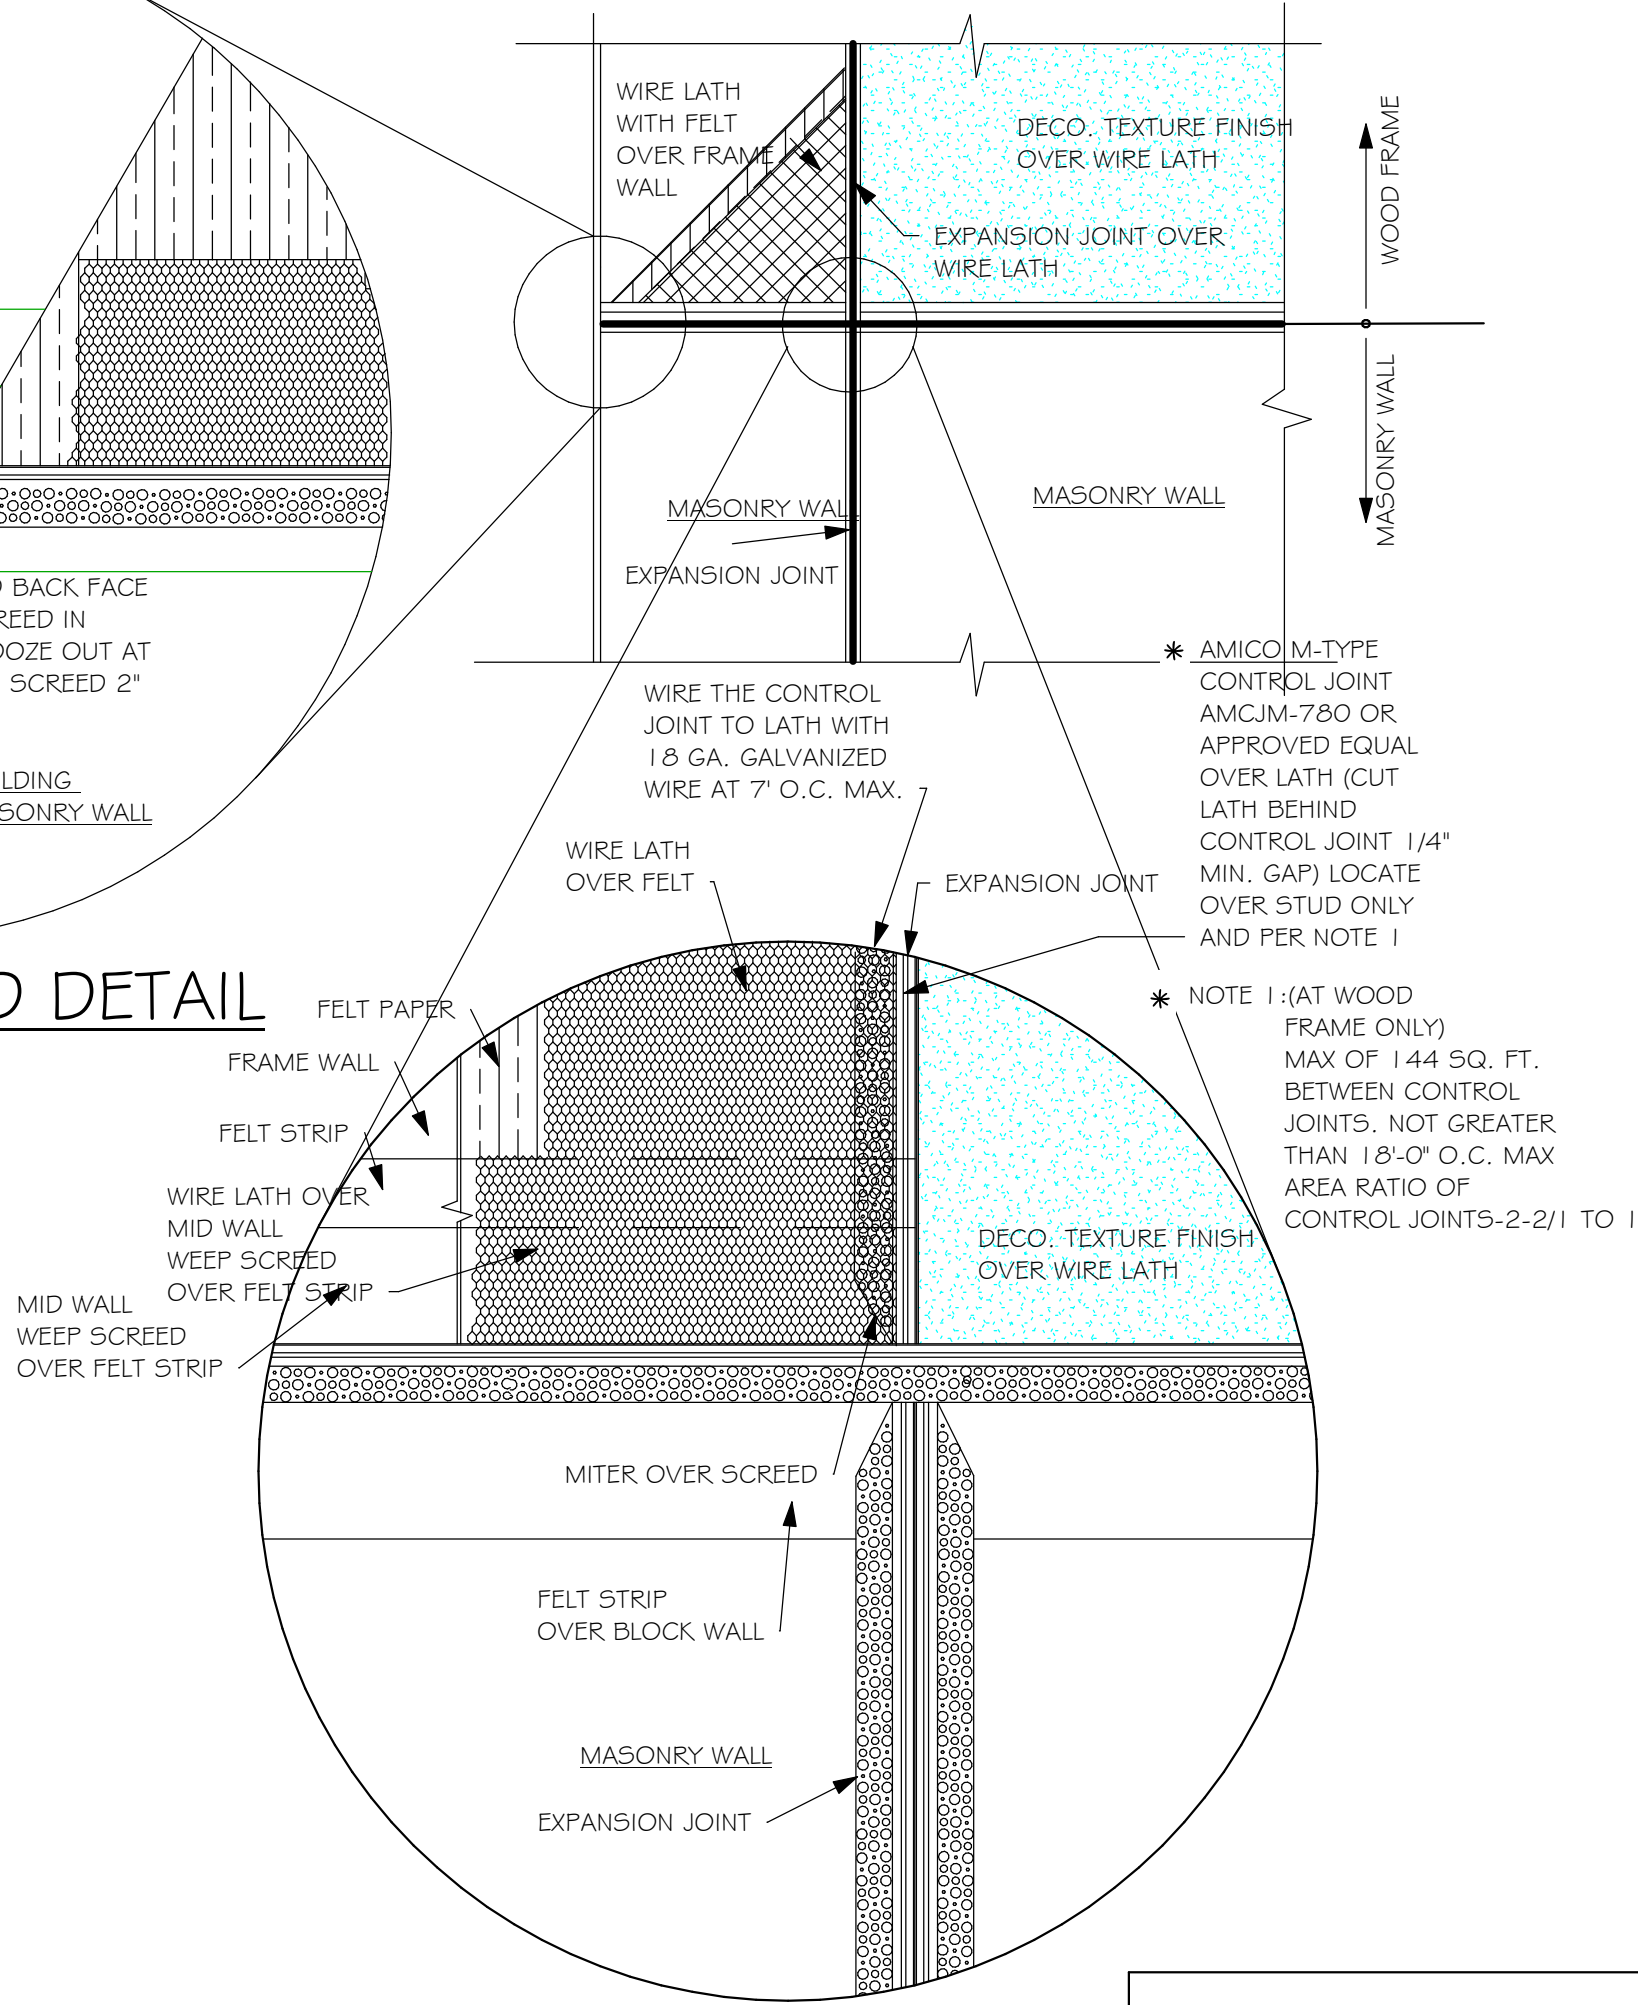

WEEP SCREED DETAIL
INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

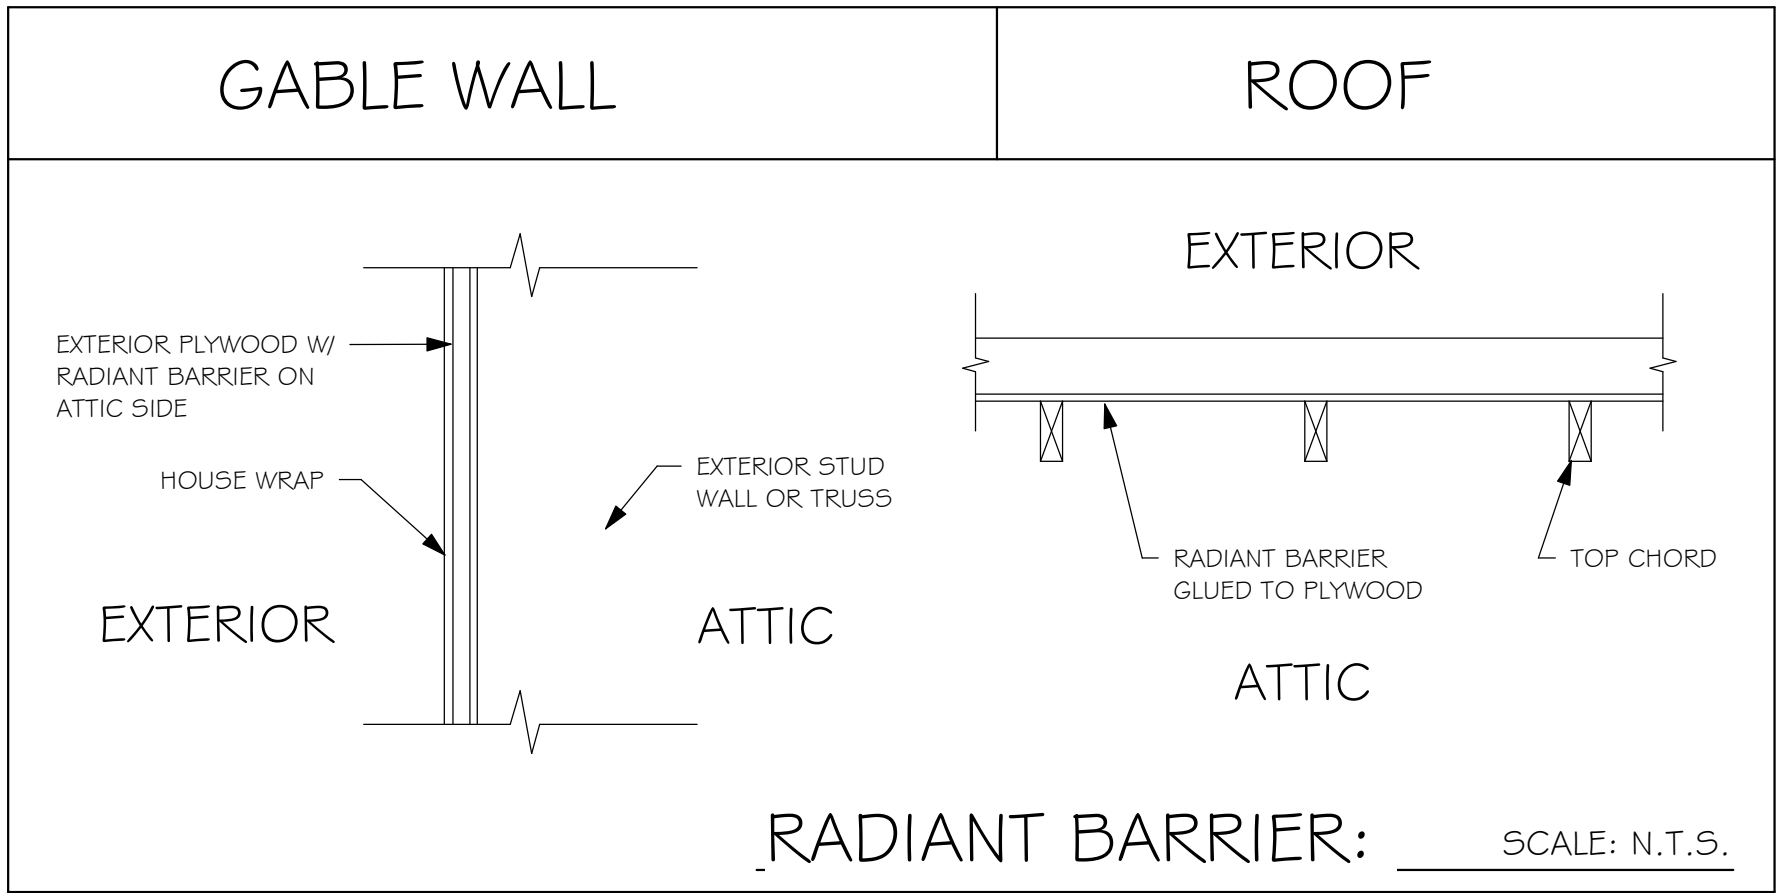

NOTE: EXTERIOR WALLS ADJACENT TO ATTIC SPACE, INCLUDING KNEEWALLS AND GABLE END WALLS, MUST HAVE RADIANT BARRIER AND HOUSE WRAP.

RESIDENTIAL SPECIFICATIONS

GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. FOR REQUIRED SOIL BEARING, SEE STRUCTURAL. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS. CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT. ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL. CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
7. TREATED WOOD REQUIREMENTS:- ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LANAI CEILINGS & COVERED ENTRY CEILINGS 1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.


2

GENERAL ROOF ASSEMBLY

ROOF SHEATHING SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "T" CLIPS AT UNSUPPORTED PANEL EDGES. FOR FASTENING, SEE STRUCTURAL.

FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURERS PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

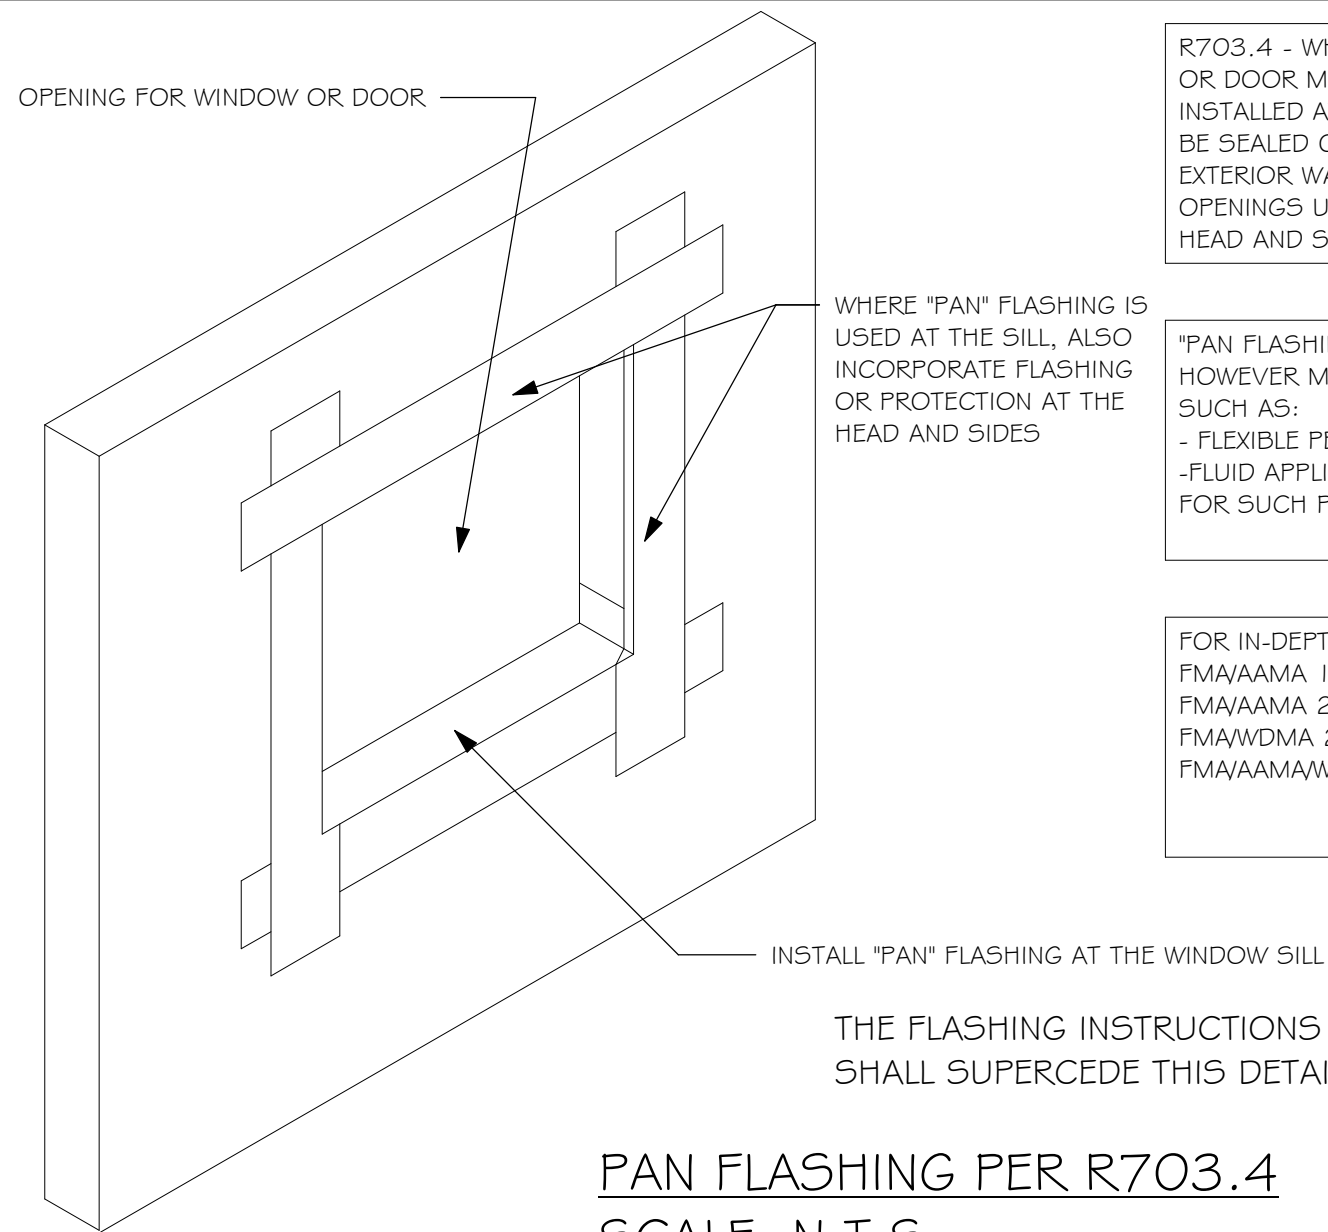

PAN FLASHING PER R703.4
SCALE: N.T.S.

3

ASPHALT SHINGLE ROOF SPECS

SHINGLES

15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462. FOR FASTENING, SEE STRUCTURAL. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

4



CLAY AND CONCRETE ROOF TILE SPECS

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF. THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C. MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK. APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE.
A. AMOUNT AND PLACEMENT OF MORTAR
B. AMOUNT AND PLACEMENT OF ADHESIVE
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.
3. UNDERLAYMENT
4. SLOPE REQUIREMENT.

5


FLOOR SHEATHING AT 2ND FLOOR

A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES SPAN RATING 48/24 OR BETTER, SEE STRUCTURAL.

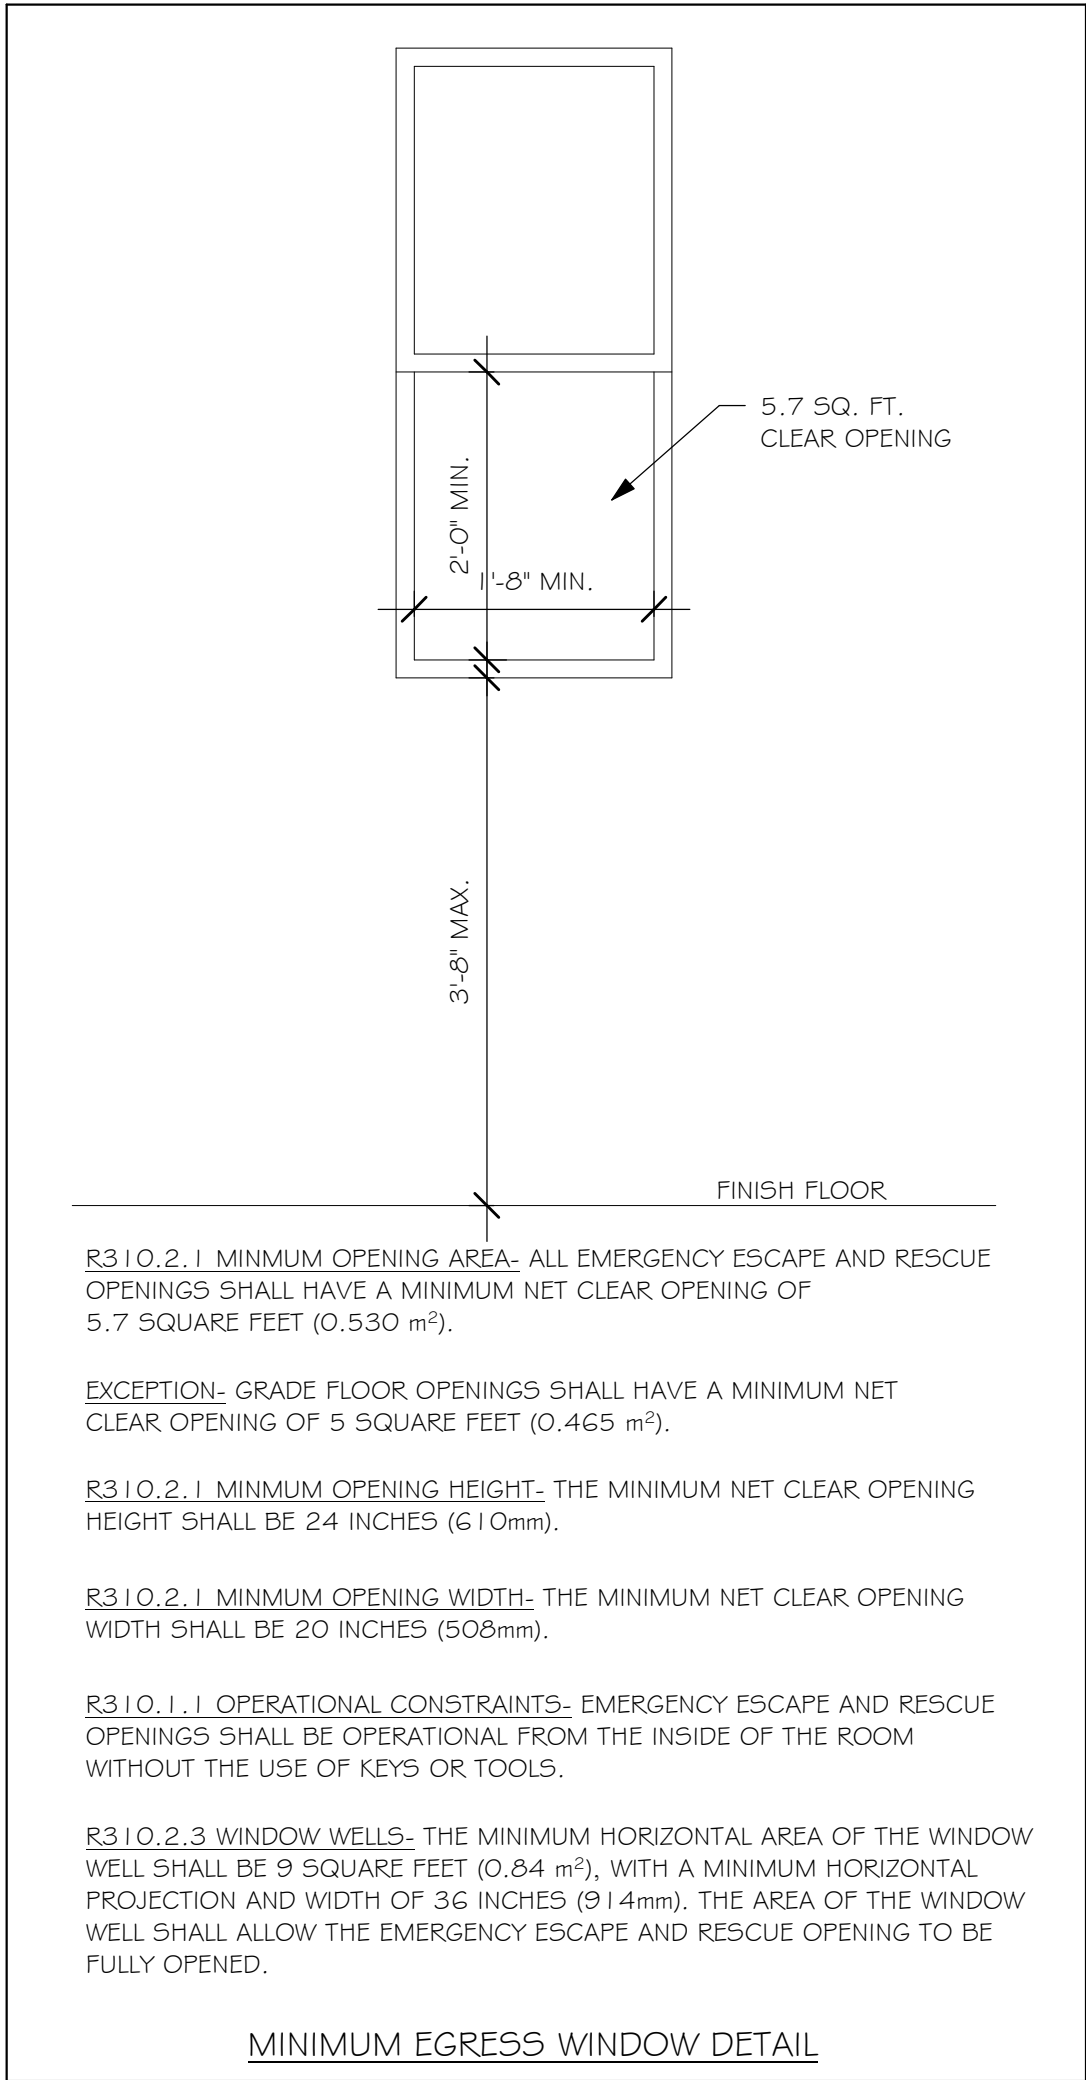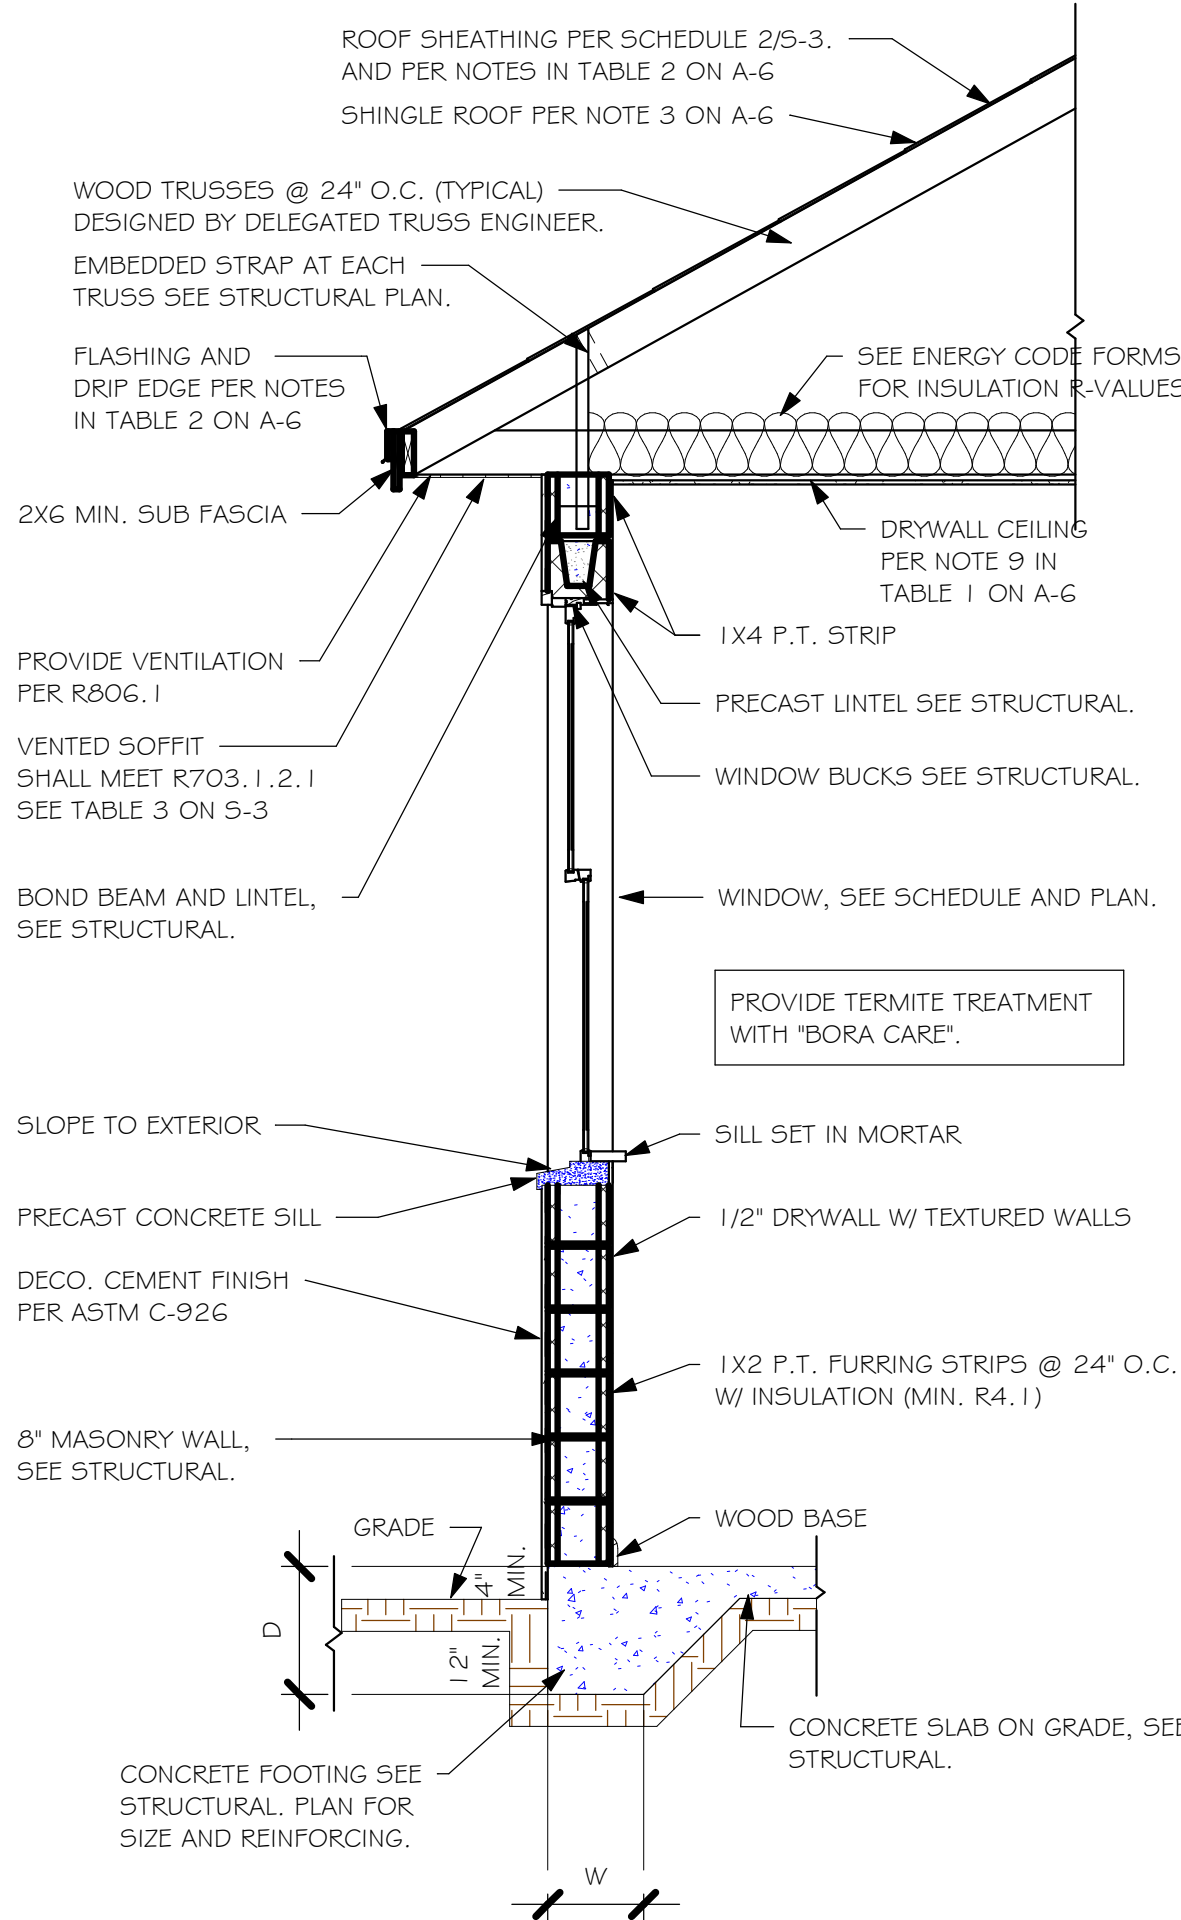

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	1/2/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

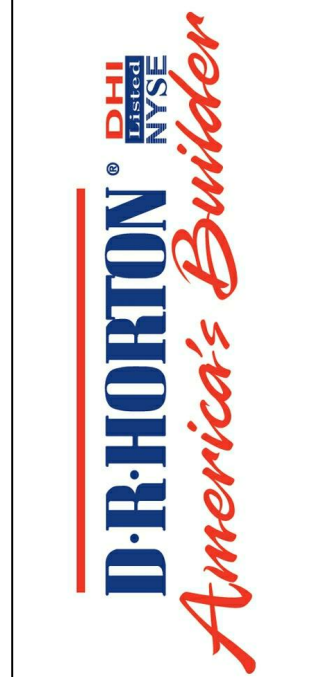

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 239-540-8223
1515 SE 47th ST. CAPE CORAL, FL 33904


LOT: 24
SUBDIVISION: SOUTH GULF COVE
ADDRESS: 8301 AGATE STREET
D.R.H. #: 579660042

MODEL
1989
GCD JOB # 12020


DATE: 1/09/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED: 1/20/20
PLAN: SECTIONS
SCALE: As indicated

A-6


Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\5UBDIVISIONS\GULF COVE 9POT LOT15\1 2020 LOT 24 BLK 4227 1989 ARREVIT\1 2020 1989 AR.vrt

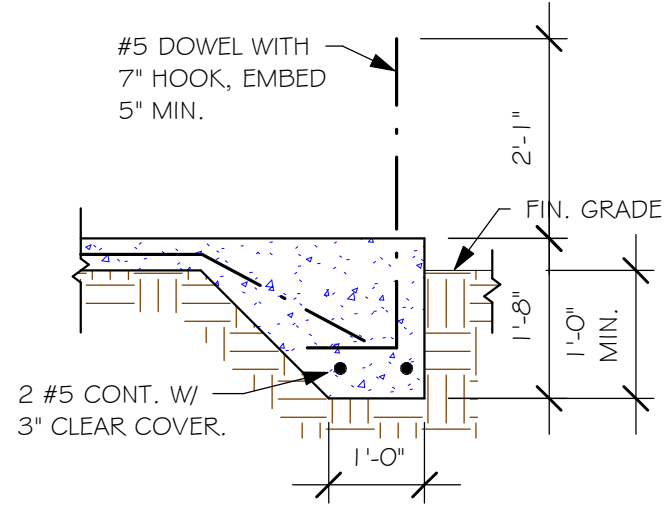


"F3" FOOTING
1/2" = 1'-0"

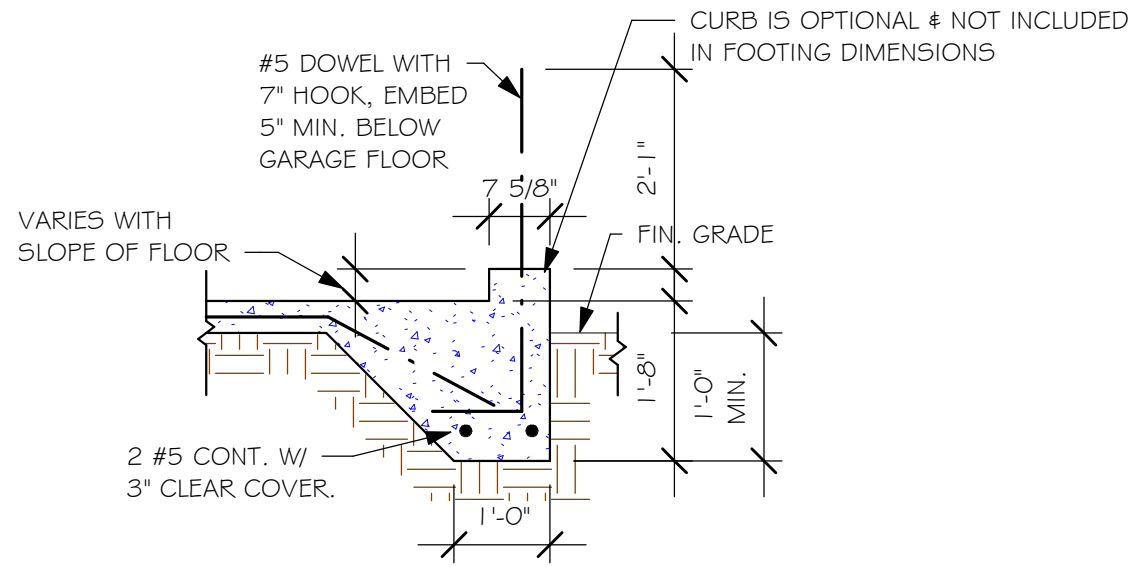


"F3" WITH CURB
1/2" = 1'-0"

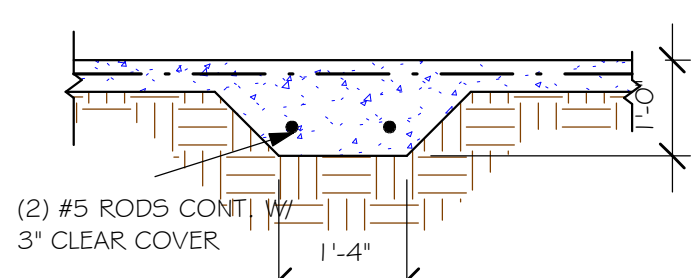


"F5" FOOTING
1/2" = 1'-0"

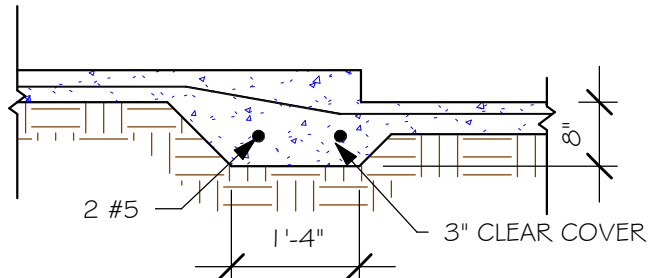

"F6" STEP DOWN
1/2" = 1'-0"

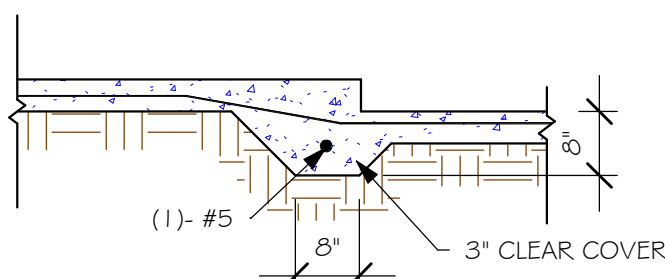

"F6A" STEP DOWN
1/2" = 1'-0"

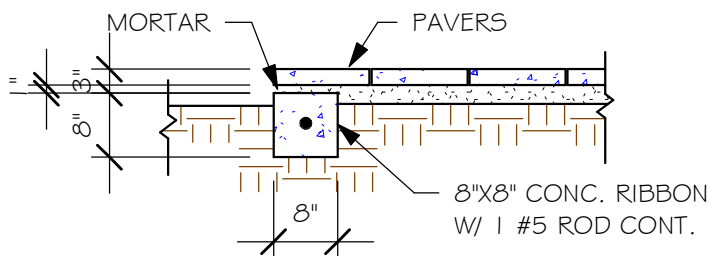


"P" PAVERS DETAIL
1/2" = 1'-0"

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
X	(A)	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
X	(B)	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
X	(C)	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
X	(D)	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
X	(E)	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE	
X	F1	CONT.	1'-4"	0'-8"	2-#5		
X	F2	CONT.	1'-8"	0'-10"	2-#5		
X	F3	CONT.	1'-0"	1'-8"	2-#5		
X	F4	CONT.	1'-4"	1'-8"	2-#5		
X	F5	CONT.	1'-4"	1'-0"	2-#5		
X	F6	CONT.	1'-4"	1'-0"	2-#5		
X	F6A	CONT.	0'-8"	0'-8"	1-#5		
X	TE	CONT.	0'-8"	0'-8"	1-#5		

PROVIDE CORNER BARS IN FOOTING PER 6/5-3

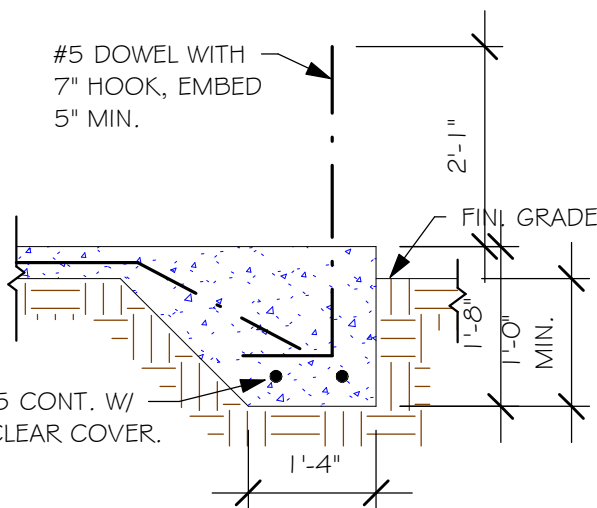


"F4" FOOTING A
1/2" = 1'-0"

FOUNDATION PLAN

SCALE: 1/4" = 1'-0"

PLAN NOTES:

1. TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
2. "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
3. PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
4. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
5. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
6. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/5-3.

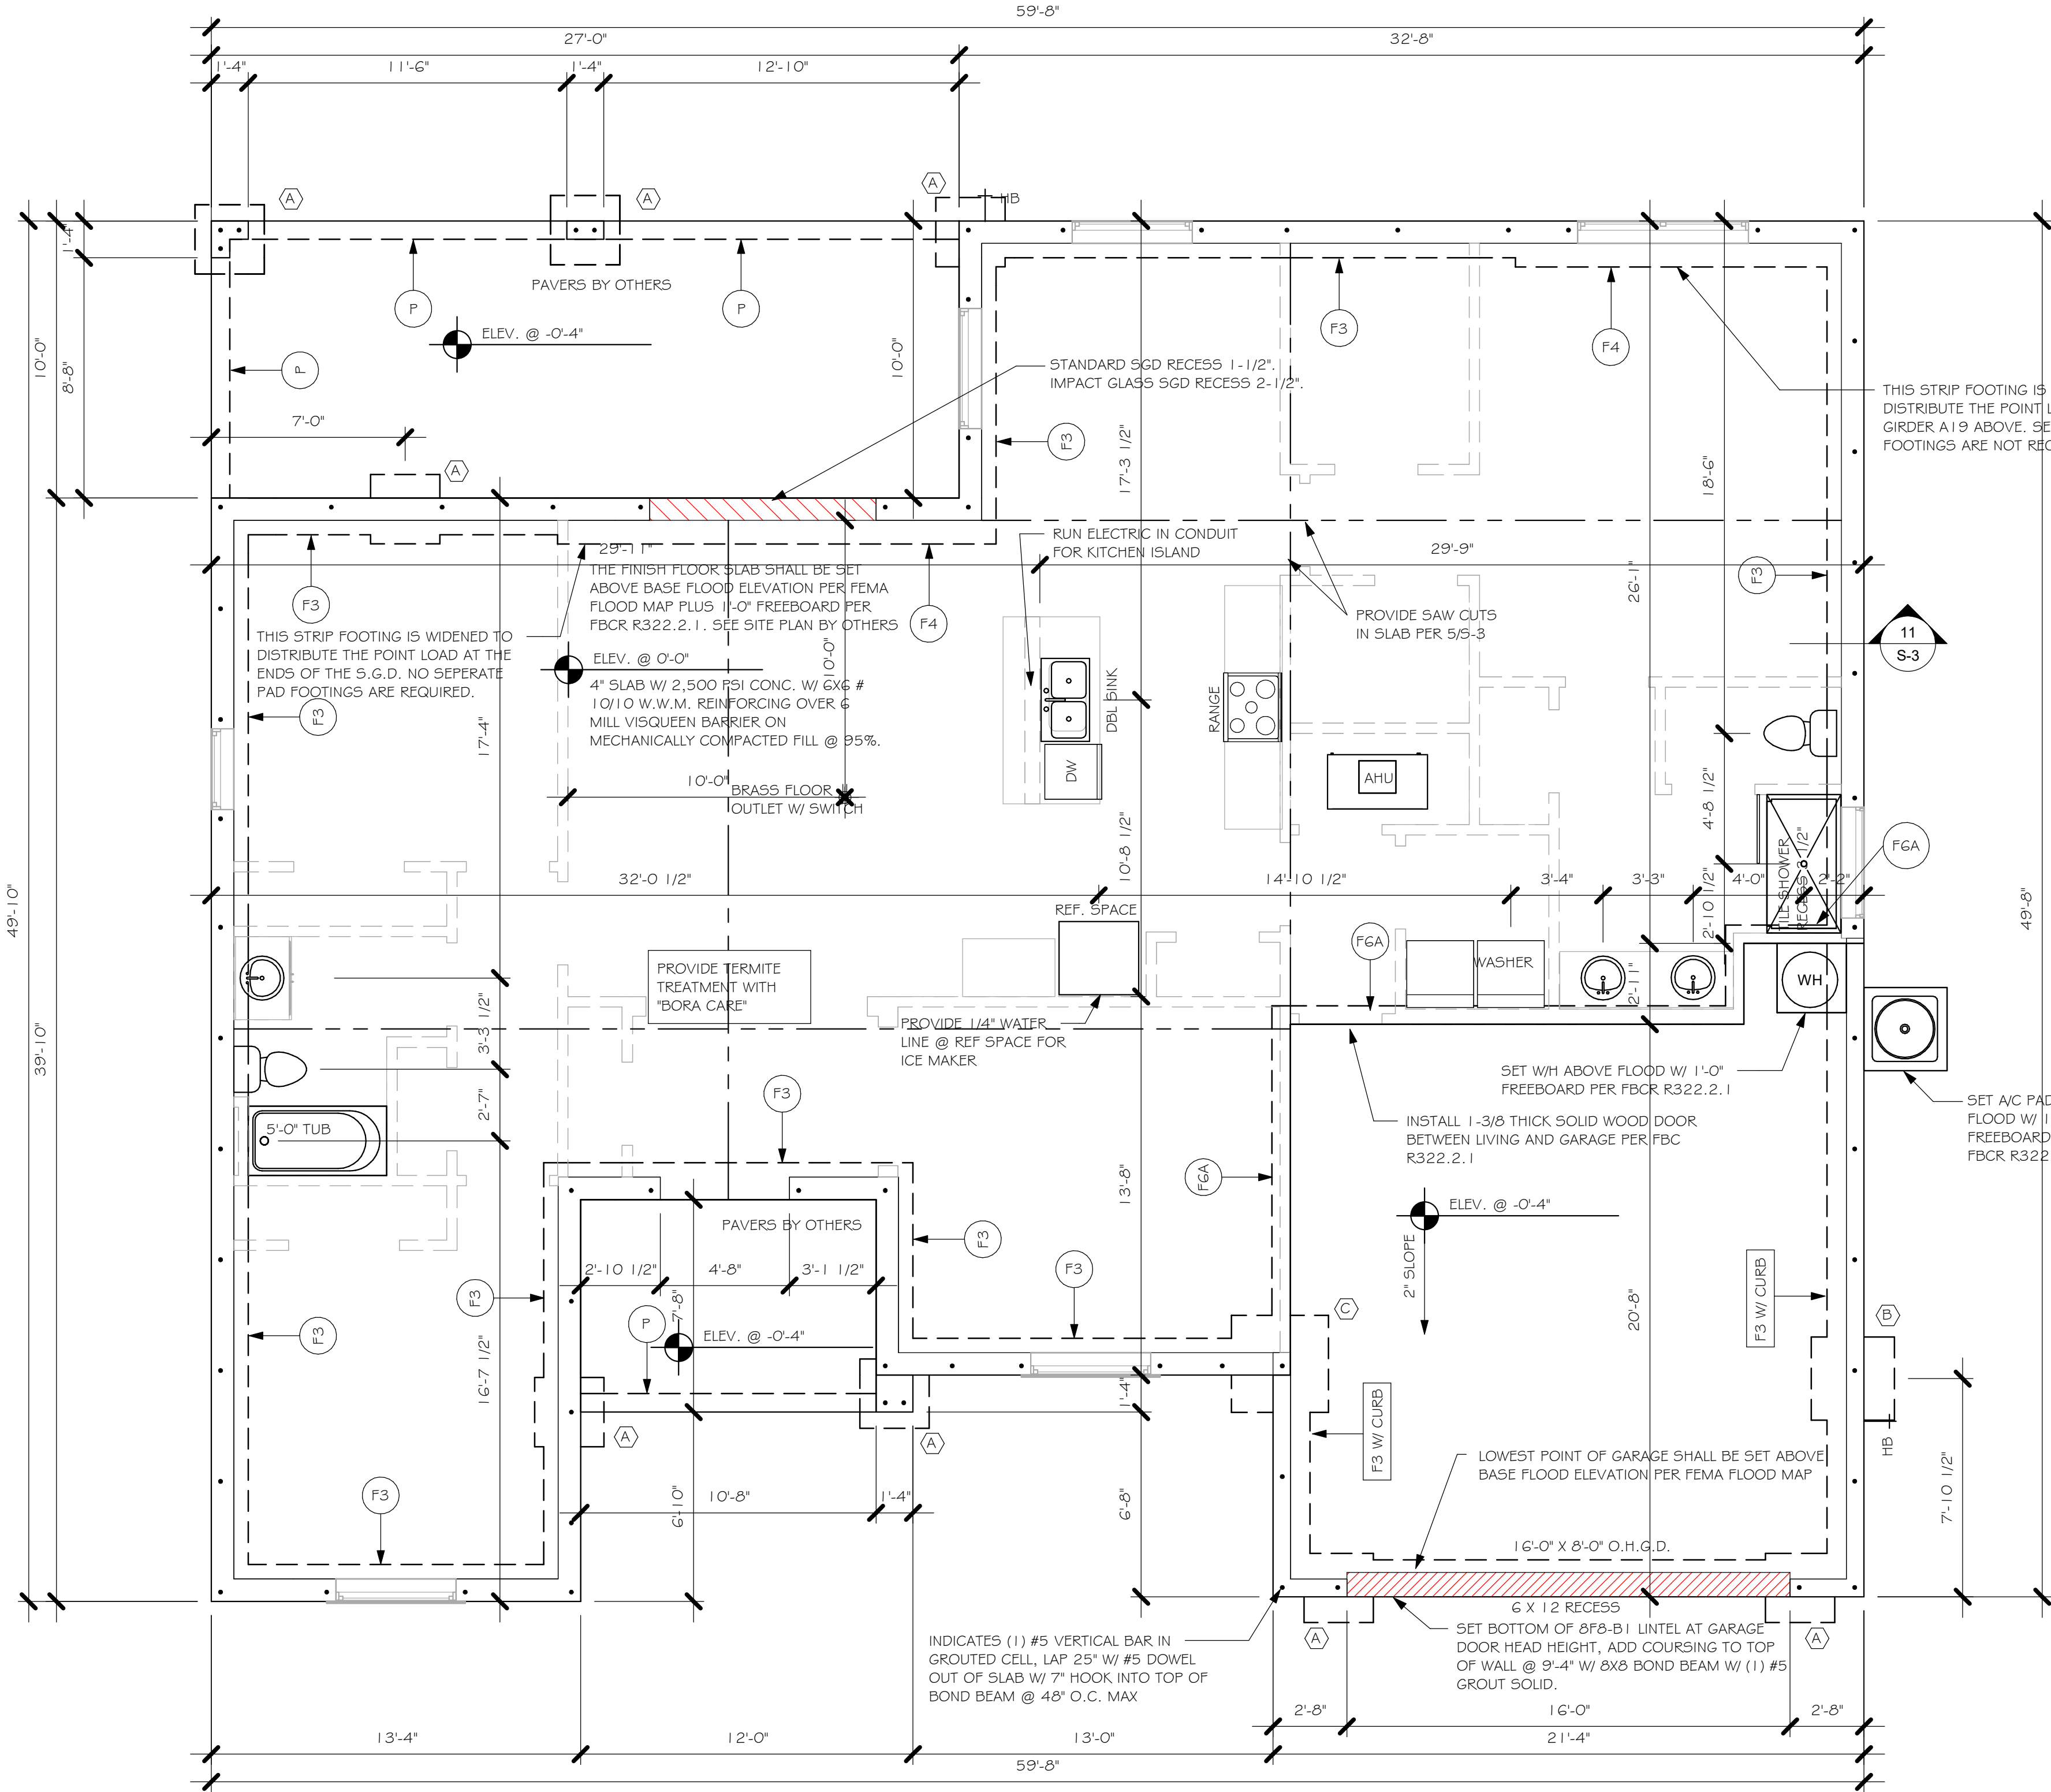


FOUNDATION PLAN "AR"
1/4" = 1'-0"

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

This item has been digitally signed by Paul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

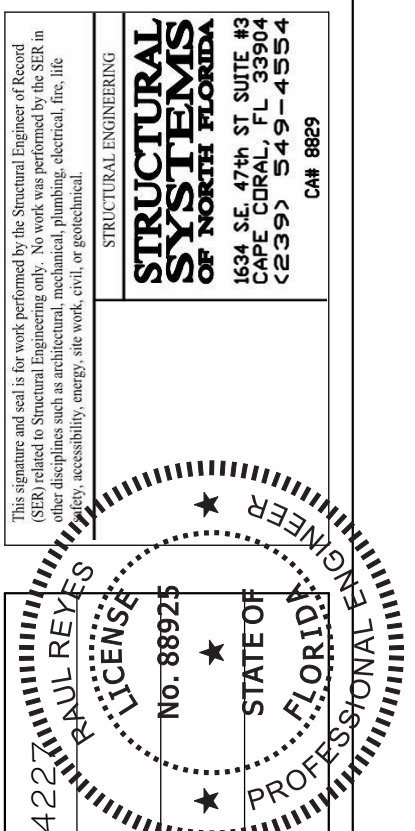

LOT: 24
SUBDIVISION: SOUTH GULF COVE
ADDRESS: 8301 AGATE STREET
D.R.H. #: 579660042

MODEL
1989
GCD JOB # 12020

DATE: 10/09/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED: 12/08/20
PLAN: FOUNDATION PLAN
SCALE: As indicated

S-1 AR

STRUCTURAL SYSTEMS OF NORTH FLORIDA
200 E. CORAL BLVD., SUITE 200
CORAL GABLES, FL 33134
(305) 449-4554
CFL 8889

Gulf Coast
Drafting & Design, Inc.
EMAIL: PLANS@GULFCOASTDRAFTING.COM
PHONE: 395-540-822
1515 SE 47th ST. CAPE CORAL, FL 33904

D-R HORTON
America's Builder

Y:\1-MASTER 2019\2019-BUILDERS\DR HORTON 2019\SUBDIVISIONS\GULF COVE 5POT LOT 24 BLK 4227 1989 AR\REVIT\2020 1989 AR.rvt

TRUSS STRAPPING TO MASONRY		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
1450	(1) META16 TO 40	(8) 0.148x1 1/2", EMBED 4"
1810	(1) META16 TO 40	(9) 0.148x1 1/2", EMBED 4"
2120	(1) HHETA16 TO 40	(10) 0.148x1 1/2", EMBED 4"
1875 (1 PLY)	(2) META16 TO 40	(10) 0.148x1 1/2", EMBED 4"
1795 (2 PLY)	(2) META16 TO 40	(14) 0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) META16 TO 40	(12) 0.162x3 1/2", EMBED 4"
2365 (2 PLY)	(2) HHETA12 TO 40	(12) 0.162x3 1/2", EMBED 4"
3965/SYP 3330/SPF	MTT (2 PLY)	(22) 0.148x3" ATR, EPOXY 12"
4235/SYP 3640/SPF	HTT4	(18) 0.162x2 1/2", 5/8" ATR, EPOXY 12"
4670/SYP 4015/SPF	HTT5	(26) 0.148x3", 5/8" ATR, EPOXY 12"
5445/SYP 5360/SPF	HTT5KT	(26) 0.148x3" TO GIRDER
10690/SYP 10690/SPF	(1)HGT - 2	(2) 3/4" Ø ATR, EPOXY 12"
10790/SYP 10790/SPF	(1)HGT - 3	(16) 0.148x3" TO GIRDER
		(2) 3/4" Ø ATR, EPOXY 12"

NOTES:

- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON -C OF WALL.
- CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
- WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 105-3.

SIMPSON CATALOG C-C- 2019



- PLAN NOTES:
- ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET 5-3.
 - PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - FOR NAILING OF ROOF, SEE 1 AND 2 ON 5-3.
 - ØF8-TB etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - AT TRUSS BEARING, PROVIDE Øx8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 115-3.

TRUSS STRAPPING TO STUDWALL/ WOOD BEAM		
MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
850	(1) MTS16 TO 20	(14) 10dx1 -1/2"
1700	(2) MTS16 TO 20	(14) 10dx1 -1/2"
2550	(3) MTS16 TO 20	(14) 10dx1 -1/2"
1125	(1) HTS20 TO 30	(24) 10dx1 -1/2"
2250	(2) HTS20 TO 30	(24) 10dx1 -1/2"
3375	(3) HTS20 TO 30	(24) 10dx1 -1/2"
4500	(4) HTS20 TO 30	(24) 10dx1 -1/2"

NOTES:


- PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
- CONNECTORS ARE SIMPSON SRTOING TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

SIMPSON CATALOG C-C- 2019

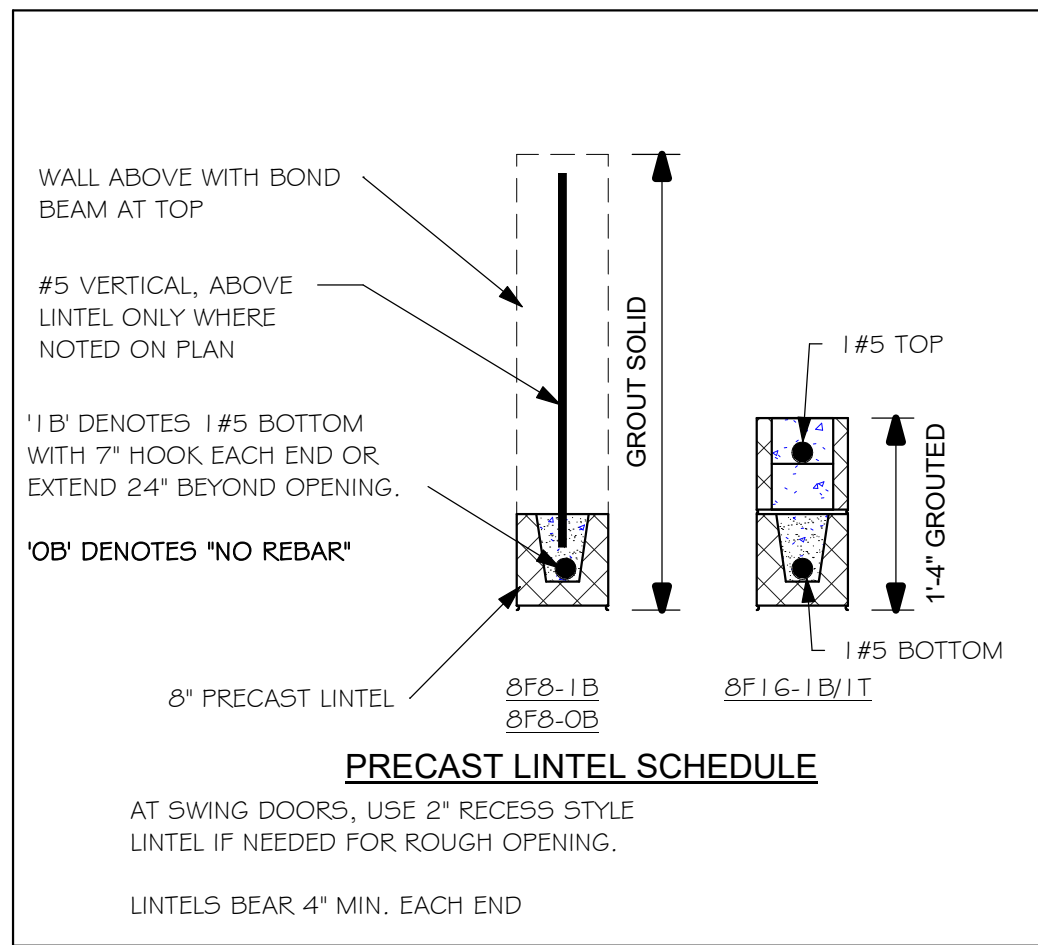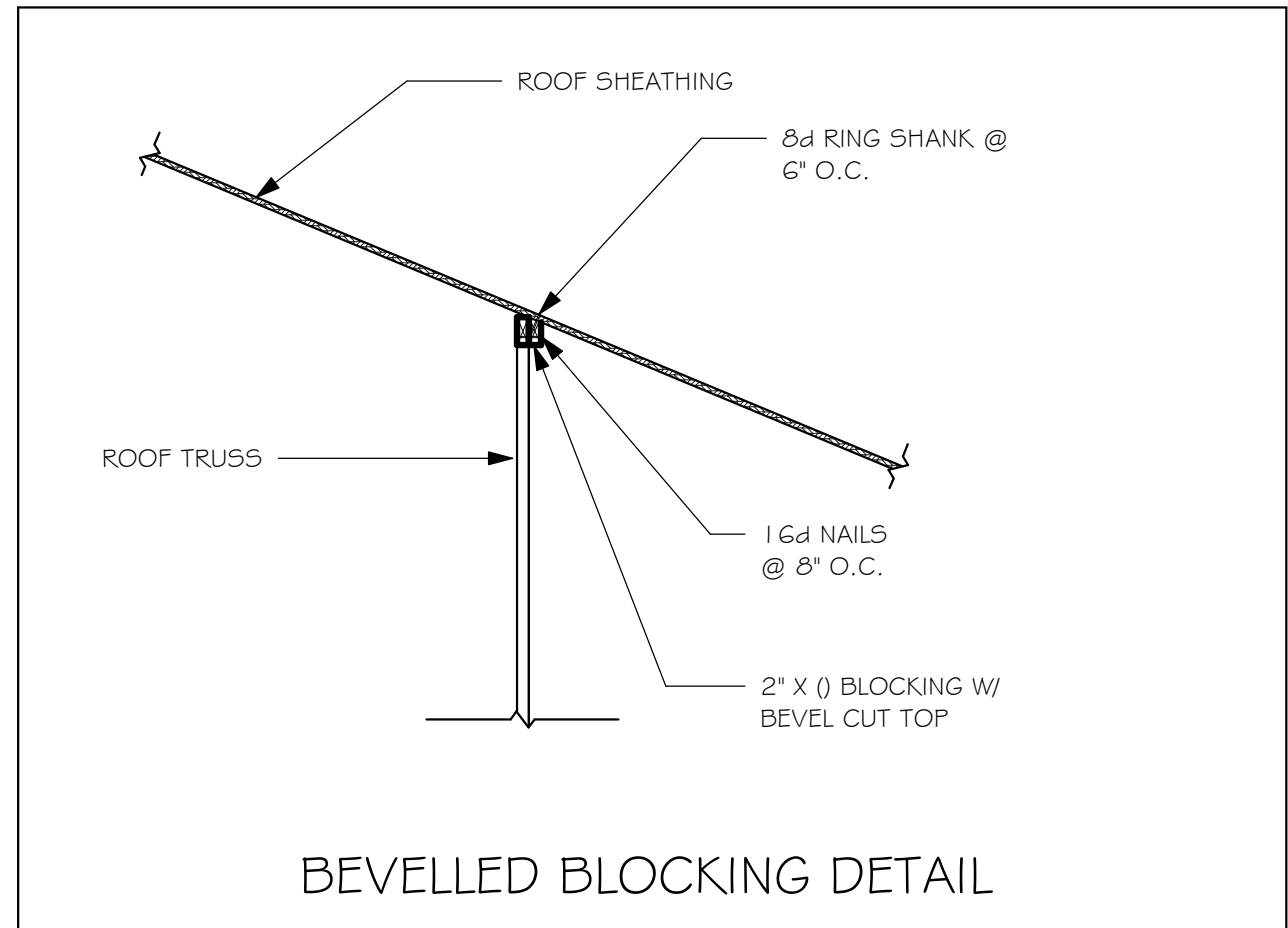

WALL HEIGHT	
	= MAIN WALL @ 9'-4"
	= ENTRY WALL @ 12'-4"




TRUSS BEARING CONDITIONS AND STRAPPING IS BASED ON TRUSS LAYOUT PREPARED BY: SCOSTA JOB # 44133 DATED: 08/06/18 REVISED: 01/29/20

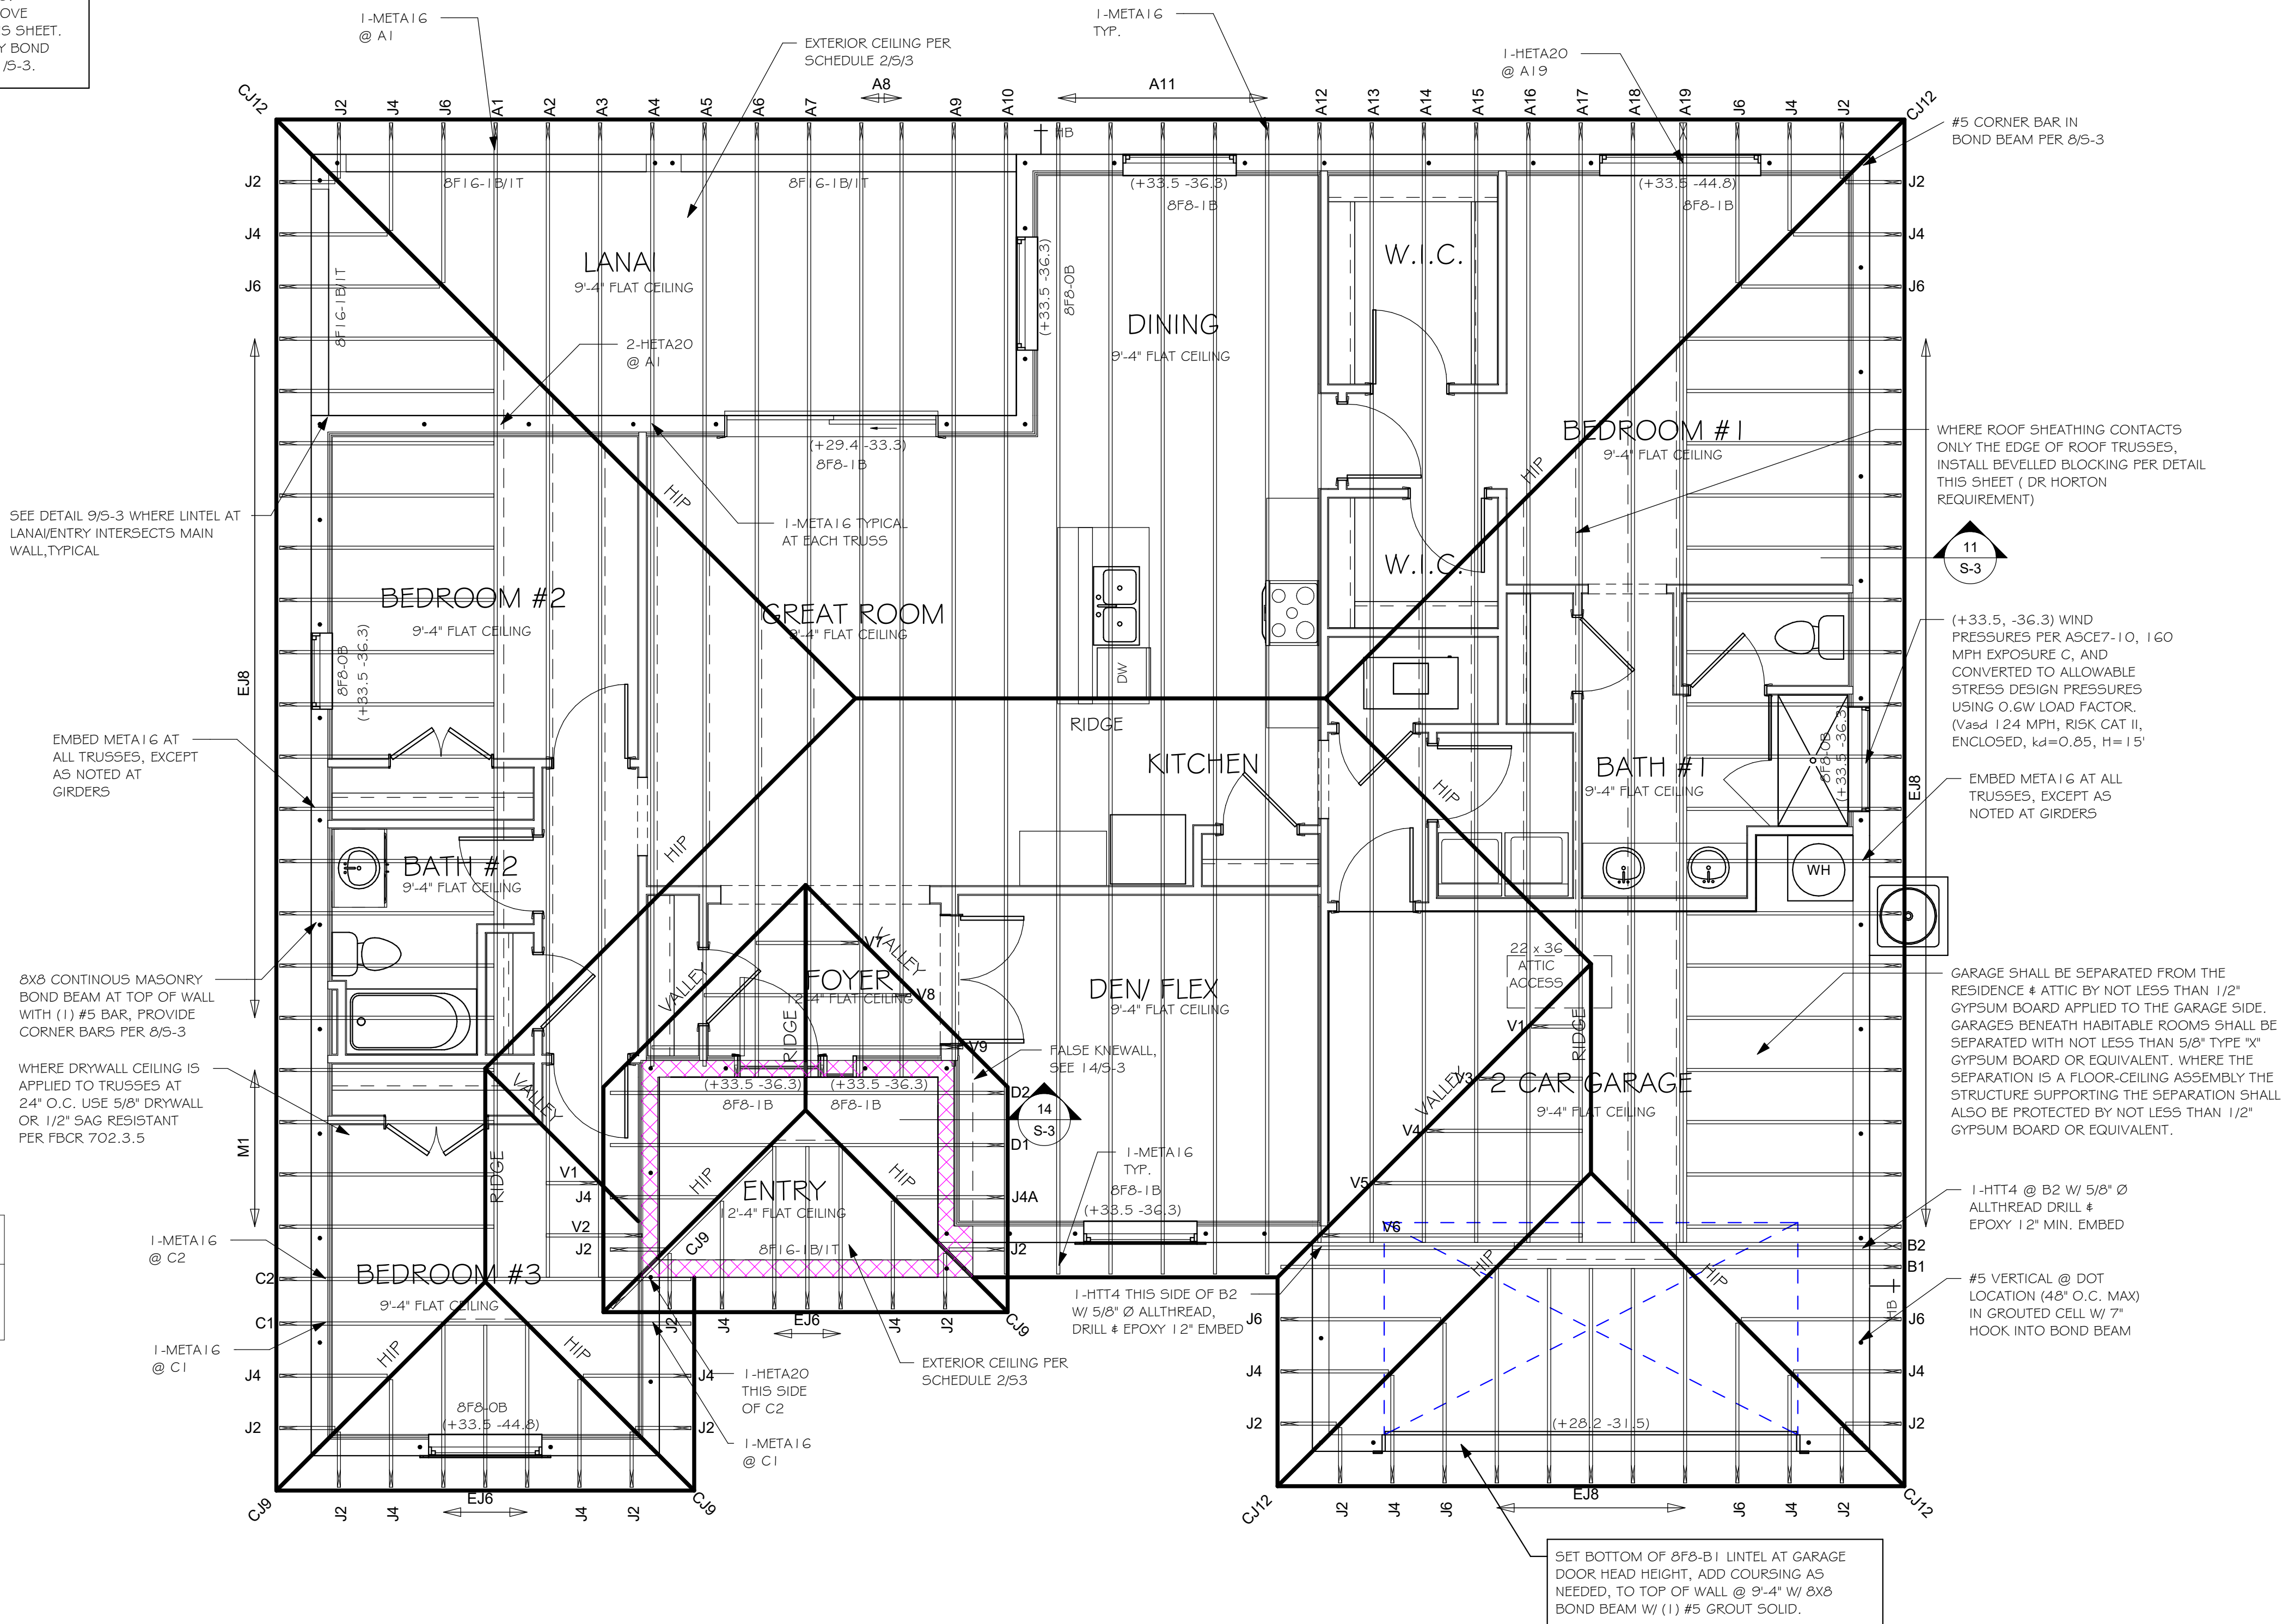

ROOF FRAMING PLAN "AR"
1/4" = 1'-0"

No.	Description	Date
1	UPDATED ADDRESS ON TITLE BLOCK	12/08/20

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL FLORIDA BUILDING CODE 2017 - 6TH EDITION

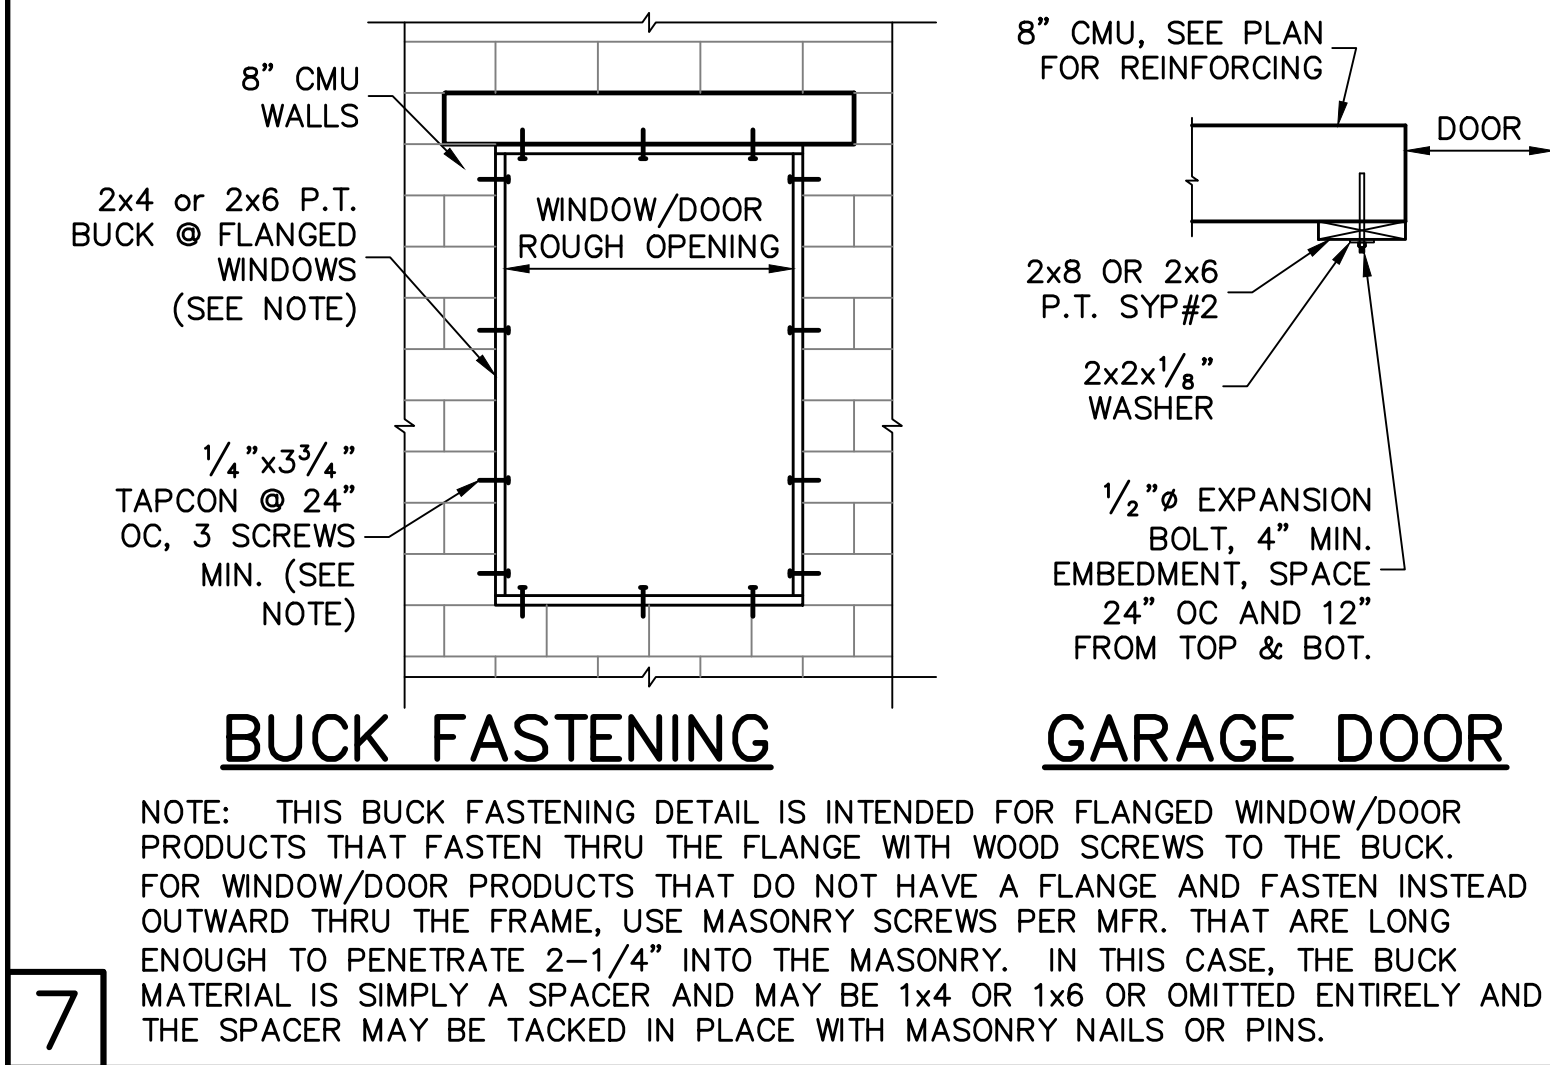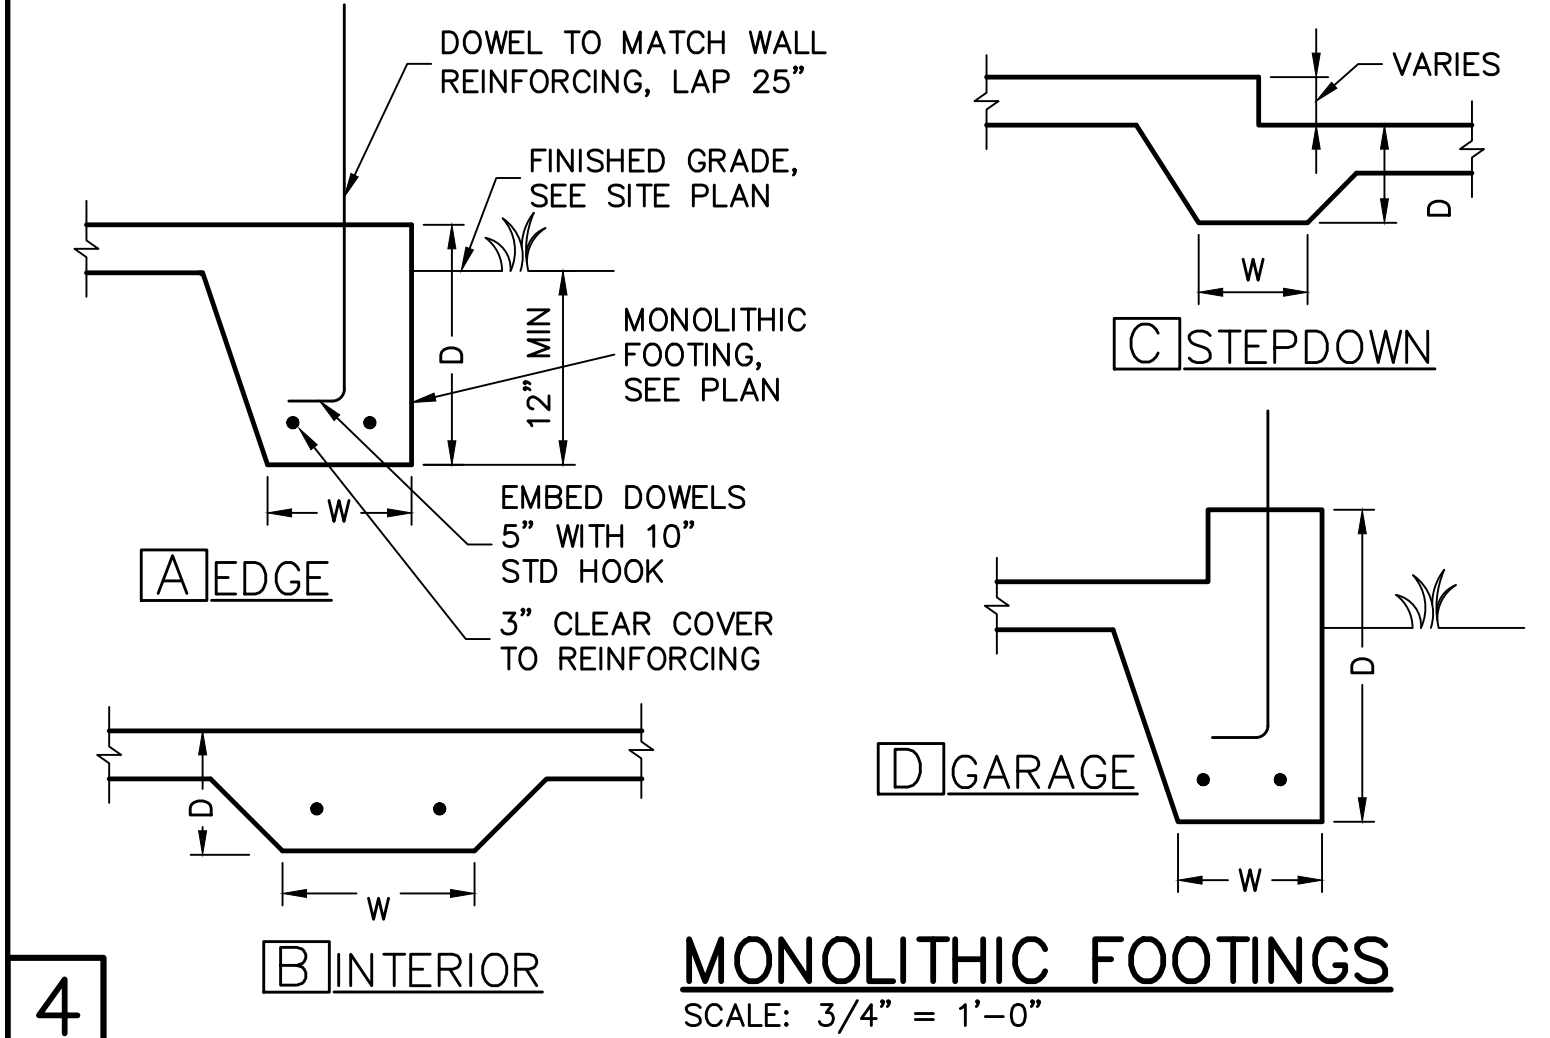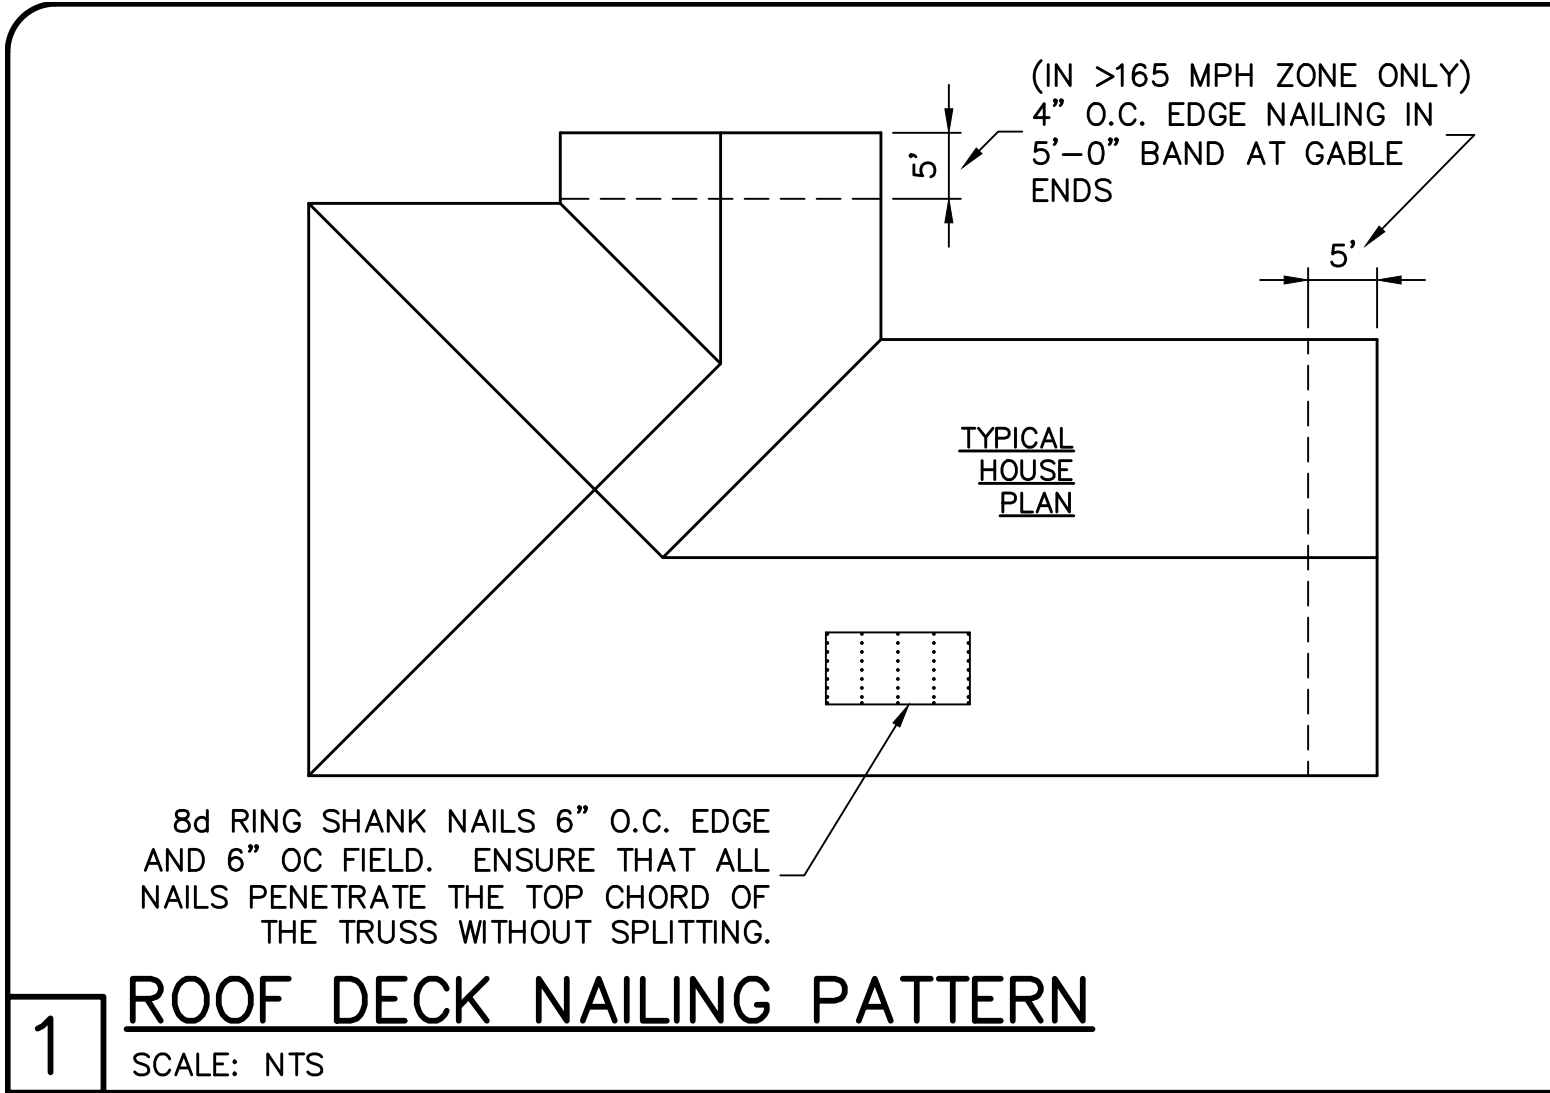

RETROFIT STRAPS TO CONCRETE/MASONRY			
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR		
TO 840	1-MTSM16 or 20	7-10dx1 1/2"	4-1/4x2 1/4" TITEN
TO 1045	1-HTSM16 or 20	8-10dx1 1/2"	4-1/4x2 1/4" TITEN
TO 2090	2-HTSM16 or 20	8-10dx1 1/2"	4-1/4x2 1/4" TITEN
TO 4300	2-LGT2	16-16d, 7-1/4"x2 1/4"	TITEN
TO 3480	HTT16	18-16d, 7/8" Ø ALLTHREAD, DRILL & EPOXY 10" EMBED w/ SIMPSON SET.	
TO 10530	HGT-2/3	TWO 3/4" Ø ALLTHREAD, DRILL & EPOXY 12" EMBED WITH SIMPSON SET.	







NOTES:
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

10 **RETROFIT UPLIFT CONNECTOR SCHEDULE**

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD. (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED) (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 3/4" EXTERIOR GYPBOARD CEILING, FASTEN w/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED w/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.

NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.

2

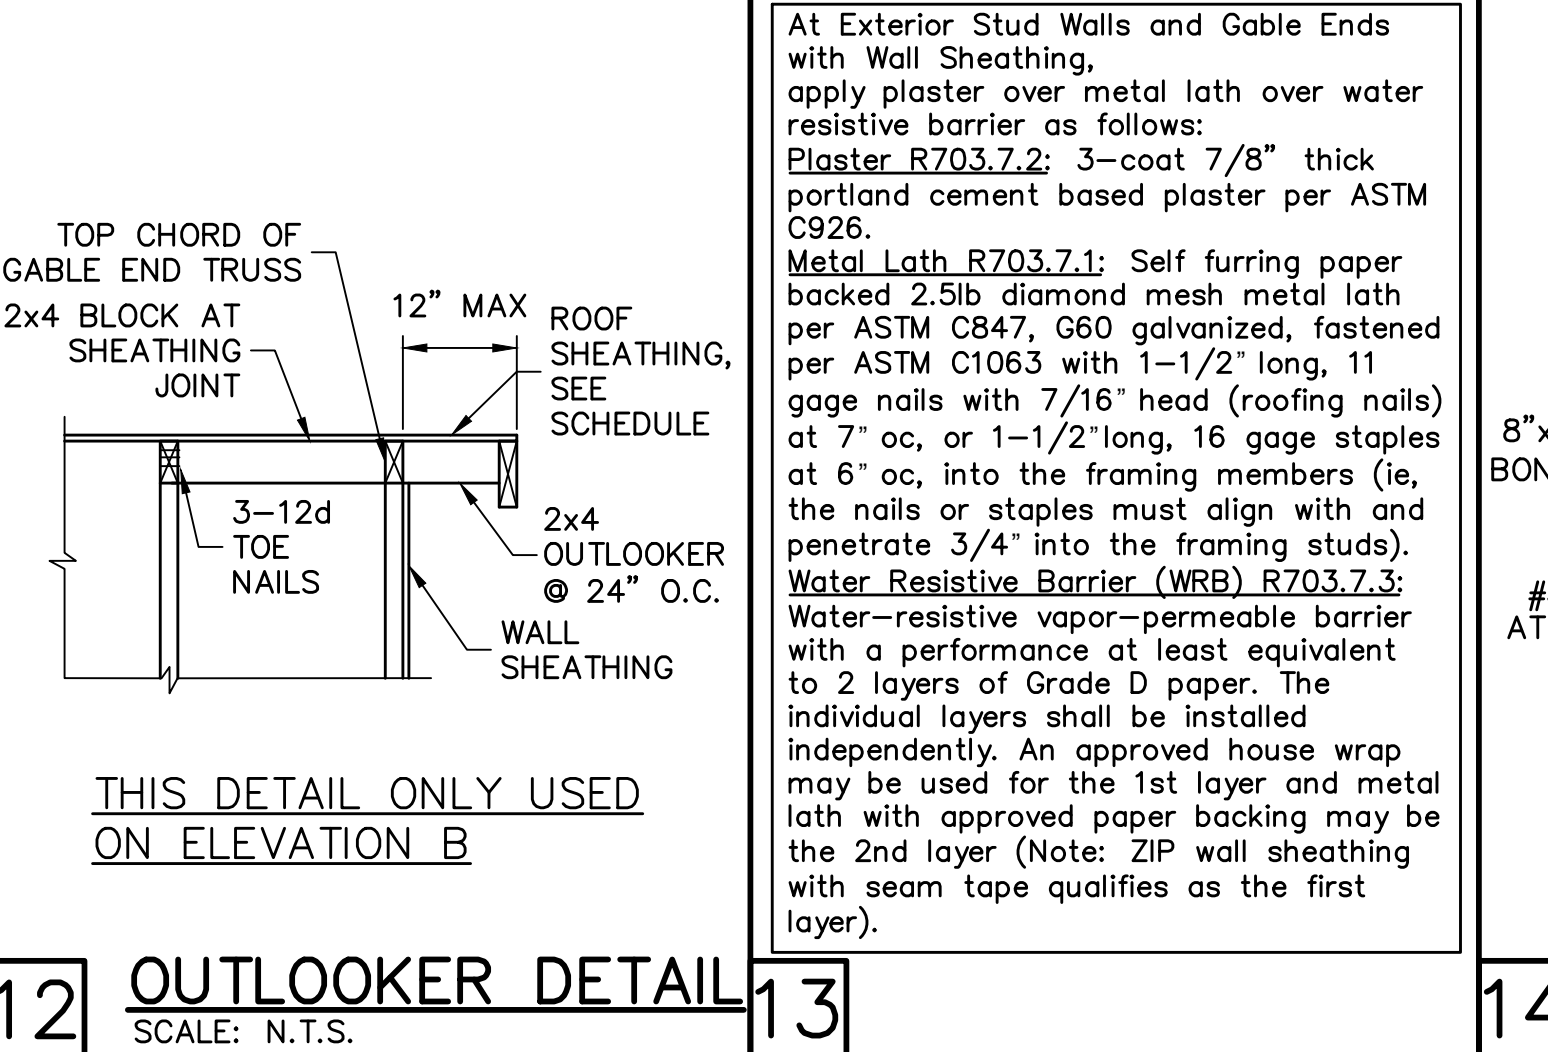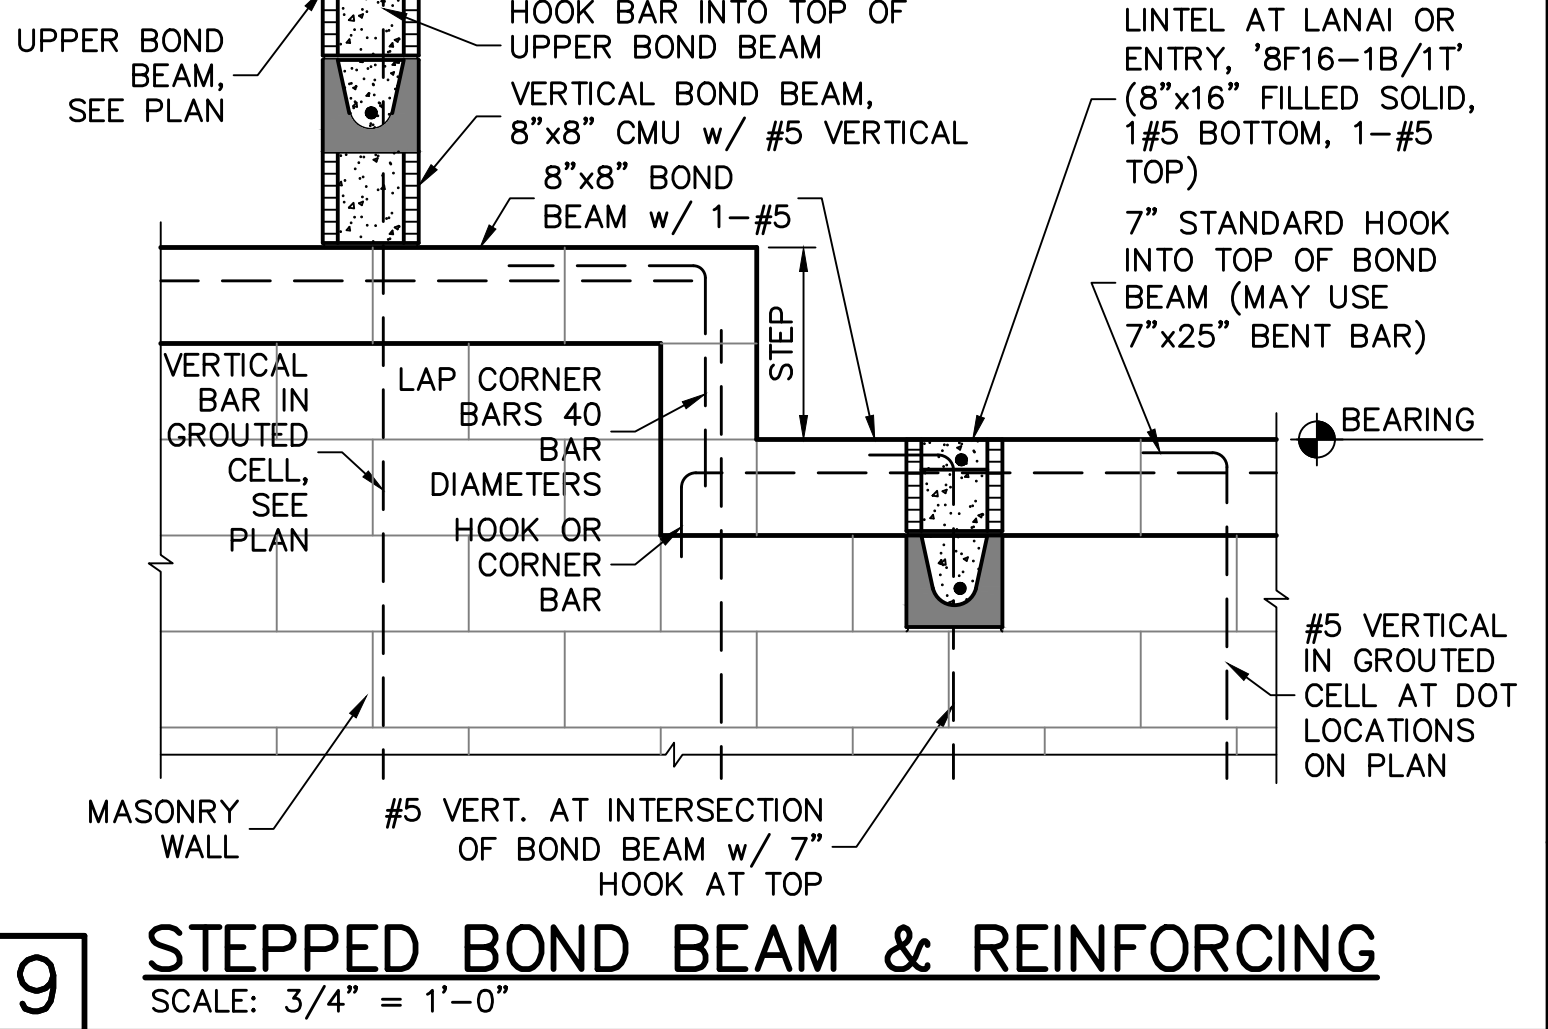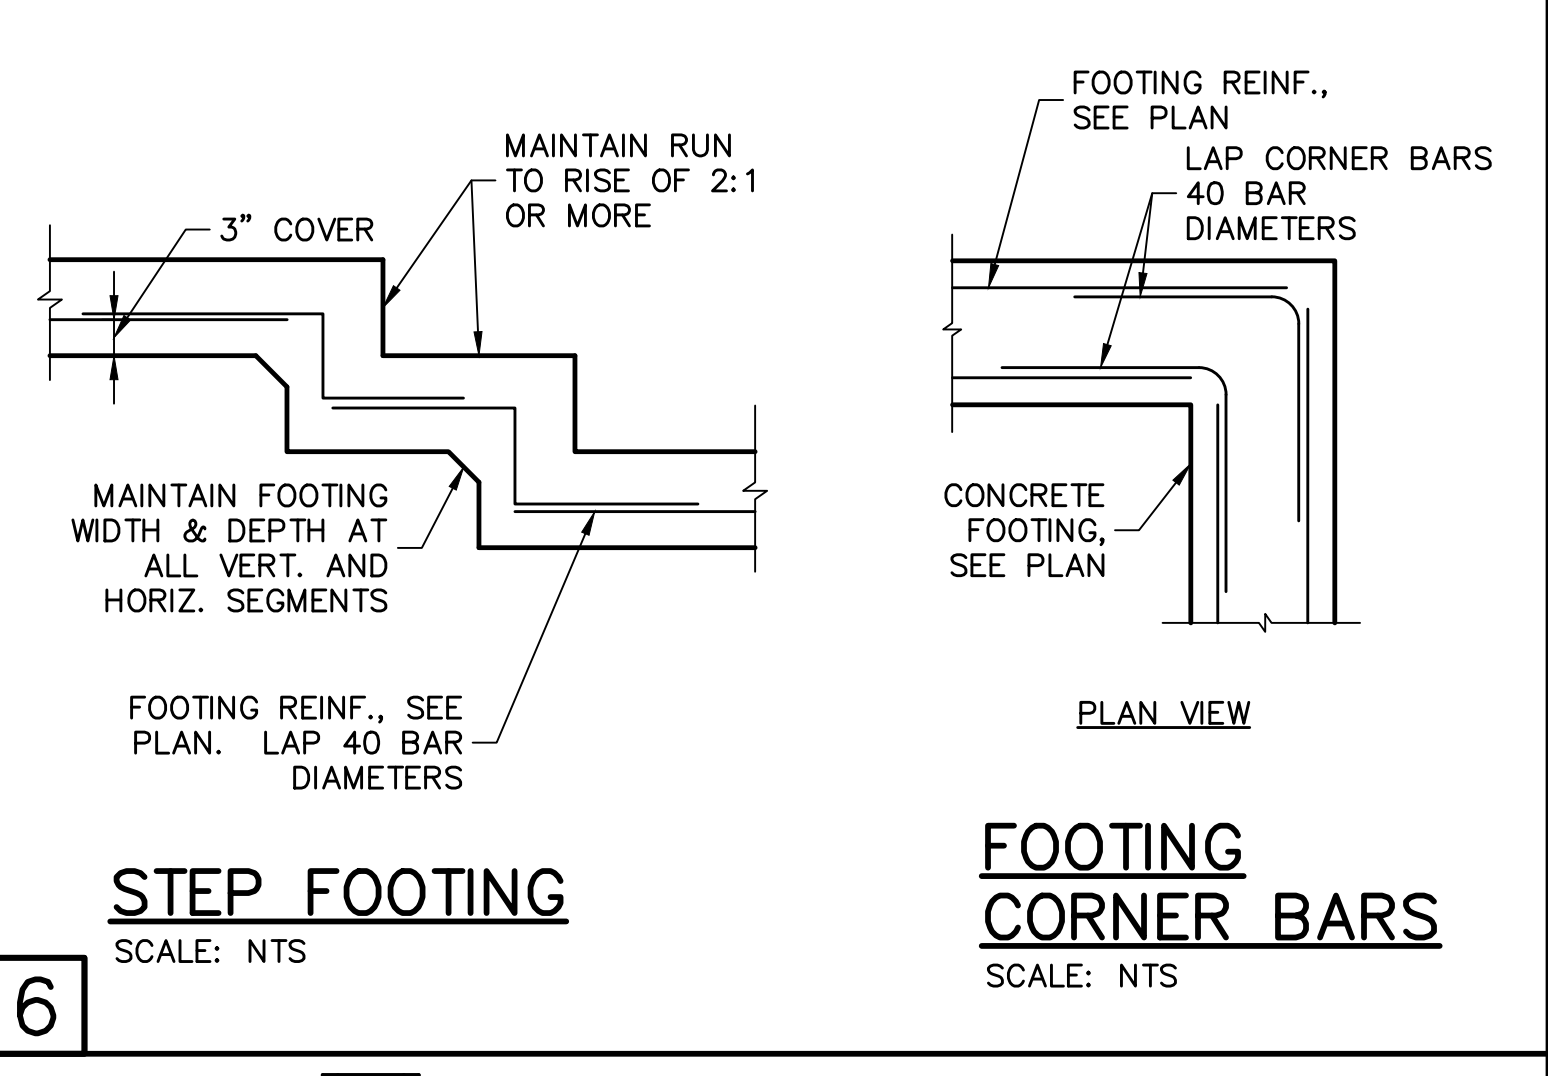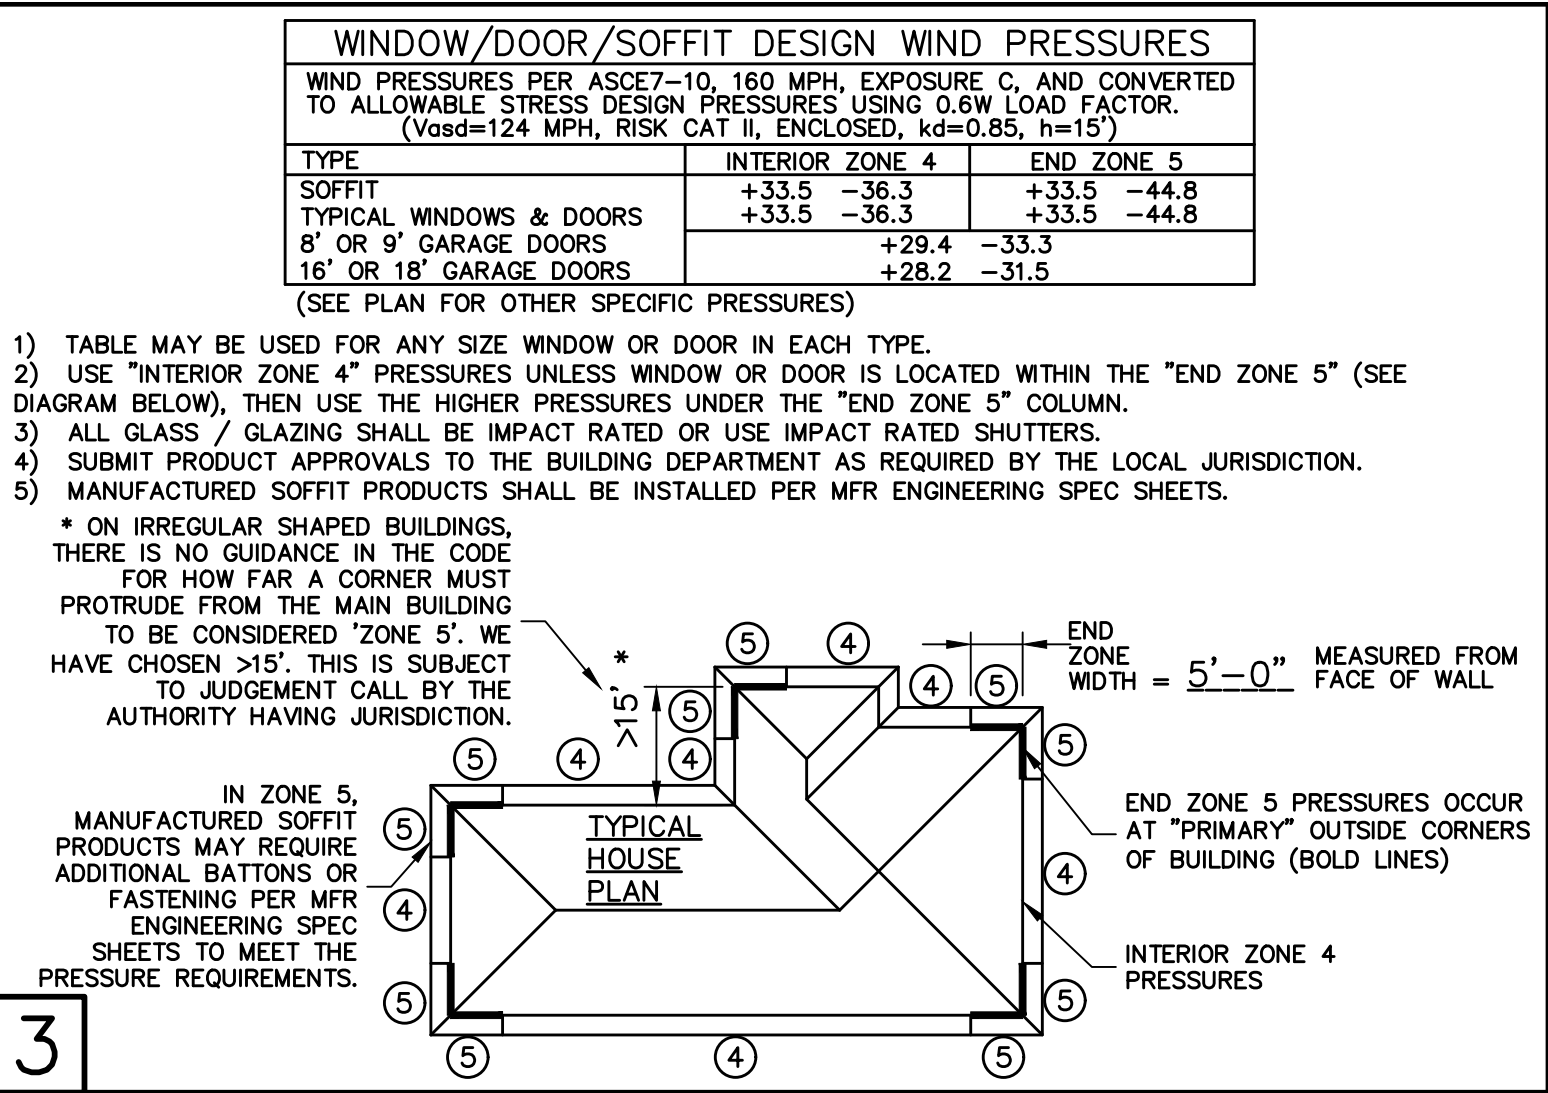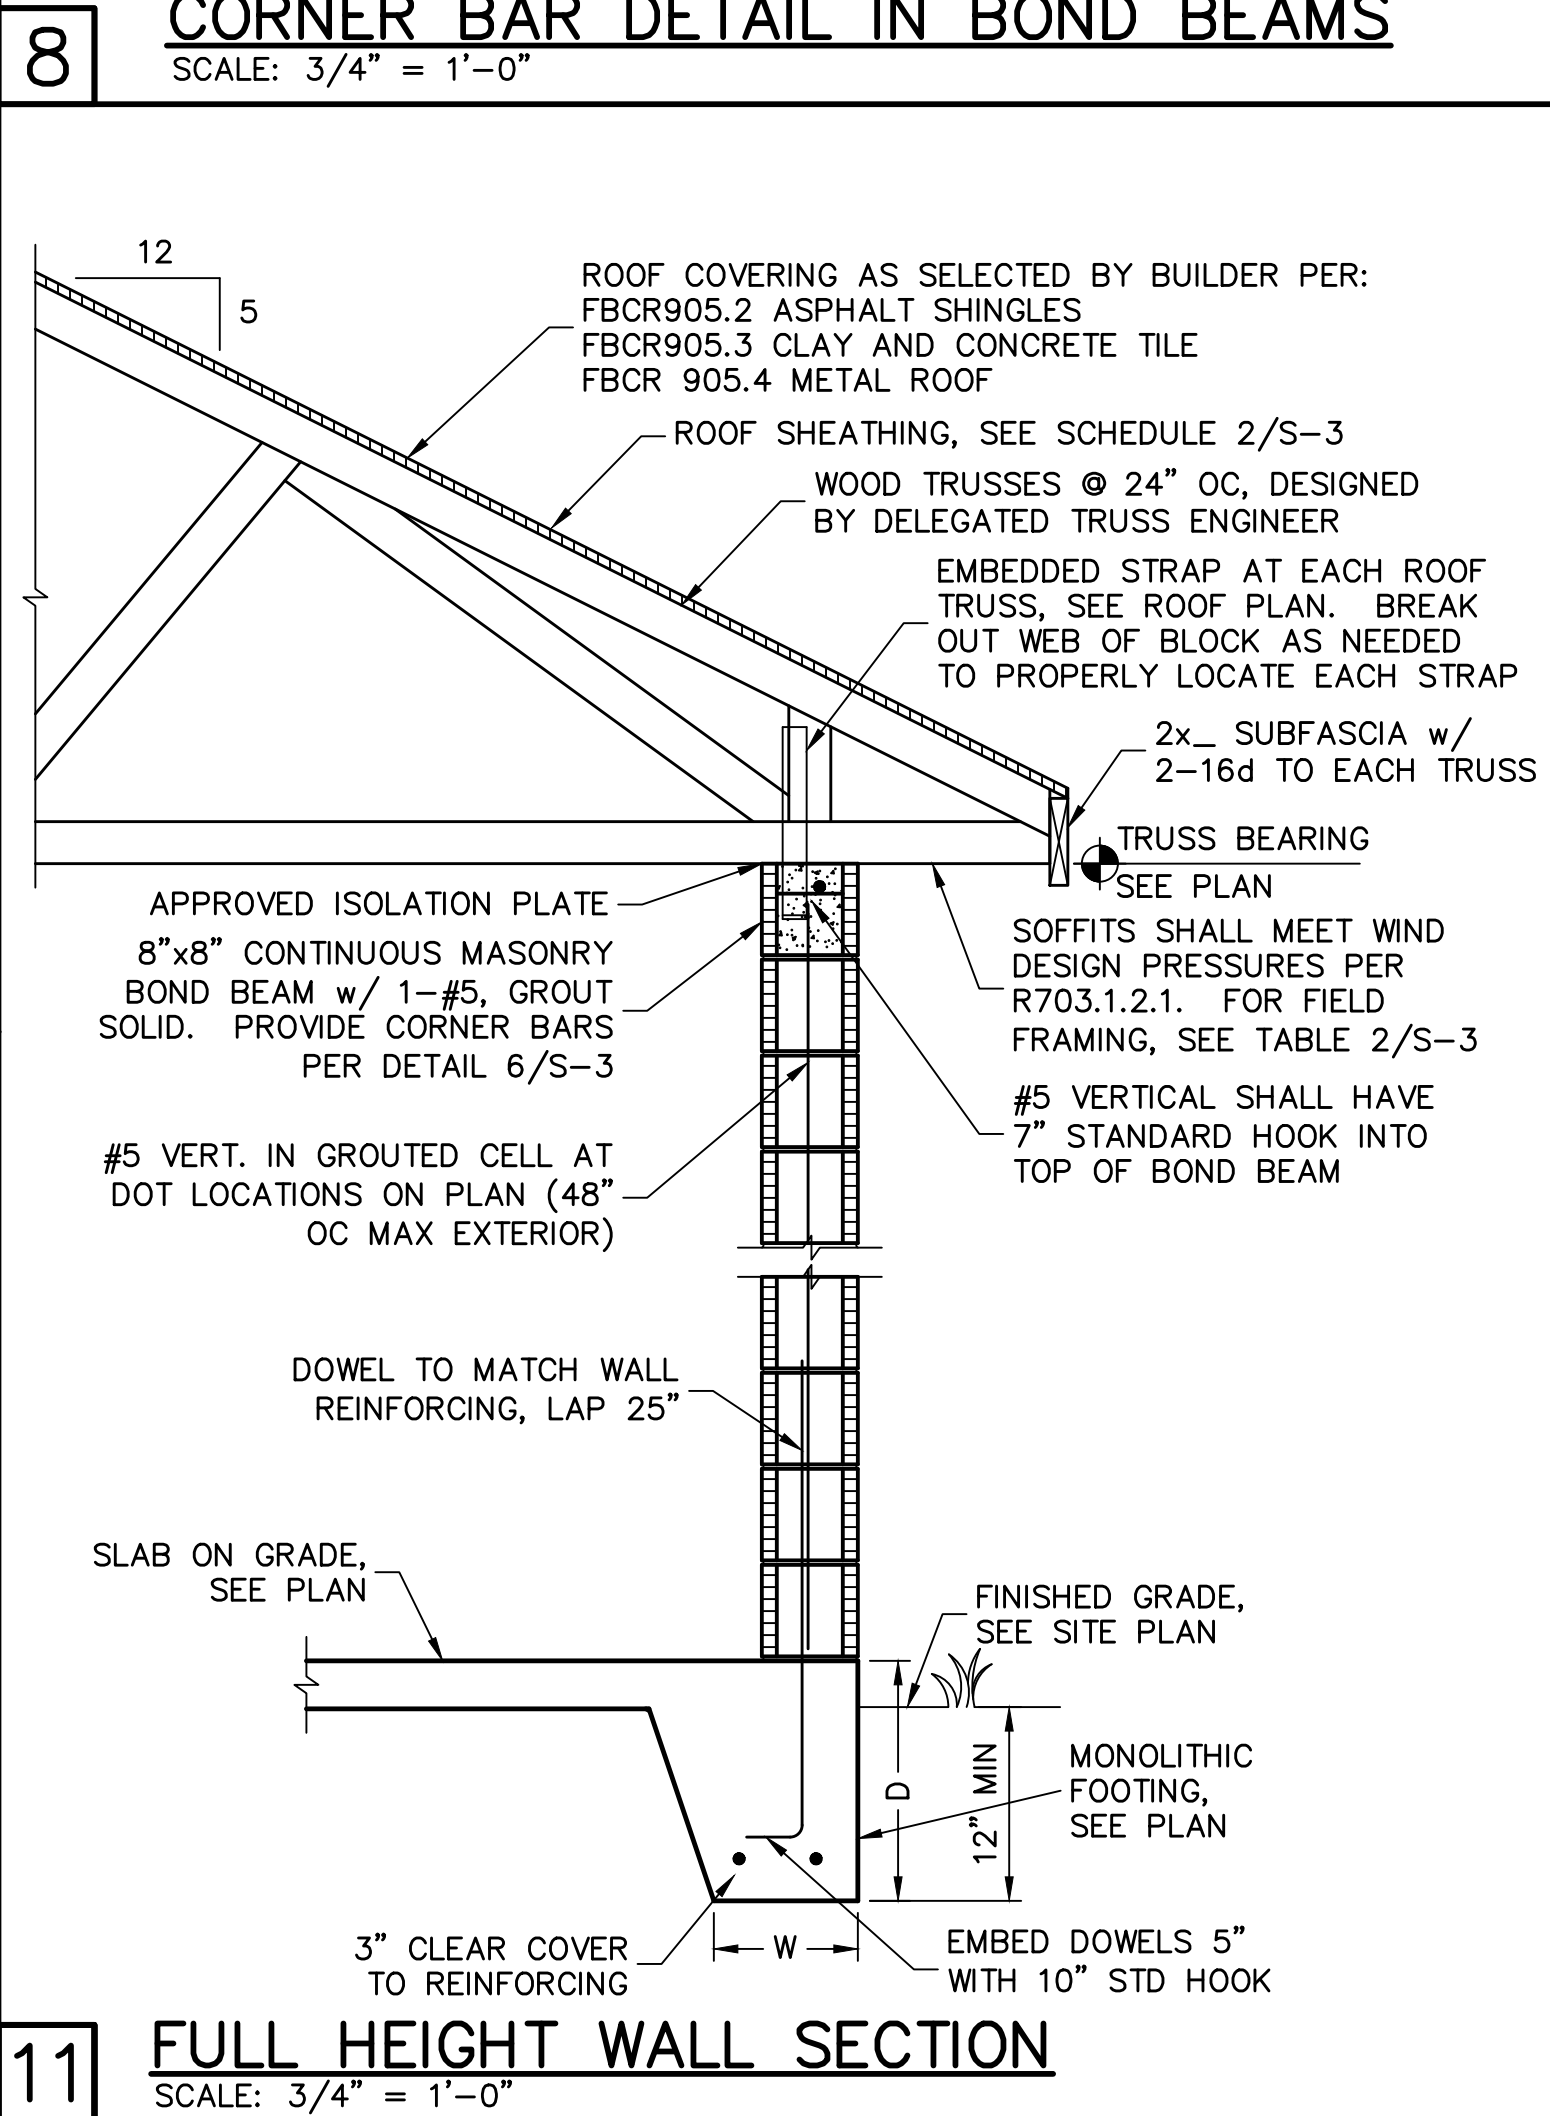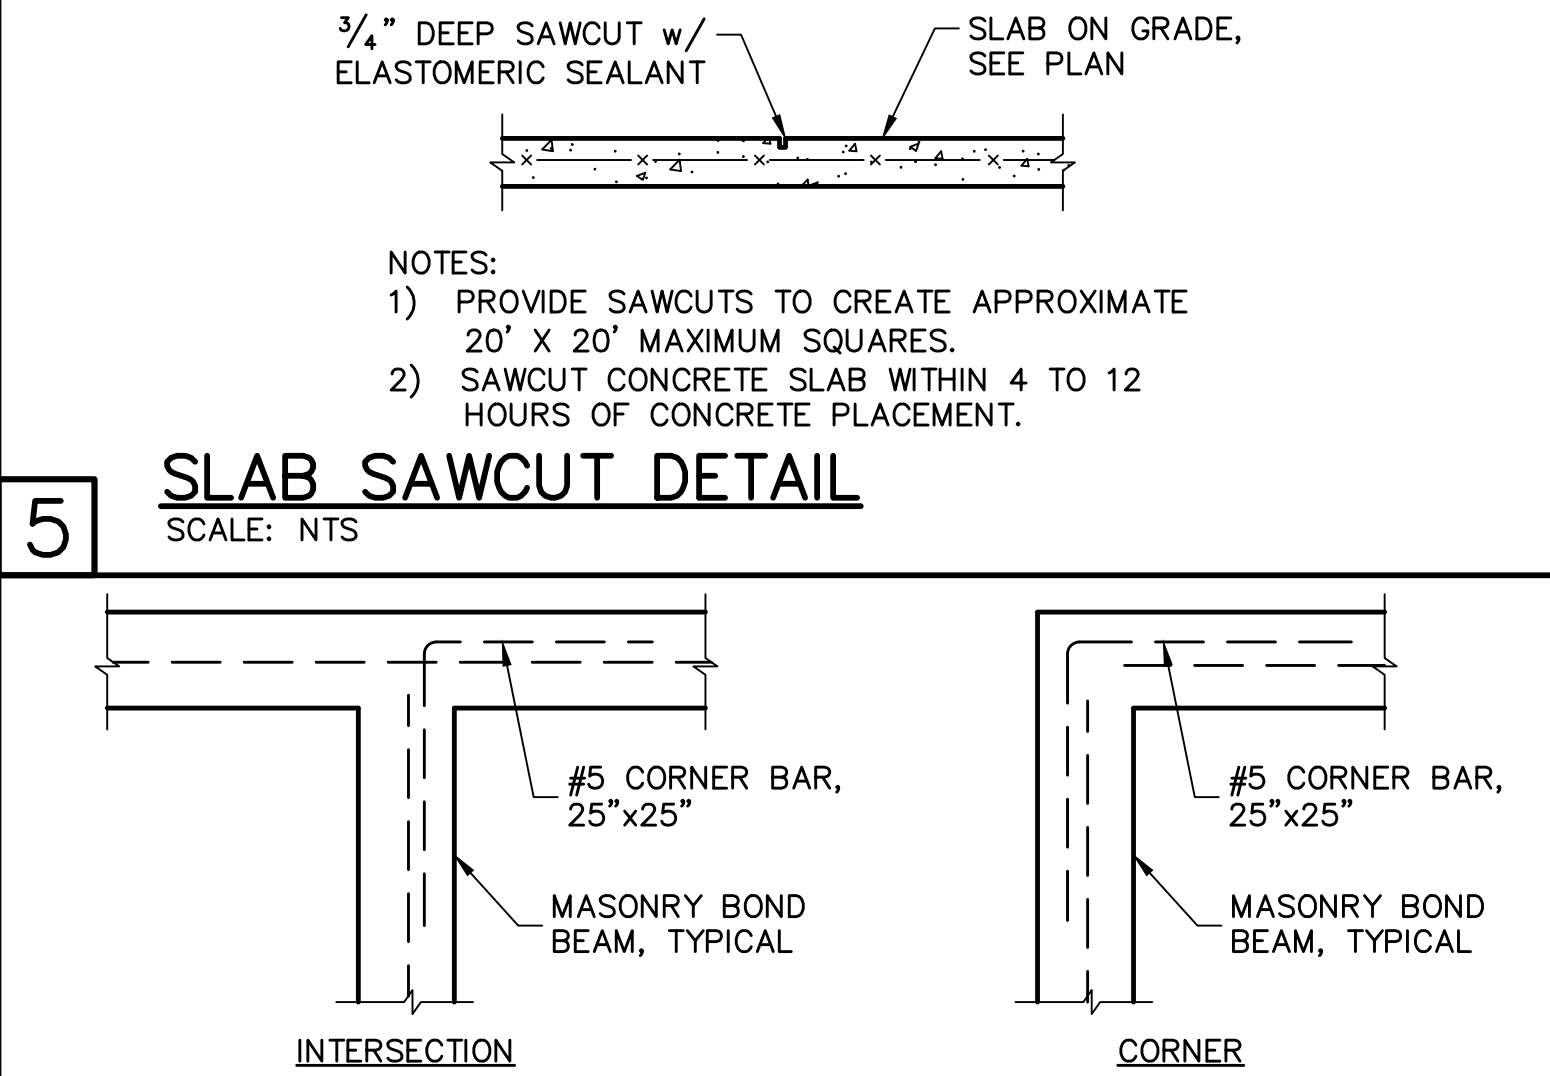

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

REV 1 - UPDATED ADDRESS ON TITLE BLOCK

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF

DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7-10
BASIC WIND SPEED (ASCE7-10) 160 MPH
NOMINAL WIND SPEED (Vg=124 MPH) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS C
INTERNAL PRESS. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3 1/2" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERESH.
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3" CENTERED
SLAB ON GRADE 1 1/2"
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3
GRADE 60 FOR #4 TO #11

WELDED WIRE FABRIC - ASTM A185

SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.

FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER ACI 530-13
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI

REINFORCING STEEL - ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS
SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY.
IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

ROOF COVERING AS SELECTED BY BUILDER PER:
FBCR905.2 ASPHALT SHINGLES
FBCR905.3 CLAY AND CONCRETE TILE
FBCR 905.4 METAL ROOF

ROOF SHEATHING, SEE SCHEDULE 2/S-3

WOOD TRUSSES @ 24" OC, DESIGNED BY DELEGATED TRUSS ENGINEER

EMBEDDED STRAP AT EACH ROOF TRUSS, SEE ROOF PLAN. BREAK OUT WEB OF BLOCK AS NEEDED TO PROPERLY LOCATE EACH STRAP

2x- SUBFASCIA w/ 2-16d TO EACH TRUSS

12'-4"

TRUSS D2

8"x8" CONTINUOUS MASONRY BOND BEAM w/ 1-#5, GROUT SOLID. PROVIDE CORNER BARS PER DETAIL 6/S-3

#5 VERT. IN GROUTED CELL AT DOT LOCATIONS ON PLAN (48" OC MAX EXTERIOR)

2x4 TOP & BOTTOM PLATE w/ 2-16d TO EACH TRUSS AND BLOCKING

FALSE KNEEWALL

2x4 PT LEDGER w/ 10d CONCRETE NAILS @ 12" O.C.

2x4 BLOCKING

TRUSS A10

TRUSS A11

9'-4"

14 **FALSE KNEEWALL AT ENTRY**
SCALE: 3/4" = 1'-0"

REVISIONS	BY
Δ 12/09/20	GCH

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

BUILDER:
D.R. HOHON
America's Builder

STRUCTURAL DETAILS
MODEL 1989 A
8501 AGATE STREET
PORT CHARLOTTE, FLORIDA
LOTS: 24 BLOCK: 4227 COVE
SUBDIVISION: SOUTH GULF COVE

FOR SCOSTA TRUSSES, ELEVATION A, JOB # 44133, DATED: 08/06/18, REVISED: 01/28/20

DESIGN/DRAWN DWB/GH
CHECKED DWB
DATE 10/13/20
SCALE VARIES
JOB NO. DR 12020
SHEET S-3
SHEET 3 OF 3