

**\*\*UNLESS NOTED\*\***

REACTION VALUES ARE UNDER 5000#

UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24"o.c. UNLESS NOTED OTHERWISE

**\*\*\*\*\*CAUTION\*\*\*\*\***

DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION, ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY SHEET FOR HANDLING METHODS & TEMPORARY BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA CORP. "+/-" BEARING DIFFERENCES SHOWN ARE CRITICAL. IF ANY HEIGHTS DEViate - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

0'-0"	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.

TYPICAL HANGER SCHEDULE

(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 16D COMMON NAILS EXCEPT THE FOLLOWING

LUS24 - 10D COMMON THJA26 - 100 x 1-1/2

**\*\*\*\*\*ATTENTION\*\*\*\*\***

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS, PITCHES, OVERHANGS, ELEVATIONS, CEILING & BEARING CONDITIONS. SCOSTA CORPORATION IS RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH PLANS AND/OR INFORMATION PROVIDED BY CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN. CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF INFORMATION AND PLANS PROVIDED TO SCOSTA CORPORATION, AND TO VERIFY CONFORMANCE TO FIELD CONDITIONS, AND/OR OWNER CHANGES. TRUSSES WILL BE BUILT IN ACCORDANCE WITH THE APPROVED LAYOUT.

APPROVED BY: \_\_\_\_\_

DATE: \_\_\_\_\_ REQUESTED DELIVERY DATE: \_\_\_\_\_

JOB SITE CONTACT NAME: \_\_\_\_\_

PHONE #: \_\_\_\_\_

E-MAIL: \_\_\_\_\_


**SCOSTA CORP.**

WOOD, STEEL OR TIMBER  
ROOF & FLOOR TRUSSES


3670 COMMERCE CENTER DRIVE  
SEBRING, FL 33870  
(863) 385-8242

SCALE: 1/4"=1'-0"	DATE: 12/12/19	REVISED BY:	DRAWN BY: J. CLEVELAND
JOB ADDRESS: 1389 B W/ LANAI GARAGE: RIGHT LEE			1 OF 1
CUSTOMER: D.R. HORTON			JOB # 44115BL


L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\LABELLE  
GLADES COUNTY\12099 LOT 1 & BLK 2291\1389 BR\REV1\12099 LOT 1 & BLK 2291\1389 BR.rvt

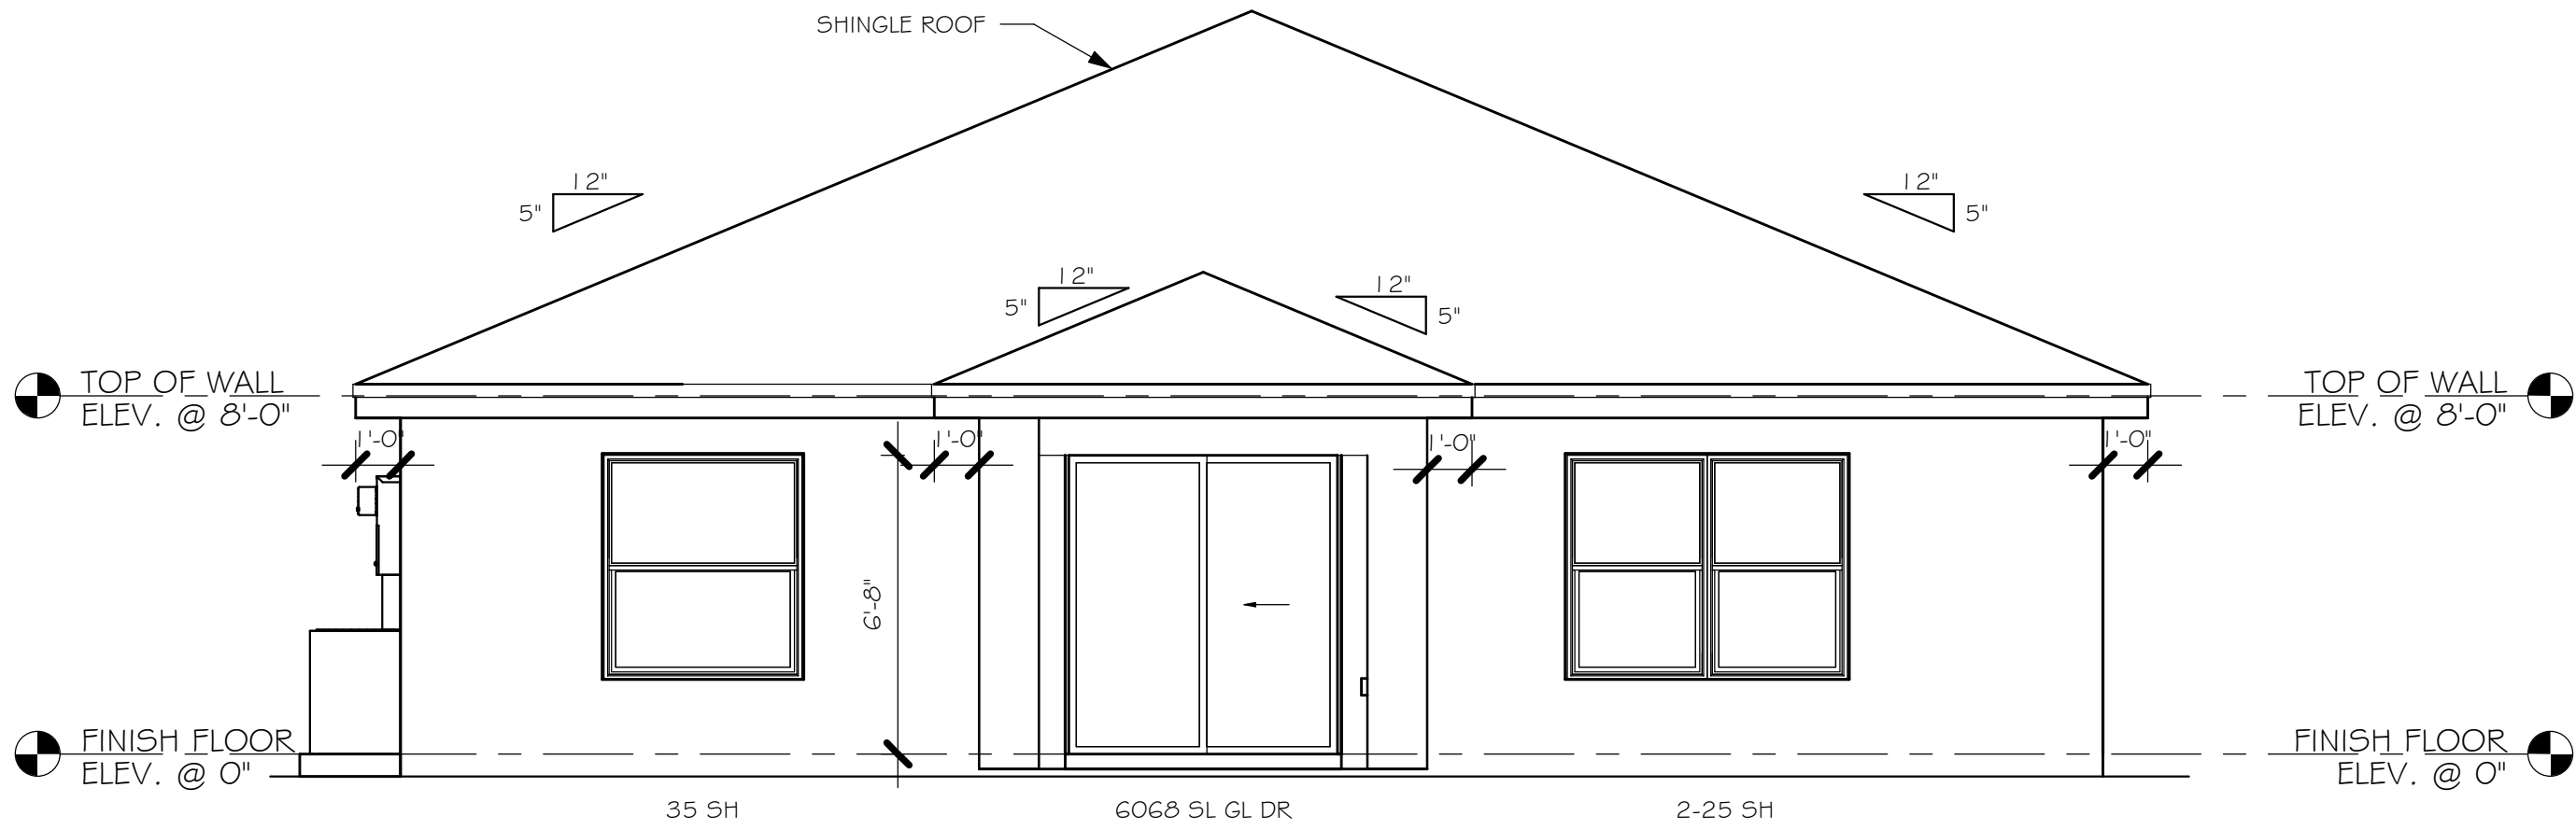


REAR ELEVATION  
1/4" = 1'-0"

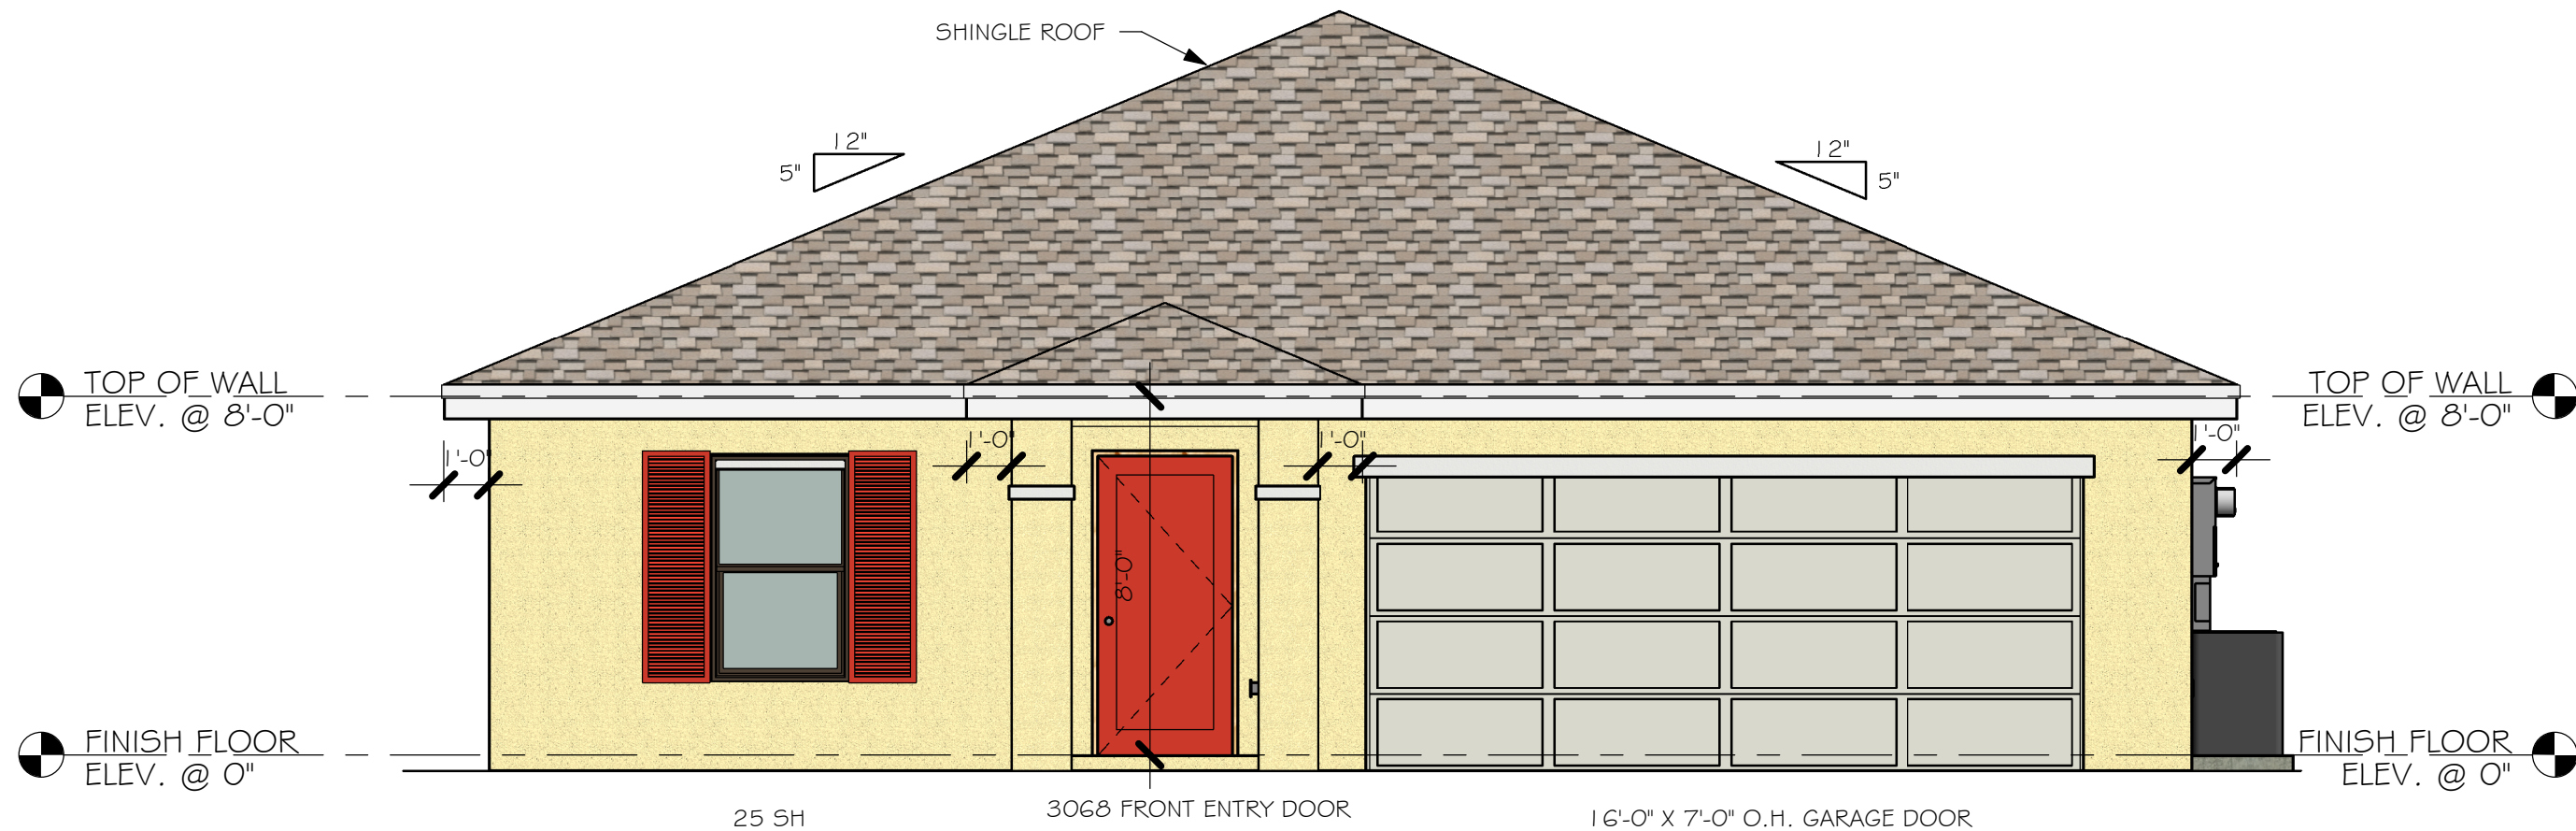

FRONT ELEVATION  
1/4" = 1'-0"

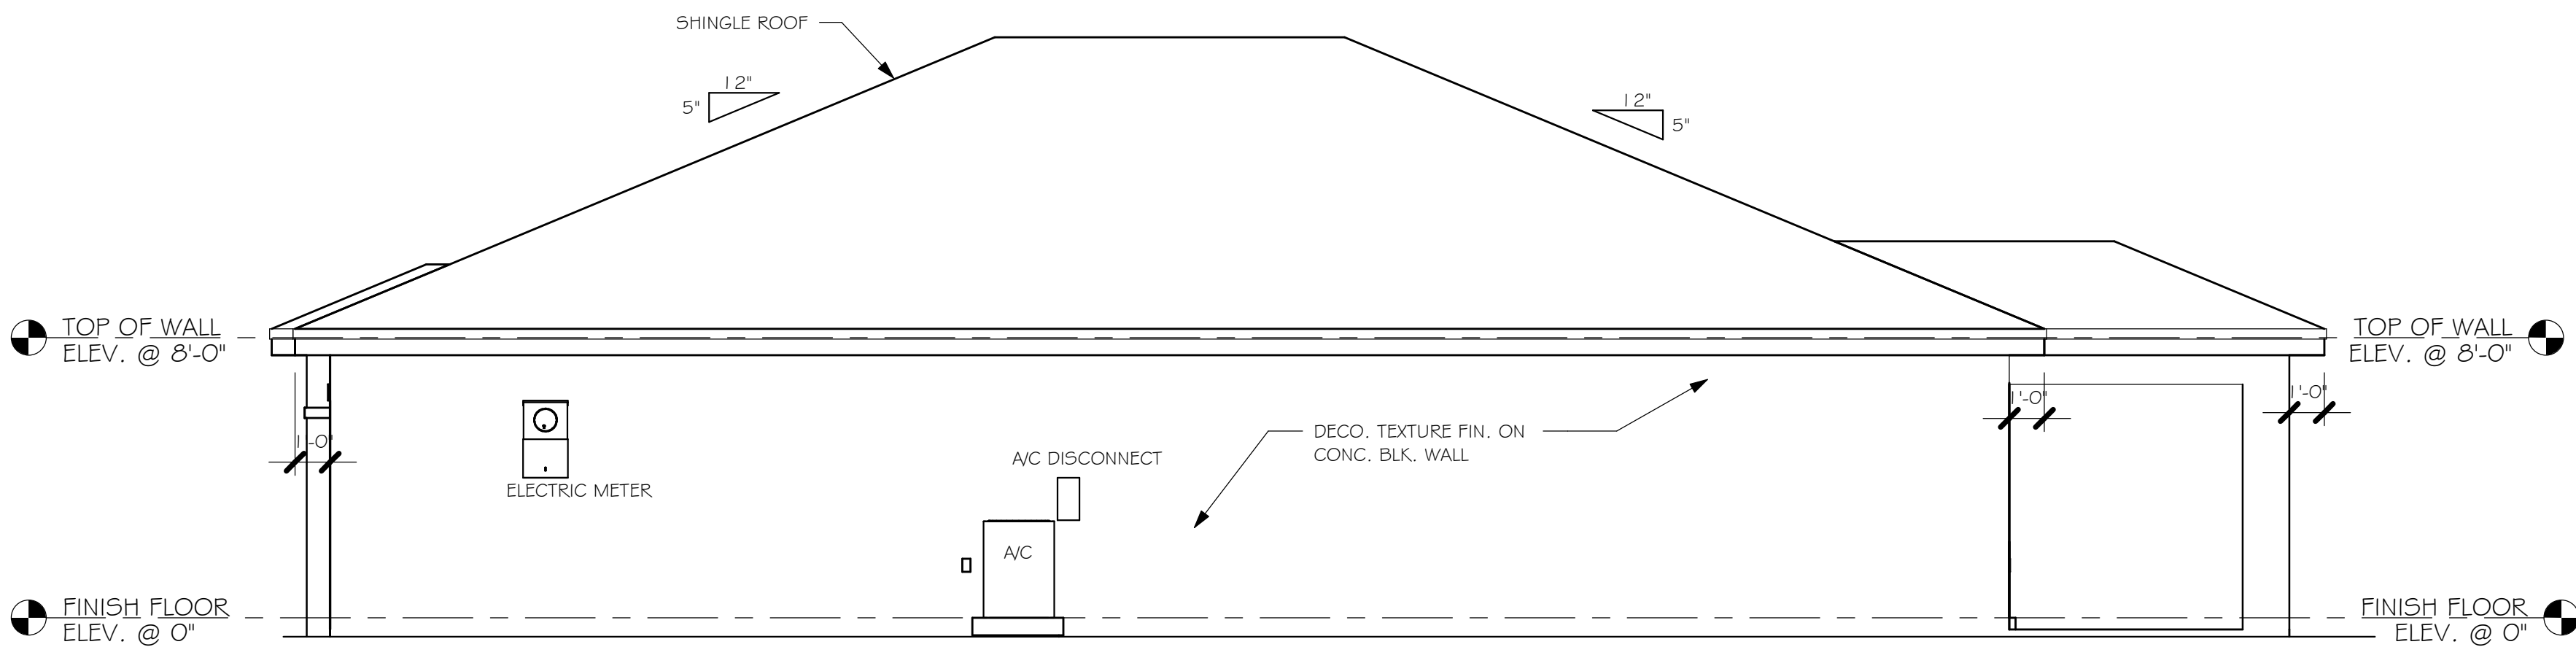

RIGHT ELEVATION  
1/4" = 1'-0"

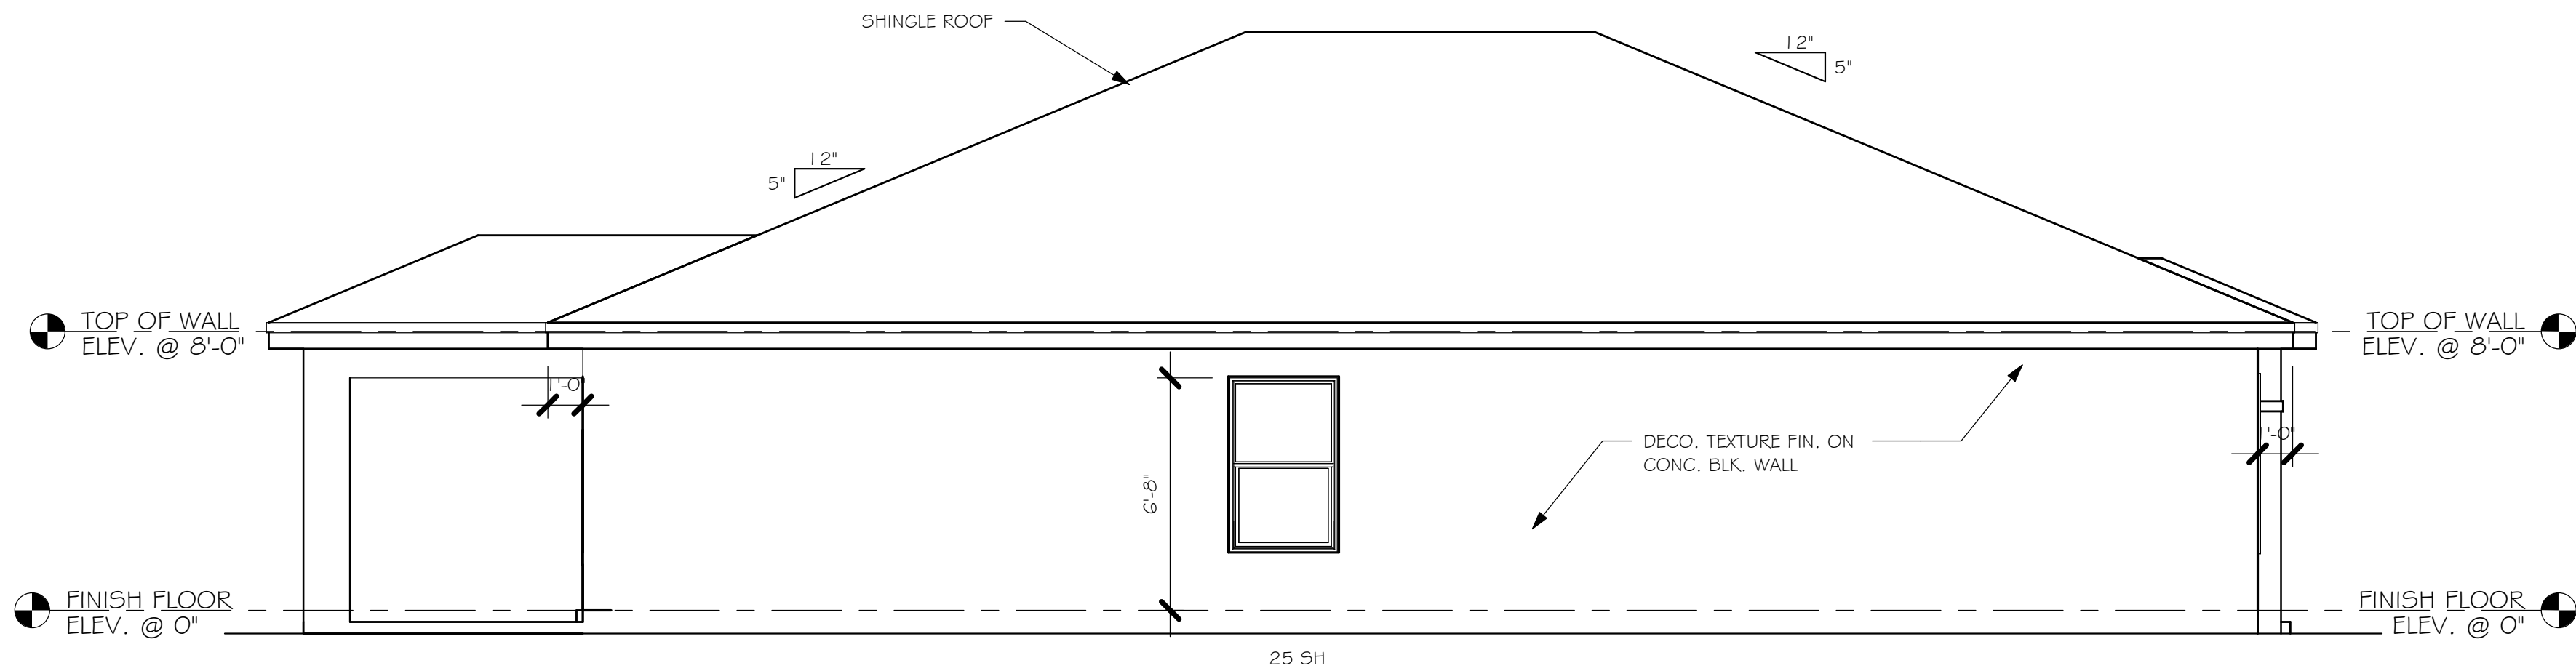

LEFT ELEVATION  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



**Gulf Coast**  
Drafting & Design, Inc.  
EMAIL: PLANS@GULFCOASTDRAFTING.COM  
PHONE: 239-540-822  
1515 SE 47th ST. CAPE CORAL, FL 33904




LOT: 18	BLOCK: 2291
SUBDIVISION: LABELLE HENDRY COUNTY	
ADDRESS: 8025 MARSH CIRCLE	
D.R.H. #: 579920039	

MODEL # 1389 B	GCD JOB # 12099
-------------------	-----------------

DATE: 11/04/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: ELEVATION
SCALE: 1/4" = 1'-0"

A-1



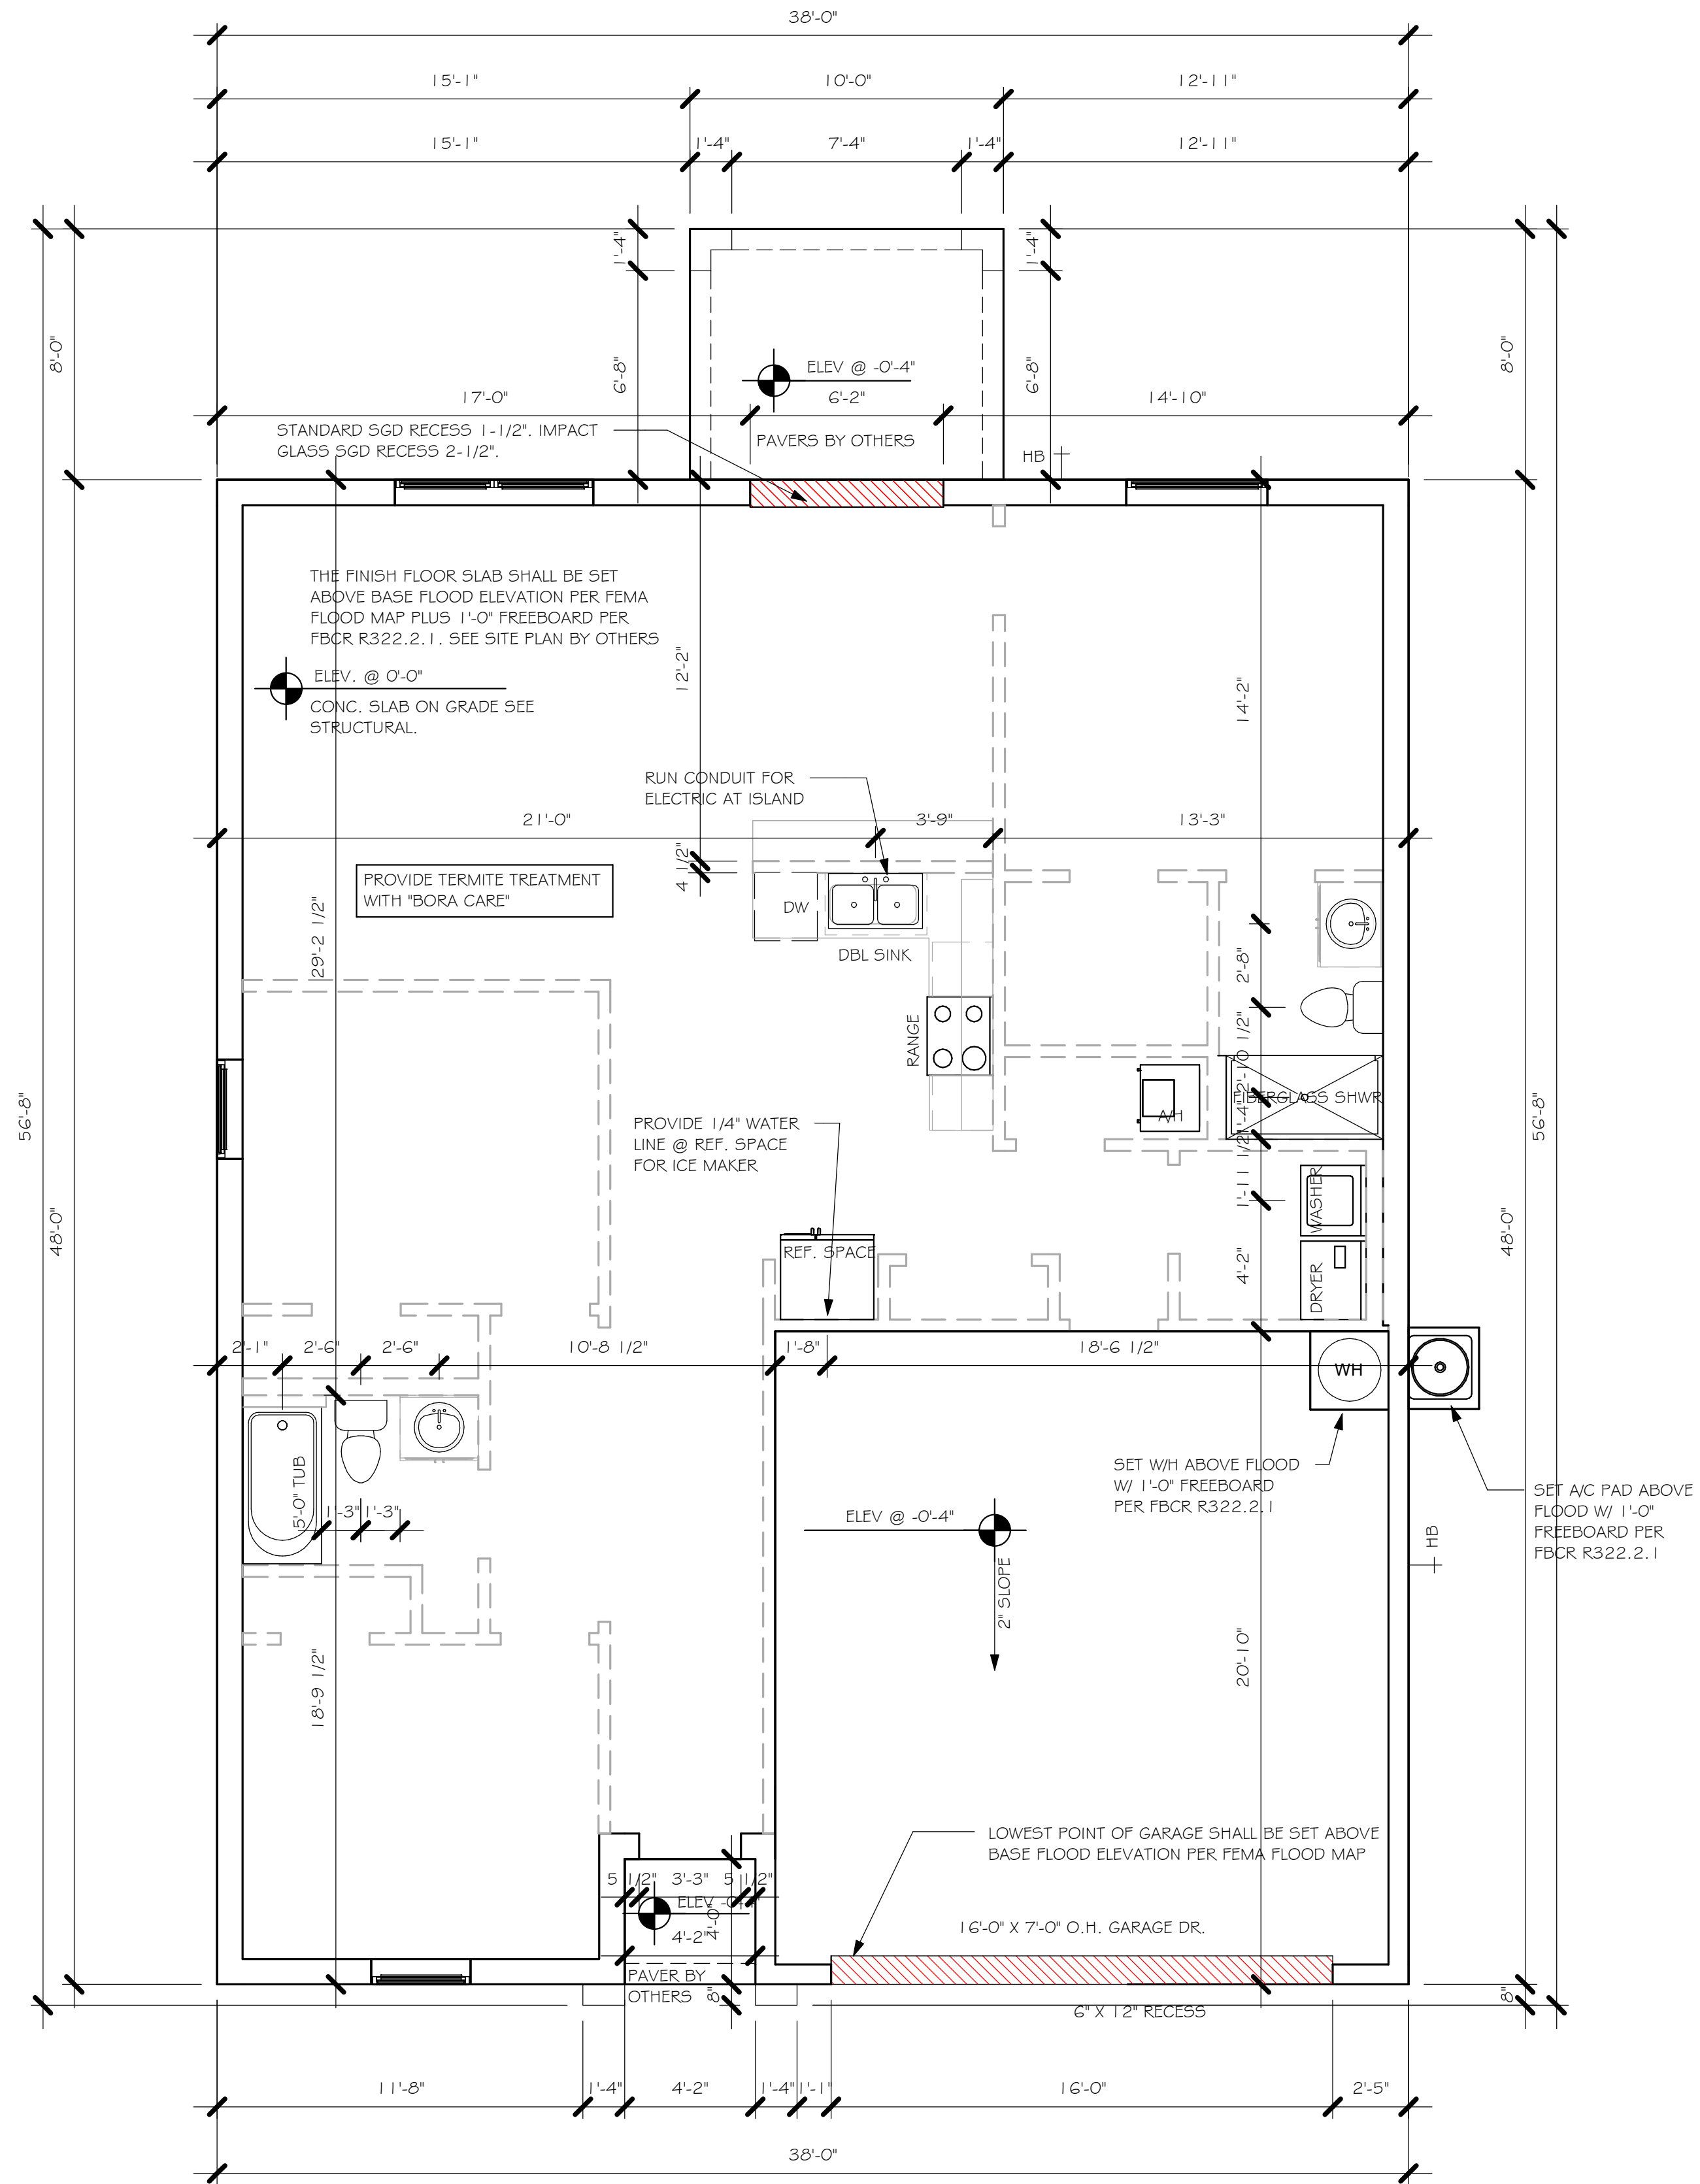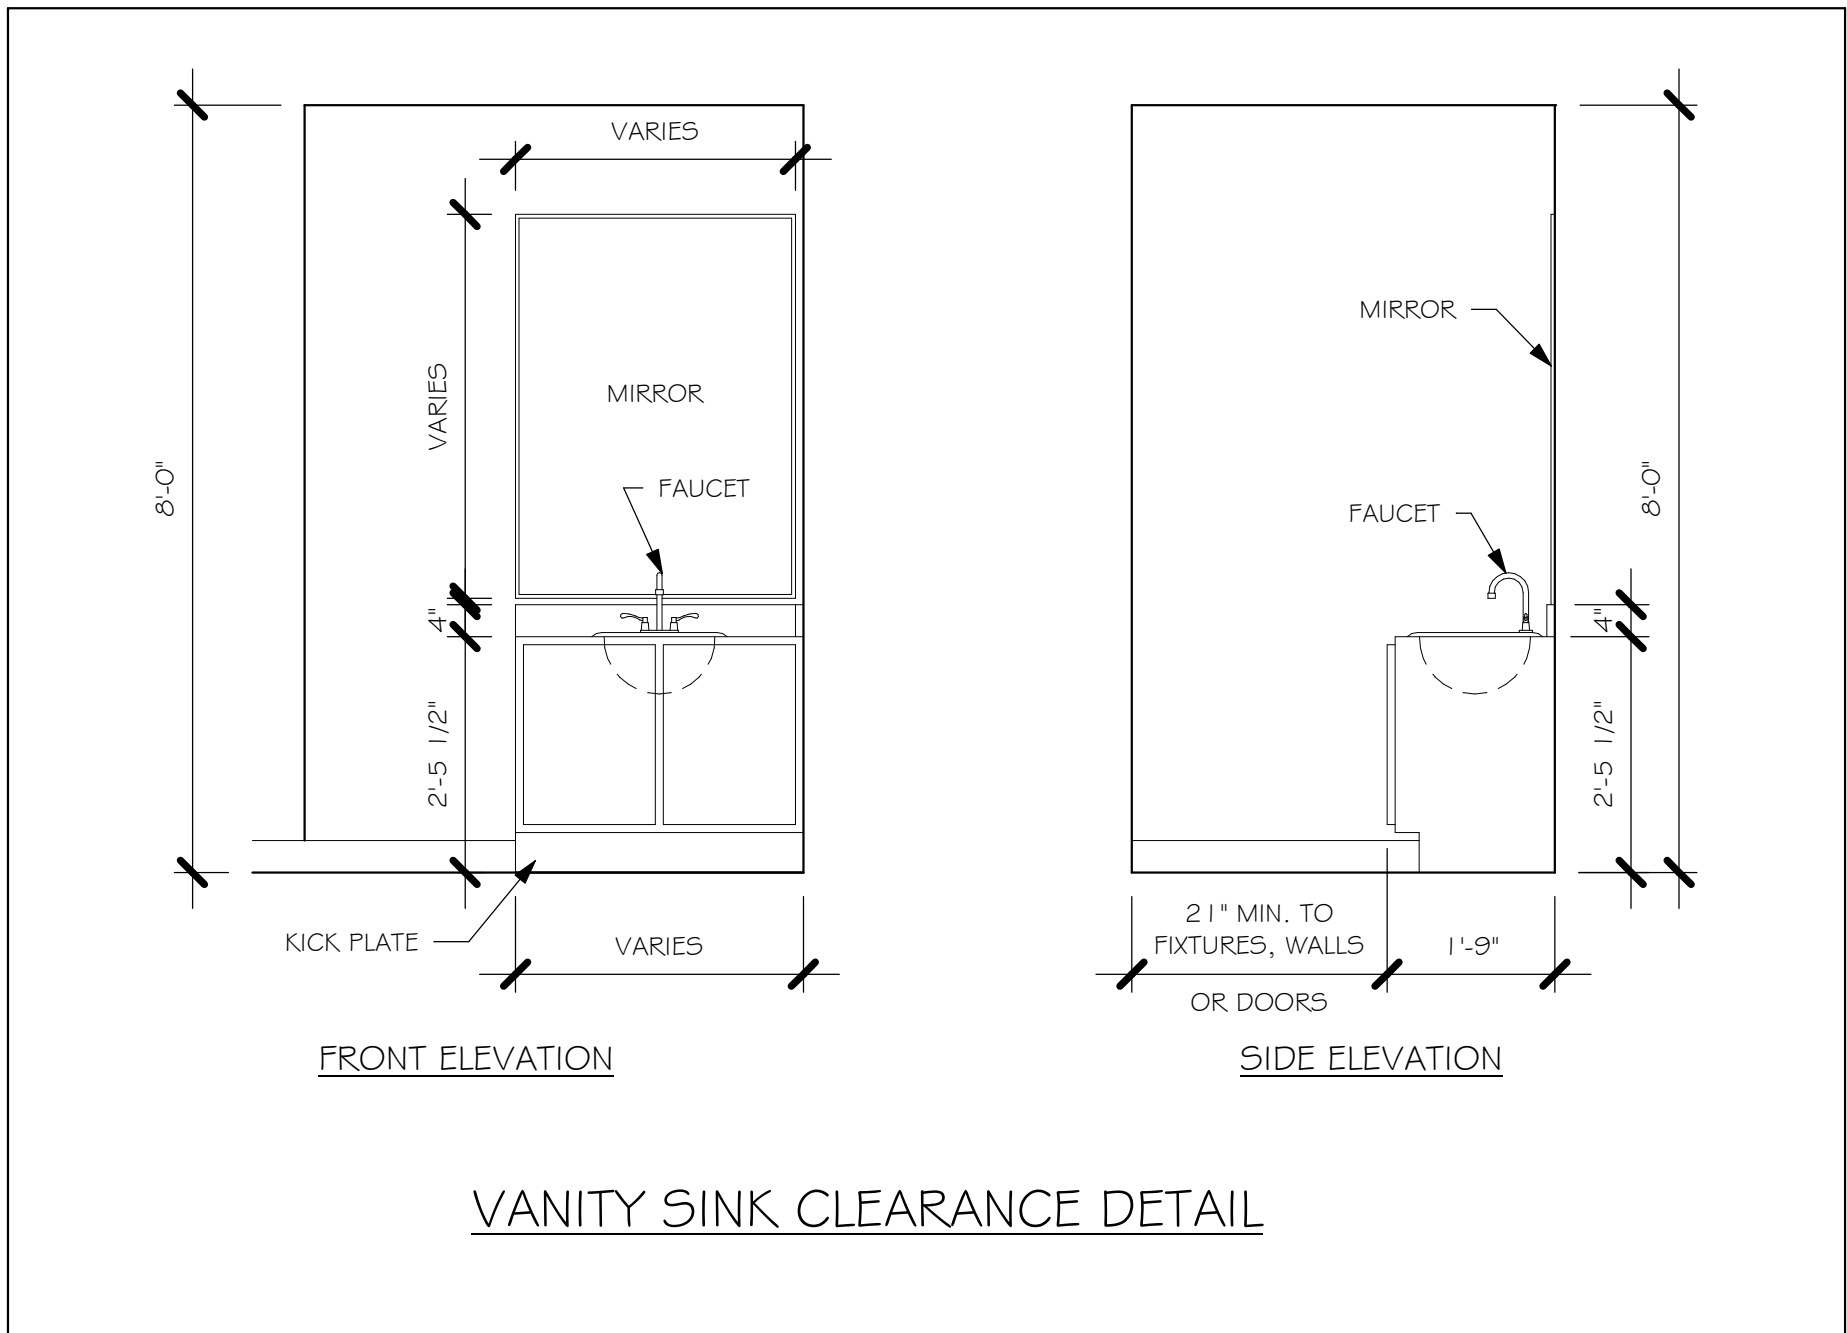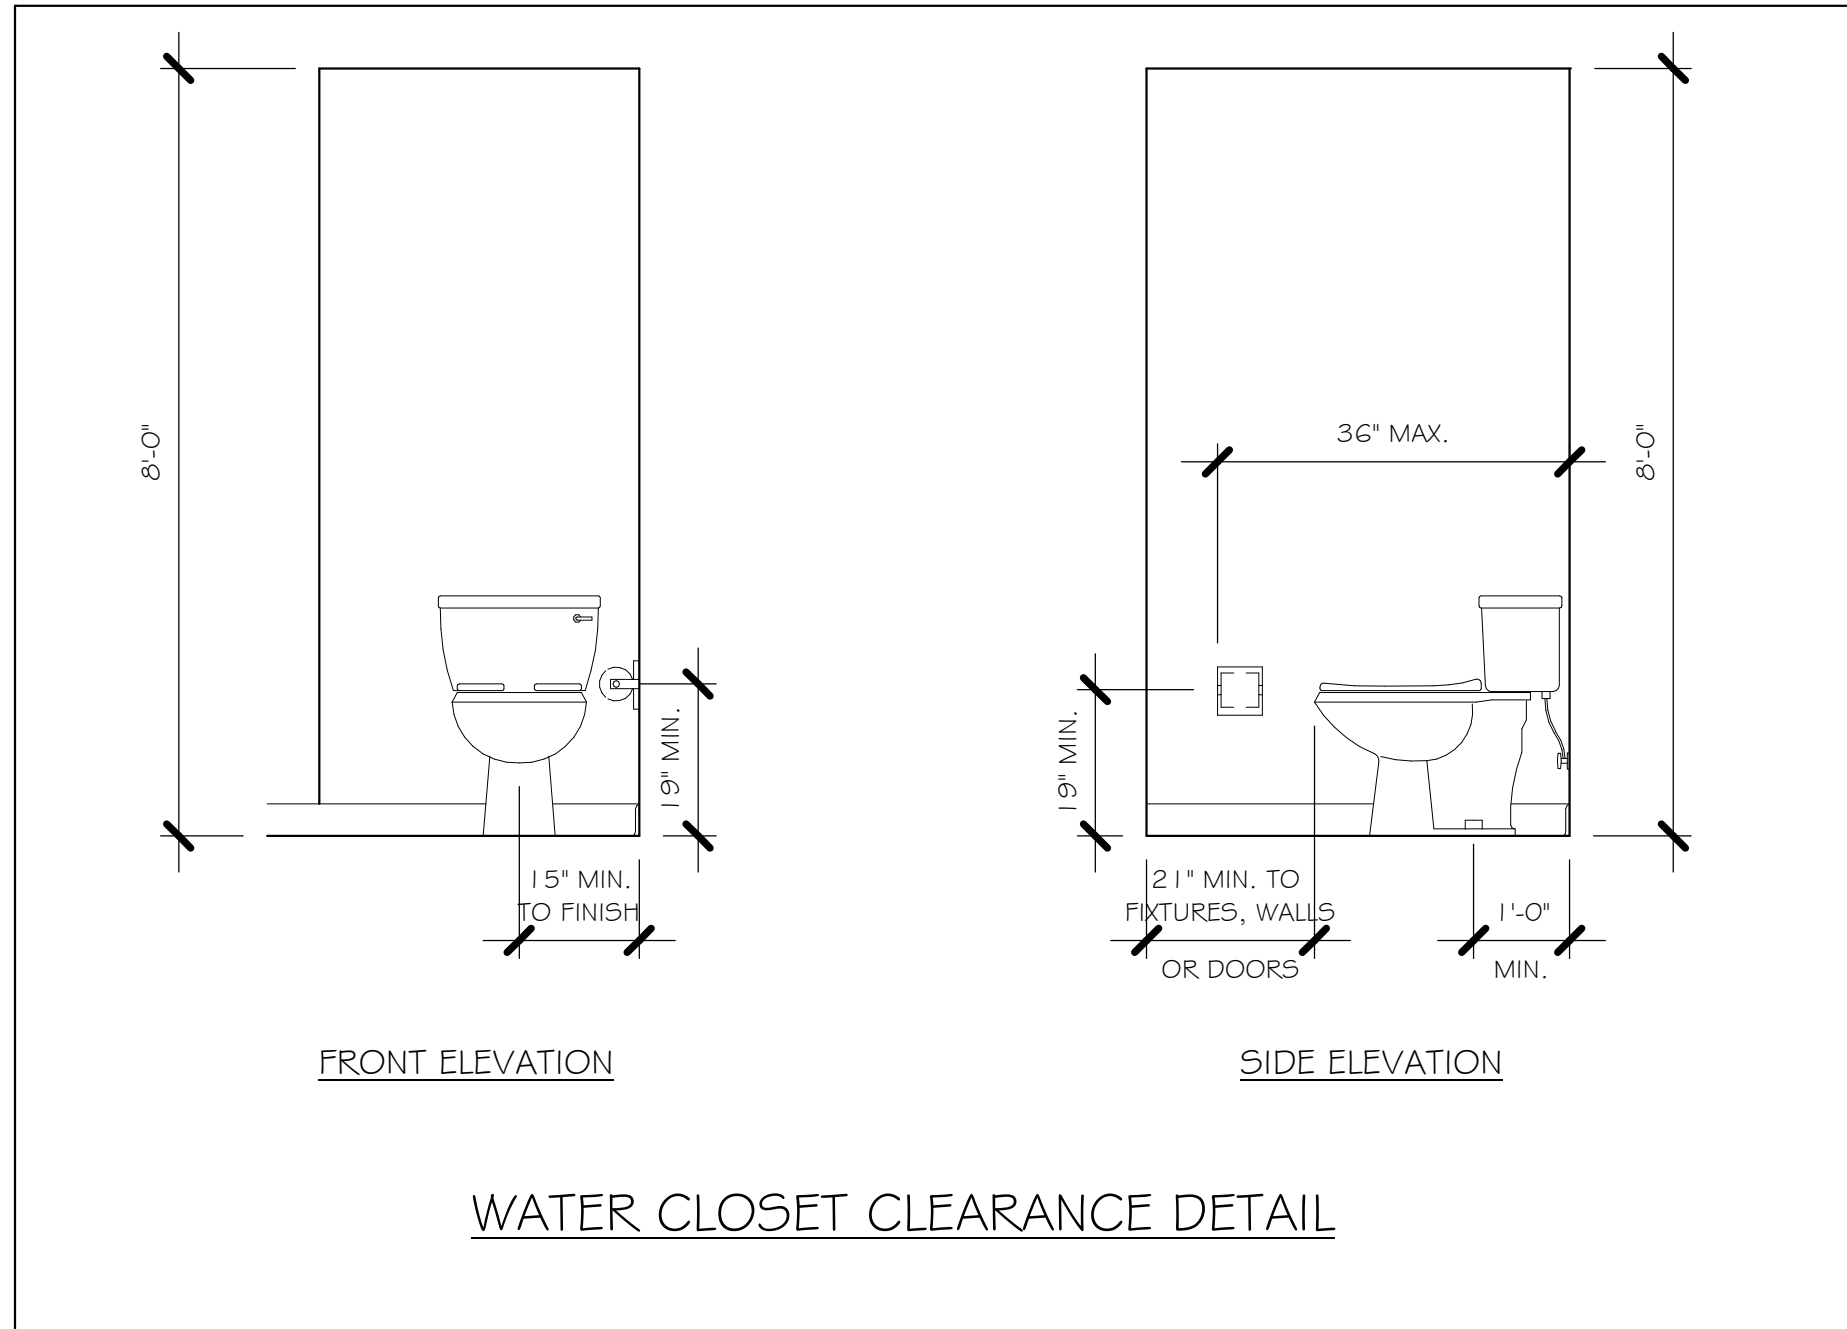

SLAB & PLUMBING  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\LABELLE  
GLADES COUNTY\12099 LOT 1 & BLK 2291 1389 BR\REV\1389 BR.rvt

DOOR SCHEDULE					
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	COUNT
1	3068 ENTRY	DISTINCTION	6'-8"	3'-0"	1
2	2-3068 SL. GL. DR.	DISTINCTION	6'-8"	6'-0"	1
3	16070 OHGD	GARAGE DOOR	7'-0"	16'-0"	1

WINDOW SCHEDULE					
MARK	DESCRIPTION	MANUFACTURER	COUNT	HEIGHT	WIDTH
A	2-25 SH		1	5'-3"	6'-4"
B	25 SH		2	5'-3"	3'-2"
C	35 SH		1	5'-3"	4'-6"

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

- PLAN NOTES
- 1)

VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS

2)

PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.

3)

PROVIDE SAFETY GLAZING AT BATH/ SHOWER PER FLORIDA BUILDING CODE R 308.4.5.

4)

NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)

5)

PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE

6)

KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.

7)

INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS

8)

WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5

9)

THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THEN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT

10)

INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.1.5.

11)

ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PRVENTION DEVICE

12)

ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.

13)




ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	L.V. = LOUVERED DOOR
5	2'-0"	
6	1'-8"	
7	1'-6"	
8	2'-11"	

SQUARE FOOTAGE	
LIVING AREA	1,389
GARAGE AREA	419
LANAI AREA	80
FRONT PORCH/ ENTRY AREA	16
TOTAL SQUARE FOOTAGE	1,904

CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

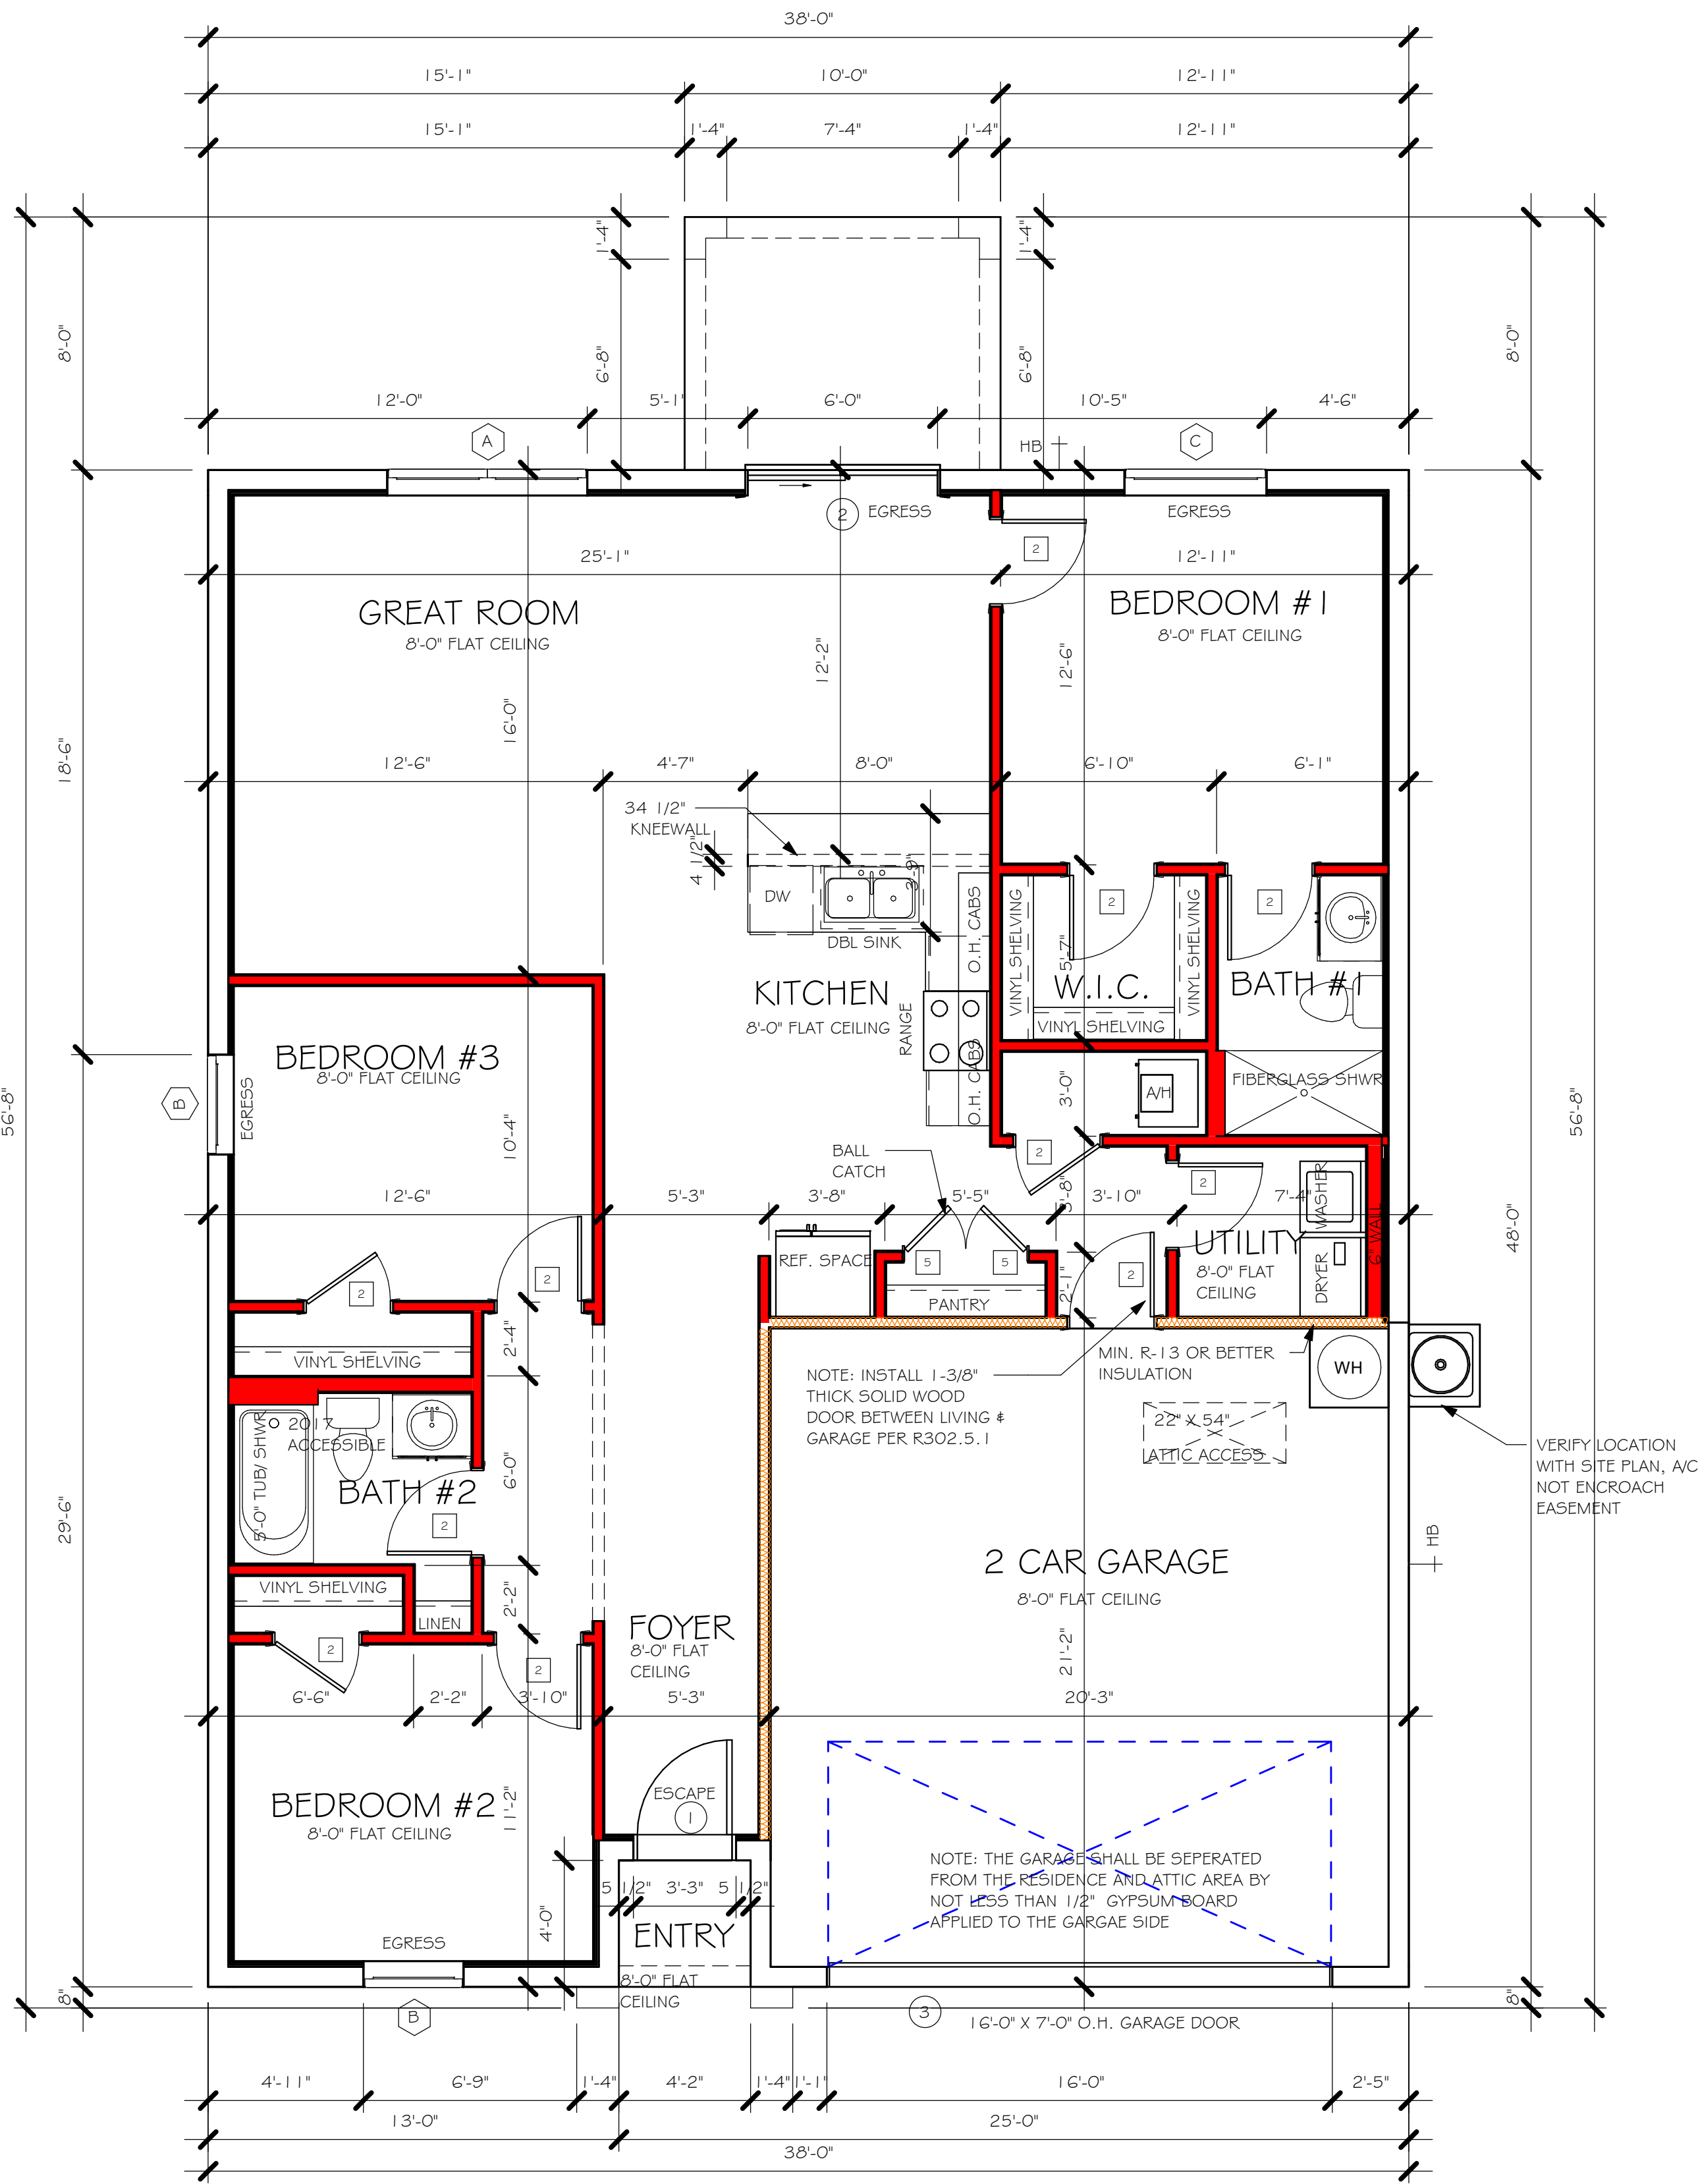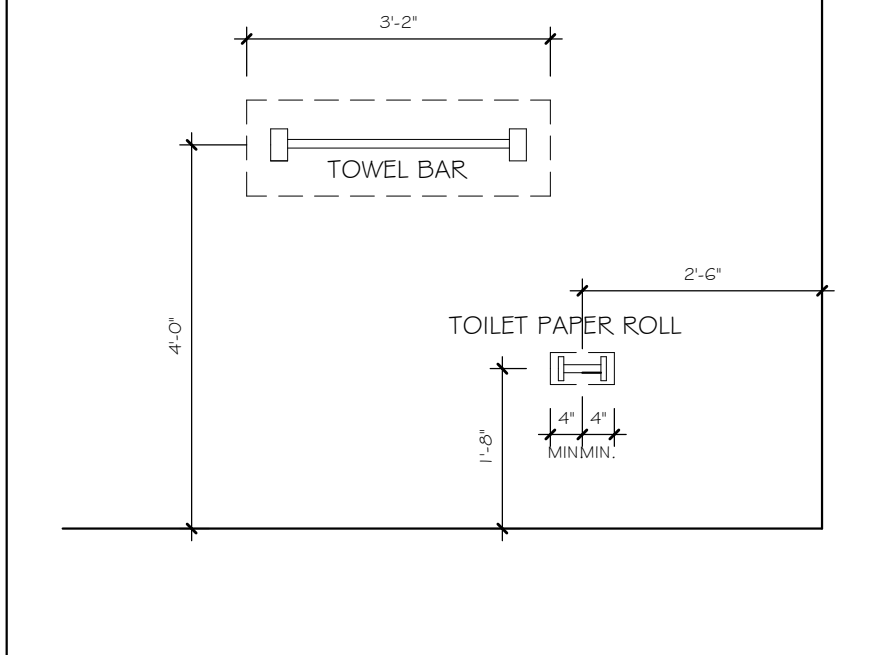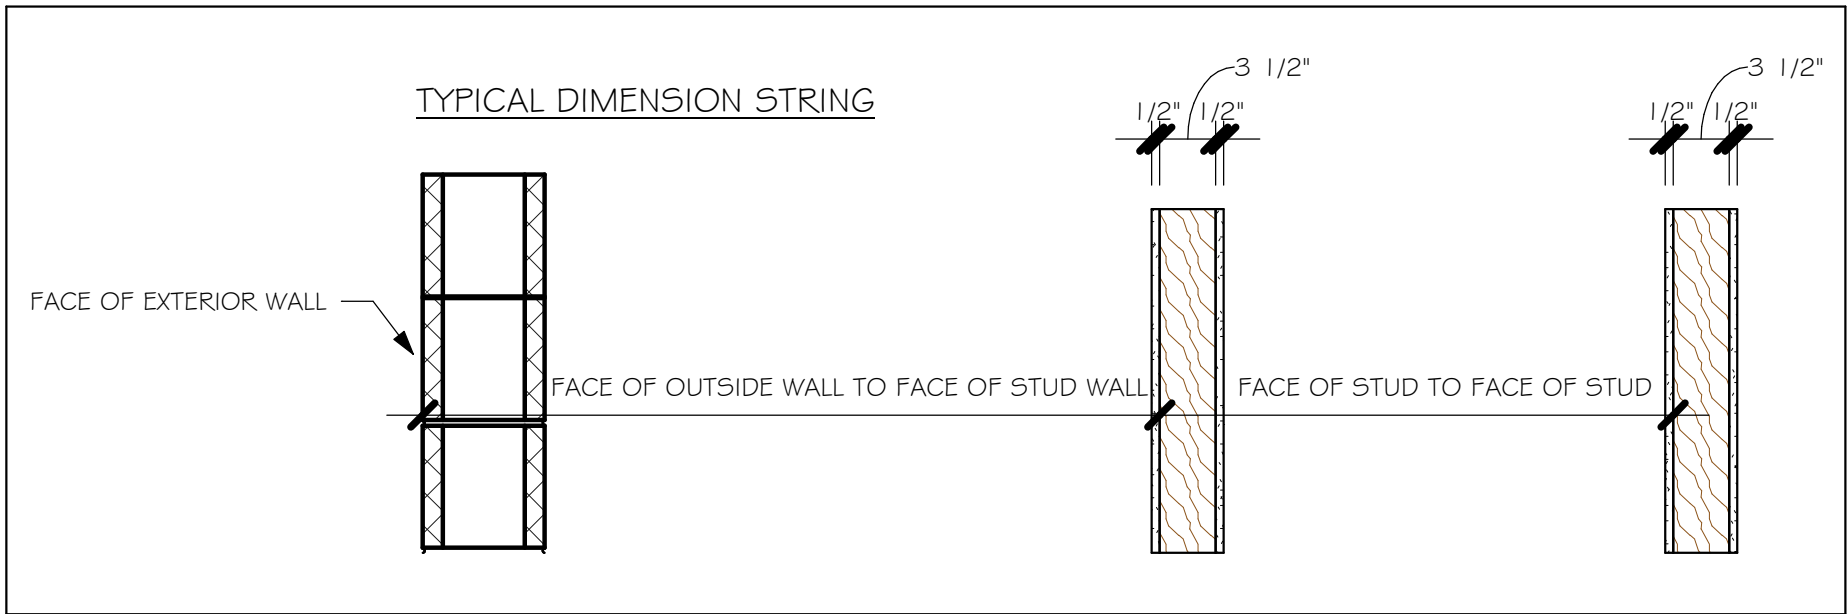

FLOOR PLAN  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast  
Drafting & Design, Inc.  
EMAIL: PLANS@GULFCOASTDRAFTING.COM  
PHONE: 239-540-8823  
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 1/8  
SUBDIVISION: LABELLE HENDRY COUNTY  
ADDRESS: 8025 MARSH CIRCLE  
D.R.H. #: 579920039

MODEL  
# 1389 B  
GCD JOB # 12099

DATE: 11/04/20  
DRAWN BY: JSL  
CHECKED BY: JWC  
REVISED:  
PLAN: FLOOR  
SCALE: As indicated



L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\LABELLE  
GLADES COUNTY\12099 LOT 1 & BLK 2291\1389 BRREVIT\12099 1389 BR.rvt


MODEL 1389 B: ATTIC VENTILATION FBCR R806

COORDINATE VENTING REQUIREMENTS WITH ENERGY CALCULATIONS

AREAS (SQ. FT.)			SOFFIT ONLY (1/150) (NO ROOF VENTS)			WITH ROOF VENTS (1/300) (R.V.)		
ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED			ATTIC VENTILATION REQUIRED		
MARK	ATTIC	SOFFIT	ATTIC AREA/150	REQD AIR FLOW OF SOFFIT	QUAD 4 SOFFIT HAS	ATTIC AREA/300	QUANTITY OF ROOF VENTS	MIN AIR FLOW OF SOFFIT
1st STORY	2000.0 SQ. FT.	176.0 SQ. FT.	13.33 SQ. FT.	7.57%	8.15%	... SQ. FT.	-	...%
			"SOFFIT ONLY" QUALIFIES			ROOF VENTS ARE NOT REQUIRED		
			SOFFIT MODEL  ACM QUAD 4, FULL VENT, NARROW PATTERN, 8.15% FREE AIR FLOW			ROOF VENT MODEL 32" BASE  22-3/8" BASE  LOMANCO 770-D 0.97 SQ. FT. FREE AIR		

WALL HEIGHT

= WALL @ 8'-0"

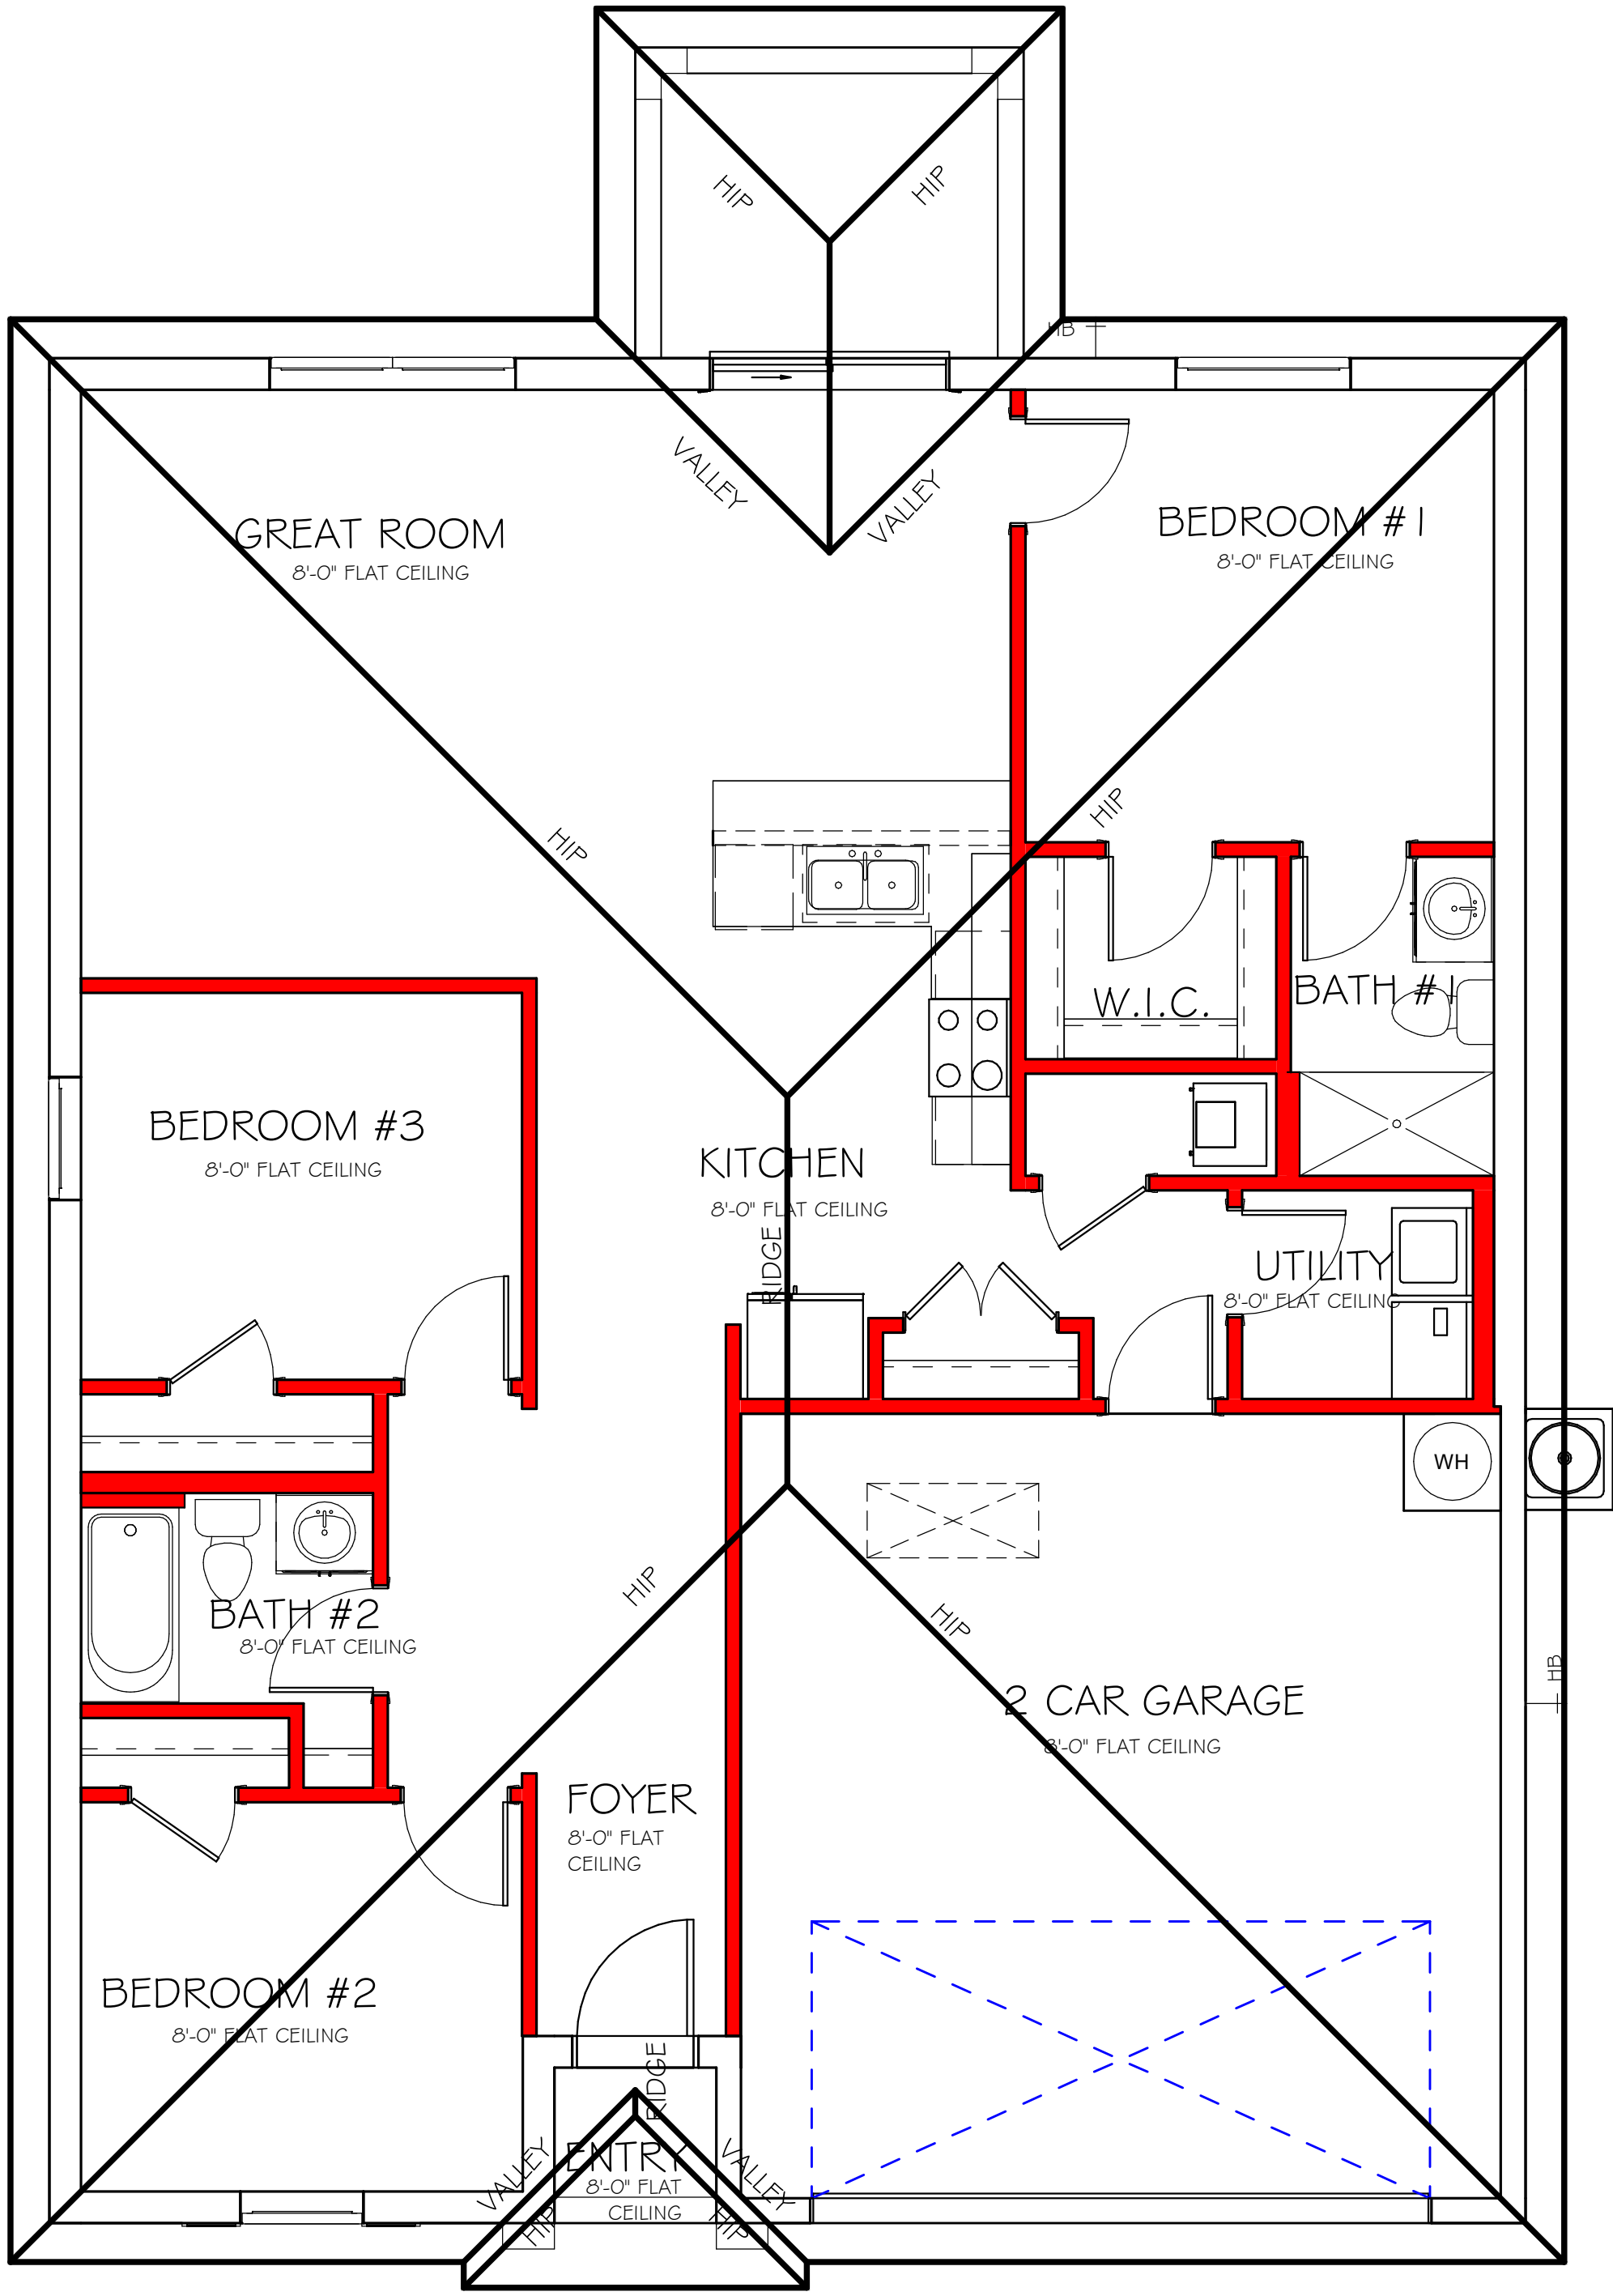

ROOF PLAN  
1/4" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



Gulf Coast  
Drafting & Design, Inc.

EMAIL: [PLANS@GULFCOASTDRAFTING.COM](mailto:PLANS@GULFCOASTDRAFTING.COM)  
PHONE: 239-540-1822  
1515 SE 47th ST. CAPE CORAL, FL 33904

LOT: 1 & BLOCK: 2291

SUBDIVISION: LABELLE HENDRY COUNTY

ADDRS: 8025 MARSH CIRCLE

D.R.H. #: 579920039

MODEL  
# 1389 B

GCD JOB # 12099

DATE: 11/04/20

DRAWN BY: JSL

CHECKED BY: JWC

REVISED:

PLAN: ROOF



SCALE: As indicated

A-4

L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\LABELLE  
GLADES COUNTY\12099 LOT 1 & BLK 2291 1389 BRREVITY\1389 BR-REV

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AG/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES. PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C. 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATION PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V. PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2014	

ELECTRICAL PLAN 1389		
200 AMP SERVICE		
TAG	QUANTITY	PRODUCT
A	(X)	(FLUSH MOUNTED LT)
B	(X)	(VAPORS)
C	(X)	(PENDANT LIGHT
D	(10)	(10" MUSHROOMS)
E	(2)	(24" 3 LT)
F	(X)	(36" 4 LT)
G	(X)	(NOT USED)
H	(2)	(COACH LIGHTS)
I	(X)	(COACH LIGHTS)
J	(X)	(J BOX)
K	(1)	(4' FLUORESCENT)
L	(X)	(2' FLUORESCENT)
M	(X)	(5LT CHANDELIER)
N	(X)	(3 LT )
O	(X)	(PENDANT/ NOOK)
P	(X)	(X)
Q	(X)	(X)

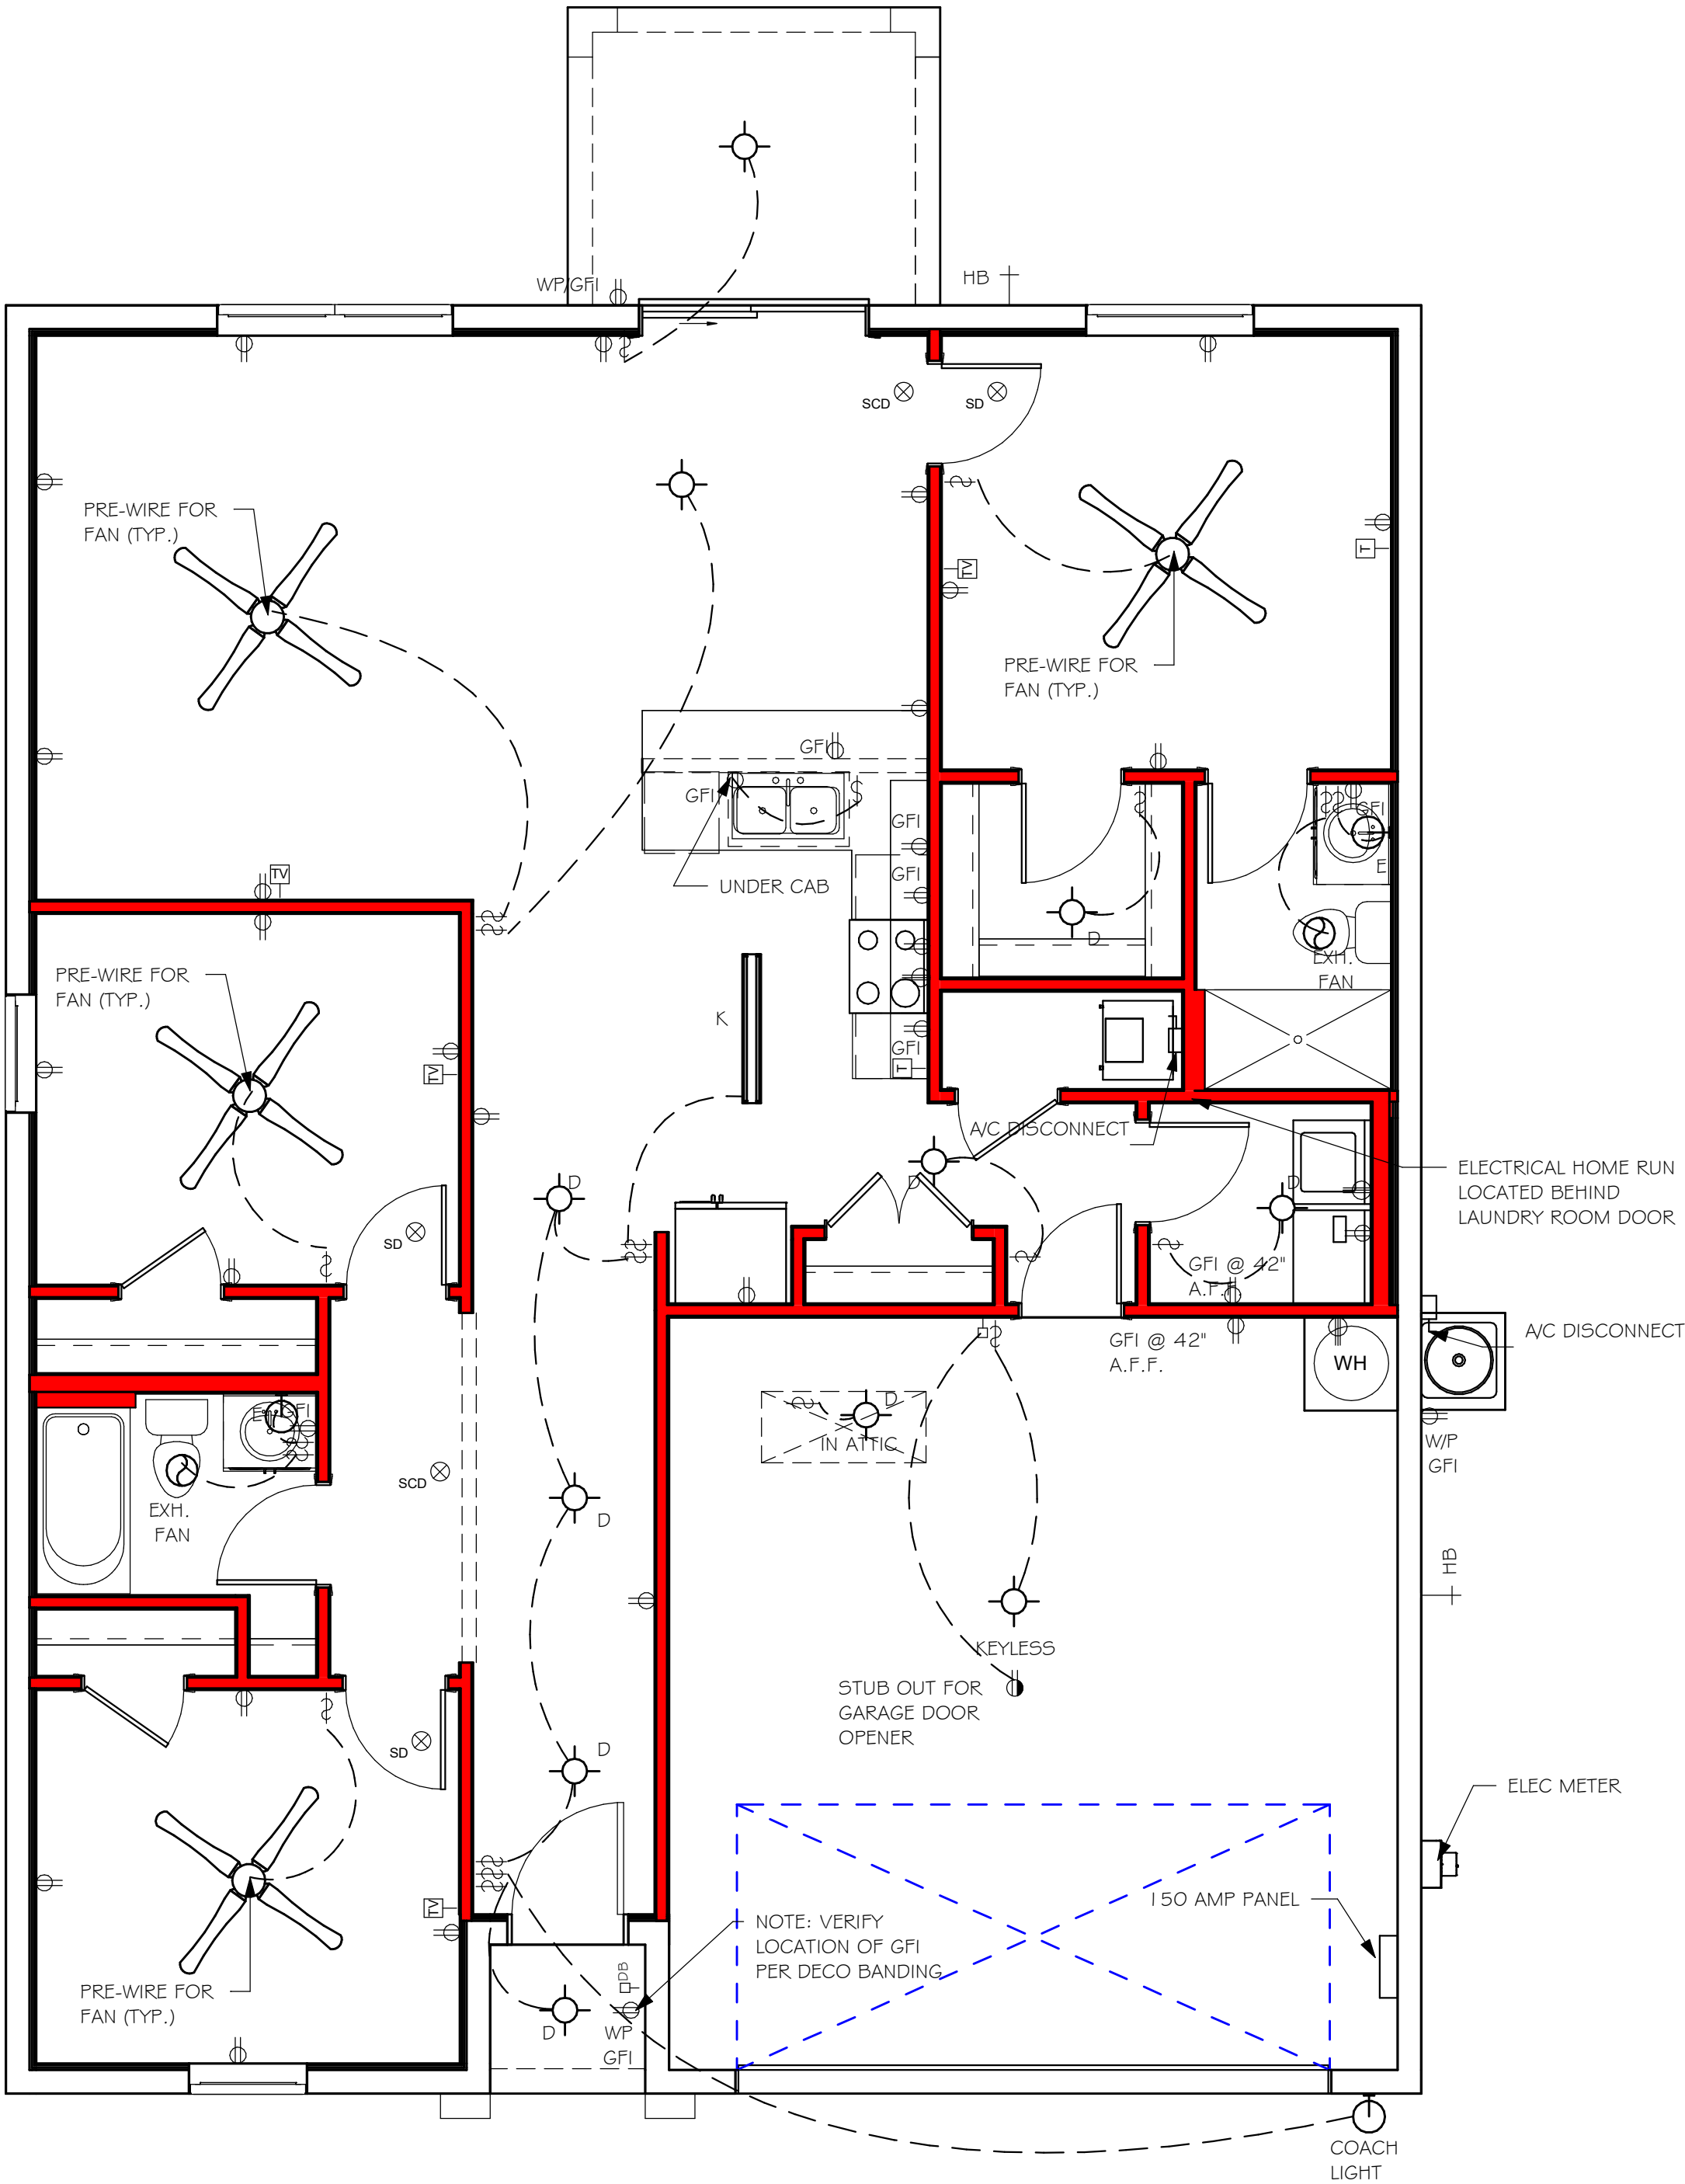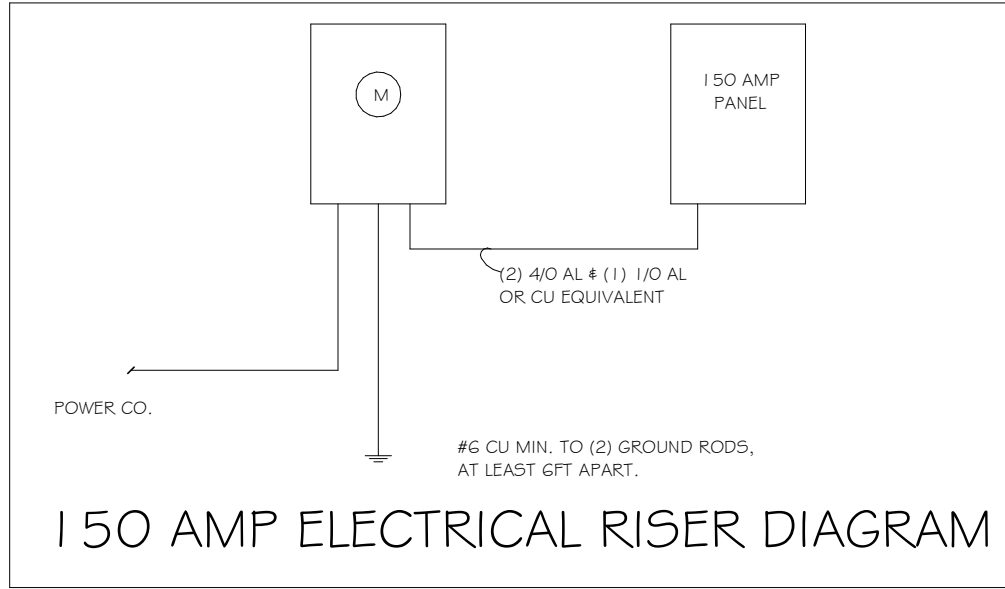

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



**Gulf Coast**  
Drafting & Design, Inc.  
EMAIL: PLANS@GULFCOASTDRAFTING.COM  
PHONE: 239-540-1822  
1515 SE 47th ST. CAPE CORAL, FL 33904


LOT: 1 &	BLOCK: 2291
SUBDIVISION: LABELLE HENDRY COUNTY	
ADDRS: 8025 MARSH CIRCLE	
D.R.H. #: 579920039	

MODEL # 1389 B	GCD JOB # 12099
-------------------	-----------------

DATE: 11/04/20
DRAWN BY: JSL
CHECKED BY: JWC
REVISED:
PLAN: ELECTRIC
SCALE: As indicated



L:\O-New Data\1 -MASTER 2019\2019-BUILDERS\DK HORTON 2019\SUBDIVISIONS\LABELLE  
GLADES COUNTY\12099 LOT 1 & BLK 2291 1389 BREVITY\12099 1389 BR.rvt

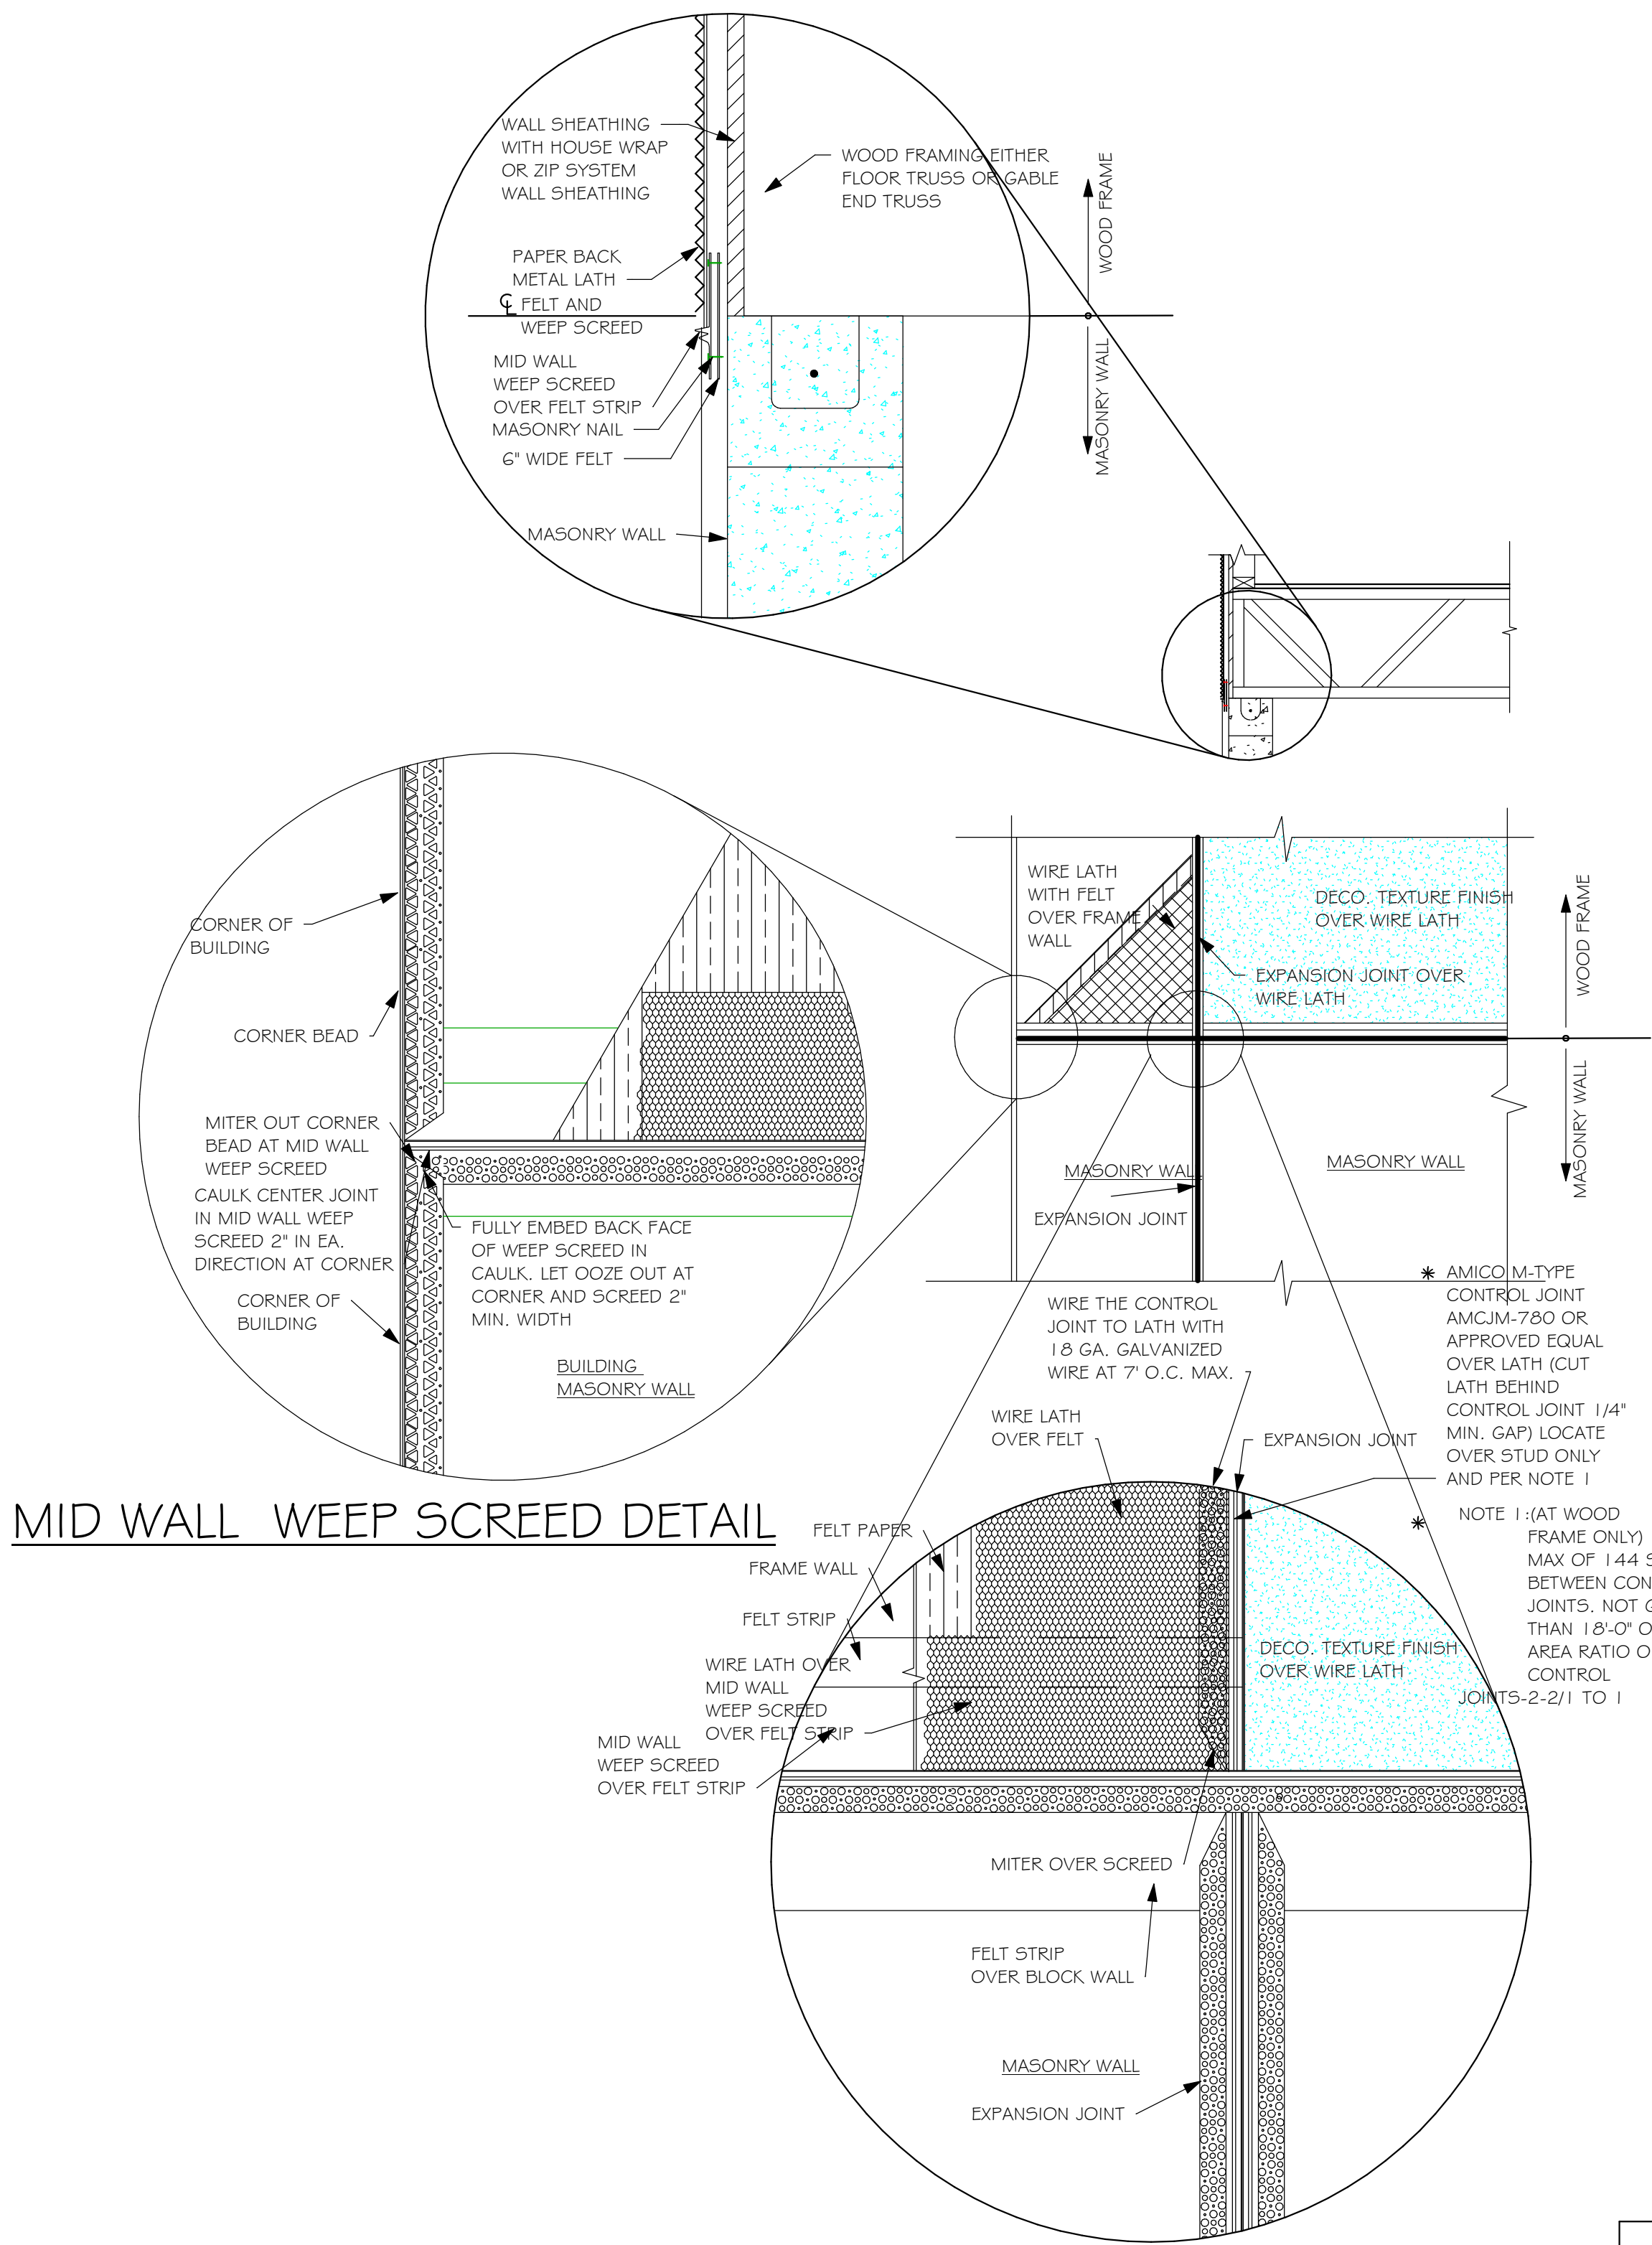

**WEEP SCREED DETAIL**  
INSTALL AT ALL EXTERIOR WALL LOCATIONS WHERE  
WOOD STUD FRAMING IS ABOVE MASONRY WALLS.

## RESIDENTIAL SPECIFICATIONS

### GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SUB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. FOR REQUIRED SOIL BEARING, SEE STRUCTURAL. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING. THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT. ALL BOLTS, NUTS, WASHERS, STRAPS AND FASTENERS INCLUDING NAILS, SHALL BE HOT MOPED DIPPED GALVANIZED OR STAINLESS STEEL. CONTINUOUS ANCHORAGE SHALL BE PROVIDED BETWEEN ALL TRUSSES, WALL SECTIONS, BEAMS, POSTS AND FOOTINGS WITH USE OF STRAPS AND CONNECTORS AS SPECIFIED HEREIN.
7. TREATED WOOD REQUIREMENTS-- ALL TREATED WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LANAI CEILINGS \* COVERED ENTRY CEILINGS 1X4 STRIPPING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYP. BOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.


### DOOR AND WINDOW ANCHORAGE

ANCHORAGE REQUIREMENTS- ALL PASS AND SLIDING GLASS DOORS AND ALL WINDOW ASSEMBLIES SHALL BE ANCHORED TO THE MAIN WIND FORCE RESISTING SYSTEM IN A MANNER SPECIFIED BY THE PUBLISHED MANUFACTURER'S LITERATURE. THERE SHALL BE NO SUBSTITUTION OF ALTERNATE FASTENINGS UNLESS PROVIDED BY THE MANUFACTURER AND APPROVED BY THE BUILDING DESIGN ENGINEER.

**MASONRY OPENING**  
WHERE WINDOW FRAME IS DESIGN TO FASTEN WITH SCREWS THROUGH THE FRAME AND INTO THE MASONRY, THE BUCK MATERIAL IS SIMPLY A SPACER. THE BUCK MAY BE FASTENED WITH THE T NAILS OR ANY SUITABLE FASTENER TO TACK IT INTO POSITION PRIOR TO WINDOW INSTALLATION. FASTEN WINDOW FRAME PER MFR INSTRUCTIONS. A WINDOW FASTENER SHALL PENETRATE MASONRY BY 2 1/4" MIN.

WHERE WINDOW FRAME IS DESIGNED TO FASTEN ONLY TO THE WOOD BUCK (IE, FLANGED FRAME WITH WOOD SCREWS) THE BUCKS SHALL BE 2X WOOD WITH STRUCTURAL FASTENING TO THE MASONRY WITH 1/4 X 3 3/4 MASONRY SCREWS @ 24" OC AND 6" FROM EACH END.

**WOOD FRAMED OPENING**- ALL DOORS AND WINDOWS SHALL BE INSTALLED ACCORDING TO THE PUBLISHED MANUFACTURER'S LITERATURE OF THE ASSEMBLY BEING INSTALLED TO THE ROUGH SUBSTRATE OPENING. SHIMS SHALL BE MADE OF MATERIALS CAPABLE OF RESISTING THE APPLIED LOADS AND SHALL BE LOCATED NEAR EACH FRAME FASTENER TO MINIMIZE DISTORTION OF THE FRAME AS THE FASTENERS ARE TIGHTENED .

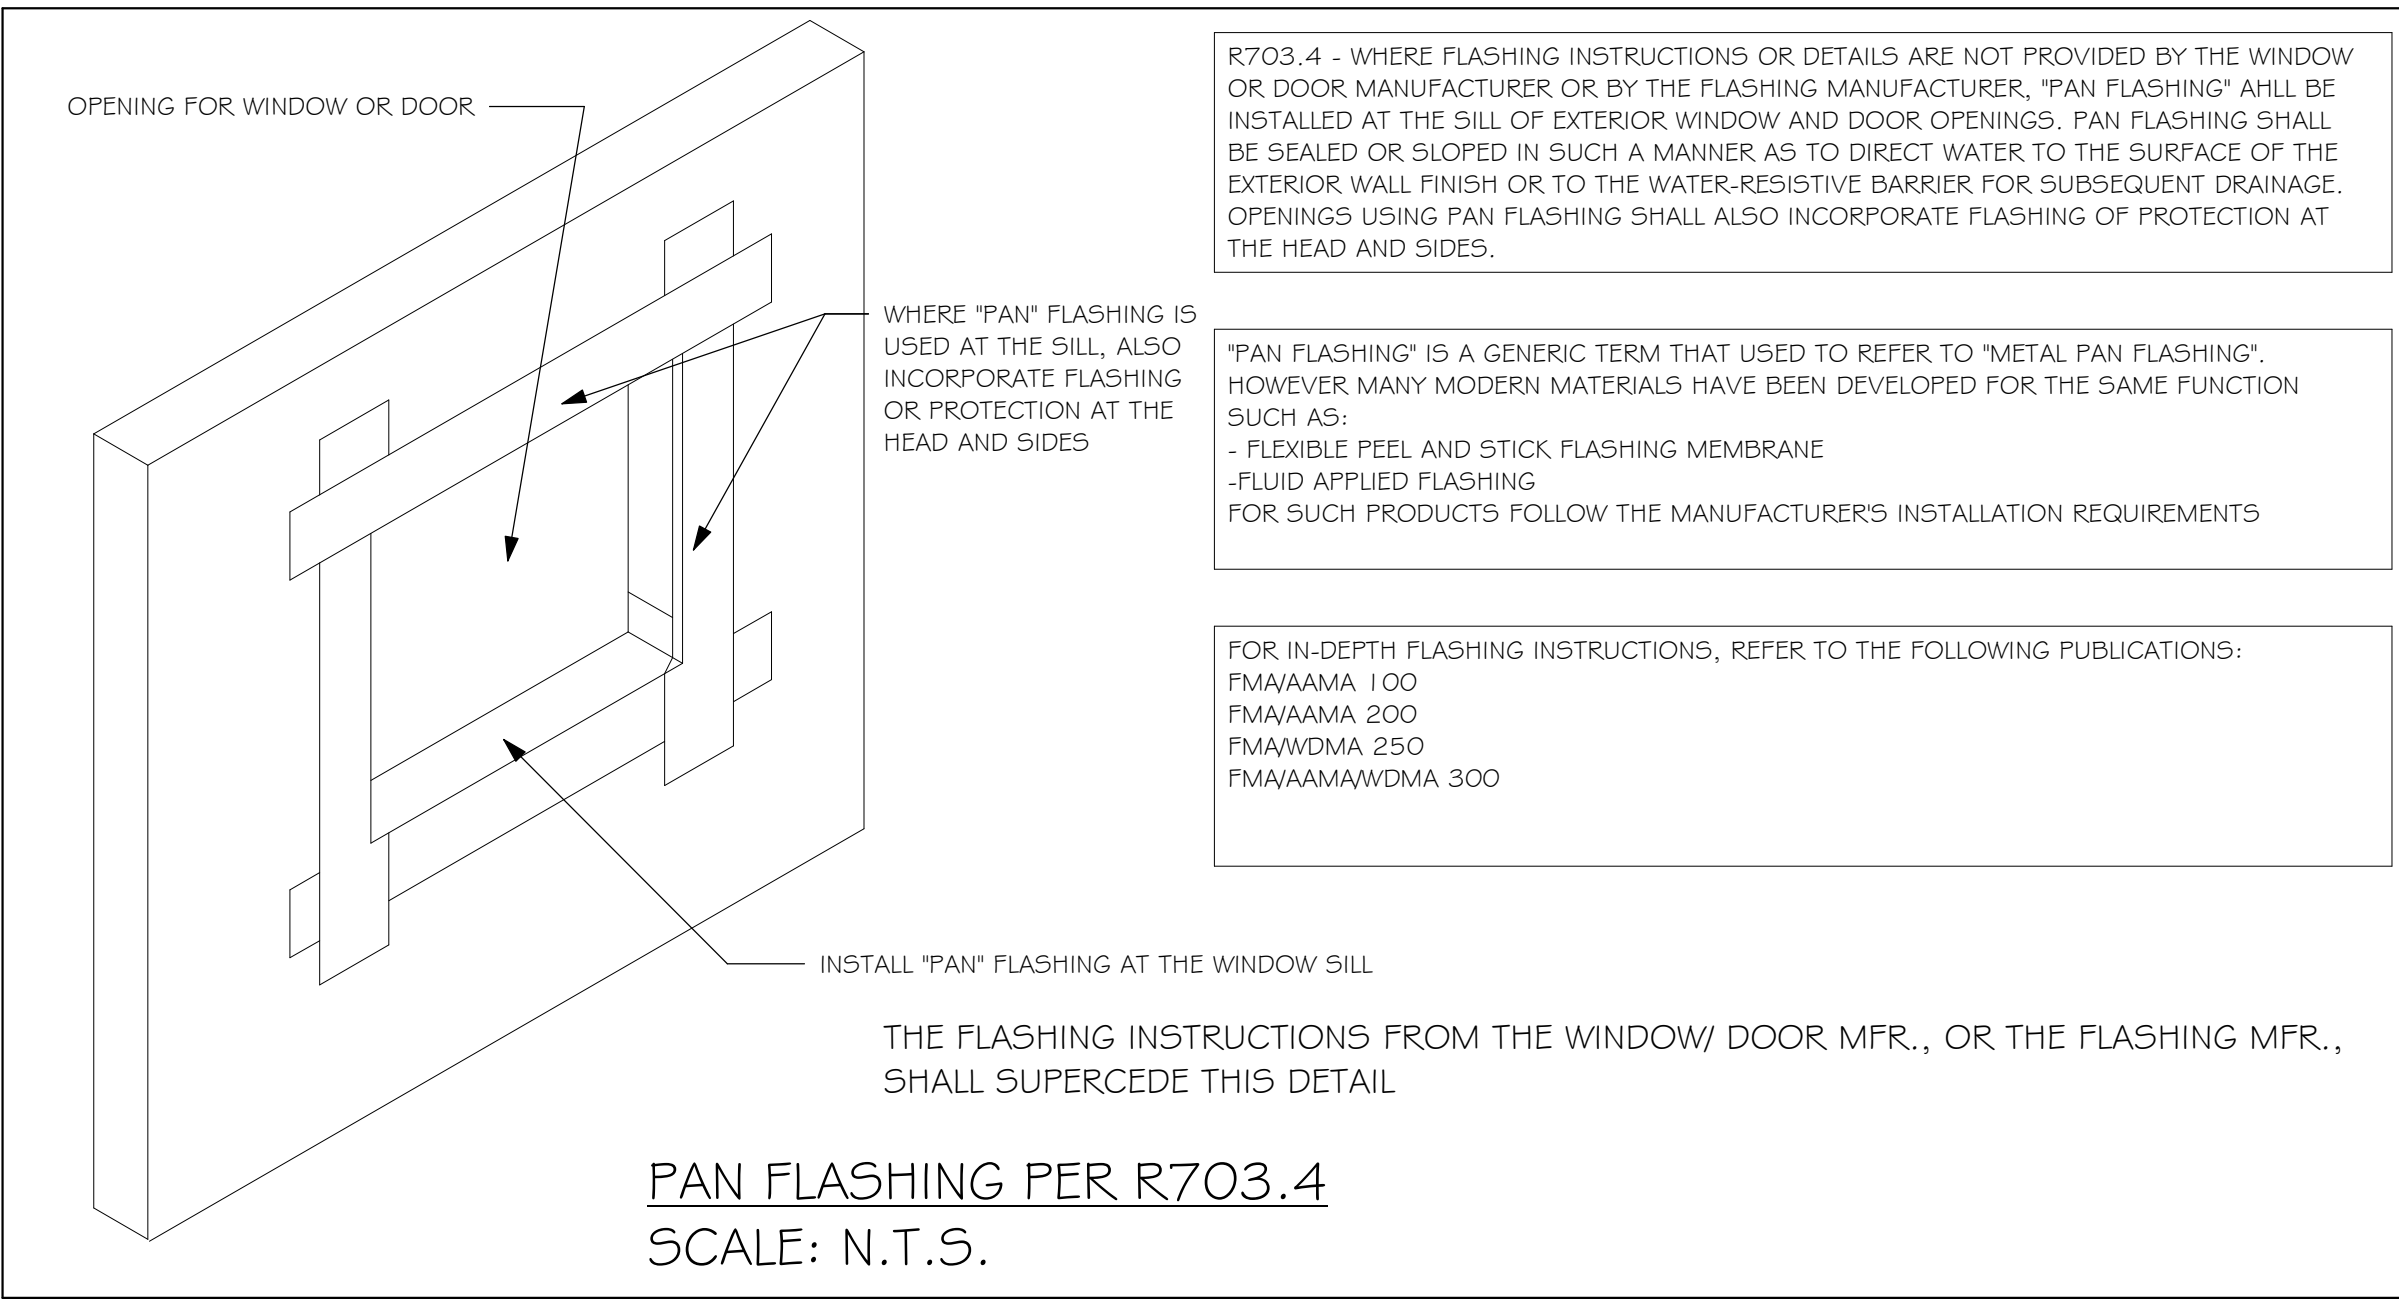

### GENERAL ROOF ASSEMBLY

**ROOF SHEATHING**  
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. INSTALL PANELS WITH LONG DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT SHEETS SHALL BE MAINTAINED. INSTALL "H" CLIPS AT UNSUPPORTED PANEL EDGES. FOR FASTENING, SEE STRUCTURAL.

**FLASHING**  
FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL 0.0179" THICK, 26 GAUGE AZ50 ALUM ZINC, OR GALVANIZED STEEL 0.0179" THICK, 26 GAUGE ZINC COATED G90. FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURER'S PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

**DRIP EDGE**  
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLES ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1/2" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

### ASPHALT SHINGLE ROOF SPECS

**SHINGLES**  
15# FELT SHALL BE INSTALLED UNDER ASPHALT SHINGLES. ALL ASPHALT SHINGLES SHALL HAVE SELF-SEALING STRIPS OR BE INTERLOCKING AND COMPLY WITH ASTM D 225 OR D 3462, FOR FASTENING, SEE STRUCTURAL. INSTALLATION SHALL COMPLY WITH MANUFACTURER'S REQUIREMENTS FOR INSTALLATION IN THE GIVEN FLORIDA WIND ZONE, AS DETERMINED BY ASTM D 3161.

### CLAY AND CONCRETE ROOF TILE SPECS


INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.  
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.  
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.  
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDED BUT NOT BE LIMITED TO THE FOLLOWING:  
1. TILE PLACEMENT AND SPACING,  
2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,  
A. AMOUNT AND PLACEMENT OF MORTAR  
B. AMOUNT AND PLACEMENT OF ADHESIVE  
C. TYPE, NUMBER, SIZE AND LENGTH OF FASTENERS AND CLIPS.  
3. UNDERLAYMENT  
4. SLOPE REQUIREMENT.

### FLOOR SHEATHING AT 2ND FLOOR


A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES SPAN RATING 48/24 OR BETTER, SEE STRUCTURAL.

ROOF SHEATHING PER SCHEDULE 2/5-1 .  
AND PER NOTES IN TABLE 3 ON A-6

SHINGLE ROOF PER NOTE 5 ON A-6

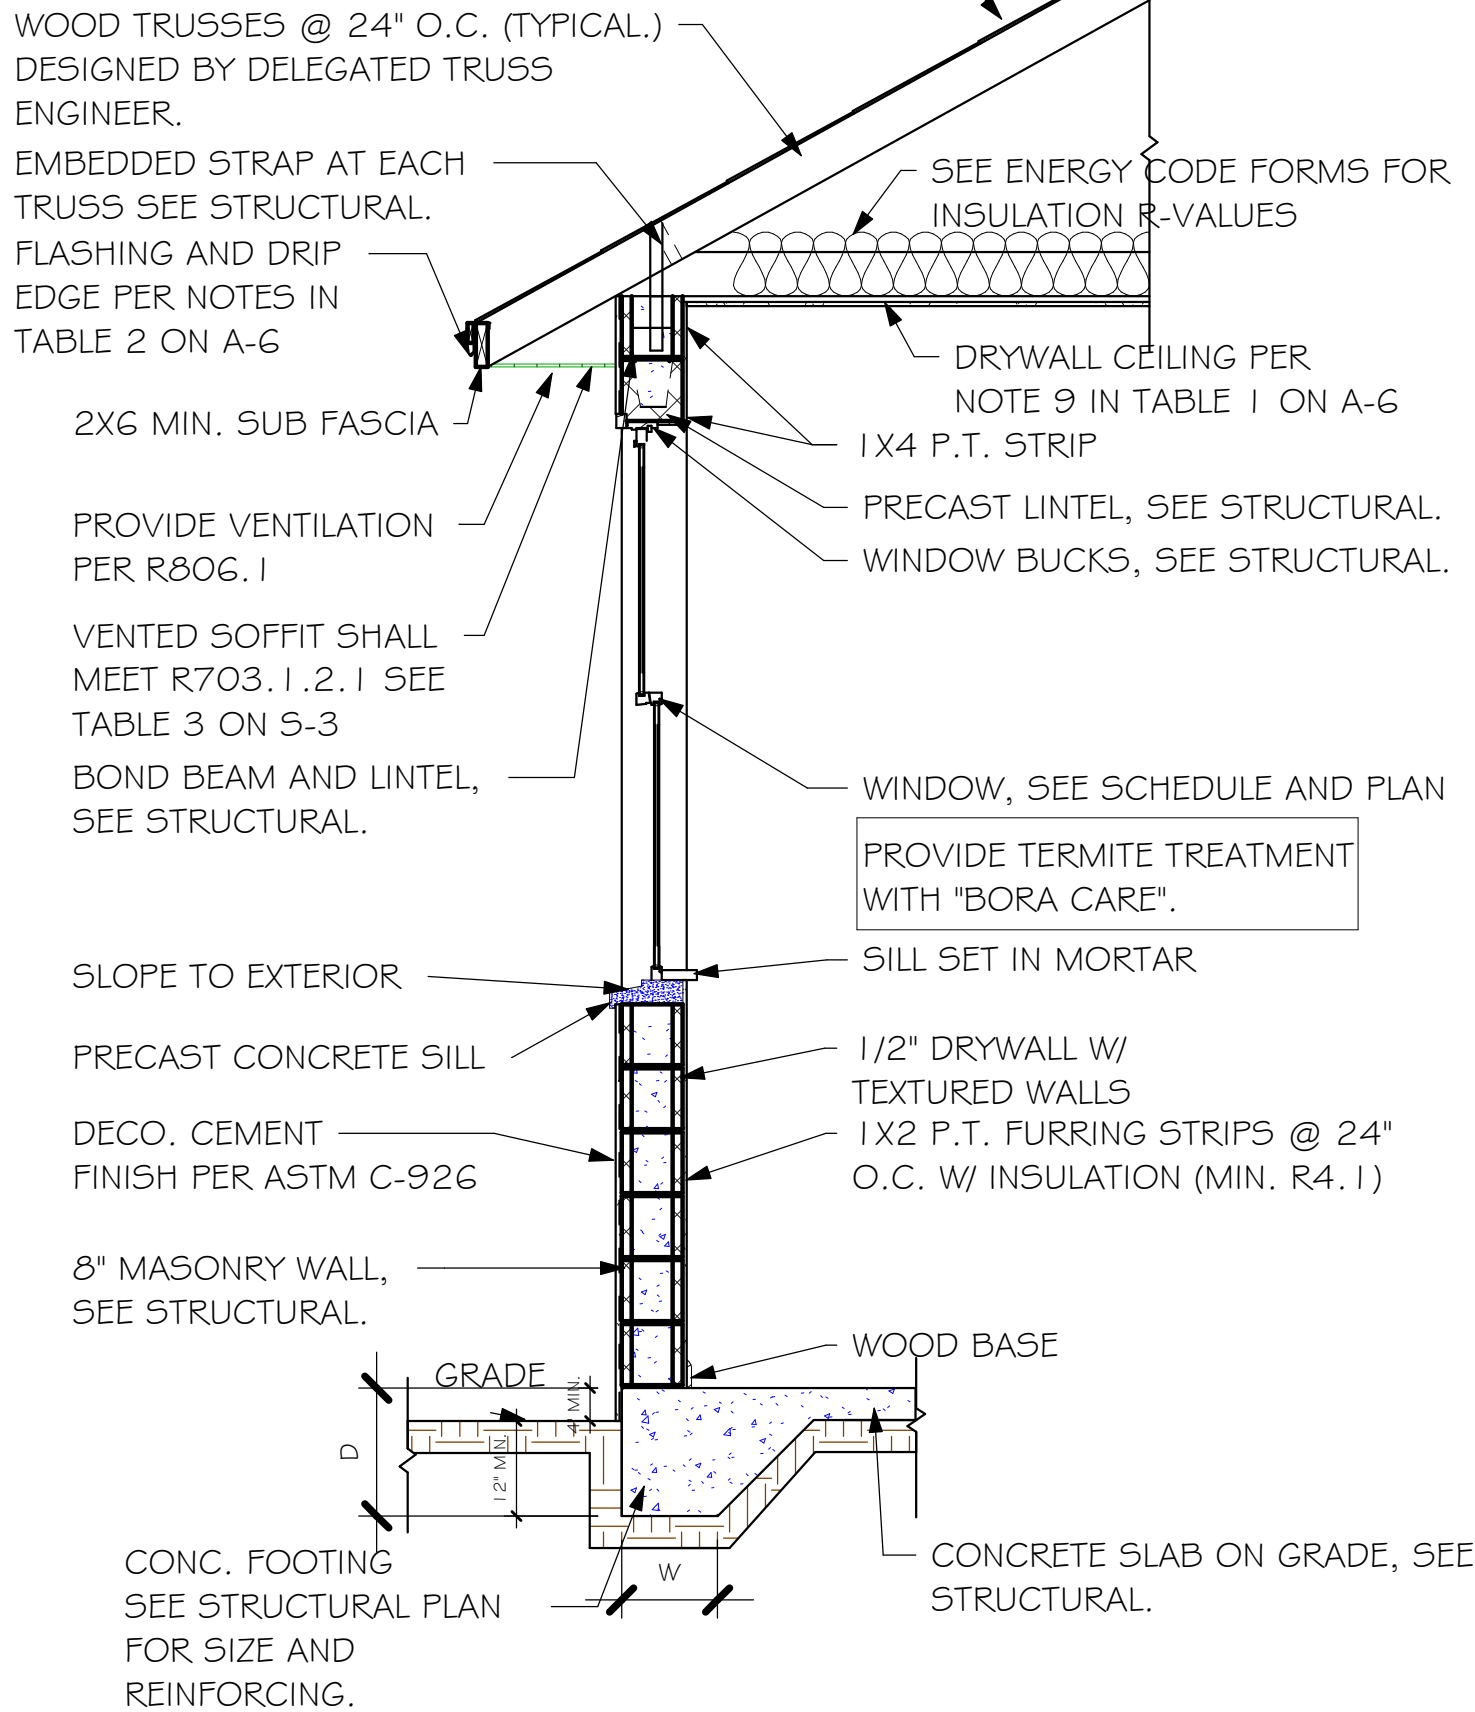

### TYPICAL WALL SECTION

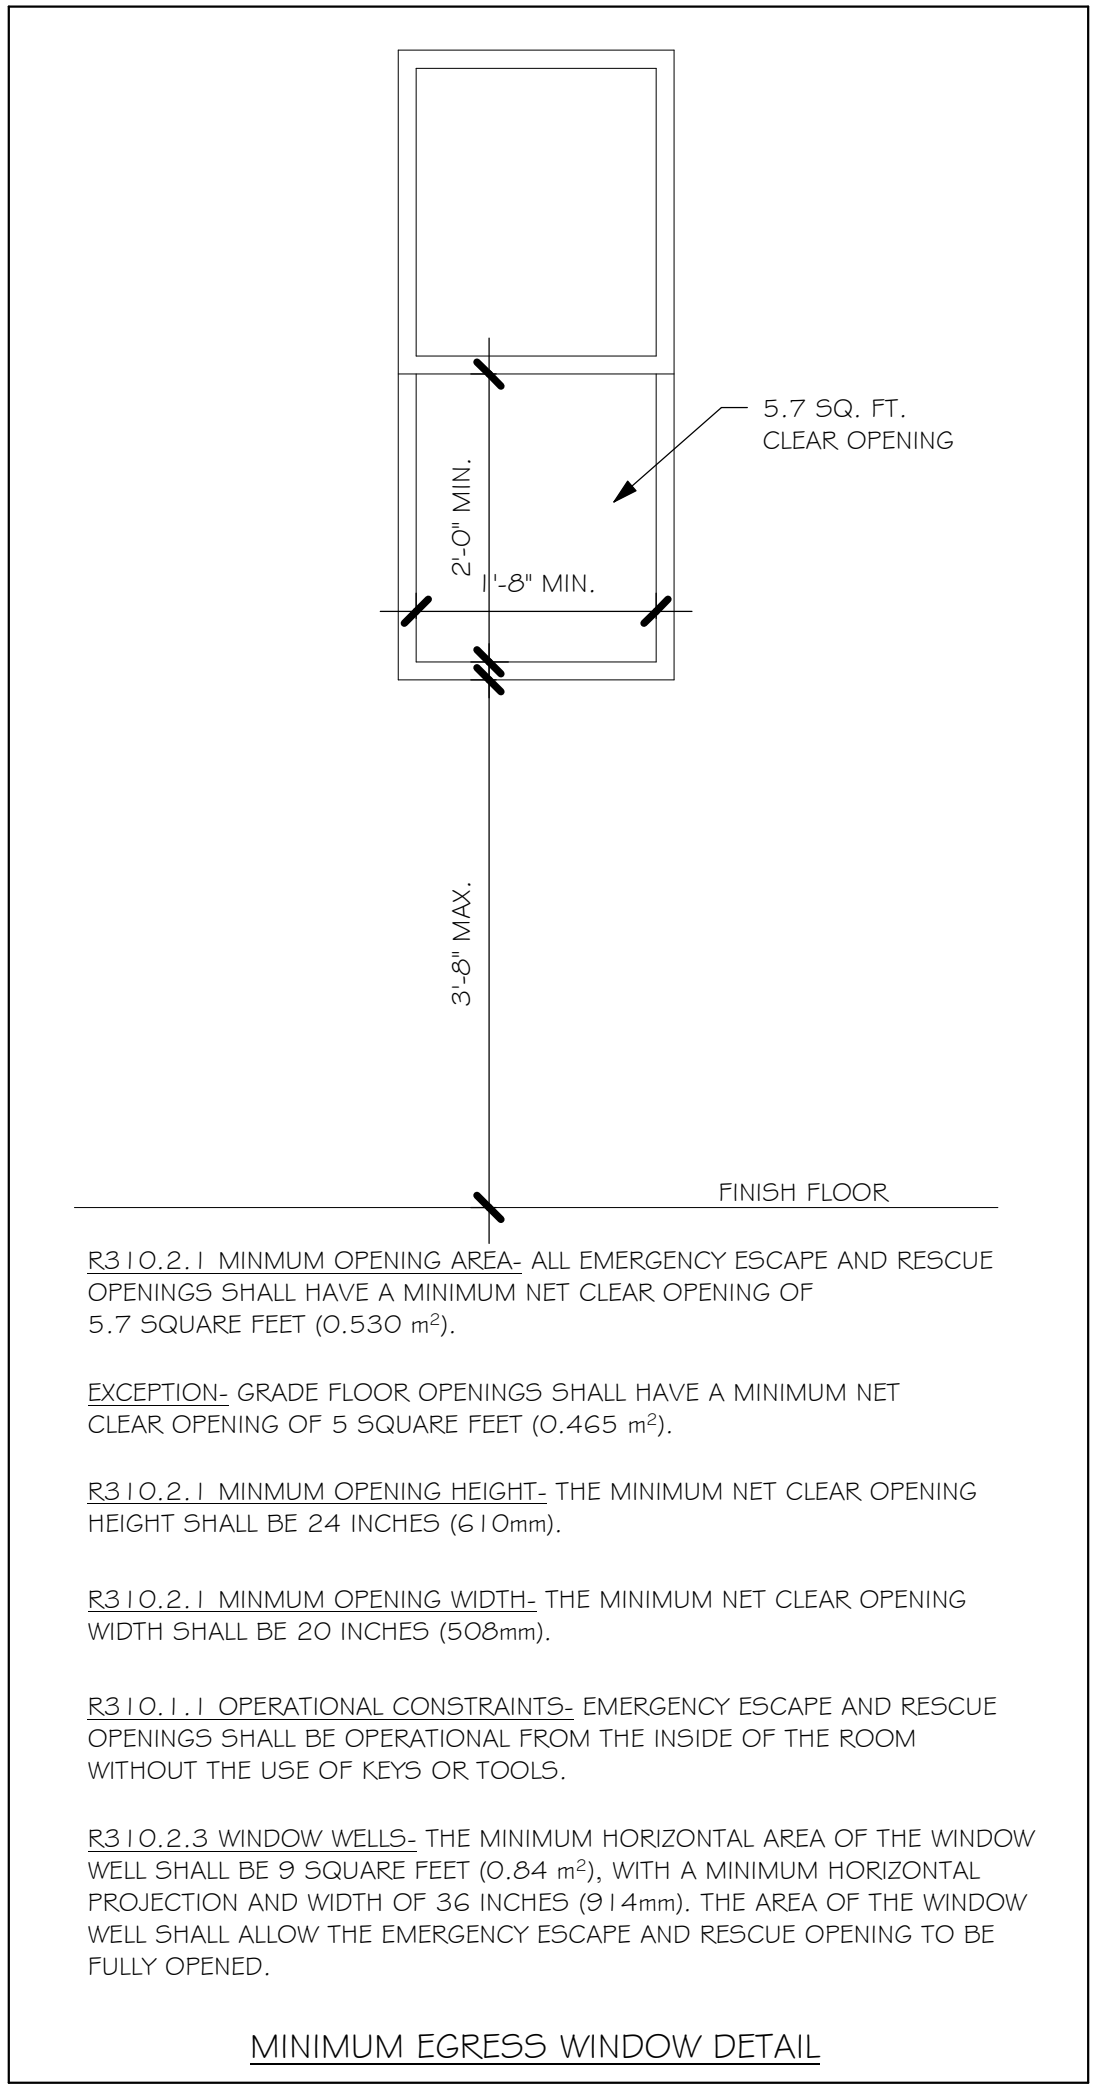

**R310.2.1 MINIMUM OPENING AREA:** ALL EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.530 m²).

**EXCEPTION:** GRADE FLOOR OPENINGS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5.7 SQUARE FEET (0.465 m²).

**R310.2.1 MINIMUM OPENING HEIGHT:** THE MINIMUM NET CLEAR OPENING HEIGHT SHALL BE 24 INCHES (610mm).

**R310.2.1 MINIMUM OPENING WIDTH:** THE MINIMUM NET CLEAR OPENING WIDTH SHALL BE 20 INCHES (508mm).

**R310.1.1 OPERATIONAL CONSTRAINTS:** EMERGENCY ESCAPE AND RESCUE OPENINGS SHALL BE OPERATIONAL FROM THE INSIDE OF THE ROOM WITHOUT THE USE OF KEYS OR TOOLS.

**R310.2.3 WINDOW WELLS:** THE MINIMUM HORIZONTAL AREA OF THE WINDOW WELL SHALL BE 9 SQUARE FEET (0.84 m²), WITH A MINIMUM HORIZONTAL PROJECTION AND WIDTH OF 36 INCHES (914mm). THE AREA OF THE WINDOW WELL SHALL ALLOW THE EMERGENCY ESCAPE AND RESCUE OPENING TO BE FULLY OPENED.





DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION











LOT: 1/8	BLOCK: 2291
SUBDIVISION: LABELLE HENDRY COUNTY	
ADDRES: 8025 MARSH CIRCLE	
D.R.H. #: 579920039	

MODEL # 1389 B	GCD JOB # 12099
DATE: 11/04/20	
DRAWN BY: JSL	
CHECKED BY: JWC	
REVISED:	
PLAN: SECTIONS	
SCALE: As indicated	
A-6	

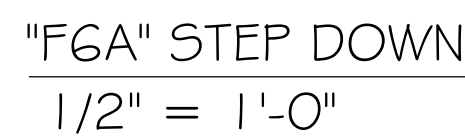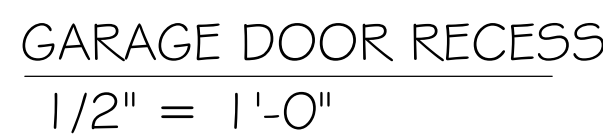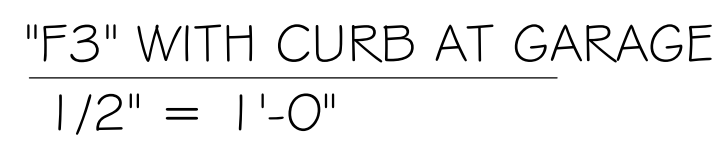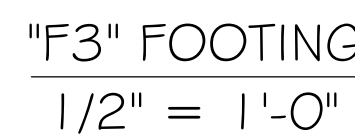




## WALL FOOTING SCHEDULE

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
	F1	CONT.	1'-4"	0'-8"	2#5	
	F2	CONT.	1'-8"	0'-10"	2#5	
X	F3	CONT.	1'-0"	1'-8"	2#5	
	F4	CONT.	1'-4"	1'-8"	2#5	
	F5	CONT.	1'-4"	1'-0"	2#5	
	F6	CONT.	1'-4"	1'-0"	2#5	
X	F&A	CONT.	0'-8"	0'-8"	1#5	
TE	TE	CONT.	0'-8"	0'-8"	1#5	

## FOUNDATION PLAN

3. PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
4. ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
5. FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
6. PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/ DOORS PER DETAIL 7/S-3.

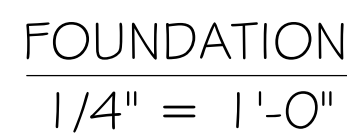

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL  
FLORIDA BUILDING CODE 2017 - 6TH EDITION



NOTES:

1. PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON C-OR-WALL.
2. CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
3. WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 105-3.

The diagram illustrates a cross-section of a precast lintel assembly. A vertical rod, labeled '#5 VERTICAL, ABOVE LINTEL ONLY WHERE NOTED ON PLAN', passes through the assembly. At the top, it is labeled 'WALL ABOVE WITH BOND BEAM AT TOP'. The rod extends through a section labeled 'GROUT SOLID'. Below the grout, the rod terminates in a hook, labeled '1" B' DENOTES 1" #5 BOTTOM WITH 7" HOOK EACH END OR EXTEND 24" BEYOND OPENING.'. The bottom of the assembly is a precast lintel, labeled '8" PRECAST LINTEL'. The lintel is shown with a cross-hatched pattern. Below the lintel, the text '0" B' DENOTES "NO REBAR"' is present. The lintel is labeled with '8" x 8" - 1B' and '8" x 8" - 0B'.

**8" PRECAST LINTEL**

**8" x 8" - 1B**  
**8" x 8" - 0B**


**PRECAST LINTEL SCHEDULE**

AT SWING DOORS, USE 2" RECESS STYLE LINTEL IF NEEDED FOR ROUGH OPENING.

LINTELS BEAR 4" MIN. EACH END


1. ROOF TRUSS BEARING @ 8'-0".
2. ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET 5-3.
3. PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
4. FOR NAILING OF ROOF AND FLOOR DECK, SEE I AND ON 5-3.
5. 8'-0" x 12'-0" PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
6. AT TRUSS BEARING, PROVIDE 8" x 8" MASONRY BOND BEAM W/ # 5 CONTINUOUS, SEE DETAIL I/5-3.

= BEARING @ 8'-0"

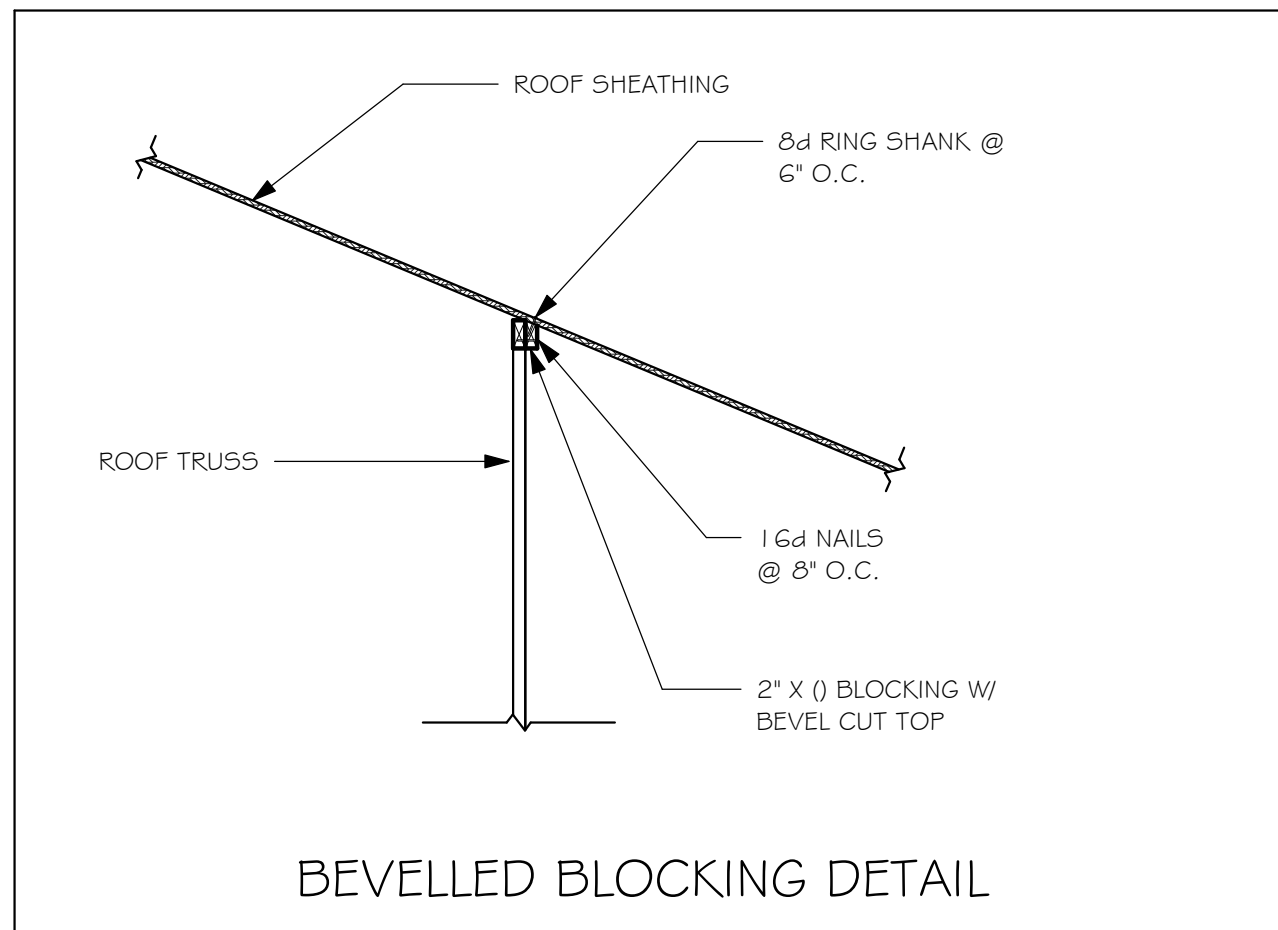

(+33.5, -36.3) WIND \_\_\_\_\_  
PRESSURES PER ASCE7-10, 1  
MPH, EXPOSURE C, AND  
CONVERTED TO ALLOWABLE  
STRESS DESIGN PRESSURES  
USING 0.6W LOAD FACTOR.  
( $V_{asd}$  = 124 MPH, RISK CAT II,  
ENCLOSED,  $k_d$  = 0.85,  $H$  = 15')

EMBED METAL G AT ALL  
TRUSSES, EXCEPT AS  
NOTED AT GIRDERS

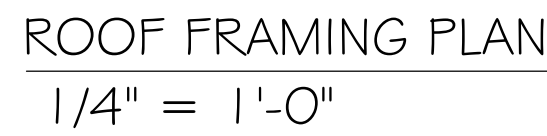

**Express**  
HOMES

**Gulf Coast**  
*Drafting & Design, Inc.*

EMAIL: [PLANS@GULFCOASTDRAFTING.COM](mailto:PLANS@GULFCOASTDRAFTING.COM)  
PHONE: 239-540-1822

1515 SE 47<sup>TH</sup> ST. CAPE CORAL, FL 33904

This signature seal is for work performed by the Structural Engineer of Record (SER) and is required by the State of Florida for all projects where the SER is in direct responsibility for the design of any discipline such as architectural, mechanical, plumbing, electrical, fire, life safety, accessibility, energy, site work, civil, or geotechnical.

**STRUCTURAL ENGINEERING**

**STRUCTURAL SYSTEMS OF NORTH FLORIDA**

1634 SE. 47th ST SUITE #3  
CAFE CORRAL, FL 33904  
(239) 549-4554  
CA# 8829

LOT: 18	BLOCK: 2291
SUBDIVISION: LABELLE HENDRY COUNTY	
ADDRESS: 8025 MARSH CIRCLE	
D.P.H. #: 579920039	

MODEL  
# 1389 B  
GCD JOB # 12099

DATE: \_\_\_\_\_

CHECKED BY: JWC


REVISÉ:

PLAN:  
ROOF FRAMING PLAN

SCALE: As indicated


S-2



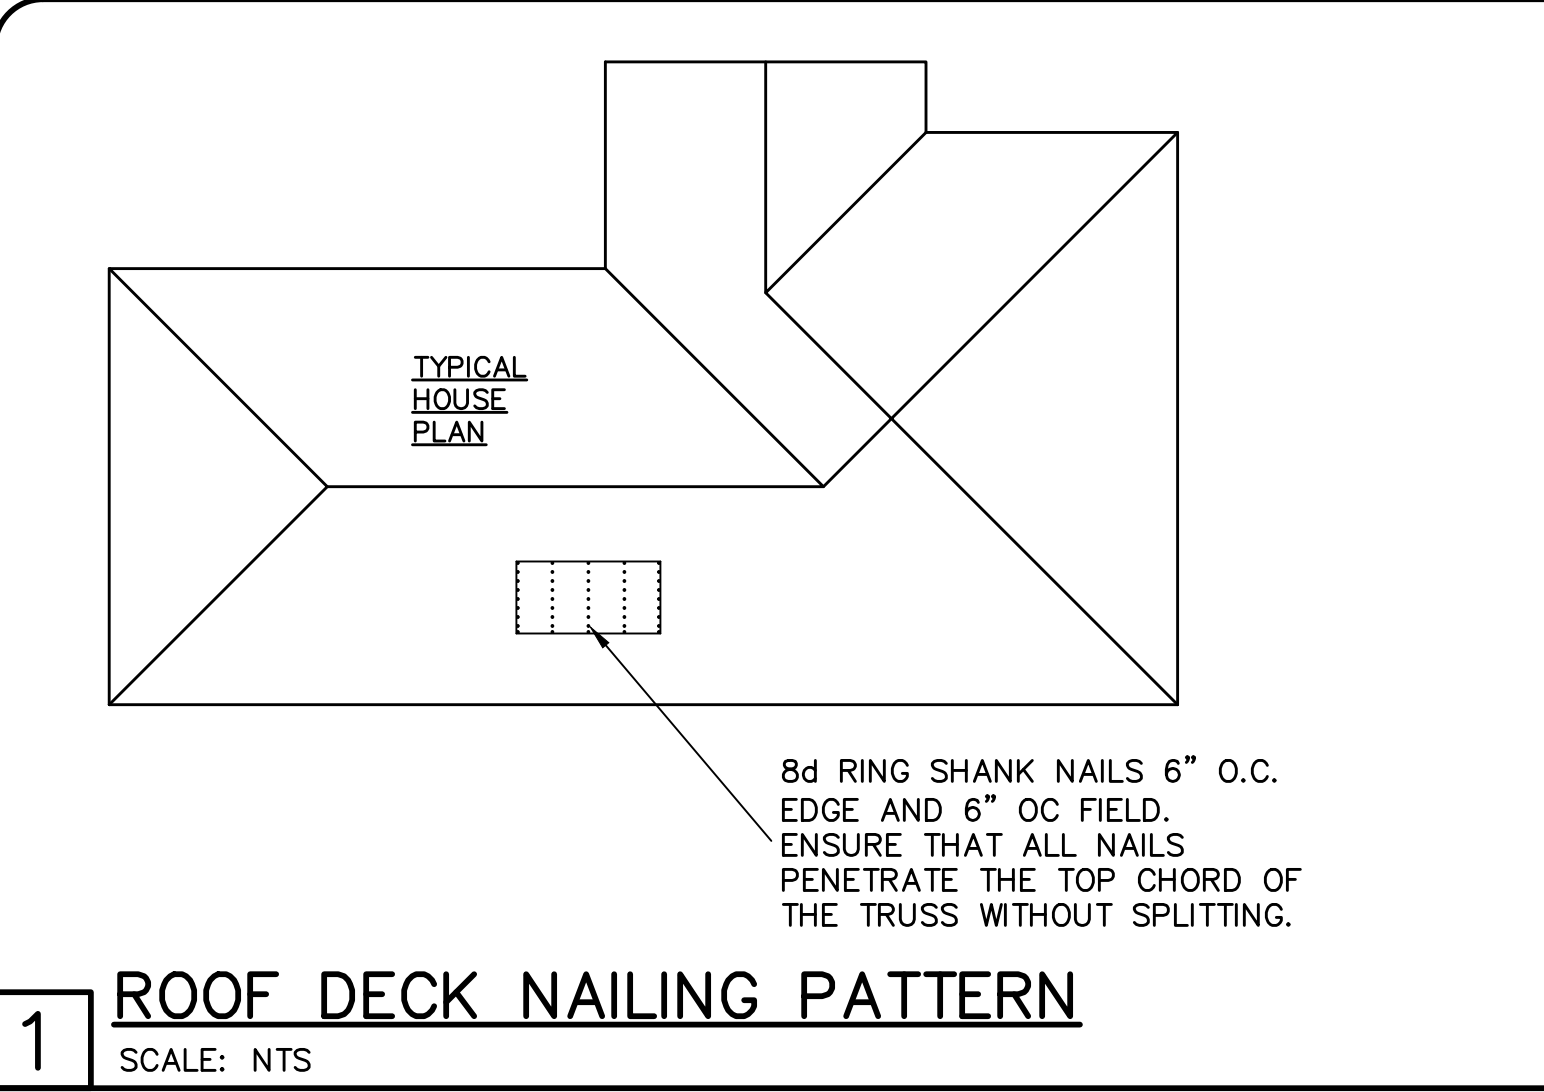


1 ROOF DECK NAILING PATTERN

SCALE: NTS

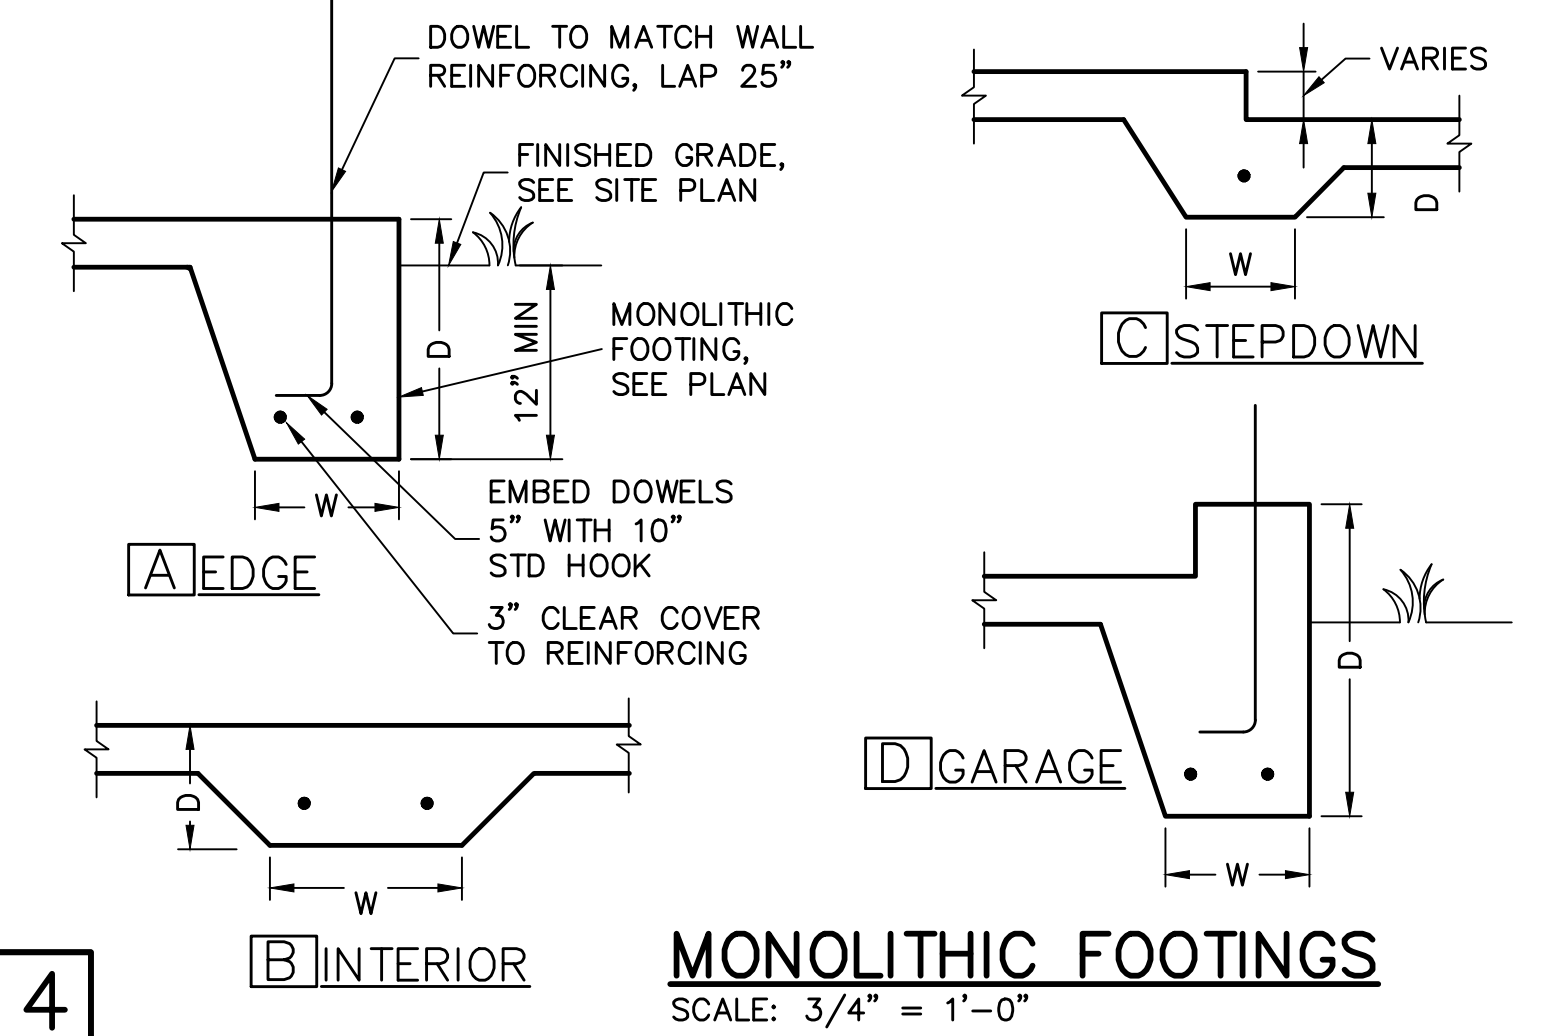

4

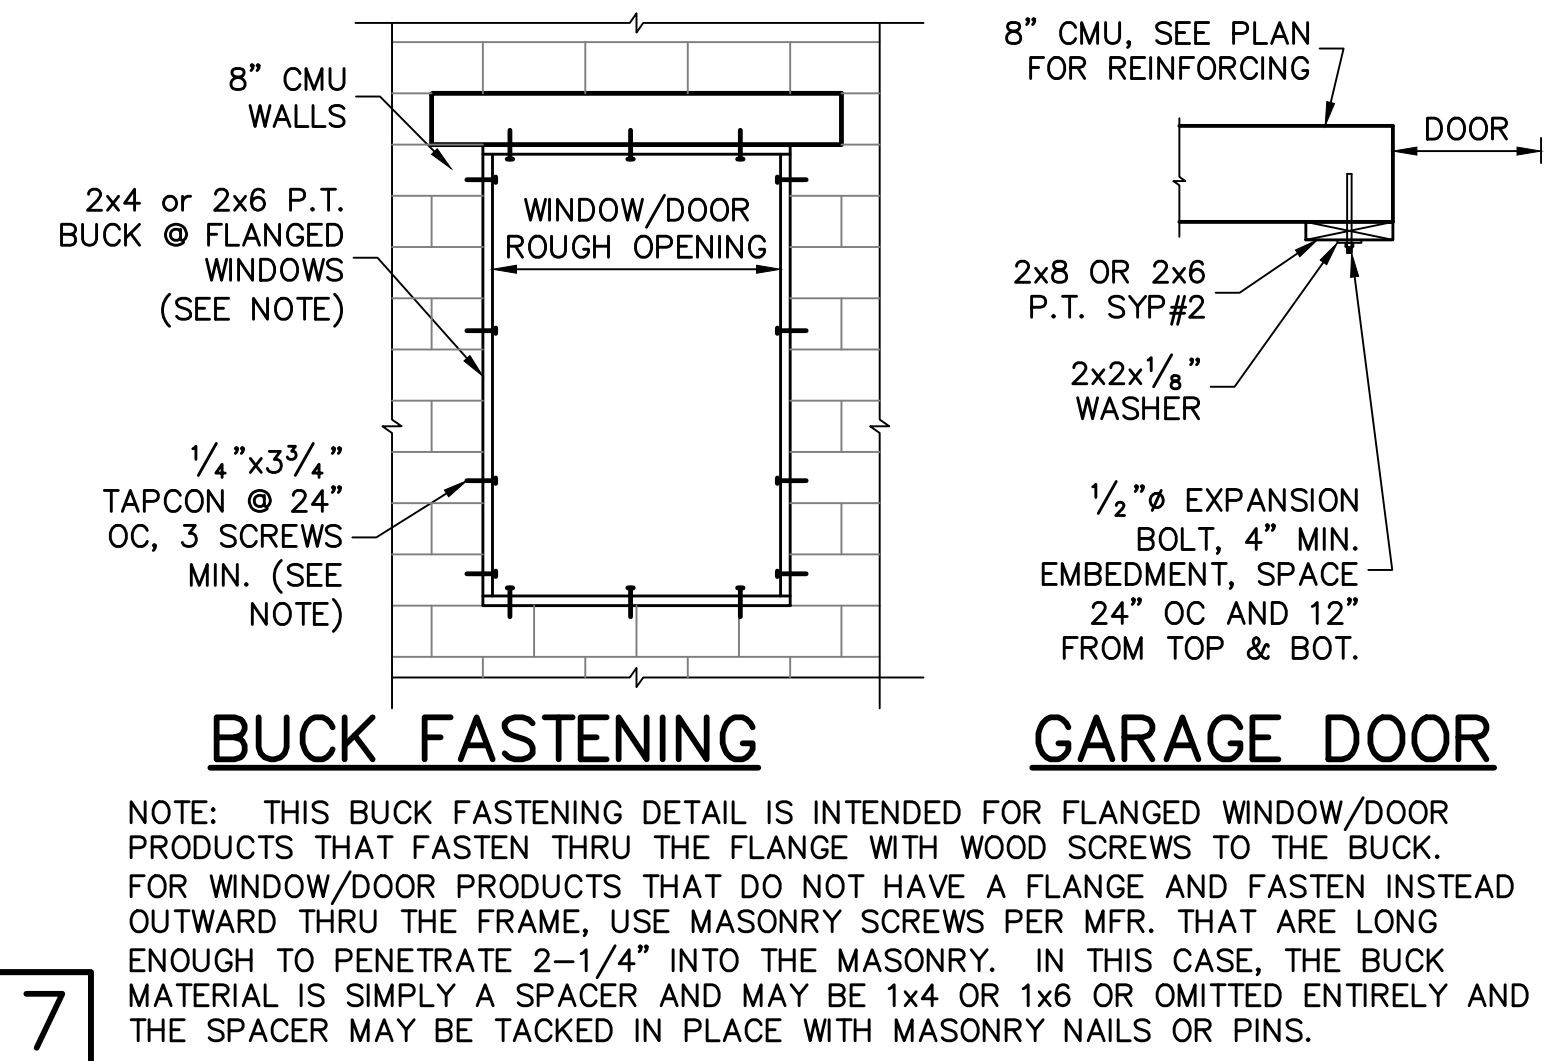

7

RETROFIT STRAPS TO CONCRETE/MASONRY		
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR	
TO 840	1-MTSM16 or 20	7-10dx1 1/2", 4-1/4"x2 1/4" TITEN
TO 1045	1-HTSM16 or 20	8-10dx1 1/2", 4-1/4"x2 1/4" TITEN
TO 2090	2-HTSM16 or 20	8-10dx1 1/2", 4-1/4"x2 1/4" TITEN
TO 4300	2-LGT2	16-16d, 7-1/4"x2 1/4" TITEN
TO 3480	HTT16	18-16d, 3/8" ALLTHREAD, DRILL & EPOXY 10" EMBED W/ SIMPSON SET.
TO 10530	HGT-2/3	TWO 3/4" ALTHREAD, DRILL & EPOXY 12" EMBED WITH SIMPSON SET.


NOTES:  
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.  
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

10 RETROFIT UPLIFT CONNECTOR SCHEDULE


SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
ROOF	EXTERIOR CEILING AND SOFFIT
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER. FASTEN WITH 8d RING SHANK NAILS @ 6" O.C. EDGE AND 6" O.C. FIELD.  (WHEN 1/2" ZIP BRAND ROOF SHEATHING IS USED, H-CLIPS ARE NOT REQUIRED)  (RING SHANK NAILS PER R803.2.3.1: 0.113" NOMINAL SHANK DIAMETER, RING DIA. OF 0.012" OVER SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER FULL ROUND HEAD, 2" NAIL LENGTH)	OPTIONS: 1) 1x4 STRIPPING @ 16"OC w/ 2-8d NAILS TO EACH TRUSS, 3/8" EXTERIOR GYPBOARD CEILING, FASTEN W/8d NAILS OR 1 5/8" DRYWALL SCREWS @ 6"OC EDGE & FIELD. 2) 3/8" BC PLYWOOD NAILED W/ 6d COMMON @ 6" OC EDGE & FIELD. 3) VINYL OR ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R703.1.2.1.

NOTE: EXTERIOR CEILINGS AND SOFFITS 1) AND 2) SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.2.1.


2

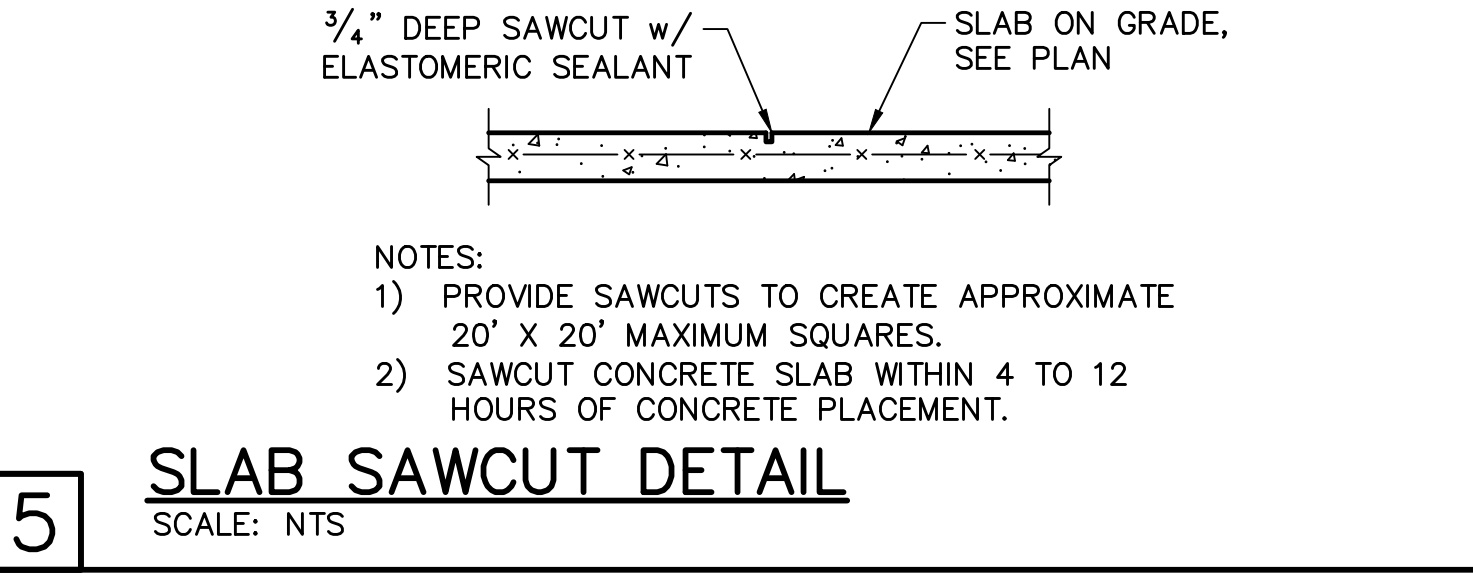

5

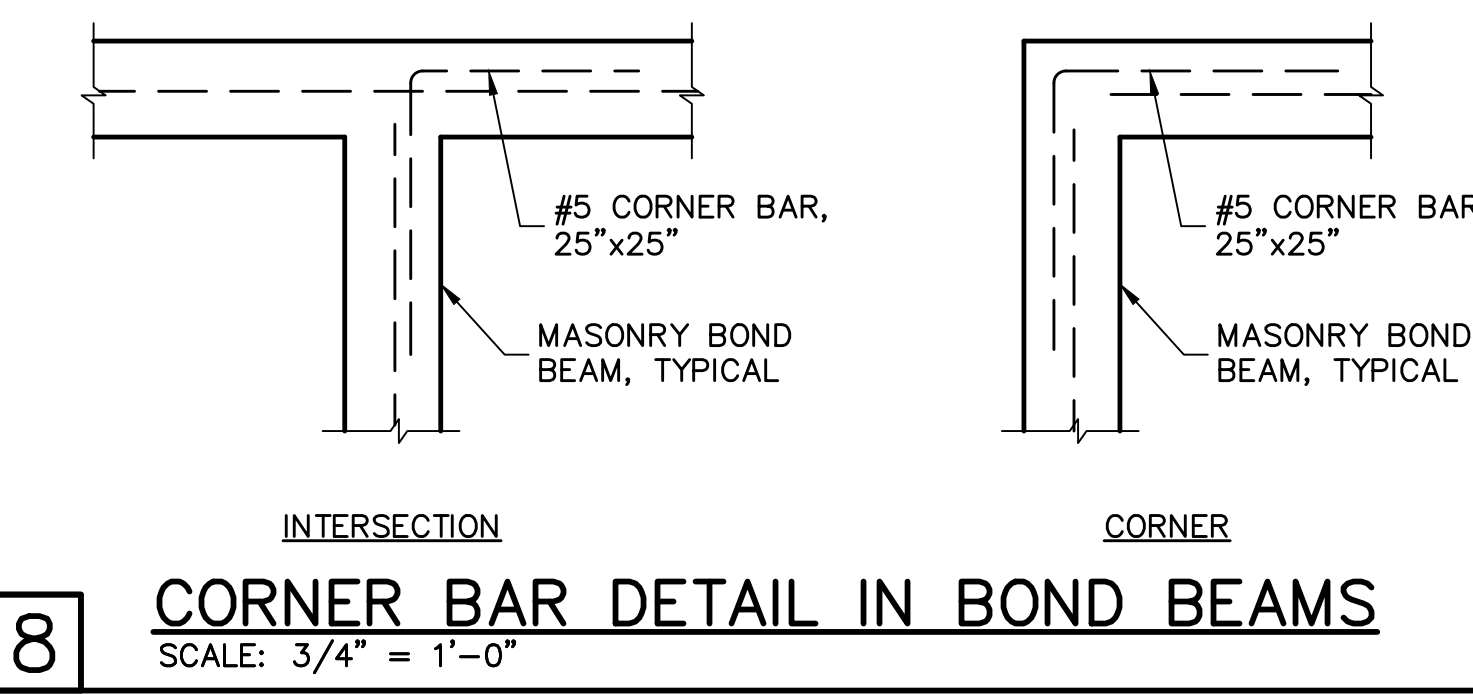


8

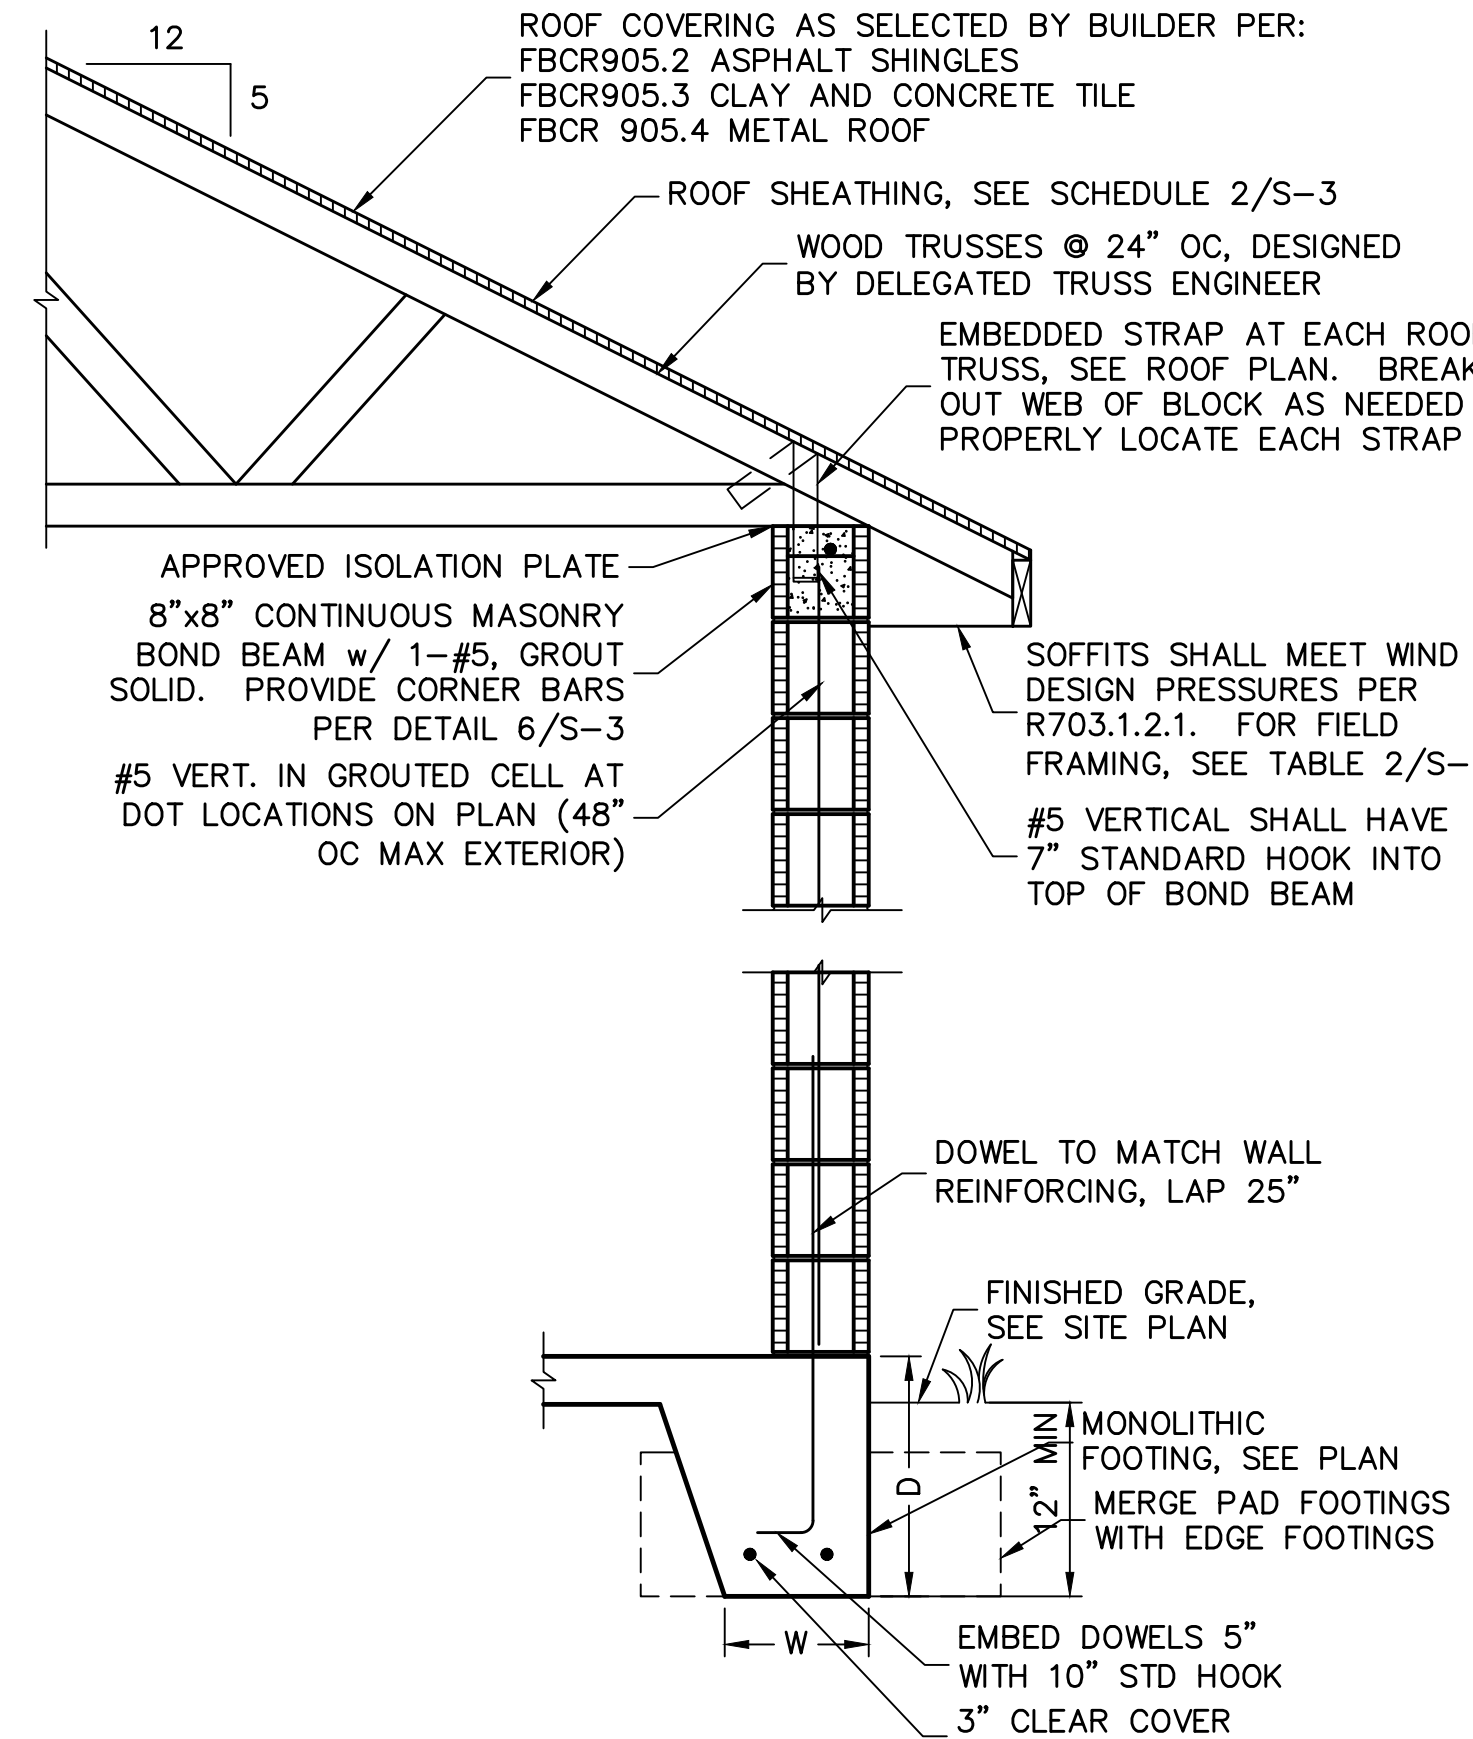


11 FULL HEIGHT WALL SECTION


SCALE: 3/4" = 1'-0"

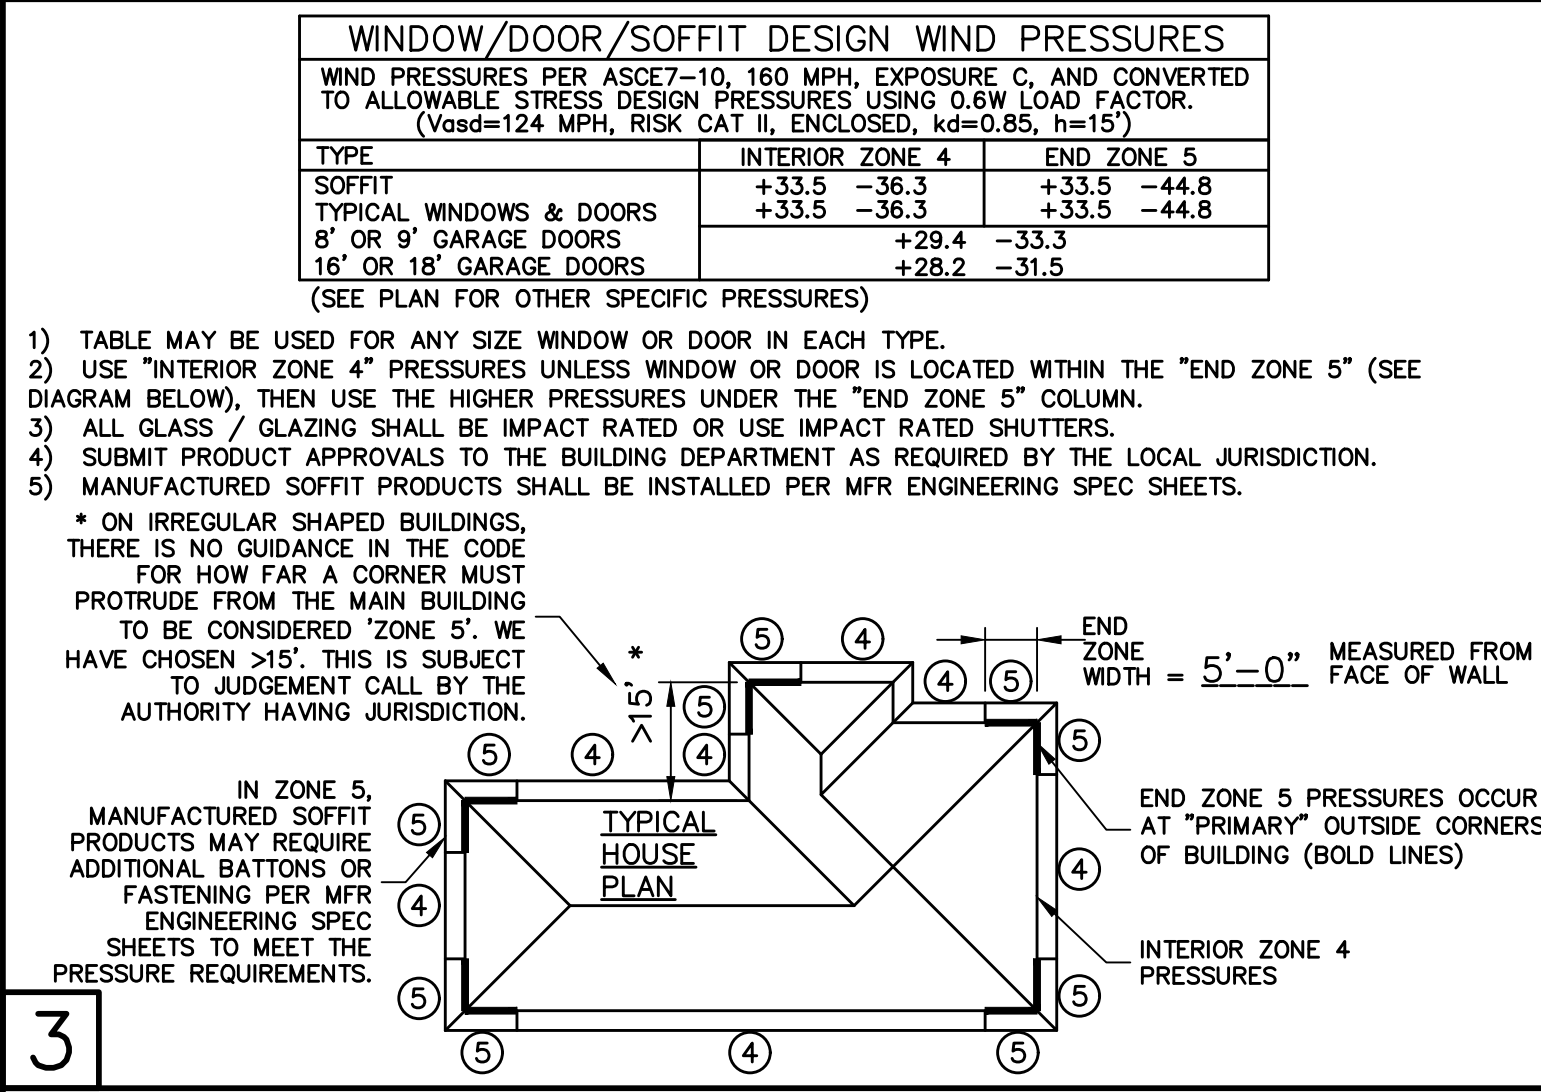


3

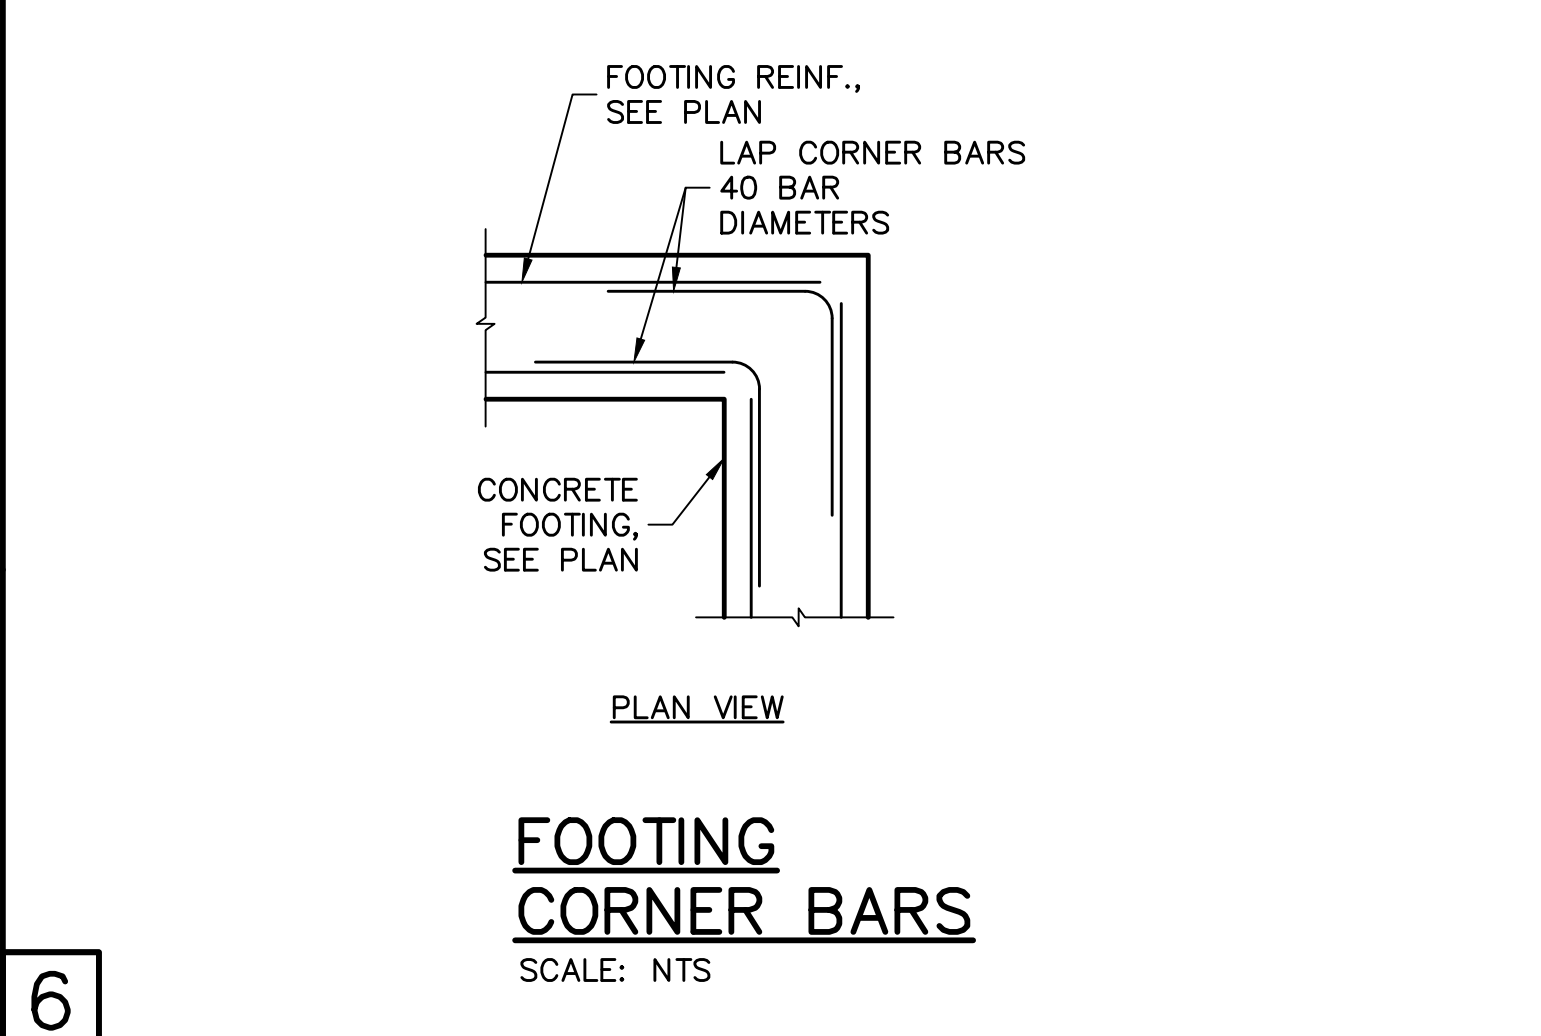

6

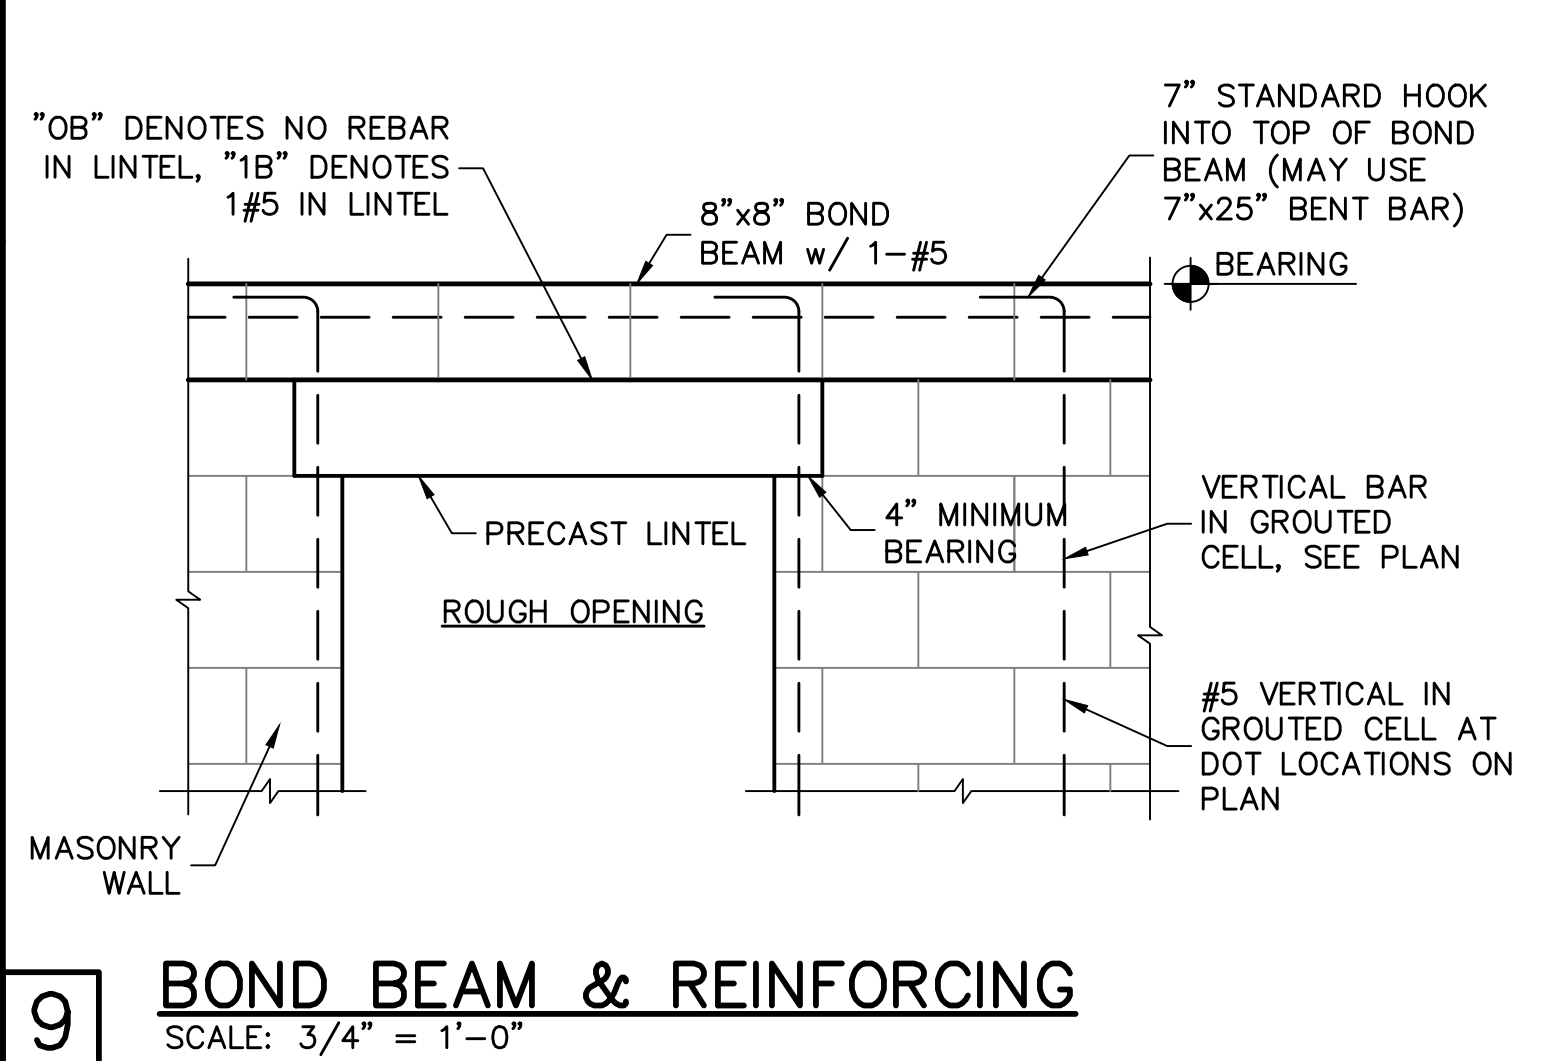

9

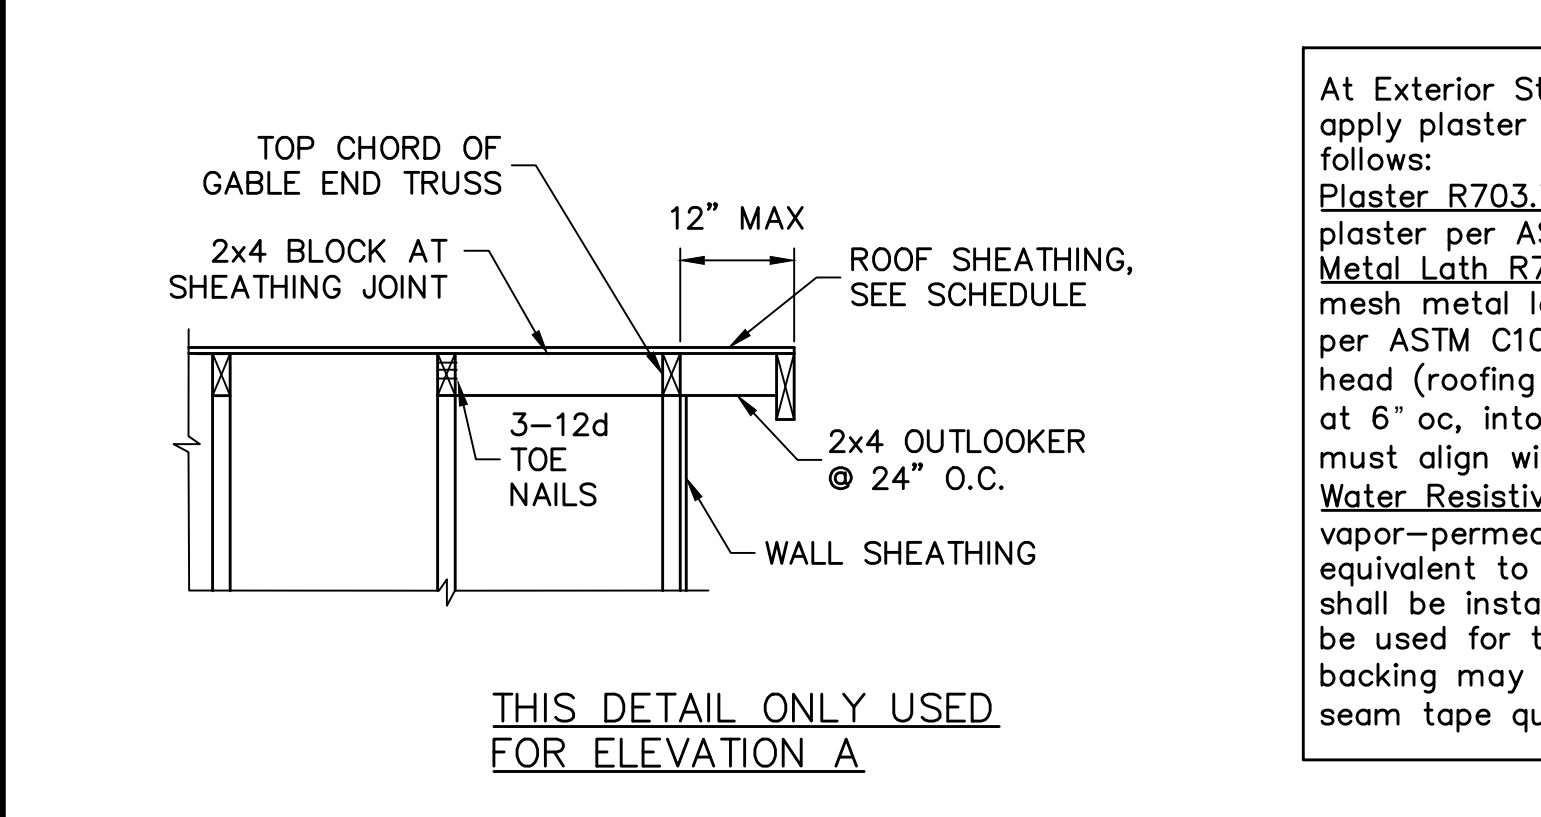

12 OUTLOOKER DETAIL

SCALE: N.T.S.

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

1. FLOOR & ROOF UNIFORM LOADS:  
ROOF: LIVE TOP CHORD 20 PSF  
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT W/ TOLL)  
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL  
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF  
DEFLECTION CRITERIA:  
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:  
WIND DESIGN PER, ASCE7-10  
BASIC WIND SPEED (ASCE7-10) 160 MPH  
NOMINAL WIND SPEED (Vwd TABLE R301.2.1.3) 124 MPH  
BUILDING CATEGORY II  
IMPORTANCE FACTOR 1.00  
EXPOSURE C  
MEAN ROOF HEIGHT = 15 FT  
ROOF PITCH 5/12  
ENCLOSURE CLASS. ENCLOSED  
INTERNAL PRES. COEFF. +/- 0.18  
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.  
SOFFITS - PER R703.1.2.1, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS.

3. REINFORCED CONCRETE:  
DESIGN AS PER ACI 318-14  
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:  
SLAB ON GRADE f'c = 2500 PSI  
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w/1.4xw/1.4 WWF OR FIBERESH.  
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI  
BEAMS AND COLUMNS f'c = 3000 PSI  
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI  
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:  
FOOTINGS 3" CENTERED  
SLAB ON GRADE 1 1/2"  
BEAMS 1 1/2"  
COLUMNS 1 1/2"  
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.  
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3 GRADE 60 FOR #4 TO #11  
WELDED WIRE FABRIC - ASTM A185  
SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.  
FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:  
DESIGN PER ACI 530-13  
REQUIRED COMPRESSIVE STRENGTHS:  
MASONRY WALLS f'm = 1500 PSI  
REINFORCING STEEL - ASTM A615 GRADE 60.  
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.  
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:  
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:  
CONVENTIONAL SHALLOW CONCRETE FOOTINGS  
SOIL BEARING CAPACITY  
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

REVISIONS	BY

STRUCTURAL ENGINEERING:  
**STRUCTURAL SYSTEMS OF NORTH FLORIDA**  
1634 S.E. 47th STREET, SUITE #3  
CAPE CORAL, FL 33904  
(239) 549-4554  
CA # 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 6th EDITION (2017) RESIDENTIAL

BUILDER:  
**D.R. HOOTON**  
*America's Builder*

STRUCTURAL DETAILS  
MODEL 1389 EXPRESS B  
8025 MARSH CIRCLE  
LABELLE, FLORIDA  
LOT: 18 BLOCK: 2291  
SUBDIVISION: LABELLE HENDRY COUNTY

DESIGN/DRAWN DWB/DWB
CHECKED DWB
DATE 11/4/20
SCALE VARIES
JOB NO. DR 12099
SHEET S-3
SHEET 3 OF 3

FOR SCOSTA TRUSSES, ELEVATION B, JOB # 44115BL, DATED 12/12/19, REVISED: NONE