



Community Development Department

18400 Murdock Circle, Port Charlotte, FL 33948
Building Phone: 941.743.1201 | Building Fax: 941.764.4907
Zoning Phone: 941.743.1964 | Zoning Fax: 941.743.1598
BuildingSvcs@CharlotteCountyFL.gov
www.CharlotteCountyFL.gov

For Office Use Only

Permit Number

20 _____

Application Date

CSR Initials _____

ONE AND TWO FAMILY DWELLING DATA SUMMARY SHEET

Florida Building Code 7th Edition (2020)

OWNER'S NAME: D. R. Horton, Inc CONTRACTOR'S NAME: D. R. Horton, Inc

PROJECT ADDRESS: Lot 434 7040 West Lenox Cir, Punta Gorda, FL 33950
Number & Street City, State, & Zipcode

Applicable Codes: Building, Mechanical, Plumbing, Accessibility, & Energy Codes - 7th Edition (2020) Florida Building Code, Residential Volume. Electrical Code - NFPA 70 & NEC 2017

Manufacturer's Product Approvals

Doors: See Attached Overhead Doors: See Attached Windows: See Attached

Mitered Glass: See Attached Roof Coverings: See Attached **Protection of Openings:**

Soffit: See Attached Siding: See Attached Shutters: See Attached

Method of Design per Florida Building Code (FBC) R301:

☒ Florida Building Code, 7th Ed (2020) ☐ ICC 600 ☐ Other: _____

Designer's Name: Structural Systems of N. Florida Inc.

Design Data (Risk Category II):

Basic Wind Speed (Vult) 160 mph (Figure R301.2(4))

Nominal Design Wind Speed (Vasd) 124 m.p.h. Flood Design Data N/A Final Floor Elevation See Site Plan

Exposure Category Section (R301.2.1.4) ☐ B ☒ C ☐ D Soil Design Load-Bearing Value 2000 PSF

Structural Forces (Section R301.4 / 301.5 / 3601.6)

Floor Design: Live Load 40 p.s.f. Dead Load Slab on Grade p.s.f.

Roof Design: Live Load 20 p.s.f. Dead Load TC=20 BC=10 p.s.f. Roof Slope 5:12

Window and Door Wind Pressure Design Loading: Mean roof height 15 ft Pressures are worst case only. See plan for actual.
Windows +33.5/-44.8 p.s.f. Doors +33.5/-44.8 p.s.f. Garage Doors +29.4/-33.3 p.s.f.

Components and Cladding Design Pressures:

Zone 1: 24.9/-44.8 p.s.f. Zone 2: +24.9/-61.7 p.s.f. Zone 3: +24.9/-61.7 p.s.f. Zone 4: 33.5/-36.3 p.s.f. Zone 5: 33.5/-44.8 p.s.f.

Area Tabulation:

TOTAL (Sq. Ft.): 2,057

Living (Sq. Ft.) 1,503 Garage (Sq. Ft.) 391 Lanai (Sq. Ft.) 143


Entry (Sq. Ft.) 20 Storage (Sq. Ft.) _____ Other (Sq. Ft.) _____

I certify to the best of my knowledge and belief that these plans and specifications have been designed to comply with the structural portion of the Building Code for wind, flood and gravity loads as amended and enforced by the permitting jurisdiction.

Signature: _____ Date: _____

Designer's Printed Name: _____

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

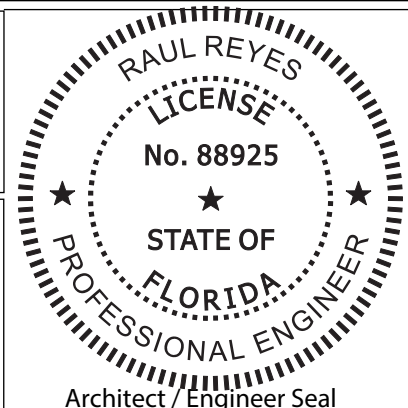



Community Development Department

18400 Murdock Circle, Port Charlotte, FL 33948
Building Phone: 941.743.1201 | Building Fax: 941.764.4907
Zoning Phone: 941.743.1964 | Zoning Fax: 941.743.1598
BuildingSvcs@CharlotteCountyFL.gov
www.CharlotteCountyFL.gov

For Office Use Only

Permit Number

20 _____

Application Date

CSR Initials _____

ONE AND TWO FAMILY DWELLING DATA SUMMARY SHEET

Florida Building Code 7th Edition (2020)

OWNER'S NAME: D. R. Horton, Inc CONTRACTOR'S NAME: D. R. Horton, Inc

PROJECT ADDRESS: Lot 435 7032 West Lenox Cir, Punta Gorda, FL 33950
Number & Street City, State, & Zipcode

Applicable Codes: Building, Mechanical, Plumbing, Accessibility, & Energy Codes - 7th Edition (2020) Florida Building Code, Residential Volume. Electrical Code - NFPA 70 & NEC 2017

Manufacturer's Product Approvals

Doors: See Attached Overhead Doors: See Attached Windows: See Attached

Mitered Glass: See Attached Roof Coverings: See Attached Protection of Openings:

Soffit: See Attached Siding: See Attached Shutters: See Attached

Method of Design per Florida Building Code (FBC) R301:

☒ Florida Building Code, 7th Ed (2020) ☐ ICC 600 ☐ Other: _____

Designer's Name: Structural Systems of N. Florida Inc.

Design Data (Risk Category II):

Basic Wind Speed (Vult) 160 mph (Figure R301.2(4))

Nominal Design Wind Speed (Vasd) 124 m.p.h. Flood Design Data N/A Final Floor Elevation See Site Plan

Exposure Category Section (R301.2.1.4) ☐ B ☒ C ☐ D Soil Design Load-Bearing Value 2000 PSF

Structural Forces (Section R301.4 / 301.5 / 3601.6)

Floor Design: Live Load 40 p.s.f. Dead Load Slab on Grade p.s.f.

Roof Design: Live Load 20 p.s.f. Dead Load TC=20 BC=10 p.s.f. Roof Slope 5:12

Window and Door Wind Pressure Design Loading: Mean roof height 15 ft Pressures are worst case only. See plan for actual.
Windows +33.5/-44.8 p.s.f. Doors +33.5/-44.8 p.s.f. Garage Doors +29.4/-33.3 p.s.f.

Components and Cladding Design Pressures:

Zone 1: 24.9/-44.8 p.s.f. Zone 2: +24.9/-61.7 p.s.f. Zone 3: +24.9/-61.7 p.s.f. Zone 4: 33.5/-36.3 p.s.f. Zone 5: 33.5/-44.8 p.s.f.

Area Tabulation:

TOTAL (Sq. Ft.): 2,057

Living (Sq. Ft.) 1,503 Garage (Sq. Ft.) 391 Lanai (Sq. Ft.) 143


Entry (Sq. Ft.) 20 Storage (Sq. Ft.) _____ Other (Sq. Ft.) _____





I certify to the best of my knowledge and belief that these plans and specifications have been designed to comply with the structural portion of the Building Code for wind, flood and gravity loads as amended and enforced by the permitting jurisdiction.

Signature: _____ Date: _____

Designer's Printed Name: _____

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

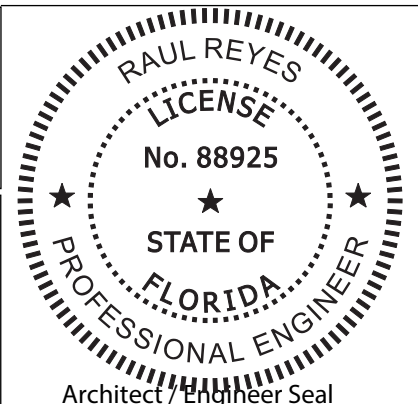


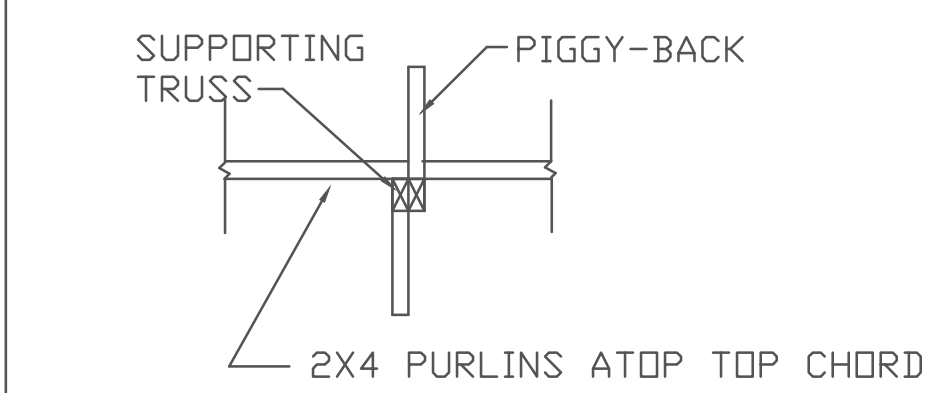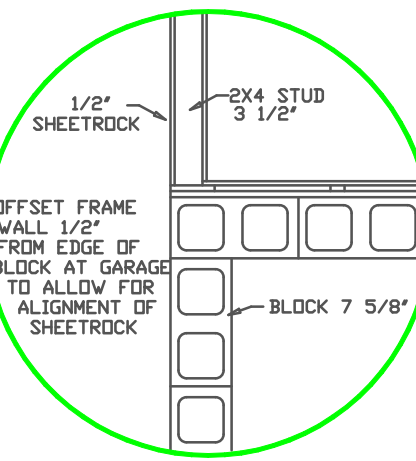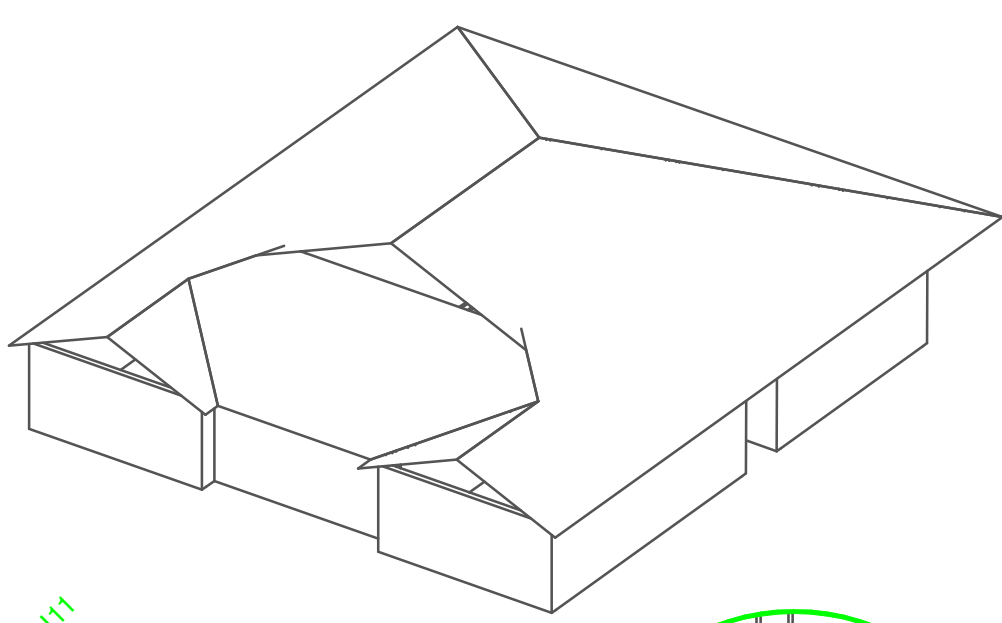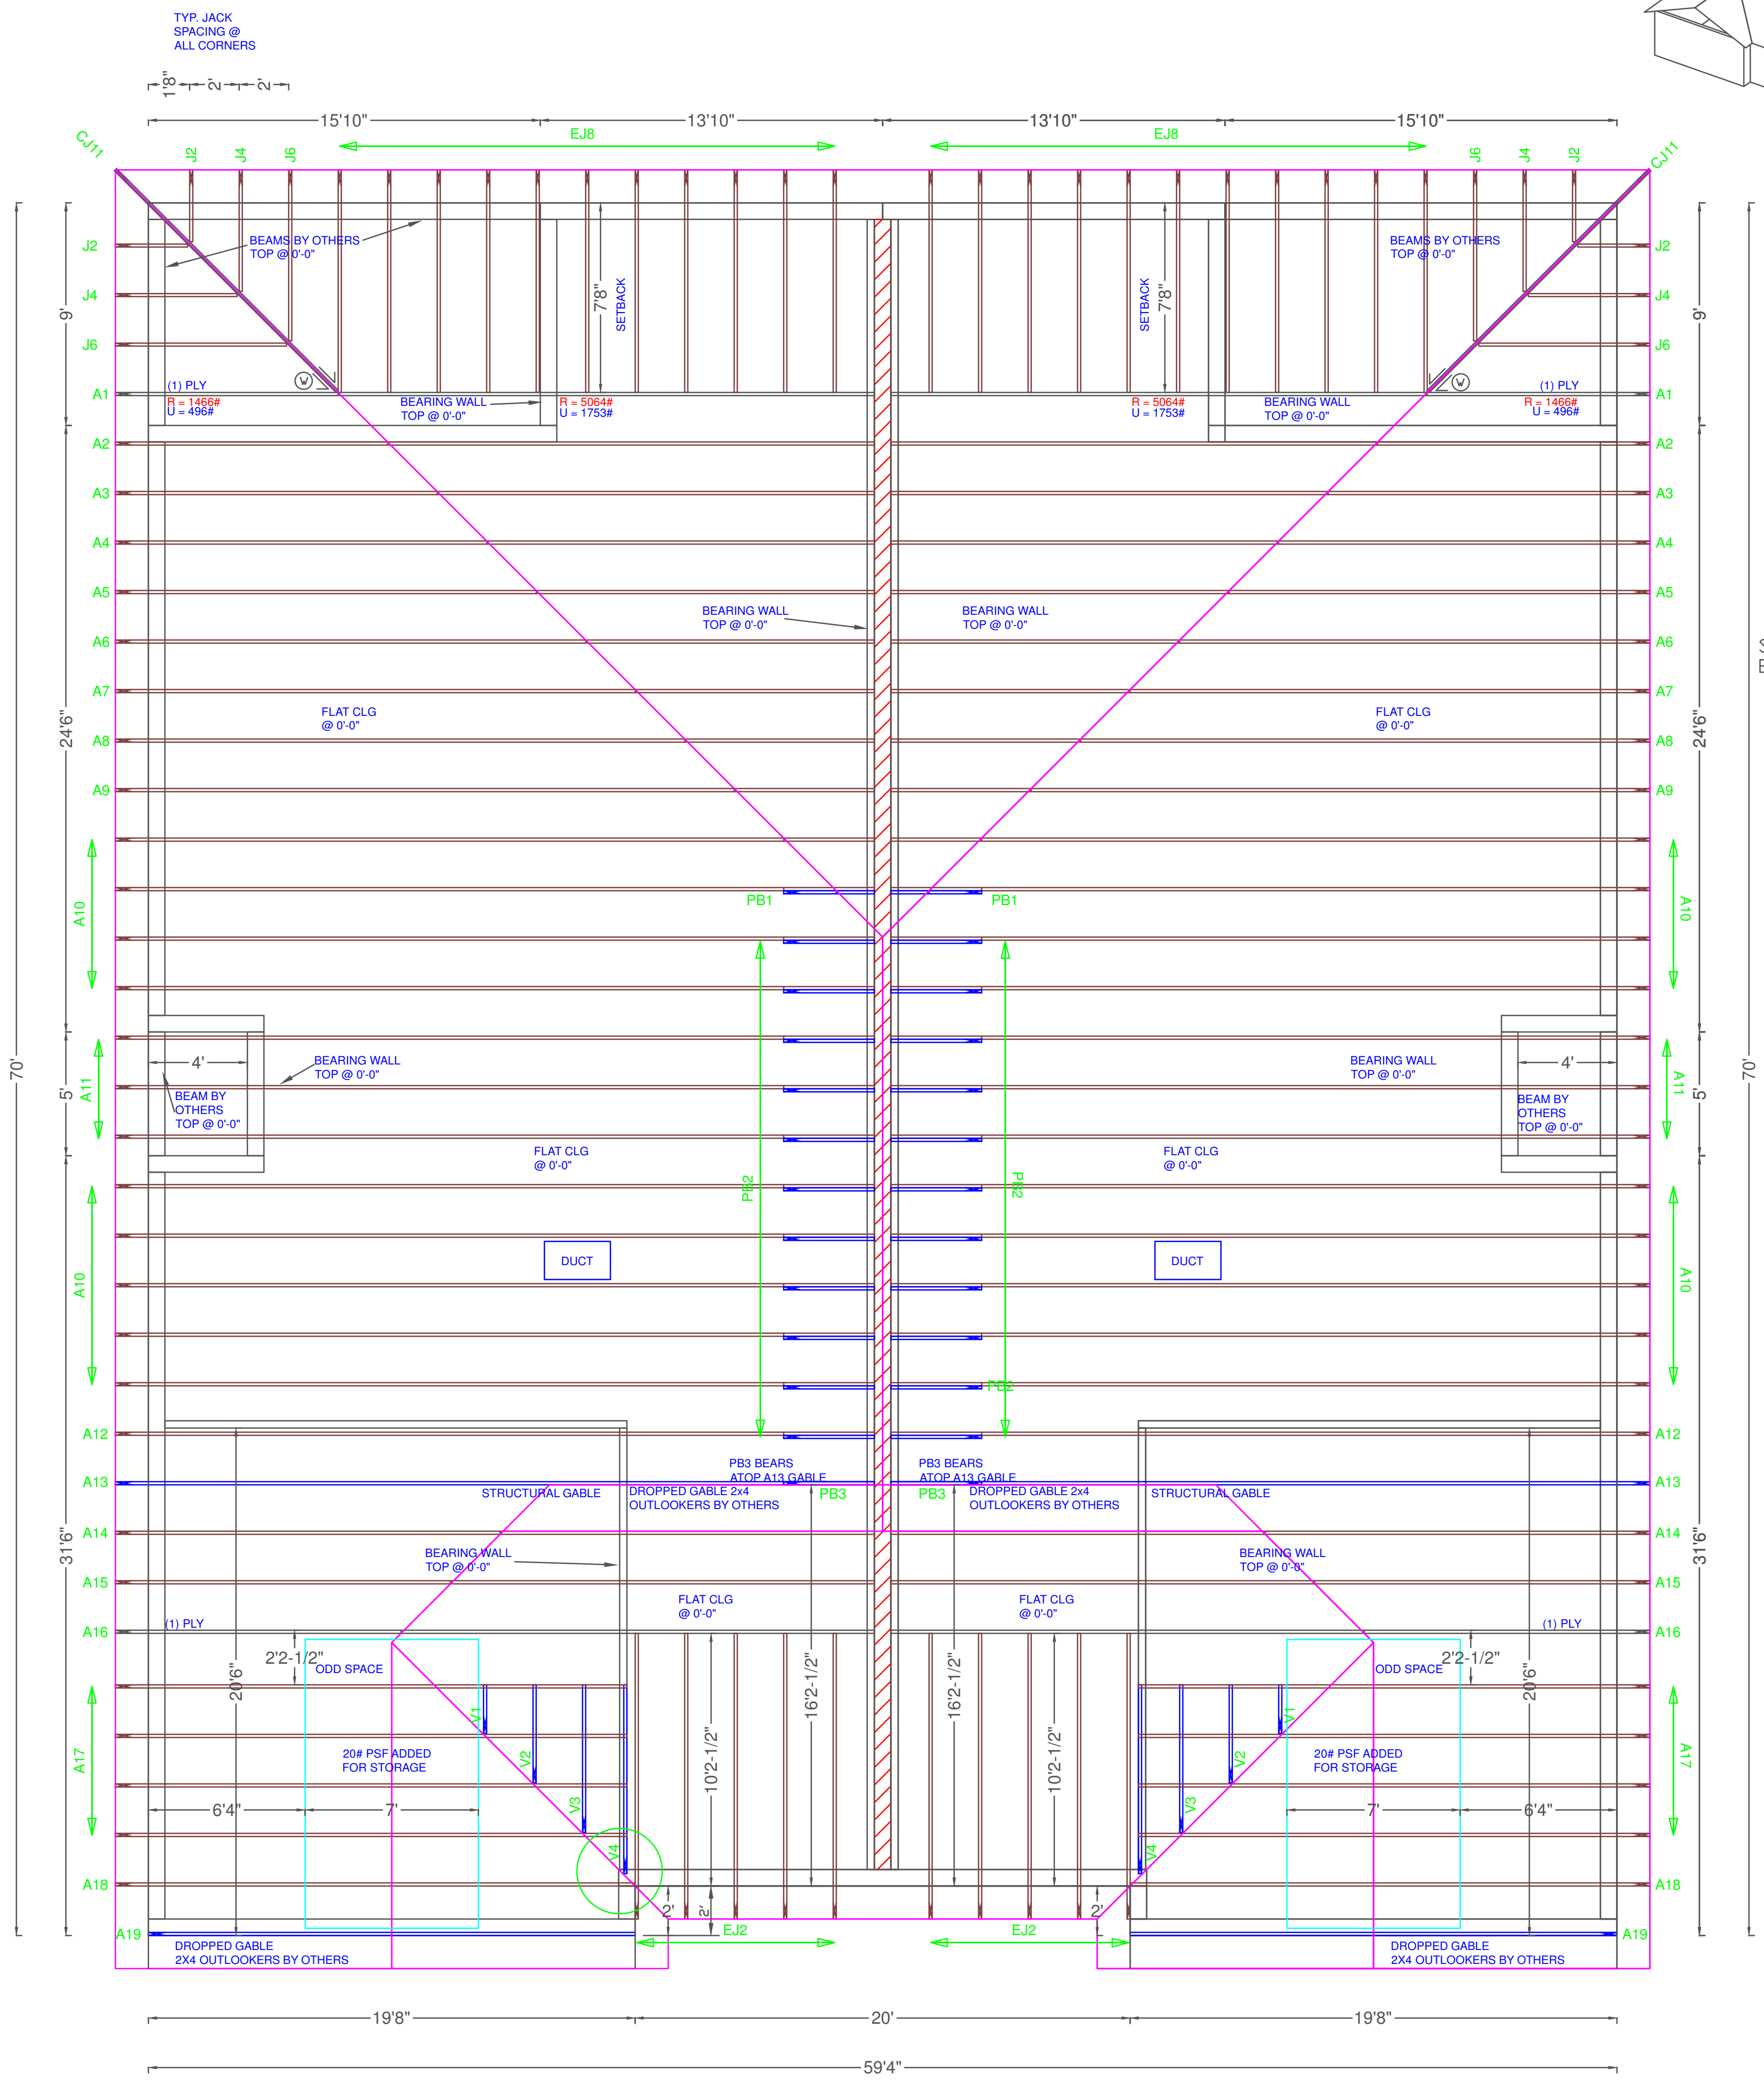

SEE SUPPORTING TRUSS & PIGGY-BACK ENGINEERING FOR ADDITIONAL INFORMATION

SCAB PIGGY-BACK DETAIL

TYPICAL JACK CUTS

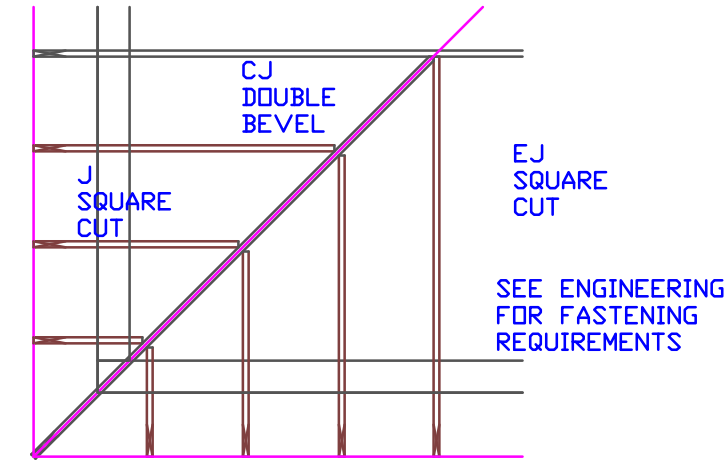

DESIGN CRITERIA

TOP CHORD LIVE LOAD	20
TOP CHORD DEAD LOAD	20
BOTTOM CHORD LIVE LOAD NON-CONCURRENT	10#
BOTTOM CHORD DEAD LOAD	10
TOTAL LOAD	50
DURATION FACTOR	1.25
WIND DESIGN SPEED (MPH)	160
ASCE 7-16 CAT II EXPOSED MVFRS	
CLOSED	FBC 2020
MAX. WALL HT FOR WIND LOAD	8'-8"

TILE

****UNLESS NOTED****
REACTION VALUES ARE UNDER 5000#
UPLIFT VALUES ARE UNDER 1000#

ALL TRUSSES 24'o.c. UNLESS NOTED OTHERWISE

*******CAUTION*******

DO NOT ATTEMPT TO ERECT TRUSSES WITHOUT REFERRING TO THE ENGINEERING DWGS.

IT IS NECESSARY TO REFER TO THE ENGINEERING DRAWINGS FOR NUMBER OF MEMBERS, BEARING LOCATION, ORIENTATION AND WEB BRACING

REFER TO WTCA/TPI BSCI-B1 SUMMARY SHEET FOR HANDLING METHODS & TEMPORARY BRACING, WHICH IS ALWAYS REQUIRED

BEARING HEIGHTS BASED ON PLANS PROVIDED TO SCOSTA CORP. +/- BEARING DIFFERENCES SHOWN ARE CRITICAL. IF ANY HEIGHTS DEVIATE - INFORM SCOSTA CORP.

BEARING WALL & BEAM HEIGHTS

8'-8" A.F.F.	0'-0" ELEV.
RAKED BEAM	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.
	ELEV.

TYPICAL HANGER SCHEDULE

(C) SIMPSON HUS 26	(M) SIMPSON HGUS 28-3
(F) SIMPSON HUS 28	(N) SIMPSON HHUS 48
(H) SIMPSON HGUS 28	(P) SIMPSON LUS 24
(I) SIMPSON HGUS 28-2	(B) SIMPSON THA 422
(W) SIMPSON THJA26	(X)

HANGER VALUES HAVE BEEN BASED ON 16D COMMON NAILS EXCEPT THE FOLLOWING:
LUS24 - 10D COMMON THJA26 - 10D x 1-1/2

*******ATTENTION*******

APPROVAL OF THIS TRUSS LAYOUT IS NECESSARY BEFORE FABRICATION CAN BEGIN. VERIFY DIMENSIONS, PITCHES, OVERHANGS, ELEVATIONS, CEILING & BEARING CONDITIONS. SCOSTA CORPORATION IS RESPONSIBLE FOR ACCURACY IN ACCORDANCE WITH PLANS AND/OR INFORMATION PROVIDED BY CUSTOMER, WITH ANY DEVIATIONS NOTED HEREIN. CUSTOMER IS RESPONSIBLE TO VERIFY ACCURACY OF INFORMATION AND PLANS PROVIDED TO SCOSTA CORPORATION, AND TO VERIFY CONFORMANCE TO FIELD CONDITIONS, AND/OR OWNER CHANGES WILL BE BUILT IN ACCORDANCE WITH THE APPROVED LAYOUT.

APPROVED BY: _____
DATE: _____ REQUESTED DELIVERY DATE: _____
JOBSITE CONTACT NAME: _____
PHONE #: _____
E-MAIL: _____

SCOSTA CORP.

WOOD, STEEL OR TIMBER
ROOF & FLOOR TRUSSES


3670 COMMERCE CENTER DRIVE
SEBRING, FL 33870
(863) 385-8242

SCALE: 1/4"=1'-0"	DATE: 11/24/20	REVISED BY:	DRAWN BY: KD
JOB ADDRESS: 1498 TWIN VILLA		1 OF 1	
CUSTOMER: D.R. HORTON		JOB #: DR1498	

Engineer of Record for the Structure
Structural Systems of N. Fl, Inc.
Raul Reyes, PE 88925
1634 SE 47th Street #3
Cape Coral, FL 33904

This document has been reviewed for conformance with the design intent of the structure and specified design criteria.


☒ Accepted As-Is ☐ Accepted As Noted ☐ Revise and Resubmit

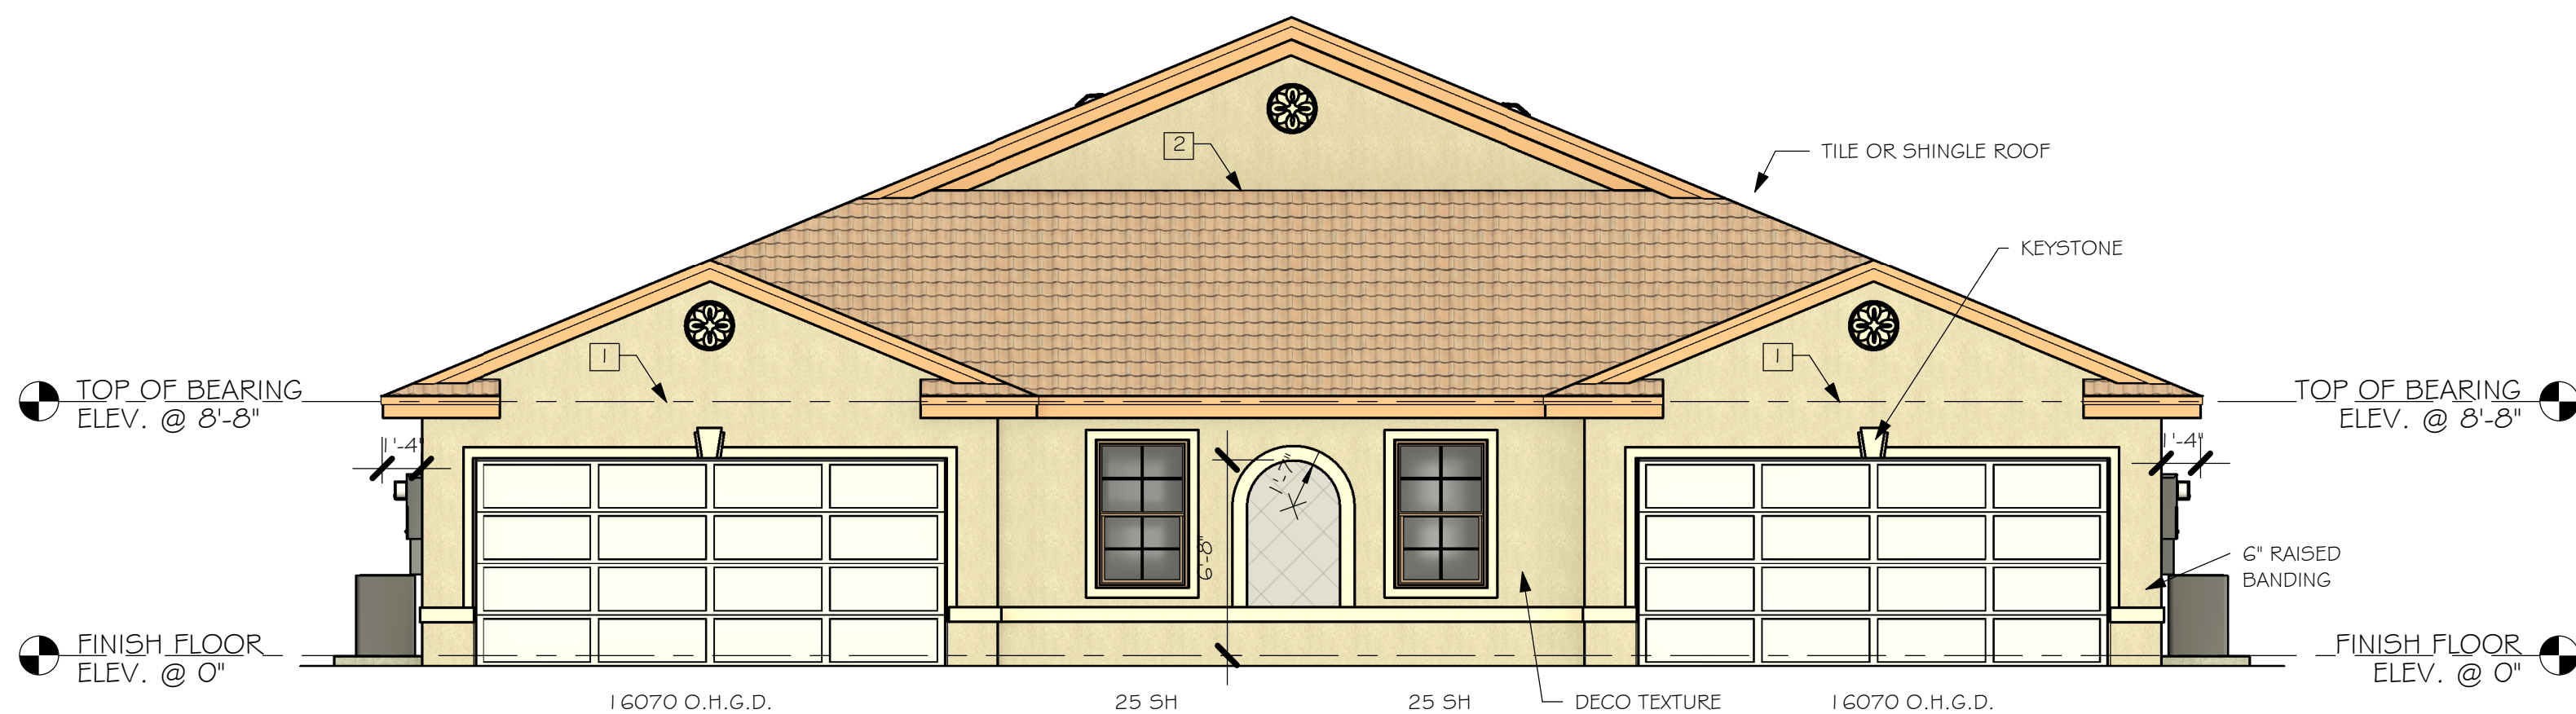

FRONT ELEVATION

3/16" = 1'-0"

- 1 MID-WALL WEEP SCREED AT WOOD MASONRY INTERFACE. INSTALL STRICTLY PER MFG. INSTRUCTIONS
- 2 ROOF / WALL SCREED INSTALL STRICTLY PER MFG. INSTRUCTIONS






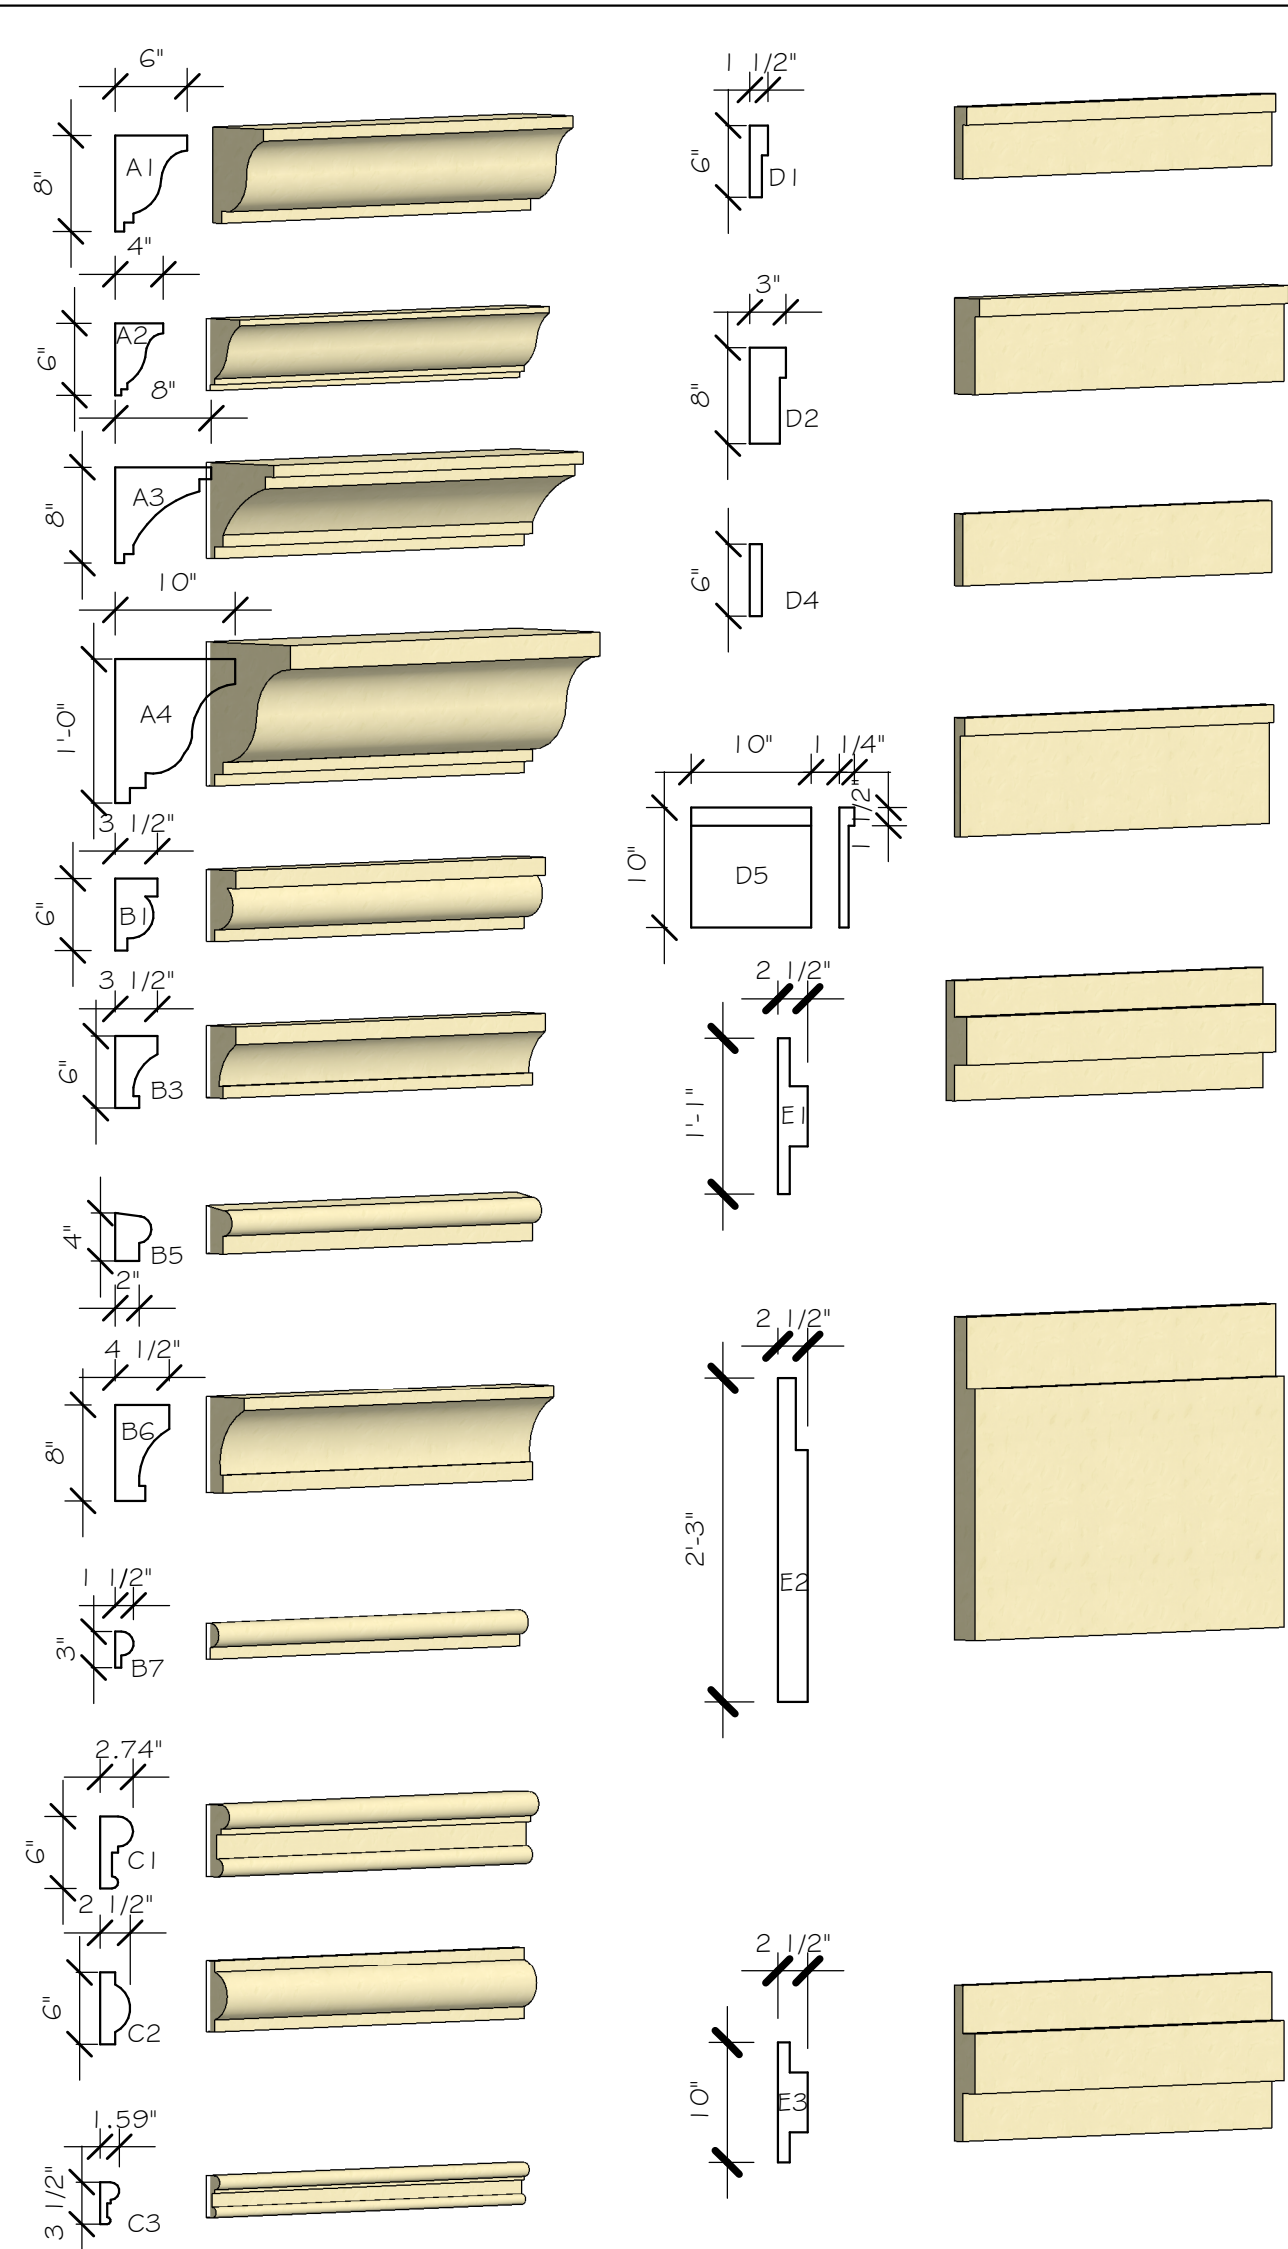


BANDING DETAILS

This is a multi-page document. I performed structural engineering only on those pages which contain my seal, Raul Reyes, and company name Structural Systems.

This item has been digitally signed by Raul Reyes on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be validated on any electronic copies.

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

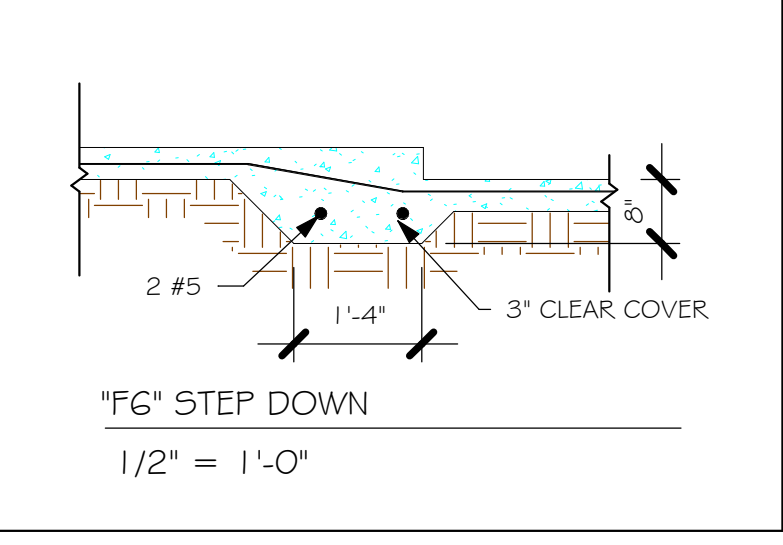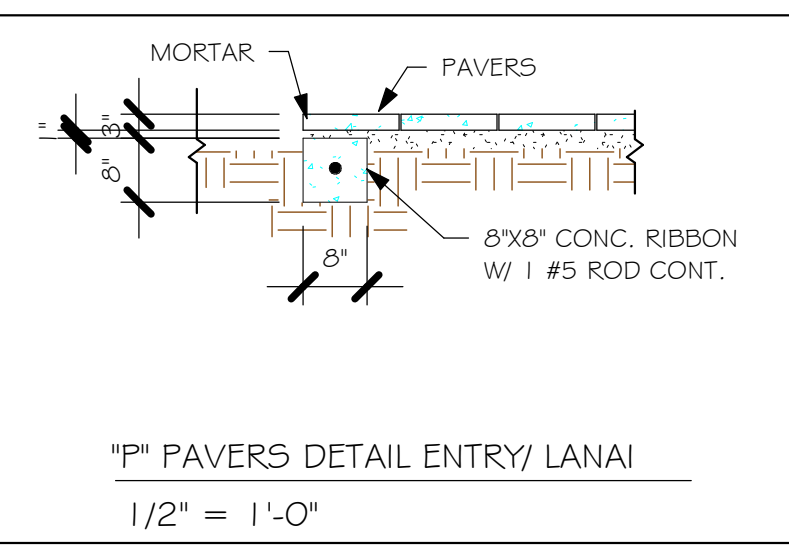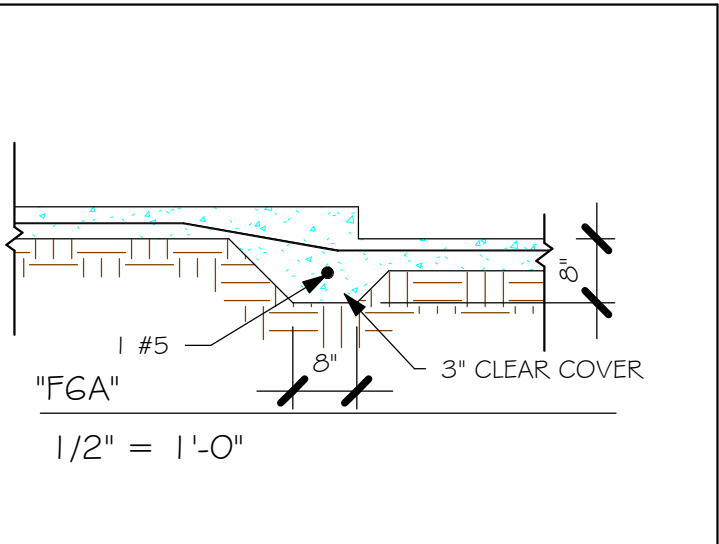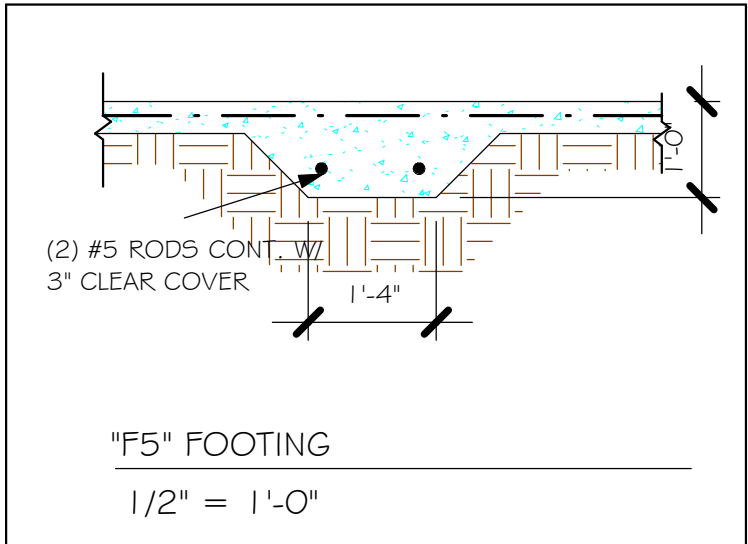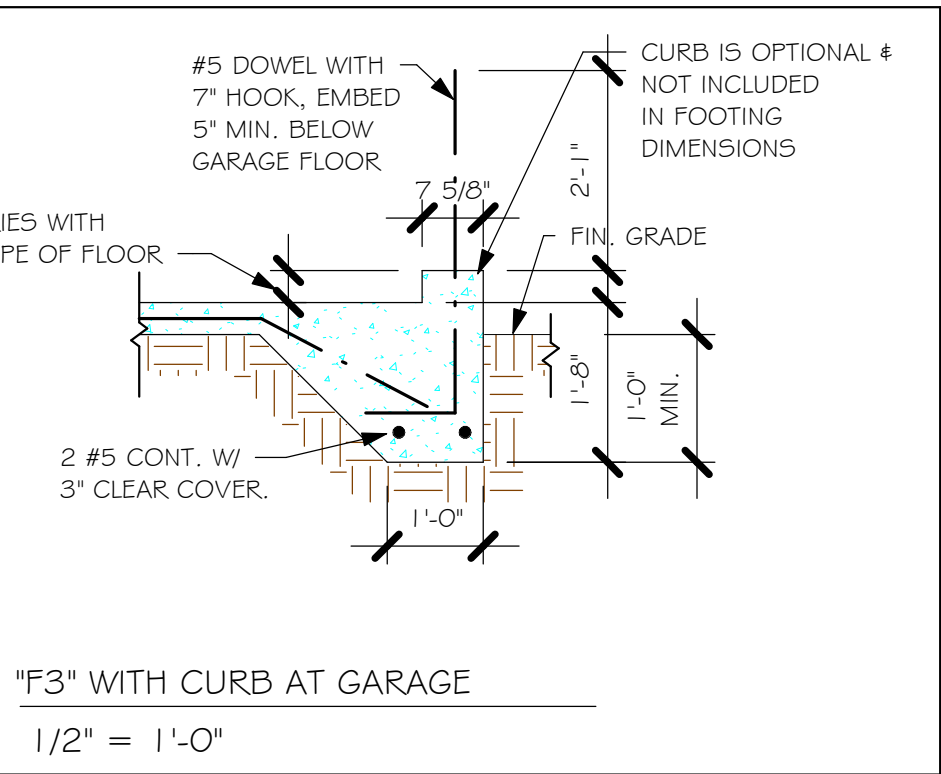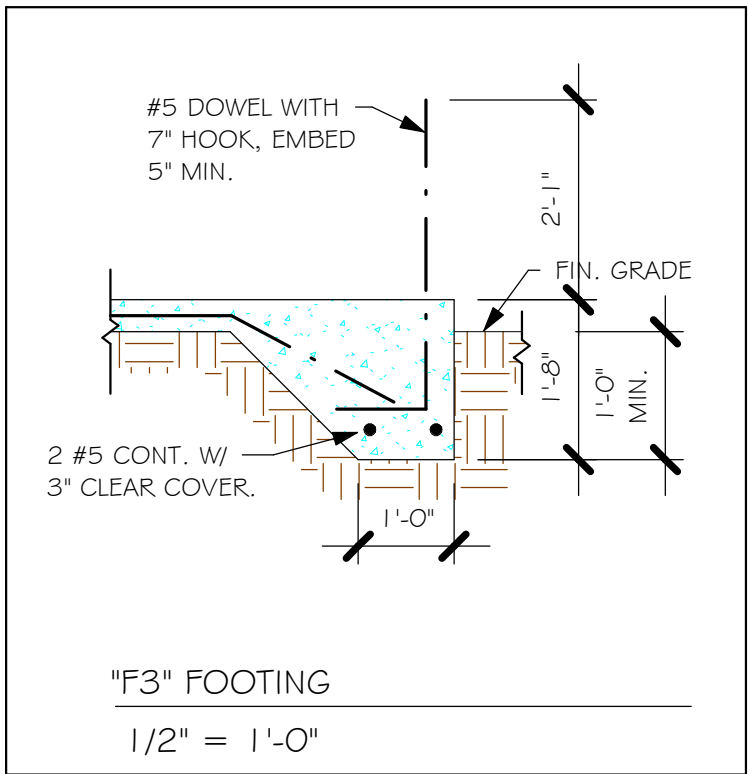

PAD FOOTING SCHEDULE

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.	REMARKS
					LONG WAY	SHORT WAY
A	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
B	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
C	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
D	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
E	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

WALL FOOTING SCHEDULE

USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
F1	CONT.	1'-4"	0'-8"	2-#5		
F2	CONT.	1'-8"	0'-10"	2-#5		
F3	CONT.	1'-0"	1'-8"	2-#5		
F4	CONT.	1'-4"	1'-8"	2-#5		
F5	CONT.	1'-4"	1'-0"	2-#5		
F6	CONT.	1'-4"	1'-0"	2-#5		
F6A	CONT.	0'-8"	0'-8"	1-#5		
TE	CONT.	0'-8"	0'-8"	1-#5		

ADD CURB TO GARAGE, SEE DETAIL.


PROVIDE CORNER BARS IN FOOTING PER DETAIL G/5-1

FOUNDATION PLAN

SCALE: 3/16" = 1'-0"


PLAN NOTES:

- TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0"
- "F#" DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- # DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- PROVIDE PRESSURE TREATED BUCKS AT WINDOWS/DOORS PER DETAIL 7/S-1.

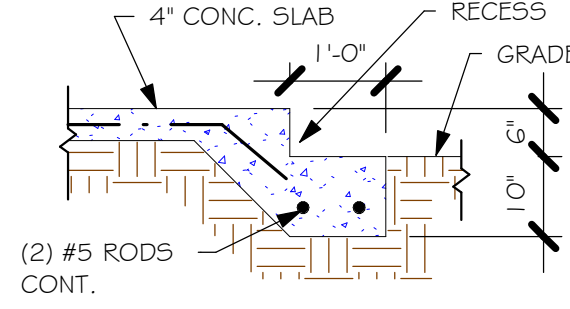

GARAGE DOOR RECESS

1/2" = 1'-0"

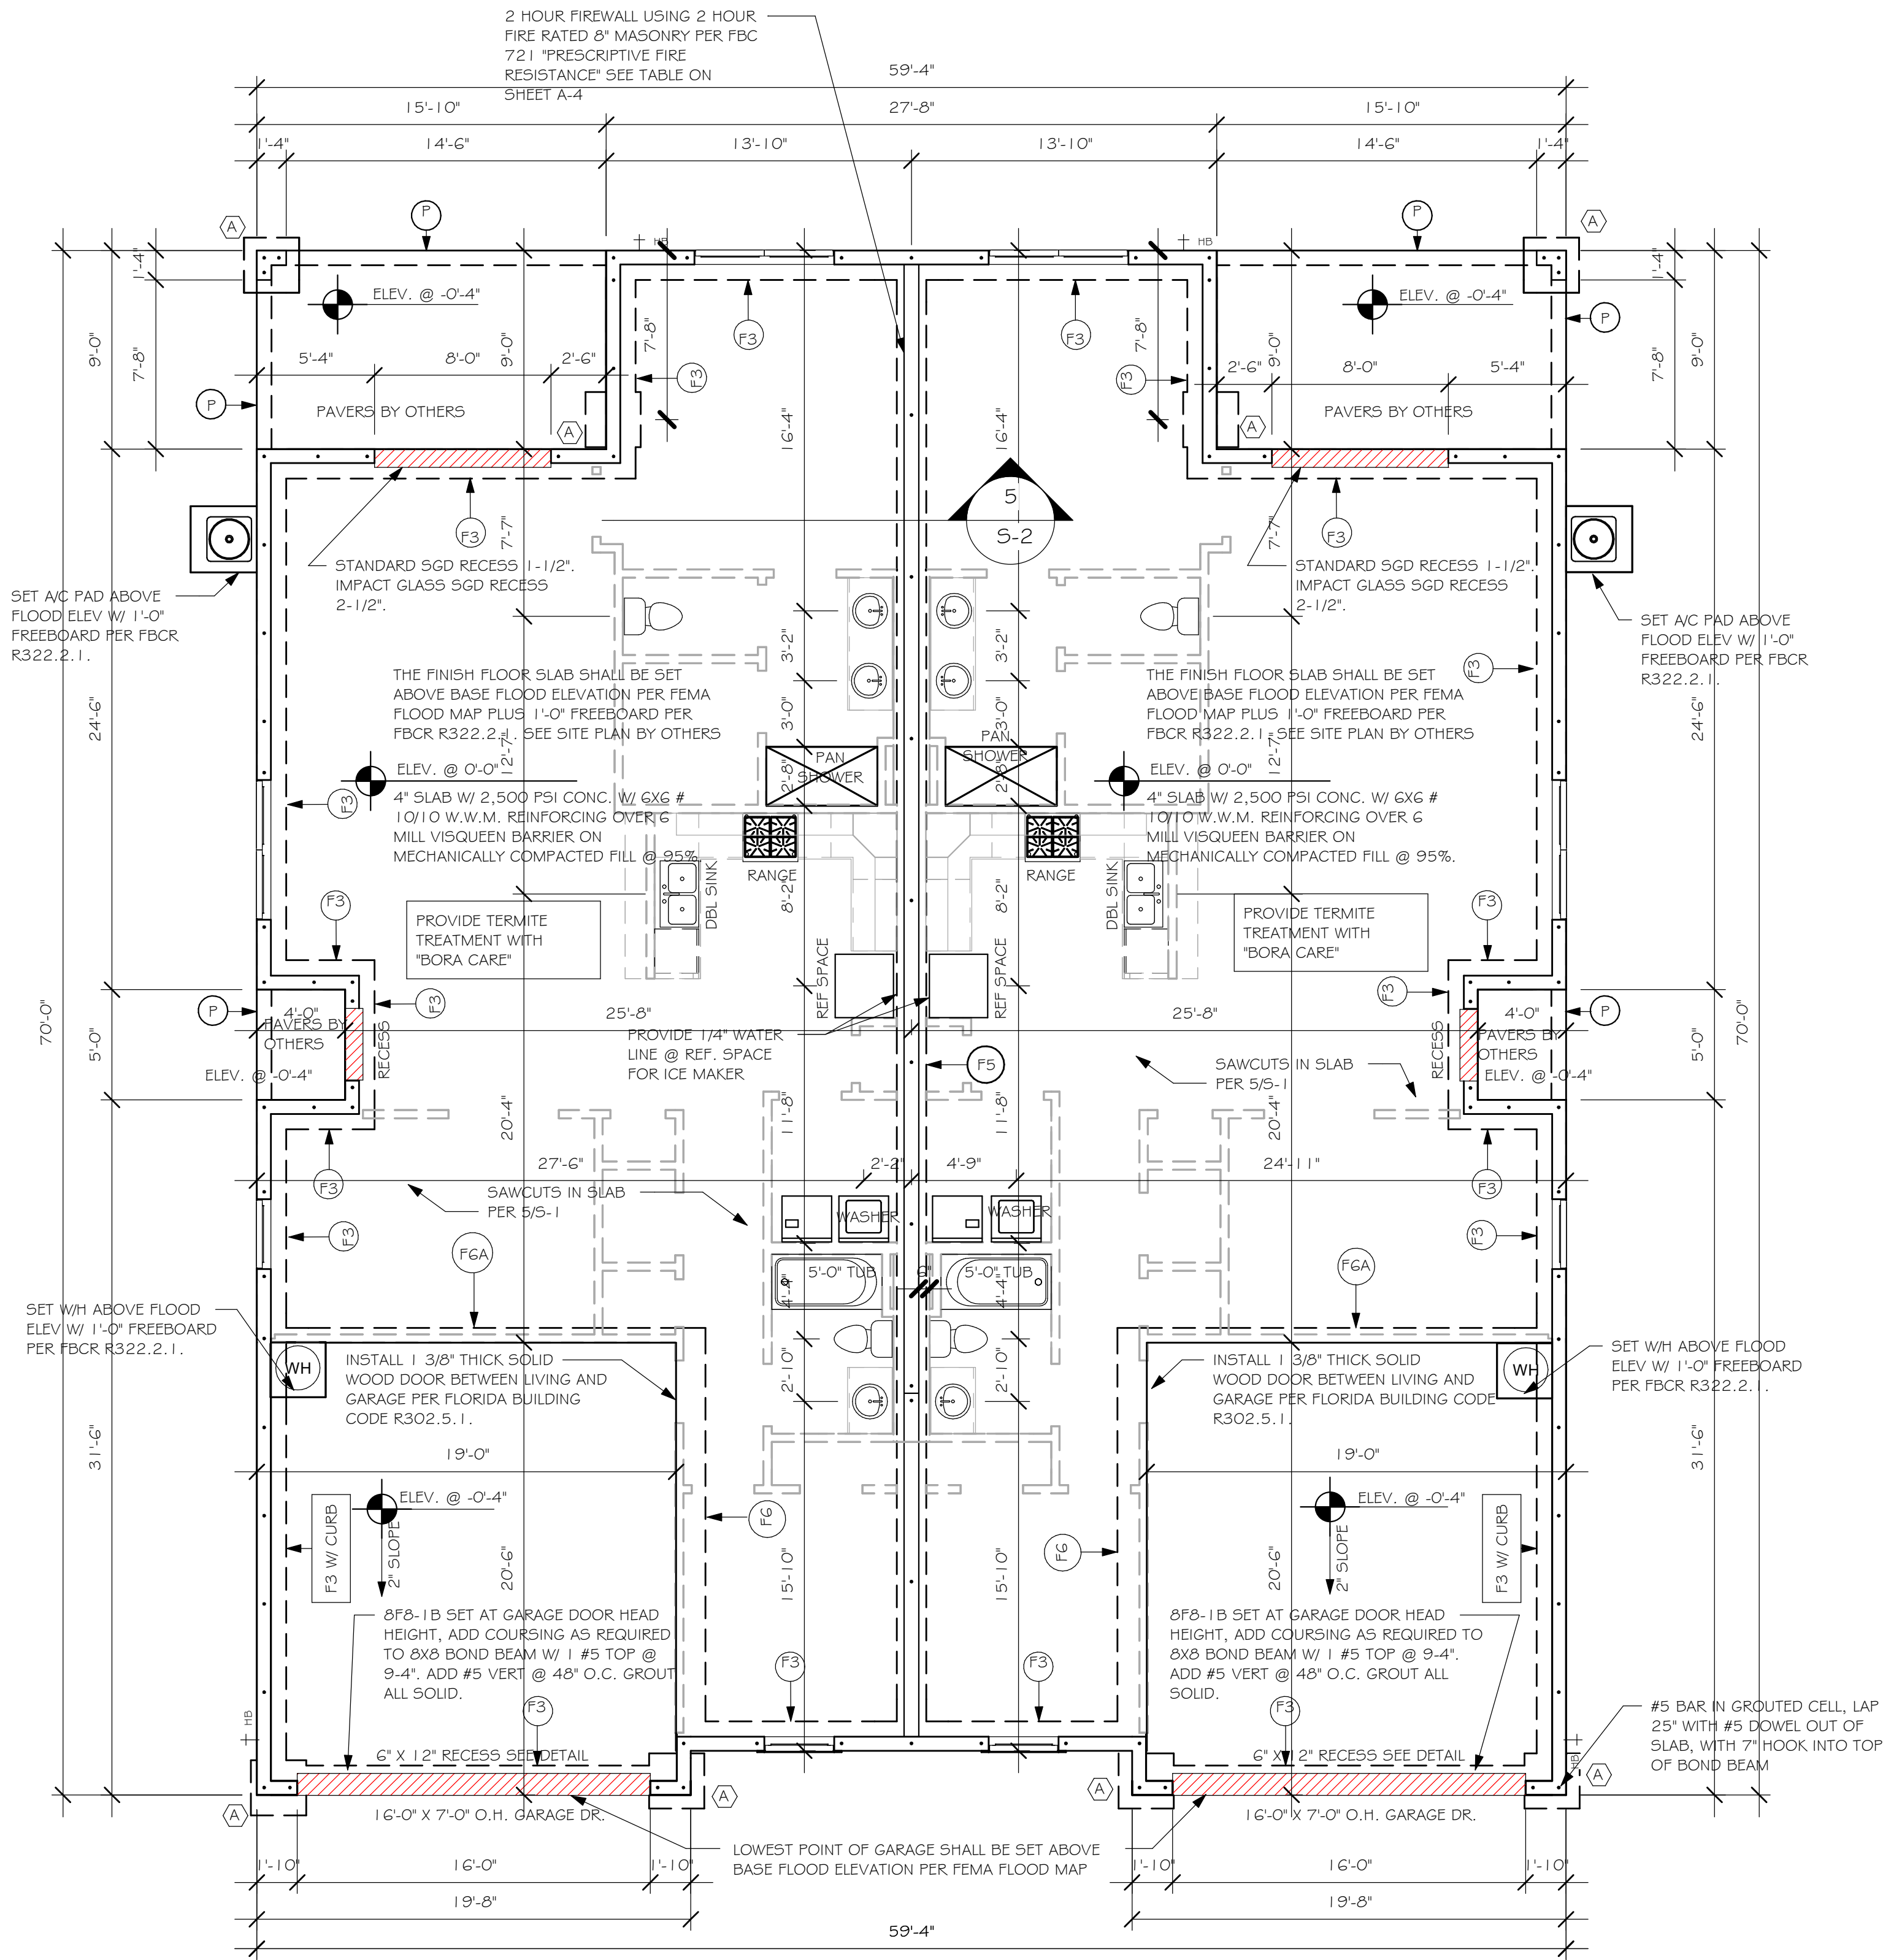

FOUNDATION PLAN

3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

L:\O-New Data\1 - MASTER 2019\2019-BUILDERS\DR HORTON
2019\SUBDIVISIONS\WATERFORD II TV\5\12196 LOT 434-435 1498 BREVIT\2196 1498
E:\t

DOOR SCHEDULE							
TYPE MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
1	16070 OHGD	GARAGE DOOR	7'-0"	16'-0"	+28.2/-31.5	+28.2/-31.5	2
2	2-4080 SL. GL. DR.	DISTINCTION	8'-0"	8'-0"	+29.4/-33.3	+29.4/-33.3	2
3	3068 ENTRY	DISTINCTION	6'-8"	3'-0"	+33.5/-36.3	+33.5/-44.8	2

WINDOW SCHEDULE							
MARK	DESCRIPTION	MANUFACTURER	HEIGHT	WIDTH	ZONE 4	ZONE 5	QTY
A	25 SH		5'-3"	3'-2"	+33.5/-36.3	+33.5/-44.8	4
B	2-25 SH		5'-3"	6'-4"	+33.5/-36.3	+33.5/-44.8	4
C	36" X 12" TRANSOM		1'-0"	3'-0"	+33.5/-36.3	+33.5/-44.8	2

WIND PRESSURES PER ASCE7-16 160 MPH, EXPOSURE C AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. $V_{asd}=124$ MPH

DOOR HEADERS		
6'-8" BI-FOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

PLAN NOTES	
1)	VERIFY ALL ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS
2)	PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT PER FLORIDA BUILDING CODE R 308.4.2.
3)	PROVIDE SAFETY GLAZING AT BATH/SHOWER PER FLORIDA BUILDING CODE R 308.4.5.
4)	NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING SHALL NOT EXCEED 24" O.C. (NON BEARING WALLS ONLY)
5)	PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE
6)	KITCHEN KNEE WALL TO BE FRAMED W/ TOP @ 34 1/2" A.F.F.
7)	INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS
8)	WHERE DRYWALL CEILING IS APPLIED TO TRUSSES @ 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. R702.3.5
9)	THE GARAGE SHALL BE SEPARATED FROM THE RESIDENCE & ATTIC BY NOT LESS THAN 1/2" GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS SHALL BE SEPARATED WITH NOT LESS THAN 5/8" TYPE "X" GYPSUM BOARD OR EQUIVALENT. WHERE THE SEPARATION IS A FLOOR - CEILING ASSEMBLY, THE STRUCTURE SUPPORTING THE SEPARATION SHALL ALSO BE PROTECTED BY NOT LESS THAN 1/2" GYPSOM BOARD OR EQUIVALENT
10)	INSTALL 1 3/8" THICK SOLID WOOD DOOR BETWEEN LIVING AND GARAGE PER FLORIDA BUILDING CODE R302.5.1.
11)	ALL WINDOWS INSTALLED 72" ABOVE GRADE MUST COMPLY WITH R612.2 MIN 24" SILL HEIGHT OR PROVIDED WITH AN APPROVED WINDOW FALL PRVENTION DEVICE
12)	ALL CLOSET SHELVES TO BE 12". ALL PANTRY & LINEN TO BE (4)-16" SHELVES 18" O.F.F. W/ 15" INCREMENT.
13)	ALL MECHANICAL AND ELECTRICAL EQUIPMENT TO BE INSTALLED AT OR ABOVE FLOOD PLUS 1'-0" FREEBOARD.




CABINET BACKING		
KITCHEN	UPPER TOP @ 84"	BASE TOP @ 35"
MASTER BATH	UPPER	BASE TOP @ 35"
GUEST BATH	UPPER	BASE TOP @ 31"
LAUNDRY ROOM	UPPER TOP @ 84"	BASE

INTERIOR DOOR SCHEDULE		
MARK	DOOR WIDTH	NOTES
1	3'-0"	P.K. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	
4	2'-4"	B.P. = BI-PASS DOOR
5	2'-0"	
6	1'-8"	L.V. = LOUVERED DOOR
7	1'-6"	
8	2'-1 1/4"	

SQUARE FOOTAGE UNIT #1	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

SQUARE FOOTAGE UNIT #2	
LIVING AREA	1,503
GARAGE AREA	391
LANAI AREA	143
FRONT PORCH/ ENTRY AREA	20
TOTAL SQUARE FOOTAGE	2,057

BATHROOM NOTES	
TB TOWEL BAR	ALL TUB DECKS @ 21" A.F.F
TP TOILET PAPER	ALL BLOCKING TO BE PT IN SHOWERS

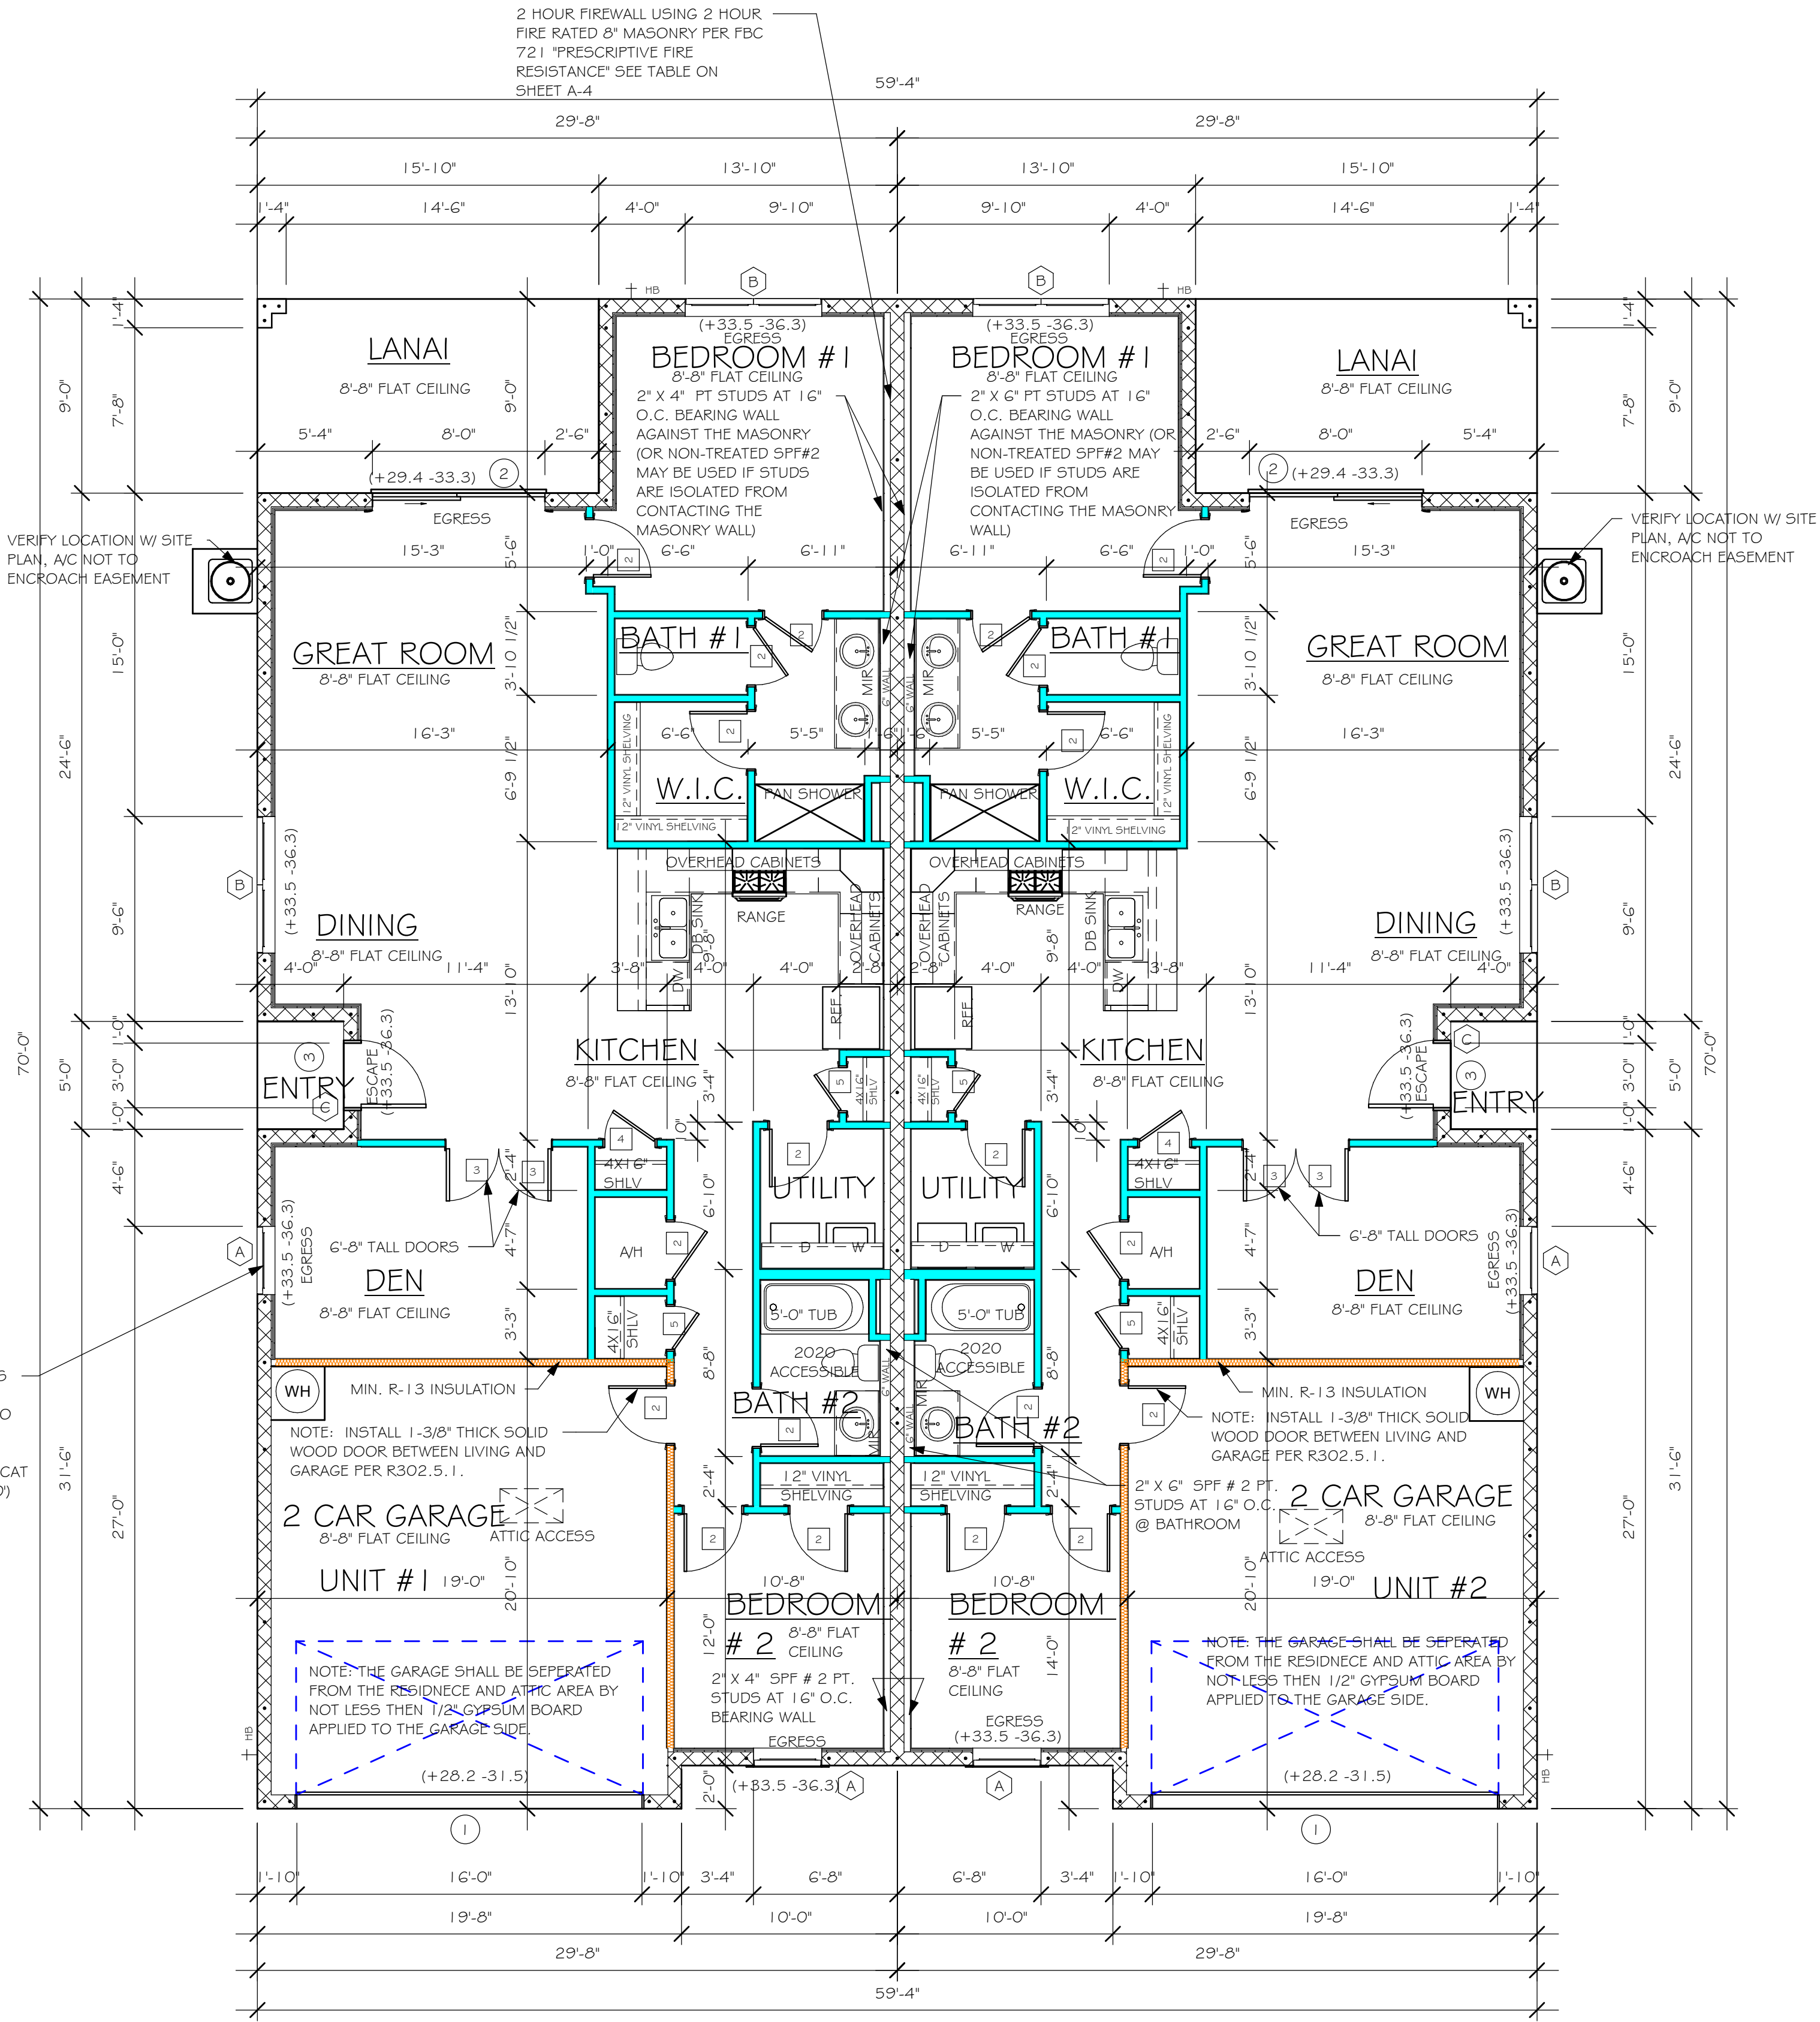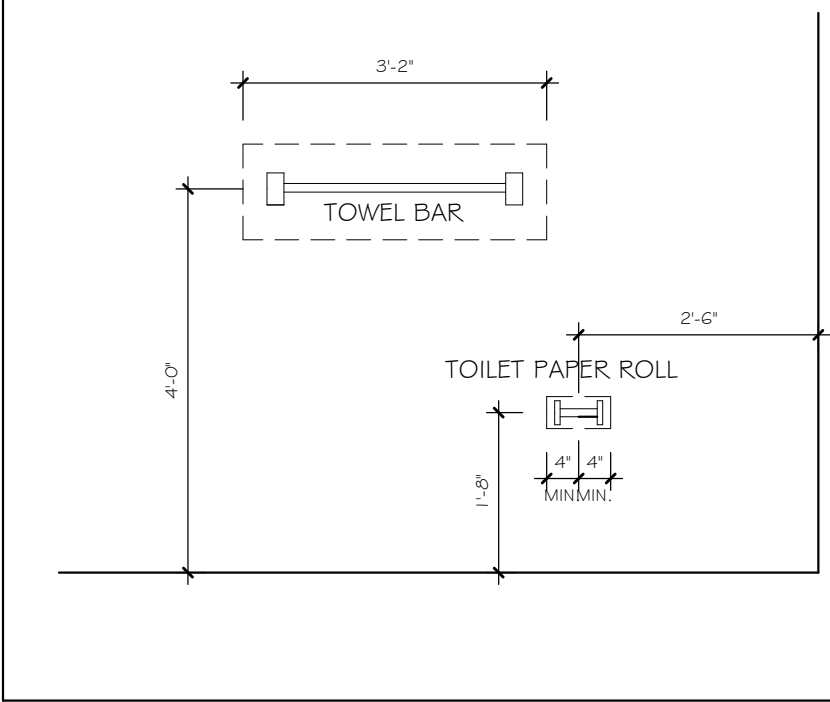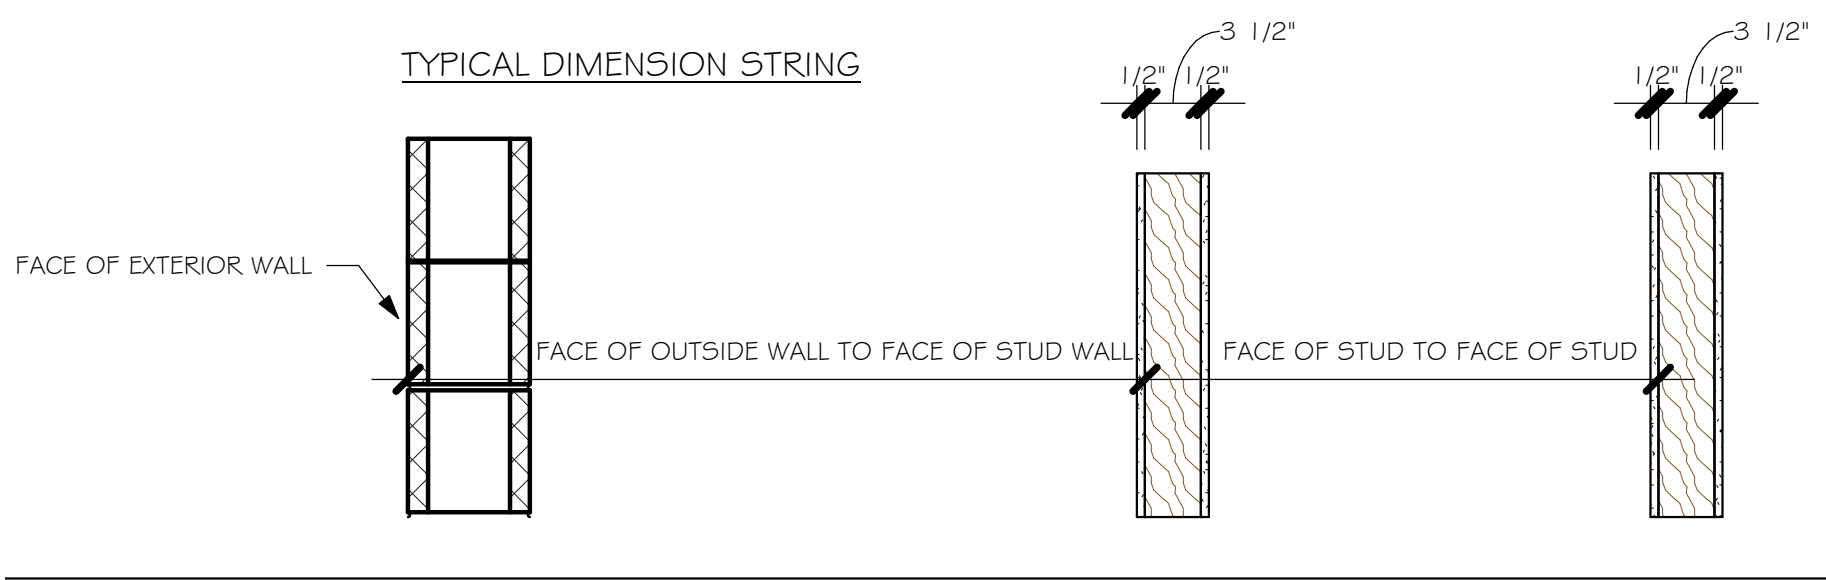


FLOOR PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

NOTES:

1. PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON -C OF WALL.
2. CONNECTORS ARE SIMPSON STRUCTURAL CONNECTORS. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
3. WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/5-3.

2 HOUR FIREWALL USING 8" MASONRY PER FBC 72.1 "PRESCRIPTIVE FIRE RESISTANCE"					
F.B.C. TABLE 722.3.2					
MINIMUM EQUIVALENT THICKNESS ¹ (IN) BEARING OR NON-BEARING CONCRETE MASONRY WALLS					
TYPE OF AGGREGATE	FIRE - RESISTANCE RATING (HOURS)				
			2	HR	
1. PUMICE OR EXPANDED SLAG			3.2"		
2. EXPANDED SHALE, CLAY OR SLATE			3.6"		
3. LIMESTONE, CINDERS, OR UNEXPANDED SLAG			4.0"		
4. CALCAREOUS OR SILICEOUS GRAVEL			4.2"		

BEARING HEIGHT	TRUSS BEARING CONDITIONS AND STRAPPING BASED ON TRUSS LAYOUT PREPARED BY SCOSTA JOB# DR1498 DATED: 11/24/20 REVISED: NONE
 = BEARING @ δ - δ "	

FIRE RESISTANCE RATINGS - ANSI/UL 263 (BXUV)


Design No. U301	Bearing Wall Rating 2 HR.	Finish Rating 66 Min.
<p>1. Naiflaths - Exposed or covered with joint finisher.</p> <p>2. Joints - Exposed or covered with flange joint and joint finisher. As an alternate, cement 3/32 in. thick gypsum veneer staggered will be applied to the entire surface of Classified veneer baseboard. Joints reinforced.</p> <p>3. Nails - 6d cement coated nails 1-7/8 in. long, 0.0915 in. shank diam, 1/4 in. diam heads, and 6d cement coated nails 2-3/8 in. long, 0.1113 in. shank diam, 9/32 in. diam heads.</p> <p>4. Gypsum Board - 5/8 in. thick, two layers applied either horizontally or vertically. Inner layer attached to studs with the 1-7/8 in. nails spaced 9" o.c. Outer layer attached to studs over inner layer with the 2-3/8 in. nails spaced 9" o.c. Vertical joints located over studs. All joint face layers staggered with joints in base layers. Joints of each base layer offset with joints of base layer on opposite side.</p> <p>When used in widths other than 48 in., gypsum board to be installed horizontally.</p> <p>When Steel Framing Members (Item 6) are used, base layer attached to framing channels with 1 in. long 2x4's Single-head steel screws spaced max. 24 in. o.c., face layer attached with 1-5/8 in. long 2x4's Single-head steel screws spaced max. 12 in. o.c.</p> <p>AMERICAN GYPSUM CO. - Types A&G, AGX-1, AGX-C.</p> <p>BEILING NEW BUILDING MATERIALS CO. LTD. - Type DBX-1.</p> <p>CERTAINTED GYPSUM CANADA, INC. - Types 1, FPRC, EPGC, ProRoC Type C or ProRoC Type X.</p> <p>CERTAINTED GYPSUM CANADA, INC. - ProRoC Type C, ProRoC Type X, ProRoC Type Abuse-Resistant.</p> <p>CANADIAN GYPSUM COMPANY - Types AR, C, IP-AR, IP-1, IP-X2, IPC-AR, SCX, SHX, WRC, WRX.</p> <p>G-P GYPSUM CORP. SUB OF GEORGIA-PACIFIC CORP. - Types 5, 9, C, DAP, DD, DA, DGG, DS, GPFSS, LAFARGE NORTH AMERICA INC. - Types LGFC-C, LGFC2, LGFC3, LGFSC, LGFC4, LGFC-CA.</p> <p>NATIONAL GYPSUM CO. - Types FSX, FSKC, FSKG-C, FSKG-F, FSKG-FSW, FSKG-F.</p> <p>PACCO GYPSUM, DIV OF PACIFIC COAST BUILDING PRODUCTS INC. - Types C, PG-2, PG-3, PG-3W, PG-4, PG-5, PG-5W, PG-5WS, PG-6 or PG-C.</p> <p>TEMPLE-IRLAND FLOOR PRODUCTS CORP. - Type TG-C.</p> <p>SIAM GYPSUM INDUSTRY (SARABURI) CO. LTD. - Type EX-1.</p> <p>STANDARD GYPSUM I L C. - Types SGC, SGC-C or SGC-G.</p> <p>UNITED STATES GYPSUM CO. - Types AR, C, FRX-C, FRX-G, IP-AR, IP-X1, IP-X2, IP-AR, SCX, SHX, WRC, WRX.</p> <p>USG MEXICO S A DE C V. - Types AR, C, IP-AR, IP-1, IP-X2, IP-AR, SCX, SHX, WRC, WRX.</p> <p>4A. Gypsum Board* - (As an alternate to Item 4) - Nom. 3/4 in. thick, installed as described in Item 4.</p> <p>CANADIAN GYPSUM COMPANY - Types AR, IP-AR.</p> <p>UNITED STATES GYPSUM CO. - Types AR, IP-AR.</p> <p>USG MEXICO S A DE C V. - Types AR, IP-AR.</p> <p>4B. Gypsum Board* - (As an alternate to Items 4 and 4A) - 5/8 in. thick; 2 ft. wide, tongue and groove edge, applied horizontally to the outer layer on one side of the assembly. Secured as described in Item 4. Joint covering (Item 2) not required.</p> <p>CANADIAN GYPSUM COMPANY - Types SHX.</p> <p>UNITED STATES GYPSUM CO. - Types SHX.</p> <p>USG MEXICO S A DE C V. - Types SHX.</p> <p>5. Molded Plastic* - Not shown. Optional - Solid vinyl siding mechanically secured over the outer layer to framing members in accordance with manufacturer's recommended installation details.</p> <p>ASSOCIATED MATERIALS INC.</p> <p>AL SIDE, DIV OF GENTEK BUILDING PRODUCTS LTD.</p> <p>HEARTLAND BUILDING PRODUCTS INC.</p> <p>VTYEC CORP.</p> <p>NEBRASKA PLASTICS INC.</p> <p>6. Steel Framing Members - (Optional, Not shown) - Furring channels and resilient sound isolation clip as described below:</p> <p>A. Furring Channels - Formed No. 25 MSG galv. steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. o.c. perpendicular to studs. Channels secured to studs as described in Item 6. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 10 SWG galv. steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Wallboard attached to furring channels as described in Item 4.</p> <p>B. Steel Framing Members - Resilient sound isolation clip used to attach furring channels (Item 6A) to studs. Clips spaced 48 in. o.c. and secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center grommel. Furring channels are friction fitted into clips.</p>		
<p>PAC INTERNATIONAL INC. - Type R5B-C-1.</p>		

*Bearing the UL Classification Mark

<p>DATE: _____</p> <p>DRAWN BY: _____</p> <p>CHECKED BY: _____</p> <p>REVISED: _____</p> <p>PLAN: _____</p> <p>SCALE: _____</p>		<p>01/15/21</p> <p>JSL</p> <p>JWC</p> <p>ROOF</p> <p>As indicated</p>
<p>MODEL 1498</p> <p>VILLA E</p> <p>GCD JOB # 12196</p>		<p>LOT: 434-435</p> <p>SUBDIVISION: WATERFORD II TVs</p> <p>ADDRESS: 7040-7032 WEST LENOX CIR</p> <p>D.R.H. #: 579170223-224</p>
<p>STRUCTURAL OF FLORIDA</p> <p>1604 S.W. 4th ST. SUITE 40 MIAMI, FL 33135 (305) 549-4454 CELL 305-249-4454</p> <p>DATE 08/05</p>		
<p>THIS DOCUMENT IS THE PROPERTY OF D.R. HORTON & ASSOCIATES, INC. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREON. IT IS NOT TO BE REPRODUCED, COPIED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM D.R. HORTON & ASSOCIATES, INC.</p>		
<p>D.R. HORTON® <small>REAL ESTATE ADVISOR</small></p> <p><i>America's Builder</i></p> <p>Gulf Coast <i>Drafting & Design, Inc.</i></p> <p>EMAIL: PLANS@GULFCOASTDRAFTING.COM PHONE: 239-540-1822</p> <p>1515 SE 42nd ST. CAPE CORRAL, FL 33904</p>		


L:\O-New Data\1-MASTER 2019\2019-BUILDERS\DR HORTON
2019\5\B\DIVISIONS\WATERFORD II TV\5\12196 LOT 434-435 1498 EREV\12196 LOT 434-435
E:\r

ELECTRICAL LEGEND	
	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE AT ELEV. A.F.F.
	DUPLEX RECEPTACLE - ABOVE COUNTER
	SINGLE POLE SWITCH
	3 WAY SWITCH
	DIMMER SWITCH
	MOTION SENSOR SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PERPOSES, PER RULE 9B-3.04.72 SD (SMOKE DETECTOR) SCD (CARBON MONOXIDE/ SMOKE DETECTOR)
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	FLUSH MOUNTED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON (PB) / DOOR BELL (DB)
	INTERCOM
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT
NOTE: NOT ALL SYMBOLS ARE USED FOR THIS PROJECT.	
ELECTRICAL NOTES: ARC-FAULT CIRCUIT-INTERRUPTERS AND TAMPER RESISTANT RECEPTACLES SHALL BE INSTALLED IN DWELLING UNITS PER N.E.C 210.12 AND 406.11 ALL ELECTRIC, ELECTRICAL EQUIPMENT AND APPLIANCES TO BE SET AT OR ABOVE BASE FLOOD ELEVATIONS PLUS 1'-0" FREEBOARD. ALL OUTLETS IN WET AREAS AND ALL EXTERIOR OUTLETS TO BE GFI'S. INSTALL PHONE AND T.V. PER CONTRACT. INSTALL ALL ELECTRICAL PER NEC 2014	

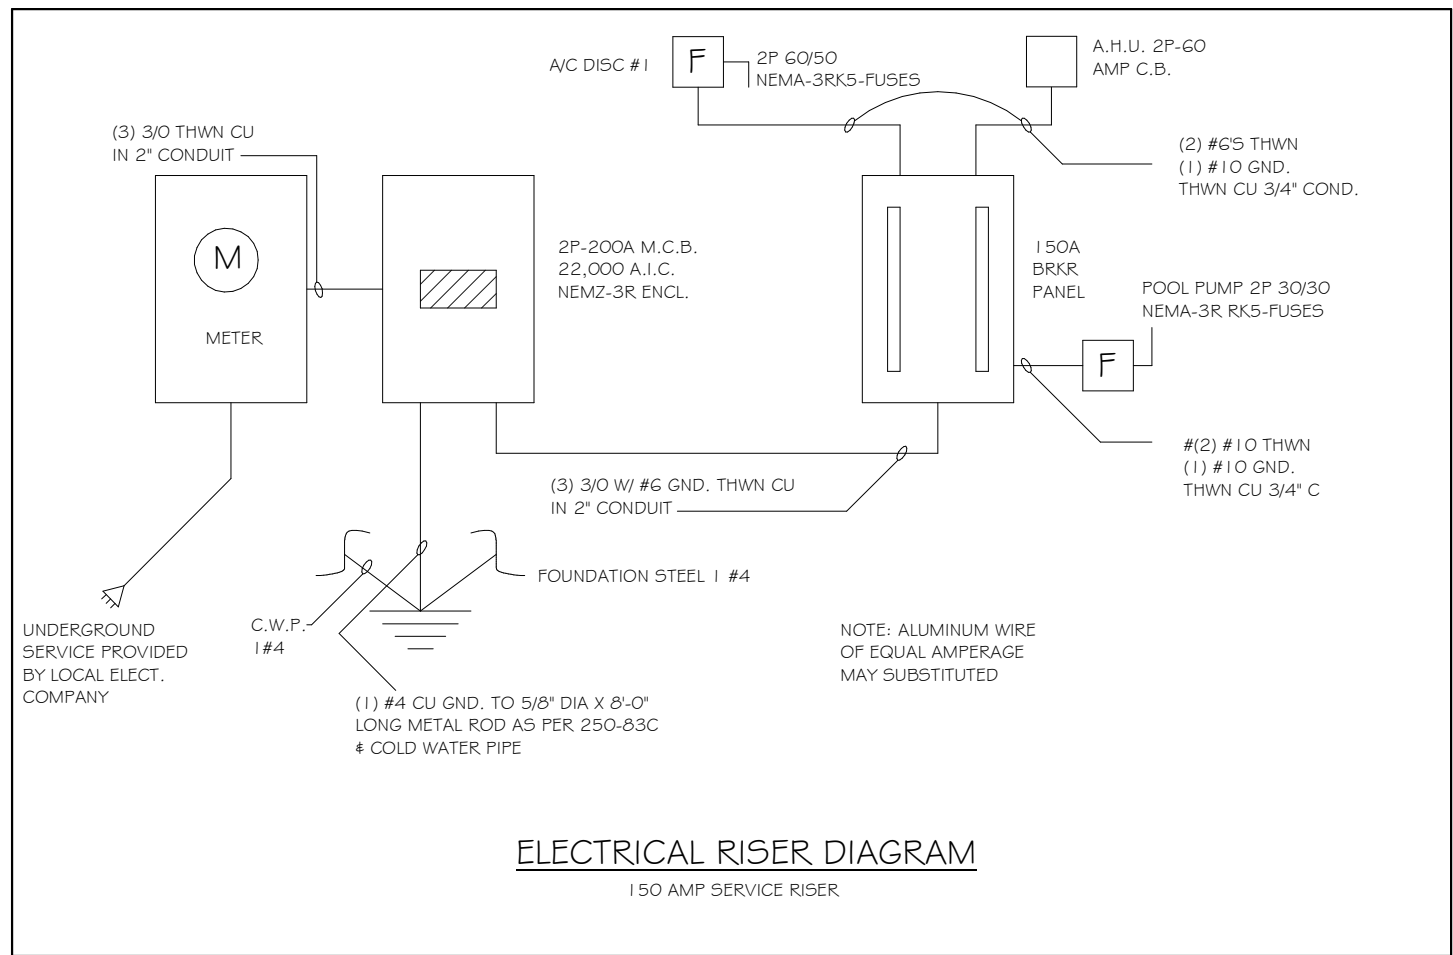

AIR CONDITIONING COORDINATION REQUIRED.
PRIOR TO ORDERING ROOF TRUSSES, THE CONTRACTOR SHALL WORK WITH THE AIR CONDITIONING SUB CONTRACTOR TO DESIGN/PLAN AND LAYOUT THE LOCATION OF AIR HANDLING EQUIPMENT, AIR DUCT SIZE AND LOCATION AND COORDINATE THAT DESIGN WITH THE TRUSSES FOR SPACE, CONNECTIVITY, AND POSITION REQUIREMENTS. THE CONTRACTOR MUST ADVISE THE TRUSS COMPANY PRIOR TO ANY CONSTRUCTION OF TRUSSES OF THE AIR CONDITIONING/HANDLING EQUIPMENT'S SIZES AND WEIGHT AND DUCT LAYOUT CONCERNS OR REQUIREMENTS THAT MAY HAVE THE POTENTIAL TO CHANGE OR MODIFY THE TRUSSES TO ACCOMMODATE THE SAME.
THE CONTRACTOR SHALL COORDINATE CONDENSATION DISCHARGE LINE LOCATION, AND ELECTRICAL SERVICE TO AIR EQUIPMENT, AND PROVIDE ANY LOCAL DISCONNECTS, LIGHTS AND SERVICE PLATFORMS THAT MAY BE REQUIRED.

ELECTRICAL NOTES FOR FIRE RATED WALLS
ELECTRICAL OUTLETS PLACED IN FIRE RATED WALLS SHALL BE IN CONFORMANCE WITH THE UNDERWRITERS LABORATORIES, INC., FIRE RESISTANCE DIRECTORY, CURRENT EDITION, THESE REQUIREMENTS INCLUDE, BUT ARE NOT LIMITED TO, THE FOLLOWING SPECIFIC ITEMS:
A) INDIVIDUAL OUTLET/SWITCH BOXES SHALL OT EXCEED (16) SQUARE INCHES IN AREA.
B) AGGREGATE AREA OF OUTLET/SWITCH BOXES SHALL NOT EXCEED (100) SQUARE INCHES WITHIN (100) SUARE FEET OF WALL AREA.
C) OUTLET/SWITCH BOXES LOCATED ON OPPOSITE SIDE OF THE SAME WALL SHALL BE SEPERATED BY A MINIMUM OF (24) INCHES.
D) ALL OUTLET/SWITCH BOXES SHALL BE SECURELY ATTACHED TO THE STUDS AND THE OPENING IN THE WALL BOARD FACING SHALL BE CUT SO THAT THE CLEARANCE BETWEEN THE BOX AND THE WALLBOARD DOES NOT EXCEED 1/8\"/>

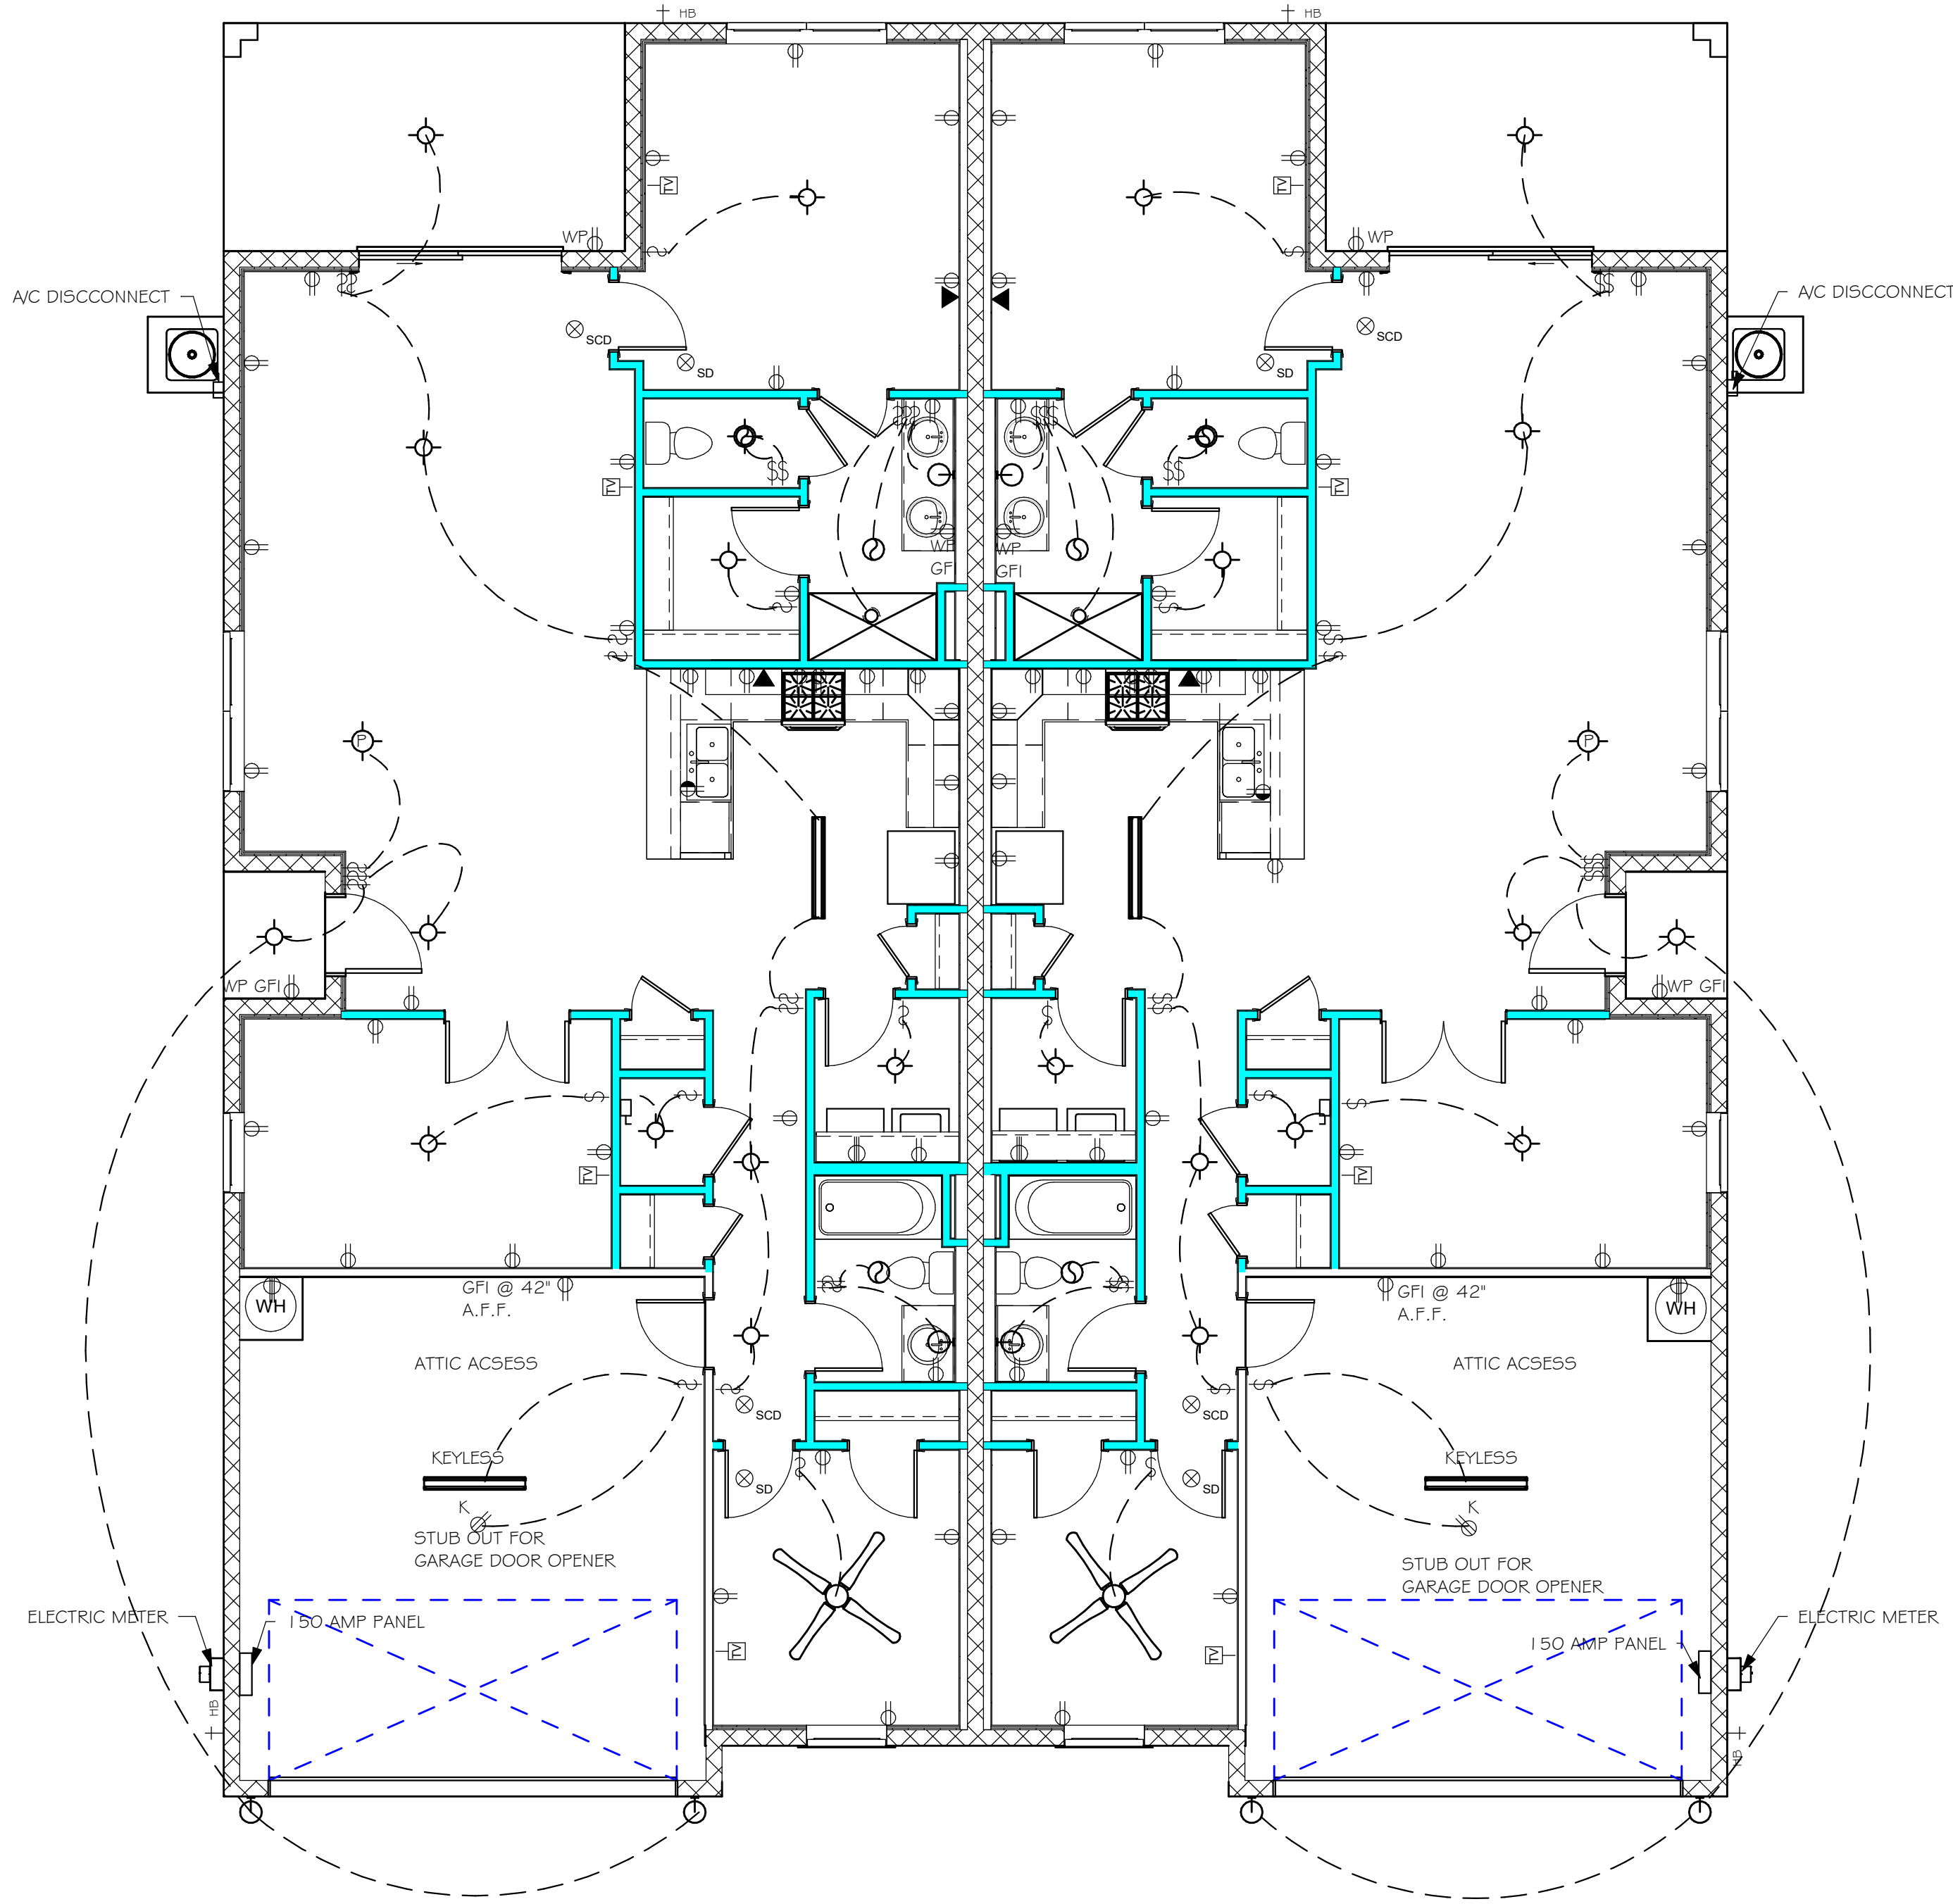

ELECTRICAL PLAN
3/16" = 1'-0"

DESIGN IN ACCORDANCE WITH THE RESIDENTIAL
FLORIDA BUILDING CODE 2020 - 7TH EDITION

TABLE R803.2.3.1 – NAIL SPACING BASED ON SPECIFIC GRAVITY OF RAFTER/TRUSS: ALL TRUSS TOP CHORDS AND FIELD ROOF FRAMING SHALL BE SOUTHERN PINE, SPECIFIC GRAVITY=0.55 (EXCEEDS SG=0.42 AND 0.49 OF TABLE R803.2.3.1).

ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSS WITHOUT SPLITTING.

TYPICAL HOUSE PLAN

EDGE NAIL TO BLOCKING AT RIDGE/VALLEY/HIP

STAGGER JOINTS AT SHEATHING PANELS

EDGE NAIL TO FACIA BOARD

NAIL SPACING (TABLE R803.2.3.1) WIND SPEED / EXPOSURE

NAIL TYPE (SECTION R803.2.3.1) 19/32 SHEATHING

160/B, 160/C, 170/B

170/C

NAIL SPACING: 6" O.C. EDGE 6" O.C. FIELD

NAIL SPACING: 4" O.C. EDGE 4" O.C. FIELD

2 1/2" x 0.131" RING SHANK OR 3" x 0.120" RING SHANK (PER ASTM F1667 RSRs-03 & 04)

1 NAILING OF ROOF SHEATHING

SCALE: NTS

DOWEL TO MATCH WALL REINFORCING, LAP 25"

FINISHED GRADE, SEE SITE PLAN

MONOLITHIC FOOTING, SEE PLAN

12" MIN

5" WITH 10" STD HOOK

3" CLEAR COVER TO REINFORCING

EDGE

VARIES

W

C STEPDOWN

W

D GARAGE

W

MONOLITHIC FOOTINGS

SCALE: 3/4" = 1'-0"

4

8" CMU WALLS

2x4 or 2x6 P.T. BUCK @ FLANGED WINDOWS (SEE NOTE)

1/4"x3 3/4" TAPCON @ 24" OC, 3 SCREWS MIN. (SEE NOTE)

WINDOW/DOOR ROUGH OPENING

8" CMU, SEE PLAN FOR REINFORCING

DOOR

2x8 OR 2x6 P.T. SYP#2

2x2x1/8" WASHER

1/2" Ø EXPANSION BOLT, 4" MIN. EMBEDMENT, SPACE 24" OC AND 12" FROM TOP & BOT.

BUCK FASTENING

GARAGE DOOR

NOTE: THIS BUCK FASTENING DETAIL IS INTENDED FOR FLANGED WINDOW/DOOR PRODUCTS THAT FASTEN THRU THE FLANGE WITH WOOD SCREWS TO THE BUCK. FOR WINDOW/DOOR PRODUCTS THAT DO NOT HAVE A FLANGE AND FASTEN INSTEAD OUTWARD THRU THE FRAME, USE MASONRY SCREWS PER MFR. THAT ARE LONG ENOUGH TO PENETRATE 2-1/4" INTO THE MASONRY. IN THIS CASE, THE BUCK MATERIAL IS SIMPLY A SPACER AND MAY BE 1x4 OR 1x6 OR OMITTED ENTIRELY AND THE SPACER MAY BE TACKED IN PLACE WITH MASONRY NAILS OR PINS.

RETROFIT STRAPS TO CONCRETE/MASONRY		
TRUSS UPLIFT (LBS) @ 24" OC	CONNECTOR	
TO 840	1-MTSM16 or 20	7-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 1045	1-HTSM16 or 20	8-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 2090	2-HTSM16 or 20	8-10dx1 1/2", 4-1/4x2 1/4" TITEN
TO 4300	2-LGT2	16-16d, 7-1/4x2 1/4" TITEN
TO 3480	HTT16	18-16d, 9/8" Ø ALLTHREAD, DRILL & EPOXY 10" EMBED W/ SIMPSON SET.
TO 10530	HGT-2/3	TWO 3/4" Ø ALLTHREAD, DRILL & EPOXY 12" EMBED WITH SIMPSON SET.

NOTES:

1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.

2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

10 RETROFIT UPLIFT CONNECTOR SCHEDULE

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
7/16" ZIP SYSTEM WALL SHEATHING BY HUBER ENGINEERED WOODS LLC, NAILED W/ 8d COMMON WIRE @ 6" O.C. EDGE AND 6" O.C. FIELD. PROVIDE 2x4 BLOCKING AT ALL JOINTS. INSTALL SHEATHING AND SEAM TAPE IN STRICT ACCORDANCE WITH MFR. WRITTEN INSTRUCTIONS.	N/A
EXTERIOR CEILING	
1) 1x4 STRIPPING @ 16" OC W/ 2-8d NAILS TO EACH TRUSS, 5/8" EXTERIOR GYPBOARD CEILING, FASTEN W/ 8d NAILS OR 1 5/8" DRYWOOD SCREWS @ 6" OC EDGE & FIELD.	
2) 3/8" BC PLYWOOD NAILED W/ 6d COMMON @ 6" OC EDGE & FIELD.	
SOFFIT	
ALUMINUM PERFORATED SOFFIT INSTALLED PER MANUFACTURER INSTRUCTIONS TO MEET WIND PRESSURES PER R704.	

NOTE: EXTERIOR CEILINGS SPECIFIED ABOVE MEET THE DESIGN WIND PRESSURES PER R703.1.2

2

3/4" DEEP SAWCUT W/ ELASTOMERIC SEALANT

SLAB ON GRADE, SEE PLAN

NOTES:

1) PROVIDE SAWCUTS TO CREATE APPROXIMATE 20' X 20' MAXIMUM SQUARES.

2) SAWCUT CONCRETE SLAB WITHIN 4 TO 12 HOURS OF CONCRETE PLACEMENT.

5 SLAB SAWCUT DETAIL

SCALE: NTS

INTERSECTION

CORNER

#5 CORNER BAR, 25"x25"

MASONRY BOND BEAM, TYPICAL

#5 CORNER BAR, 25"x25"

MASONRY BOND BEAM, TYPICAL

8 CORNER BAR DETAIL IN BOND BEAMS

SCALE: 3/4" = 1'-0"

12

5

ROOF COVERING AS SELECTED BY BUILDER PER: FBCR 905.2 ASPHALT SHINGLES FBCR 905.3 CLAY AND CONCRETE TILE FBCR 905.4 METAL ROOF

ROOF SHEATHING, SEE SCHEDULE 2/S-1

WOOD TRUSSES @ 24" OC, DESIGNED BY DELEGATED TRUSS ENGINEER

EMBEDDED STRAP AT EACH ROOF TRUSS, SEE ROOF PLAN. BREAK OUT WEB OF BLOCK AS NEEDED TO PROPERLY LOCATE EACH STRAP

TRUSS BEARING

SEE PLAN

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

APPROVED ISOLATION PLATE

8"x8" CONTINUOUS MASONRY BOND BEAM W/ 1-#5, GROUT SOLID. PROVIDE CORNER BARS PER DETAIL 6/S-1

ALUMINUM SOFFITS SHALL MEET WIND DESIGN PRESSURES PER R704 INSTALLED PER MFR. SPECS.

#5 VERT. IN GROUTED CELL AT DOT LOCATIONS ON PLAN (48" OC MAX EXTERIOR)

#5 VERTICAL SHALL HAVE 7" STANDARD HOOK INTO TOP OF BOND BEAM

11 TRUSS STRAP TO BOND BEAM

SCALE: 3/4" = 1'-0"

3

WINDOW/DOOR/SOFFIT DESIGN WIND PRESSURES

WIND PRESSURES PER ASCE7-16, 160 MPH, EXPOSURE C, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vwsd=124 MPH, RISK CAT II, ENCLOSED, kd=0.85, I=1.15)

TYPE	INTERIOR ZONE 4	END ZONE 5
SOFFIT (10 SQ. FT.)	+33.5 -36.3	+33.5 -44.8
WINDOWS & DOORS (10 SQ. FT.)	+33.5 -36.3	+33.5 -44.8
8' OR 9' GARAGE DOORS	+29.4 -33.3	
16' OR 18' GARAGE DOORS	+28.2 -31.5	

(SEE PLAN FOR OTHER SPECIFIC PRESSURES)

1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.

2) USE "INTERIOR ZONE 4" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "END ZONE 5" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "END ZONE 5" COLUMN.

3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.

4) SUBMIT PRODUCT APPROVALS TO THE BUILDING DEPARTMENT AS REQUIRED BY THE LOCAL JURISDICTION.

5) MANUFACTURED SOFFIT PRODUCTS SHALL BE INSTALLED PER MFR ENGINEERING SPEC SHEETS.

* ON IRREGULAR SHAPED BUILDINGS, THERE IS NO GUIDANCE IN THE CODE FOR HOW FAR A CORNER MUST PROTRUDE FROM THE MAIN BUILDING TO BE CONSIDERED "ZONE 5". WE HAVE CHOSEN >15'. THIS IS SUBJECT TO JUDGEMENT CALL BY THE AUTHORITY HAVING JURISDICTION.

IN ZONE 5, MANUFACTURED SOFFIT PRODUCTS MAY REQUIRE ADDITIONAL BATTENS OR FASTENING PER MFR ENGINEERING SPEC SHEETS TO MEET THE PRESSURE REQUIREMENTS.

END ZONE 5 PRESSURES OCCUR AT "PRIMARY" OUTSIDE CORNERS OF BUILDING (BOLD LINES)

INTERIOR ZONE 4 PRESSURES

TYPICAL HOUSE PLAN

END ZONE WIDTH = 4'-0" MEASURED FROM FACE OF WALL (FIG R301.2(7))

FOOTING REIN., SEE PLAN

LAP CORNER BARS 40 BAR DIAMETERS

3" COVER

MAINTAIN RUN TO RISE OF 2:1 OR MORE

FOOTING REIN., SEE PLAN. LAP 40 BAR DIAMETERS

CONCRETE FOOTING, SEE PLAN

PLAN VIEW

STEP FOOTING

SCALE: NTS

FOOTING CORNER BARS

SCALE: NTS

6

LINTEL AT LANAI OR ENTRY. '8F16-1B/1T' (8"x16" FILLED SOLID, 1#5 BOTTOM, 1-#5 TOP)

8"x8" BOND BEAM W/ 1-#5

TRUSS BEARING

7" STANDARD HOOK INTO TOP OF BOND BEAM (MAY USE 7"x25" BENT BAR)

#5 VERT. AT INTERSECTION OF BOND BEAM W/ 7" HOOK AT TOP

MASONRY WALL

#5 VERTICAL IN GROUTED CELL AT DOT LOCATIONS ON PLAN

BOND BEAM REINFORCING DETAIL

SCALE: 3/4" = 1'-0"

12

ROOF SHEATHING, SEE SCHEDULE.

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

2x4 BLOCK AT SHEATHING JOINT

2x4 BRACE AT LOCATIONS SHOWN ON PLAN

3-12d TOE NAILS

2x4 BLOCKING

TRUSS TOP CHORD, DROP 3/2"

BRACE VERTICAL MEMBERS PER TRUSS MFR DETAILS

MID WALL WEEP SCREED

12d NAILS AT TRUSS BOTTOM CHORD TO SILL @ 8" O.C.

MASONRY WALL, SEE PLAN

DROPPED GABLE TRUSS

GABLE END BRACING

SCALE: N.T.S.

At Exterior Stud Walls and Gable Ends with Wall Sheathing, apply plaster over metal lath over water resistive barrier as follows:

Plaster R703.7.2.3: 3-coat 7/8" thick portland cement based plaster per ASTM C926.

Metal Lath R703.7.1: Self furring paper backed 2.5lb diamond mesh metal lath per ASTM C947, G60 galvanized, fastened per ASTM C1063 with 1-1/2" long, 11 gage nails with 7/16" head (roofing nails) at 7" oc, or 1-1/2" long, 16 gage staples at 6" oc, into the framing members (ie, the nails or staples must align with and penetrate 3/4" into the framing studs).

Water Resistive Barrier (WRB) R703.7.3: Water-resistive vapor-permeable barrier with a performance at least equivalent to 2 layers of Grade D paper. The individual layers shall be installed independently. An approved house wrap may be used for the 1st layer and metal lath with approved paper backing may be the 2nd layer (Note: ZIP wall sheathing with seam tape qualifies as the first layer).

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT W/ TOLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF
- DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7-16
BASIC WIND SPEED (ASCE7-16) 160 MPH
NOMINAL WIND SPEED (Vwsd TABLE R301.2.1.3) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE C
MEAN ROOF HEIGHT = 15 FT
ROOF PITCH 5/12
ENCLOSURE CLASS ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE PER TABLE R301.2(2), R301.2(3) AND R301.2(4), SEE DETAIL ON S-3.
SOFFITS - PER R704, ALL SOFFITS & THEIR ATTACHMENTS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS USING 10 SQ. FT.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-14
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3/4" MINIMUM THICKNESS REINFORCED WITH 6x6 w1.4xw1.4 WWF OR FIBERMESH f'c = 2500 PSI
CONVENTIONAL SHALLOW FOOTINGS f'c = 2500 PSI
BEAMS AND COLUMNS f'c = 3000 PSI
ALL OTHER CONCRETE (U.N.O.) f'c = 3000 PSI
UNLESS OTHERWISE SHOWN ON DRAWINGS, MINIMUM CONCRETE COVER FOR REINFORCING SHALL BE AS FOLLOWS:
FOOTINGS 3" CENTERED
SLAB ON GRADE 1 1/2"
BEAMS 1 1/2"
COLUMNS 1 1/2"
ALL REINFORCING STEEL SHALL BE PLACED IN ACCORDANCE WITH THE TYPICAL BENDING DIAGRAMS AND PLACING DETAILS OF ACI STANDARDS AND SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE HELD SECURELY IN POSITION WITH STANDARD ACCESSORIES DURING PLACING OF CONCRETE.
REINFORCING STEEL - ASTM A615 GRADE 40 FOR #3 GRADE 60 FOR #4 TO #11

- WELDED WIRE FABRIC - ASTM A185
- SPICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5" APART FOR #5 BARS.
- FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER TMS 402/602-16
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI
- REINFORCING STEEL - ASTM A615 GRADE 60.
SPICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE "S" MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN.

5. DELEGATED-ENGINEERED WOOD ROOF TRUSSES:
ALL WOOD ROOF TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS 2000 PSF
SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL, AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, GUYING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

13

2x4 BLOCK AT SHEATHING JOINT

ROOF SHEATHING, SEE SCHEDULE

2x6 (MIN) SPF #2 W/ 3-16d TO EACH TRUSS

3-12d TOE NAILS

2x4 BLOCKING

2x4 OUTLOOKER

H2.5A CLIP @ EA. OUTLOOKER TO TRUSS

TRUSS TOP CHORD, DROP 3/2"

DROPPED GABLE TRUSS

OUTLOOKER DETAIL


SCALE: N.T.S.

REVISIONS	BY

STRUCTURAL ENGINEERING:

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA # 8629

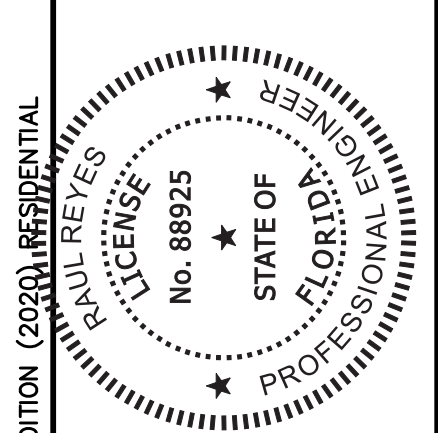

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

BUILDER:

D.R. HORTON

America's Builder

STRUCTURAL DETAILS FOR

1498 SIGNATURE VILLA


7032 & 7040 WEST LENOX CIRCLE
PUNTA GORDA, FLORIDA
LOTS: 434-435 SUBDIVISION: WATERFORD

DESIGN/DRAWN	DWB/DWB
CHECKED	DWB
DATE	01/22/21
SCALE	AS NOTED
JOB NO.	DR 12196
SHEET	


S-1

SHEET 1 OF 2


FOR SCOSTA TRUSSES, JOB # DR1498, DATED 11/24/20, REVISED: NONE

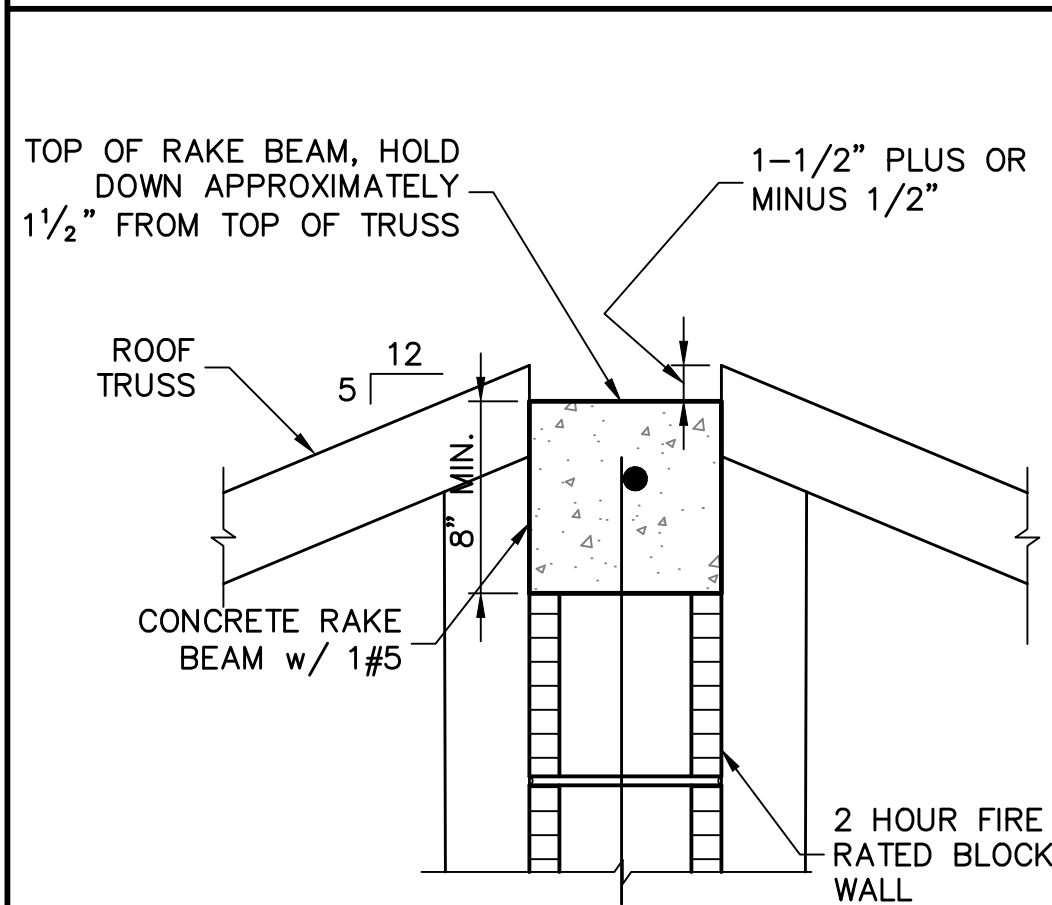


1A TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

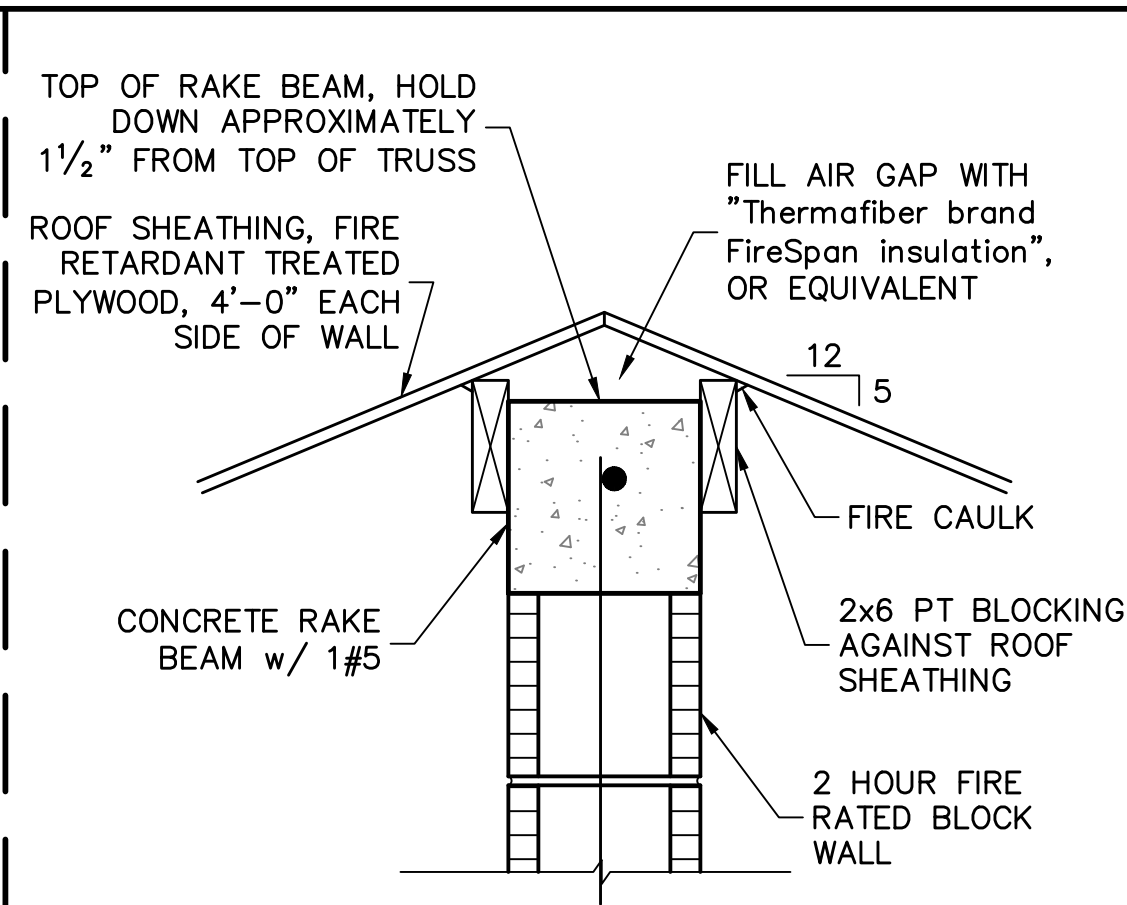


1B TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

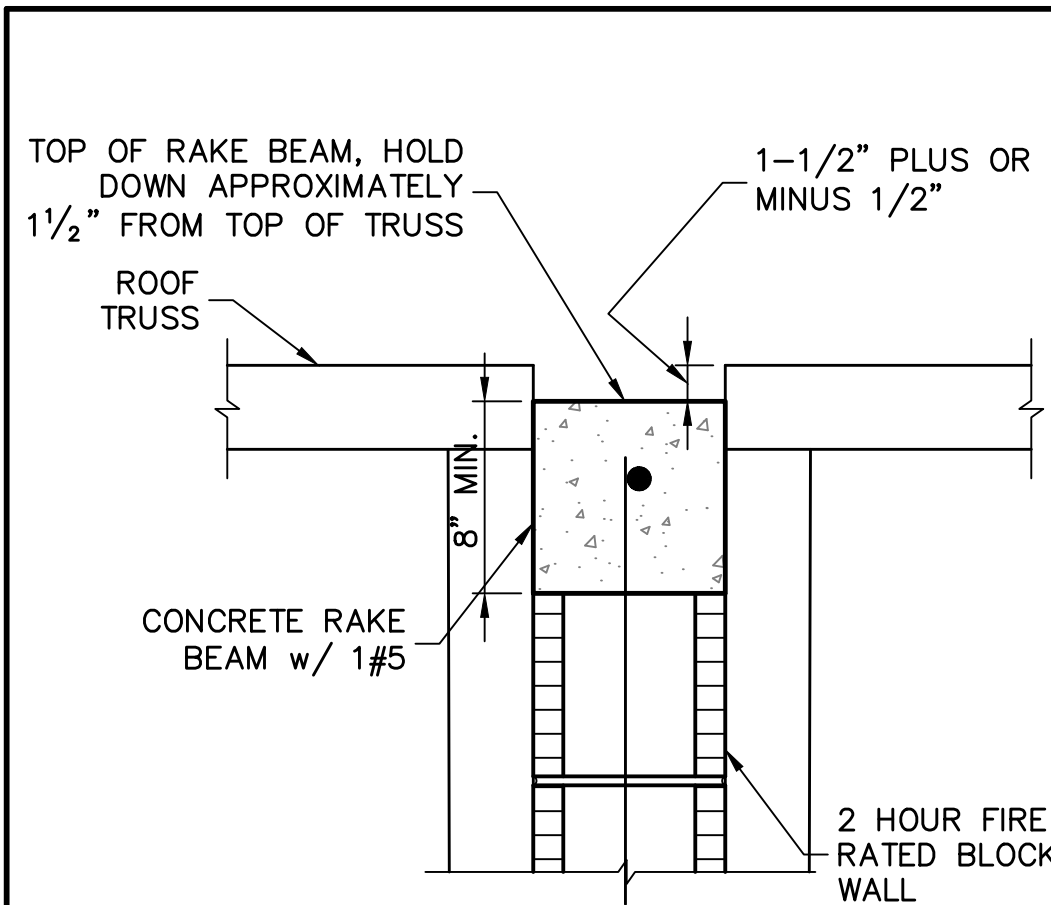



2A TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

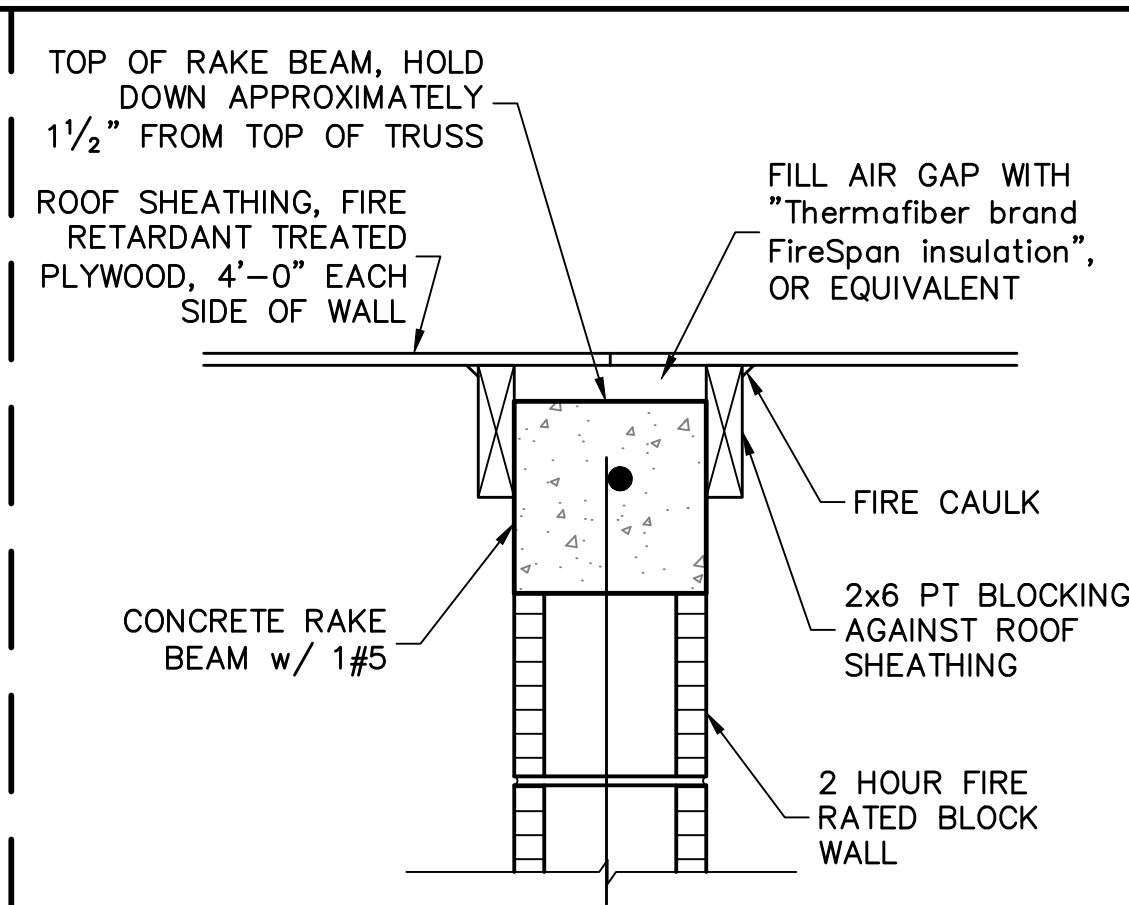

2B TOP OF FIREWALL
SCALE: 1-1/2" = 1'-0"

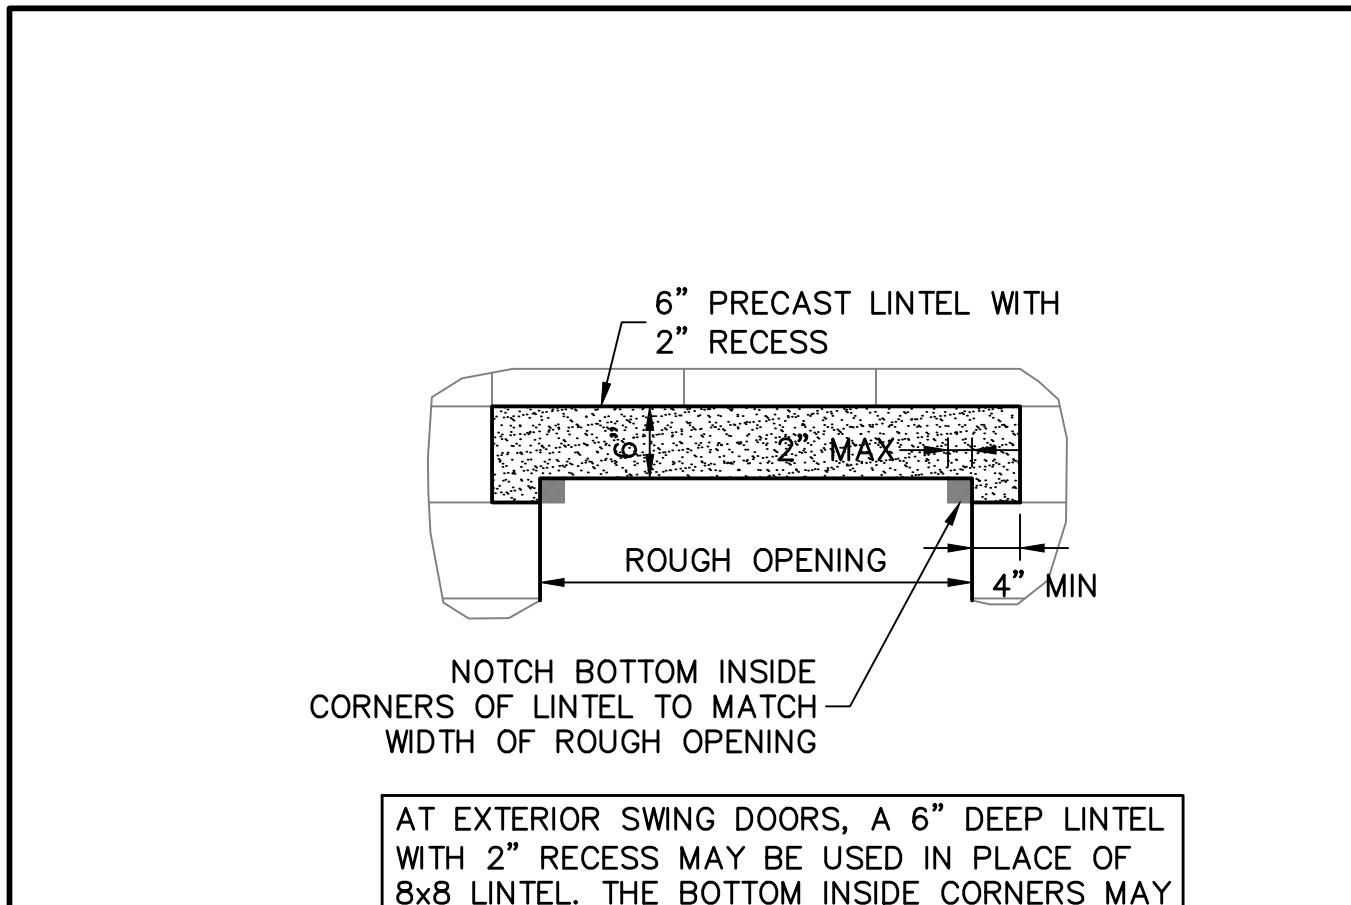

3 6" PRECAST LINTEL WITH 2" RECESS
SCALE: 3/4" = 1'-0"

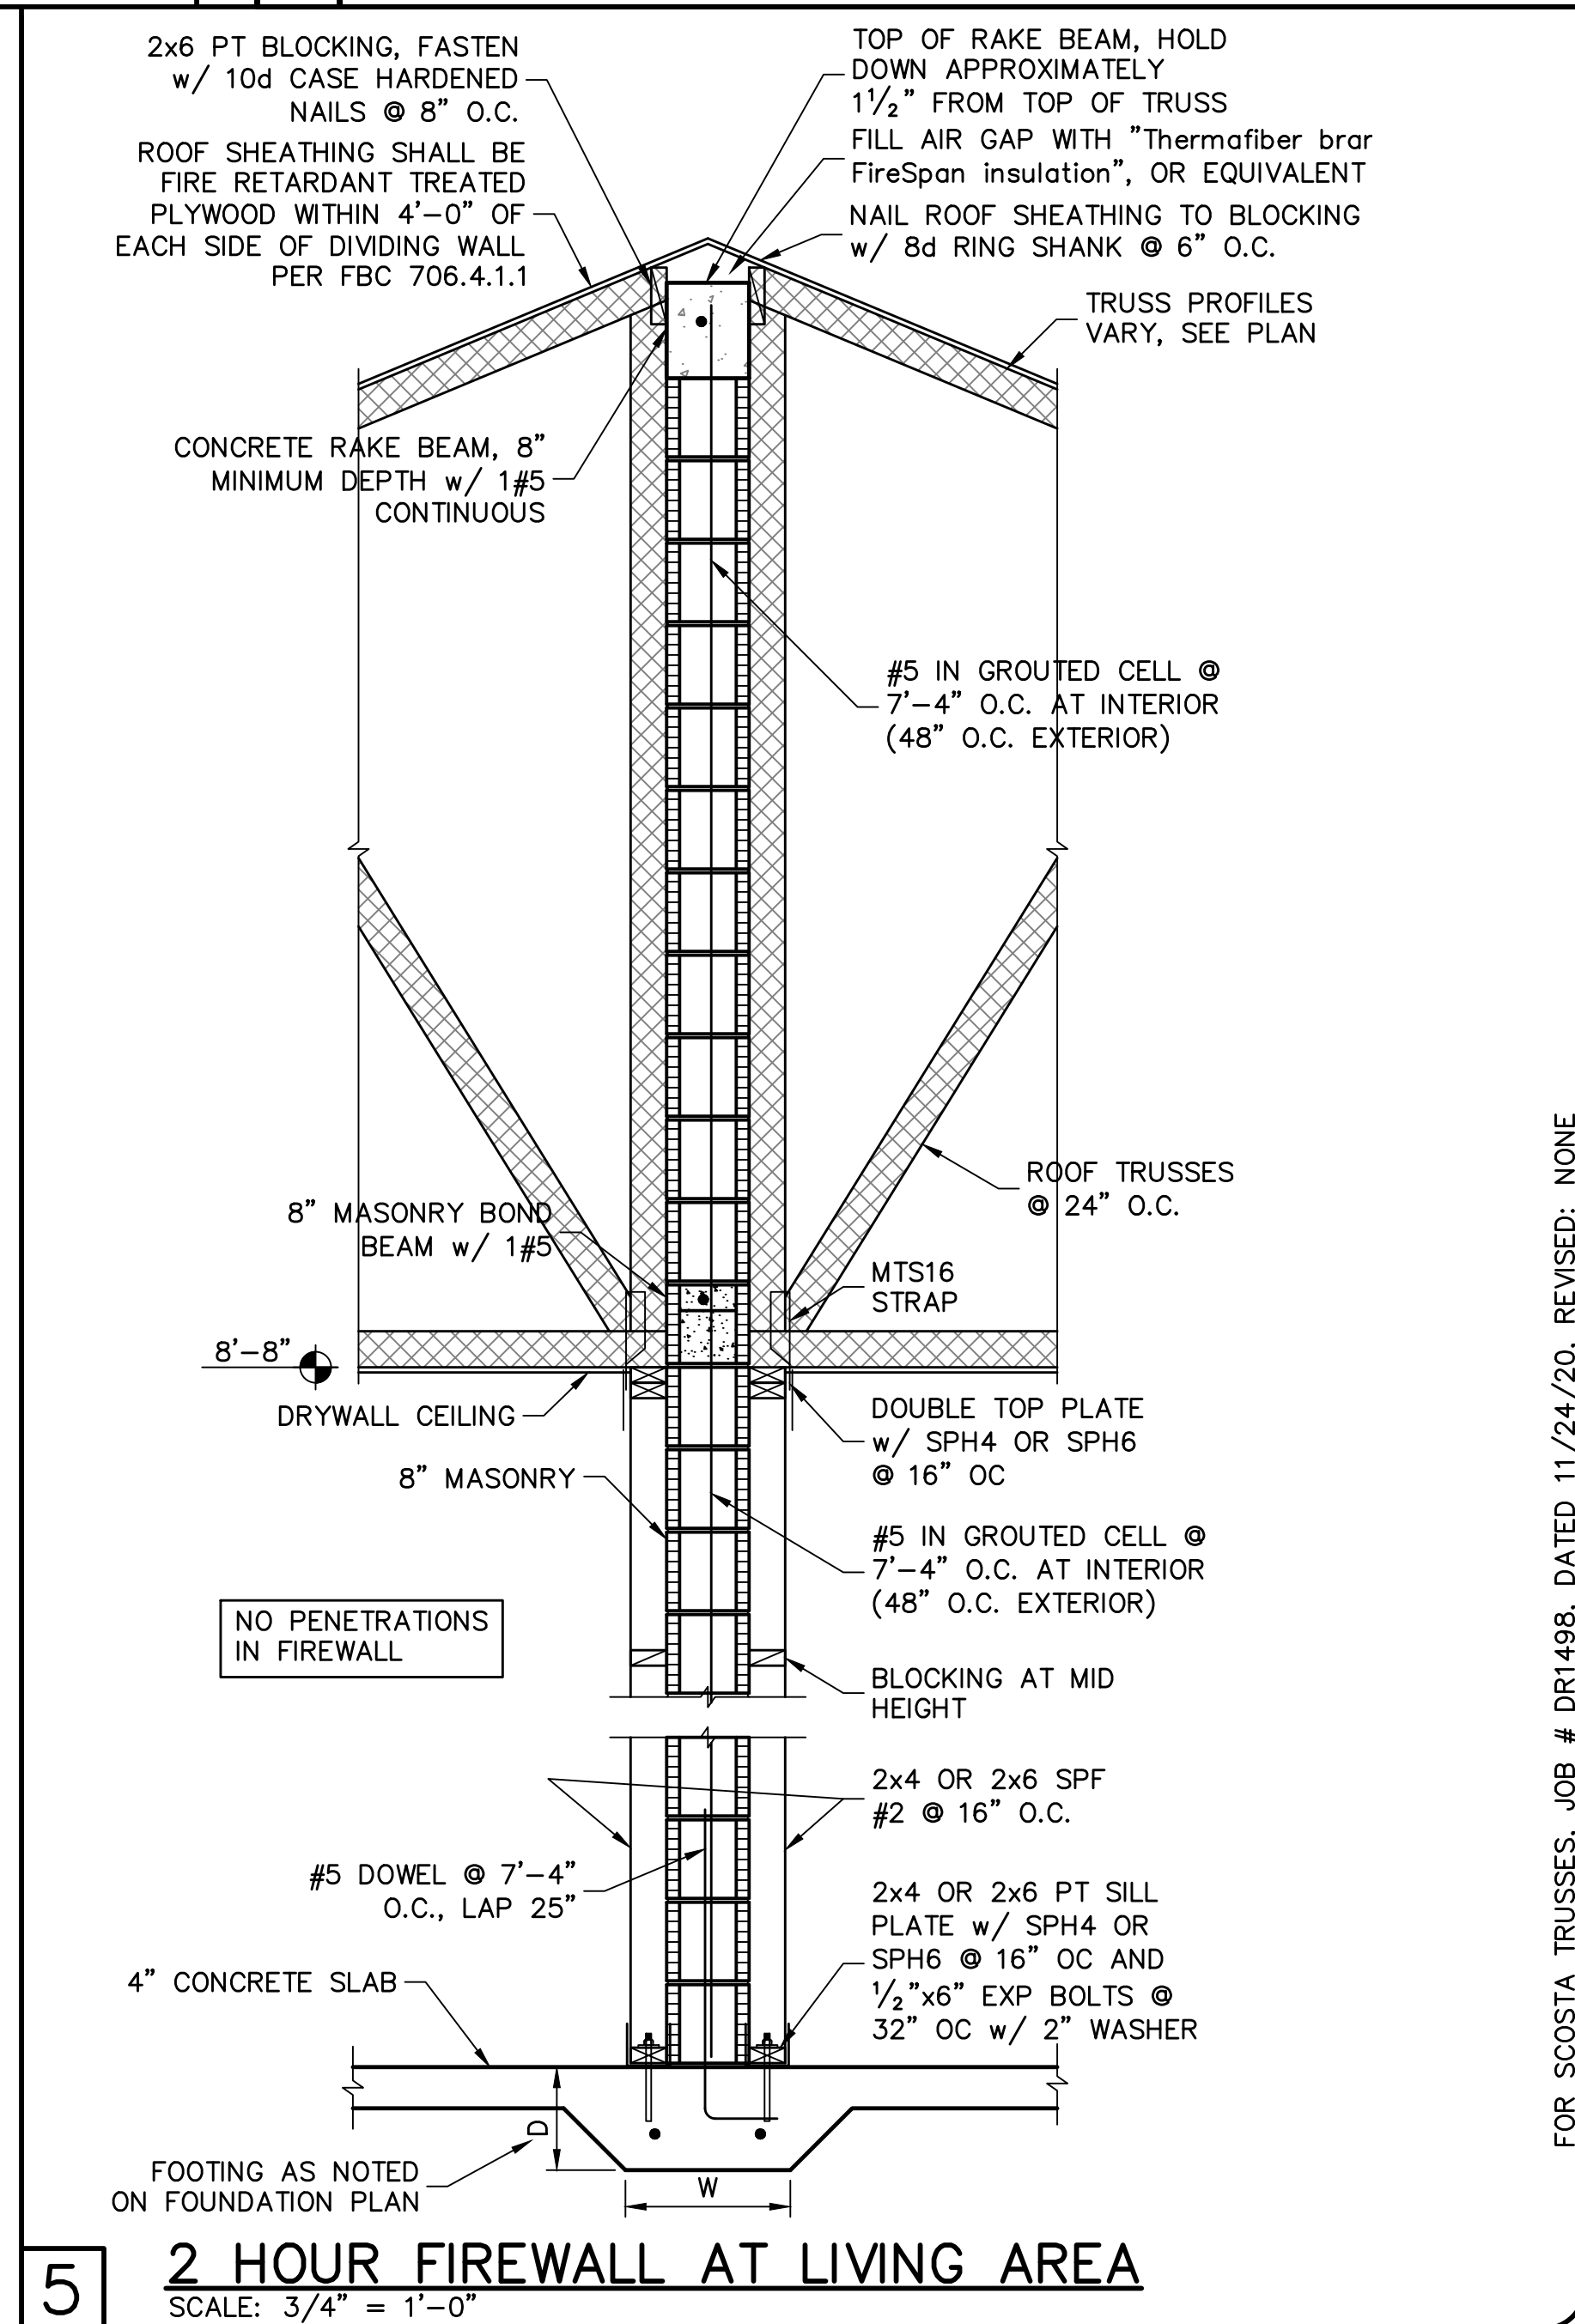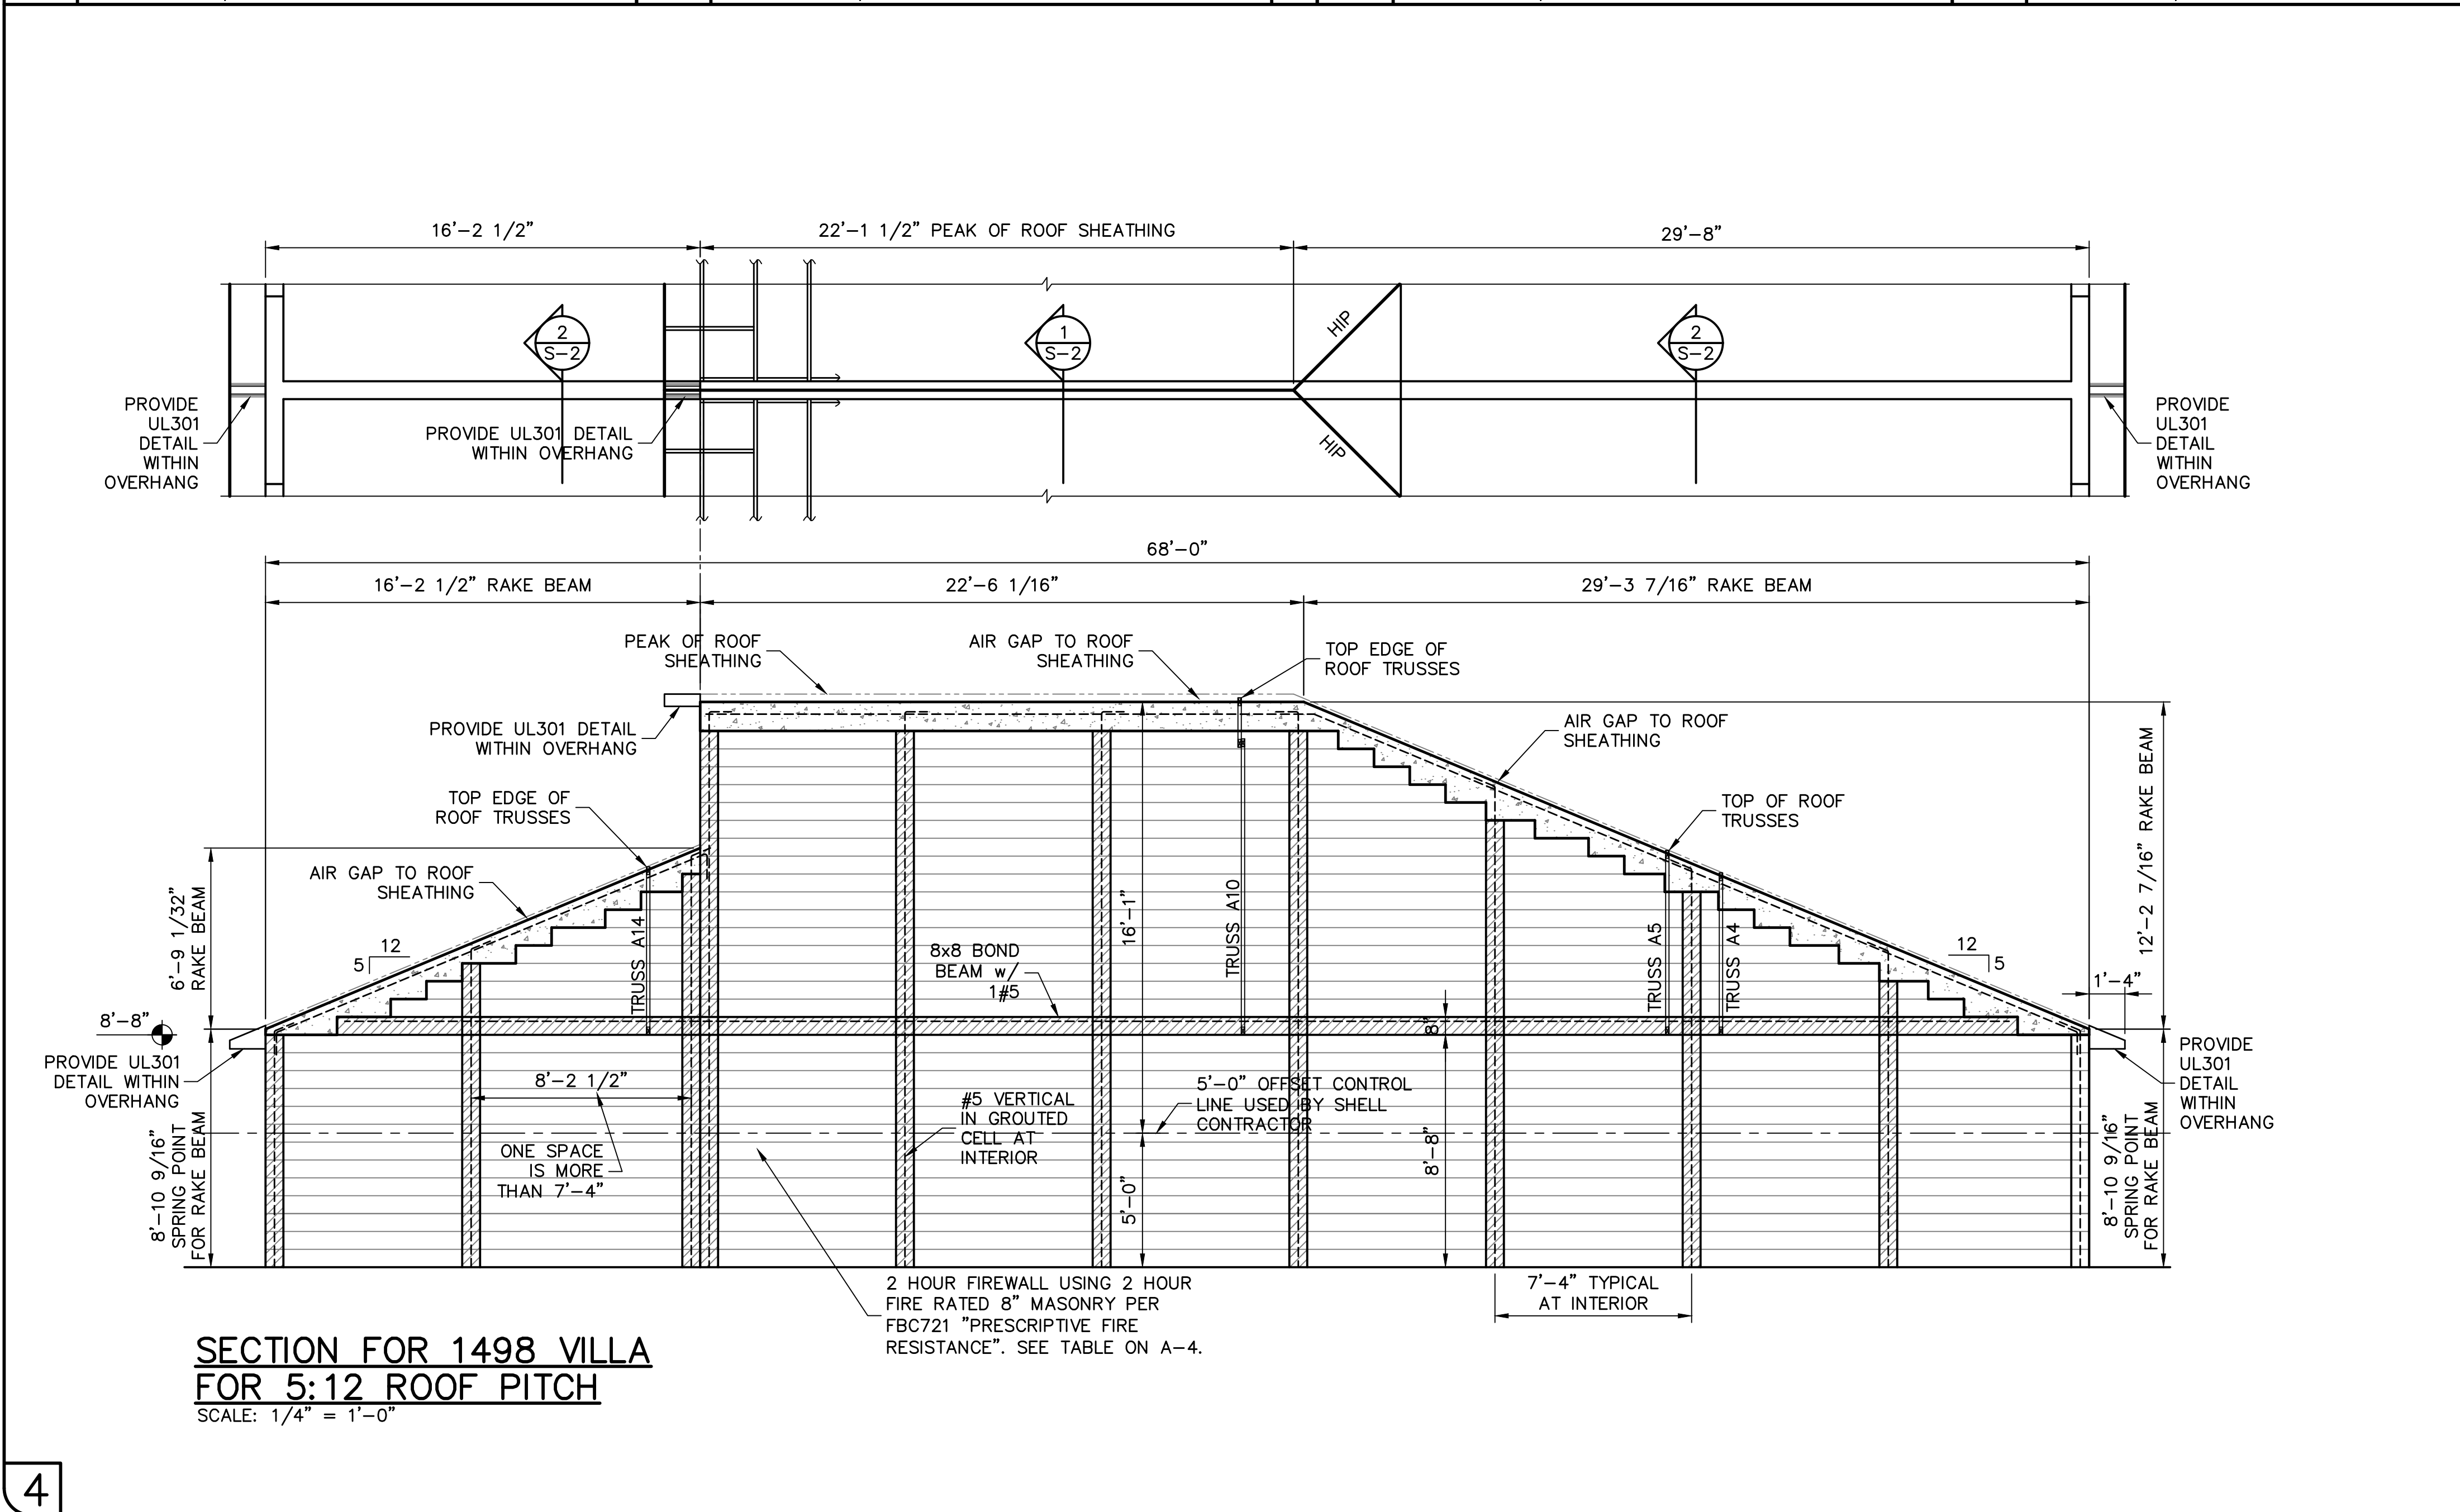

REVISIONS	BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1634 S.E. 47th STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8629

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 7th EDITION (2020) RESIDENTIAL

PROFESSIONAL SEAL
No. 88925
STATE OF FLORIDA
REGISTERED PROFESSIONAL ENGINEER

BUILDER:
D.R. HOHON
America's Builder

STRUCTURAL DETAILS FOR
1498 SIGNATURE VILLA
7032 & 7040 WEST LENOX CIRCLE
PUNTA GORDA, FLORIDA
LOTS: 434-435 SUBDIVISION: WATERFORD

DESIGN/DRAWN
DWB/DWB
CHECKED
DWB
DATE
01/22/21
SCALE
AS NOTED
JOB NO.
DR 12196
SHEET

S-2

SHEET 2 OF 2

FOR SCOSTA TRUSSES, JOB # DR1498, DATED 11/24/20, REVISED: NONE