


(2) 4080 SL. GL. DOORS

6" SCORED BANDS ON SIDE AND REAR ELEVATION TYPICAL


REAR ELEVATION: "A"

SCALE: AS NOTED

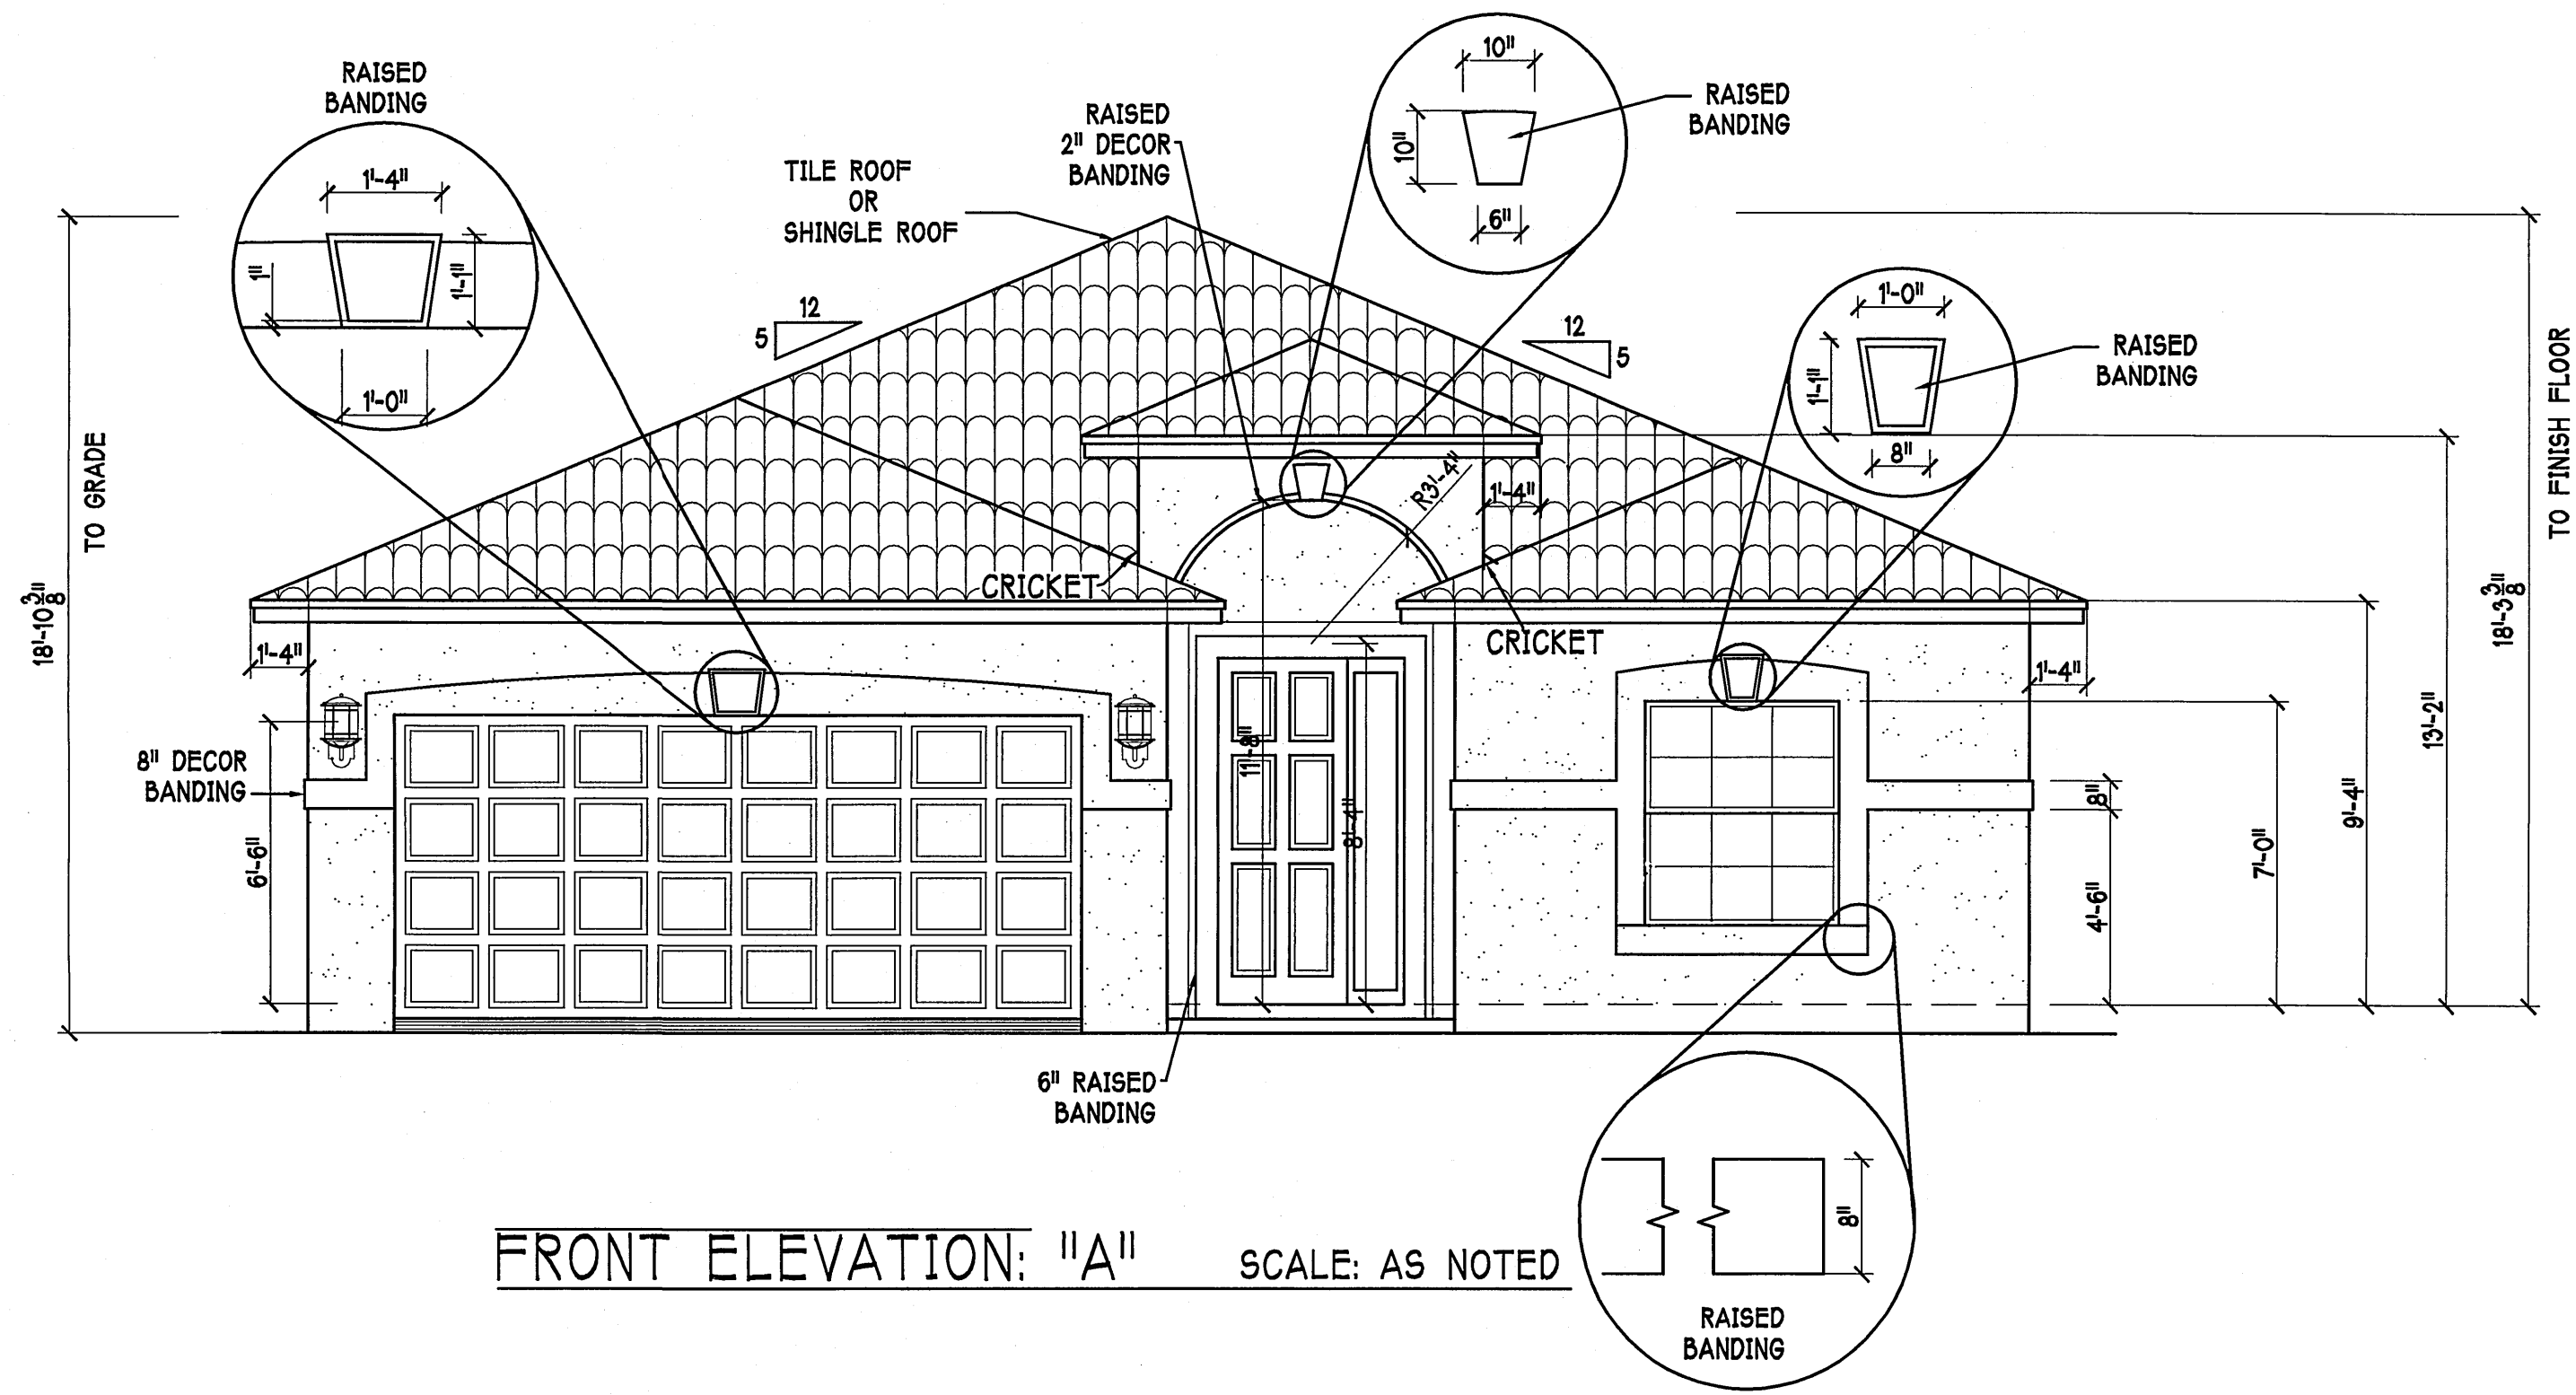


FRONT ELEVATION: "A"

SCALE: AS NOTED

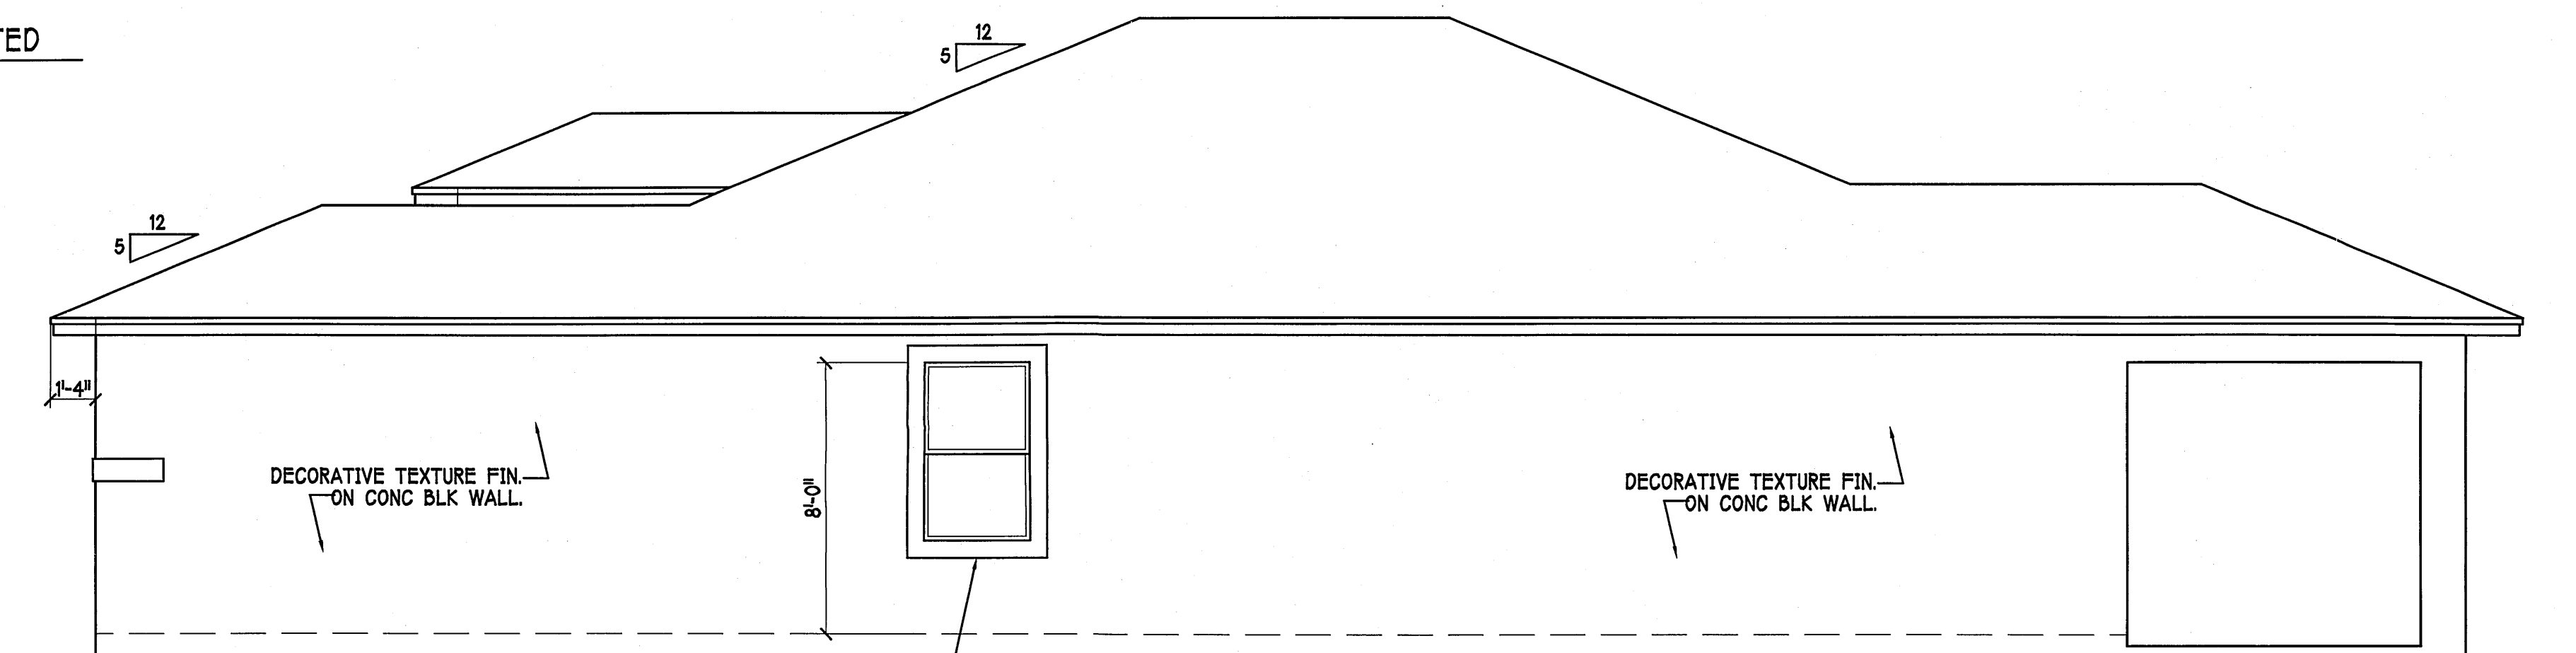

RIGHT SIDE ELEVATION: "A"

SCALE: AS NOTED

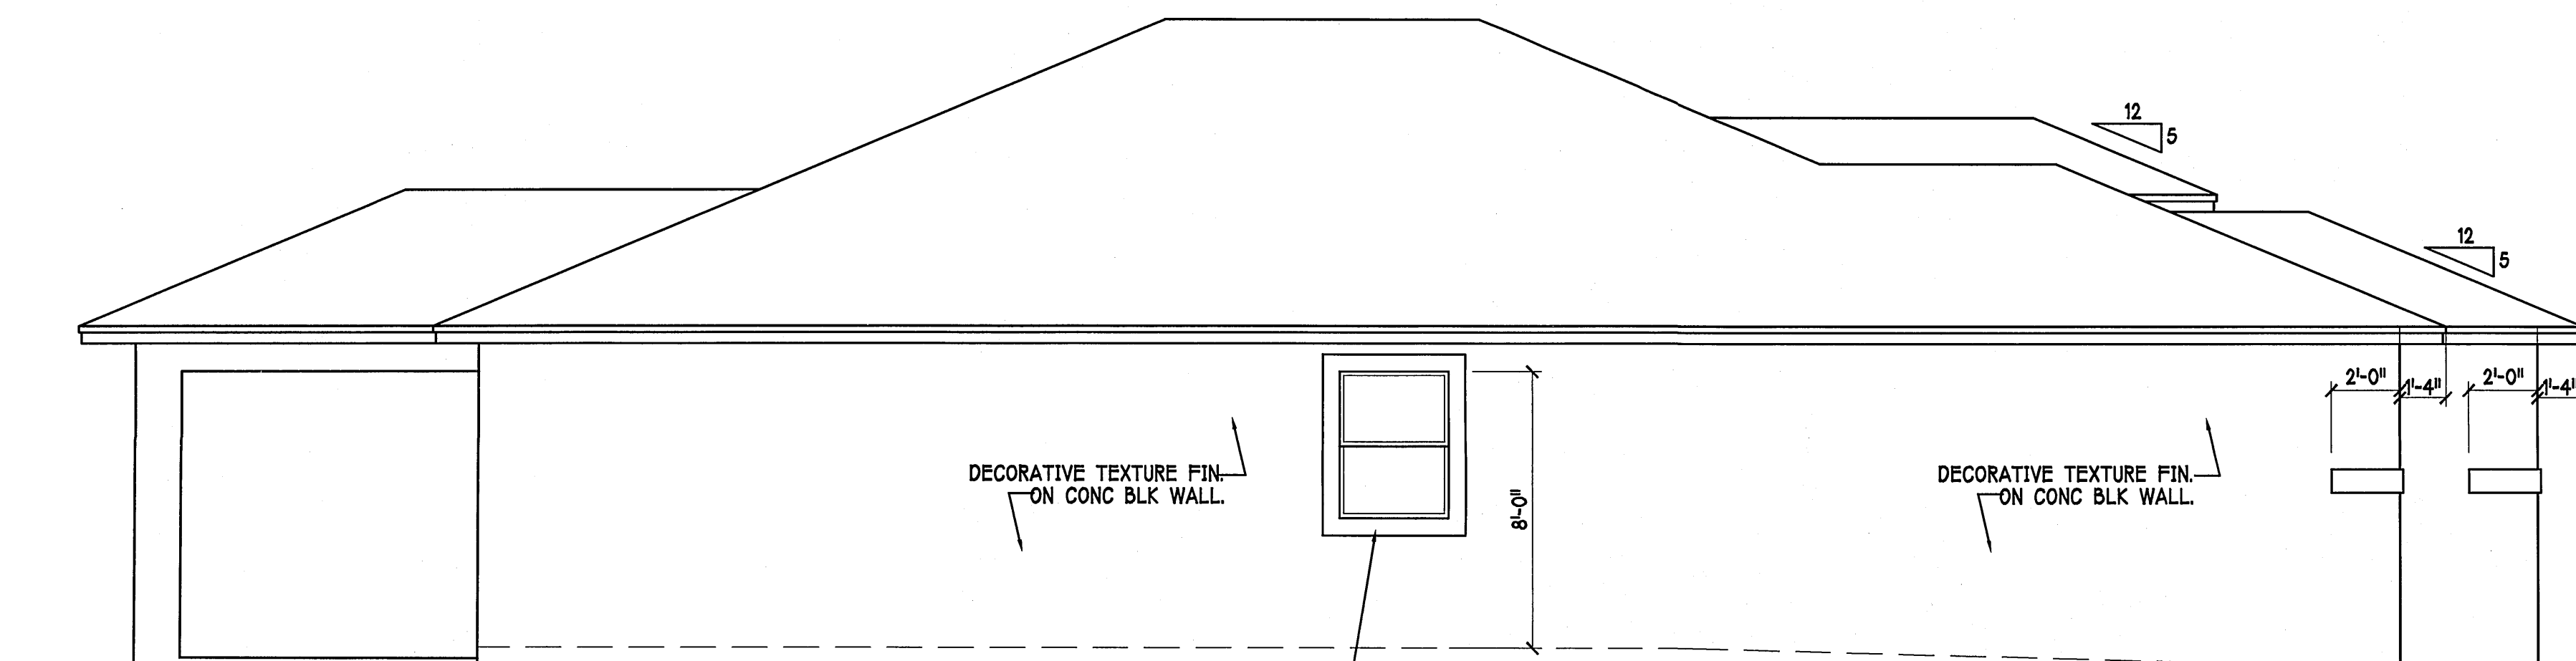

LEFT SIDE ELEVATION: "A"

SCALE: AS NOTED

9-17-10	MASTER REVISIONS
7-28-11	RECESS MSTR. SHOWER

DESIGN IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2010


D.R. HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759


STRUCTURAL
SYSTEMS
OF NORTH FLORIDA
INC.
JUN 9 7 2012
DATE: 6-26-12
G.C.D. JOB #: DR-2096

MODEL:	LOT: 3	BLOCK:
	SUBDIV: BUCKS RUN	
	ADDRESS: 7879 BUCKS RUN DR.	
	G.C.D. JOB #: DR-2096	

DATE:	6-26-12
DRAWN BY:	D.B.
CHECKED BY:	JWC
REVISED:	
PLAN:	ELEVATIONS
SCALE:	1/4" = 1'-0"
SHEET#	A1-A

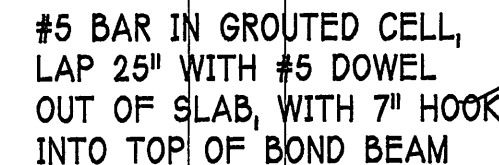


8F8-1B SET AT GARAGE DOOR
HEAD HEIGHT, ADD COURSE
AS REQUIRED TO 8X8 BOND
BEAM W/ 1 #5 TOP @ 9'-4".
ADD #5 VERT @ 48" O.C.
GROUT ALL SOLID.

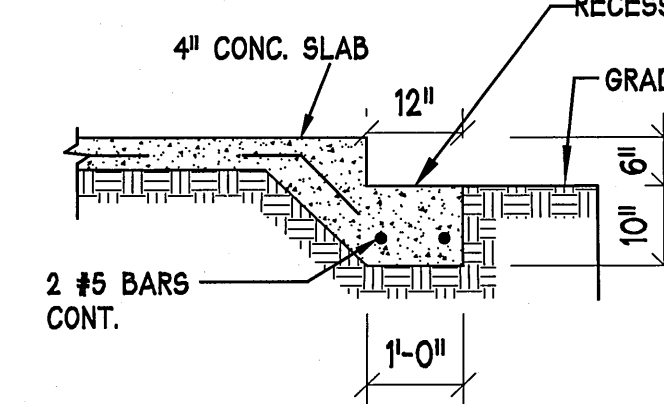


GARAGE DOOR RECESS


SCALE: 1/2" = 1'-0"

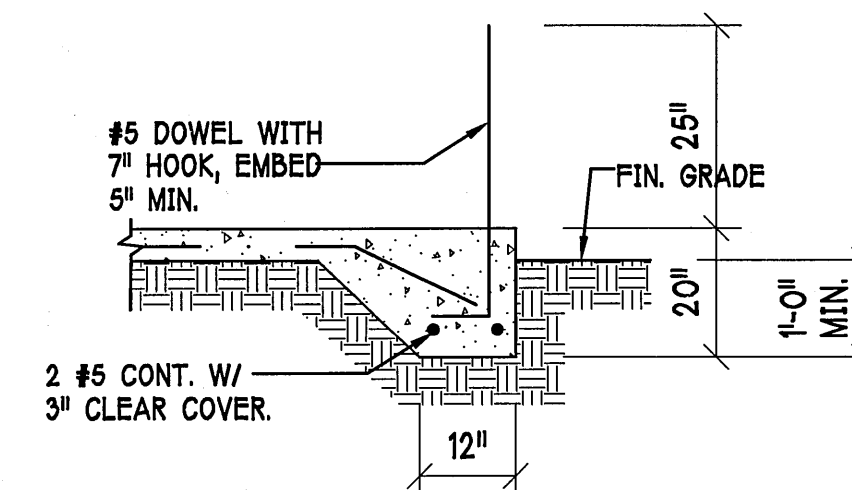


'F3' FOOTING

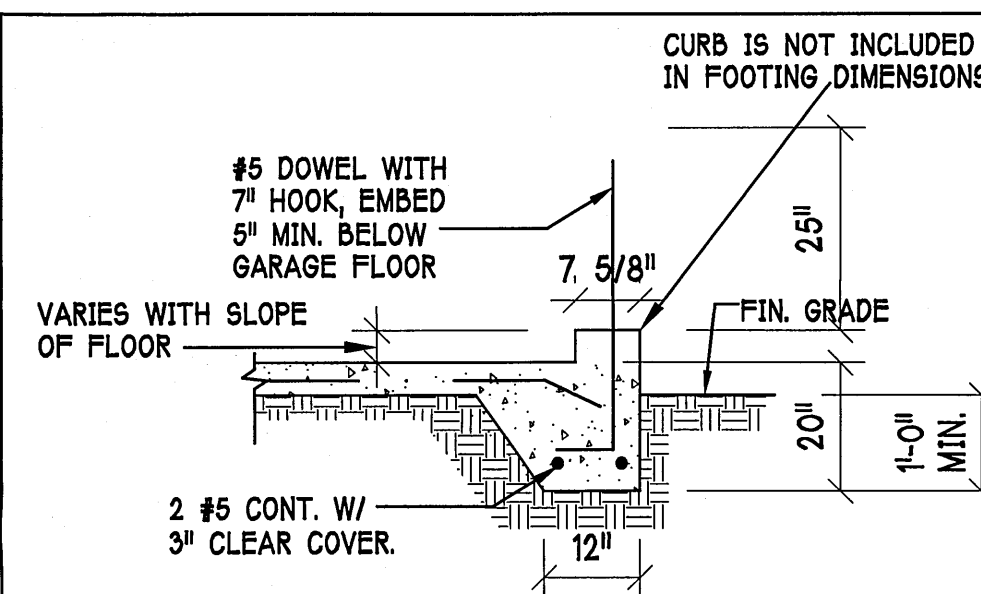


'F3' WITH CURB AT GARAGE

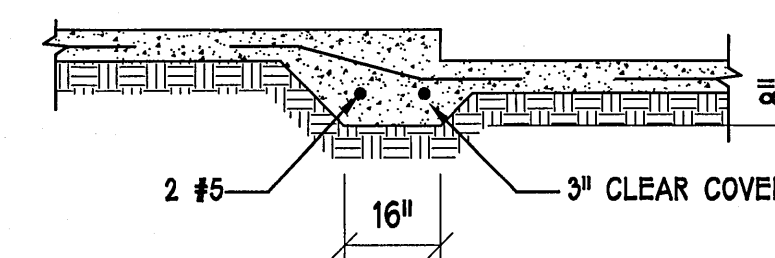

'F6' STEP DOWN

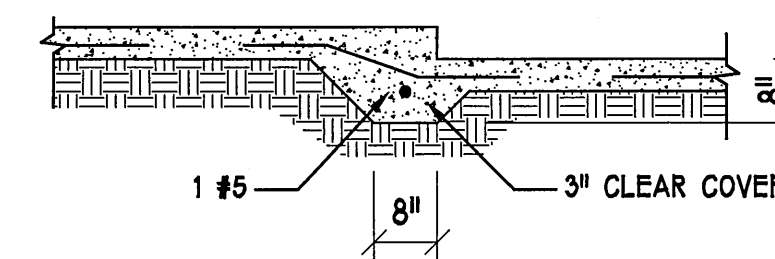

'F6A' STEP DOWN

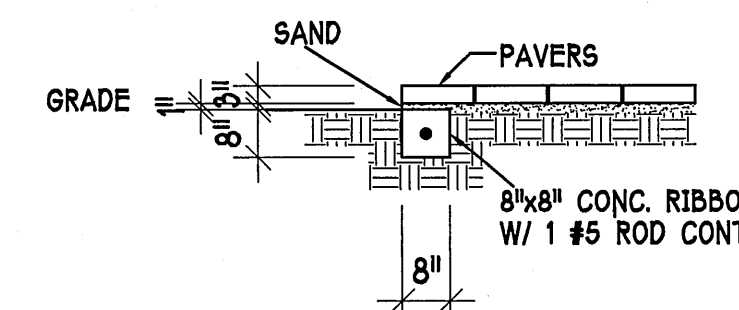

'P' PAVERS DETAIL ENTRY/LANA:









SCALE: 1/4" = 1'-0"

PLAN NOTES:

PLAN NOTES:

- 1) TOP OF GROUND FLOOR SLAB DATUM ELEVATION 0'-0".
- 2) 'F' DENOTES CONTINUOUS WALL FOOTING TYPE PER SCHEDULE THIS SHEET.
- 3) Ⓢ DENOTES PAD FOOTING AT CONCENTRATED LOADS PER SCHEDULE THIS SHEET.
- 4) PROVIDE #5 VERTICAL REINFORCING AT DOT LOCATIONS SHOWN ON PLAN FROM FOOTING TO BOND BEAM.
- 5) ALL DIMENSIONS ARE TO OUTSIDE FACE OF MASONRY WALLS. SOME SLAB EDGES MAY EXTEND BEYOND FACE OF WALL.
- 6) FOR DIMENSIONS OF ROUGH OPENINGS IN MASONRY WALLS, COORDINATE WITH WINDOW/DOOR SUPPLIER.
- 7) PROVIDE PRESSURE TREATED BUCKS AT WINDOWS / DOORS PER DETAIL 7/S-1 AND TABLE 2 ON A-6.

PAD FOOTING SCHEDULE							
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINF.		REMARKS
					LONG WAY	SHORT WAY	
<input checked="" type="checkbox"/>	(A)	2'-6"	2'-6"	1'-0"	3-#5	3-#5	-
<input checked="" type="checkbox"/>	(B)	3'-0"	3'-0"	1'-0"	4-#5	4-#5	-
<input checked="" type="checkbox"/>	(C)	3'-6"	3'-6"	1'-0"	4-#5	4-#5	-
<input checked="" type="checkbox"/>	(D)	4'-0"	4'-0"	1'-2"	5-#5	5-#5	-
<input checked="" type="checkbox"/>	(E)	5'-0"	5'-0"	1'-2"	6-#5	6-#5	-

WALL FOOTING SCHEDULE						
USED	TYPE	LENGTH	WIDTH	DEPTH	BOTTOM REINFORCING	SHAPE
	F1	CONT.	1'-4"	0'-8"	2-#5	
	F2	CONT.	1'-8"	0'-10"	2-#5	
X	F3	CONT.	1'-0"	1'-8"	2-#5	
	F4	CONT.	1'-4"	1'-8"	2-#5	
	F5	CONT.	1'-4"	1'-0"	2-#5	
X	F6	CONT.	1'-4"	1'-0"	2-#5	
	F6A	CONT.	8"	8"	1-#5	
	TE	CONT.	0'-8"	0'-8"	1-#5	

ADD CURB TO
GARAGE, SEE
DETAIL

**Gulf Coast Drafting
& Design**
Phone (239) 540-1822
Fax (239) 540-7759

This document and all its contents are to be used **exclusively** by the Structural Systems of North Florida (SSNF) for the purpose of Structural Engineering only. No work was performed by the SSNF in connection with this document. The SSNF is not responsible for the design, construction, or use of any other building system or equipment, including but not limited to, mechanical, plumbing, electrical, fire, life safety, or other building systems. The SSNF is not responsible for the design, construction, or use of any other building system or equipment, including but not limited to, mechanical, plumbing, electrical, fire, life safety, or other building systems.

STRUCTURAL ENGINEERING

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 SE. 47th ST. SUITE #3
CAPE CURAL, FL 33904
(239) 545-4554

CAN 8829

JUN 27 2012

06 06 2012

06 06 2012

MODEL:	UNIT 1804	LOT: 3	BLOCK :
		SUBDIV: BUCKS RUN	
RESIDENCE FOR:		ADDRESS: 7879 BUCKS RUN DR.	
SPEC		G.C.D. JOB # : DR-2696	


DATE:	6-26-12
DRAWN BY:	D.B.
CHECKED BY:	JWC
REVISED:	
PLAN:	FOUNDATION
SCALE:	1/4" = 1'-0"
SHEET#	

A2-A

DESIGN IN ACCORDANCE WITH
THE FLORIDA BUILDING CODE 2010

FOUNDATION PLAN: "A"

SCALE: 1/4"=1'-0"

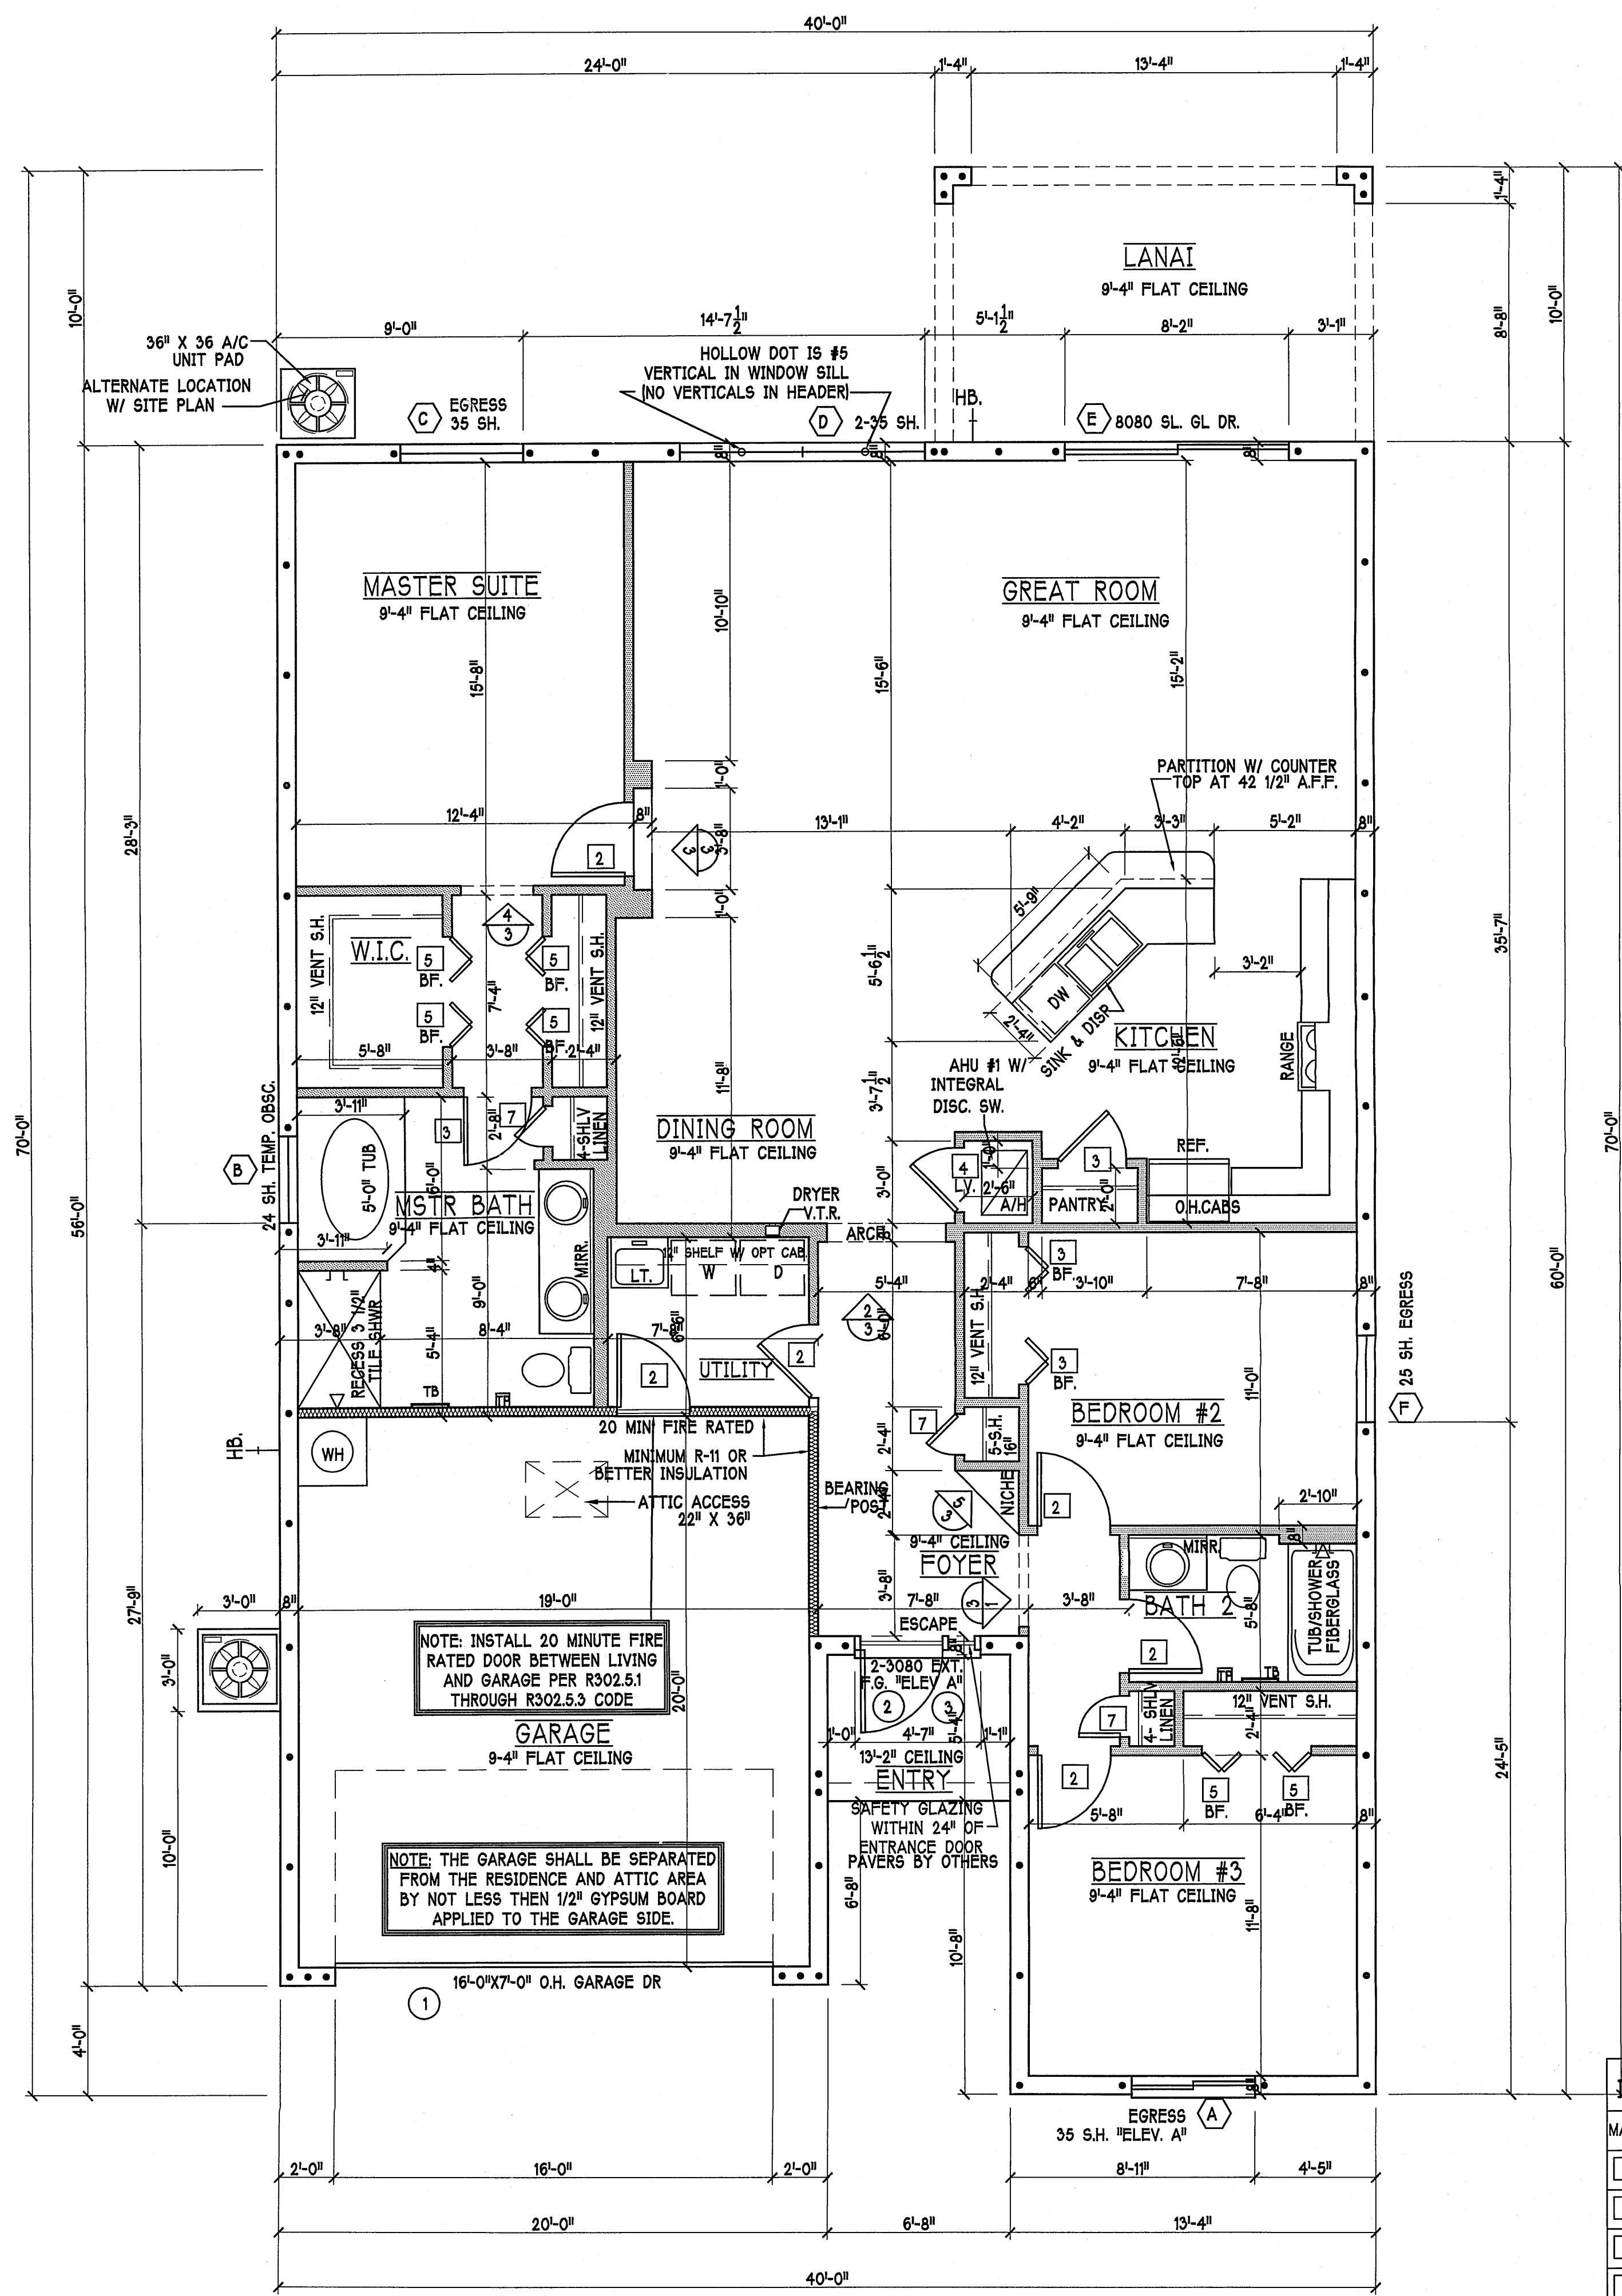

FLOOR PLAN: "A" SCALE: 1/4"=1'-0"



MARK	DOOR WIDTH	NOTES
1	3'-0"	PK. = POCKET DOOR
2	2'-8"	B.F. = BI-FOLD DOOR
3	2'-6"	B.P. = BI-PASS DOOR
4	2'-4"	LV. = LOUVERED DOOR
5	2'-0"	
6	1'-8"	
7	1'-6"	

SQUARE FOOTAGE	
TOTAL LIVING AREA	1804'
GARAGE AREA	408'
ENTRY AREA	37'
LANAI AREA	160'
TOTAL AREA	2409'


PROVIDE SAFETY GLAZING WITHIN 24" FROM EXIT DOOR.
(PER FLORIDA BUILDING CODE-R308.3.1)

NOTE:
PROVIDE SAFETY GLAZING AT BATH/SHRW.
SHALL COMPLY WITH R 308.3.1


**** NOTE: ****
STUB OUT FOR GAS @ OUTDOOR KITCHEN, RANGE, WATER HEATER, AND DRYER. VERIFY WITH CONTRACT AND SUBDIV. SPECS. A SEPARATE PERMIT IS REQUIRED FOR GAS PIPING.

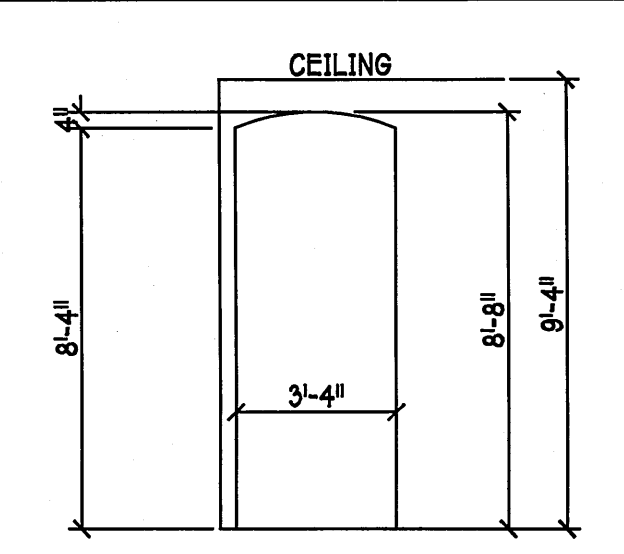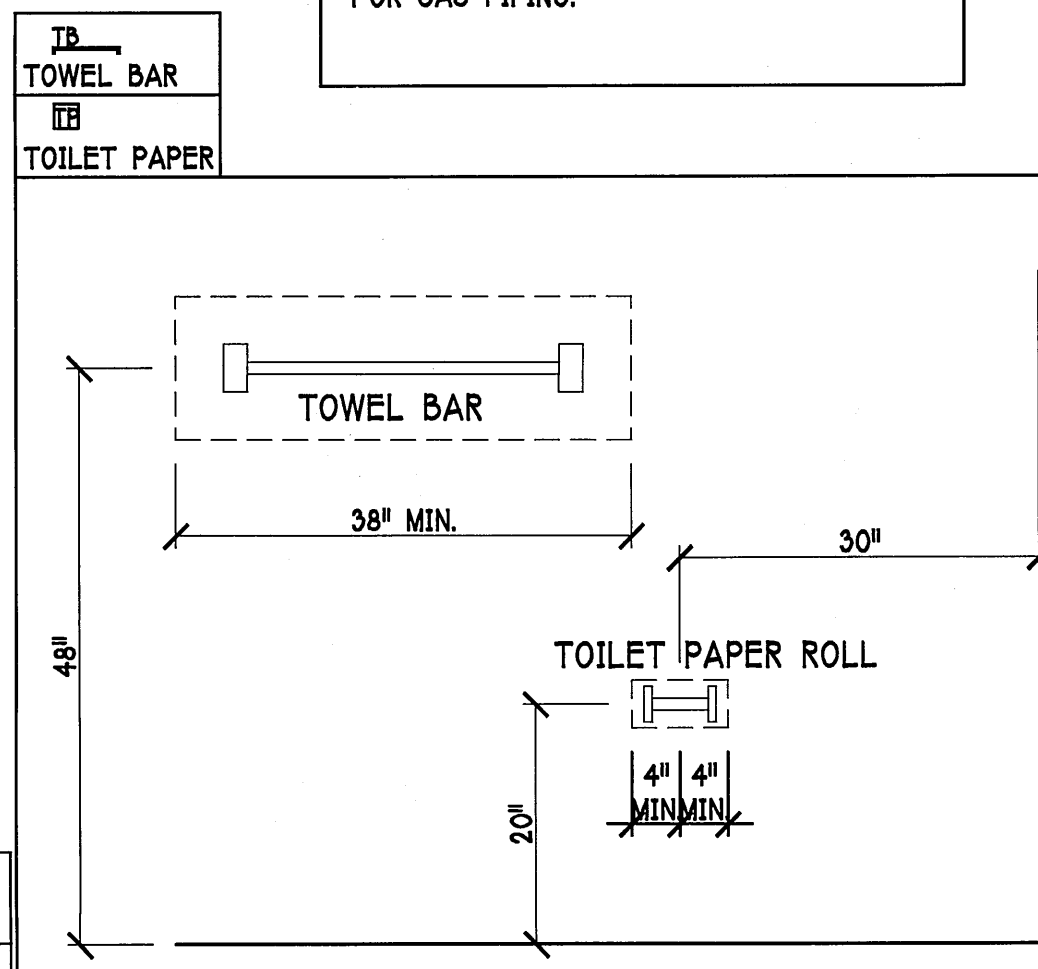


GUEST HALL DETAIL

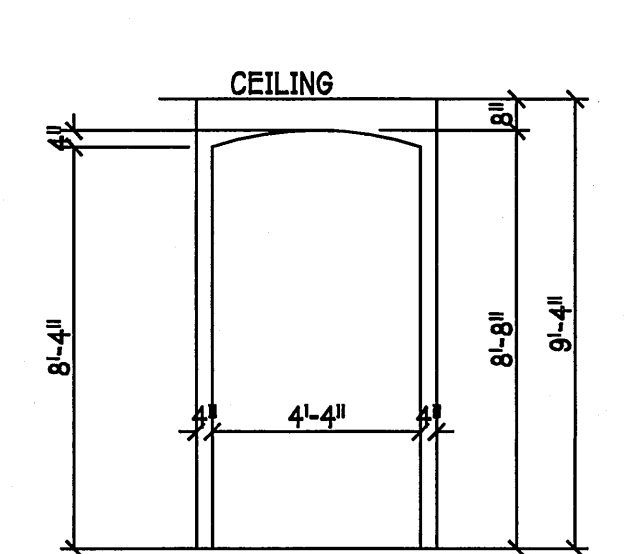

DINING/FOYER DETAIL

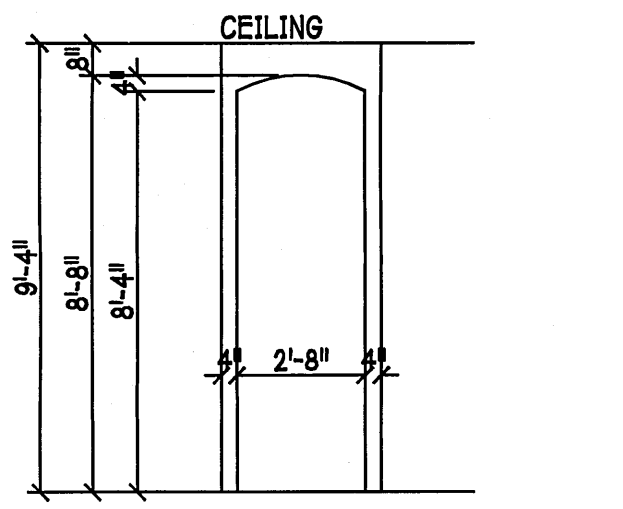

MASTER SUITE DETAIL

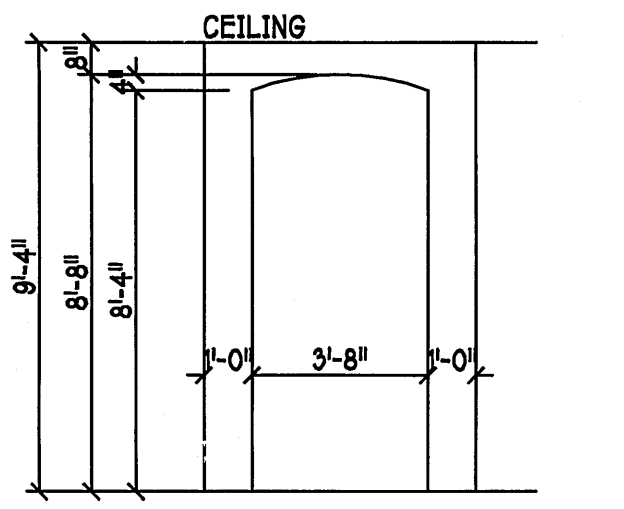

MASTER SUITE DETAIL

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE B, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. Vmax=132 MPH						
MARK	SIZE CODE	PRODUCT DESCRIPTION	DOOR WIDTH	DOOR HEIGHT	ZONE	WIND PRESSURE
1	OVERHEAD	GARAGE DOOR	192	84	4&5	+23.3/-26.0
2	SWING DOOR		36	80	4	+27.7/-30.0
3	12\"		80	5	4	+27.7/-37.0
3	SIDE LITE		12	80	5	+27.7/-37.0

WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE B, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. Vmax=132 MPH						
MARK	SIZE CODE	PRODUCT DESCRIPTION	ZONE	WIND PRESSURE	WIND-BORNE DEBRIS PROTECTION	QTY
A	35	SH	4	+27.7/-30.0	SHUTTERS	1
B	24 OBS.	SH	4	+27.7/-37.0	SHUTTERS	1
C	35	SH	4	+27.7/-37.0	SHUTTERS	1
D	2-35	SH	4	+27.7/-37.0	SHUTTERS	1
E	8080	SL. GL. DOOR	4	+24.4/-26.7	SHUTTERS	1
F	25	SH	4	+24.4/-30.6	SHUTTERS	1
			5	+27.7/-37.0	SHUTTERS	1

FRAMERS NOTES:
NON BEARING INTERIOR FRAME WALLS SHALL BE FRAMED W/ WOOD OR METAL STUDS. SPACING ON STUDS SHALL NOT EXCEED 24" O.C.
NON BEARING WALLS ONLY.

- PLAN NOTES:**
- SEE EXTERIOR ELEVATION SHEET FOR DETAILS OF ALTERNATE WINDOW ARRANGEMENTS, ENTRY WALKS AND ADDITIONAL WALKS.
 - KITCHEN KNEE WALL 42 1/2" TO TOP USING 2x4 TOP PLATE.
 - MEDICINE CABINETS OPENING 14x18 TOP OF OPENING @ 72" / 5" OFF WALL.
 - JOB MUST BE BROOM SWEEP EVERYDAY.
 - VERIFY ROUGH OPENING DIMENSIONS FOR ALL WINDOWS AND DOORS.
 - PROVIDE DEAD WOOD IN ATTIC FOR OVERHEAD GARAGE DOOR HARDWARE.
 - INSTALL SMOOTH WALLS IN KITCHEN AND ALL BATHROOM AREAS.
 - WHERE DRYWALL CEILING IS APPLIED TO TRUSSES AT 24" O.C. USE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5.

CABINET BACKING		
KITCHEN	UPPER TOP @ 54", 84" & 96"	BASE TOP @35"
	MICROWAVE @ 102"	
MASTER BATH	UPPER	BASE- TOP @35"
GUEST BATH	UPPER	BASE- TOP @35"
LAUNDRY RM.	UPPER TOP @84"	BASE

BATHROOM NOTES

ALL TUB DECKS @ 2" A.F.F.

ALL BLOCKING TO BE PT IN SHOWERS

DOOR HEADERS		
6'-8" BIFOLD	HEADER HEIGHT	82" A.F.F.
6'-8" SWING	HEADER HEIGHT	82 1/2" A.F.F.
8'-0" SWING	HEADER HEIGHT	98 1/2" A.F.F.

VINYL SHELF NOTES:

1) ALL CLOSET SHELVES TO BE 12"

2) ALL PANTRY & LINEN TO BE 14" 16" SHELVES 18" O.F.F. WITH 15" INCREMENT.

DESIGN IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2010

Gulf Coast Drafting & Design
Phone (239) 540-1822
Fax (239) 540-7759

MODEL: LOT: 3 SUBDIV: BUCKS RUN UNIT 1804

RESIDENCE FOR: SPEC

DATE: 6-26-12
DRAWN BY: D.B.
CHECKED BY: JWC
REVISIONS:
PLAN: FLOOR
SCALE: 1/4" = 1'-0"
SHEET#

A3-A

TRUSS BEARING CONDITIONS AND STRAPPING IS BASED ON TRUSS LAYOUT PREPARED BY SOUTHERN TRUSS COMPANIES, INC. JOB # 210945

- PLAN NOTES:
- 1) ROOF TRUSS BEARING ELEVATION VARIES, SEE LEGEND.
 - 2) ROOF FRAMING SHALL BE WOOD TRUSSES DESIGNED BY A DELEGATED TRUSS ENGINEER PER DESIGN CRITERIA ON SHEET S-1.
 - 3) PROVIDE STRAPPING AT TRUSSES PER NOTES ON THIS SHEET.
 - 4) FOR NAILING OF ROOF DECK, SEE 1 AND 2 ON S-1.
 - 5) [8F8-1B] etc., DENOTES PRECAST LINTEL ABOVE DOOR/WINDOW OPENING PER SCHEDULE THIS SHEET.
 - 6) AT TRUSS BEARING, PROVIDE 8x8 MASONRY BOND BEAM W/ 1 #5 CONTINUOUS, SEE DETAIL 2/A-6.

TRUSS STRAPPING TO MASONRY


	MAX TRUSS UPLIFT @ 24" OC (LBS)	CONNECTOR	FASTENER
INSTALL META16 AT ALL TRUSSES TO 1450 UPLIFT. FOR HIGHER UPLIFTS, SEE NOTES ON PLAN.	1450	(1)META16 TO 40	9-10dx1 1/2", EMBED 4"
	1810	(1)HETA16 TO 40	10-10dx1 1/2", EMBED 4"
	2235	(1)HETA16 TO 40	12-10dx1 1/2", EMBED 4"
	1985 (1 PLY)	(2)META12 TO 40	12-10dx1 1/2", EMBED 4"
	1900 (2 PLY)	(2)META12 TO 40	14-16d, EMBED 4"
	2500 (2 PLY)	(2)HETA12 TO 40	14-16d", EMBED 4"
	2500 (2 PLY)	(2)HETA12 TO 22	14-16d", EMBED 4"

- NOTES:
- 1) PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE AND SUITABLE FOR THE GEOMETRY. EMBED STRAP ON C OF WALL.
 - 2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS. SUBSTITUTIONS MUST BE APPROVED IN WRITING BY THE ENGINEER OF RECORD.
 - 3) WHERE EMBEDDED STRAPS ARE MISSING, OR MIS-LOCATED, INSTALL RETROFIT STRAP PER 10/S-1.

REV 2

ATTIC VENTILATION

	WITHOUT OFF RIDGE VENTS	WITH OFF RIDGE VENTS
ATTIC AREA	VENTILATION REQUIRED [ATTIC AREA 1/150]	VENTILATION REQUIRED [ATTIC AREA 1/300]
2409 SQ. FT.	16.0 SQ. FT.	8.0 SQ. FT.

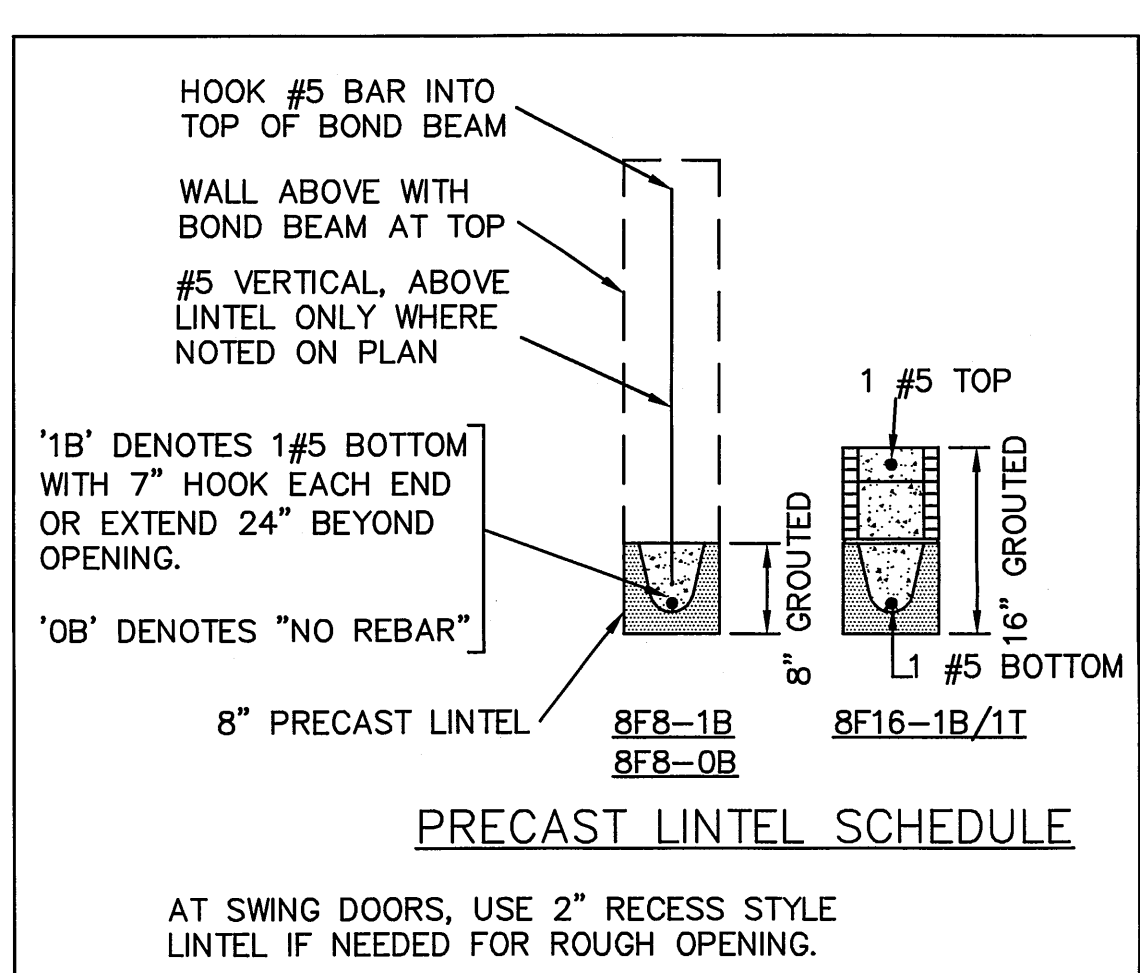

BEARING HEIGHT = 9'-4"	
BEARING HEIGHT = 13'-2"	

ROOF PLAN: "A" SCALE: 1/4"=1'-0"

D.R. HOUGHTON
America's Builder

Gulf Coast Drafting & Design
Phone (239) 540-1822
Fax (239) 540-7759


STRUCTURAL ENGINEERING
STRUCTURAL SYSTEMS
1834 SE 47th ST SUITE 402
CAPE CORAL, FL 33904
(239) 549-4554
FL REG #2552
JUN 9 7 2012

MODEL: LOT: 3 BLOCK: SUBDIV: BUCKS RUN
UNIT 1804 ADDRESS: 7879 BUCKS RUN DR.
RESIDENCE FOR: SPEC
G.C.D. JOB #: DR-2696

DATE: 6-26-12
DRAWN BY: D.B.
CHECKED BY: JWC
REVISED:
PLAN: ROOF FRAMING
SCALE: 1/4"=1'-0"
SHEET#

A4-A

DESIGN IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2010

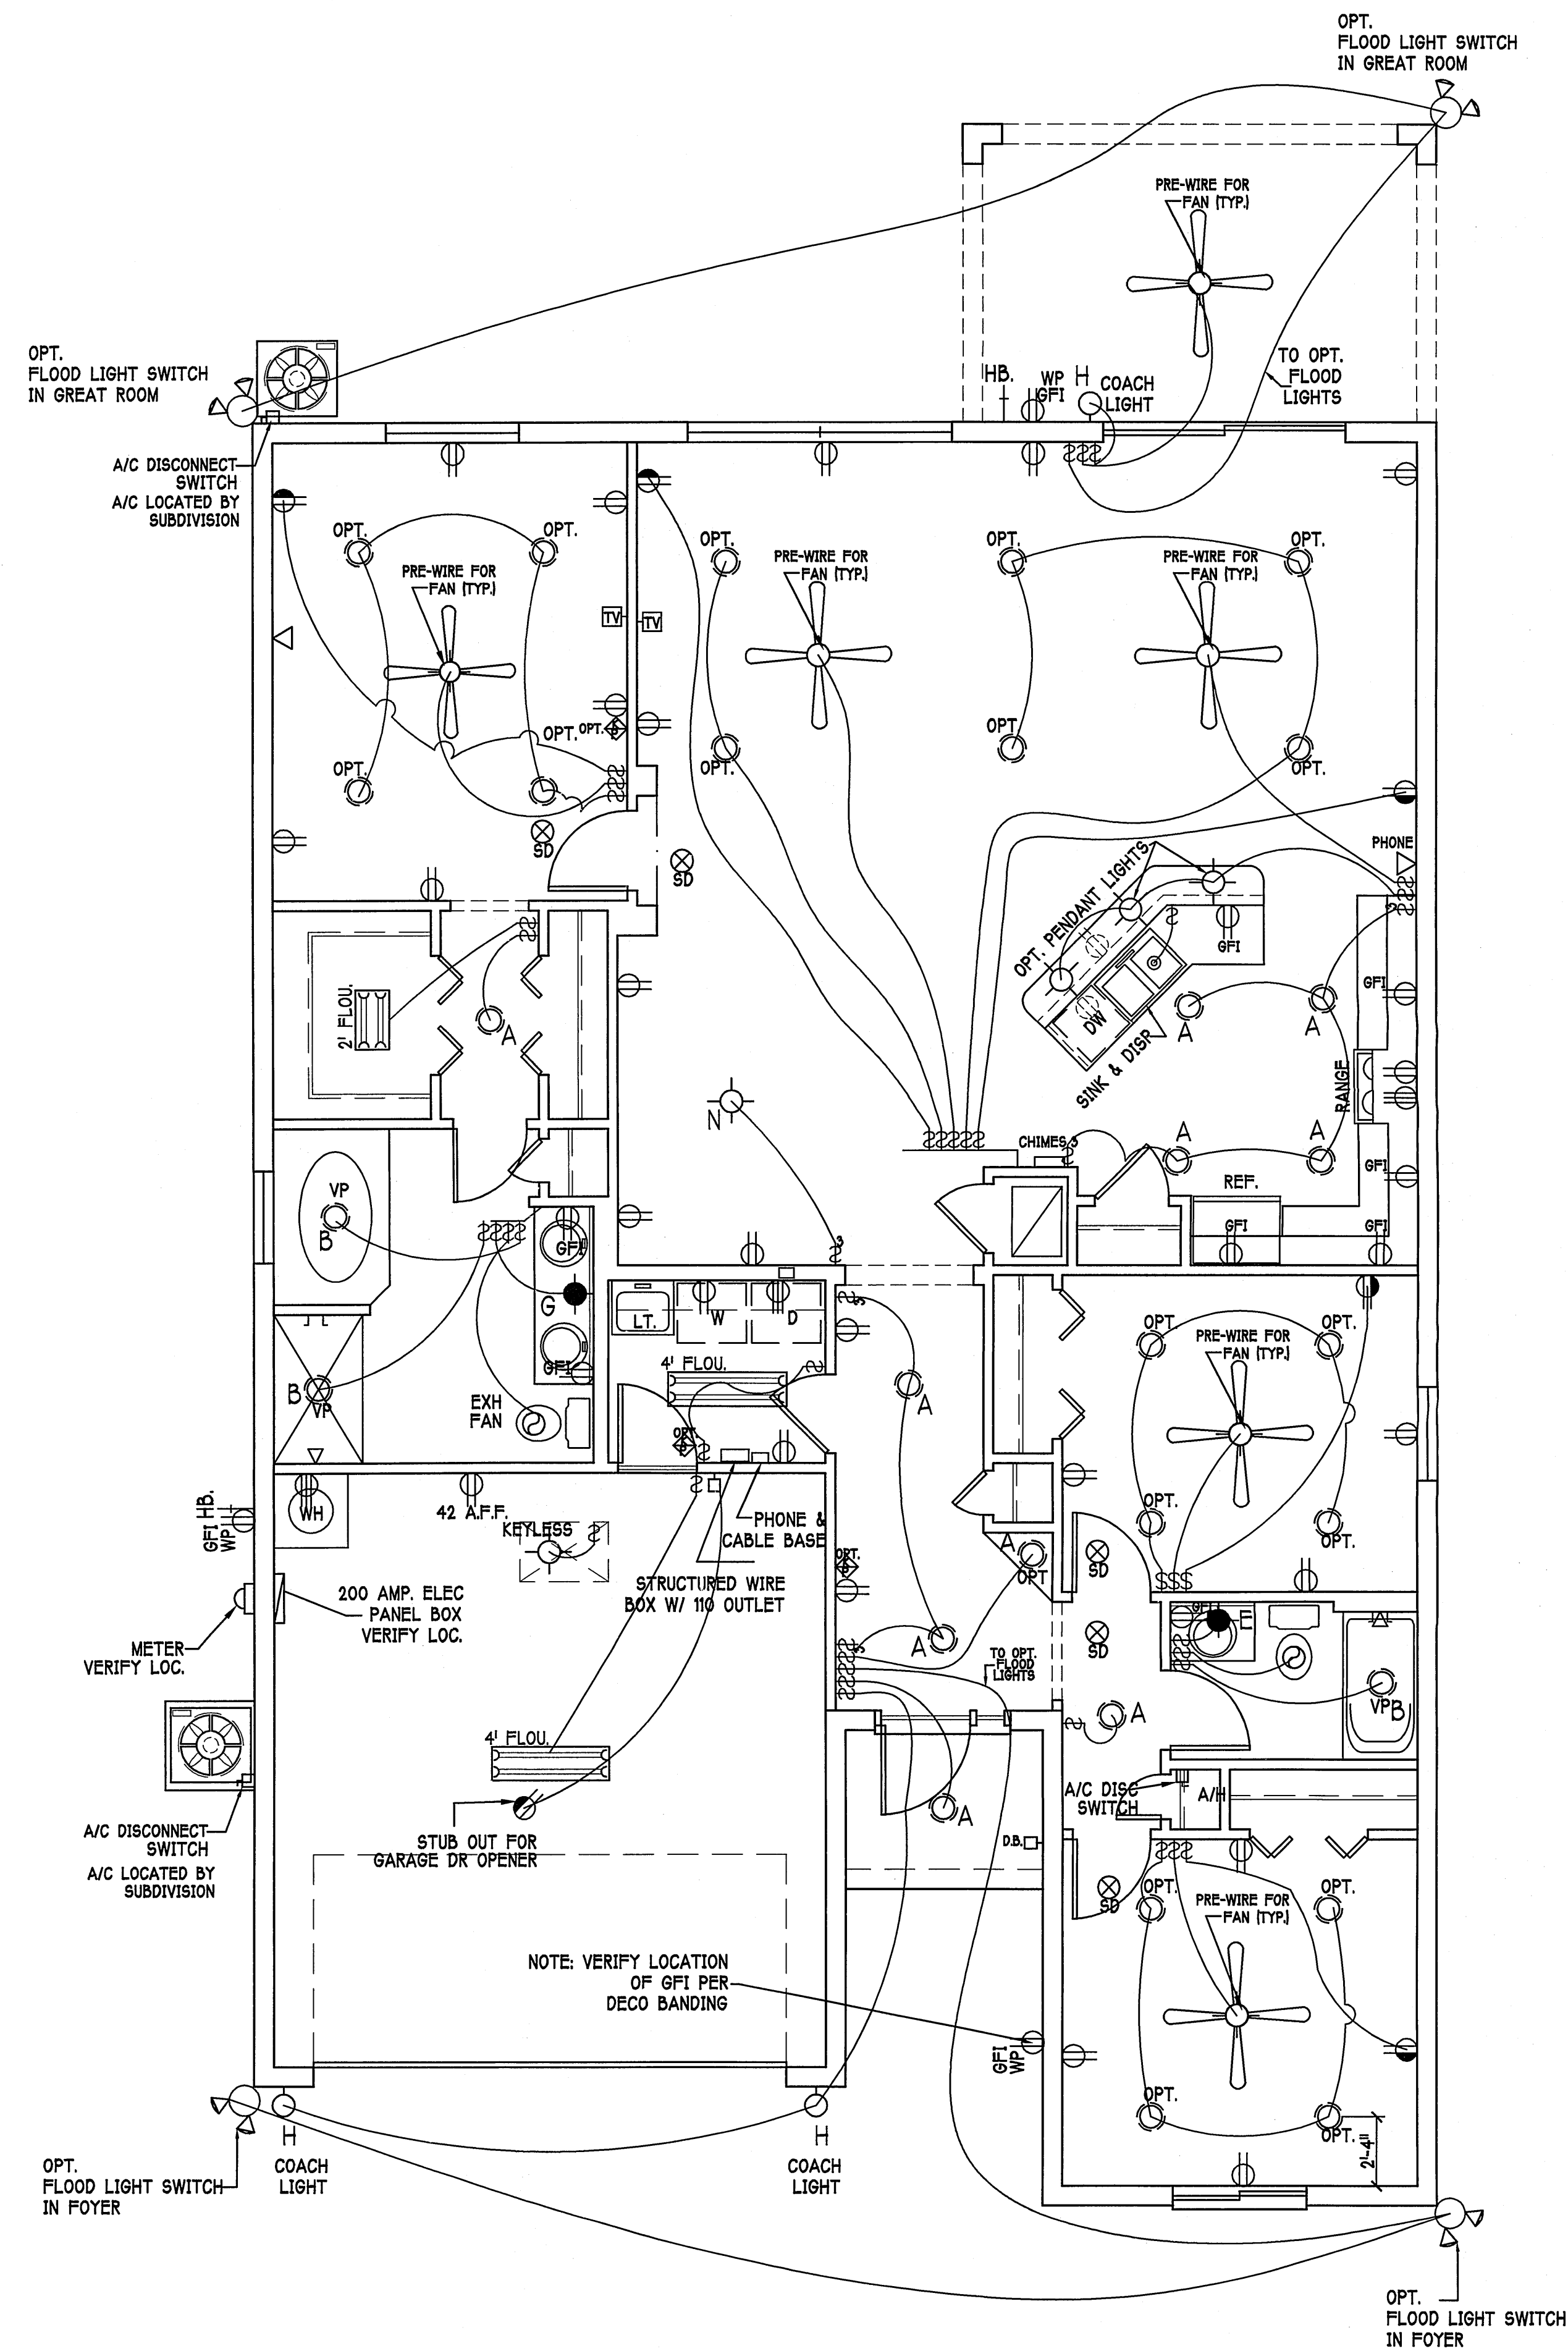


FLOOR ELECTRICAL PLAN: "A" SCALE: 1/4" = 1'-0"

OPTIONAL SANDOVAL ONLY

TV	2 RG6 CABLE 2 CAT5E INTERNET ALL BEDROOMS, STUDY AND STANDER TV AREAS
----	---

ELECTRICAL LEGEND

	ELECTRICAL METER
	ELECTRICAL PANEL
	120 V JUNCTION BOX
	SINGLE RECEPTACLE OUTLET
	220 V RECEPTACLE OUTLET
	4-PLEX RECEPTACLE OUTLET
	DUPLEX RECEPTACLE OUTLET
	1/2 SWITCHED DUPLEX OUTLET
	DUPLEX RECEPTACLE @ ELEV. A.F.F.
	TIMER SWITCH
	GFI SWITCH
	DIMMER SWITCH
	3 WAY SWITCH
	SINGLE POLE SWITCH
	AC/DC SMOKE DETECTOR TO BE INTERCONNECTED ANY RESIDENT HAVING A FOSSIL-BURNING HEATER OR APPLIANCE, A FIREPLACE, OR AN ATTACHED GARAGE SHALL HAVE AN OPERATIONAL CARBON MONOXIDE ALARM INSTALLED WITHIN 10 FEET OF EACH ROOM USED FOR SLEEPING PURPOSES. PER RULE 9B-3.04.72
	TELEPHONE OUTLET
	TELEVISION RECEPTION OUTLET
	SURFACE MOUNTED CEILING LIGHT
	RECESSED LIGHT
	WALL MTD. BRACKET LIGHT
	DUPLEX FLOOD LIGHT
	EXHAUST FAN
	TRACK MTD. LIGHTS
	A/C DISCONNECT
	PUSH BUTTON
	DOOR BELL
	KEYPAD
	4' FLUORESCENT LIGHT
	2' UNDER COUNTER LIGHT

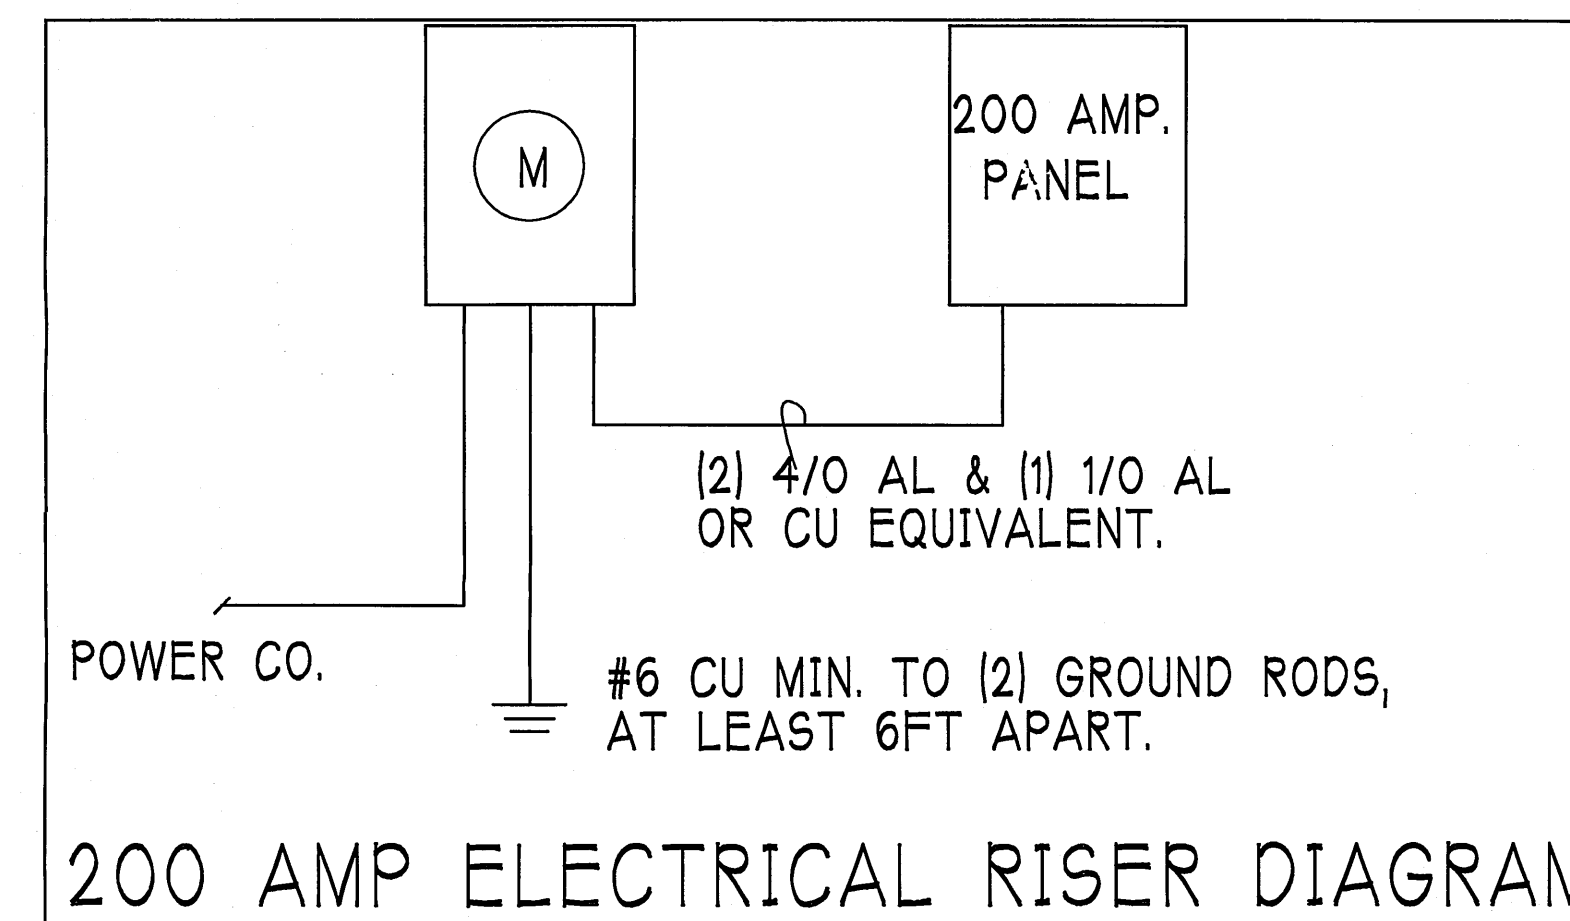

OPTIONAL SANDOVAL ONLY

TV	2 RG6 CABLE 2 CAT5E INTERNET
----	---------------------------------

OPTIONAL ELECTRICAL PLAN 1804 "A"

200 Amp Service			
TAG	QUANTITY	PRODUCT	PRODUCT #
A	(29)	Recessed Cans	
B	(3)	Vapors	
C	(X)	Pendant/Nook	P5090-09
D	(X)	10" Mushrooms	P3410-30
E	(1)	24" Hollywood	P3298-15
F	(X)	36" Hollywood	P3299-15
G	(1)	48" Hollywood	P3300-15
H	(3)	Coach Lights	P5815-30
J	(X)	Coach Lights	P5683-30
K	(X)	J BOX	
L	(2)	4' FLUORESCENT	
M	(1)	2' FLUORESCENT	
N	(1)	5lt Chandelier	P4391-09

Electrical Notes:

Install Arc-Fault circuit-Interruption & Tamper-Resistant Receptacles shall be installed in dwelling unit. per NEC 210.12 & 406.11

All electrical equipment to be set at or above base flood elevation.

All outlets in wet areas and all exterior outlets to be GFI's

Install Phone & T.V per contract .

INSTALL ALL ELECTRICAL PER NEC 2008

DESIGN IN ACCORDANCE WITH
THE FLORIDA BUILDING CODE 2010

D.R. HORTON
America's Builder

Gulf Coast Drafting
& Design
Phone (239) 540-1822
Fax (239) 540-7759

LOT: 3 BLOCK: SUBDIV: BUCKS RUN
ADDRESS: 7879 BUCKS RUN DR.
G.C.D. JOB #: DR-2696

MODEL: UNIT 1804
RESIDENCE FOR: SPEC

DATE: 6-26-12
DRAWN BY: D.B.
CHECKED BY: JWC
REVISED:
PLAN: ELECTRICAL
SCALE: 1/4"=1'-0"
SHEET#

A5-A

1	RESIDENTIAL SPECIFICATIONS
	GENERAL NOTES

1. THE CONTRACTOR SHALL VERIFY ALL CONDITIONS AND DIMENSIONS AT THE JOB SITE PRIOR TO COMMENCING WORK. THE CONTRACTOR SHALL REPORT ALL DISCREPANCIES BETWEEN THE DRAWINGS AND EXISTING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
2. THE CONTRACTOR SHALL SUPPLY, LOCATE AND BUILD INTO THE WORK ALL INSERTS, ANCHORS, ANGLES, PLATES, OPENINGS, SLEEVES, HANGERS, SLAB DEPRESSIONS AND PITCHES AS MAY BE REQUIRED TO ATTACH AND ACCOMMODATE OTHER WORK.
3. ALL DETAILS AND SECTIONS SHOWN ON THE DRAWINGS ARE INTENDED TO BE TYPICAL AND SHALL BE CONSTRUCTED TO APPLY TO ANY SIMILAR SITUATION ELSEWHERE IN THE WORK EXCEPT WHERE A DIFFERENT DETAIL IS SHOWN.
4. SUBSURFACE SOIL CONDITION INFORMATION IS NOT AVAILABLE. FOUNDATIONS ARE DESIGNED FOR A SOIL BEARING CAPACITY OF 2,000 PSF. THE CONTRACTOR SHALL REPORT ANY DIFFERING CONDITIONS TO THE DESIGNER PRIOR TO COMMENCING WORK.
5. STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH JOB SPECIFICATION AND HOUSE PLANS, MECHANICAL, ELECTRICAL, PLUMBING, AND SITE DRAWINGS, CONSULT THESE DRAWINGS FOR SLEEVES, DEPRESSIONS AND OTHER DETAILS NOT SHOWN ON STRUCTURAL DRAWINGS.
6. ALL SPECIFIED FASTENERS MAY ONLY BE SUBSTITUTED IF APPROVED BY THE ENGINEER IN WRITING, THE INSTALLATION OF THE FASTENERS SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S SPECIFICATIONS. SIMPSON FASTENERS SPECIFIED MAY BE SUBSTITUTED WITH THE SAME QUANTITY AND EQUIVALENT STRENGTH PRODUCT.
7. TREATED WOOD REQUIREMENTS:-
ALL WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY.
ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, OR PRESSURE TREATED.
8. THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS COMPLETE. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE ERECTION PROCEDURES AND SEQUENCES TO ENSURE SAFETY OF THE BUILDING AND ITS COMPONENTS DURING ERECTION. THIS INCLUDES THE NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, OR TIE DOWNS.
9. CEILING DRYWALL INSTALLED WITHIN THE HOUSE TO TRUSSES SPACED 24" O.C. SHALL BE 5/8" DRYWALL OR 1/2" SAG RESISTANT PER SEC. 702.3.5
10. LANAI CEILINGS & COVERED ENTRY CEILINGS
1X4 STRIPLING @ 16" O.C. FASTENED WITH 2-8d NAILS TO EACH TRUSS. 5/8" EXTERIOR GYPOBOARD CEILING FASTENED WITH 8d NAILS OR 1-5/8" DRYWALL SCREWS @ 6" O.C. EDGE AND FIELD.

2 DOOR AND WINDOW ANCHORAGE

ANCHORAGE REQUIREMENTS-- ALL PASS AND SLIDING GLASS DOORS AND ALL WINDOW ASSEMBLIES SHALL BE ANCHORED TO THE MAIN WIND FORCE RESISTING SYSTEM IN A MANNER SPECIFIED BY THE PUBLISHED MANUFACTURERS LITERATURE. THERE SHALL BE NO SUBSTITUTION OF ALTERNATE FASTENINGS UNLESS PROVIDED BY THE MANUFACTURER AND APPROVED BY THE BUILDING DESIGN ENGINEER.

MASONRY OPENING
WHERE WINDOW FRAME IS DESIGN TO FASTEN WITH SCREWS THROUGH THE FRAME AND INTO THE MASONRY, THE BUCK MATERIAL IS SIMPLY A SPACER. THE BUCK MAY BE FASTENED WITH T NAILS OR ANY SUITABLE FASTENER TO TACK IT INTO POSITION PRIOR TO WINDOW INSTALLATION. FASTEN WINDOW FRAME PER MFR INSTRUCTIONS. A WINDOW FASTENER SHALL PENETRATE MASONRY BY 2 1/4" MIN.

WHERE WINDOW FRAME IS DESIGNED TO FASTEN ONLY TO THE WOOD BUCK
(IE, FLANGED FRAME WITH WOOD SCREWS) THE BUCKS SHALL BE 2X WOOD WITH
STRUCTURAL FASTENING TO THE MASONRY WITH 1/4X 3 3/4 MASONRY SCREWS
@ 24" OC AND 6" FROM EACH END.

WOOD FRAMED OPENING:- ALL DOORS AND WINDOWS SHALL BE INSTALLED ACCORDING TO THE PUBLISHED MANUFACTURERS LITERATURE OF THE ASSEMBLY BEING INSTALLED TO THE ROUGH SUBSTRATE OPENING. SHIMS SHALL BE MADE OF MATERIALS CAPABLE OF RESISTING THE APPLIED LOADS AND SHALL BE LOCATED NEAR EACH FRAME FASTENER TO MINIMIZE DISTORTION OF THE FRAME AS THE FASTENERS ARE TIGHTENED.

3 GENERAL ROOF ASSEMBLY

ROOF SHEATHING
SHALL BE APA RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER.
INSTALL PANELS WITH LONG
DIMENSION PLACED PERPENDICULAR TO TRUSSES. A 1/8" SPACE BETWEEN ADJACENT
SHEETS SHALL BE MAINTAINED. INSTALL 3/4" CLIPS AT UNSUPPORTED FIELD EDGES,
ENDS AND JOINTS. THE SHEETING SHALL BE NAILED WITH 8d RING SHANK NAILS @6" O.C.
EDGE AND FIELD. ENSURE THAT ALL NAILS PENETRATE THE TOP CHORD OF THE TRUSS
WITHOUT SPLITTING. RING SHANK NAILS PER R203.2.1, 0.119" NOMINAL SHANK DIAMETER
RINGS @ 0.004" RADIUS. RING SHANK DIAMETER, 16 TO 20 RINGS PER INCH, 0.280" DIAMETER
FULL ROUND HEAD, 2" NAIL LENGTH.

FLASHING SHALL BE ALUMINUM, ALUMINUM ZINC COATED STEEL .0179 INCHES THICK, 26 GAGE AZ50 ALUM ZINC, OR GALVANIZED STEEL .0179 INCHES THICK, 26 GAGE ZINC COATED 690, FLASHING SHALL BE INSTALLED IN ACCORDANCE WITH THE ZIP SYSTEM ROOF SHEATHING MANUFACTURERS PUBLISHED REQUIREMENTS. ALL FLASHING AND INSTALLATION SHALL CONFORM TO SECTION R905.2.8 (1 TO 5).

DRIP EDGE
DRIP EDGE SHALL BE PROVIDED AT ALL EAVES AND GABLES OF SHINGLE ROOFS, LAPPED A MINIMUM OF 3" @ JOINTS. THE OUTSIDE EDGE SHALL EXTEND A MINIMUM OF 1" BELOW SHEATHING AND THE INSIDE EDGE SHALL EXTEND BACK A MINIMUM OF 2". DRIP EDGE SHALL BE FASTENED AT NO MORE THAN 4" CENTERS. THERE SHALL BE A MINIMUM OF 4" WIDTH OF ROOF CEMENT INSTALLED OVER THE DRIP EDGE FLANGE.

4	WOOD FRAMING:
---	---------------

1. ALL WOOD FRAMING SHALL BE FABRICATED AND INSTALLED PER NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION.
2. UNLESS NOTED OTHERWISE THE FOLLOWING MINIMUM GRADES SHALL BE USED:
 - A. INTERIOR BEARING WALLS SPF #2
 - B. RAFTERS, JOISTS, HEADERS AND BEAMS SYP #2.EXTERIOR BEARING WALLS,
3. TREATED WOOD REQUIREMENTS: ALL WOOD EXPOSED TO WEATHER SHALL BE PROTECTED, PRESSURE TREATED, OR NATURALLY RESISTANT TO DECAY. ALL WOOD TOUCHING MASONRY OR CONCRETE SHALL BE ISOLATED, PRESSURE TREATED.
4. CONTRACTOR SHALL PROVIDE ALL FASTENING DEVICES AS SHOWN ON THE DRAWINGS AND AS NECESSARY AND SUITED FOR EACH APPLICATION. FASTENING SUBJECT TO MOISTURE SHALL BE HOT DIP GALVANIZED TO ASTM A-153-90, OR STAINLESS STEEL.
5. ALL METAL CONNECTIONS AND FABRICATIONS SHALL COMPLY WITH AISC SPECIFICATIONS.
6. SOLID BLOCK ALL JOISTS AND RAFTERS AT POINTS OF SUPPORT.
7. PREFABRICATED STRUCTURAL TRUSSES SHALL COMPLY WITH NFPA NATIONAL DESIGN SPECIFICATIONS FOR WOOD CONSTRUCTION, TPI DESIGN SPECIFICATIONS FOR METAL PLATE WOOD TRUSSES AND ATTIC 100.
8. ALL TRUSSES SHALL BE DESIGNED AND CERTIFIED BY THE TRUSS MANUFACTURER'S STATE OF FLORIDA REGISTERED ENGINEER.
9. CONTRACTOR SHALL CORRELATE WITH TRUSS MANUFACTURER TO ENSURE THAT ADEQUATE BEARING IS PROVIDED AT END REACTIONS OF ALL GIRDER TRUSSES.
10. TRUSS MANUFACTURER SHALL SUBMIT SHOP DRAWINGS TO THE CONTRACTOR AND DESIGNER FOR REVIEW AND APPROVAL PRIOR TO FABRICATION. CONTRACTOR SHALL BE RESPONSIBLE FOR FIELD VERIFICATION OF DIMENSIONS, MATERIALS AND CONDITIONS.
11. AT VOLUME CEILING CONDITIONS, ALIGN TRUSSES TO PROVIDE A SMOOTH AND UNBROKEN INTERIOR WALL SURFACE FROM FLOOR TO CEILING.
12. BRACE TRUSSES DURING ERECTION AND AFTER PERMANENT INSTALLATION TO COMPLY WITH TPI BWY-76.
13. MICRO-LAMS (OR EQUAL PARALAMS, LVL'S, ETC.) SHALL BE USED WHERE SPECIFIED ON ENGINEERED PLANS AND INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. ANY EDGES OR ENDS EXPOSED TO THE WEATHER SHALL BE PROTECTED BY THE INSTALLATION OF 26 GA, MIN, GALVANIZED STEEL FLASHING.
14. SPLICES IN MULTI-BOARD CONTINUOUS BEAMS SHALL BE ALLOWED FOR ONE BOARD ONLY PER SPAN AND ONLY AT THE QUARTER POINT OF THE SPAN, UNLESS SHOWN OTHERWISE.
15. SPACE FRAMING OF ARCHES UNDER THE BEAM SHALL BE FILL IN FRAME UNLESS NOTED OR CONSTRUCTED OTHERWISE

5	ASPHALT SHINGLE ROOF SPEC'S
---	-----------------------------

SHINGLES
15# felt shall be installed under asphalt shingles. All asphalt shingles shall have self sealing strips or be interlocking and comply with ASTM D 225 or D 3462, and shall be secured to the roof with no less than 6 fasteners per shingle strip, or a minimum of 2 fasteners per shingle tab. And shall in no case be fastened with less fasteners than that required by the manufacture. Installation shall comply with the manufactures requirements for installation in the given Florida wind zone, as determined by ASTM D 3161

FASTENERS
Fasteners for asphalt shingles shall comply with ASTM F 1667, and shall be made of galvanized steel, stainless steel or aluminum with a minimum shank size of 12 gage (0.105 inches) with a minimum 3/8 inch diameter head and shall be of a length to penetrate the sheathing.

The nail component of plastic cap nails shall meet or exceed the requirements of ASTM A 641, Class I, or equal, and shall be corrosion resistant by coating electro galvanization, mechanical galvanization, hot dipped galvanization or shall be made of stainless steel, non ferrous metal.

6	CLAY AND CONCRETE TILE ROOF SPECS
---	-----------------------------------

INSTALL PEEL AND STICK UNDERLAYMENT APPROVED FOR SINGLE LAYER APPLICATION UNDER TILE ROOF.
THE INSTALLATION OF CLAY AND CONCRETE TILE SHALL COMPLY WITH THE PROVISIONS OF R905.3 F.B.C.
MARKING: EACH ROOF TILE SHALL HAVE A PERMANENT MANUFACTURER'S IDENTIFICATION MARK.
APPLICATION SPECIFICATIONS: THE TILE MANUFACTURER'S WRITTEN APPLICATION SPECIFICATIONS SHALL BE AVAILABLE AND SHALL INCLUDE BUT NOT BE LIMITED TO THE FOLLOWING:





- INCLUDE BUT NOT BE LIMITED TO THE FOLLOWING:
1. TILE PLACEMENT AND SPACING;
 2. ATTACHMENT SYSTEM NECESSARY TO COMPLY WITH CURRENT WIND CODE,
 - A. AMOUNT AND PLACEMENT OF MORTAR
 - B. AMOUNT AND PLACEMENT OF ADHESIVE;
 - C. TYPE, NUMBER, SIZE, AND LENGTH OF FASTENERS AND CLIPS.
 3. UNDERLAYMENT
 4. SLOPE REQUIREMENT.

7 FLOOR CHEATING AT AND FLOOR

FLOOR SHEATHING AT 2ND FLOOR
A.P.A. RATED STURDI-FLOOR, EXPOSURE 1, TONGUE & GROOVE EDGES
SPAN RATING 48/24 OR BETTER, GLUE AND NAIL W/
10d COMMON @ 6" O.C. EDGE AND FIELD.

8	EXTERIOR WALL SHEATHING
---	-------------------------

SHALL BE 7/16" THICK ZIP SYSTEM WALL SHEATHING/ MANUFACTURED BY HUBER ENGINEERING WOODS LLC. INSTALL PANELS WITH A 1/8" GAP BETWEEN EDGES AND FASTEN WITH 8d COMMON NAILS @ 6" O.C. EDGE AND FIELD. IF PANELS ARE INSTALLED HORIZONTALLY, BLOCKING SHALL BE INSTALLED BEHIND PANEL JOINTS. ALL SEAMS IN THE SHEATHING SHALL BE SEALED WITH THE ZIP SYSTEM SELF ADHERING SEAM TAPE USING THE ZIP SYSTEM APPLICATOR GUN. THE USUAL TYVEK HOUSE WRAP IS NOT REQUIRED.

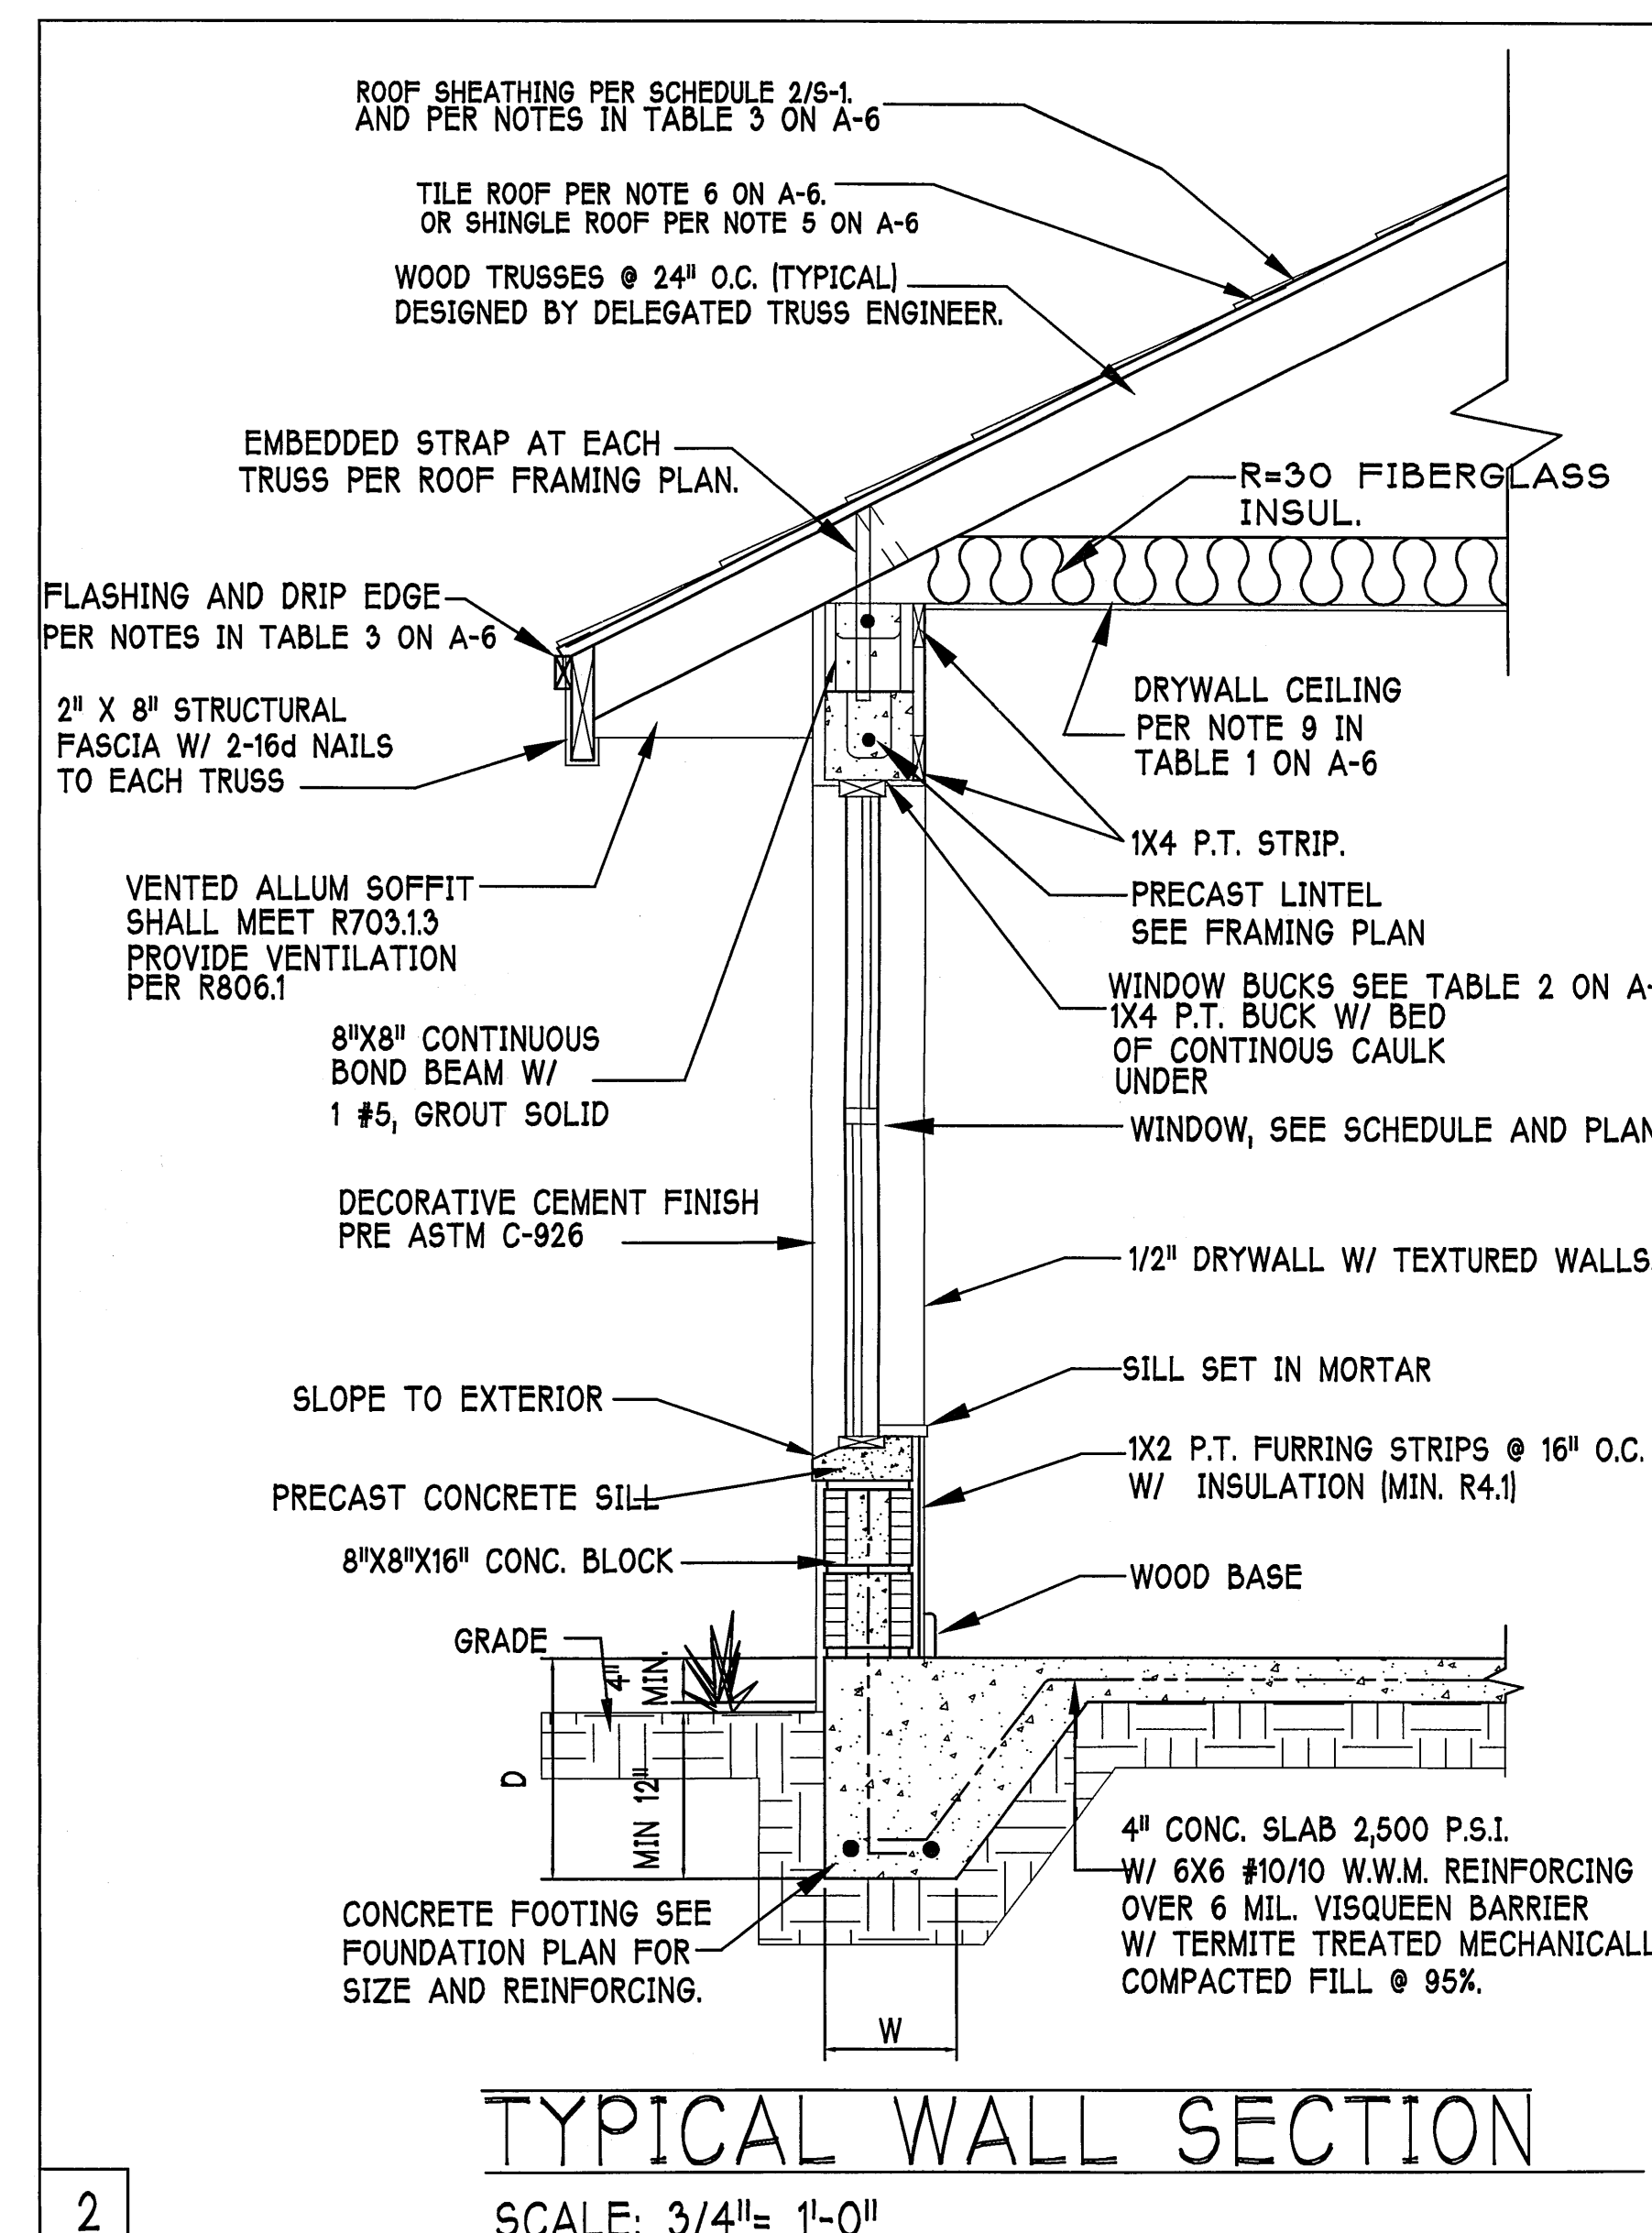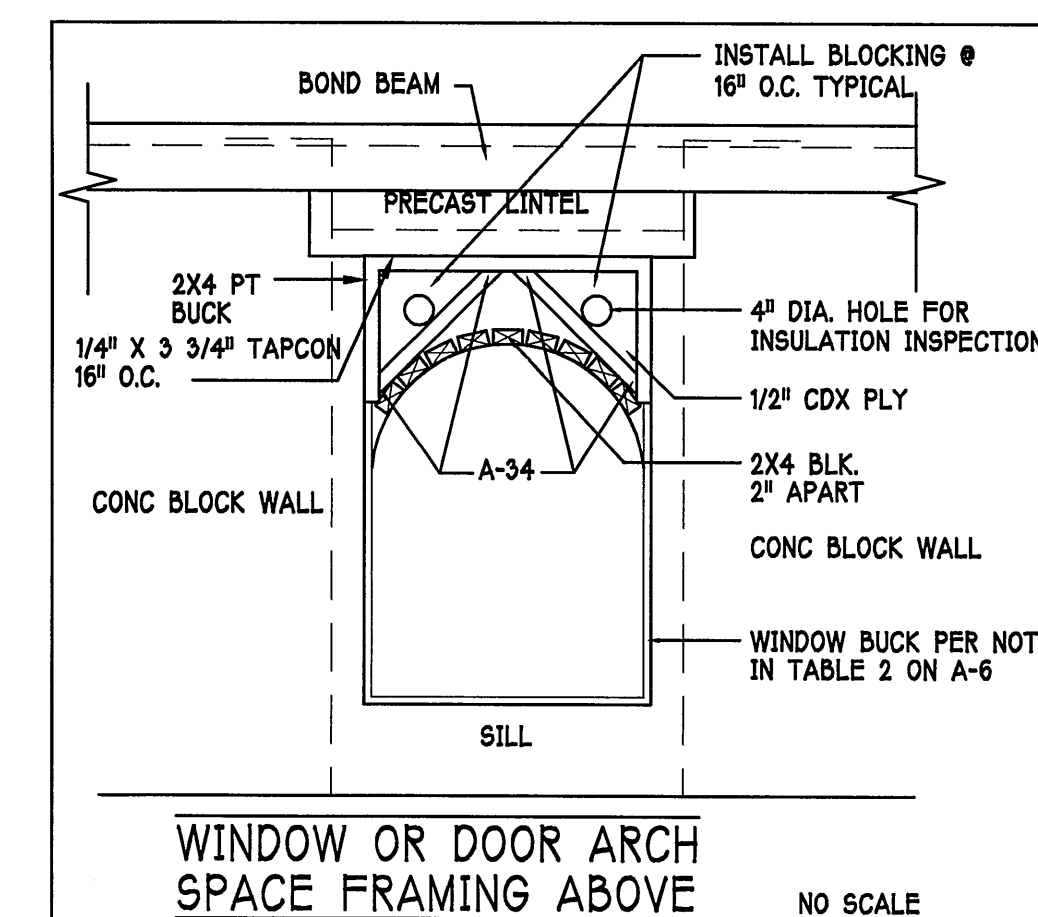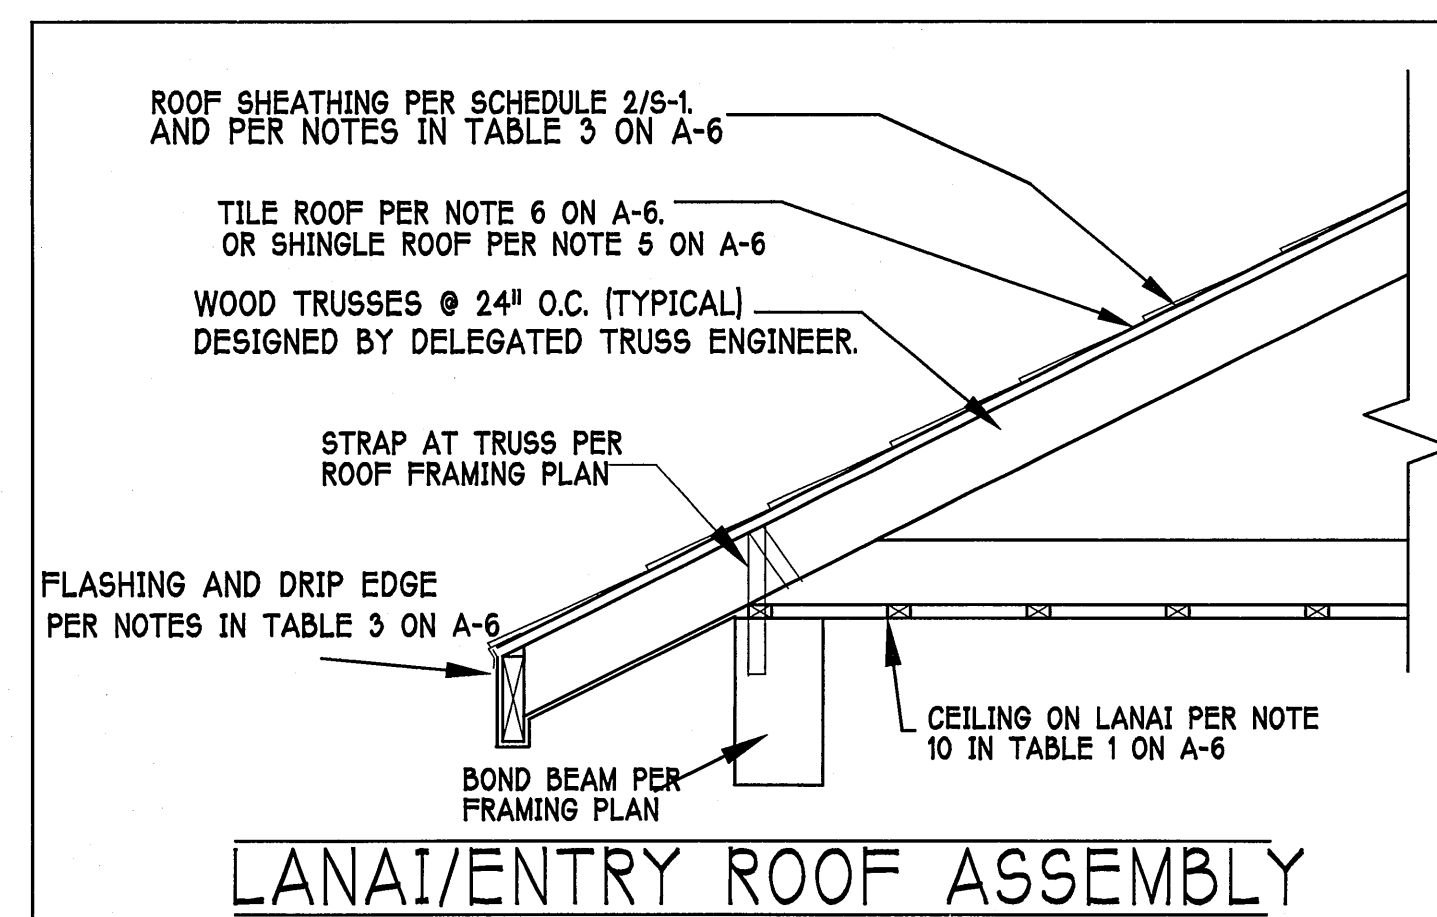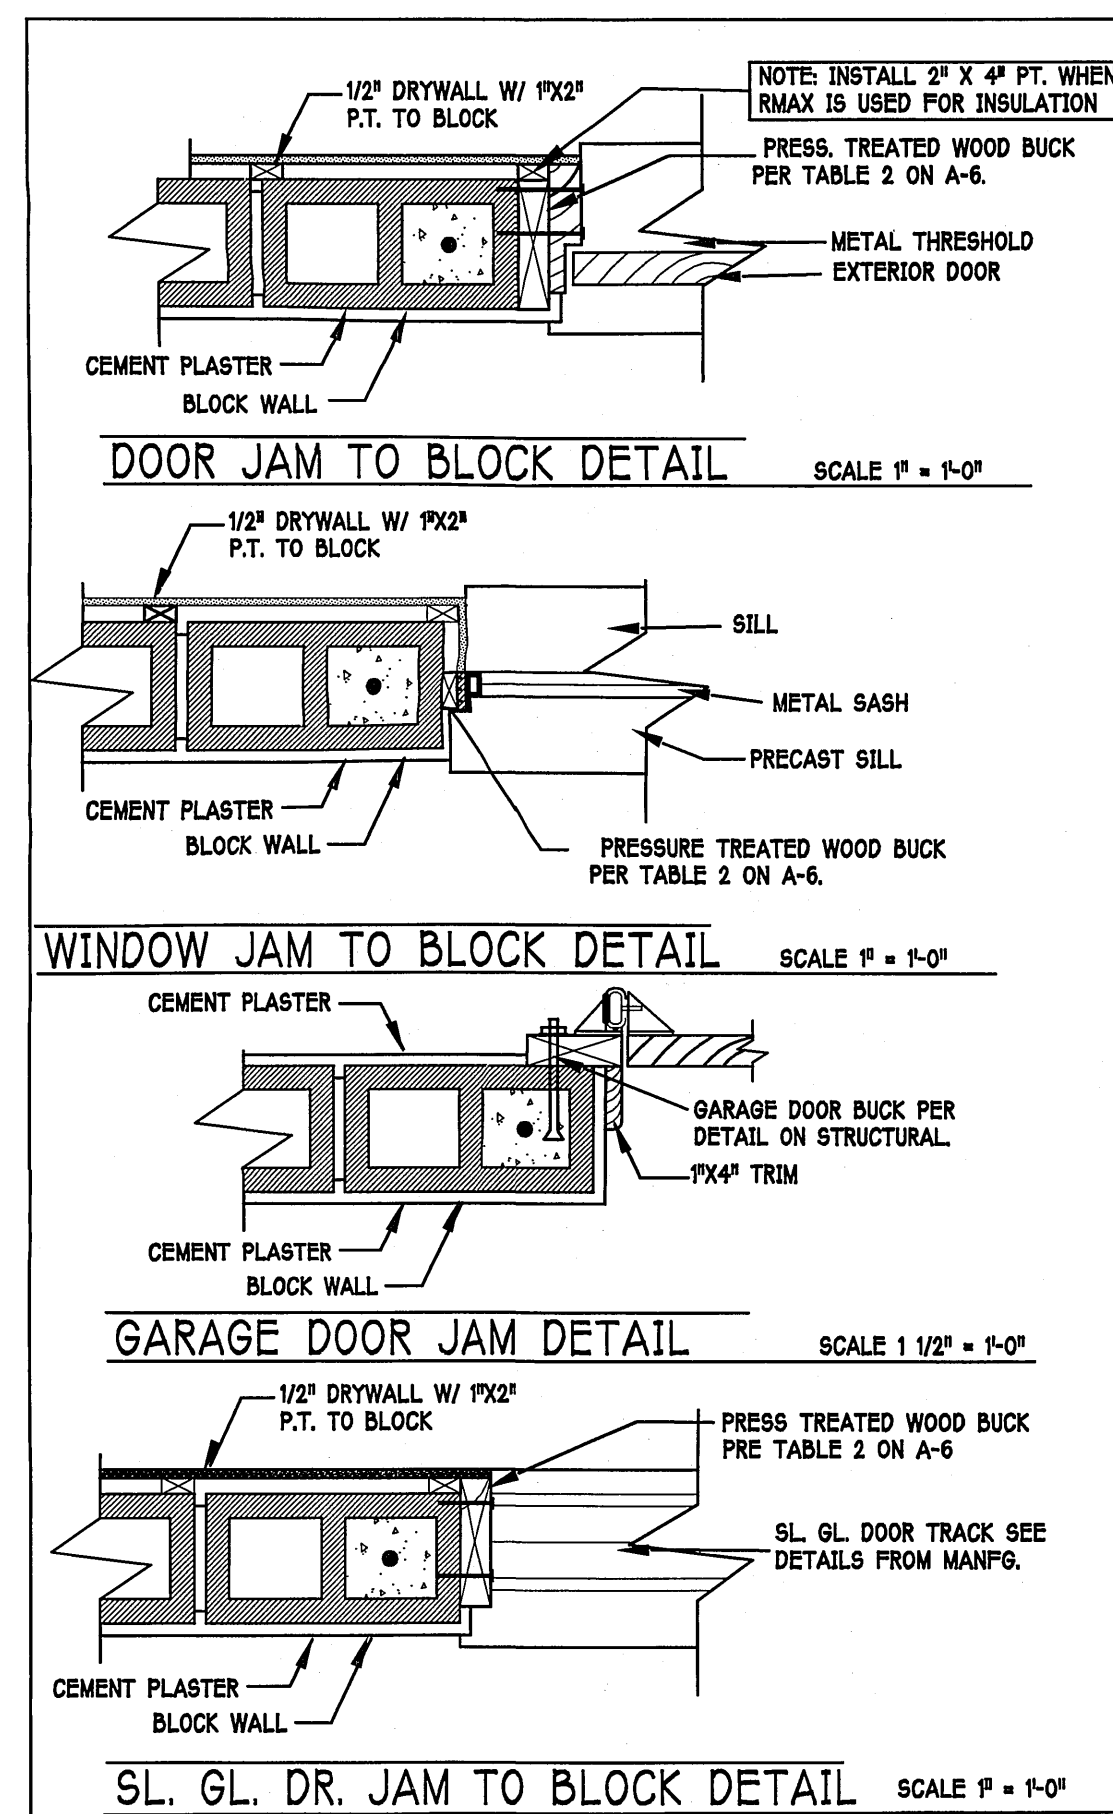

DESIGN IN ACCORDANCE WITH
THE FLORIDA BUILDING CODE 2010

D·R·HORTON • RHI
NYSE
America's Builder

**Gulf Coast Drafting
& Design**
Phone (239) 540-1822
Fax (239) 540-7759

This signature and seal is to be used, performed by the Structural Engineer of Record for the project. It is not to be used for any other project. The use of this signature and seal is not a warranty, endorsement, or seal of approval by the State of Florida, the Department of Transportation, or the Federal Highway Administration. The use of this signature and seal is not a warranty, endorsement, or seal of approval by the State of Florida, the Department of Transportation, or the Federal Highway Administration.

STRUCTURAL ENGINEERING

STRUCTURAL SYSTEMS OF NORTH FLORIDA

1634 SE 47th ST SUITE #3
 CECAP CORRAL, FL 32904
 (850) 549-4554

SEAL **REGISTERED**




JUN 27 2012

06 05 433652

MODEL:	LOT: 3	BLOCK :
UNIT 1804	SUBDIV: BUCKS RUN	
RESIDENCE FOR:	ADDRESS: 7879 BUCKS RUN DR.	
SPEC	G.C.D. IOR # - DR-2606	

DATE:	6-26-12
DRAWN BY:	D.B.
CHECKED BY:	JWC
REVISED:	
PLAN:	SECTIONS
SCALE:	AS NOTED
SHEET#	

A-6

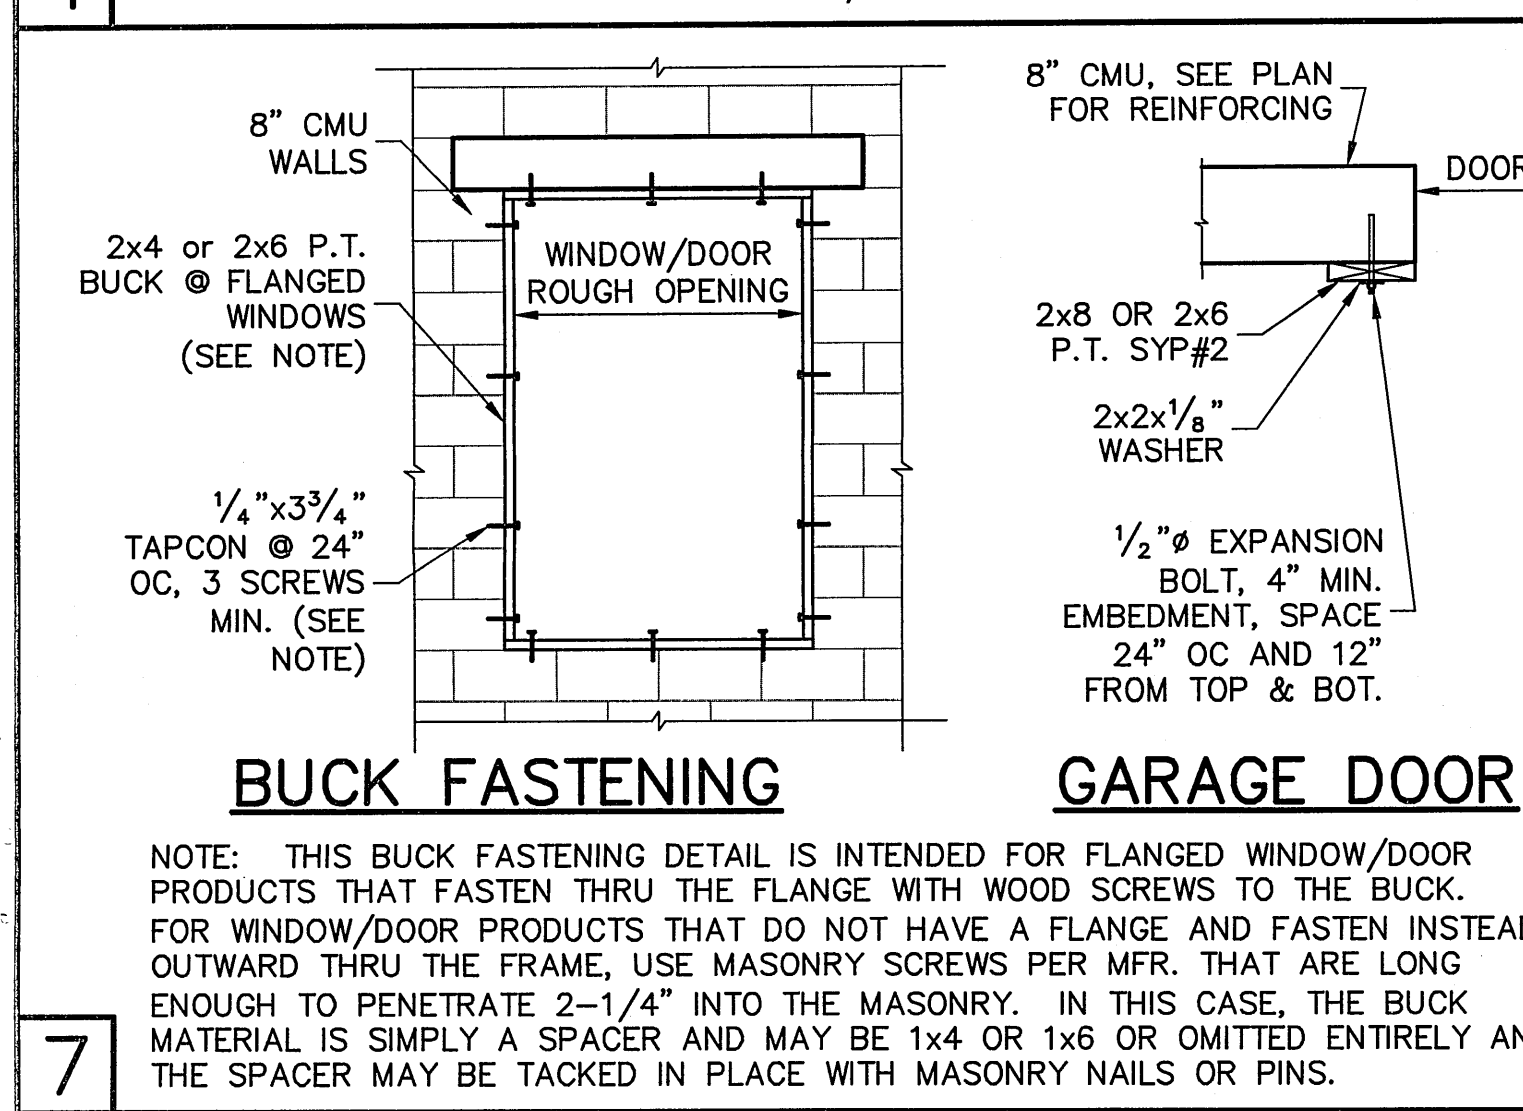
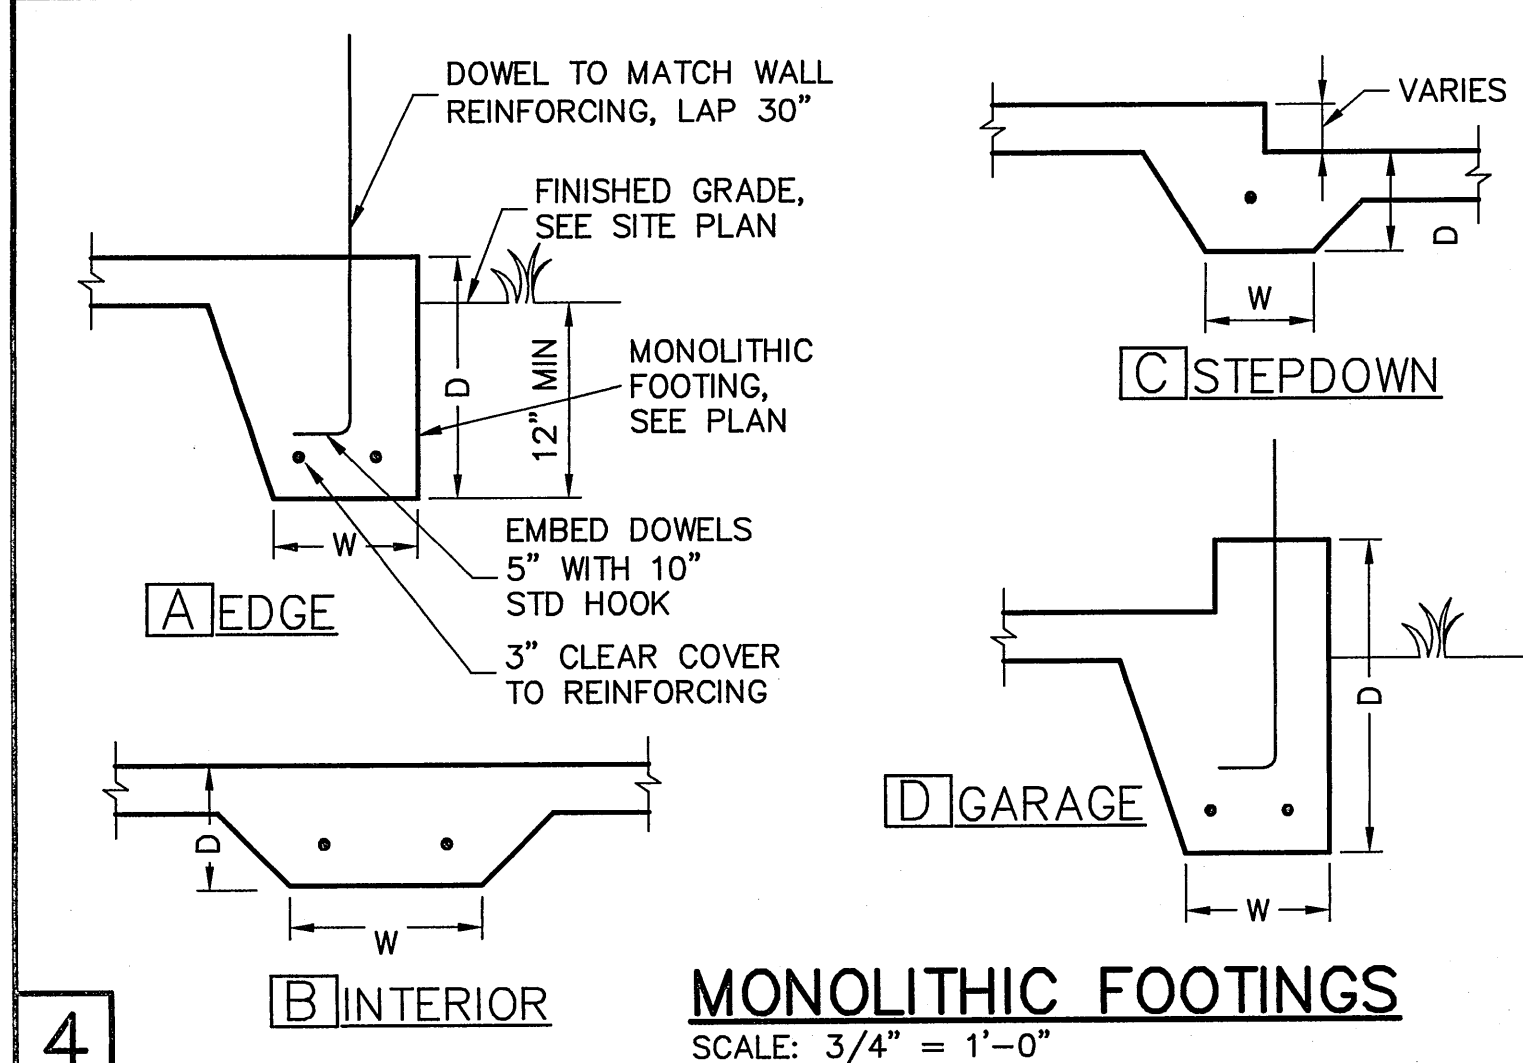
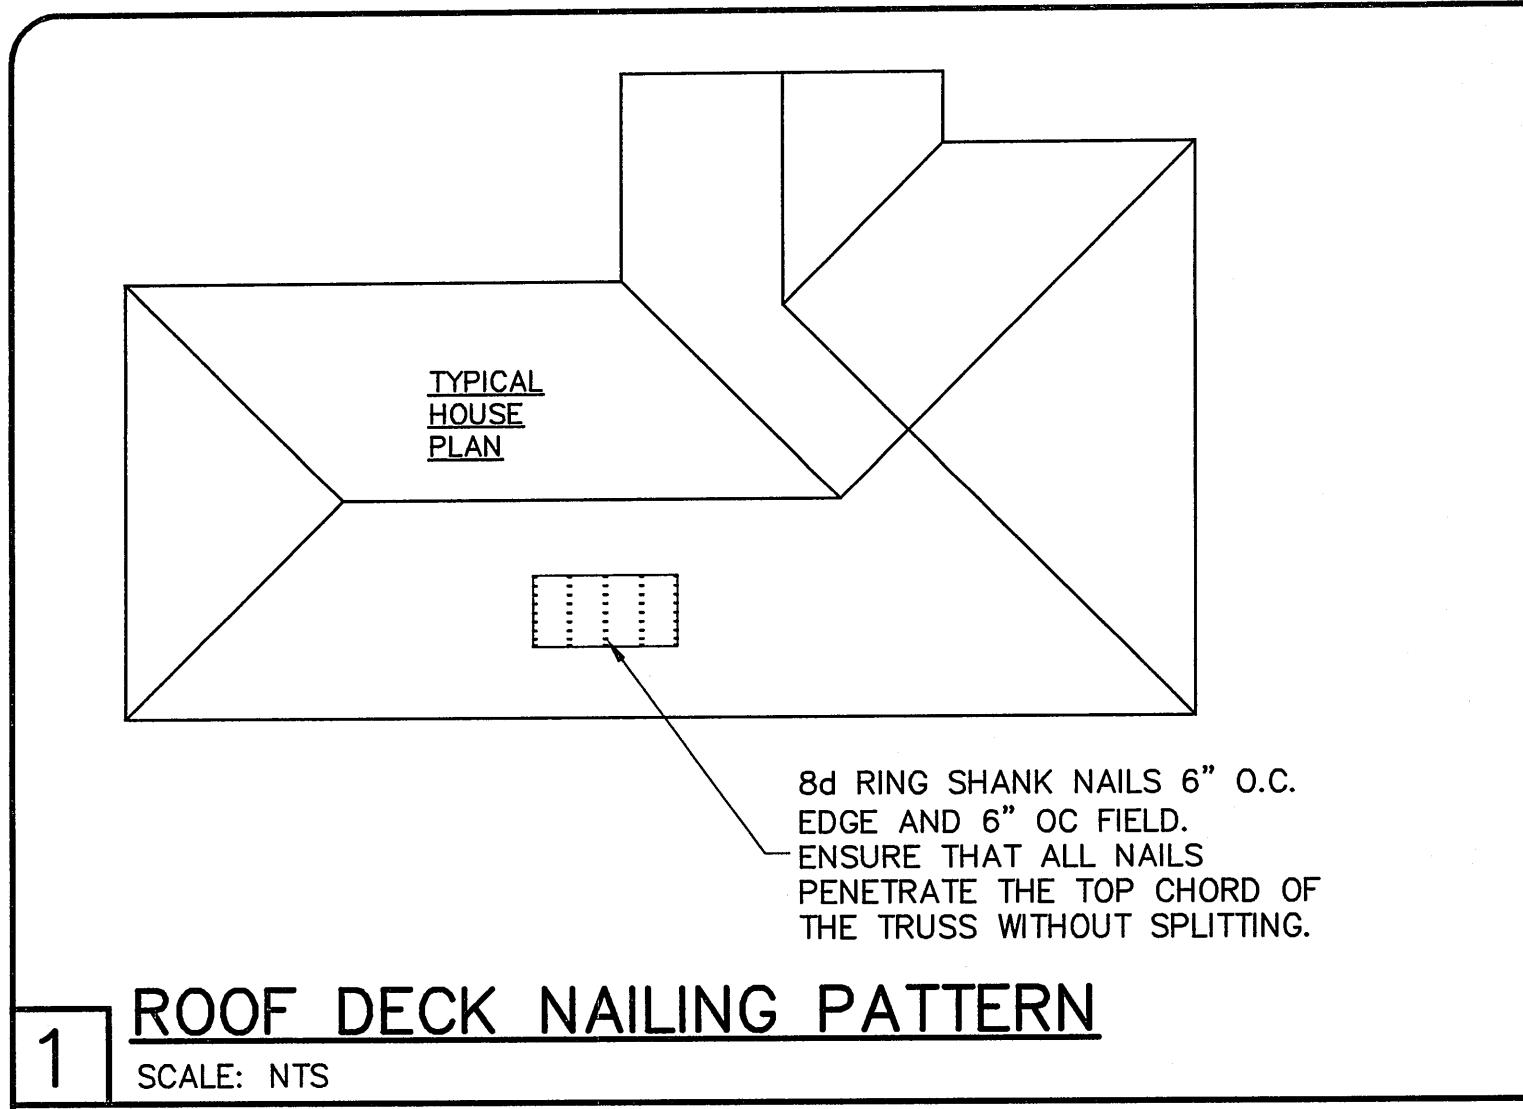


RETROFIT STRAPS TO CONCRETE/MASONRY			
TRUSS UPLIFT (LBS) @ 24\"/>	CONNECTOR		
TO 840	1-MTSM16 or 20	7-10dx1 1/2\"/>	4-1/4\"/>
TO 1045	1-HTSM16 or 20	8-10dx1 1/2\"/>	4-1/4\"/>
TO 2090	2-HTSM16 or 20	8-10dx1 1/2\"/>	4-1/4\"/>
TO 4300	2-LGT2	16-16d, 7-1/4\"/>	4-1/4\"/>
TO 3480	HTT16	18-16d, 5/8\"/>	ALLTHREAD, DRILL & EPOXY 10\"/>
TO 10530	HGT-2/3	TWO 3/4\"/>	

NOTES:
1) WHERE EMBEDDED STRAP IS MISSING OR MIS-LOCATED, PROVIDE A STRAP FROM THE ABOVE LIST AT EACH ROOF TRUSS BEARING POINT, BASED ON THE TRUSS UPLIFT VALUES IN THE SIGNED AND SEALED TRUSS DESIGN PACKAGE.
2) CONNECTORS ARE SIMPSON STRONG TIE. ALL CONNECTORS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH SIMPSON PRINTED INSTRUCTIONS.

SHEATHING SCHEDULE	
EXTERIOR STUD WALL	FLOOR
N/A	N/A
ROOF	LANAI / ENTRY CEILING
A.P.A. RATED SHEATHING, EXPOSURE 1, SPAN RATING 24/16 OR BETTER (HIGHER NUMBERS INDICATE BETTER SPAN RATING). THE USUAL CHOICE IS 15/32\"/>	OPTIONS: 1) 1x4 STRIPPING @ 16\"/>




NOTE: EXTERIOR CEILINGS AND SOFFITS SPECIFIED HERE MEET THE DESIGN WIND PRESSURES PER R703.1.3.

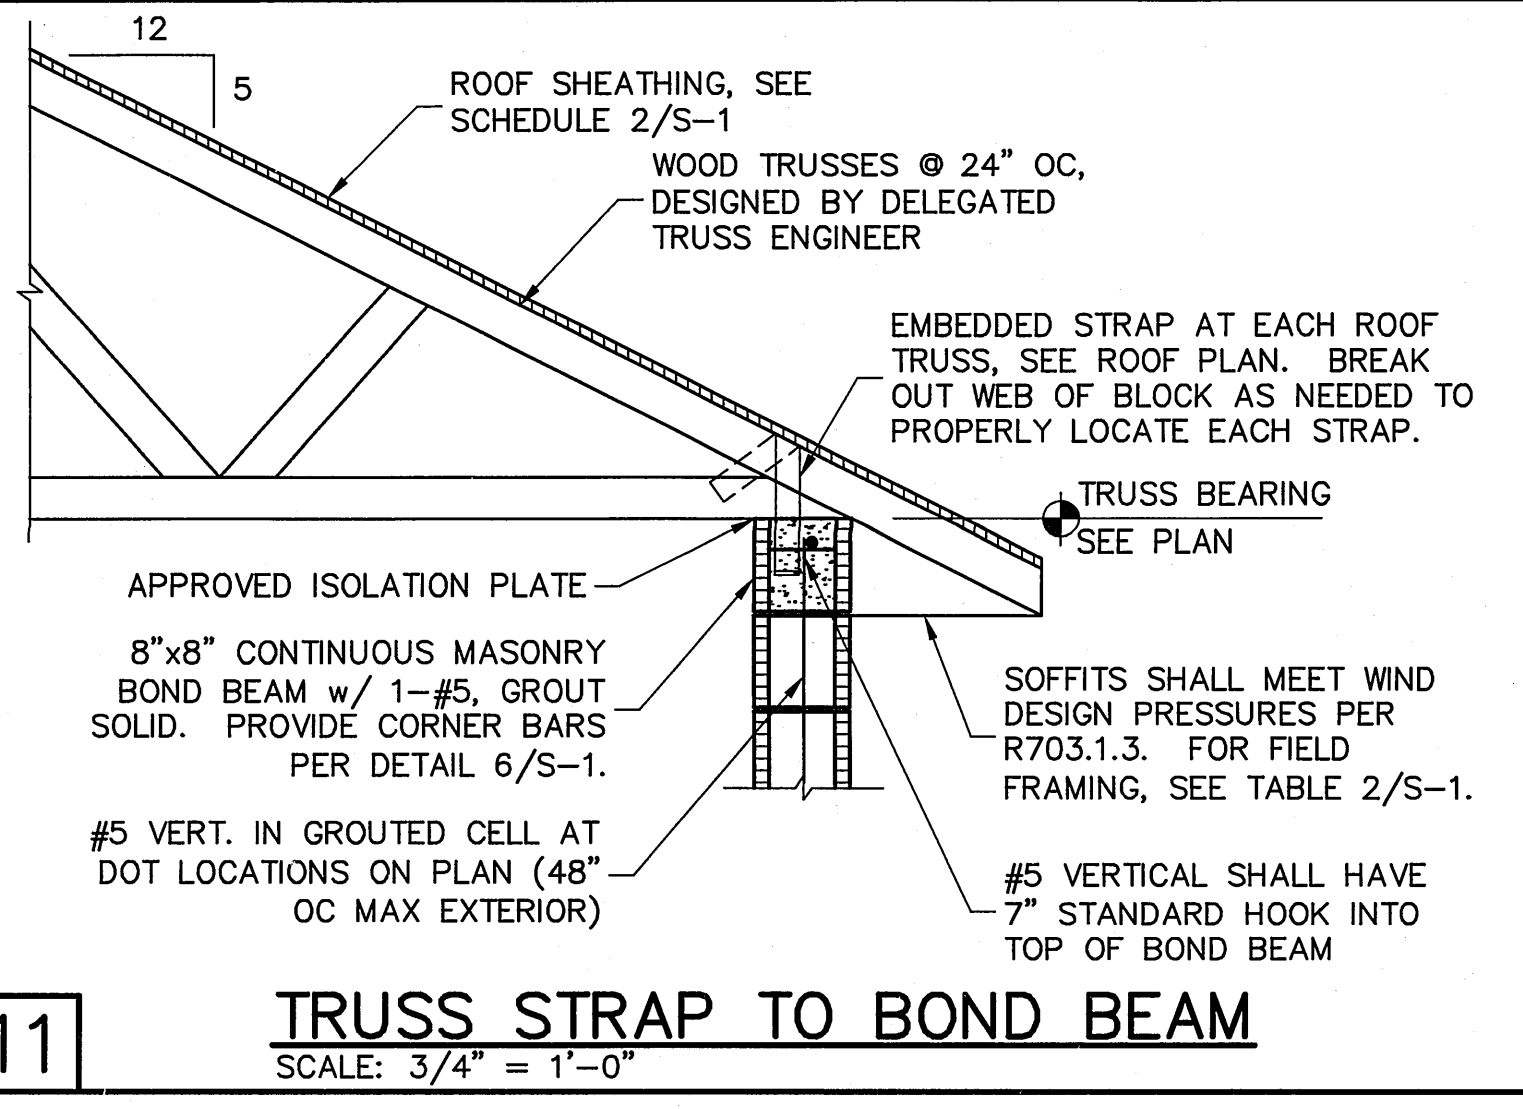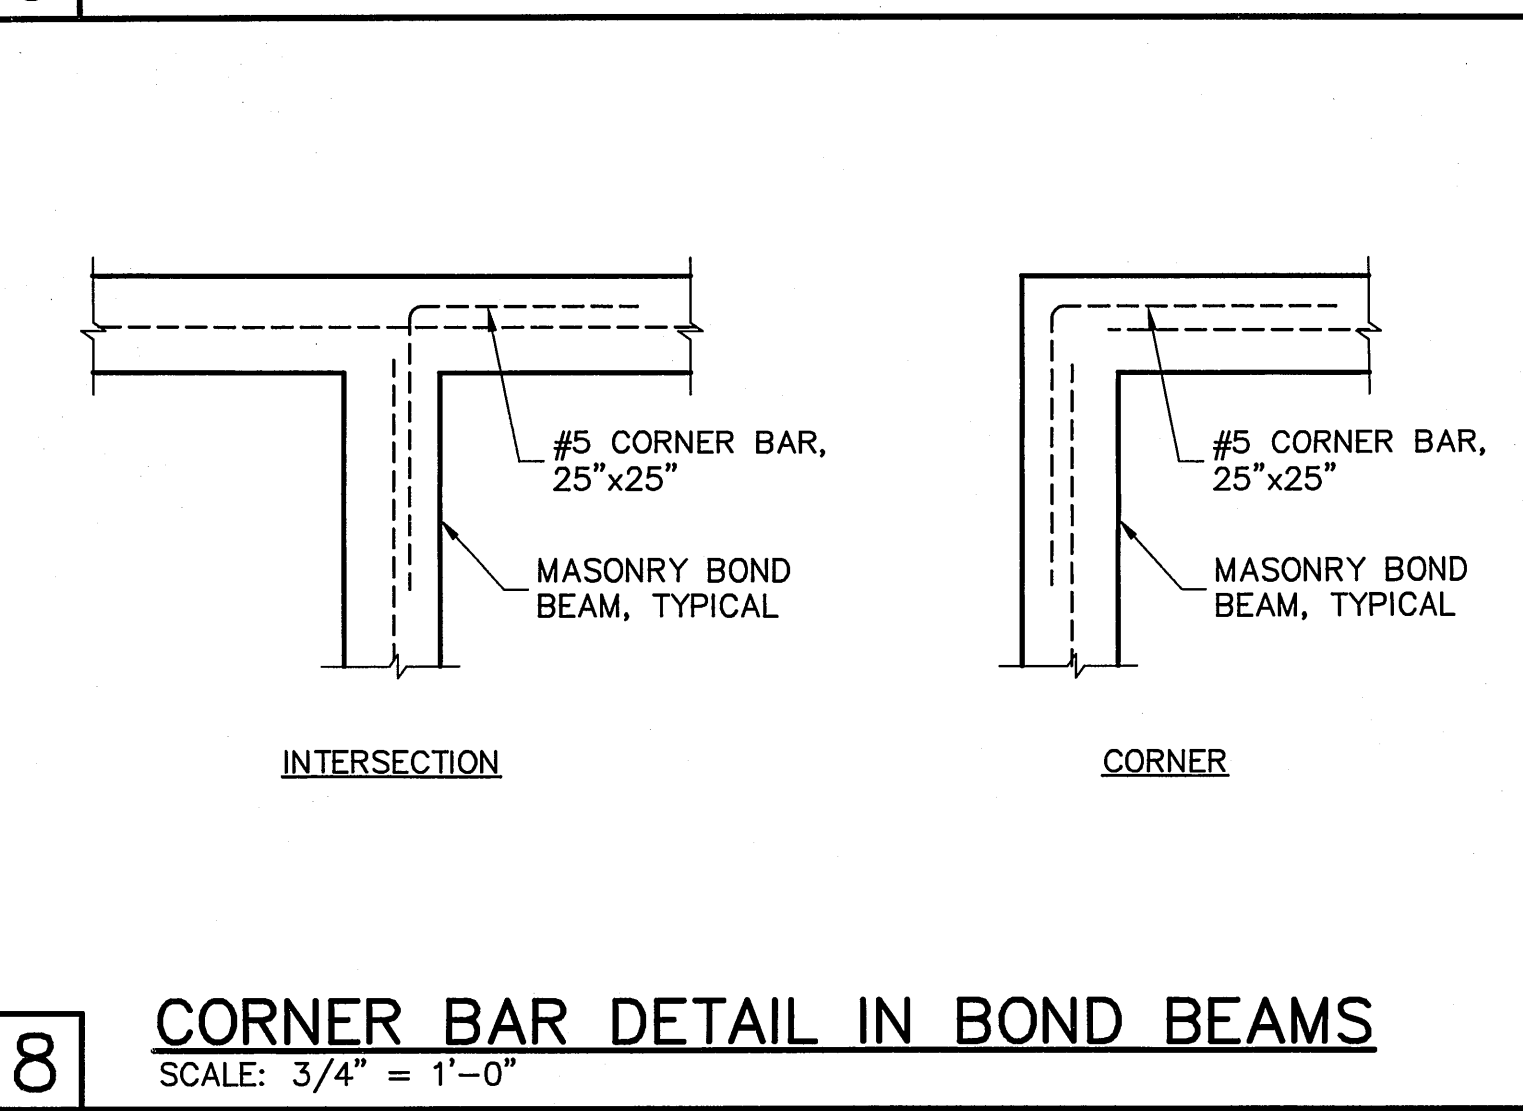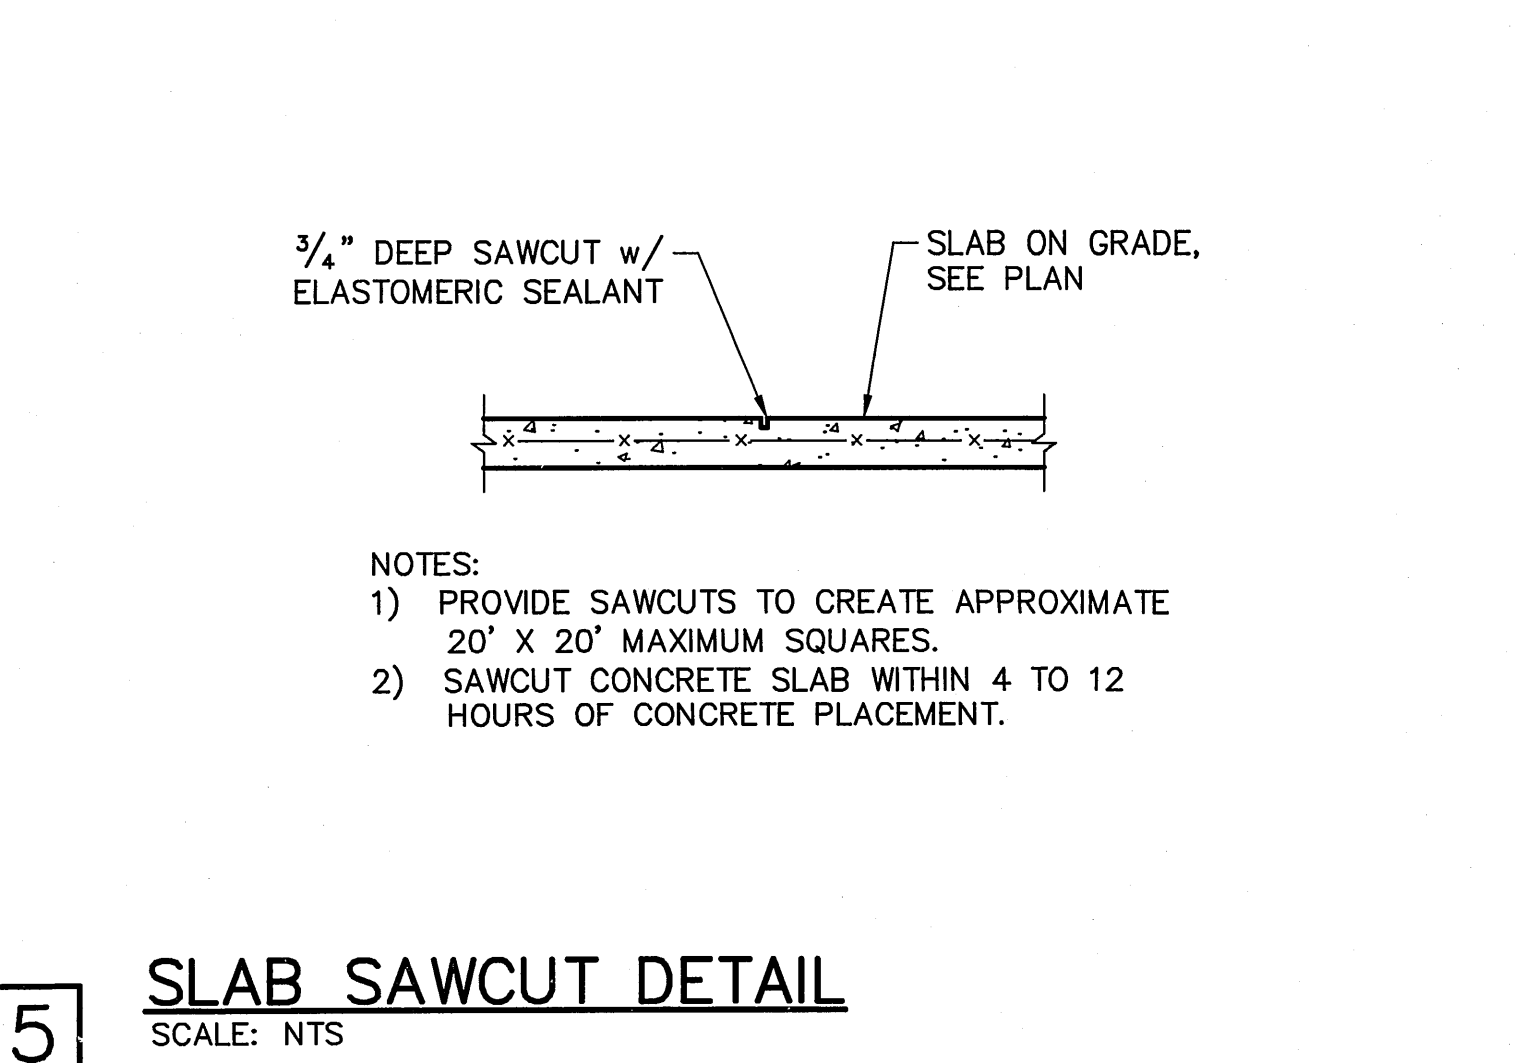

WINDOW & DOOR DESIGN WIND PRESSURES		
WIND PRESSURES PER ASCE7-10, 160 MPH, EXPOSURE B, AND CONVERTED TO ALLOWABLE STRESS DESIGN PRESSURES USING 0.6W LOAD FACTOR. (Vasd=124 MPH, RISK CAT II, ENCLOSED, kd=0.85, h<30')		
TYPE	INTERIOR ZONE 4	EDGE STRIP 5
TYPICAL WINDOWS & DOORS	+27.7 -30.0	+27.7 -37.0
8' OR 9' GARAGE DOORS	+24.3 -27.5	
16' OR 18' GARAGE DOORS	+23.3 -26.0	

(SEE PLAN FOR OTHER SPECIFIC PRESSURES)

1) TABLE MAY BE USED FOR ANY SIZE WINDOW OR DOOR IN EACH TYPE.
2) USE "INTERIOR ZONE" PRESSURES UNLESS WINDOW OR DOOR IS LOCATED WITHIN THE "EDGE STRIP" (SEE DIAGRAM BELOW), THEN USE THE HIGHER PRESSURES UNDER THE "EDGE STRIP" COLUMN.
3) ALL GLASS / GLAZING SHALL BE IMPACT RATED OR USE IMPACT RATED SHUTTERS.
4) PRODUCT APPROVALS MUST BE ON FILE WITH THE BUILDING DEPARTMENT.

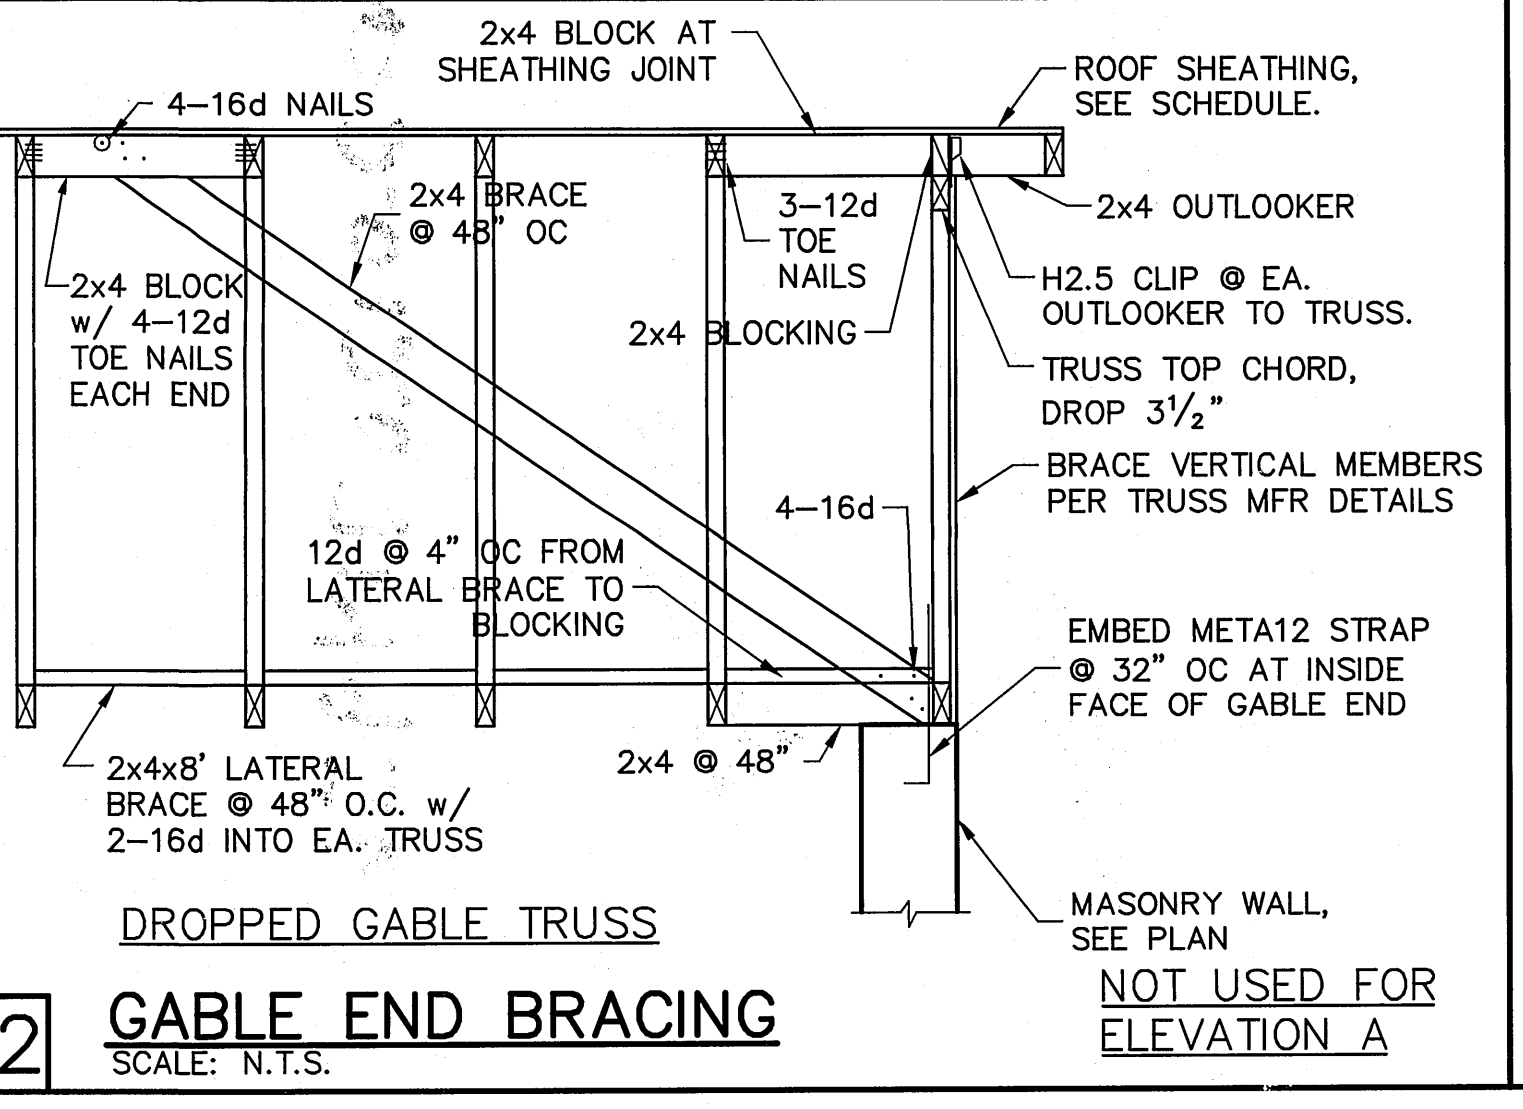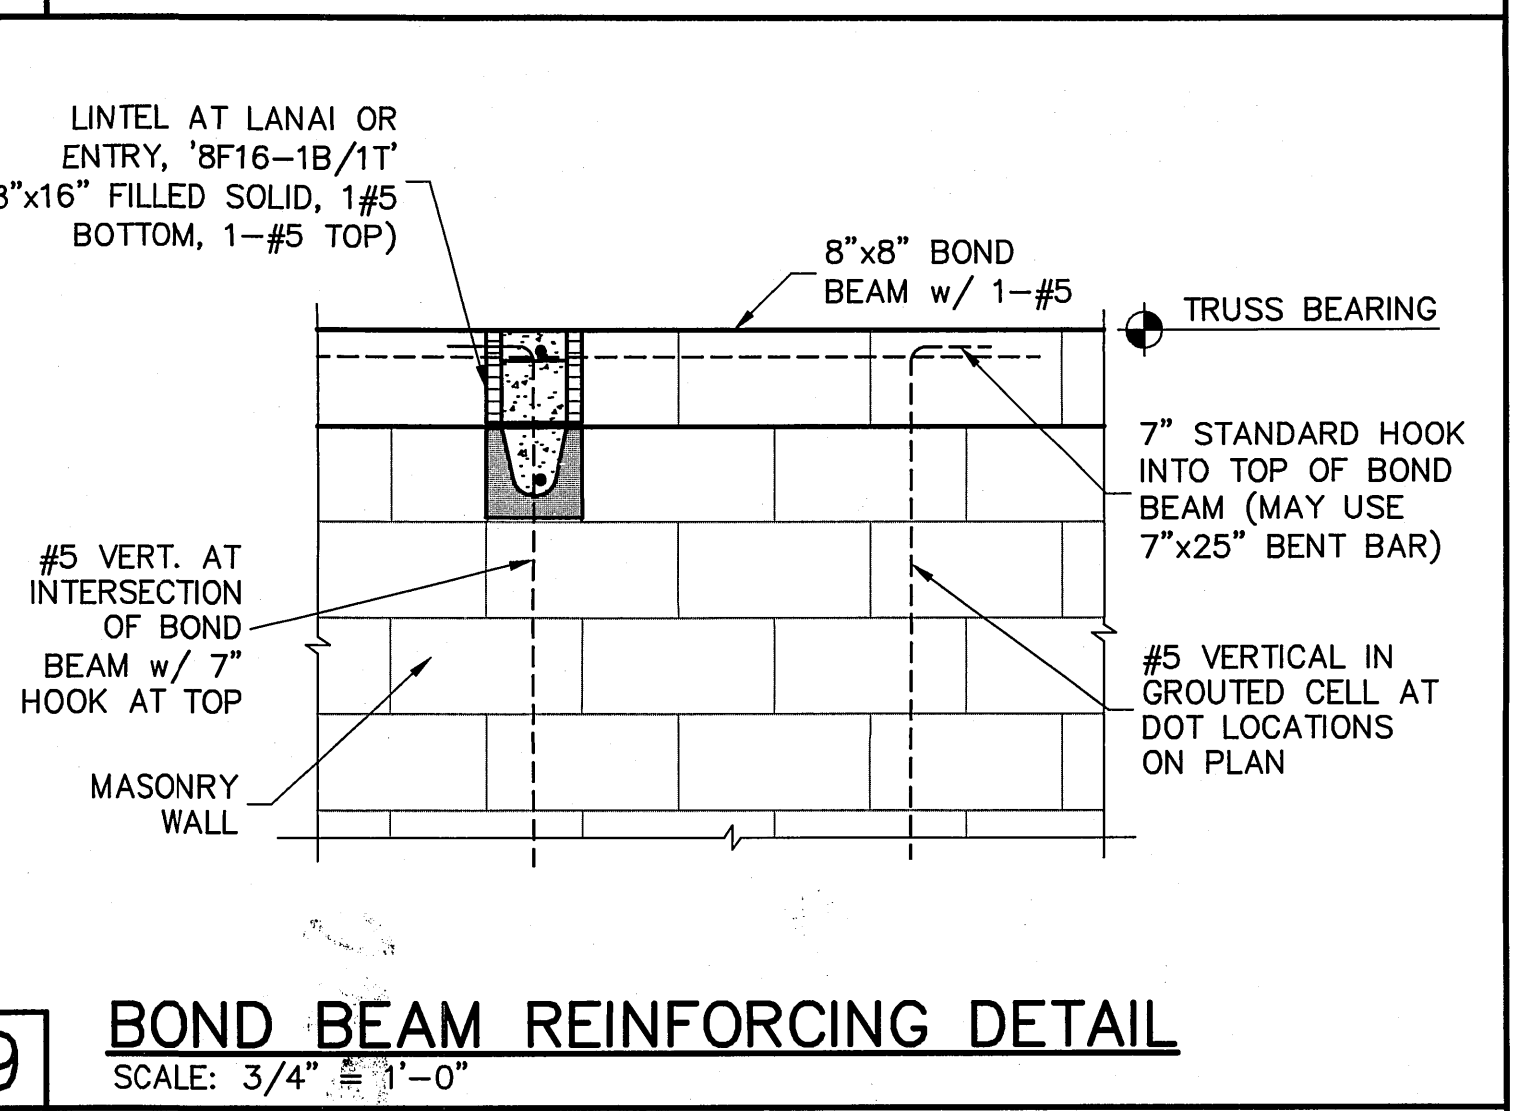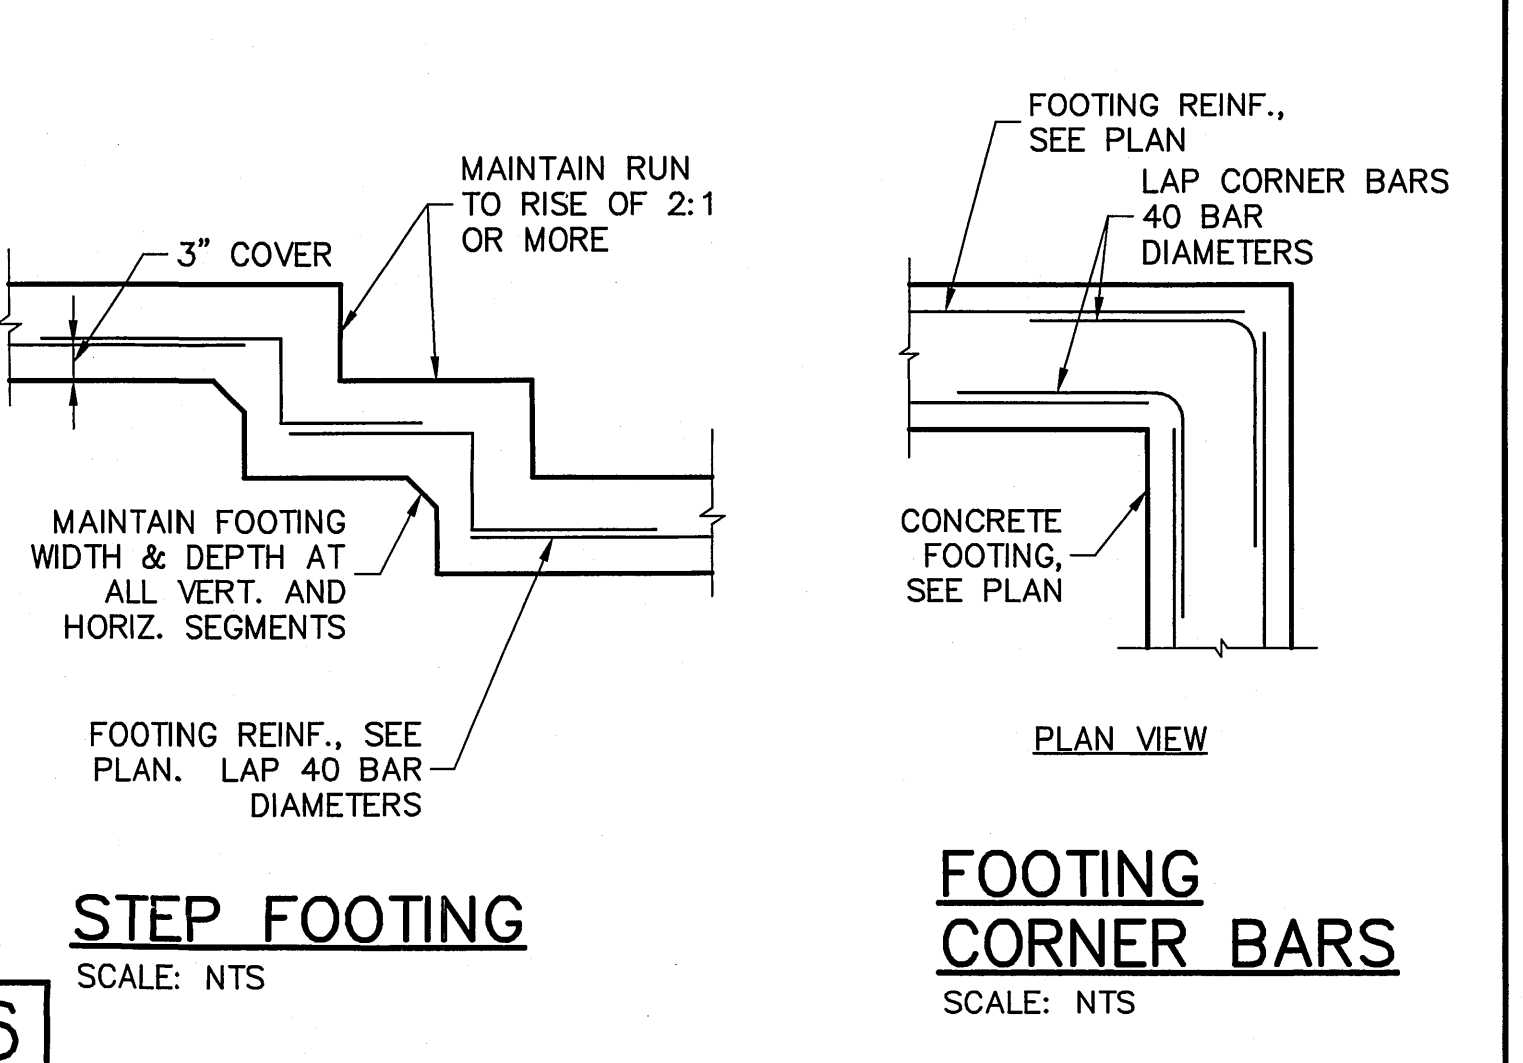

DESIGN CRITERIA:

DESIGN IN ACCORDANCE WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 2010 - RESIDENTIAL.

1. FLOOR & ROOF UNIFORM LOADS:
ELEVATED FLOORS: LIVE LOAD 40 PSF, DEAD LOAD 20 PSF
ROOF: LIVE TOP CHORD 20 PSF
LIVE BOTTOM CHORD 10 PSF (NON-CONCURRENT w/ TCLL)
CEMENT ROOF TILE DEAD LOAD 25 PSF TOTAL
SHINGLE/METAL ROOFING DEAD LOAD 15 PSF TOTAL
MINIMUM DEAD LOAD FOR WIND: TC 5 PSF, BC 5 PSF

DEFLECTION CRITERIA:
FLOOR L/480 LIVE, L/360 TOTAL
ROOF L/240 LIVE, L/180 TOTAL

2. WIND LOADS:
WIND DESIGN PER, ASCE7-10
BASIC WIND SPEED (ASCE7-10) 160 MPH
NOMINAL WIND SPEED (Vasd TABLE R301.2.1.3) 124 MPH
BUILDING CATEGORY II
IMPORTANCE FACTOR 1.00
EXPOSURE B
MEAN ROOF HEIGHT < 30 FT
ROOF PITCH 5/12
ENCLOSURE CLASS ENCLOSED
INTERNAL PRES. COEFF. +/- 0.18
WINDOW/DOOR DESIGN WIND PRESSURE, SEE TABLE IN DETAIL 3.
SOFFITS - PER R703.1.3, ALL SOFFITS SHALL BE CAPABLE OF RESISTING THE DESIGN PRESSURES SPECIFIED IN TABLE R301.2(2) FOR WALLS. PER R616.4, SOFFIT TESTING SHALL USE ASCE7 DESIGN PRESSURES USING 0.6W LOAD FACTOR.

3. REINFORCED CONCRETE:
DESIGN AS PER ACI 318-08
REQUIRED COMPRESSIVE STRENGTH AT 28 DAYS:
SLAB ON GRADE f'c = 2500 PSI
3 1/2\"/>

WELDED WIRE FABRIC - ASTM A185

SPLICES IN REINFORCING, SHALL BE 40 BAR DIAMETERS. NON-CONTACT LAP SPLICES MAY BE USED PROVIDED REINFORCING IS NOT SPACED MORE THAN 5\"/>

FORMWORK AND SHORING SHALL REMAIN IN PLACE UNTIL CONCRETE HAS REACHED AT LEAST 2/3 OF THE REQUIRED 28 DAY STRENGTH.

4. REINFORCED MASONRY:
DESIGN PER ACI 530-08
REQUIRED COMPRESSIVE STRENGTHS:
MASONRY WALLS f'm = 1500 PSI

REINFORCING STEEL - ASTM A615 GRADE 60.
SPLICES IN REINFORCING, SHALL BE 48 BAR DIAMETERS.
ALL CONCRETE MASONRY UNITS SHALL BE COMPOSED OF ASTM C90, GRADE N-1 HOLLOW CONCRETE MASONRY UNITS WITH TYPE 'S' MORTAR. GROUT ALL CELLS CONTAINING VERTICAL REINFORCEMENT WITH 3000 PSI PEA ROCK CONCRETE GROUT. ALL CELLS BELOW FINISHED GRADE SHALL BE GROUTED SOLID. ALL EXTERIOR WALLS SHALL BE REINFORCED FULL HEIGHT AT DOT LOCATIONS ON PLAN. PROVIDE HORIZONTAL JOINT REINFORCEMENT IN WALLS AT 16\"/>

5. DELEGATED-ENGINEERED WOOD ROOF & FLOOR TRUSSES:
ALL WOOD ROOF AND FLOOR TRUSSES SHALL BE DESIGNED BY A DELEGATED TRUSS ENGINEER PER RULE 61G15-31.003 OF THE FLORIDA ADMINISTRATIVE CODE. ALL TRUSSES SHALL HAVE TEMPORARY BRACING PER "COMMENTARY AND RECOMMENDATIONS FOR HANDLING, INSTALLING AND BRACING METAL PLATE CONNECTED WOOD TRUSSES, HIB-91." FOR OTHER BRACING REQUIREMENTS, NOTIFY ENGINEER. PROVIDE PERMANENT BRACING PER TRUSS MFR. SHOP DRAWINGS. IF PERMANENT BRACING IS NOT SPECIFIED, CONTACT ENGINEER.

6. FOUNDATION:
CONVENTIONAL SHALLOW CONCRETE FOOTINGS
SOIL BEARING CAPACITY 2000 PSF
THE CONTRACTOR SHALL BE RESPONSIBLE FOR DETERMINING THE SUITABILITY OF THE SOIL CONDITIONS FOR THE INTENDED STRUCTURE AND ASSUMED SOIL BEARING CAPACITY. IT IS RECOMMENDED THAT A GEOTECHNICAL FIRM BE HIRED TO PERFORM A SITE EVALUATION.

7. DIMENSIONS: VERIFY ALL DIMENSIONS WITH HOUSE PLANS. SEE HOUSE PLANS, MECHANICAL, ELECTRICAL AND PLUMBING DRAWINGS FOR EMBEDS, OPENINGS, SLEEVES, ETC. WHICH ARE NOT SHOWN ON STRUCTURAL DRAWINGS.

8. MEANS AND METHODS: THE STRUCTURAL ENGINEER SHALL NOT HAVE CONTROL OR BE RESPONSIBLE FOR CONSTRUCTION MEANS, METHODS, TECHNIQUES, PROCEDURES, OR SEQUENCES TEMPORARY BRACING, SHORING, CURING OR OTHER MEANS TO SUPPORT STRUCTURAL ELEMENTS IN PLACE DURING CONSTRUCTION. FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR, OR ANY OTHER PERSONS PERFORMING THE WORK OR FOR THE FAILURE OF ANY OF THEM TO CONSTRUCT THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.

9. SHOP DRAWINGS: SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED TO THE ENGINEER FOR REVIEW FOR ALL STRUCTURAL ELEMENTS UTILIZING PREFABRICATED COMPONENTS. ONE SET OF SIGNED & SEALED TRUSS ENGINEERING SHALL BE DELIVERED TO THE ENGINEER OF RECORD FOR THE STRUCTURE PER FLORIDA ADMINISTRATIVE CODE 61G15-30.005 AND 61G15-31.003.

FOR SOUTHERN TRUSS

REVISIONS

BY

STRUCTURAL ENGINEERING:
STRUCTURAL SYSTEMS OF NORTH FLORIDA
1834 SE 47TH STREET, SUITE #3
CAPE CORAL, FL 33904
(239) 549-4554
CA# 8829

DESIGNED/DRAWN
DWB/DWB
CHECKED
DWB
DATE
06/27/12
SCALE
VARIES
JOB NO.
DR2696
SHEET
S-1

DESIGNED IN ACCORDANCE WITH FLORIDA BUILDING CODE 2010

BUILDER:
D.R. HOOTON
America's Builder
STRUCTURAL DETAILS
MODEL 1804 A
7879 BUCK'S RUN DRIVE
NAPLES, FLORIDA
LOT: 3 SUBDIVISION: BUCK'S RUN