





CUST/PROJECT		APPROVED BY		COLOUR		MODEL	150	300	450	600
JOB NUMBER		SIGNED BY		STANDARD COLOUR B.D.W		"L"	900	1100	1500	1800
MODEL		DATE		VALVES REQ	Y	N	"C"	530	730	1130
CEILING								HEATING UNITS - 240		
150	300	450	600					COOLING UNITS - 260		



L/HAND
COIL AND
DRAIN

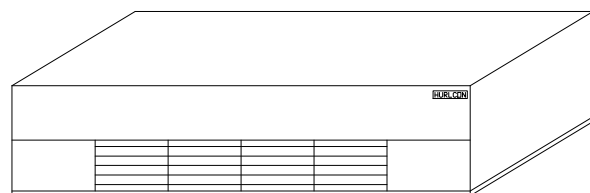

R/HAND
COIL AND
DRAIN

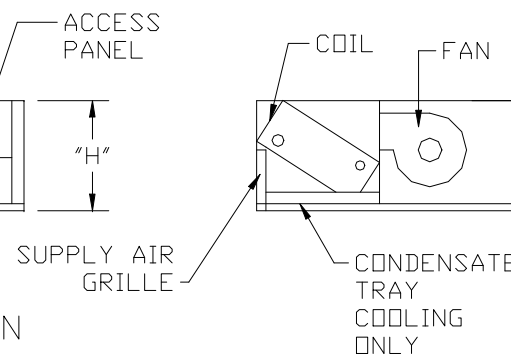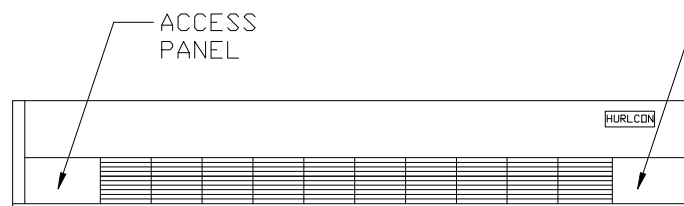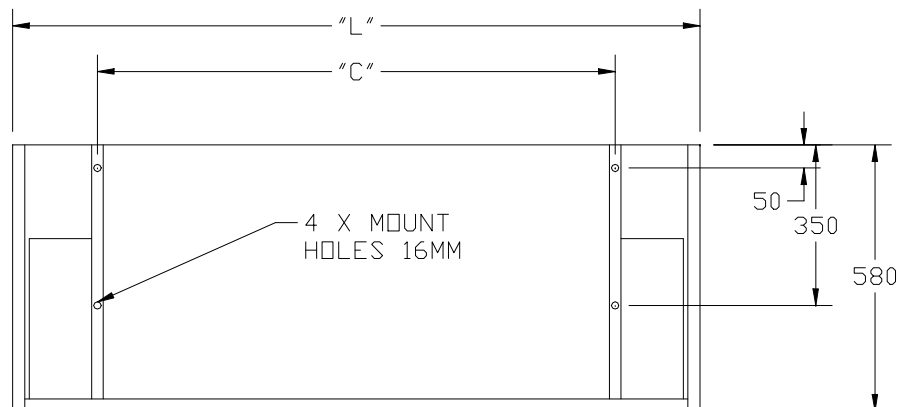

NOTE: ELECTRICAL BOX IS OPPOSITE COIL AND DRAIN CONNECTION

				UNLESS OTHERWISE STATED ALL TOLERANCES +/-0.5MM		© HURLCON P/L Ph 9701 5166		DWG NO: CEILING		SHT 1 OF 1	
				DRAFTING STANDARD AS 1100		THIS DRAWING AND THE INFORMATION IT CONTAINS MUST NOT BE DUPLICATED WITHOUT THE PERMISSION OF HURLCON P/L. ALL COPIES MUST BE RETURNED UPON REQUEST.		DWG TITLE:		REV:	
REV		CHANGE DESCRIPTION		DATE		BY		DRAWN BY: B BUTLER		APPROVED: B BUTLER	
								DATE: 27/05/03		DATE: 27/05/03	
								SCALE: NTS		MATERIAL: -	
										00	